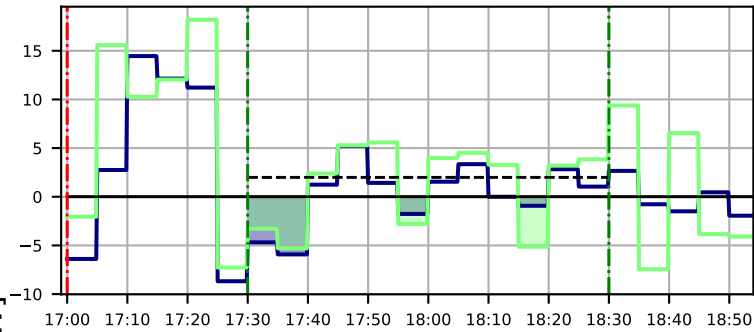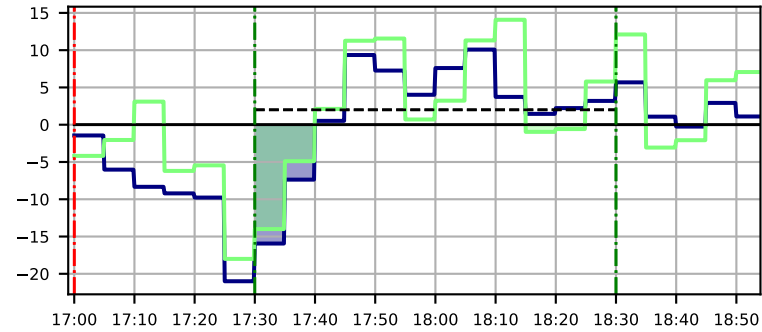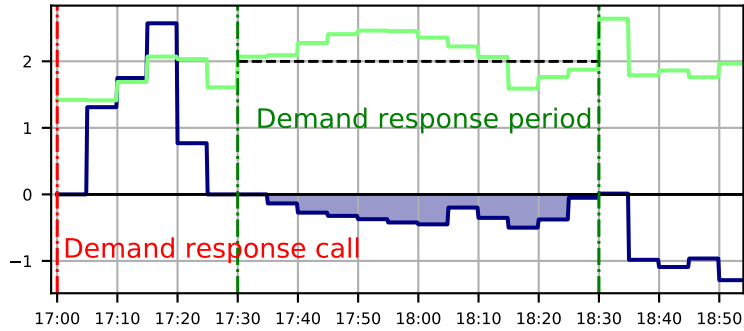Differences to Reference Profiles set by MPC

Static Pricing
Winter 7.1.

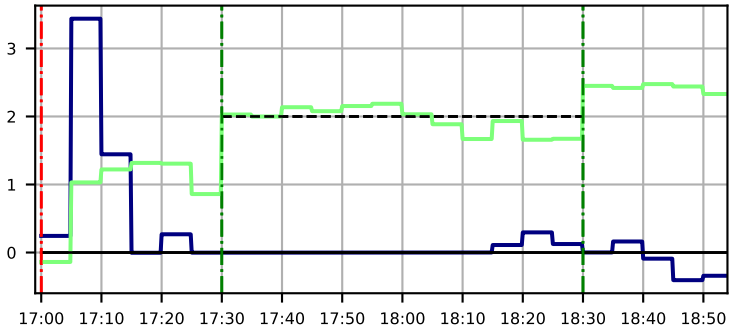Dynamic pricing
Winter 7.1.

Spring 1.3.

Spring 1.3.

Demand response period
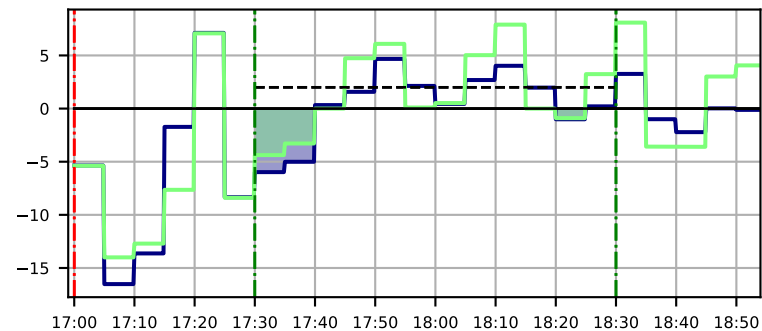
Demand response call

Autumn 20.11.

Autumn 20.11.

Difference to reference [kW]
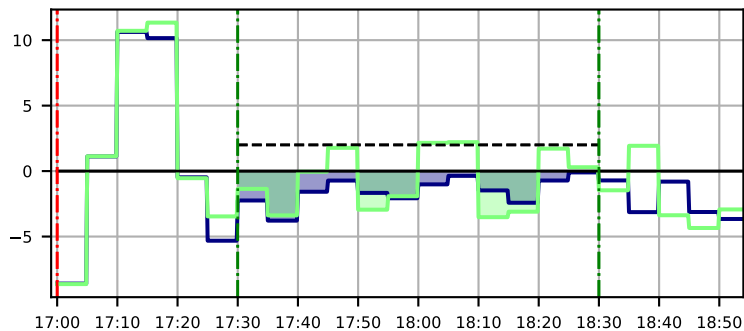
Time

Decentralised   Centralised