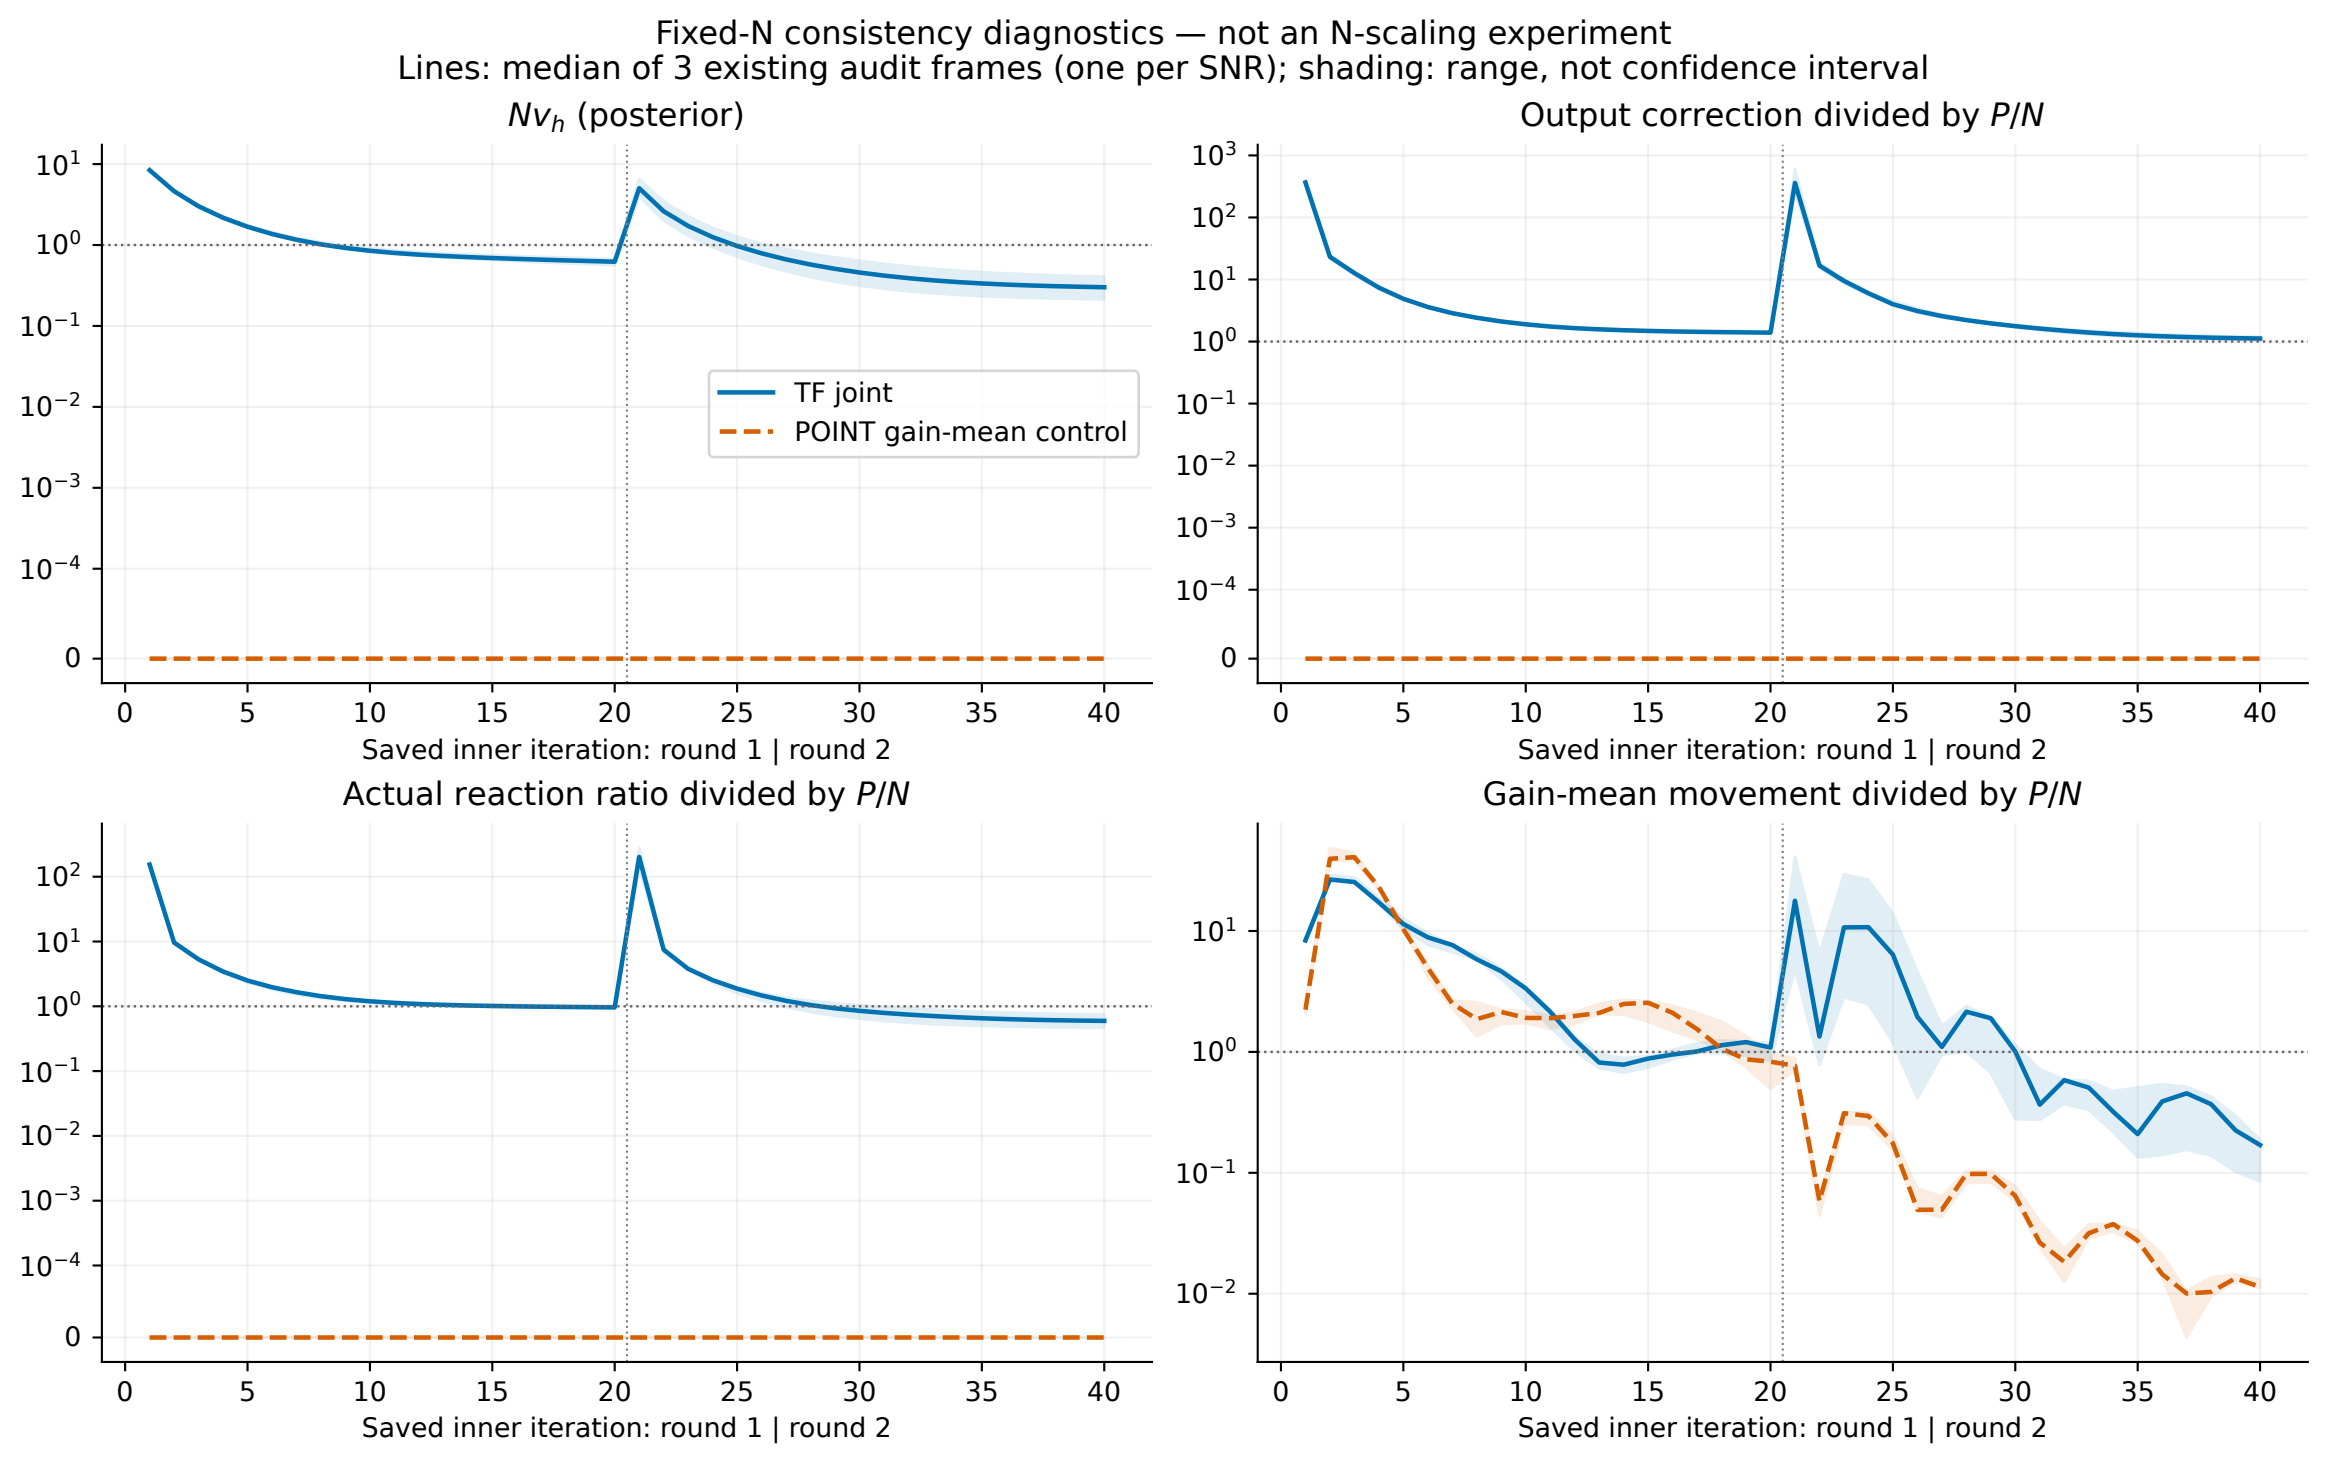
Fixed-N consistency diagnostics — not an N-scaling experiment
Lines: median of 3 existing audit frames (one per SNR); shading: range, not confidence interval
Nv_h (posterior)
Output correction divided by P/N
Actual reaction ratio divided by P/N
Gain-mean movement divided by P/N
TF joint
POINT gain-mean control
Saved inner iteration: round 1 | round 2