
PIPING AND INSTRUMENTATION DIAGRAM (P&ID)

Dissolved Oxygen Control Loop 201 – Aeration Stage of the Activated Sludge Process

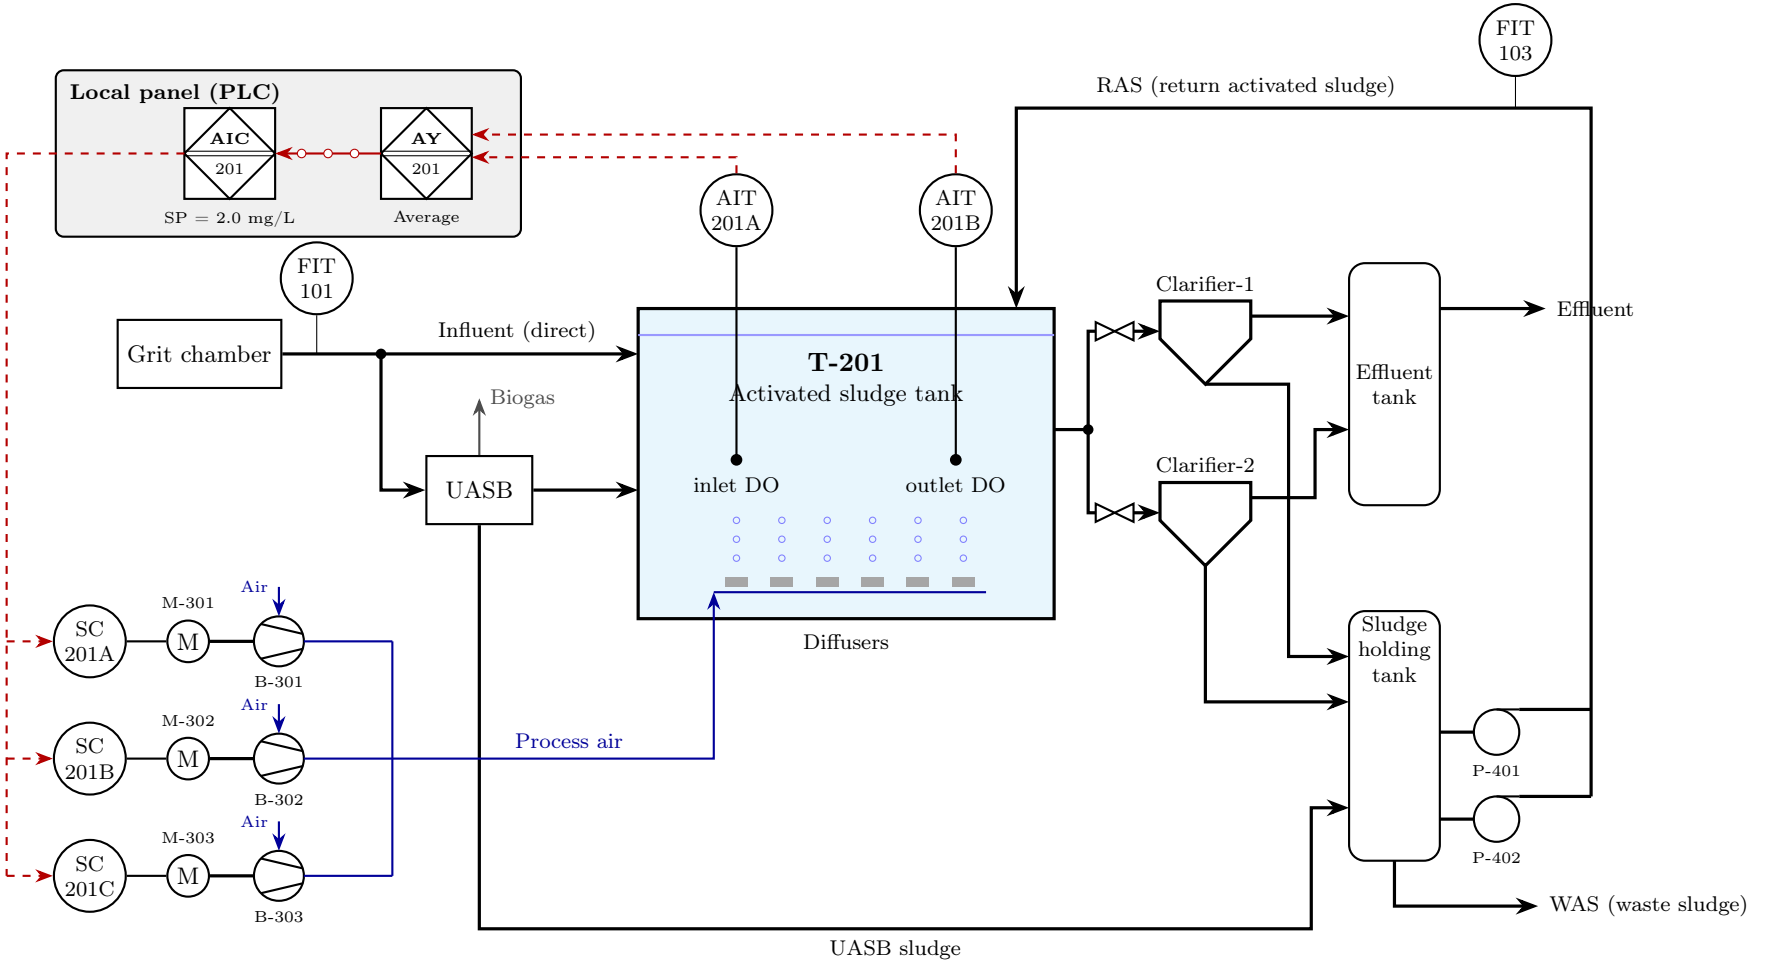

Process line Air Electrical signal (4–20 mA) Software link

Field instrument PLC function in local panel

AIT: DO transmitter AY: average AIC: DO controller FIT: flow transmitter
SC: speed control (VFD) M: motor B: blower P: pump RAS / WAS: return / waste activated sludge

P&ID – Aeration stage, DO loop 201
Plant: WWTP, module M2 (ISA-5.1 symbols)
Drawn by: M. E. Peña Choachi
Date: 2026-11-05 Rev.: 0