
WASTEWATER TREATMENT PLANT – AERATION STAGE P&ID

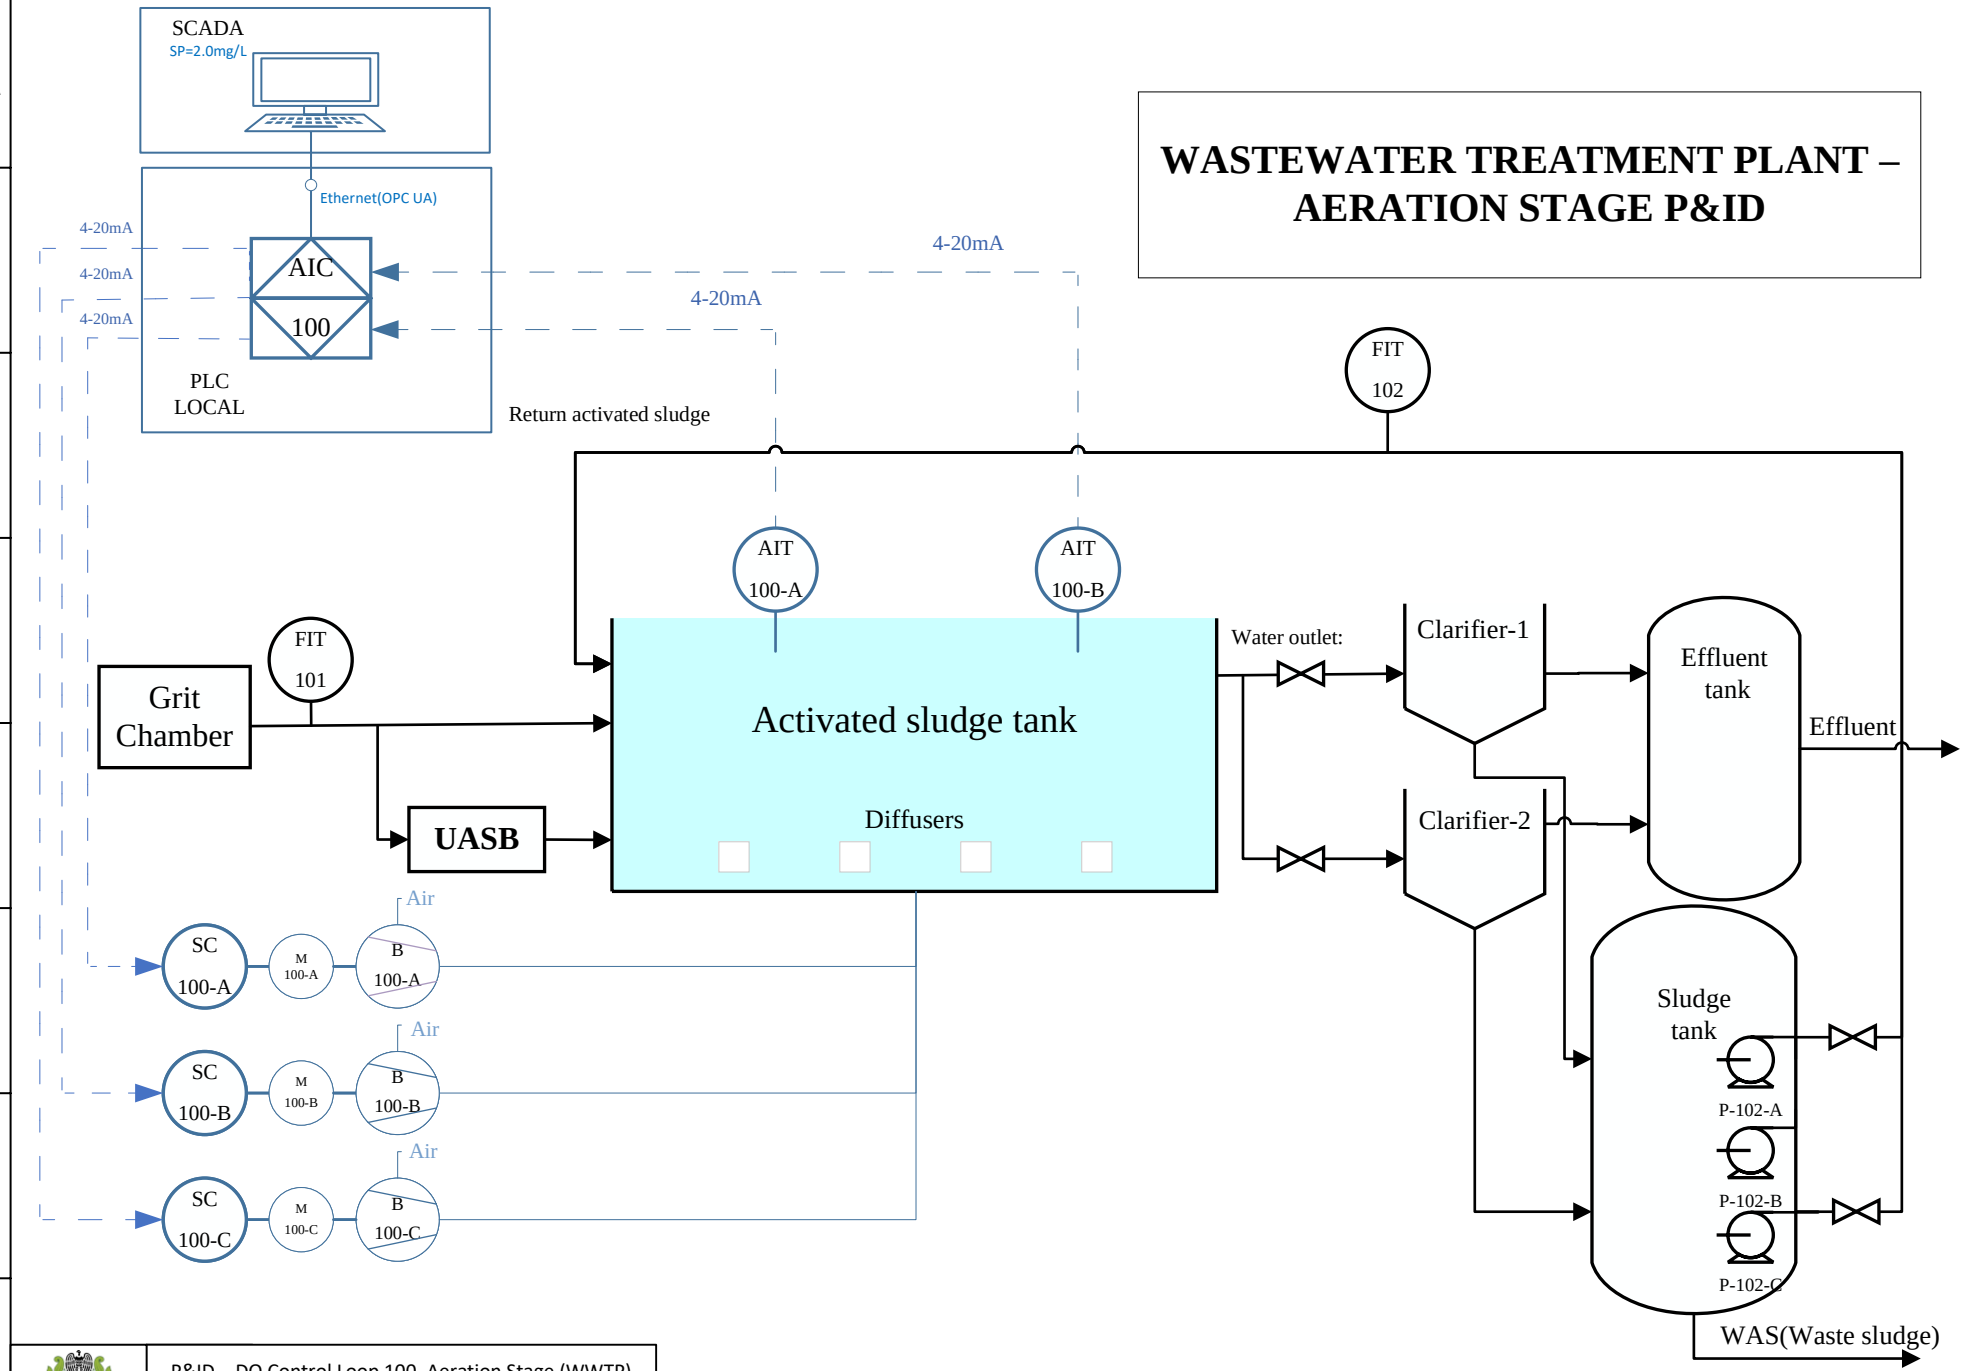

P&ID – DO Control Loop 100, Aeration Stage (WWTP) Drawn by: Manuel Esteban Peña Choachi"	SIZE:NTS	FSCM NO	PTAR-P&ID-100	REV
ISSUED 2026-11-05	SCALE: A		SHEET	1 OF 1