


Sili fixed-validation loss ablation — both selected step 0

Thick-reference COT RMSE (COT ≥ 30)



All-valid COT RMSE

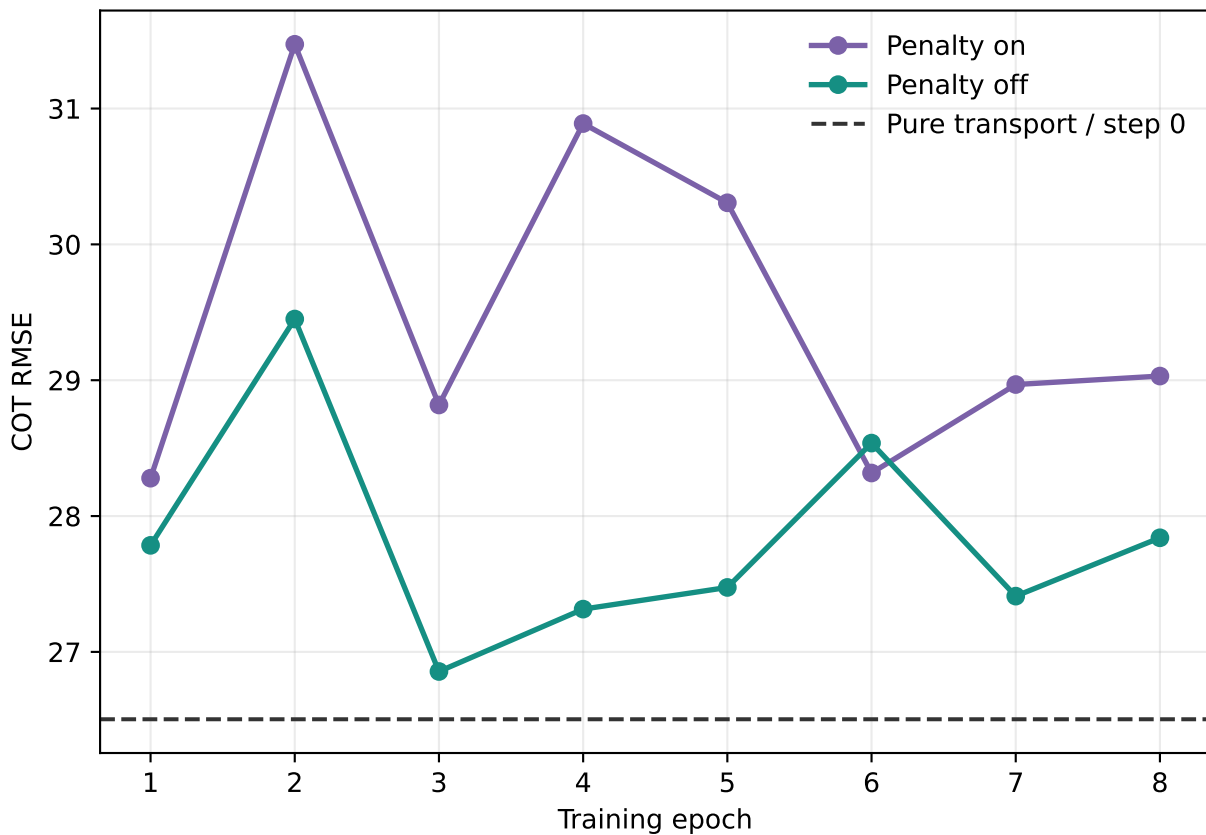