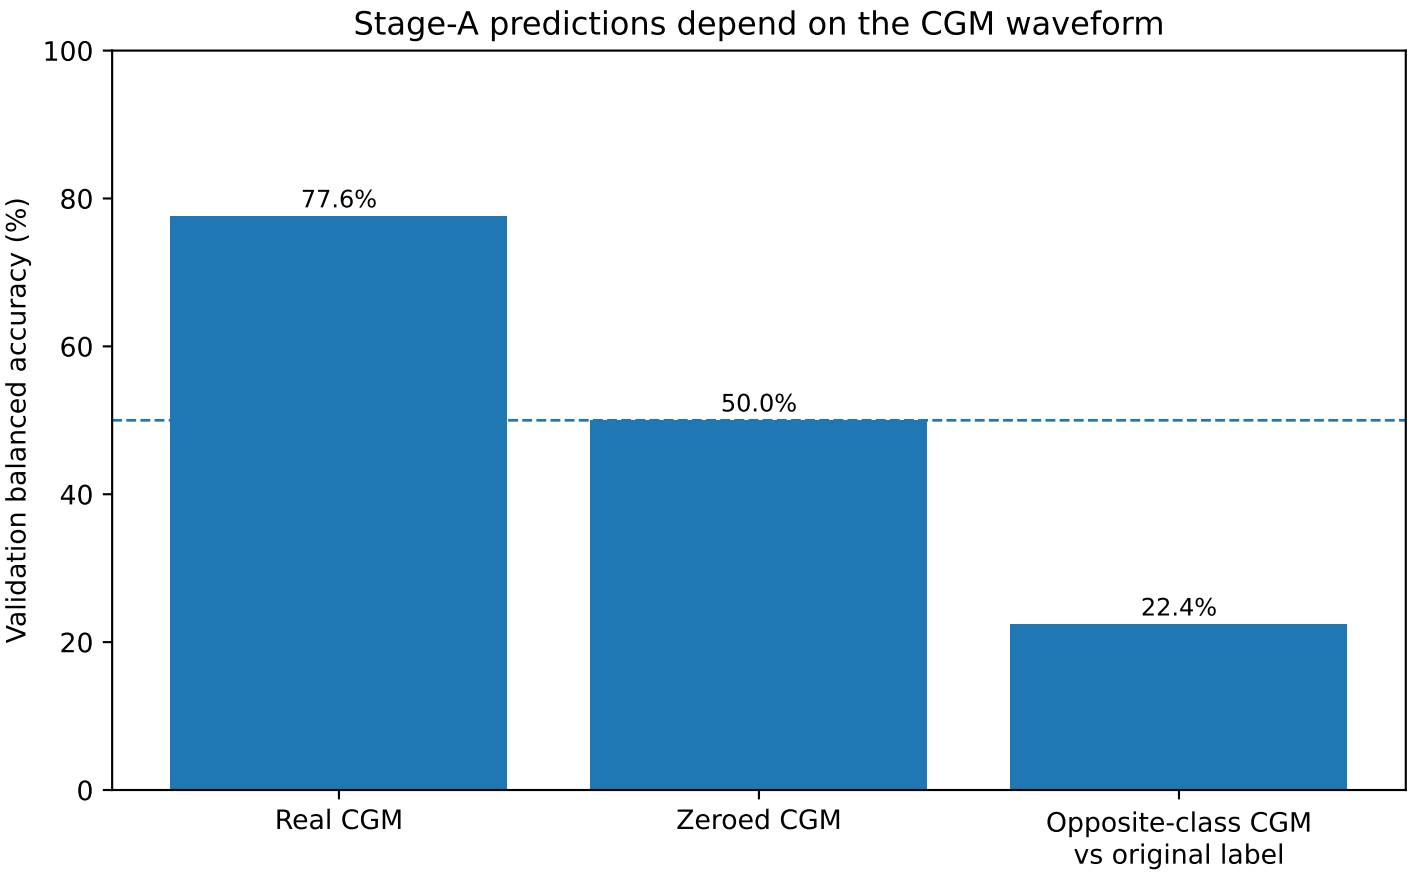
Stage-A predictions depend on the CGM waveform
Validation balanced accuracy (%)
100
80
60
40
20
0
77.6%
50.0%
22.4%
Real CGM
Zeroed CGM
Opposite-class CGM
vs original label