



REFERENCE KEYNOTES	
DIVISION 03 - CONCRETE	
CL	- 4" THICK CONCRETE LANDING, MINIMUM 3'-0" DEEP x DOOR WIDTH. LANDING SHALL NOT EXCEED 1/4 UNIT VERTICAL IN 12 UNITS HORIZONTAL (2%)
DIVISION 06 - WOOD AND PLASTICS	
1HR	- 1 HOUR FIRE RATED WALL TO UNDERSIDE OF ROOF SHEATHING PER R302.1 (1), EAVES REDUCED TO 0 HRS UNDER R302.1 (1) SUBNOTE (a), USE PRESCRIPTIVE 1-HOUR ASSEMBLY PER R337.7.4
DIVISION 07 - THERMAL AND MOISTURE PROTECTION	
INS21	- R-21 INSULATION
INS38	- R-38 INSULATION, UNFACED BATTS
ROOF ACCESSORIES -	
AA	- 22"x30" ATTIC ACCESS, PERMANTLY ATTACH INSULATION USING ADHESIVE OR MECHANICAL FASTENERS TO ACCESS PANEL. ACCESS SHALL BE GASKETED TO PREVENT AIR LEAKAGE
ROOFING AND SIDING -	
SHG	- CLASS 'A' LIFETIME COMPOSITION ROOF SHINGLES <i>o</i> / 15LB FELT COMPLIANT WITH TABLE R905.1(1). FASTEN ROOFING WITH CORROSION RESISTANT FASTENERS CRC R905.2.5
DIVISION 09 - FINISHES	
BBS	- 5/8" T1-11 BOARD AND BATTEN SIDING <i>o</i> / TWO LAYER GRADE 'D' PAPER OR 1 LAYER TYVEK. NAILING PER STRUCTURAL
FLOORING -	
LVF	- LUXURY VINYL FLOORING
DIVISION 11 - EQUIPMENT	
DW18	- 18" DISHWASHER
FR30	- FRIDGE, 30" WIDE
MWEH	- MICROWAVE EXHAUST HOOD COMBINATION, MIN VENTILATION RATE OF 100 CFM (CMC TABLE 403.7), HVI RATED & LIMITED TO 3 SONES, HERS VERIFICATION REQUIRED
RG30-E	- 30" RANGE - ELECTRIC
WD	- STACKED WASHER AND DRYER, PROVIDE MIN 2" STANDPIPE
WDT	- WASHER DRYER TERMINATION, A MINIMUM 4" DIA, ALL METAL, SMOOTH INTERIOR SURFACE CLOTHES DRYER VENT DUCT SHALL NOT EXCEED 14' (HORIZ. OR VERT.), INCLUDING TWO 90° TURNS WITHOUT AN ENGINEERED "MECHANICAL UPGRADE". TWO FEET OF LENGTH SHALL BE DEDUCTED FOR EACH ADDITIONAL TURN. DUCT TO BE INSTALLED PER MANUFACTURES INSTALLATION INSTRUCTIONS AND NOT BE WITH SCREWS THAT EXTEND INTO THE DUCT.
DIVISION 12 - FURNISHINGS	
BC24	- 24" DEEP BASE CABINET
CS12	- 12" CLOSET SHELF, x4
UC12	- 12" DEEP UPPER CABINET
UC24	- 24" DEEP UPPER CABINET
DIVISION 13 - SPECIAL CONSTRUCTION	
PS	- CLOSET POLE & SHELF
DIVISION 15 - MECHANICAL	
40HPE	- 40 GALLON HYBRID HEAT PUMP ELECTRIC HOT WATER HEATER, DRAIN TO EXTERIOR
MSU	- MINI SPLIT OUTDOOR UNIT, INSTALLED PER MANUFACTURER SPECIFICATIONS
DIVISION 16 - ELECTRICAL	
EPP	- ELECTRICAL SUB PANEL, 120/240V 125A, W/ UFER GROUND, PROVIDE 30"x30" WORKING AREA CENTERED IN FRONT OF PANEL
DIVISION 17 - PLUMBING	
KS	- KITCHEN SINK
SK48	- SINK w/VANITY 48"
TS35	- TILE SHOWER 3x5
WC	- WATER CLOSET, MINIMUM 30" CLEAR WIDTH CENTERED ON WATER CLOSET & 24" CLEAR SPACE OFF NOSE OF WATER CLOSET.


SILL: MIN 2" AT CONC,
MIN 8" AT EXT. GRADE
FINISH:MIN 2" AT CONC,
MIN 4" AT EXT. GRADE

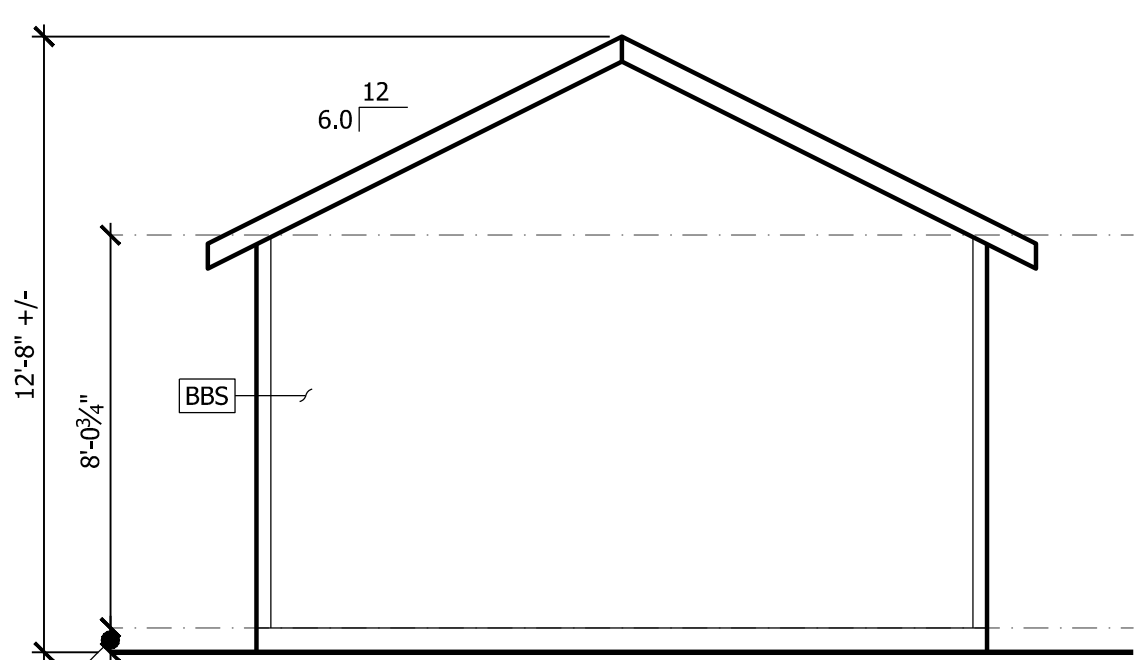


B LEFT ELEVATION
A2.1 1/4" = 1'-0"

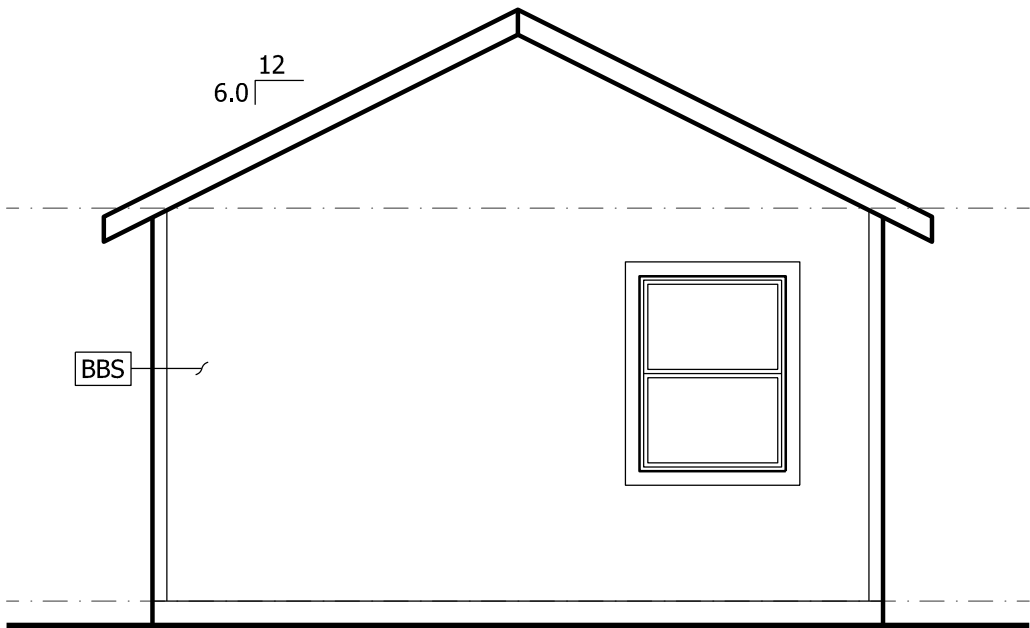

C RIGHT ELEVATION
A2.1 1/4" = 1'-0"

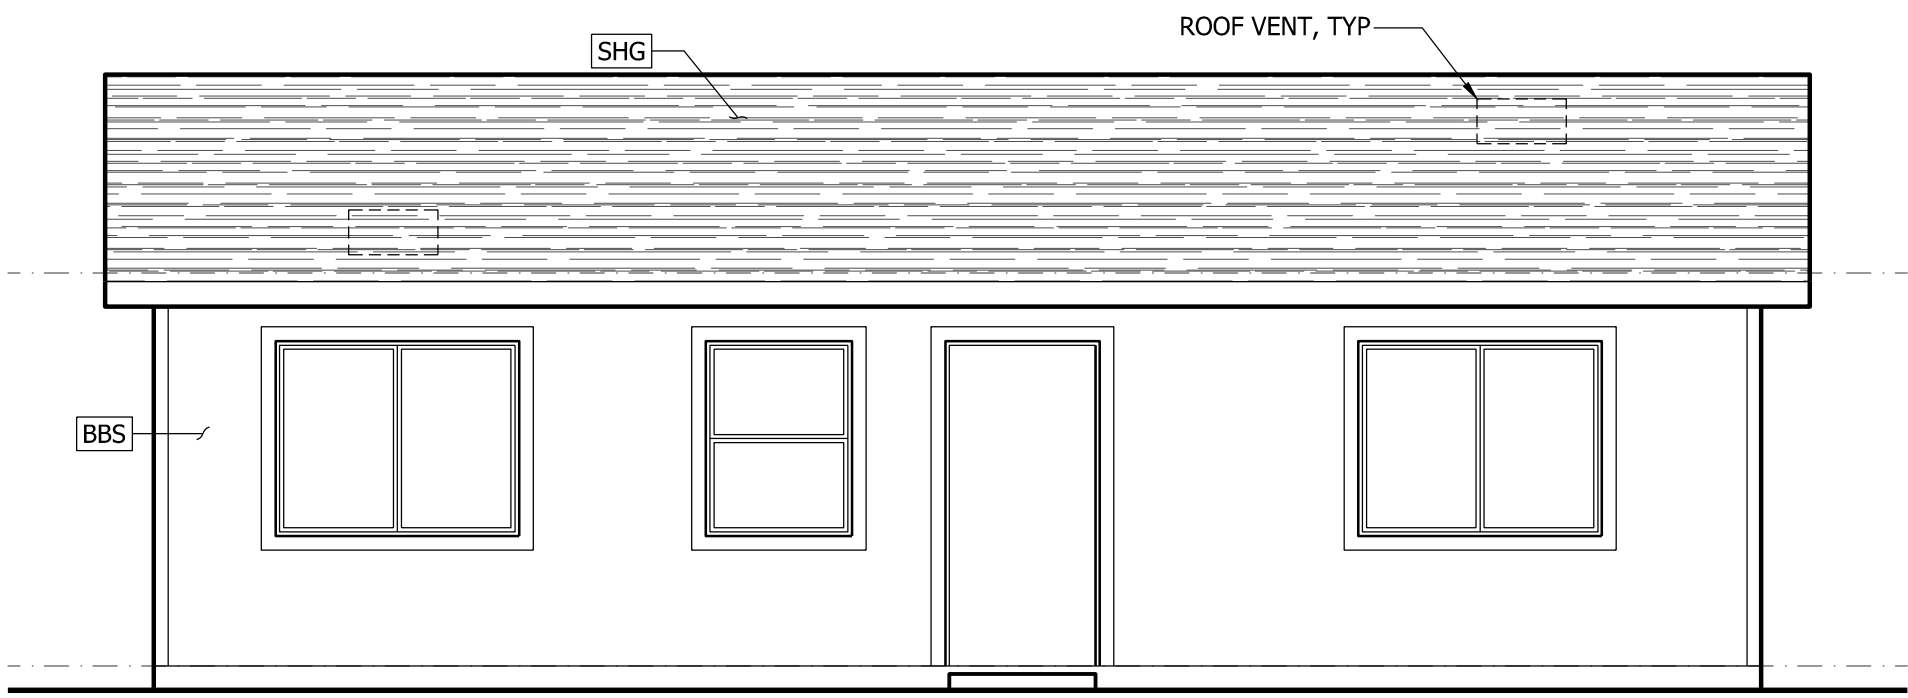


A FRONT ELEVATION
A2.1 1/4" = 1'-0"

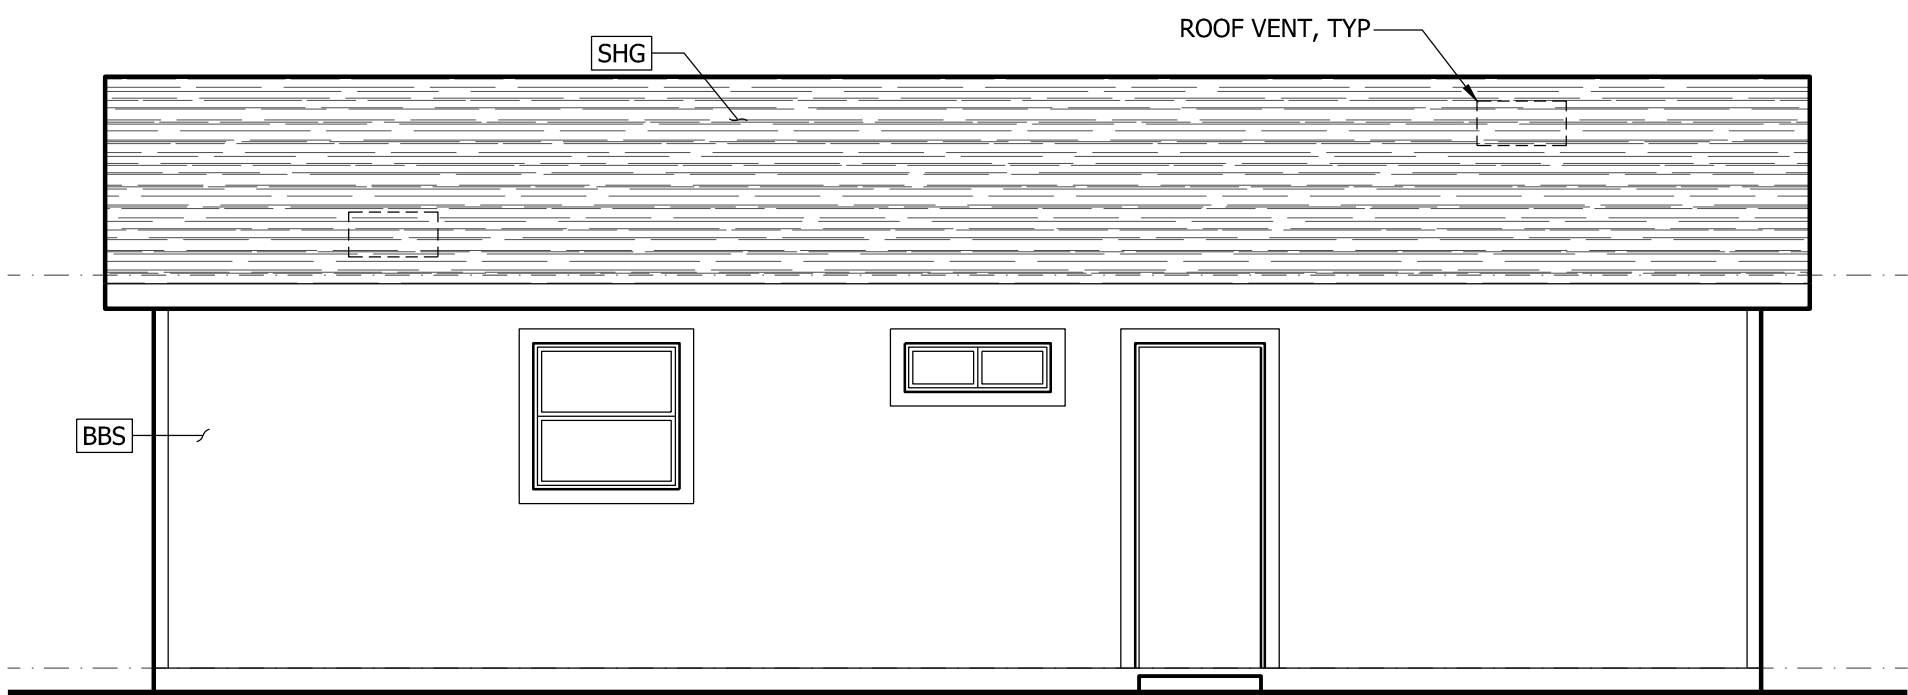

D REAR ELEVATION
A2.1 1/4" = 1'-0"

DOOR AND FRAME SCHEDULE				
NUMBER	SIZE	STYLE	FIRE RATING	NOTES
1	3'-0" x 6'-8" x 1-3/4"	SINGLE - EXTERIOR	--	--
2	2'-6" x 6'-8" x 1-3/4"	SINGLE - INTERIOR	--	--
3	2'-6" x 6'-8" x 1-3/4"	SINGLE - INTERIOR	--	--
4	PR 1'-4" x 6'-8" x 1-3/4"	BIFOLD	--	--
5	2'-6" x 6'-8" x 1-3/4"	SINGLE - EXTERIOR	--	--
6	PR 3'-0" x 6'-8" x 1-3/4"	HORIZONTAL BYPASS	--	--
7	PR 1'-4" x 6'-8" x 1-3/4"	BIFOLD	--	--

WINDOW SCHEDULE							
NUMBER	SIZE		STYLE	HEAD HEIGHT	SHCG	U-FACTOR	NOTES
	WIDTH	HEIGHT					
1	5'-0"	4'-0"	SLIDER	6'-8"	.23	.30	TEMP
2	3'-0"	4'-0"	SINGLE HUNG	6'-8"	.23	.30	TEMP
3	5'-0"	4'-0"	SLIDER	6'-8"	.23	.30	--
4	3'-0"	4'-0"	SINGLE HUNG	6'-8"	.23	.30	--
5	3'-0"	3'-0"	SINGLE HUNG	6'-8"	.23	.30	--
6	3'-0"	1'-0"	SLIDER	6'-8"	.23	.30	--

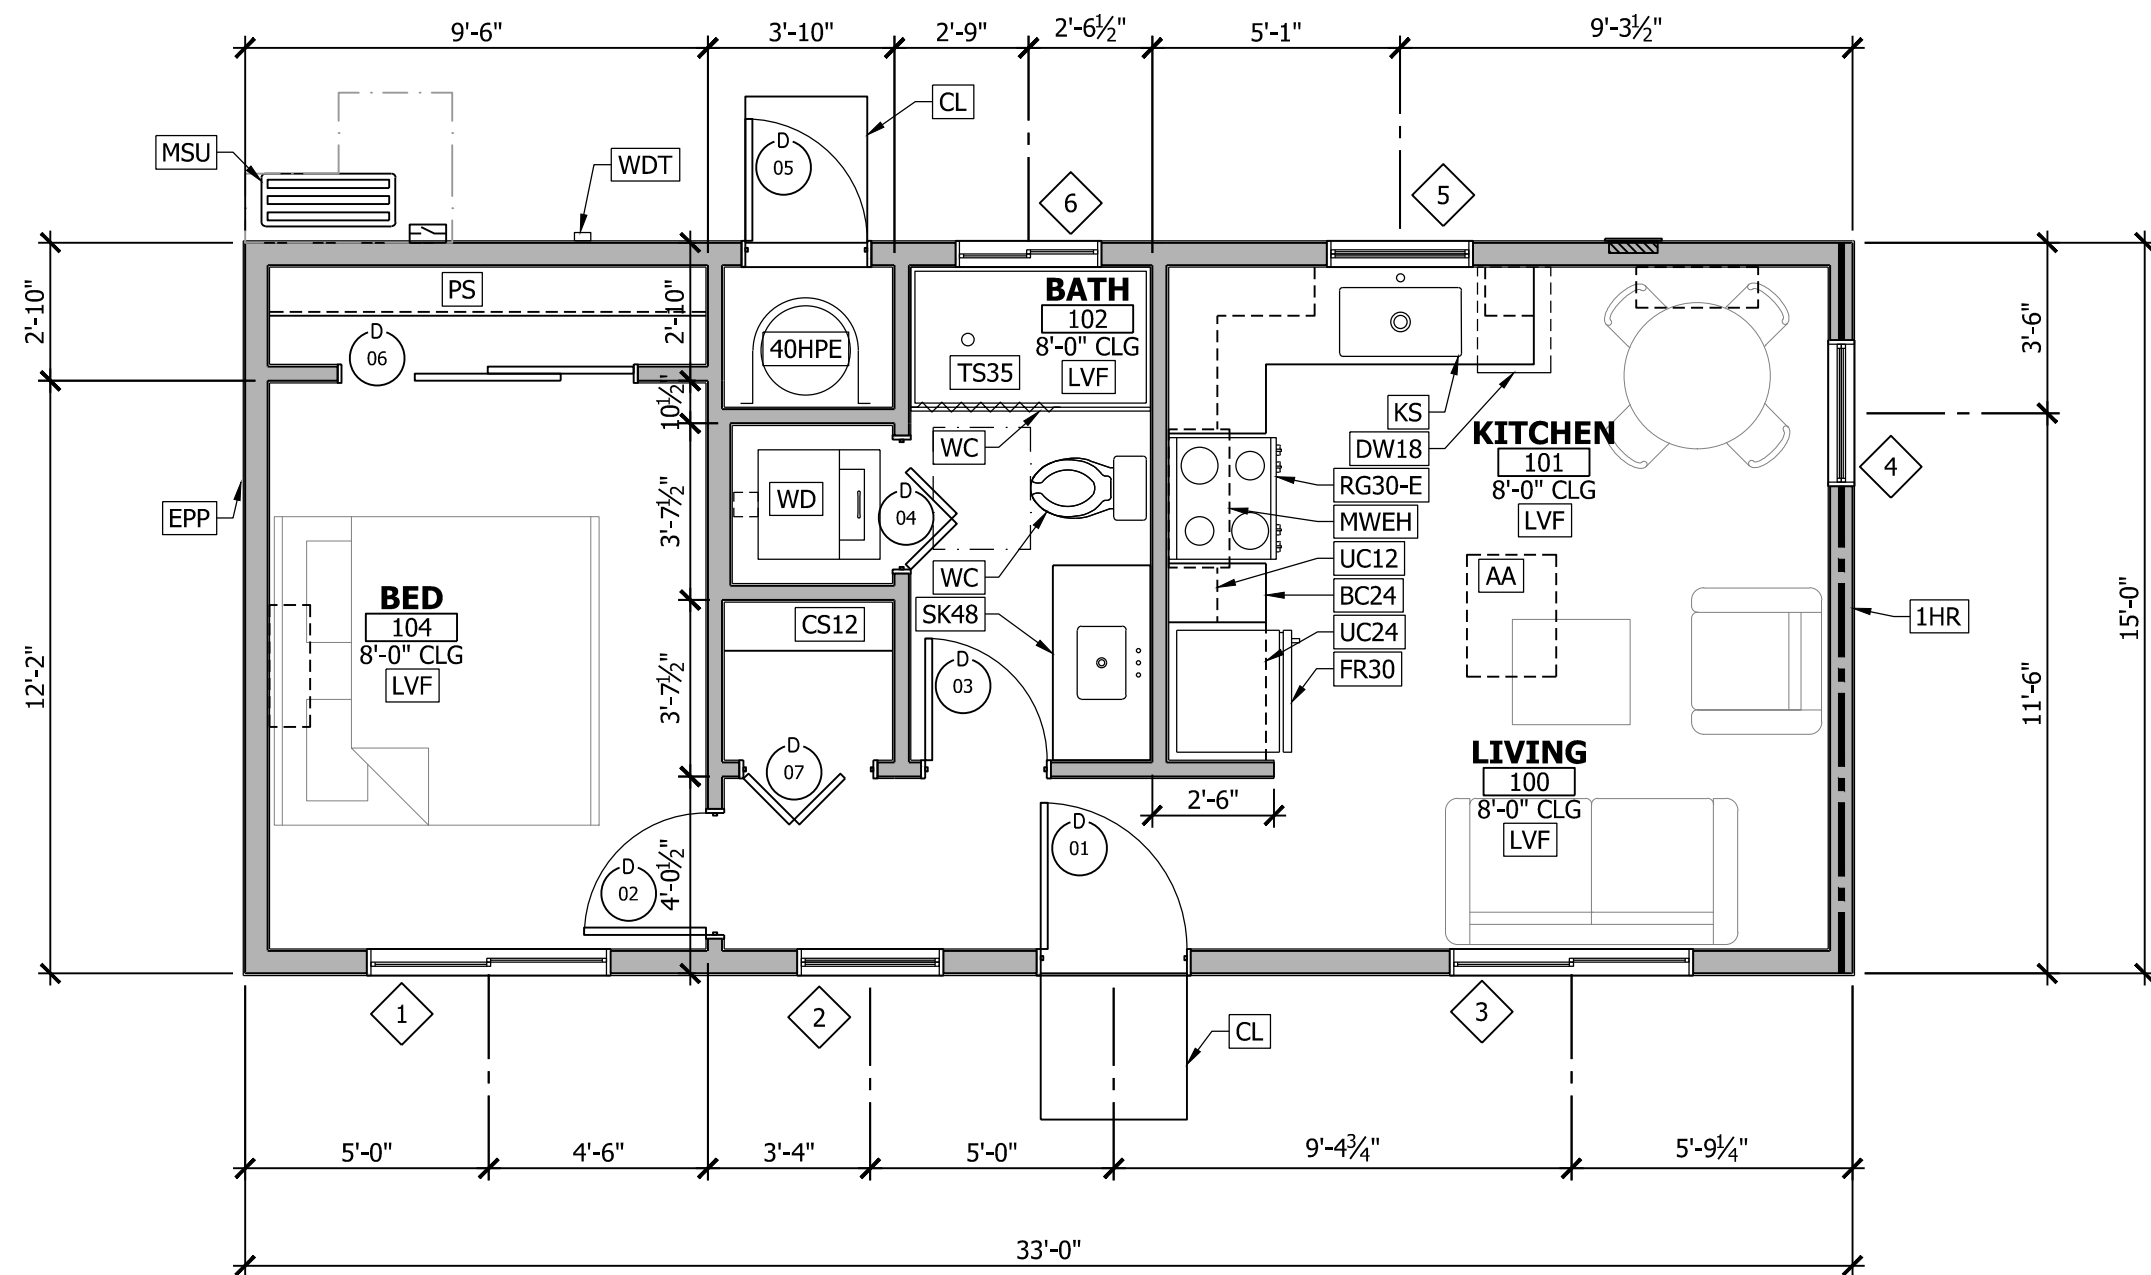

1 FLOOR PLAN
A2.1 1/4" = 1'-0"

0 1' 2' 3' 4' 5' 10'
495 SF LIVING

