

LEGEND

SWITCH (DIMMABLE UNLESS OTHERWISE SPECIFIED)
MULTI SWITCH
ETHERNET HUB
ETHERNET POINT
SERVICE DISCONNECT
ARC FAULT CIRCUIT RECEPTACLE (TAMPER RESISTANT)
GFCI RECEPTACLE ON ARC FAULT CIRCUIT (TAMPER RESISTANT)
WATERPROOF GFCI RECEPTACLE ARC FAULT CIRCUIT
220 VOLT RECEPTICAL
RECESSED LIGHT FIXTURE
WALL MOUNTED LIGHT FIXTURE (W = WET LOCATIONS)
RECESSED LIGHT FIXTURE (APPROVED FOR WET LOCATIONS)
EXHAUST FAN, * = EQUIPPED WITH HUMIDISTAT
SMOKE DETECTOR
CARBON MONOXIDE DETECTOR
GARBAGE DISPOSAL
PHOTO CELL MOTION SENSOR
CEILING FAN W/LIGHT

REFERENCE KEYNOTES

DIVISION 15 - MECHANICAL

IHW-E	- INSTANT HOT WATER HEATER, ELECTRIC, INSTALLED PER MANUFACTURER SPECIFICATION AND INSTALLATION INSTRUCTIONS.
MSH	- MINI SPLIT HEAD
MSU	- MINI SPLIT OUTDOOR UNIT, INSTALLED PER MANUFACTURER SPECIFICATIONS

DIVISION 16 - ELECTRICAL

AQR	- ARC FAULT QUAD RECEPTACLE, MOUNT LOWER FOR ENTERTAINMENT CENTER AND DUPLEX ABOVE AT 72" FOR TV EQUIPMENT
ARH	- APPLIANCE RECEPTACLE HIGH, +72" AFF MOUNTING HEIGHT, VERIFY EXACT LOCATION W/ CONTRACTOR AND APPLIANCE SPECIFICATIONS PRIOR TO INSTALL.
ARL	- APPLIANCE RECEPTACLE LOW, +18" AFF MOUNTING HEIGHT, VERIFY EXACT LOCATION W/ CONTRACTOR AND APPLIANCE SPECIFICATIONS PRIOR TO INSTALL.
EPP	- ELECTRICAL SUB PANEL, 120/240V 125A, W/ UFER GROUND, PROVIDE 30" MIN WIDTH OF PANEL + 30" IN FRONT OF PANEL WORKING AREA CENTERED IN FRONT OF PANEL
ESD	- EQUIPMENT SERVICE DISCONNECT, VERIFY MOTOR POWER REQUIREMENTS PRIOR TO INSTALL
ESR	- EQUIPMENT SERVICE RECEPTACLE

R314 SMOKE ALARM NOTES:


R314-2.3.4

4. SMOKE ALARMS OR SMOKE DETECTORS SHALL BE INSTALLED A MINIMUM OF 20 FEET HORIZONTAL DISTANCE FROM A PERMANENTLY INSTALLED COOKING APPLIANCE.
- EXCEPTION: IONIZATION SMOKE ALARMS WITH AN ALARM-SILENCING SWITCH OR PHOTOELECTRIC SMOKE ALARMS SHALL BE PERMITTED TO BE INSTALLED 10 FEET OR GREATER FROM A PERMANENTLY INSTALLED COOKING APPLIANCE.

R315 CARBON MONOXIDE ALARM NOTES:

R315.2.2 FOR EXISTING BUILDINGS AND NEW CONSTRUCTION, CARBON MONOXIDE ALARMS SHALL BE PROVIDED IN DWELLING UNITS WHERE EITHER OR BOTH OF THE FOLLOWING CONDITIONS EXIST.

- THE DWELLING UNIT CONTAINS A FUEL-FIRED APPLIANCE OR FIREPLACE.
- THE DWELLING UNIT HAS AN ATTACHED GARAGE WITH AN OPENING THAT COMMUNICATES WITH THE DWELLING UNIT.

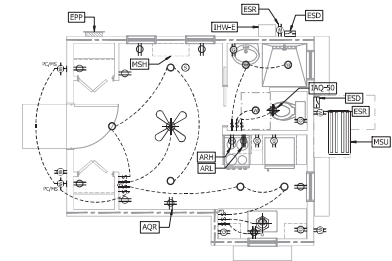

NOTE: ALL SWITCHES DIMMABLE UNLESS OTHERWISE SPECIFIED

ELECTRICAL PLAN

A2.1 1/4" = 1'-0"

WINDOW SCHEDULE

NUMBER	SIZE	HEAD HEIGHT	STYLE	SHCG	U-FACTOR	NOTES
1	2'-0" x 5'-0"	8'-0"	SINGLE HUNG	.23	.30	--
2	2'-0" x 5'-0"	8'-0"	SINGLE HUNG	.23	.30	--
3	2'-0" x 5'-0"	8'-0"	SINGLE HUNG	.23	.30	--
4	2'-0" x 5'-0"	8'-0"	SINGLE HUNG	.23	.30	--
5	2'-0" x 5'-0"	8'-0"	SINGLE HUNG	.23	.30	--

REFERENCE KEYNOTES

DIVISION 03 - CONCRETE

CL	- 4" THICK CONCRETE LANDING, MINIMUM 3'-4" DEEP x DOOR/STAIR WIDTH+. LANDING SHALL NOT EXCEED 1/4 UNIT VERTICAL IN 12 UNITS HORIZONTAL (2%). ELEVATION NOT TO BE MORE THAN 7'-4" LOWER THAN THE TOP OF THRESHOLD OF THE DOOR. LANDINGS TO BE SLOPED AWAY FROM BUILDING. SEE SHEET A04 GENERAL NOTE 14 FOR ADDITIONAL THRESHOLD NOTES.
----	---

DIVISION 06 - WOOD AND PLASTICS

IHR	- 1 HOUR FIRE RATED WALL TO UNDERSIDE OF ROOF SHEATHING, BAYES REDUCED TO 0 HRS UNDER TABLE R302.1 (1) SUBNOTE (B).
-----	---

DIVISION 09 - FINISHES

LVT	- LUXURY VINYL FLOORING
-----	-------------------------

DIVISION 10 - SPECIALTIES

SSS	- SHOWER SHELF INSET, STANDARD, MIN 3" ABOVE GRAB BAR BLOCKING (FOR FUTURE GRAB BAR INSTALLATION)
-----	---

DIVISION 11 - EQUIPMENT

PR24	- REFRIG, 24" WIDE, PLUMB FOR WATER/ ICE DISPENSER.
------	---

MWHE	- MICROWAVE EXHAUST HOOD COMBINATION, MIN VENTILATION RATE OF 100 CFM (CMC TABLE 405.7), HV1 RATED & LIMITED TO 3 ZONES, HERE VERIFICATION REQUIRED
------	---

RQ24-RFC	- 24" RANGE ELECTRIC, PER CLIENT SPECIFICATION
----------	--

DIVISION 12 - FURNISHINGS

BC24	- 24" DEEP BASE CABINET
------	-------------------------

UC12	- 12" DEEP UPPER CABINET
------	--------------------------

DIVISION 15 - MECHANICAL

IHW-E	- INSTANT HOT WATER HEATER, ELECTRIC, INSTALLED PER MANUFACTURER SPECIFICATION AND INSTALLATION INSTRUCTIONS.
-------	---

MSH	- MINI SPLIT HEAD
-----	-------------------

MSU	- MINI SPLIT OUTDOOR UNIT, INSTALLED PER MANUFACTURER SPECIFICATIONS
-----	--

DIVISION 16 - ELECTRICAL

EPP	- ELECTRICAL SUB PANEL, 120/240V 125A, W/ UFER GROUND, PROVIDE 30" MIN WIDTH OF PANEL + 30" IN FRONT OF PANEL WORKING AREA CENTERED IN FRONT OF PANEL
-----	---

DIVISION 17 - PLUMBING

KS	- KITCHEN SINK
----	----------------


SKB	- PEDESTAL SINK
-----	-----------------

WC	- WATER CLOSET, MINIMUM 30" CLEAR WIDTH CENTERED ON WATER CLOSET & 24" CLEAR SPACE OFF NOSE OF WATER CLOSET.
----	--

WD-ST	- WALK-IN SHOWER TILE
-------	-----------------------


DOOR AND FRAME SCHEDULE

NUMBER	SIZE	STYLE	JAMB	HEAD	THRESHOLD	FIRE RATING	NOTES
1	PR 1'-0" x 6'-0" x 1-3/4"	BIFOLD	--	--	--/A	--	--
2	3'-0" x 8'-0" x 1-3/4"	SINGLE - EXTERIOR	--	--	--/A	--	--
3	PR 1'-0" x 6'-0" x 1-3/4"	BIFOLD	--	--	--/A	--	--
4	2'-0" x 6'-0" x 1-3/4"	POCKET	--	--	--/A	--	--

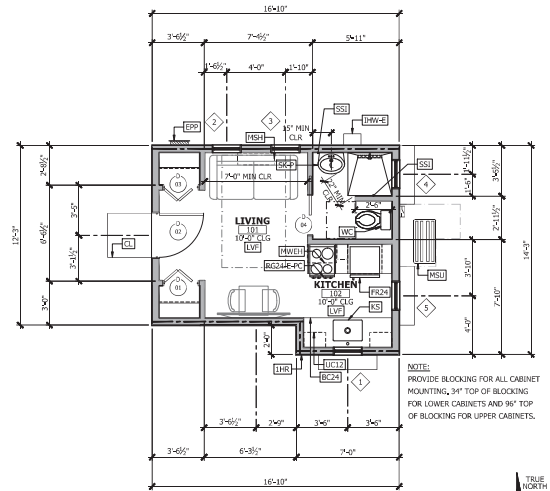


FLOOR PLAN


A2.1 1/4" = 1'-0"

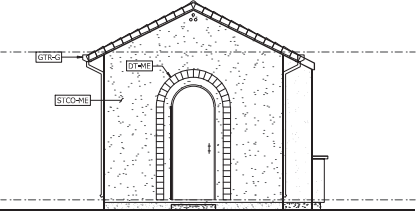


A FRONT ELEVATION
A2.2 1/4" = 1'-0"

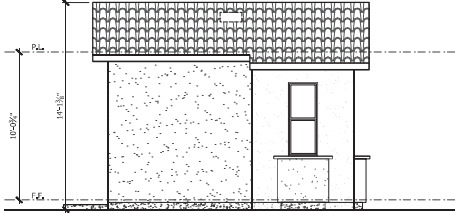


B RIGHT ELEVATION
A2.2 1/4" = 1'-0"

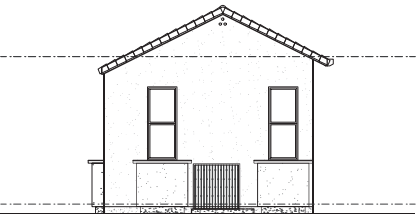

C REAR ELEVATION
A2.2 1/4" = 1'-0"

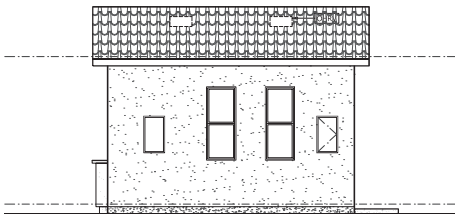

D LEFT ELEVATION
A2.2 1/4" = 1'-0"

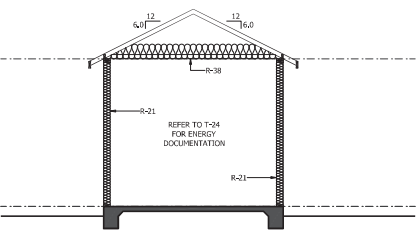

E SECTION
A2.2 1/4" = 1'-0"

ATTIC VENTILATION CALCULATIONS

ZONE 1 270 SF / 150 SF = 1,467 SF VENTILATION REQ'D
0" HIDDEN LOW PROFILE VENT = 96.75 SQ IN / 144 = 0.685 x 3 QTY = 2,055 SF
2,055 SF PROVIDED > 1,467 SF REQ'D

REFERENCE KEYNOTES	
DIVISION 07 - THERMAL AND MOISTURE PROTECTION	
FLASHING AND SHEET METAL -	
GTR-G	- 2x6 FASCIA & GUTTER
ROOFING AND SIDING -	
CHRV	- 12" HIDDEN ROOF VENT, TYP
DIVISION 09 - FINISHES	
CEMENT PLASTER -	
STCO-ME	- STUCCO, TO MATCH EXISTING
TILE -	
DT-ME	- DECORATIVE TILE, TO MATCH EXISTING