





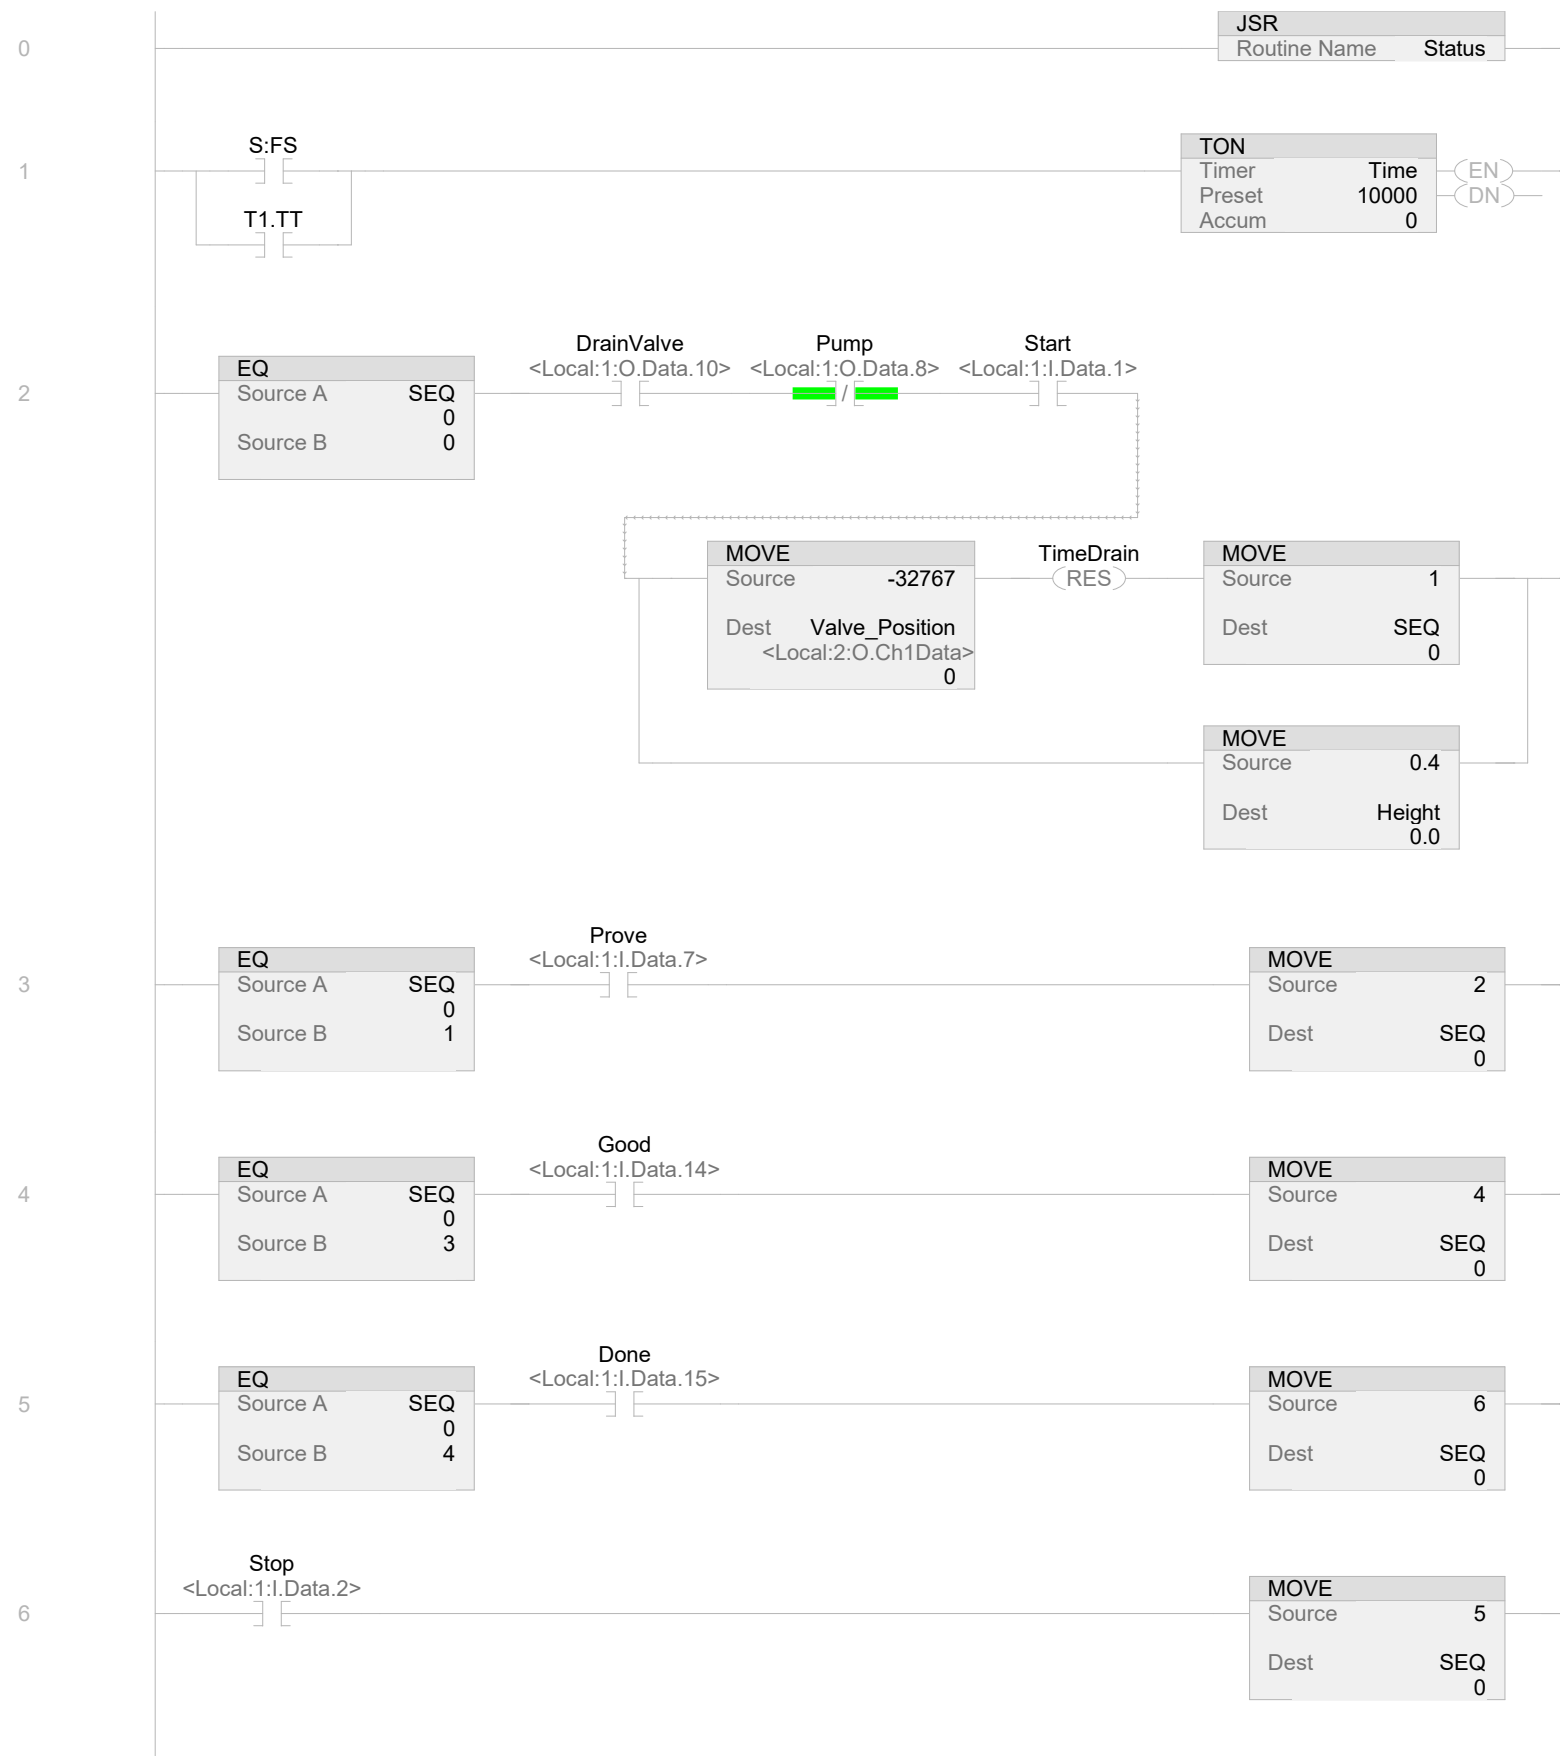

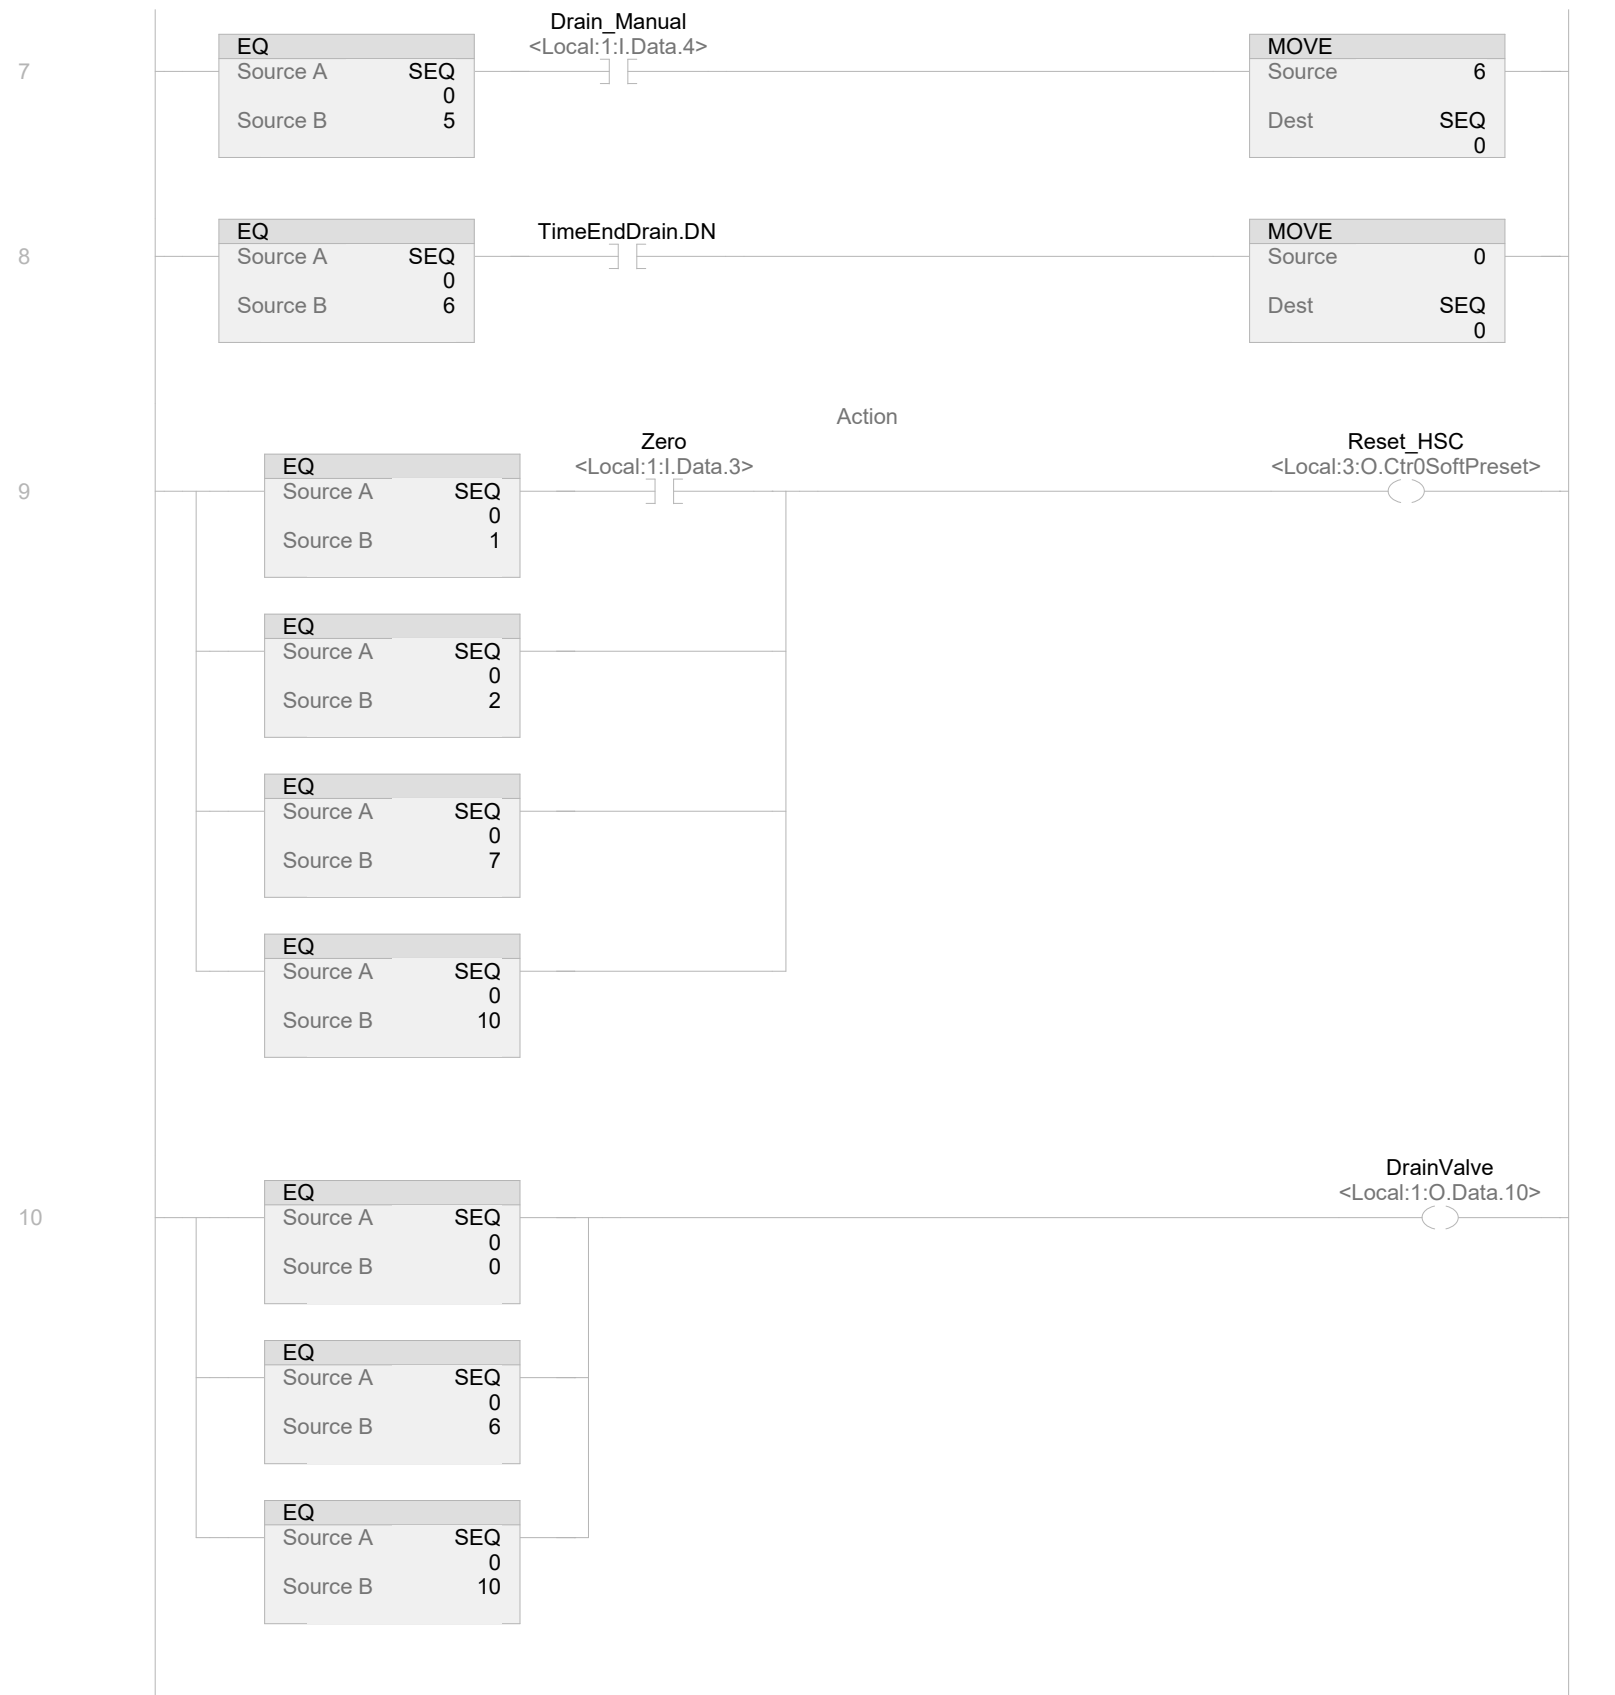

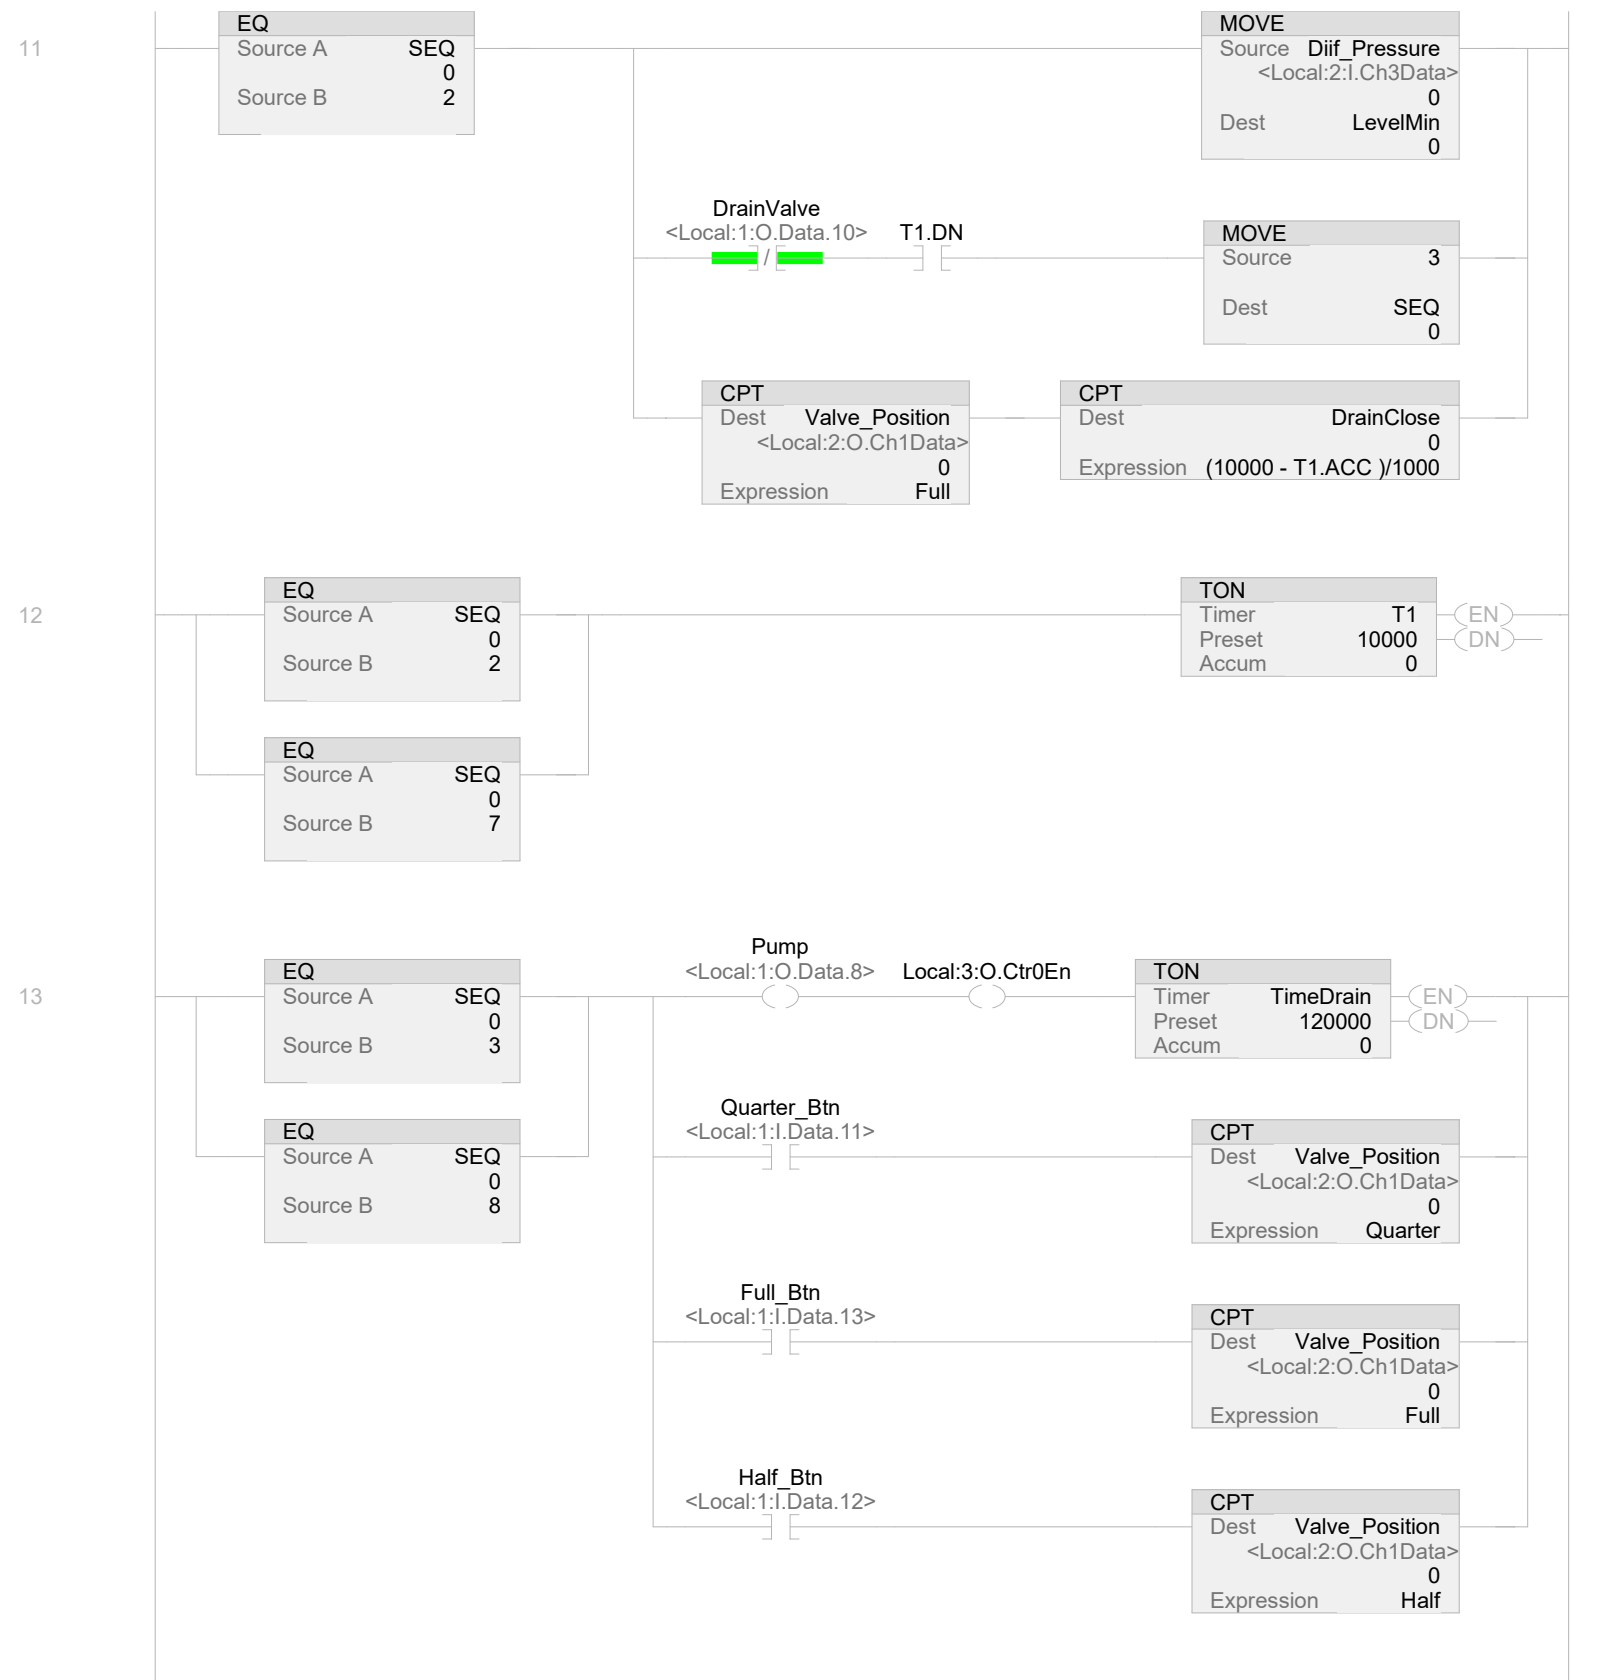

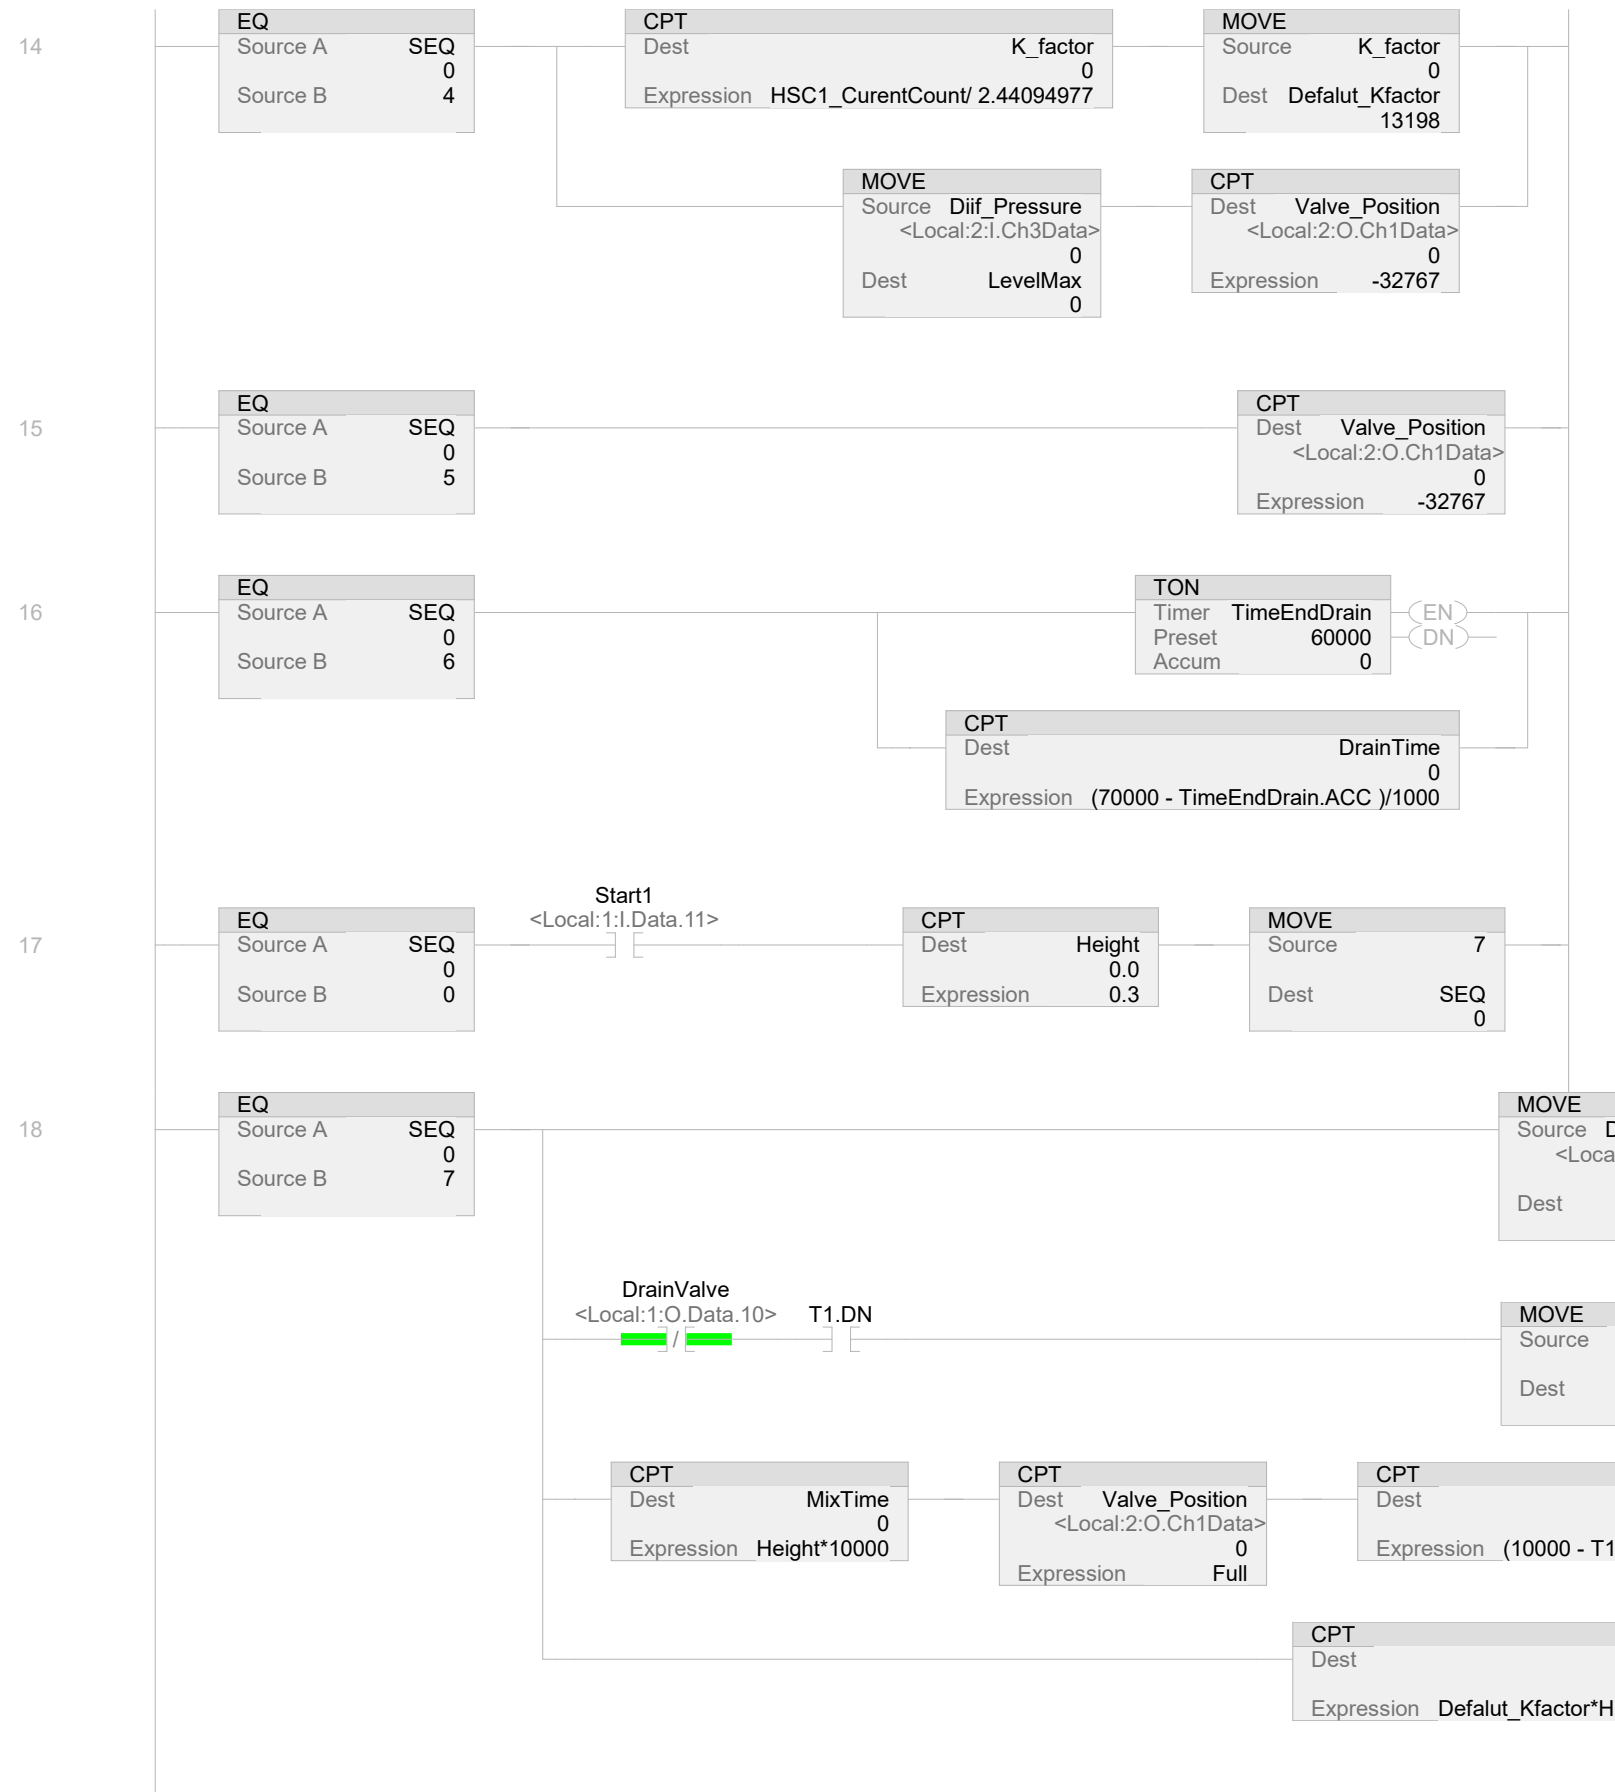

19

f_Pressure
2:I.Ch3Data>
0
LevelMin
0

8
SEQ
0

DrainClose
0
(CC)/1000

TargetTicks
0
ght*4.0669

EQ
Source A SEQ
0
Source B 8

GE
Source A HSC1_CurentCount
<Local:3:I.Ctr0CurrentCount>
0
Source B TargetTicks
0

MOVE
Source 9
Dest SEQ
0

MOVE
Source MixTime
0
Dest T3.PRE
10000


EQ
Source A Height
0.0
Source B 0.3

CPT
Dest V1
0
Expression CurrHeight*3.14159*49

EQ
Source A Height
0.0
Source B 0.2

CPT
Dest V2
0
Expression CurrHeight*3.14159*49

CPT
Dest Volume
0
Expression V1 + V2

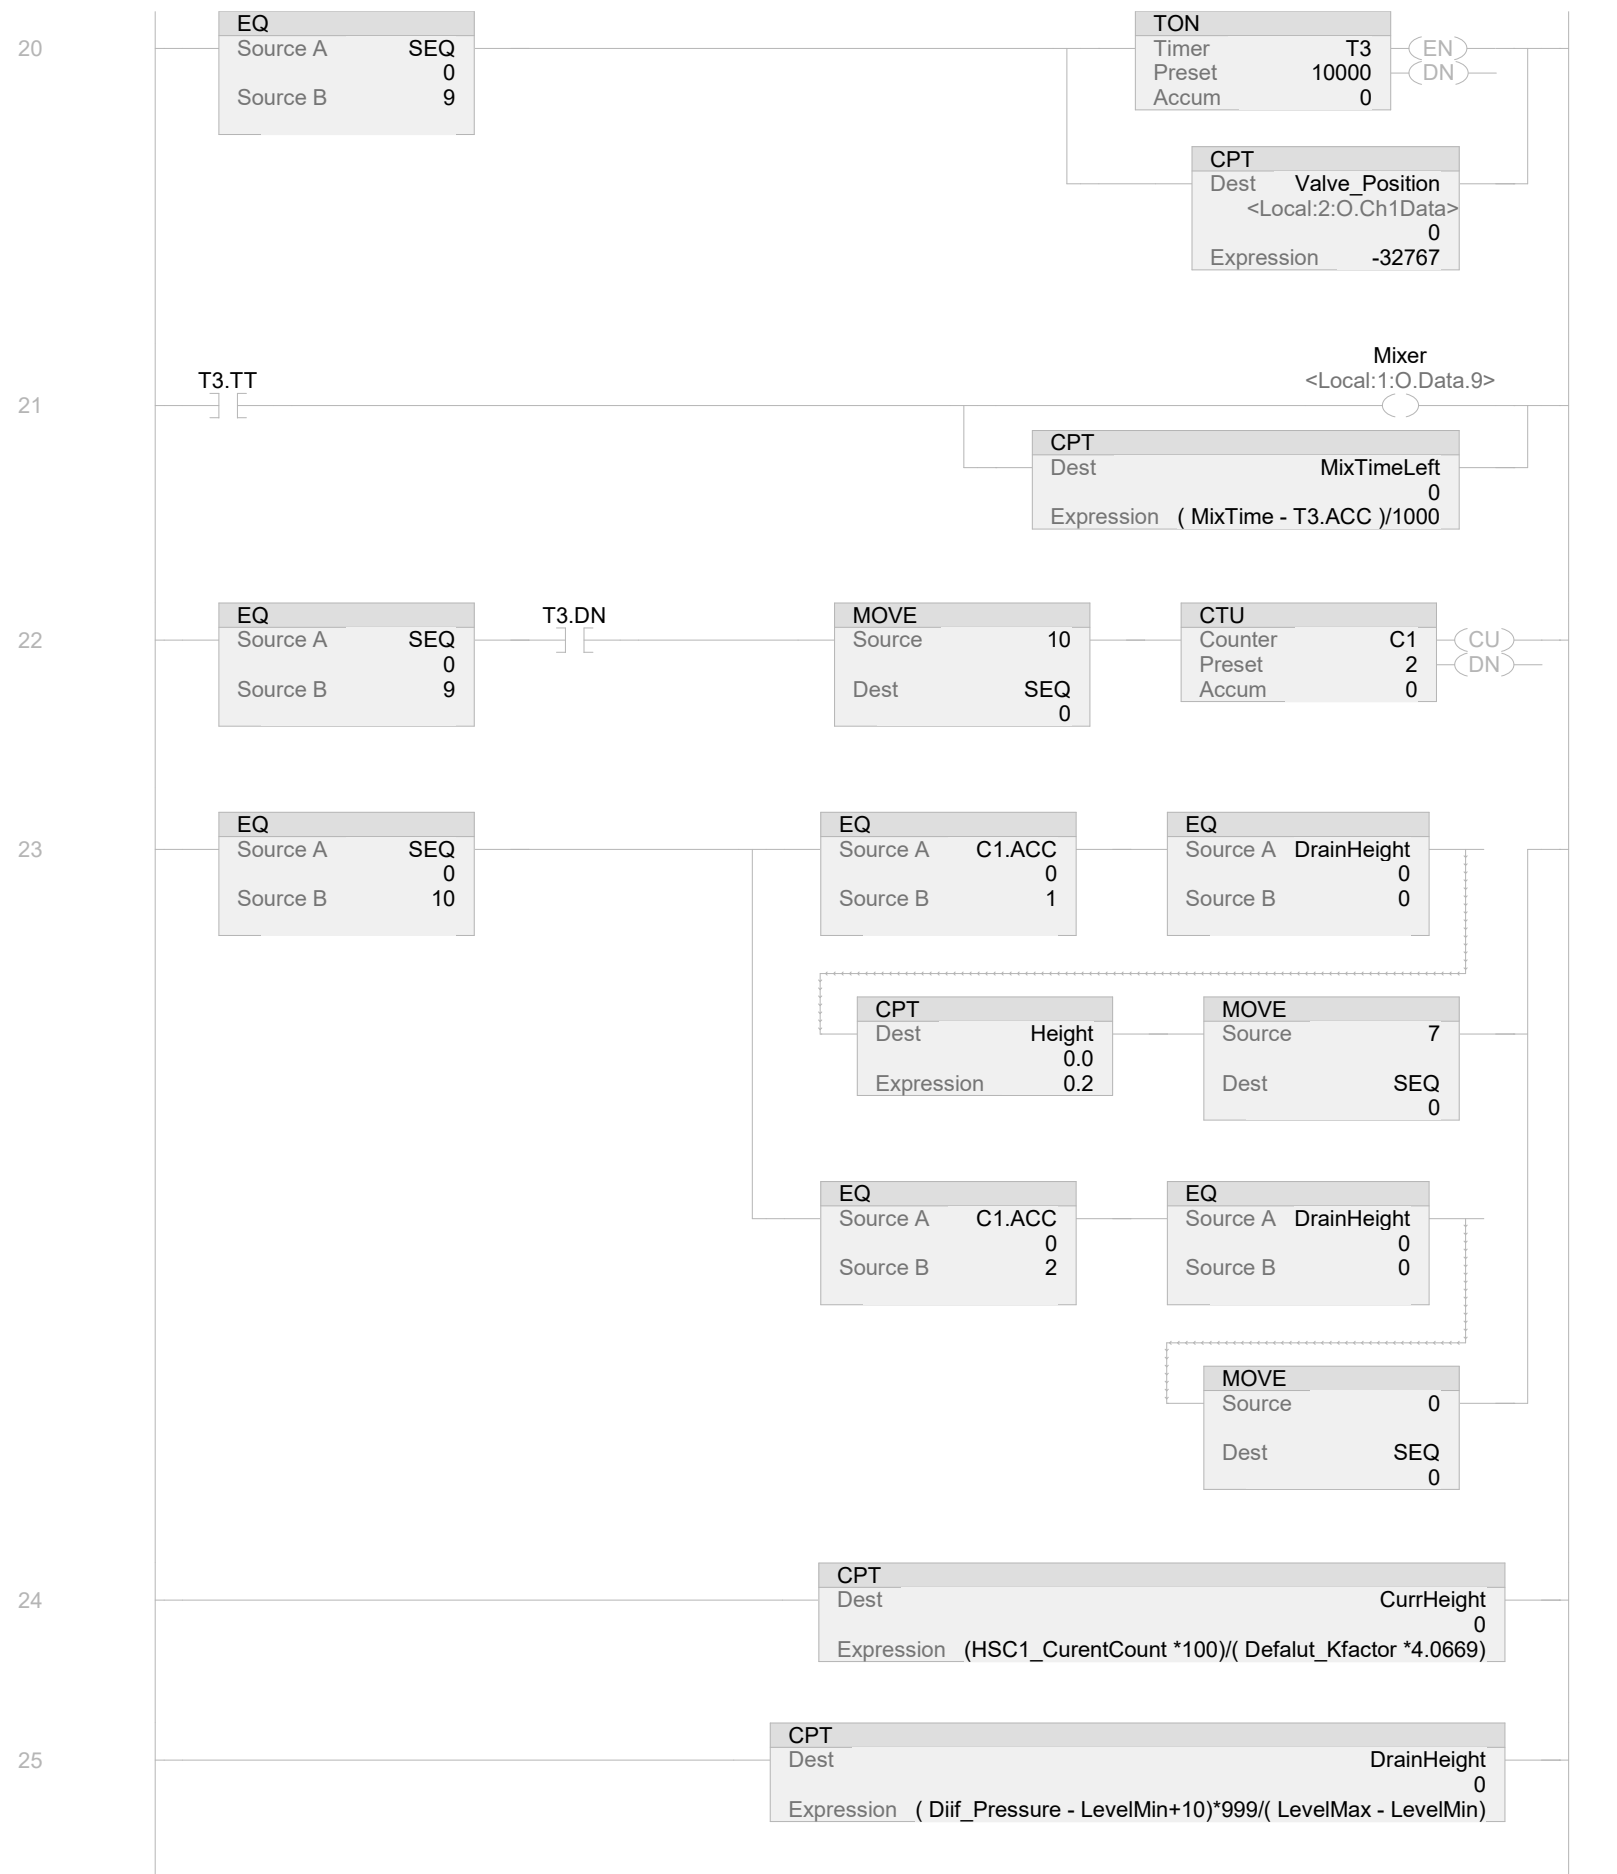

(End)