Patient: Hạnh Trần, 06/11/1979 (42yrs)
Recorded: Tuesday, 8 March 2022 at 05:18:23
Heart Rate: 95 BPM
Duration: 30s

Kardia Advanced Determination: Normal Sinus Rhythm
*Kardia Advanced Determination is done on Lead I.

Kardia

Enhanced Filter, Mains Frequency: 50Hz Scale: 25mm/s, 10mm/mV

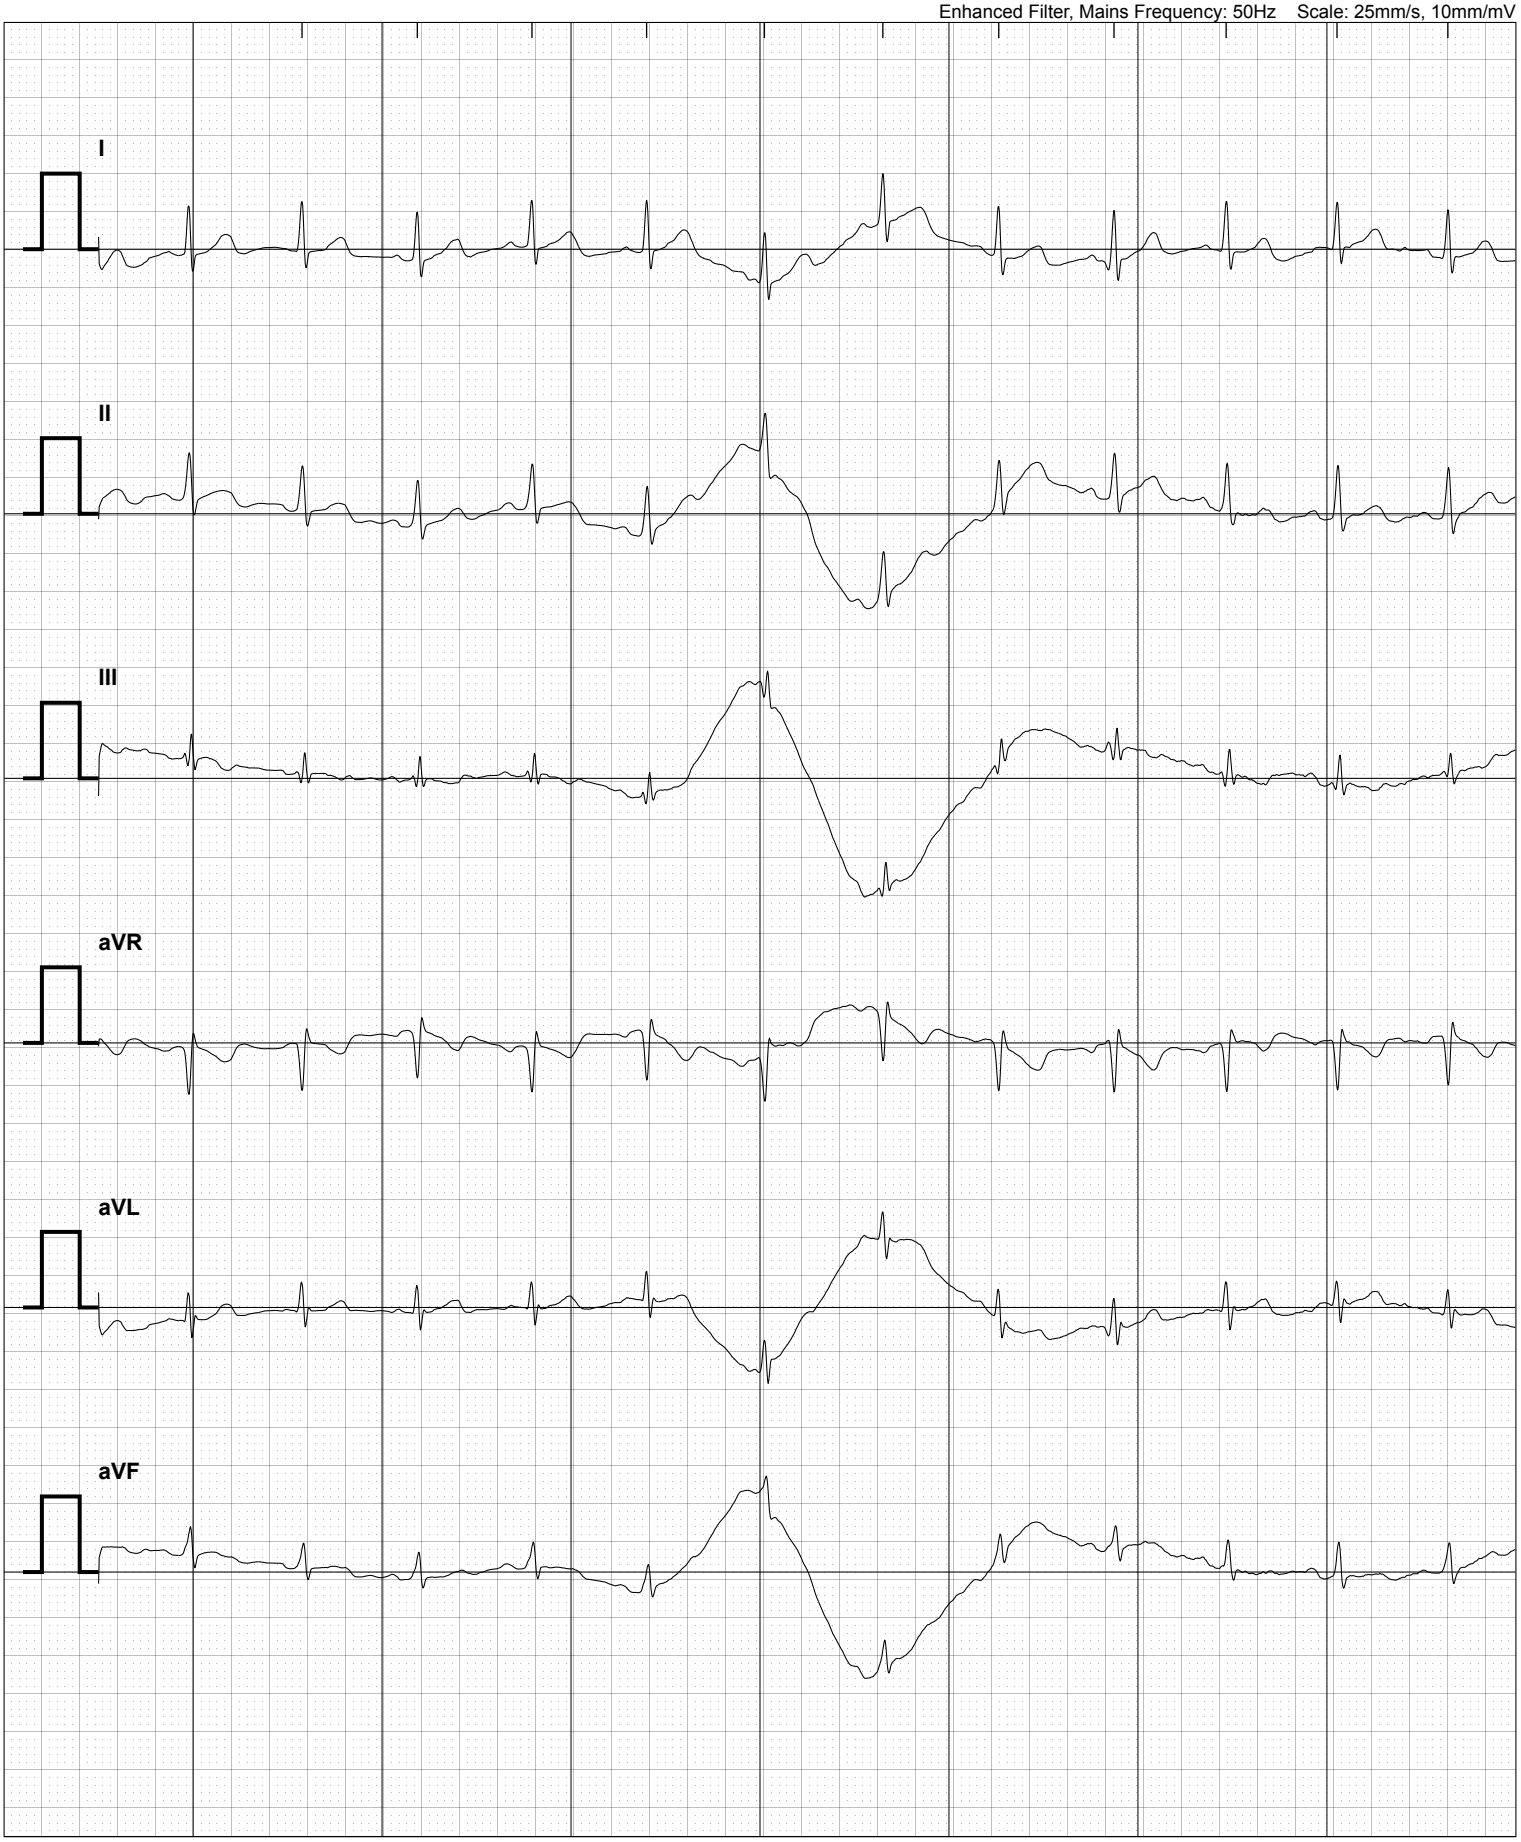

(c) Copyright 2021, AliveCor Inc. Kardia 5.22.2, UUID: 8d7e7410-839d-432c-9199-1c08838a5ee2

Patient: Hạnh Trần, 06/11/1979 (42yrs)
Recorded: Tuesday, 8 March 2022 at 05:18:23
Heart Rate: 95 BPM
Duration: 30s

Kardia Advanced Determination: Normal Sinus Rhythm
*Kardia Advanced Determination is done on Lead I.

Kardia

Enhanced Filter, Mains Frequency: 50Hz Scale: 25mm/s, 10mm/mV

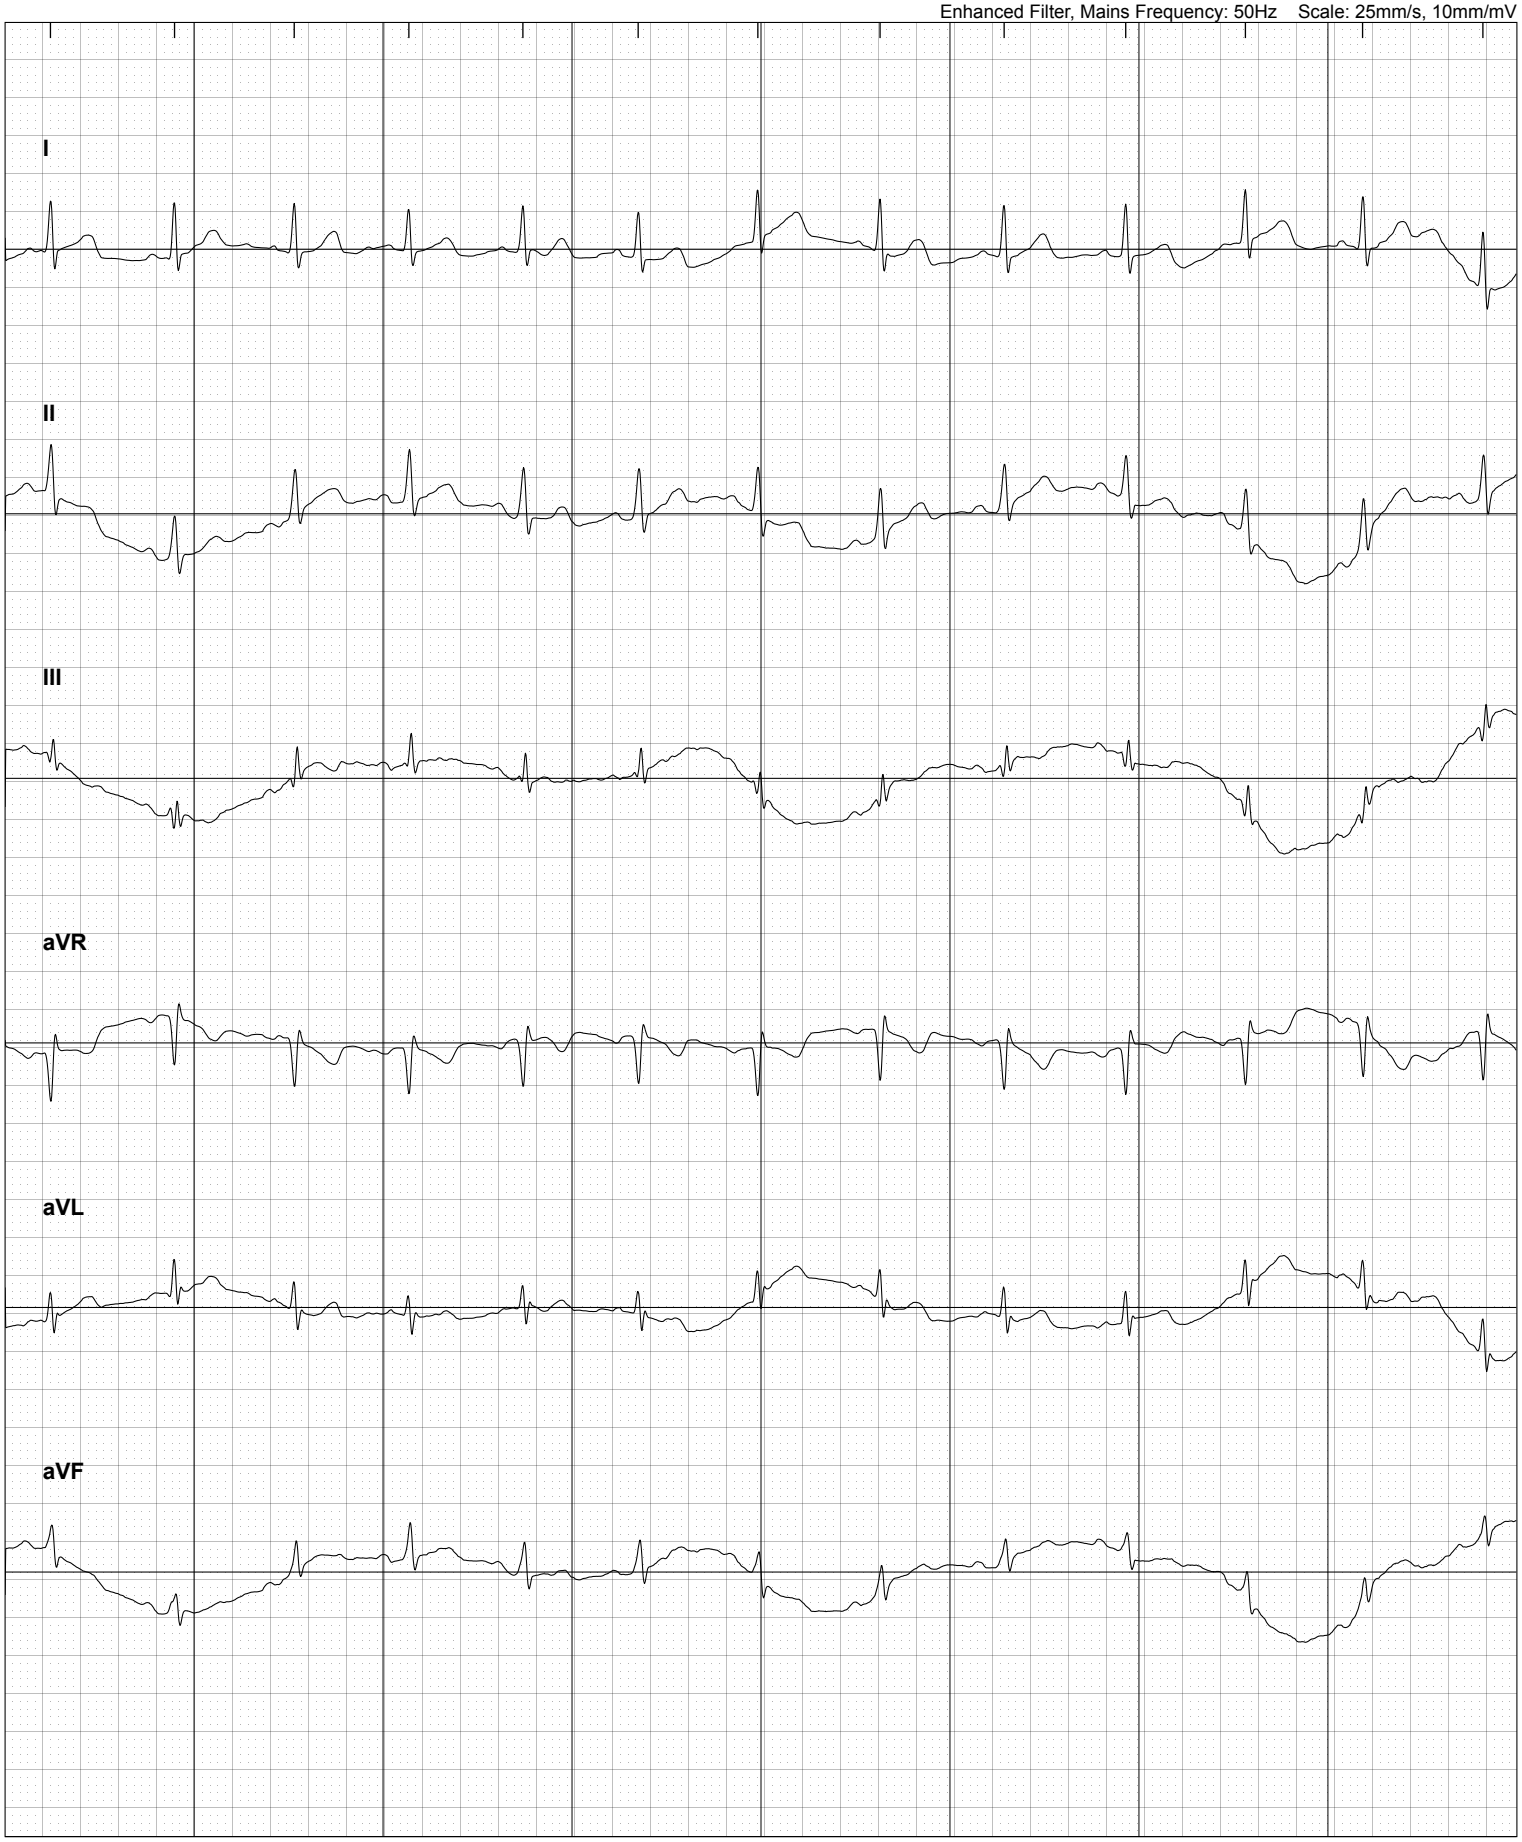

(c) Copyright 2021, AliveCor Inc. Kardia 5.22.2, UUID: 8d7e7410-839d-432c-9199-1c08838a5ee2

Patient: Hạnh Trần, 06/11/1979 (42yrs)
Recorded: Tuesday, 8 March 2022 at 05:18:23
Heart Rate: 95 BPM
Duration: 30s

Kardia Advanced Determination: Normal Sinus Rhythm
*Kardia Advanced Determination is done on Lead I.

Kardia

Enhanced Filter, Mains Frequency: 50Hz Scale: 25mm/s, 10mm/mV

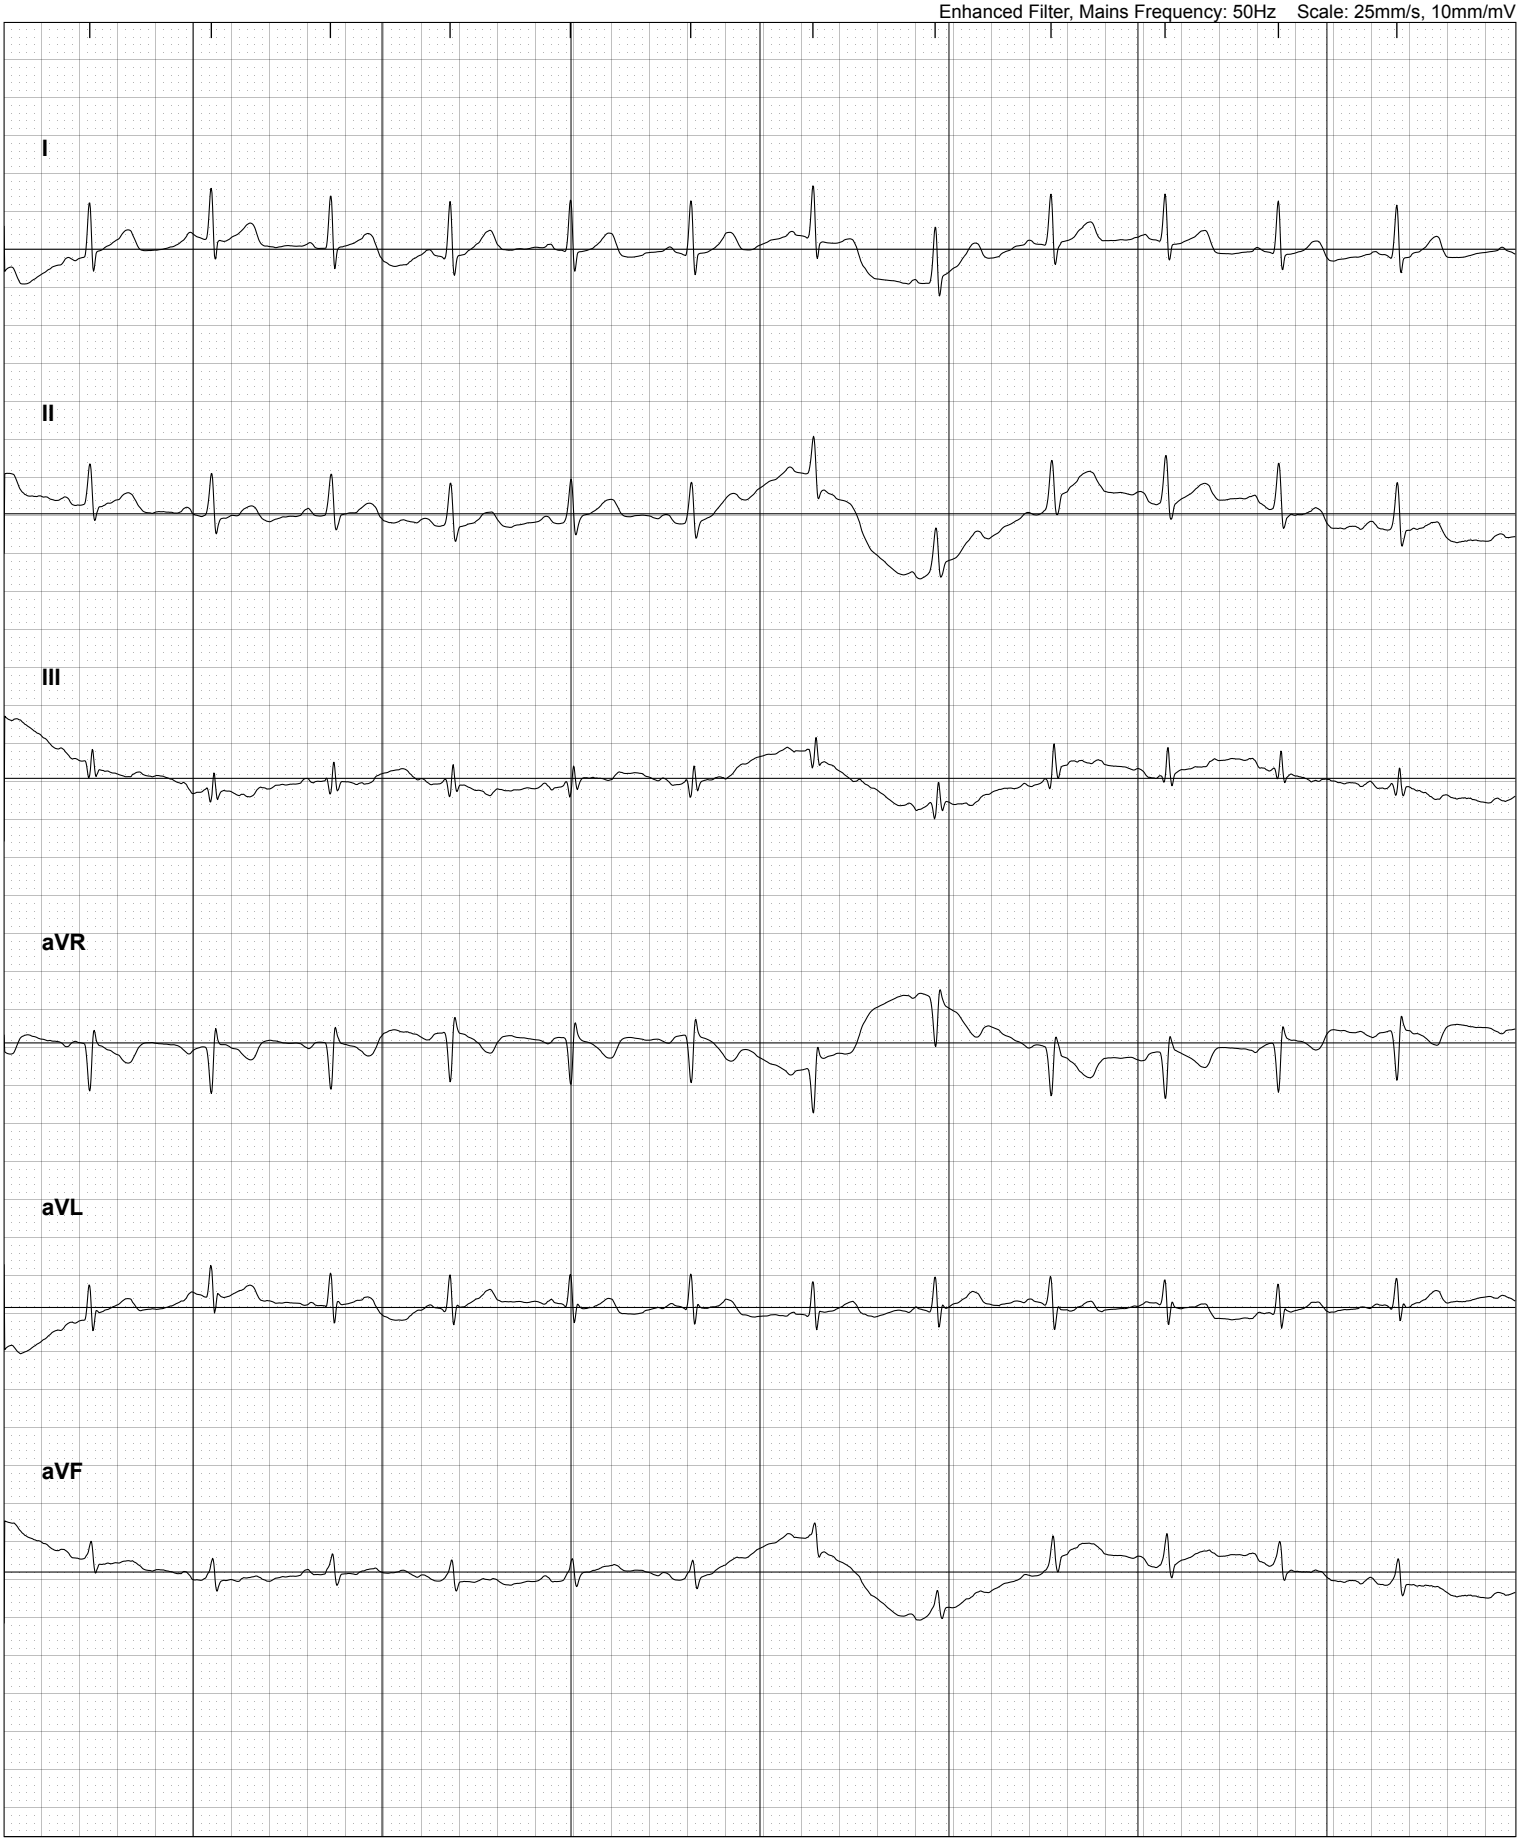

(c) Copyright 2021, AliveCor Inc. Kardia 5.22.2, UUID: 8d7e7410-839d-432c-9199-1c08838a5ee2

Patient: Hạnh Trần, 06/11/1979 (42yrs)
Recorded: Tuesday, 8 March 2022 at 05:18:23
Heart Rate: 95 BPM
Duration: 30s

Kardia Advanced Determination: Normal Sinus Rhythm
*Kardia Advanced Determination is done on Lead I.

Kardia

Enhanced Filter, Mains Frequency: 50Hz Scale: 25mm/s, 10mm/mV

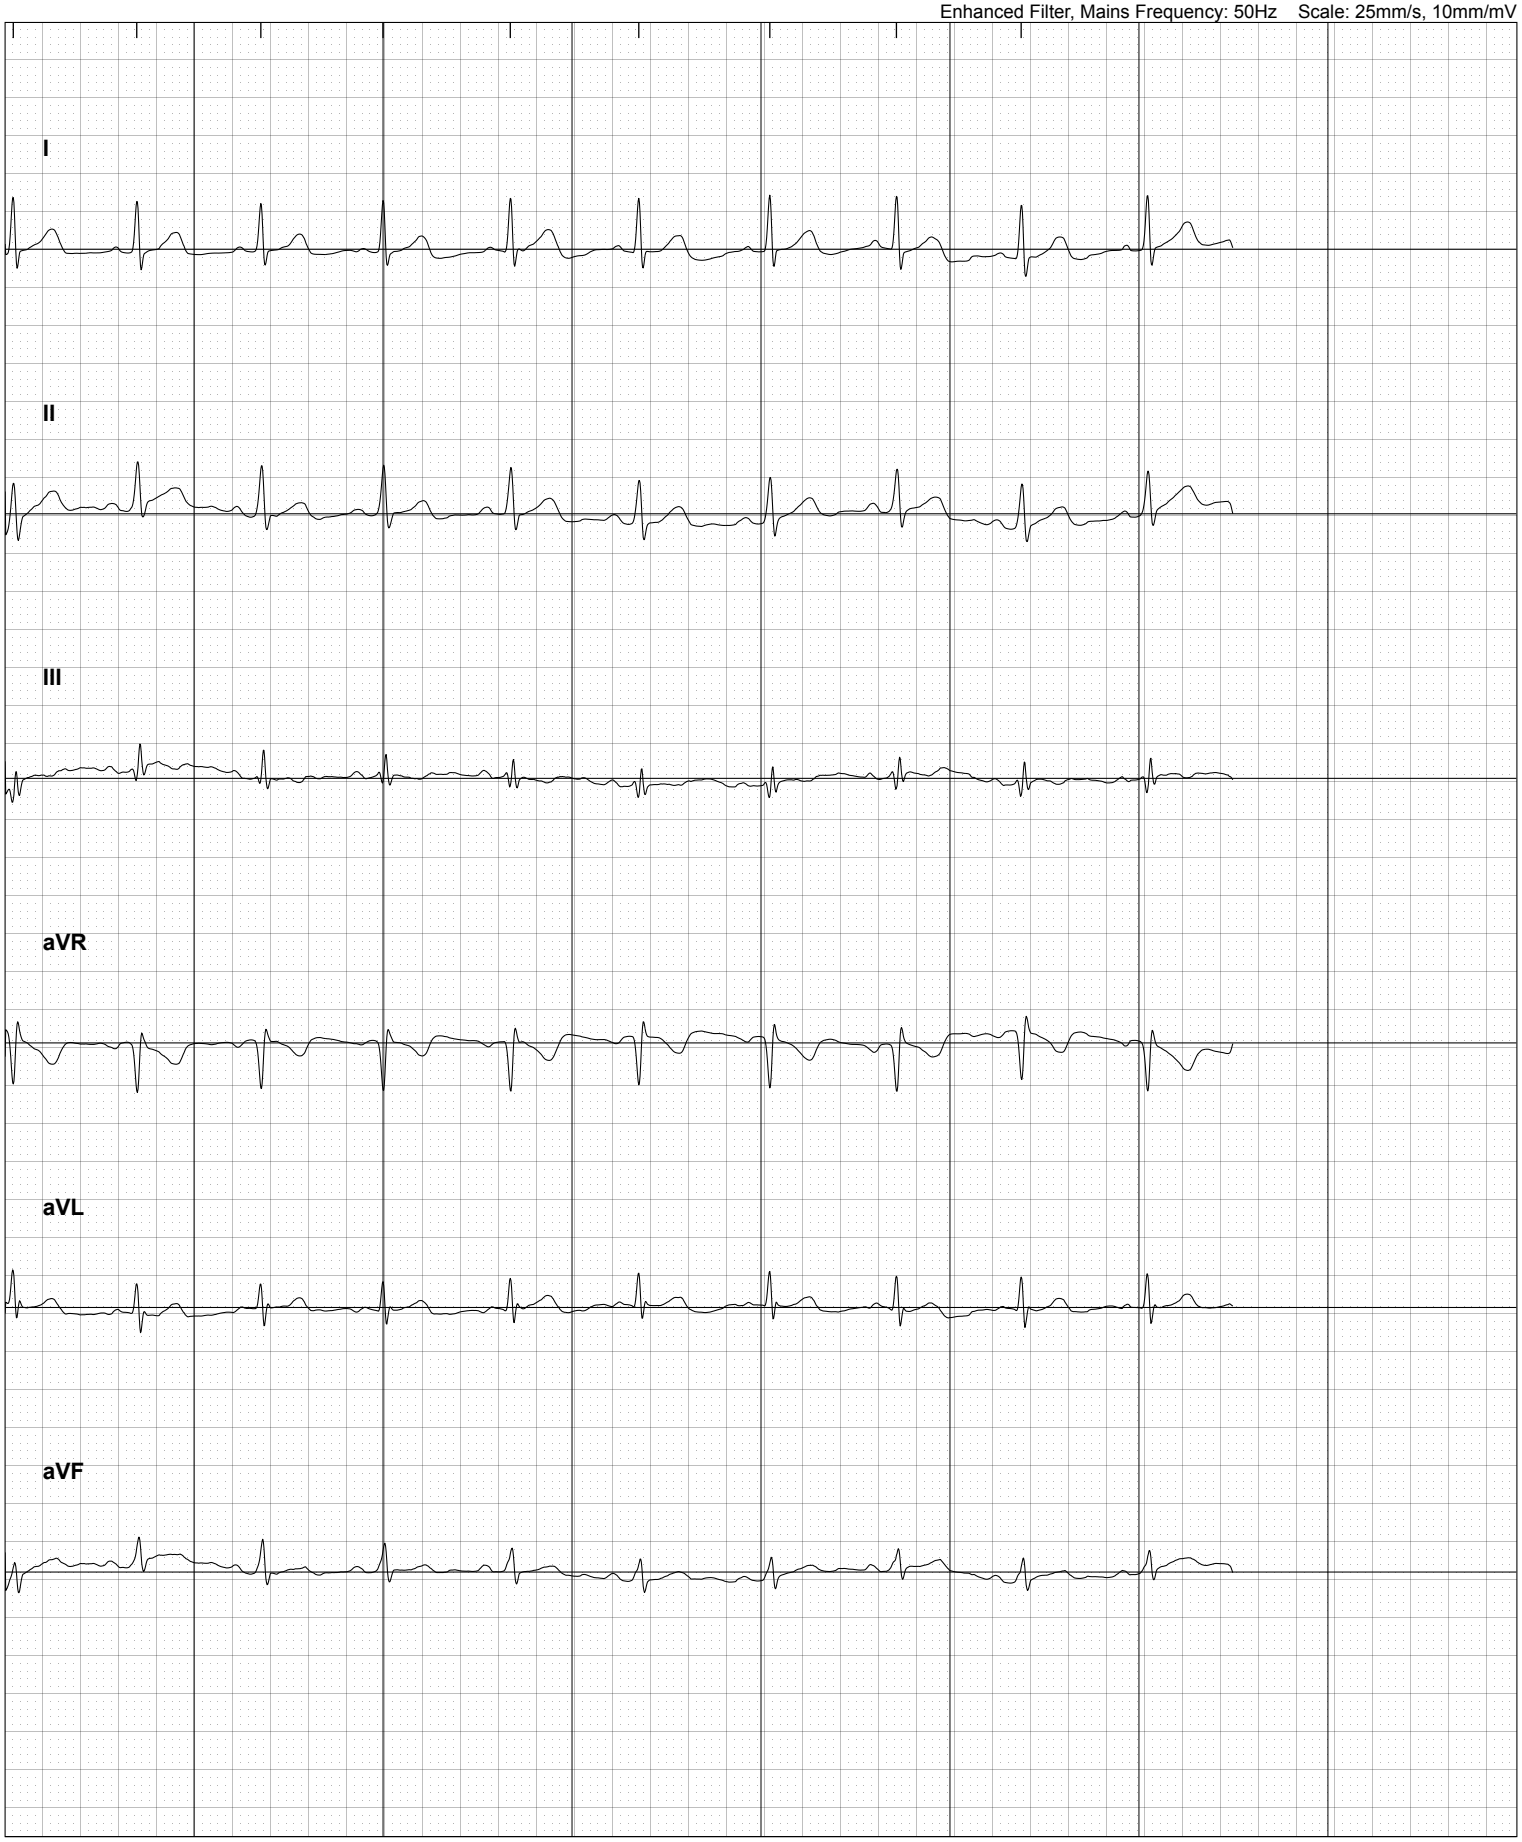

(c) Copyright 2021, AliveCor Inc. Kardia 5.22.2, UUID: 8d7e7410-839d-432c-9199-1c08838a5ee2

Patient: Hạnh Trần, 06/11/1979 (42yrs)
Recorded: Tuesday, 8 March 2022 at 05:18:23
Heart Rate: 95 BPM
Duration: 30s

Kardia Advanced Determination: Normal Sinus Rhythm
*Kardia Advanced Determination is done on Lead I.

Kardia

R–R Interval Plot
Detection of QRS locations allows Kardia AI to measure the distance between heartbeats or the RR interval. This can be used to review variability of heart rate, which may be useful in understanding heart rate variability, or to visually display irregularity in rate (such as in Afib).

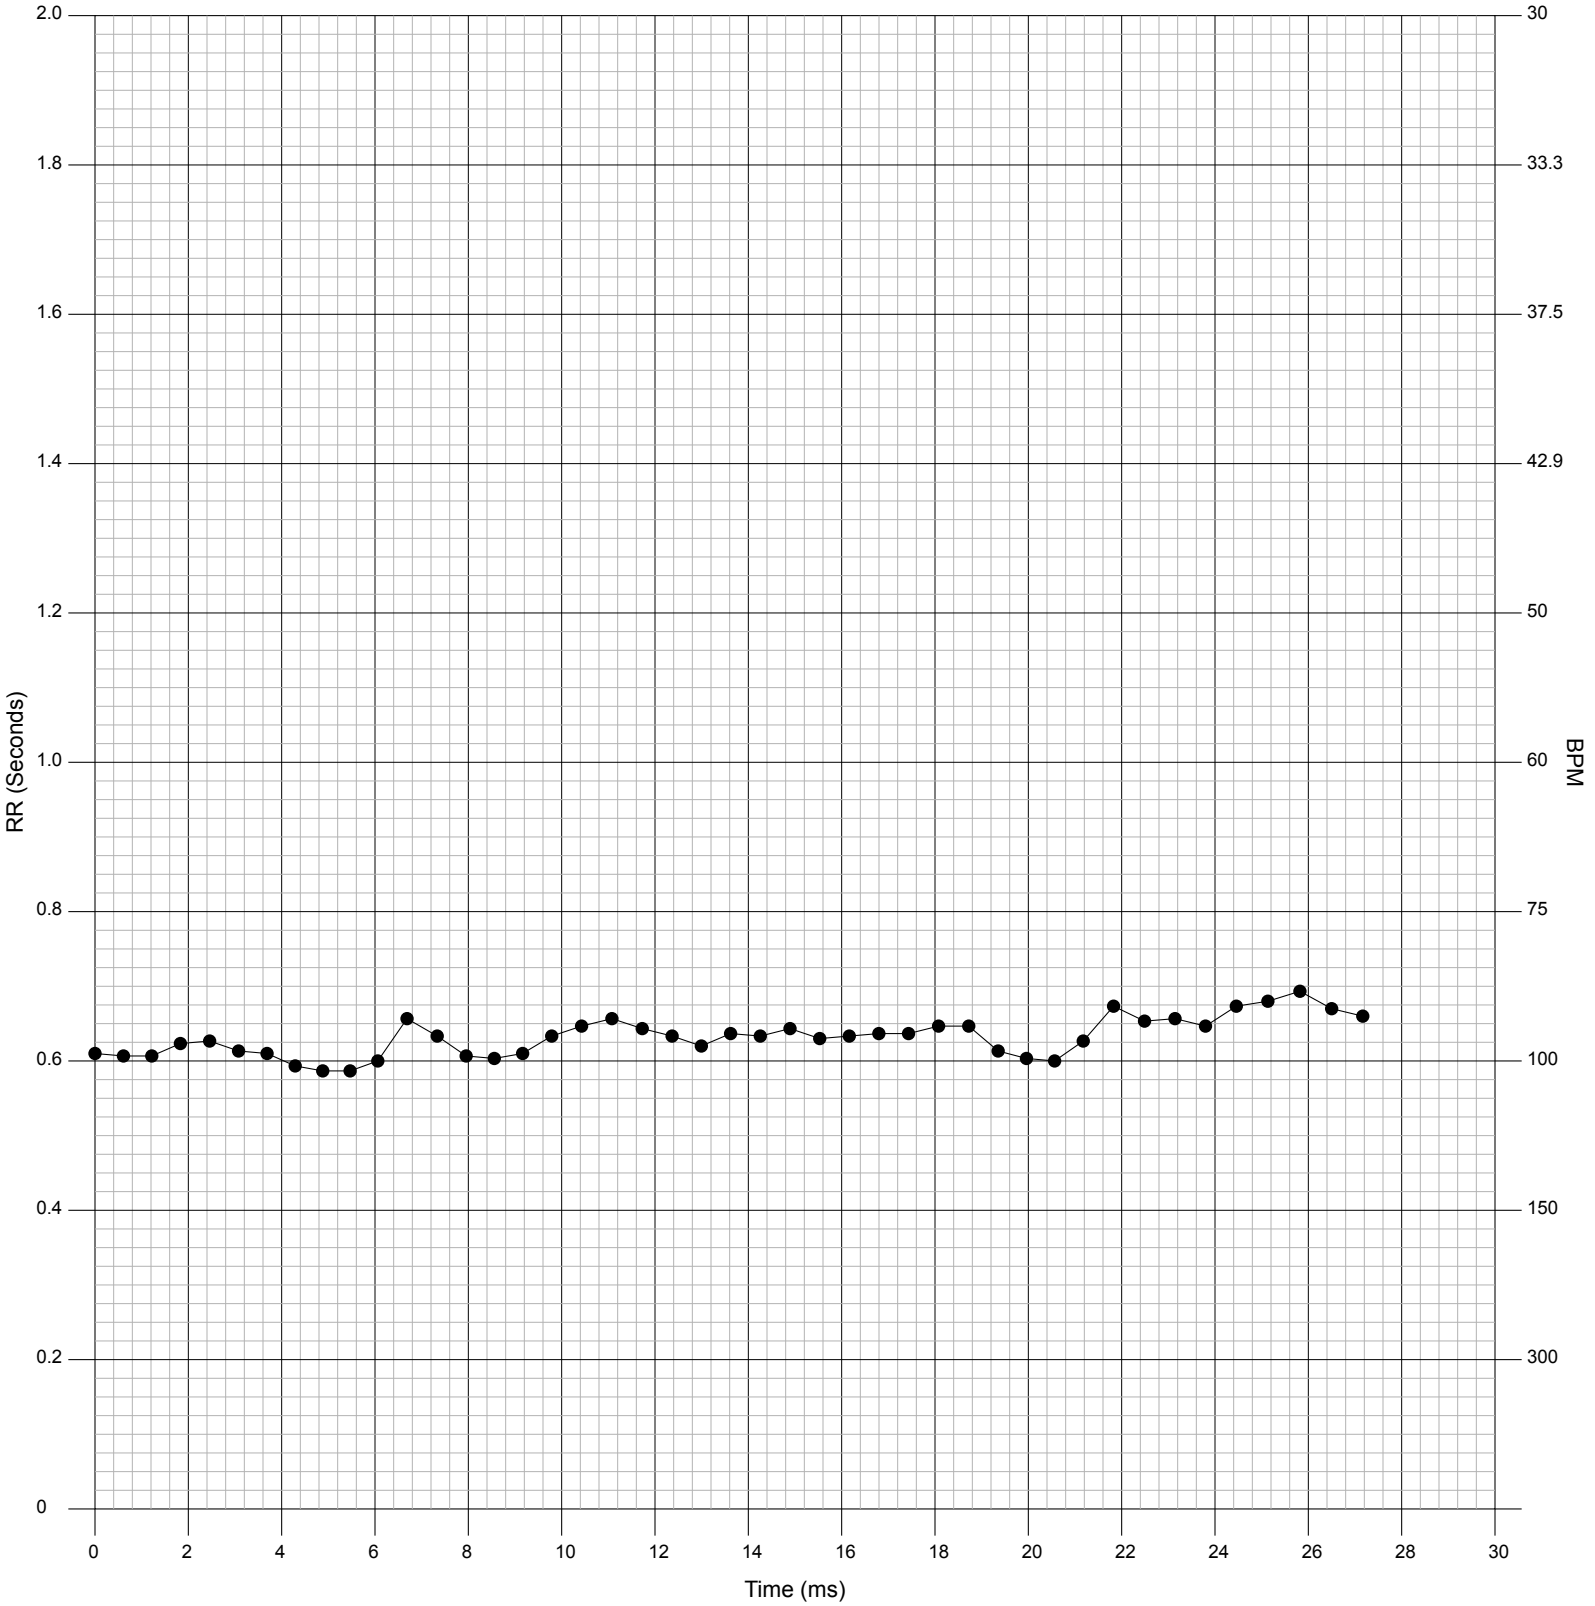

(c) Copyright 2021, AliveCor Inc. Kardia 5.22.2, UUID: 8d7e7410-839d-432c-9199-1c08838a5ee2

Patient: Hạnh Trần, 06/11/1979 (42yrs)
Recorded: Tuesday, 8 March 2022 at 05:18:23
Heart Rate: 95 BPM
Duration: 30s

Kardia Advanced Determination: Normal Sinus Rhythm
*Kardia Advanced Determination is done on Lead I.

Kardia

Average Beat Plot
The average beat display is the average of all the normal, non-ectopic (extra/missed) beats in the ECG. An average beat display is intended to be a simple visual representation of one beat in a 30-second ECG.

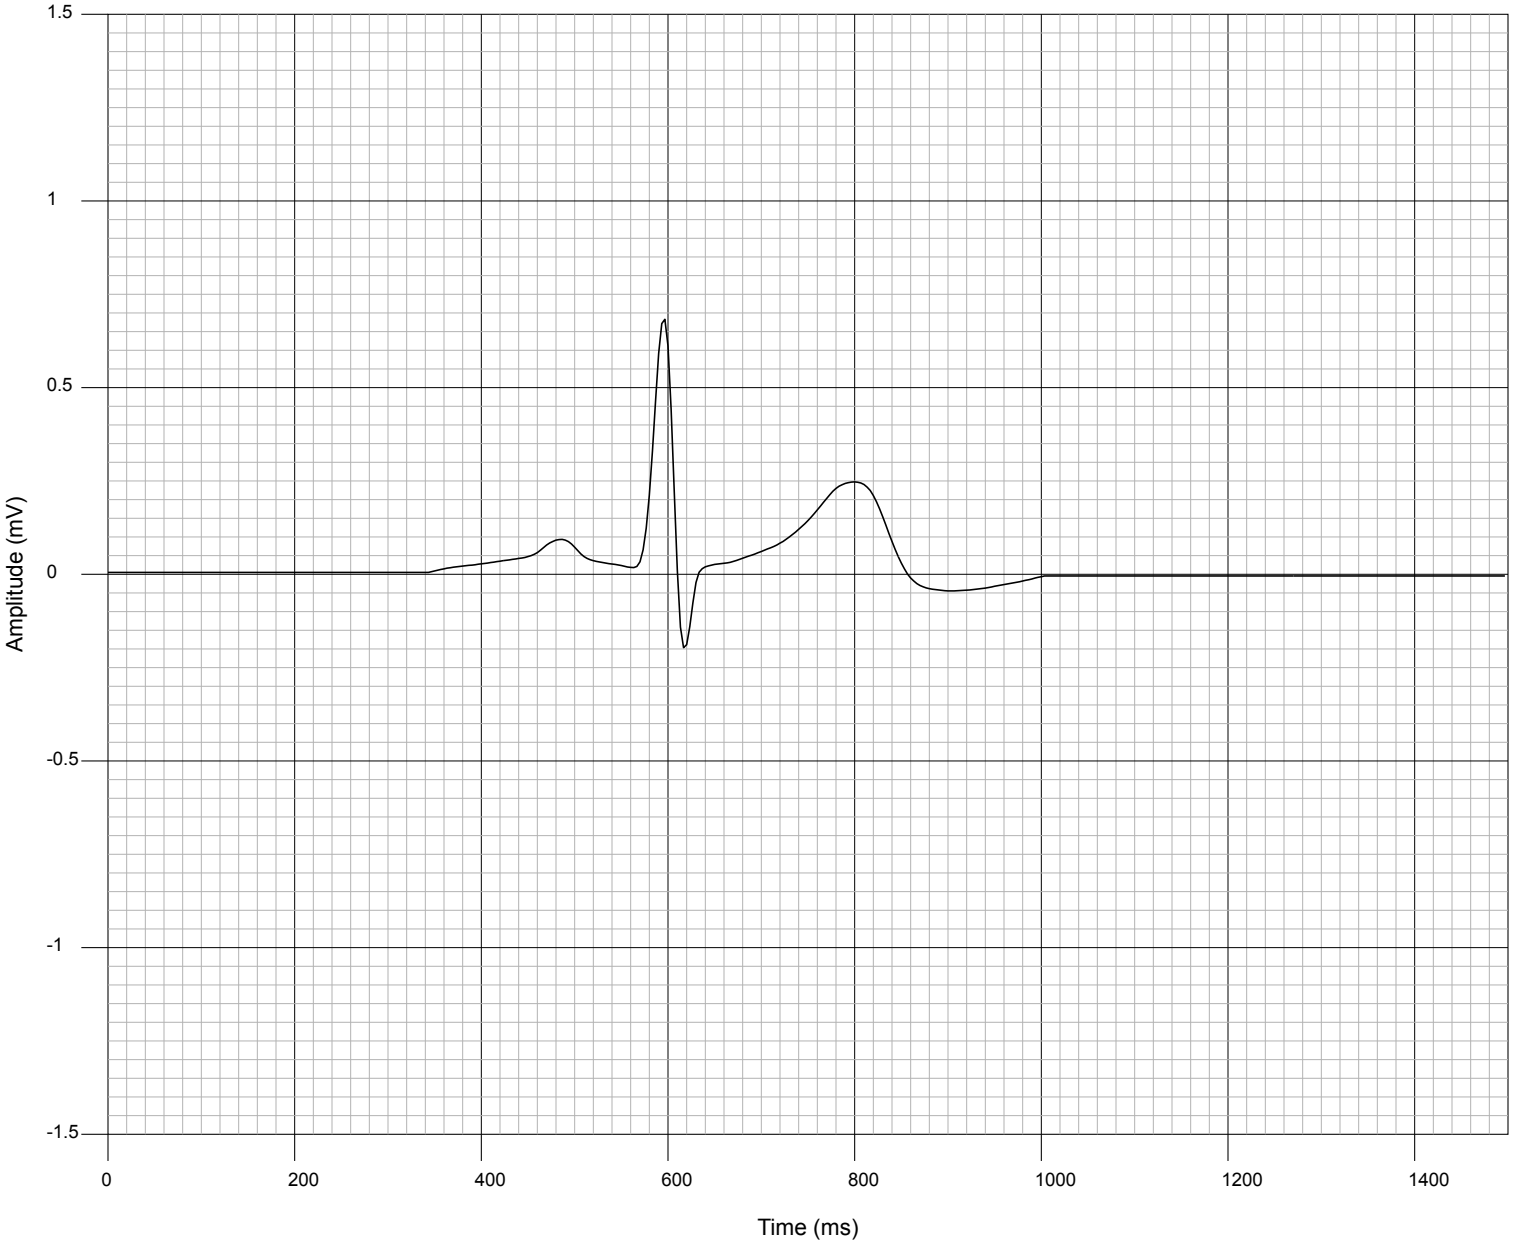

(c) Copyright 2021, AliveCor Inc. Kardia 5.22.2, UUID: 8d7e7410-839d-432c-9199-1c08838a5ee2