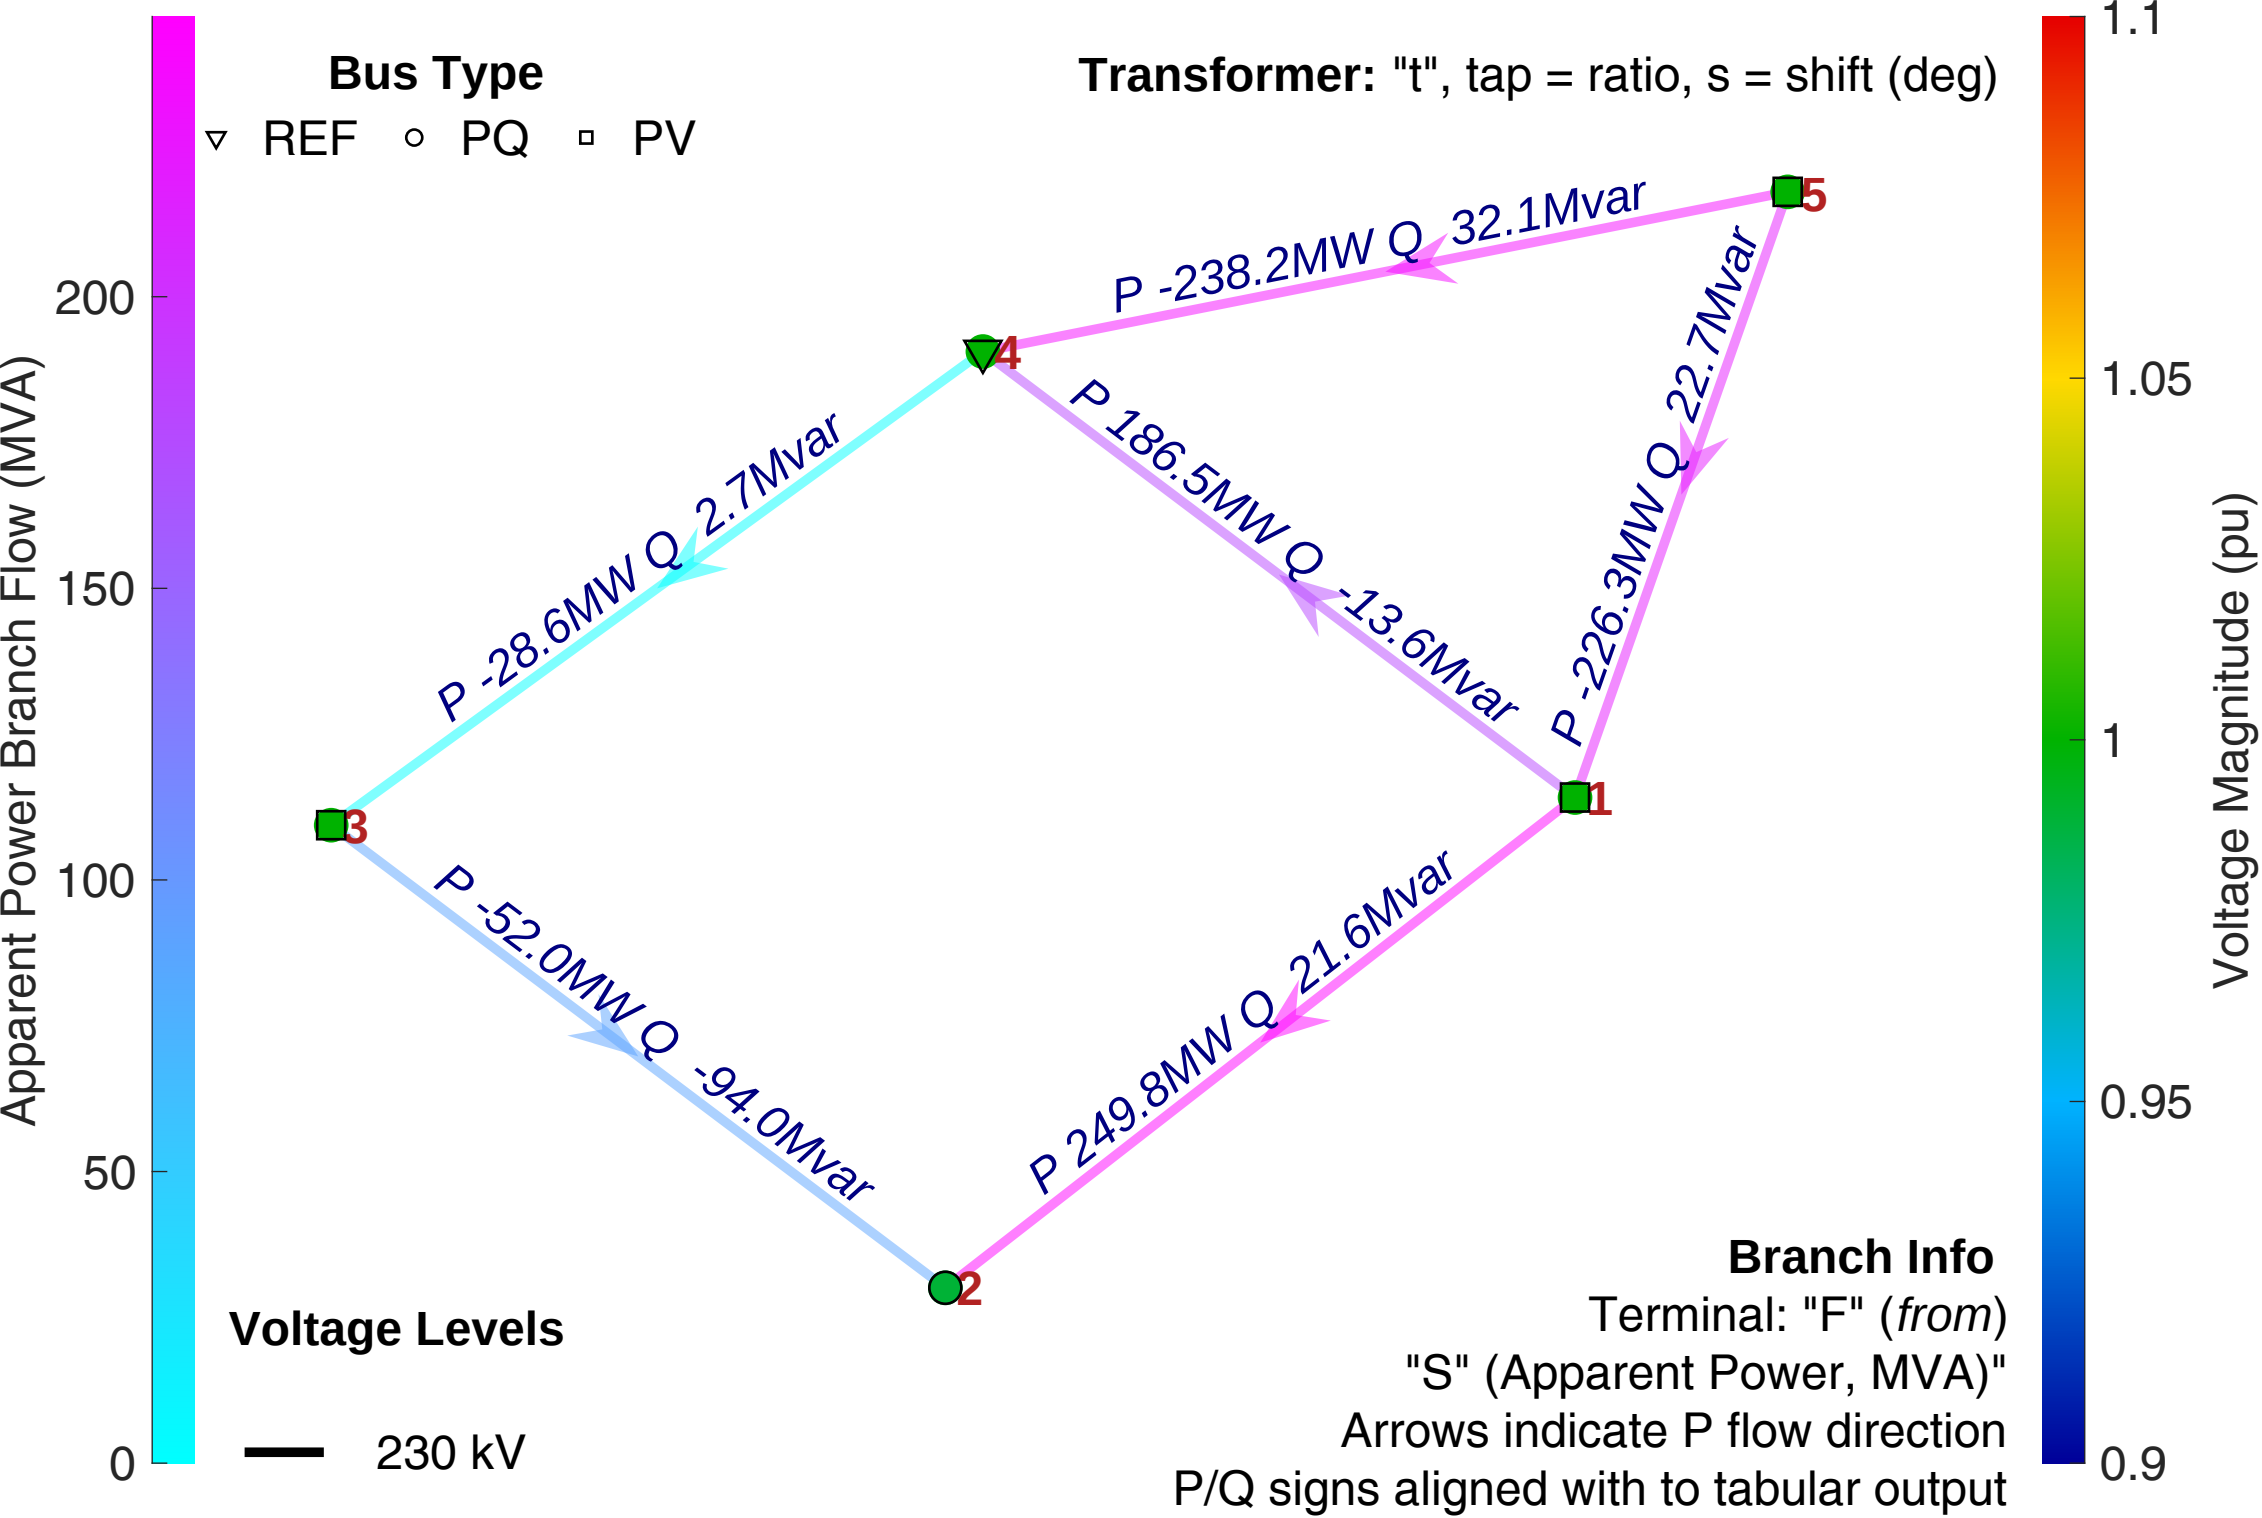

Bus Type
REF
PQ
PV
Transformer: "t", tap = ratio, s = shift (deg)
Apparent Power Branch Flow (MVA)
200
150
100
50
0
Voltage Magnitude (pu)
1.1
1.05
1
0.95
0.9
1
2
3
4
5
P -238.2MW Q 32.1Mvar
P 186.5MW Q -13.6Mvar
P -28.6MW Q 2.7Mvar
P -226.3MW Q 22.7Mvar
P -52.0MW Q -94.0Mvar
P 249.8MW Q 21.6Mvar
Voltage Levels
230 kV
Branch Info
Terminal: "F" (from)
"S" (Apparent Power, MVA)"
Arrows indicate P flow direction
P/Q signs aligned with to tabular output