

# Enhancing the German Transmission Grid through Dynamic Line Rating

Philipp Glaum

Fabian Hofmann

Institute of Energy Technology

Technical University Berlin

Berlin, Germany

p.glaum@tu-berlin.de

**Abstract**—According to recently announced plans of the German Federal Government, the German power system is facing an ongoing transition from conventional to renewable power generation, which should supply 80% of the total demand by 2030. One key task lays in reorganizing the transmission system such that power can be transported from sites with good renewable potentials to the load centers. As the literature shows a system-wide implementation of Dynamic Line Rating (DLR), a dynamic calculation of the transmission line capacities based on prevailing weather conditions, can act as an important complement to building new transmission lines. On behalf of a detailed power system model including all of today's extra high voltage transmission lines and substations, we show how synergies between DLR and an increased wind power generation leverage, leading to an overall cost-benefit of XX% for the 2030 goals compared to a system without DLR.

**Index Terms**—Power system analysis computing, Power System Management, Power System Planning, Renewable energy sources

## I INTRODUCTION

The deployment of new renewable energy sources far from load centers is leading to an increasing need for grid capacity. A notable example can be found in Germany, where most of the wind energy is generated in the North while there is significant industrial demand in the South [1]. Whereas the current federal government plans to add ~70 GW wind power capacity until 2030, only a few grid expansion projects have been realized [2], [3]. Moreover, most of these projects have been delayed due to administrative problems and protest activities [4], [5]. This trend will likely exacerbate transmission system congestion, which may lead to more grid instability and curtailment [6]. There is therefore a strong incentive to exploit existing grid infrastructure more fully.

To overcome the mismatch between slow installation of new transmission lines and rapid installation of new renewable generation, several approaches can be taken that must be

reconciled: (1) large scale implementation of storage facilities in order to flatten power feed-ins and power demands [7]; (2) usage of alternative energy carrier networks to relieve the electricity grid [8]; (3) leveraging the existing grid infrastructure to increase the operating capacity. Note that in a smart setup, these points complement each other. In the following, we will focus on the last point. In comparison to the first two points, it is straight-forward, cheap and non-invasive to implement and does not require conversion technologies which (yet) suffer from high prices and comparably low round-trip efficiencies [9], [10].

Traditionally, transmission line capacity is calculated assuming unfavorable, static weather conditions such as 40°C ambient temperature and 0.6m/s wind speed [11]. This is referred to as Static Line Rating (SLR). By design, SLR underestimates the capacity of a transmission line and, when implemented in practice, leads to an overestimated transmission capacity. In contrast, Dynamic Line Rating (DLR) calculates the line capacity taking into account the prevailing weather conditions. Cold weather and wind cool overheated transmission lines, enabling the thermal rating to be raised. This results in key benefits in cost-efficiency, congestion reduction and better wind power integration [12]. So far, the literature provides case studies considering DLR in small scale Energy System Optimization Models (ESOMs) [13]–[15]. However, it is lacking of an extensive evaluation and assessment of DLR being applied to a higher scale ESOM considering capacity expansion and a CO<sub>2</sub> target.

This paper addresses this gap. We model and analyze the impact of DLR on the optimal dispatch and deployment of power generators in the German electricity sector. The underlying model is created from the PyPSA-Eur framework [16], and for Germany consists of XX representative nodes and considers a time horizon of one year with an hourly resolution. To model the effect of DLR on the power system, we use the IEEE standard [17] with highly resolved historical weather data implemented in the Atlite software [18]. The advantages of the DLR are illustrated by

comparison with an SLR-based system. Therefore, we analyze and compare curtailment, grid congestion as well as the optimal generator deployment.

## II METHODOLOGY

### II.A Dynamic Line Rating

For simulating the effect of DLR, we follow the IEEE standard documented in [17], [19]. The methodology was integrated into the Atlite software [18], a Python package used for converting weather data into time-series and energy potential of renewable power generation.

The key concept of DLR is based on a dynamic estimation of the maximally allowed electrical current  $I_{max}$  for the conducting material [20]. It is set such that the conductor does not surpass the maximally allowed temperature  $T_{max}$  after which impermissible sag of the line or hardware damage can be expected. For each conductor, the heat balance equation

$$q_c + q_r = q_s + I^2 \cdot R(T) \quad (1)$$

relates the heat losses on the left hand side, comprising the convective heat loss  $q_c$  and the radiated heat loss  $q_r$ , to the heat gains on the right hand side, comprising the solar heat gain  $q_s$  and the resistive heat gain  $I^2 R(T)$  for an electrical current  $I$  and temperature dependent resistance  $R(T)$ . The latter can be approximated by linearly extrapolating from reference resistance  $R_{ref} = R(T_{ref})$  using a material specific temperature coefficient  $\alpha$ , i.e.

$$R(T) = R_{ref} \cdot (1 + \alpha \cdot (T - T_{ref})) \quad (2)$$

Solving (1) for the electrical current and setting the temperature to its maximal allowed limit yields the maximally allowed current

$$I_{max} = \sqrt{\frac{q_c + q_r - q_s}{R(T_{max})}} \quad (3)$$

which for three-phase electric power transmission operating at voltage level  $V$  directly leads to the maximally power transfer

$$P_{max} = \sqrt{3} \cdot I_{max} \cdot V \quad (4)$$

Fig. 1 shows the maximally allowed power transmission for different environmental conditions.

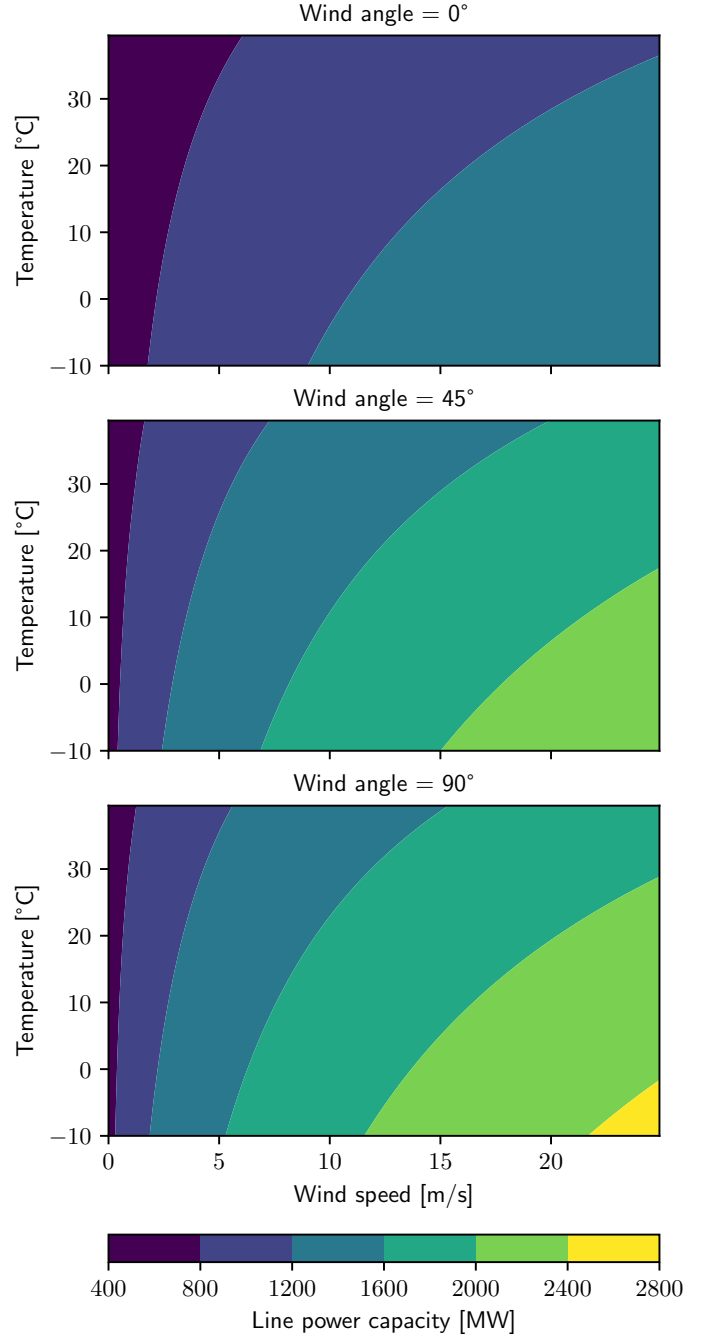


Figure 1: Power Rating for different prevailing weather conditions

## II.B Power System Modelling

Software, Topology data, Power Plant data, approximations, optimization,

## III RESULTS

### I.A Effect on Optimal Operation of the Existing Power System

Germany 2019

### I.B Effect on Optimal Operation and Investment

Germany 2030

## IV DISCUSSION

Given an adequate size ratio, wind farms together with hydrogen stores can provide a base load preventing high pressure on the transmission system. However, the economic feasibility for a large scale implementation of hydrogen stores is not yet fully given, mainly due to relatively low round-trip efficiencies and (yet) high prices of conversion and storage components.

By converting renewable energy to Methan, Hydrogen of synthetic fuels, the energy can be transported through the existing or new built transport system, as for example planned by the European Hydrogen Backbone initiative (Citation). Again, this requires high investments as well as a long planning phase, thus cannot be considered as a short term measure.

## REFERENCES

- [1] O. Kühne and F. Weber, "Conflicts and negotiation processes in the course of power grid extension in Germany," *Landsc. Res.*, vol. 43, no. 4, pp. 529–541, May 2018, doi: 10.1080/01426397.2017.1300639.
- [2] Federal Ministry of Economic Affairs and Climate Action, "Germany's current climate action status," Jan. 2022. Accessed: Jan. 28, 2022. [Online]. Available: <https://www.bmwi.de/Redaktion/EN/Downloads/E/germany-s-current-climate-action-status.html>
- [3] P. D. B. Burger, "Energy-Charts." <https://energy-charts.info/?l=de&c=DE> (accessed Jan. 28, 2022).
- [4] M. Neukirch, "Protests against German electricity grid extension as a new social movement? A journey into the areas of conflict," *Energy Sustain. Soc.*, vol. 6, no. 1, p. 4, Dec. 2016, doi: 10.1186/s13705-016-0069-9.
- [5] E. Fernandez, I. Albizu, M. T. Bedialauneta, A. J. Mazon, and P. T. Leite, "Review of dynamic line rating systems for wind power integration," *Renew. Sustain. Energy Rev.*, vol. 53, pp. 80–92, Jan. 2016, doi: 10.1016/j.rser.2015.07.149.
- [6] F. G. Erdinç, O. Erdinç, R. Yumurtacı, and J. P. S. Catalão, "A comprehensive overview of dynamic line rating combined with other flexibility options from an operational point of view," *Energies*, vol. 13, no. 24, p. 6563, Dec. 2020, doi: 10.3390/en13246563.
- [7] Y. Li *et al.*, "Day-ahead scheduling of power system incorporating network topology optimization and dynamic thermal rating," *IEEE Access*, vol. 7, pp. 35287–35301, 2019, doi: 10.1109/ACCESS.2019.2904877.
- [8] M. Dabbaghjamanesh, A. Kavousi-Fard, and S. Mehraeen, "Effective scheduling of reconfigurable microgrids with dynamic thermal line rating," *IEEE Trans. Ind. Electron.*, vol. 66, no. 2, pp. 1552–1564, Feb. 2019, doi: 10.1109/TIE.2018.2827978.
- [9] N. Viafora, K. Morozovska, S. H. H. Kazmi, T. Laneryd, P. Hilber, and J. Holbøll, "Day-ahead dispatch optimization with dynamic thermal rating of transformers and overhead lines," *Electr. Power Syst. Res.*, vol. 171, pp. 194–208, 2019.
- [10] J. Hörsch, F. Hofmann, D. Schlachtberger, and T. Brown, "PyPSA-Eur: An open optimisation model of the European transmission system," *Energy Strategy Rev.*, vol. 22, pp. 207–215, Nov. 2018, doi: 10.1016/j.esr.2018.08.012.
- [11] "IEEE Standard for Calculating the Current-Temperature Relationship of Bare Overhead Conductors," IEEE. doi: 10.1109/IEEESTD.2013.6692858.
- [12] F. Hofmann, J. Hampp, F. Neumann, T. Brown, and J. Hörsch, "atlite: A Lightweight Python Package for Calculating Renewable Power Potentials and Time Series," *J. Open Source Softw.*, vol. 6, no. 62, p. 3294, Jun. 2021, doi: 10.21105/joss.03294.