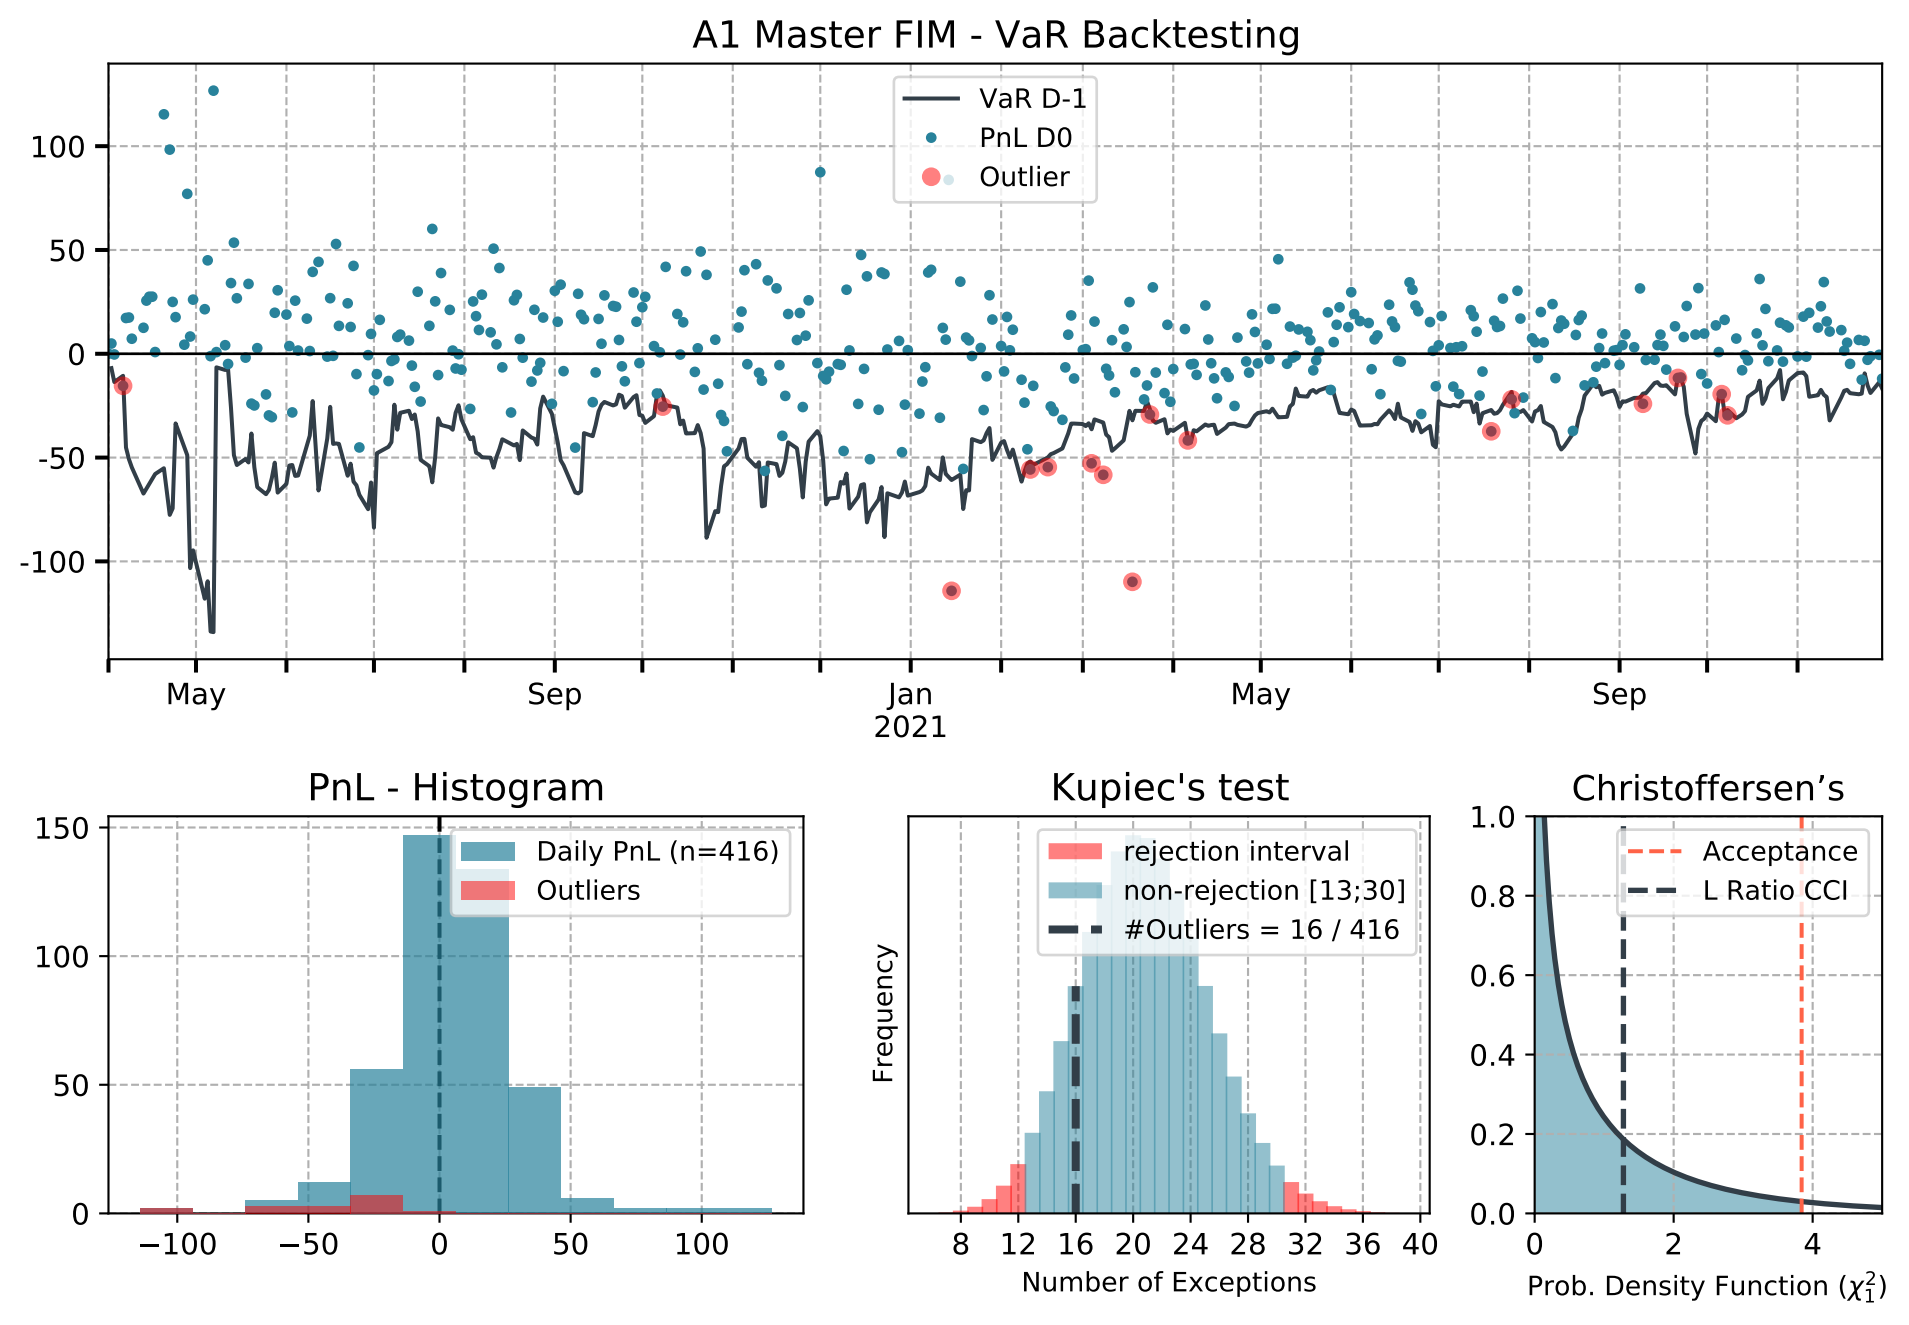
A1 Master FIM - VaR Backtesting
VaR D-1
PnL D0
Outlier
100
50
0
-50
-100
May
Sep
Jan
2021
May
Sep
PnL - Histogram
Daily PnL (n=416)
Outliers
150
100
50
0
−100
−50
0
50
100
Kupiec's test
rejection interval
non-rejection [13;30]
#Outliers = 16 / 416
Frequency
8
12
16
20
24
28
32
36
40
Number of Exceptions
Christoffersen’s
Acceptance
L Ratio CCI
1.0
0.8
0.6
0.4
0.2
0.0
0
2
4
Prob. Density Function (χ_1^2)