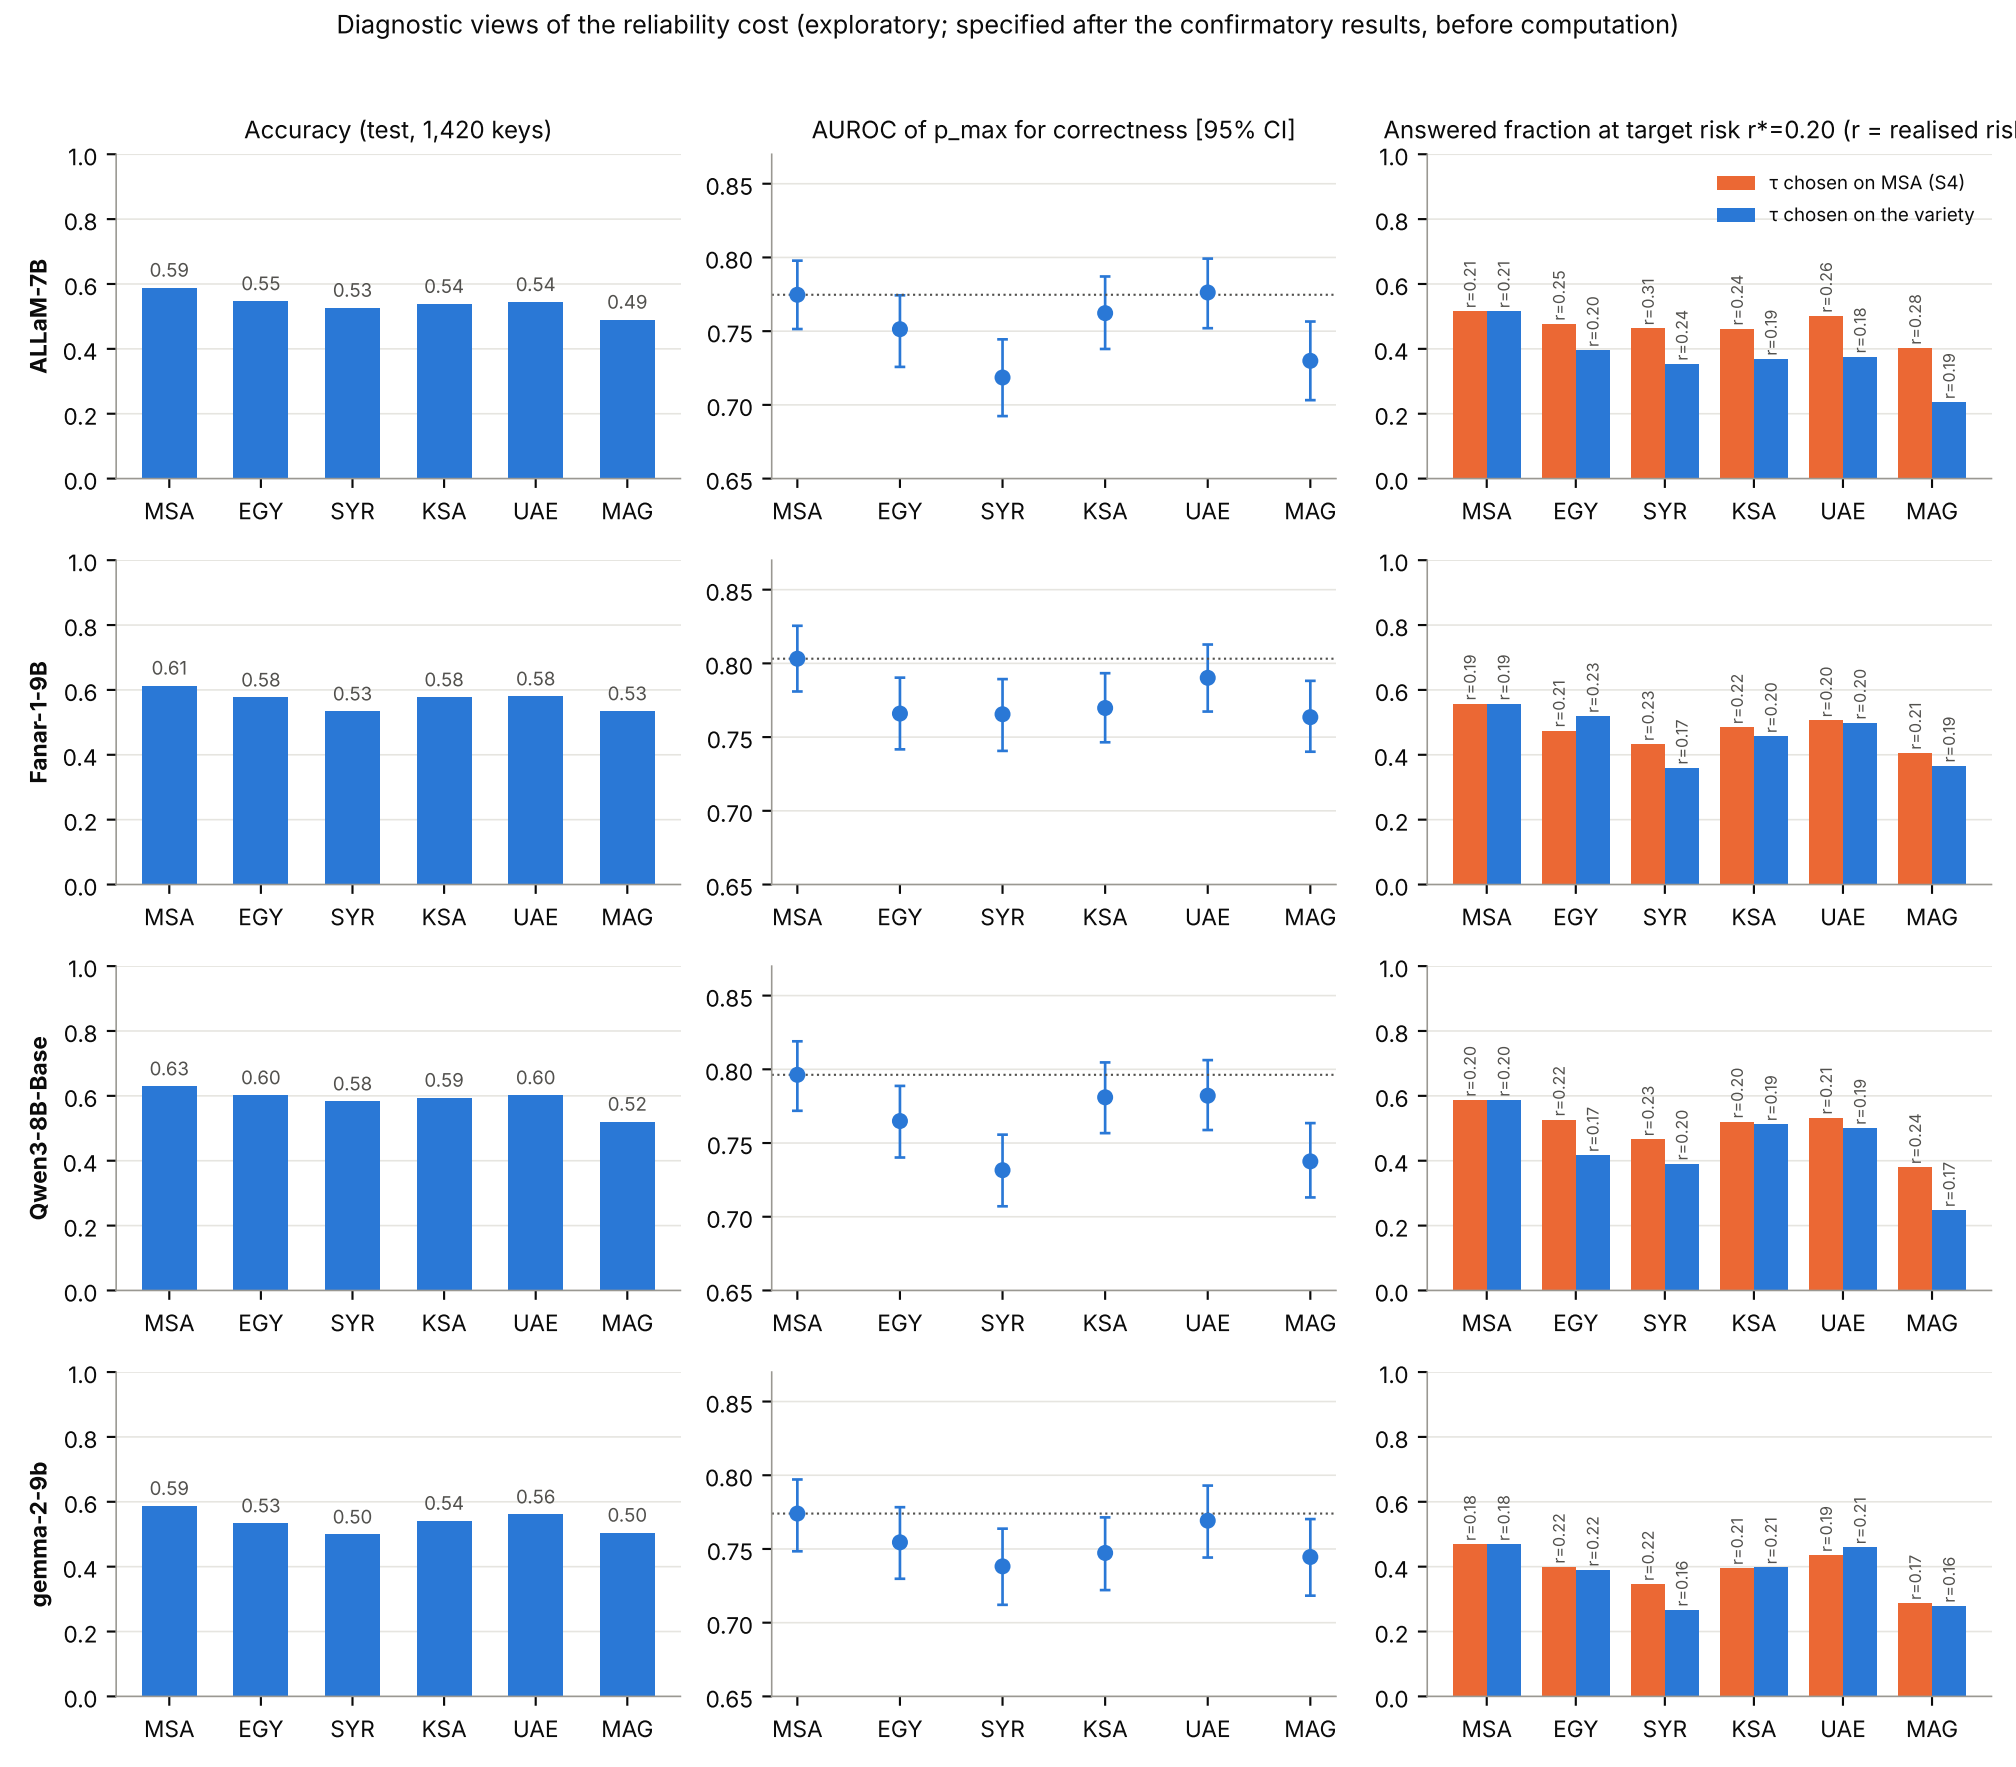
Diagnostic views of the reliability cost (exploratory; specified after the confirmatory results, before computation)
Accuracy (test, 1,420 keys)
AUROC of p_max for correctness [95% CI]
Answered fraction at target risk r*=0.20 (r = realised ris
τ chosen on MSA (S4)
τ chosen on the variety
ALLaM-7B
Fanar-1-9B
Qwen3-8B-Base
gemma-2-9b
MSA
EGY
SYR
KSA
UAE
MAG
0.59
0.55
0.53
0.54
0.54
0.49
0.61
0.58
0.53
0.58
0.58
0.53
0.63
0.60
0.58
0.59
0.60
0.52
0.59
0.53
0.50
0.54
0.56
0.50
r=0.21
r=0.21
r=0.25
r=0.20
r=0.31
r=0.24
r=0.24
r=0.19
r=0.26
r=0.18
r=0.28
r=0.19
r=0.19
r=0.19
r=0.21
r=0.23
r=0.23
r=0.17
r=0.22
r=0.20
r=0.20
r=0.20
r=0.21
r=0.19
r=0.20
r=0.20
r=0.22
r=0.17
r=0.23
r=0.20
r=0.20
r=0.19
r=0.21
r=0.19
r=0.24
r=0.17
r=0.18
r=0.18
r=0.22
r=0.22
r=0.22
r=0.16
r=0.21
r=0.21
r=0.19
r=0.21
r=0.17
r=0.16