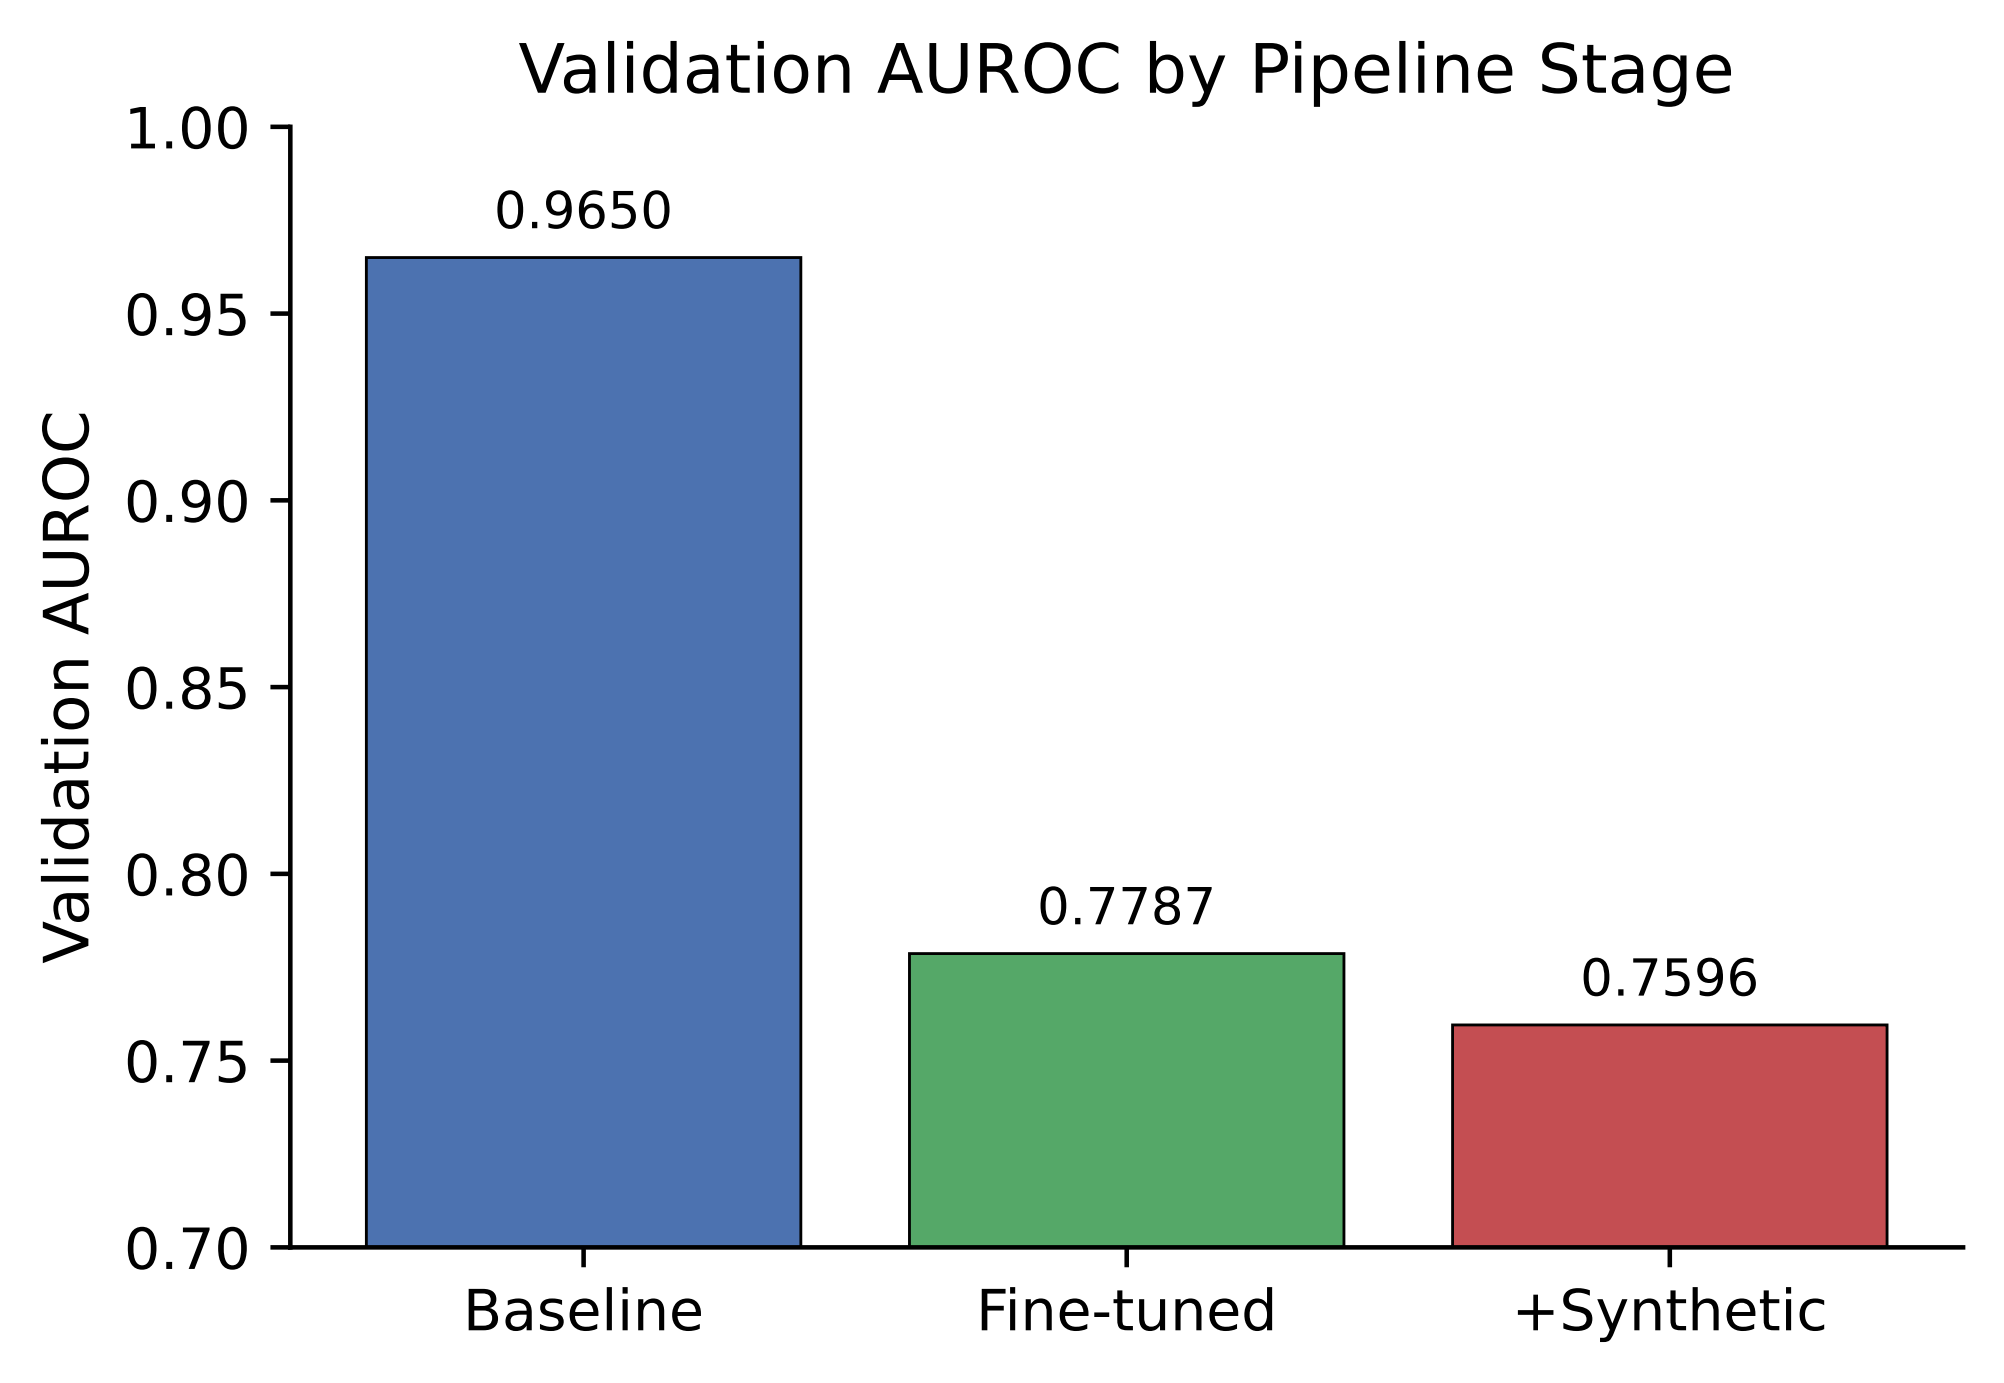
Validation AUROC by Pipeline Stage
Validation AUROC
1.00
0.95
0.90
0.85
0.80
0.75
0.70
0.9650
0.7787
0.7596
Baseline
Fine-tuned
+Synthetic