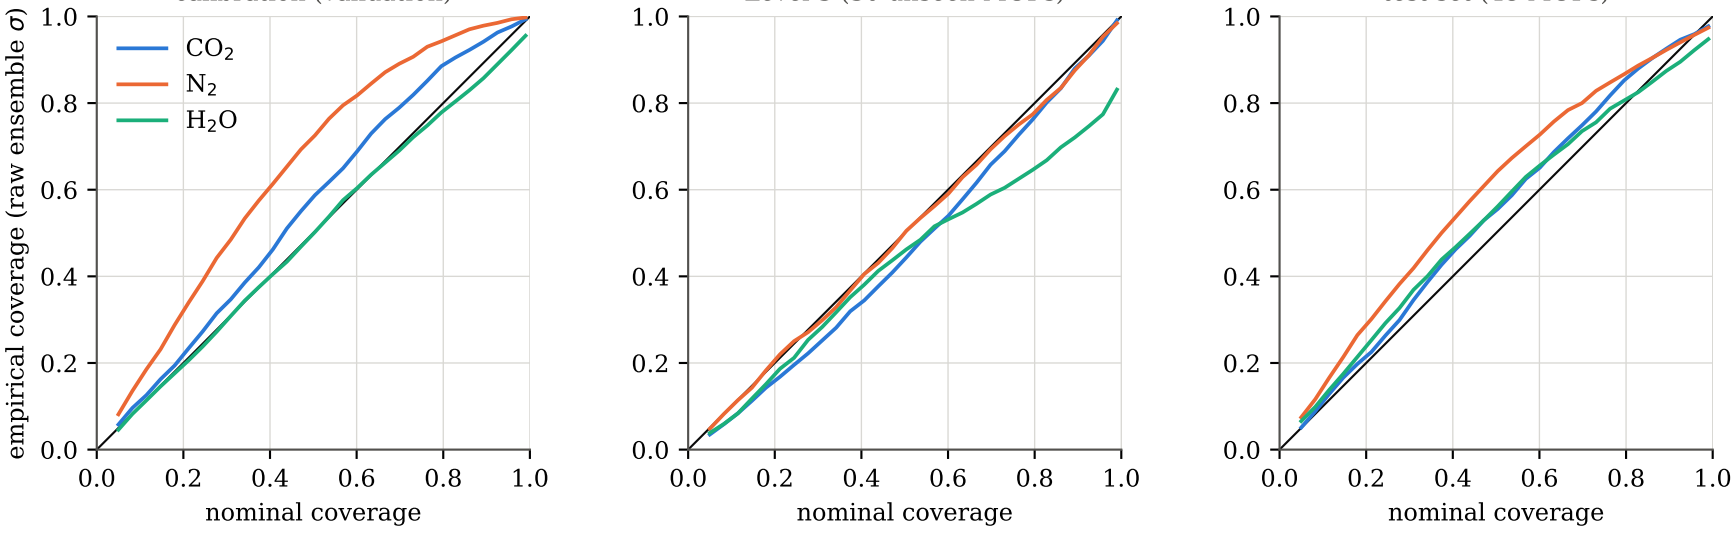
calibration (validation)
Level 3 (30 unseen MOFs)
test set (48 MOFs)
empirical coverage (raw ensemble σ)
nominal coverage
CO2
N2
H2O
0.0
0.2
0.4
0.6
0.8
1.0