DOCUMENT TRANSMITTAL (DUMMY DATA - not a real facility)

Transmittal No. TX-0057 Unit 100 - Feed Gas Inlet P&ID set

PID-100-001 Rev D FEED GAS INLET - INLET KO DRUM V-1002
PID-100-002 Rev B FEED GAS INLET - PRESSURE CONTROL AND EXPORT
PID-100-003 Rev A FEED GAS INLET - UTILITY CONNECTIONS

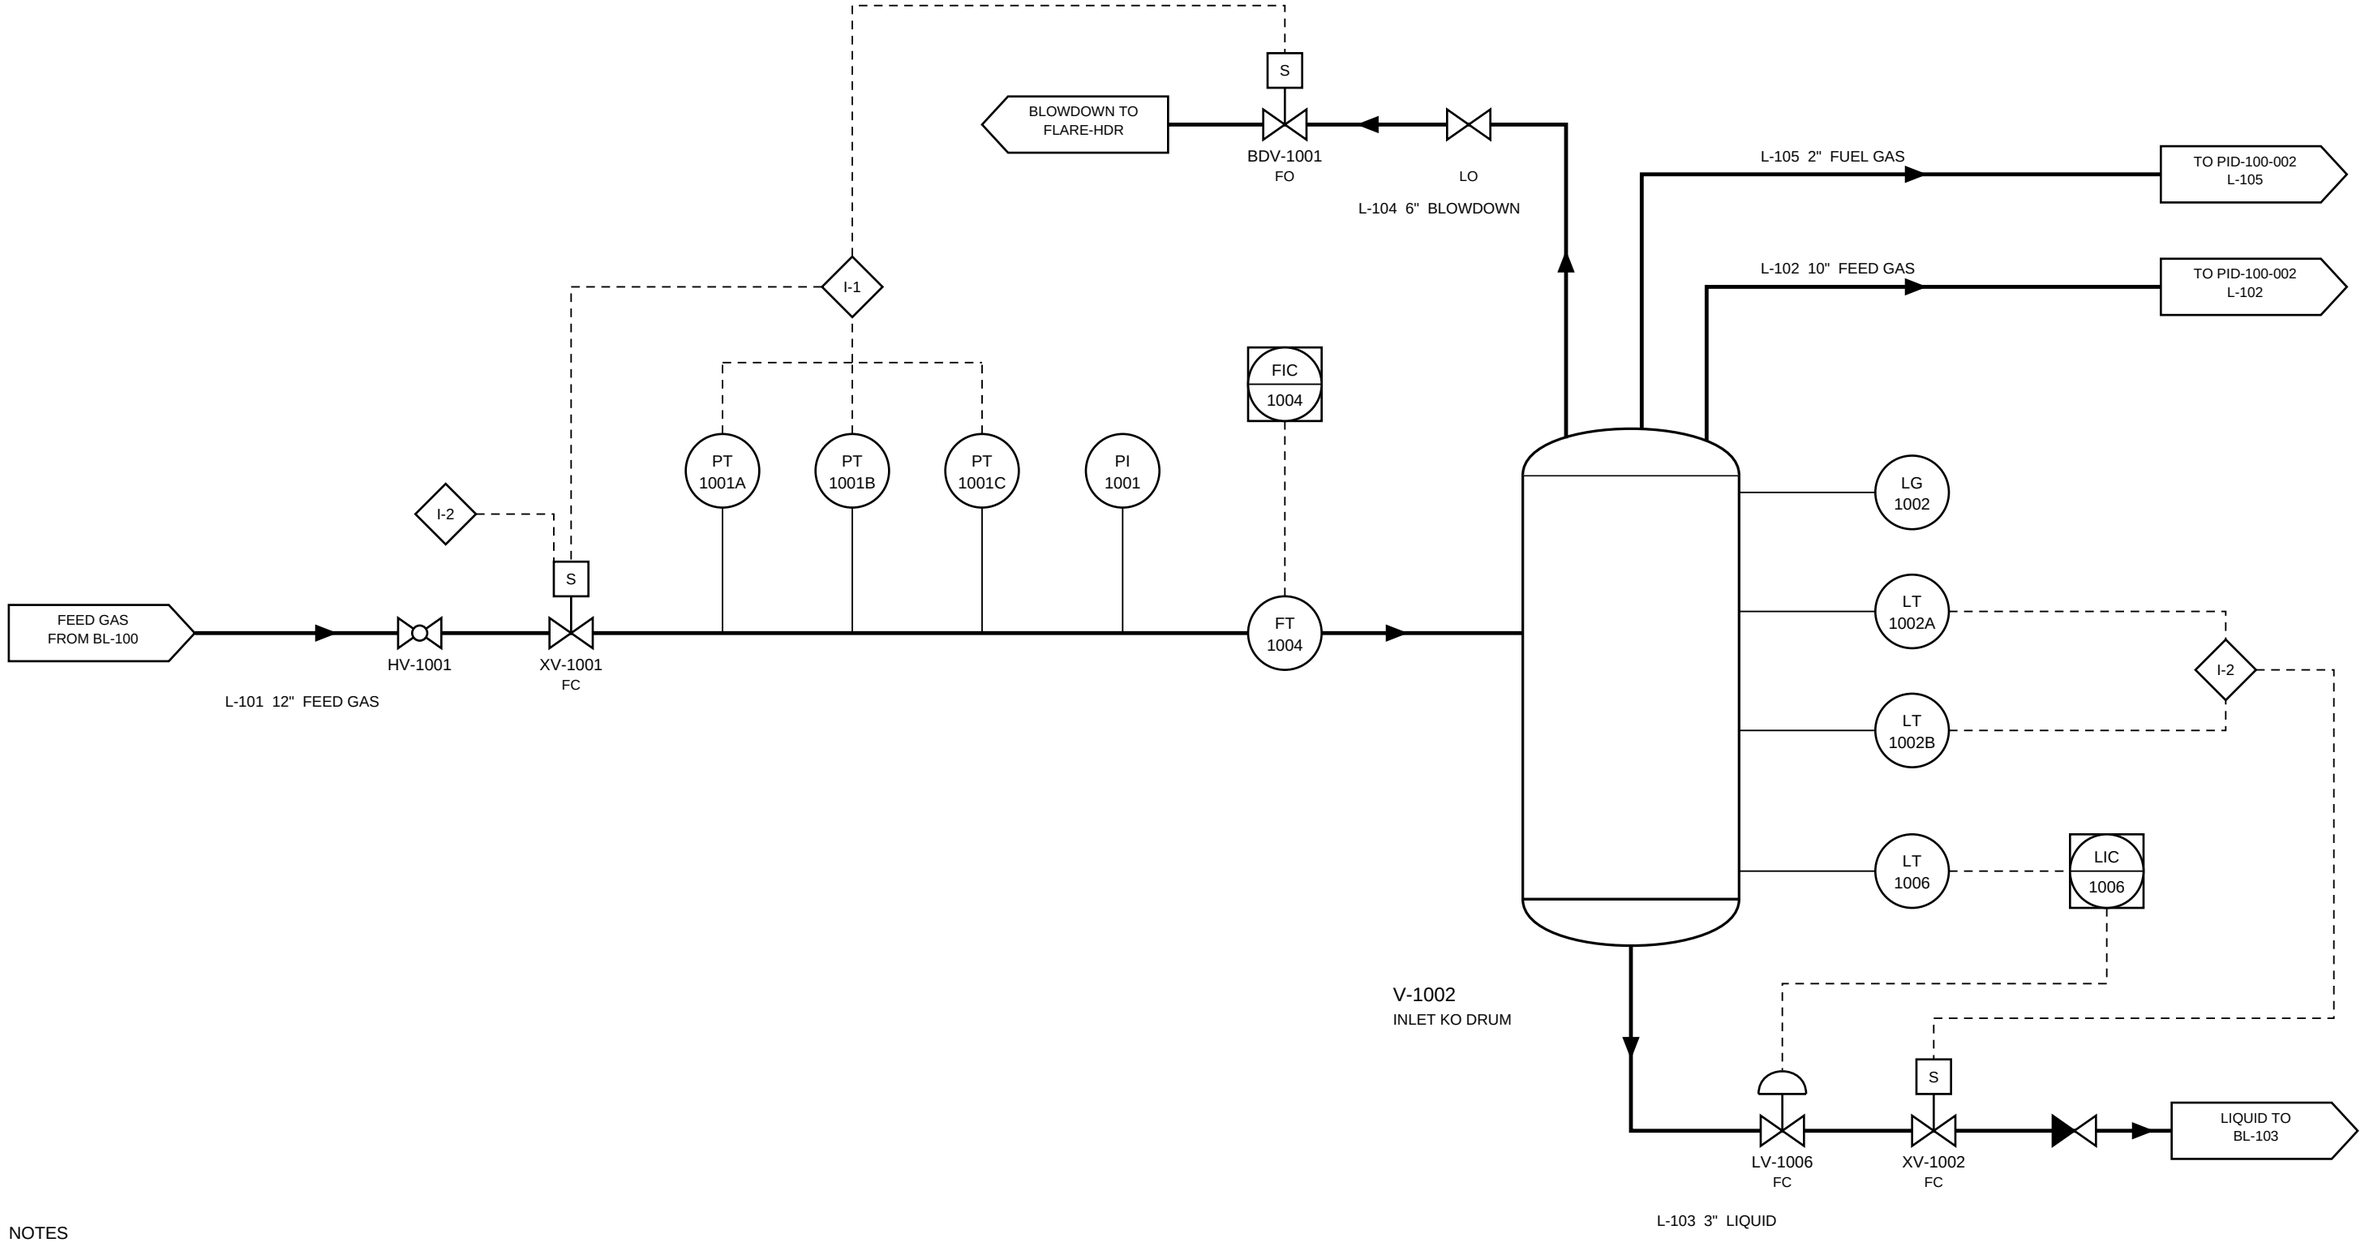

NOTES

1. I-1 = SIF-100-01: PT-1001A/B/C HIGH-HIGH (2oo3) CLOSES XV-1001 AND OPENS BDV-1001.
2. I-2 = SIF-100-02: LT-1002A/B HIGH-HIGH (2oo3) CLOSES XV-1001 AND XV-1002.
3. LO = LOCKED OPEN. FC / FO = FAIL CLOSED / FAIL OPEN.
4. DASHED LINES ARE ELECTRICAL SIGNALS. SQUARED BUBBLES ARE DCS FUNCTIONS.
5. DUMMY DATA - NOT A REAL FACILITY.

DUMMY LNG PROJECT - UNIT 100 FEED GAS INLET

TITLE: FEED GAS INLET - INLET KO DRUM V-1002

DRAWING NO. PID-100-001 REV. D

SHEET 1 OF 1 SCALE: NTS

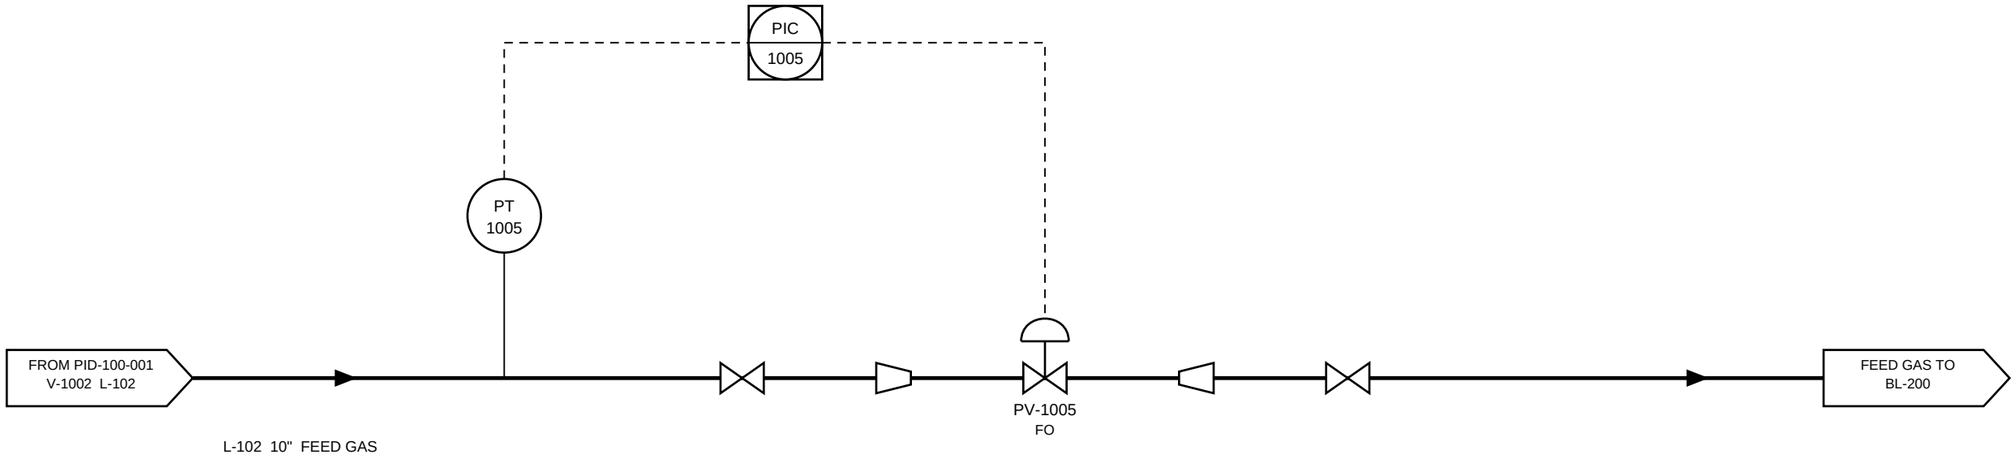

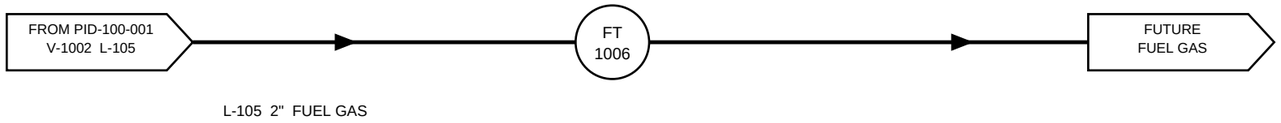

NOTES

1. FC / FO = FAIL CLOSED / FAIL OPEN.
2. DASHED LINES ARE ELECTRICAL SIGNALS. SQUARED BUBBLES ARE DCS FUNCTIONS.
3. DUMMY DATA - NOT A REAL FACILITY.

DUMMY LNG PROJECT - UNIT 100 FEED GAS INLET

TITLE: FEED GAS INLET - PRESSURE CONTROL AND EXPORT

DRAWING NO. PID-100-002 REV. B

SHEET 1 OF 1 SCALE: NTS



1" INSTRUMENT AIR



1" NITROGEN

NOTES

1. UTILITY LINES ARE NOT NUMBERED ON THIS SHEET.
2. DUMMY DATA - NOT A REAL FACILITY.

DUMMY LNG PROJECT - UNIT 100 FEED GAS INLET

TITLE: FEED GAS INLET - UTILITY CONNECTIONS

DRAWING NO. PID-100-003 REV. A

SHEET 1 OF 1 SCALE: NTS