




EasyBuilder 5000 software HMI:

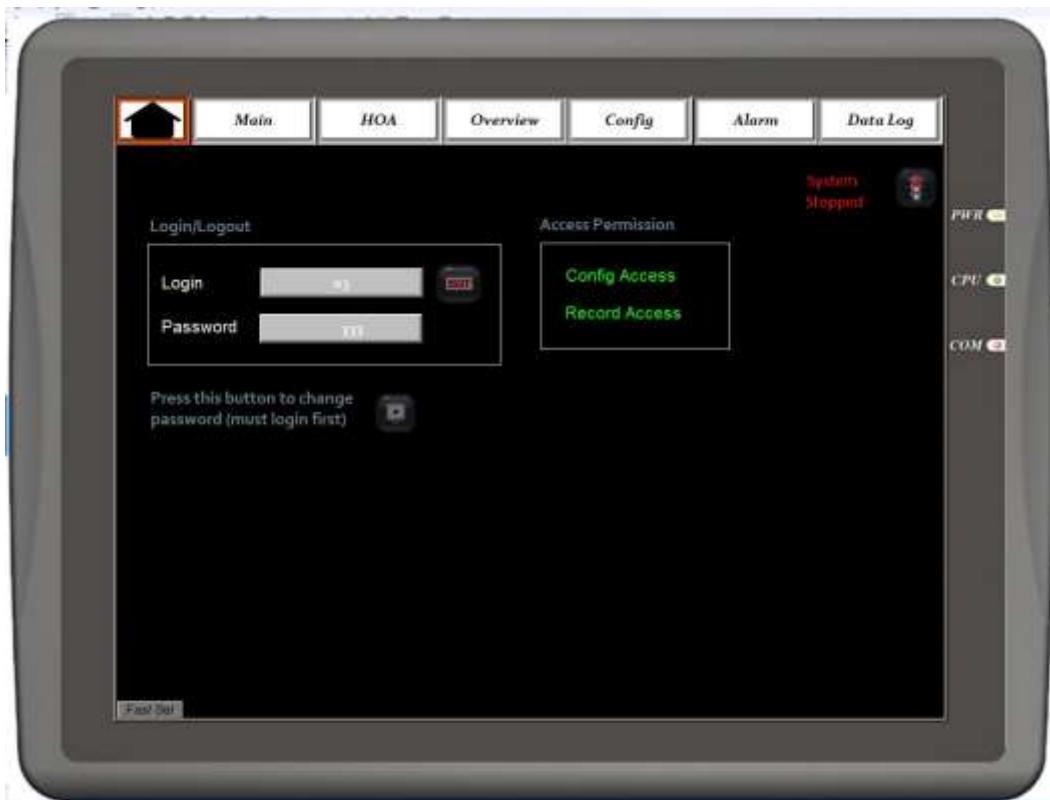

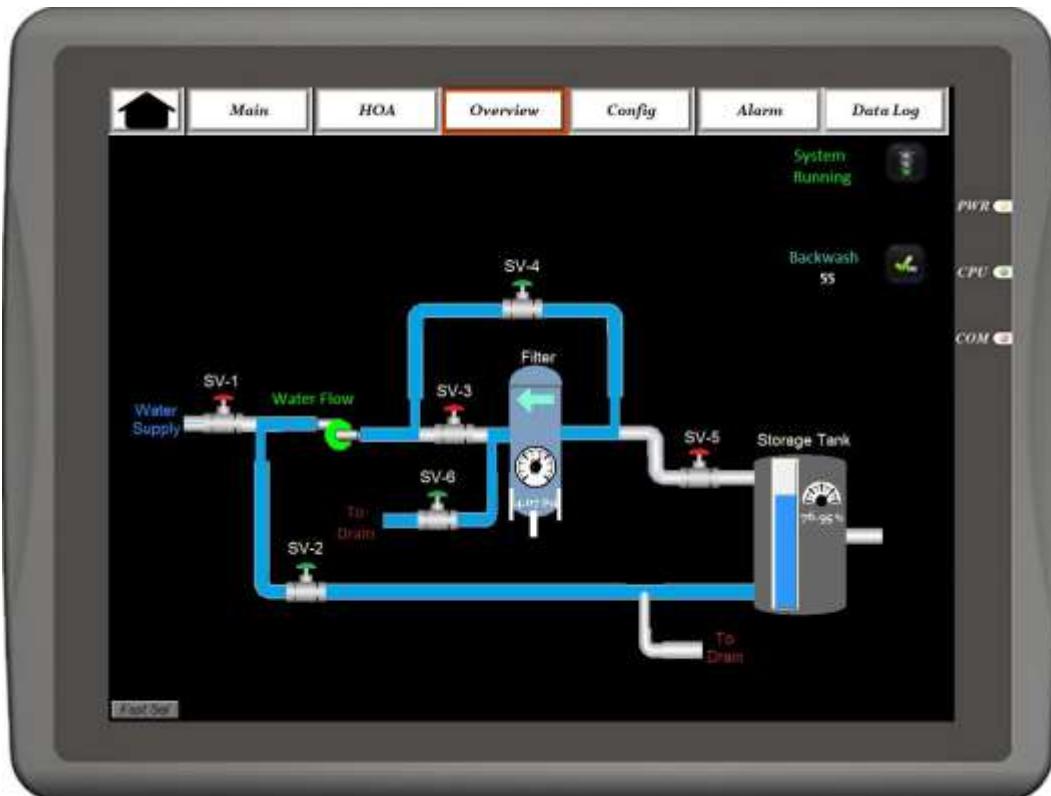

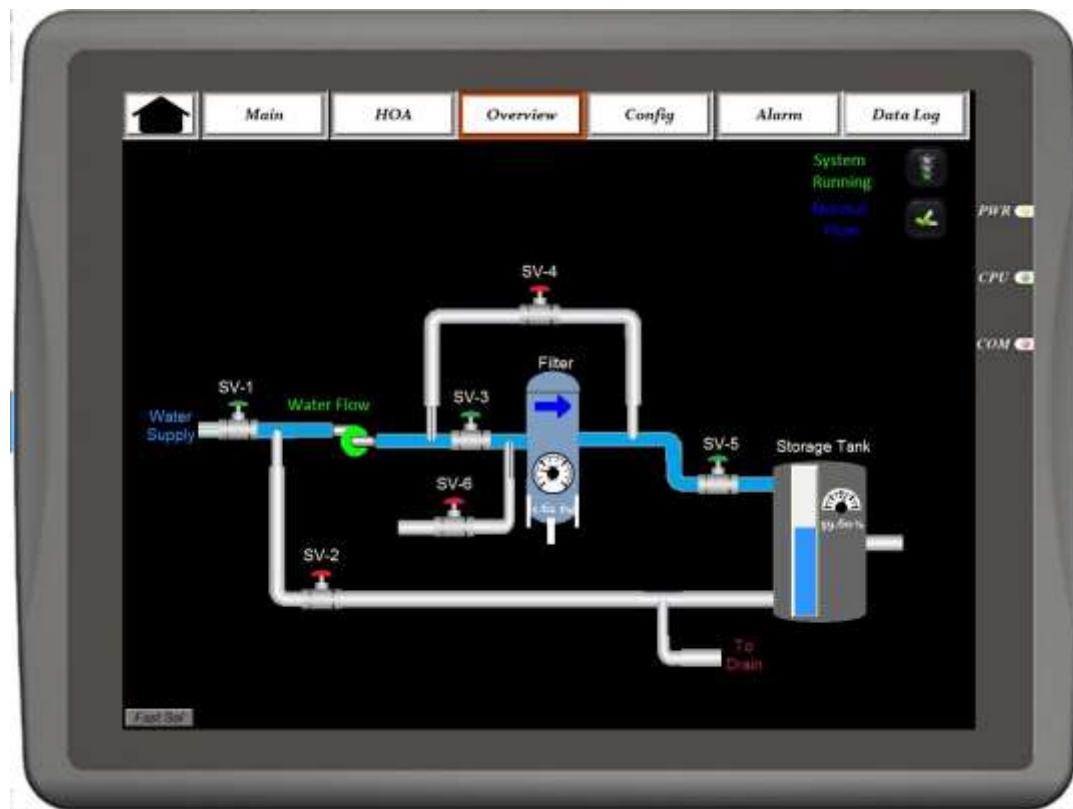

Config

| | | | | |
|--------------------------|------------|--------------------------|--------------------------|--------------------------|
| Control Set Point | | Backwash Control | | |
| Tank start filling at | 10.00 % | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Tank start drain at | 80.00 % | Enable | Disable | Manual |
| Backwash at | 05.00 Psid | Backwash is Enabled | | |
| Alarm Set Point | | | | |
| High Level Limit | 80.00 % | | | |
| Low Level Limit | 10.00 % | | | |
| High Pressure Limit | 15.00 Psid | | | |

