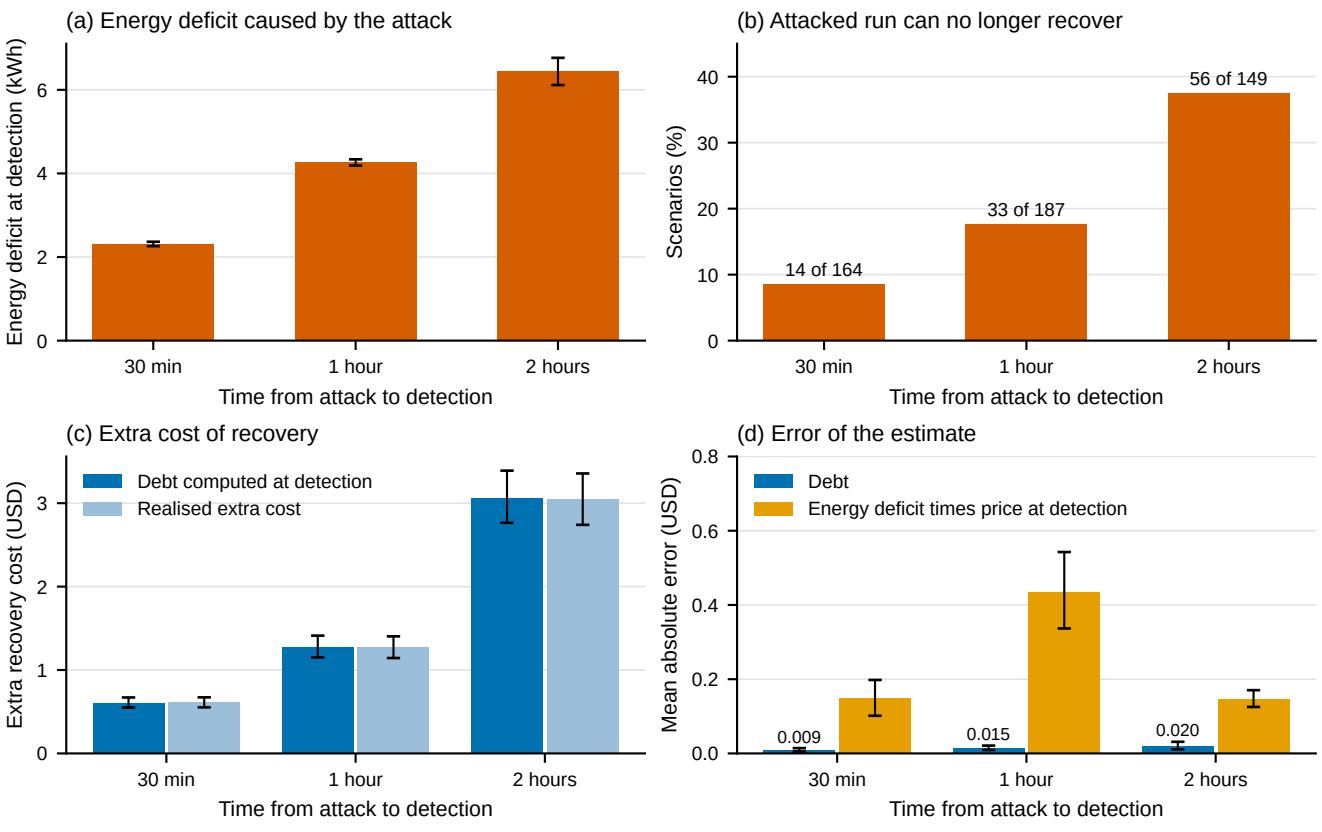
(a) Energy deficit caused by the attack
Energy deficit at detection (kWh)
0
2
4
6
30 min
1 hour
2 hours
Time from attack to detection
(b) Attacked run can no longer recover
Scenarios (%)
0
10
20
30
40
14 of 164
33 of 187
56 of 149
30 min
1 hour
2 hours
Time from attack to detection
(c) Extra cost of recovery
Extra recovery cost (USD)
Debt computed at detection
Realised extra cost
0
1
2
3
30 min
1 hour
2 hours
Time from attack to detection
(d) Error of the estimate
Mean absolute error (USD)
Debt
Energy deficit times price at detection
0.0
0.2
0.4
0.6
0.8
0.009
0.015
0.020
30 min
1 hour
2 hours
Time from attack to detection