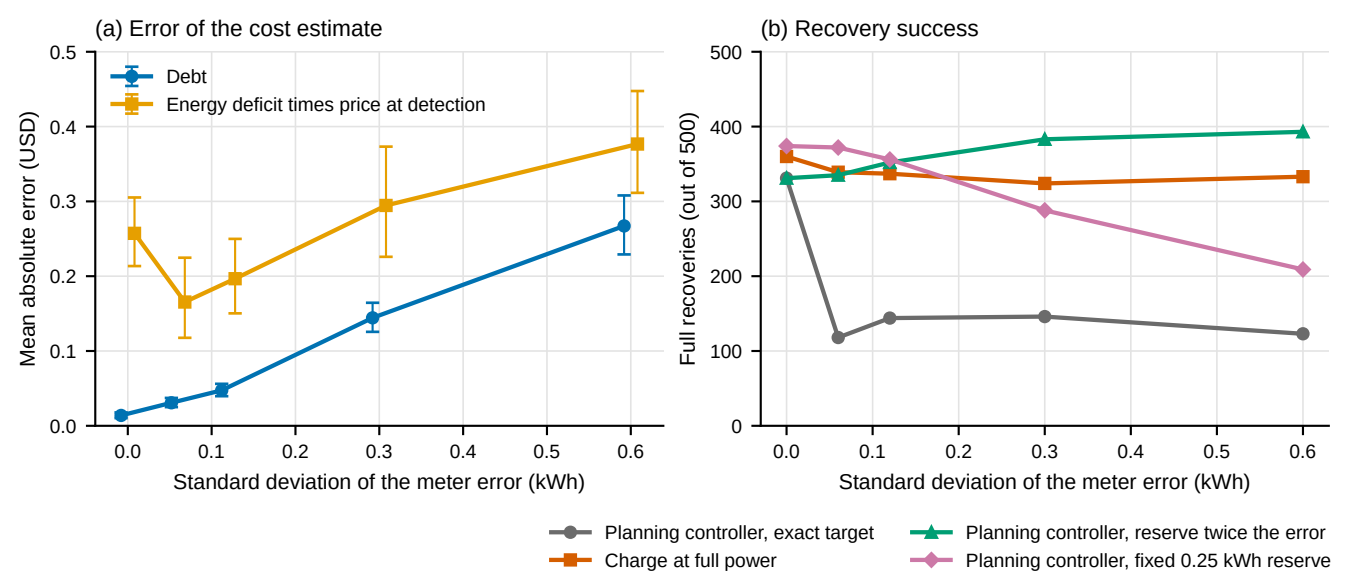
(a) Error of the cost estimate
Debt
Energy deficit times price at detection
Mean absolute error (USD)
0.0
0.1
0.2
0.3
0.4
0.5
0.0
0.1
0.2
0.3
0.4
0.5
0.6
Standard deviation of the meter error (kWh)
(b) Recovery success
Full recoveries (out of 500)
0
100
200
300
400
500
0.0
0.1
0.2
0.3
0.4
0.5
0.6
Standard deviation of the meter error (kWh)
Planning controller, exact target
Charge at full power
Planning controller, reserve twice the error
Planning controller, fixed 0.25 kWh reserve