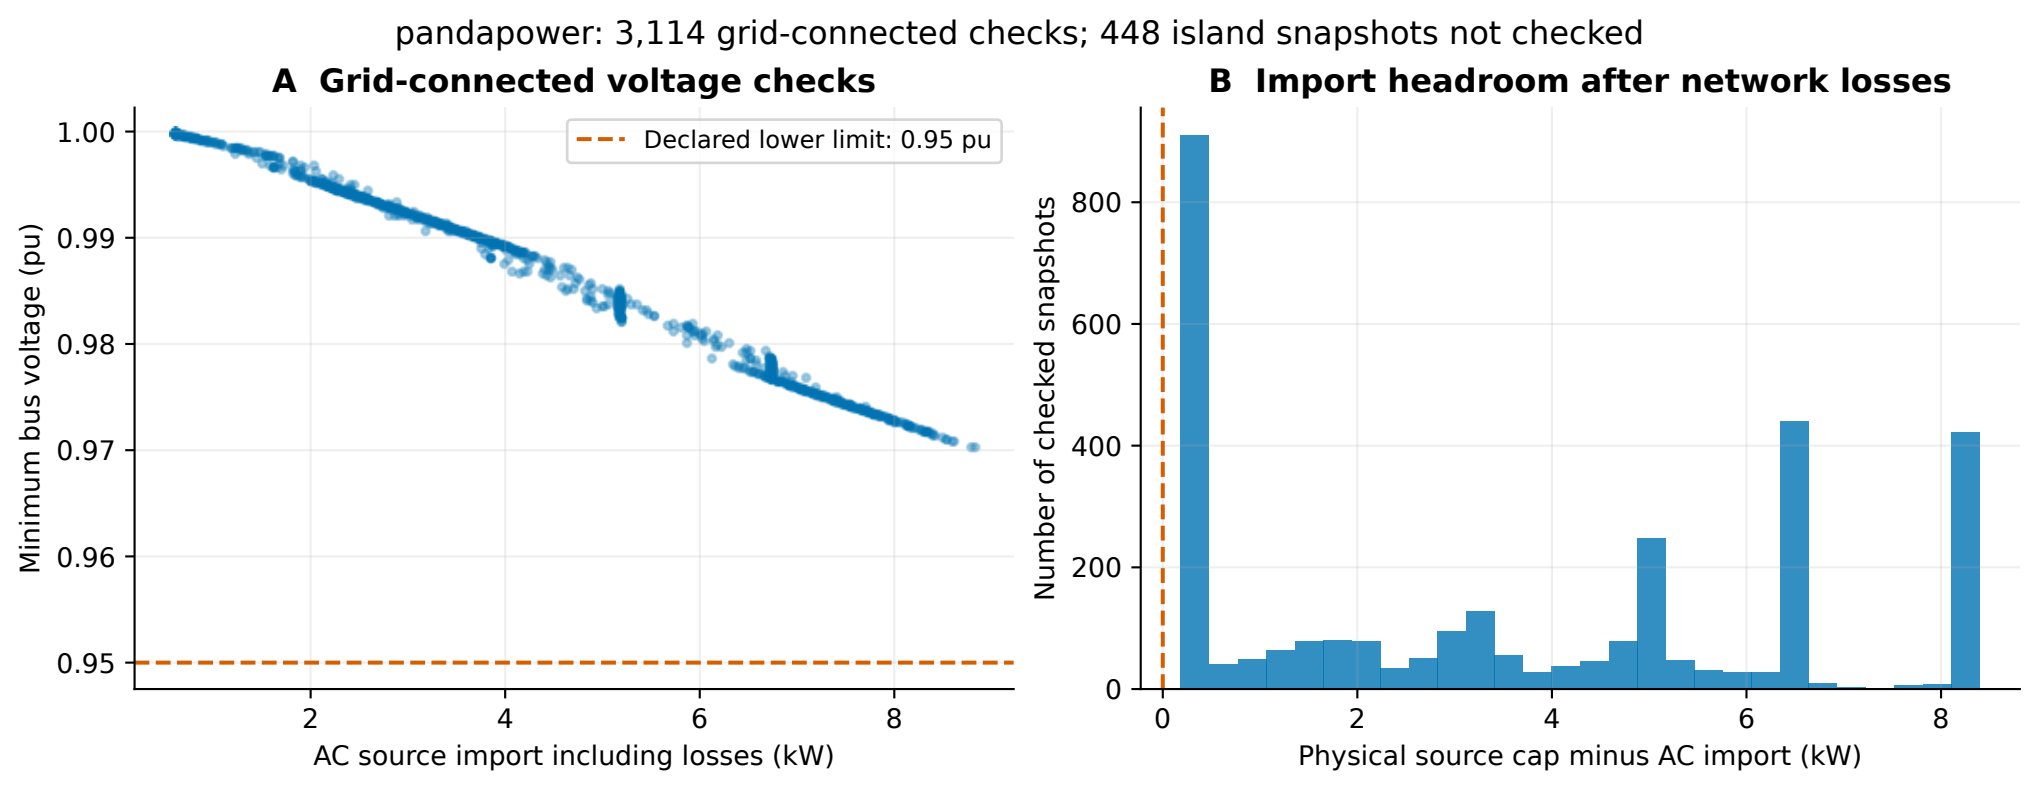
pandapower: 3,114 grid-connected checks; 448 island snapshots not checked
A Grid-connected voltage checks
Declared lower limit: 0.95 pu
Minimum bus voltage (pu)
1.00
0.99
0.98
0.97
0.96
0.95
2
4
6
8
AC source import including losses (kW)
B Import headroom after network losses
Number of checked snapshots
800
600
400
200
0
0
2
4
6
8
Physical source cap minus AC import (kW)