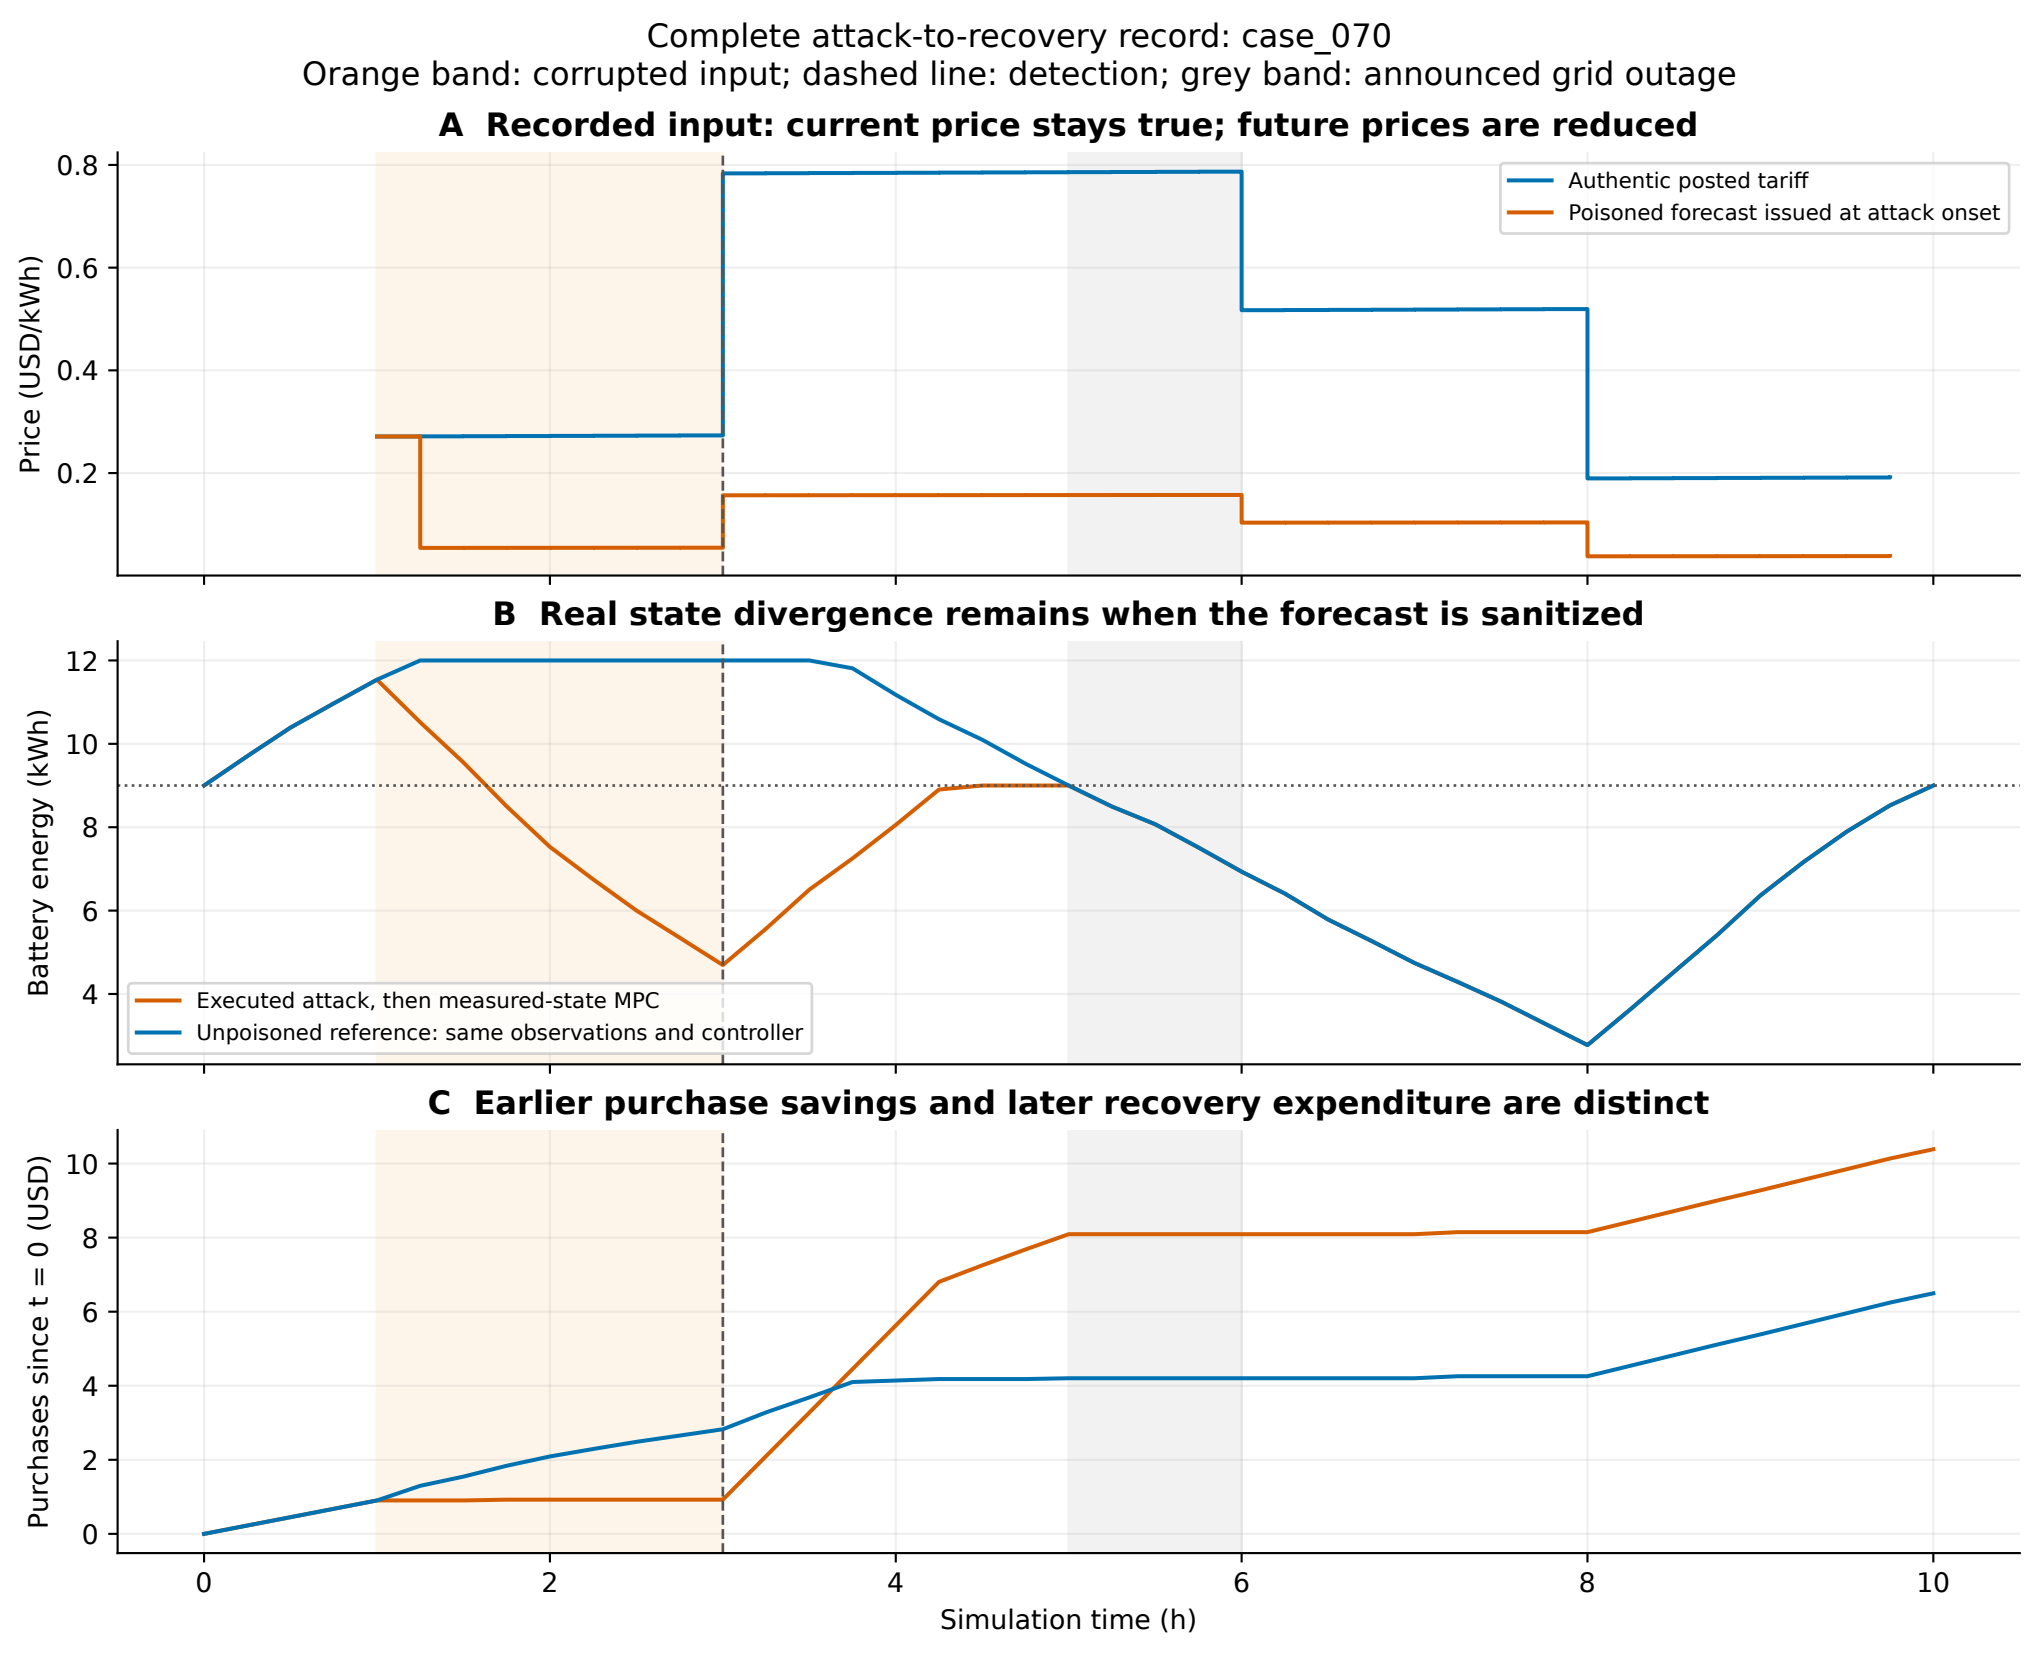
Complete attack-to-recovery record: case_070
Orange band: corrupted input; dashed line: detection; grey band: announced grid outage
A Recorded input: current price stays true; future prices are reduced
Price (USD/kWh)
0.8
0.6
0.4
0.2
Authentic posted tariff
Poisoned forecast issued at attack onset
B Real state divergence remains when the forecast is sanitized
Battery energy (kWh)
12
10
8
6
4
Executed attack, then measured-state MPC
Unpoisoned reference: same observations and controller
C Earlier purchase savings and later recovery expenditure are distinct
Purchases since t = 0 (USD)
10
8
6
4
2
0
0
2
4
6
8
10
Simulation time (h)