









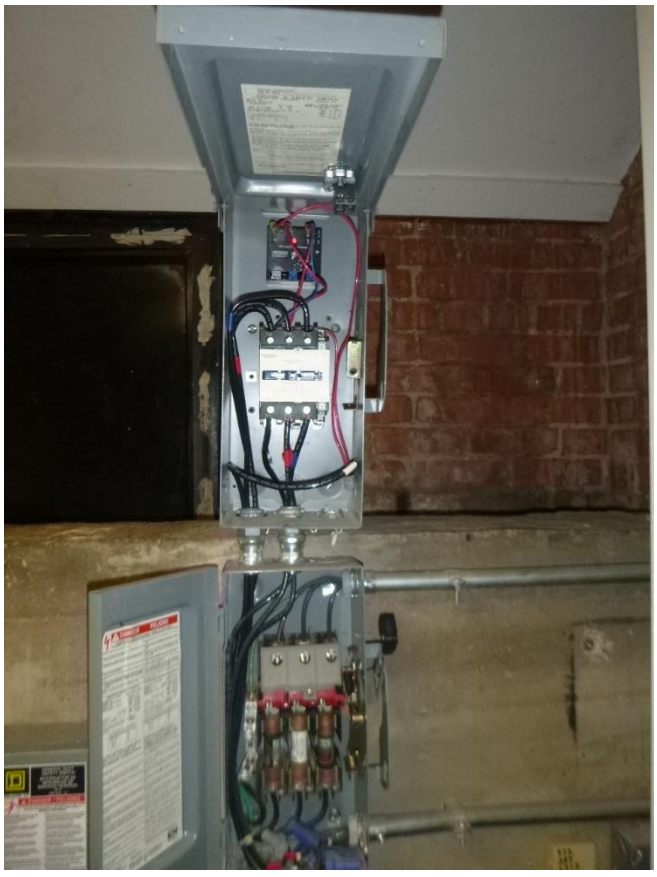



UNDERWRITERS LABORATORIES INC.
SWINGING TYPE FIRE DOOR
MINIMUM LABEL UNION
INCH
HOUR
National Door
& Repair, Inc.



HOLLISTER-WHITNEY GOV.
CONTR.
TRIP
F.P.M.
M/S
SW.
F.P.M.
M/S
ROPE PULL-THRU
LBS.
N.
ROPE DIA.
IN.
MM. 8x19 / 8x21 T.S.
DO NOT LUBRICATE GOVERNOR ROPE.


1

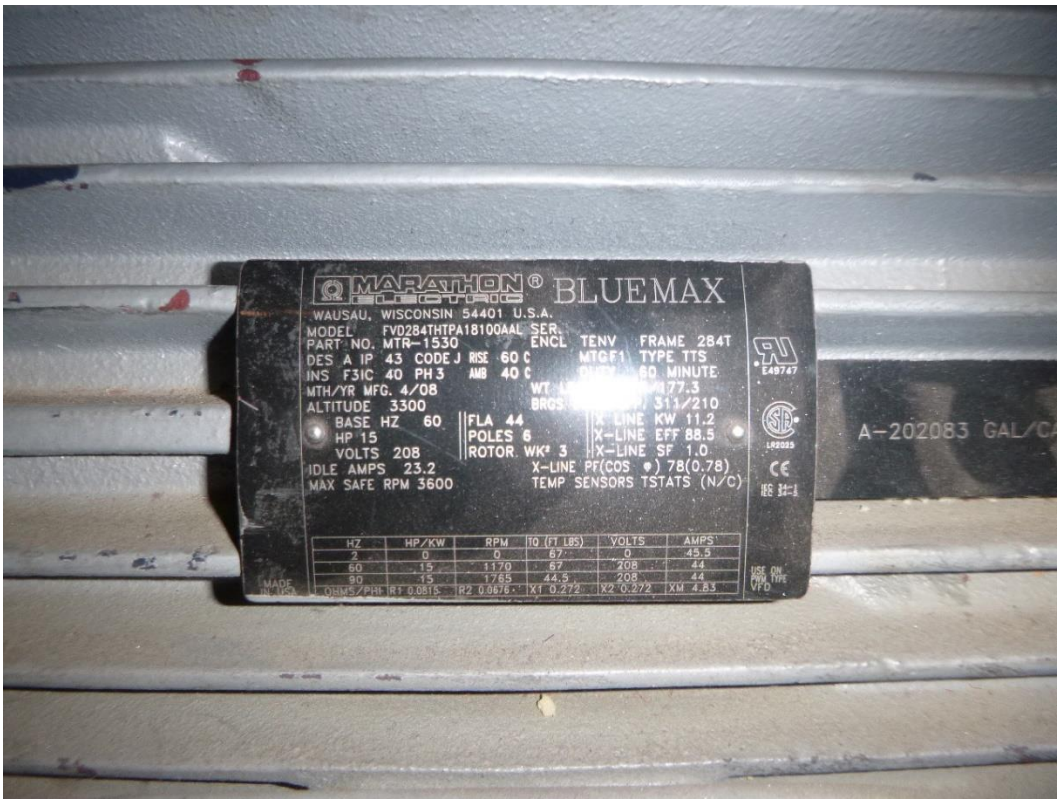
MARATHON ELECTRIC
BLUEMAX
WAUSAU, WISCONSIN 54401 U.S.A.
MODEL FVD284THTPA18100AAL SER.
PART NO. MTR-1530
ENCL TENV FRAME 284T
DES A IP 43 CODE J RISE 60 C
MTGF1 TYPE TTS
INS F3IC 40 PH 3 AMB 40 C
DUTY 60 MINUTE
MTH/YR MFG. 4/08
WT
177.3
BRGS
311/210
ALTITUDE 3300
BASE HZ 60
HP 15
VOLTS 208
FLA 44
POLES 6
ROTOR WK² 3
X-LINE KW 11.2
X-LINE EFF 88.5
X-LINE SF 1.0
IDLE AMPS 23.2
MAX SAFE RPM 3600
X-LINE PF(COS φ) 78(0.78)
TEMP SENSORS TSTATS (N/C)
HZ HP/KW RPM TQ (FT LBS) VOLTS AMPS
2 0 0 67 0 45.5
60 15 1170 67 208 44
90 15 1765 44.5 208 44
OHMS/PH R1 0.0815 R2 0.0676 X1 0.272 X2 0.272 XM 4.83
E49747
LR20025
A-202083 GAL/CA

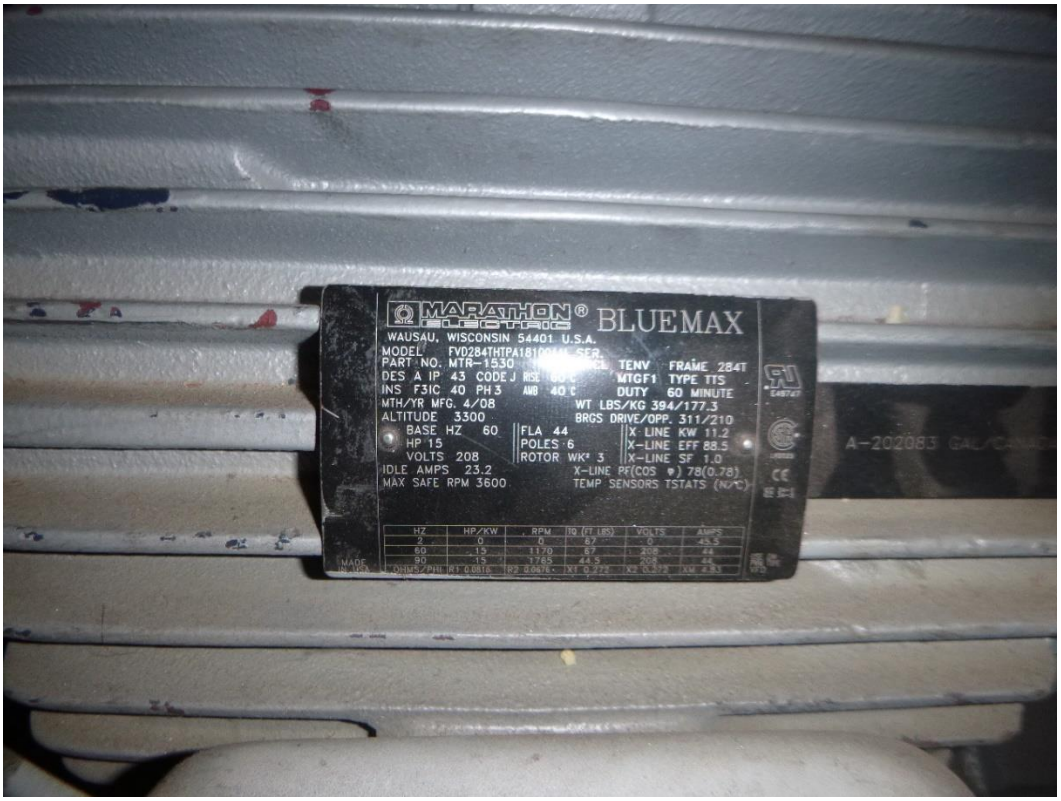
MARATHON ELECTRIC
BLUEMAX
WAUSAU, WISCONSIN 54401 U.S.A.
MODEL FVD284THTPA181
SER.
PART NO. MTR-1530
TENV FRAME 284T
DES A IP 43 CODE J
MTGF1 TYPE TTS
INS F3IC 40 PH 3 AMB 40 C
DUTY 60 MINUTE
MTH/YR MFG. 4/08
WT LBS/KG 394/177.3
ALTITUDE 3300
BRGS DRIVE/OPP. 311/210
BASE HZ 60
HP 15
VOLTS 208
FLA 44
POLES 6
ROTOR WK² 3
X-LINE KW 11.2
X-LINE EFF 88.5
X-LINE SF 1.0
IDLE AMPS 23.2
MAX SAFE RPM 3600
X-LINE PF(COS φ) 78(0.78)
TEMP SENSORS TSTATS (N/C)
HZ HP/KW RPM TQ (FT LBS) VOLTS AMPS
2 0 0 67 0 45.5
60 15 1170 67 208 44
90 15 1765 44.5 208 44
OHMS/PH R1 0.0815 R2 0.0676 X1 0.272 X2 0.272 XM 4.83
E49747
A-202083 GAL/CA



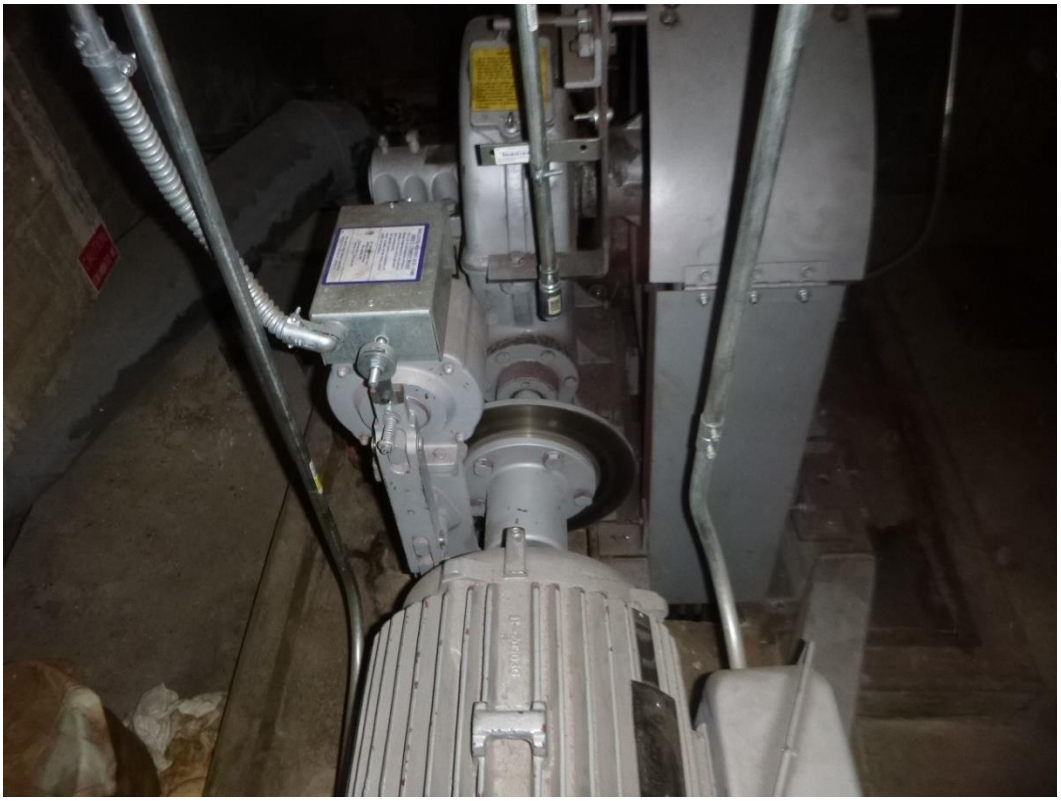














CAUTION

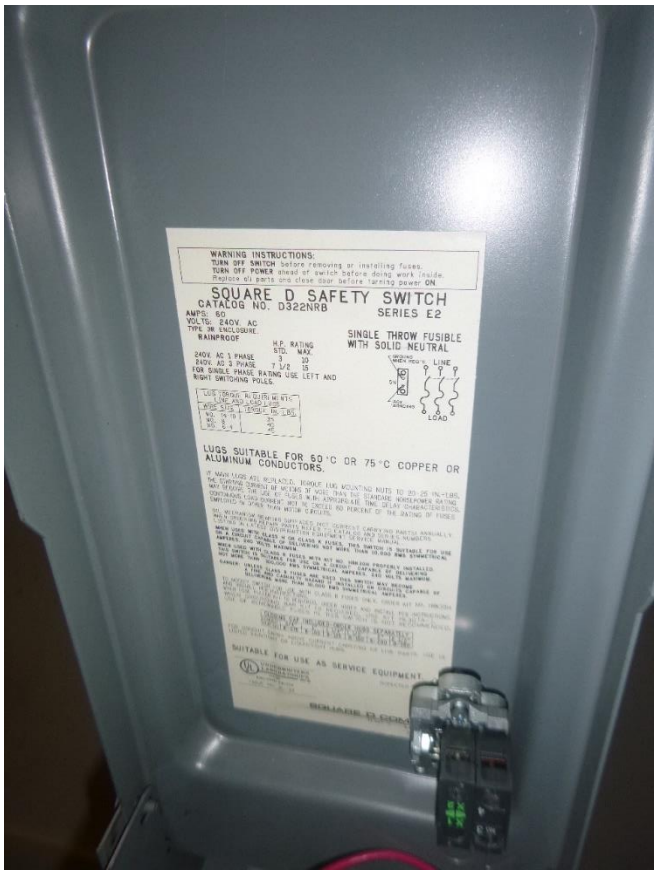


WARNING INSTRUCTIONS:
TURN OFF SWITCH before removing or installing fuses.
TURN OFF POWER ahead of switch before doing work inside.
Replace all parts and close door before turning power ON.
SQUARE D SAFETY SWITCH
CATALOG NO. D322NRB
SERIES E2
AMPS: 60
VOLTS: 240V. AC
TYPE 3R ENCLOSURE
RAINPROOF
SINGLE THROW FUSIBLE
WITH SOLID NEUTRAL
H.P. RATING
STD. MAX.
240V. AC 1 PHASE 3 10
240V. AC 3 PHASE 7 1/2 15
FOR SINGLE PHASE RATING USE LEFT AND
RIGHT SWITCHING POLES
LINE
LOAD
LUGS SUITABLE FOR 60°C OR 75°C COPPER OR
ALUMINUM CONDUCTORS.
SUITABLE FOR USE AS SERVICE EQUIPMENT.



SW
COM
N.O.
N.C.
AIROTRONICS
Timers and Controls
www.airotronics.com
TIMING
FUNCTION
1 2 3 4
1015

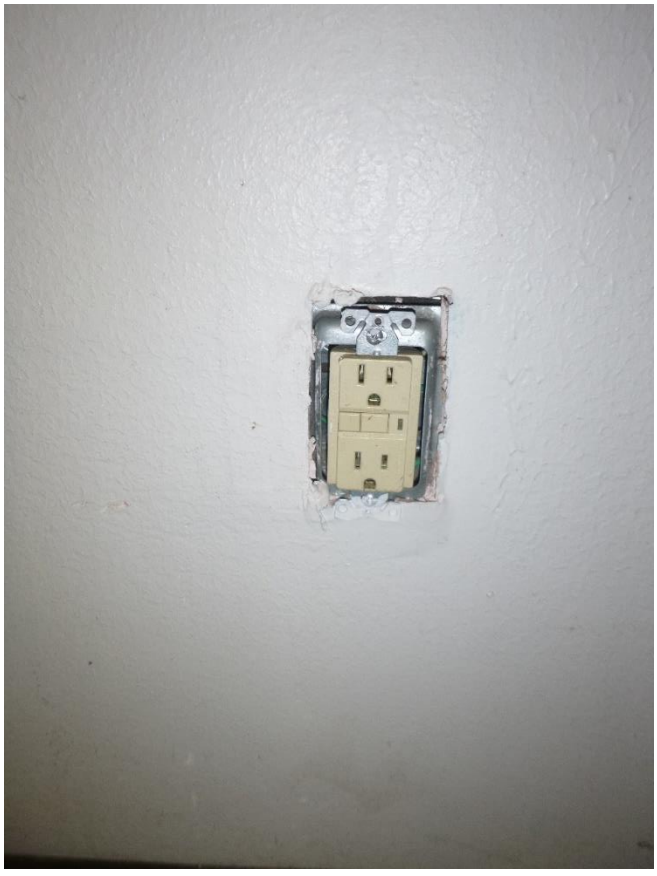





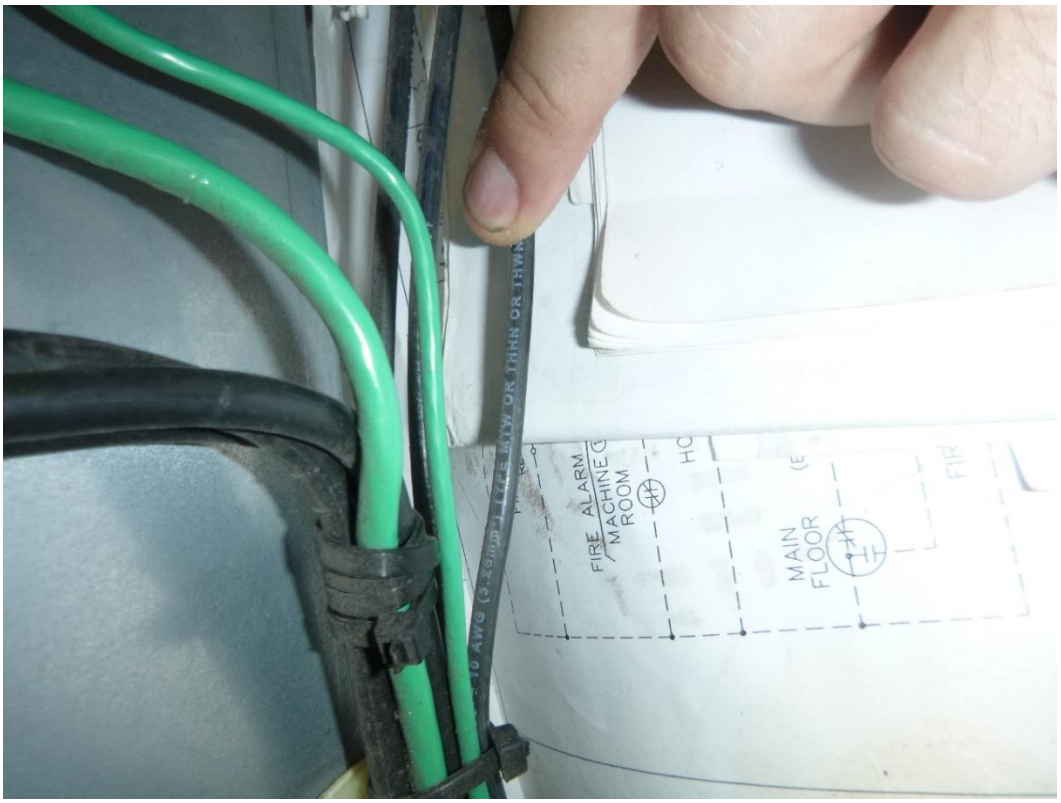


FIRE ALARM
MACHINE
ROOM
MAIN
FLOOR







MODEL
CAPACITY
SPEED
GEAR RATIO
CONT. NO.
LBS.
F.P.M.
KGS.
M/S




ELEV-9-3

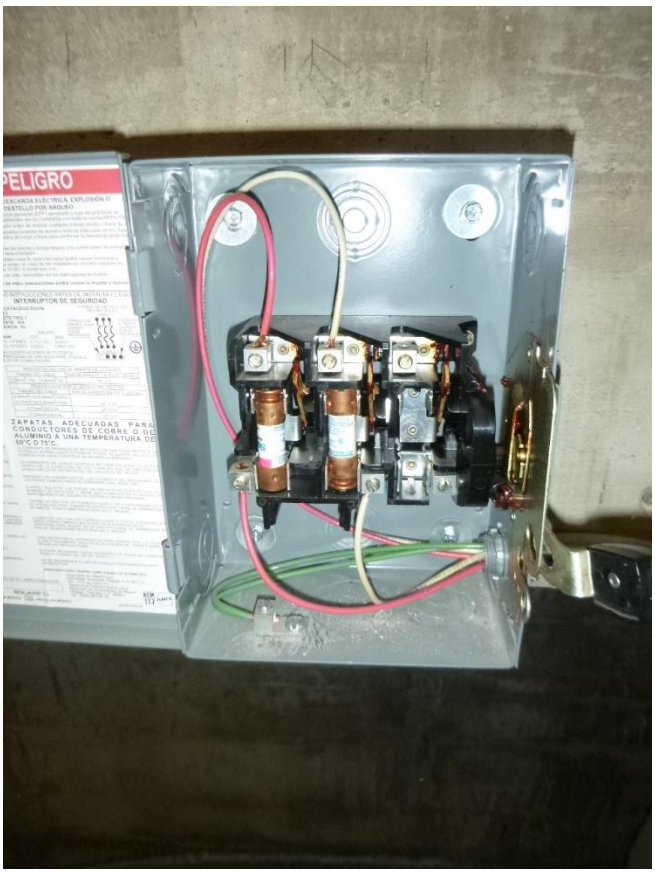


PELIGRO







3
4
5
6
7
8
9
27
28
29
30
31
32
33





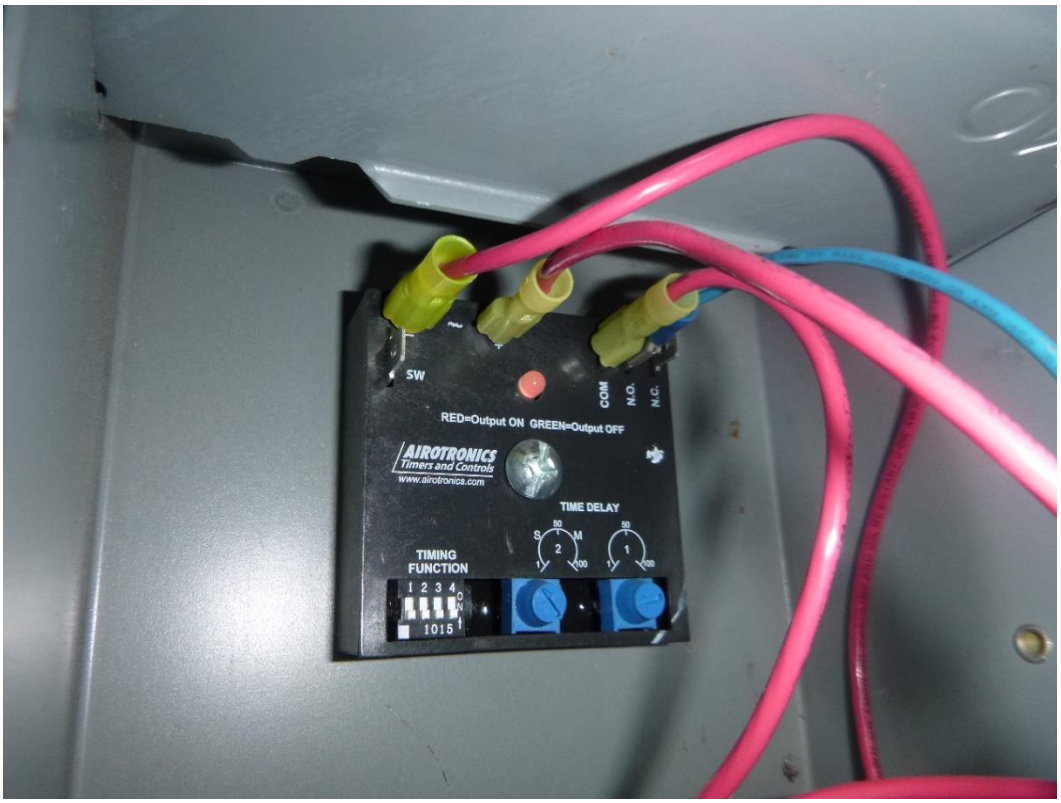



SW
COM
N.O.
N.C.
RED=Output ON GREEN=Output OFF
AIROTRONICS
Timers and Controls
www.airotronics.com
TIME DELAY
TIMING
FUNCTION
1 2 3 4
ON
1015


Schneider Electric
LC1D65


ELEV-9-3
1
CAR LIGHTS



TEST PERFORMED BY
OVERLAND & ASSOCIATES INC
972-669-9665

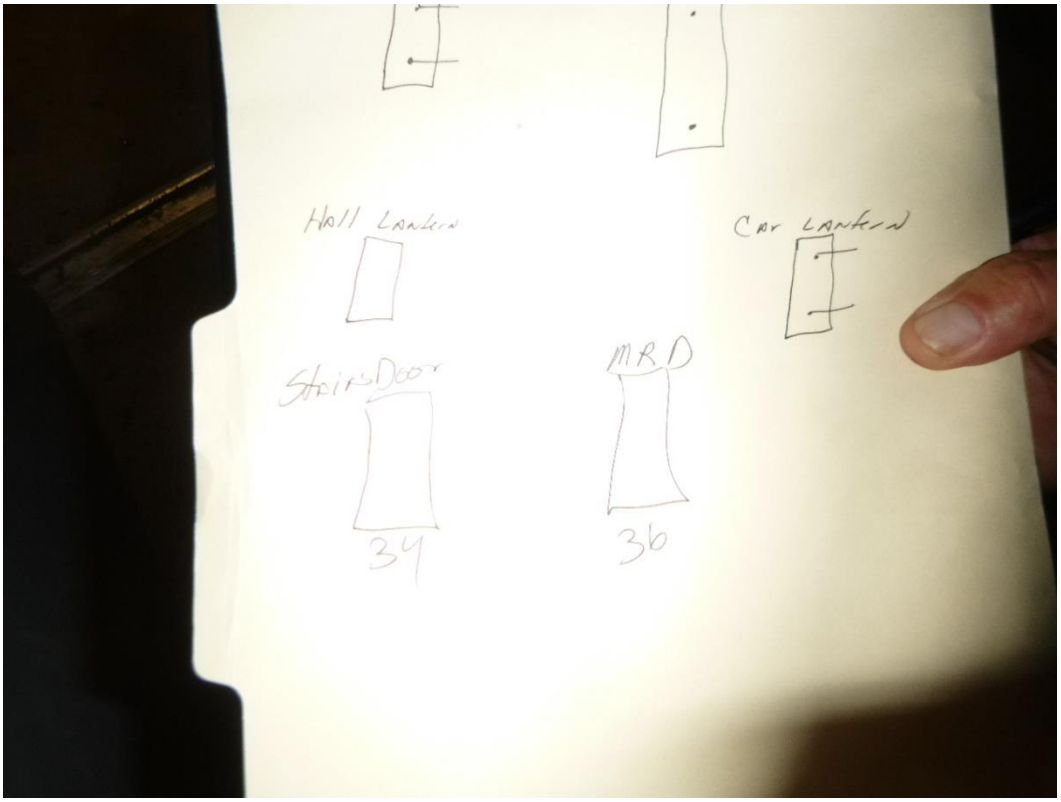


Hall Lantern
Car Lantern
Stairs Door
MRD
34
36




33

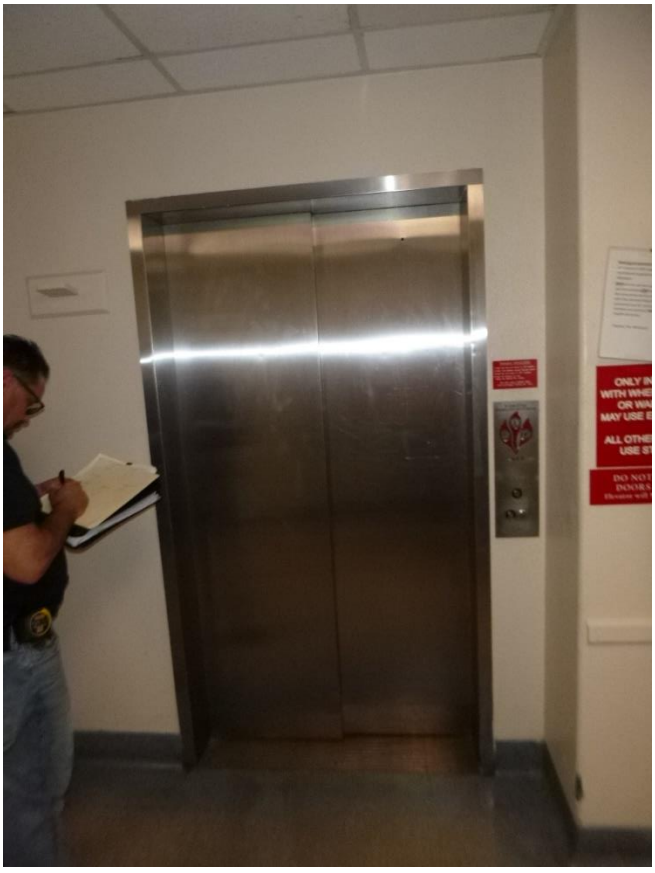


2
1
B






IMPORTANT
WARNING !!


3


41
42
43
44
45
46
47
48








2
1
B


CODE DATA PLATE
ALTERATION CODE:
ASME A17.1b-2003
SECT. 8.7 REQUIREMENTS COMPLIED WITH:




OFF
LIGHT
2
1
B




WARSAW ELEVATOR COMPANY
OUR ORDER NO. 10163
DATE INSTALLED
NO. OF PASSENGERS
MAX. CAR SPEED PER MINUTE
18
100
FT.
GOVERNOR
1
COMPENSATION




10163


7F






























41
OFF
20
ON
OFF
20
OFF
GENERAL ELECTRIC
TYPE
STYLE
AMP.
225
VOLTS
PH
W
CODE H
PLANT R
PLAINVILLE, CONN.
MADE IN U.S.A.

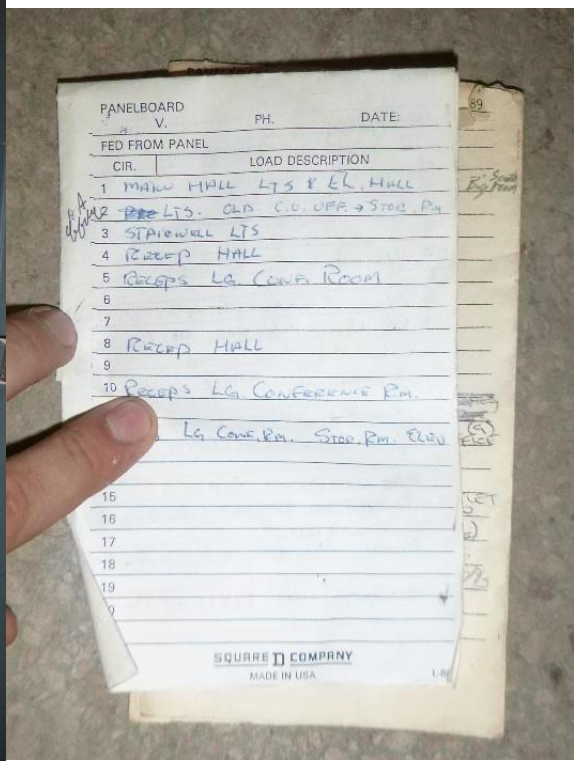



PANELBOARD
V. PH. DATE:
FED FROM PANEL
CIR. LOAD DESCRIPTION
1 MAIN HALL LTS & EL. HALL
2 ~~REC~~ LTS. OLD C.O. OFF. → STOR. RM
3 STAIRWELL LTS
4 RECEP HALL
5 RECEPS LG. CONFR ROOM
6
7
8 RECEP HALL
9
10 RECEPS LG. CONFERENCE RM.
LG. CONF. RM. STOR. RM. ELEV.
15
16
17
18
19
SQUARE D COMPANY
MADE IN USA

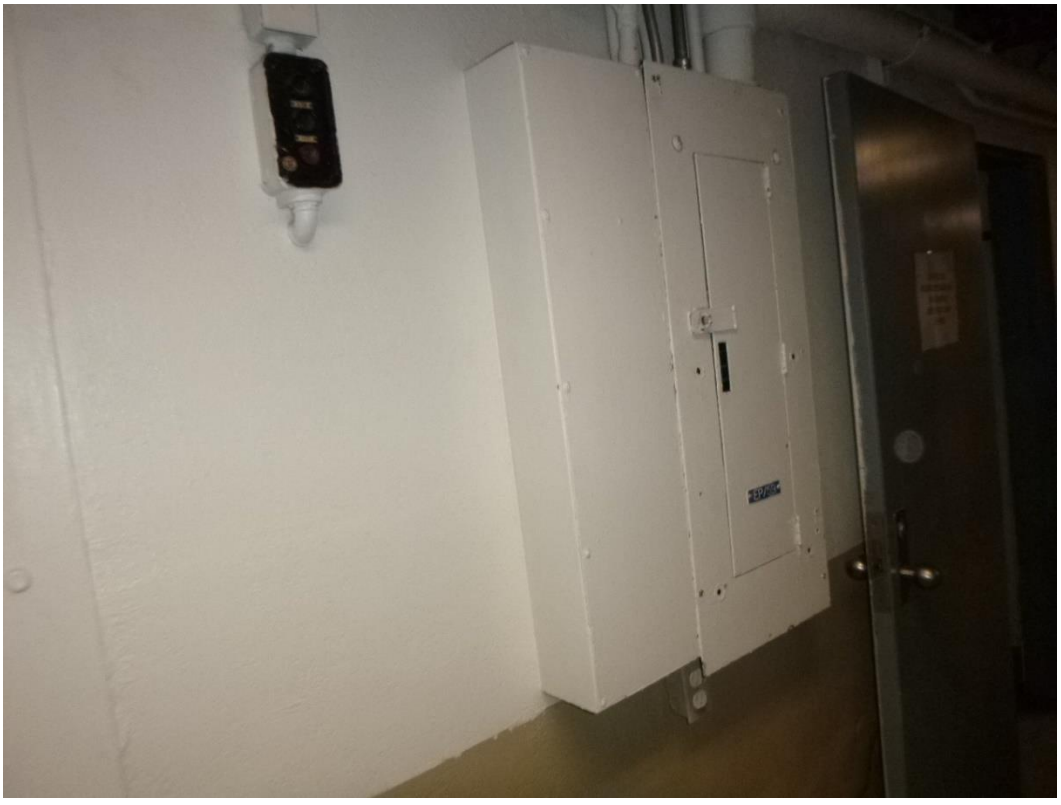



PANELBOARD
B-9-8 V. 208 PH. 3Ø DA 89
FED FROM PANEL

CIR.	LOAD DESCRIPTION
22	LIGHTS: CLOTHING RM.
23	~~A/C: UPSTAIRS~~ Pump out side Big Room
24	CLOTHING RM.
25	~~A/C: UPSTAIRS~~ Space
26	SPARE
27	CONTROL: A/C
28	~~CONTROL~~: A/C Staff R.R.
29	EMERGENCY LIGHTS
30	CONTROL: A/C Big Room
31	RECPT. UNDER PANEL
32	CONTROL: A/C
33	~~RECPT.~~ (MYERS OFFICE) ~~WATER~~ PLUGS (9)
34	~~SPARE~~ MAP OFFICE
35	CLOTHING RM.
36	SPARE
37	~~Dryer Outlet~~ OUTLET RM 10
38	~~OUTLET RECPT~~
39	~~Dryer Outlet~~ ~~SPARE~~ GYM
40	↓
41	Rec. For File Room
42	Lighting

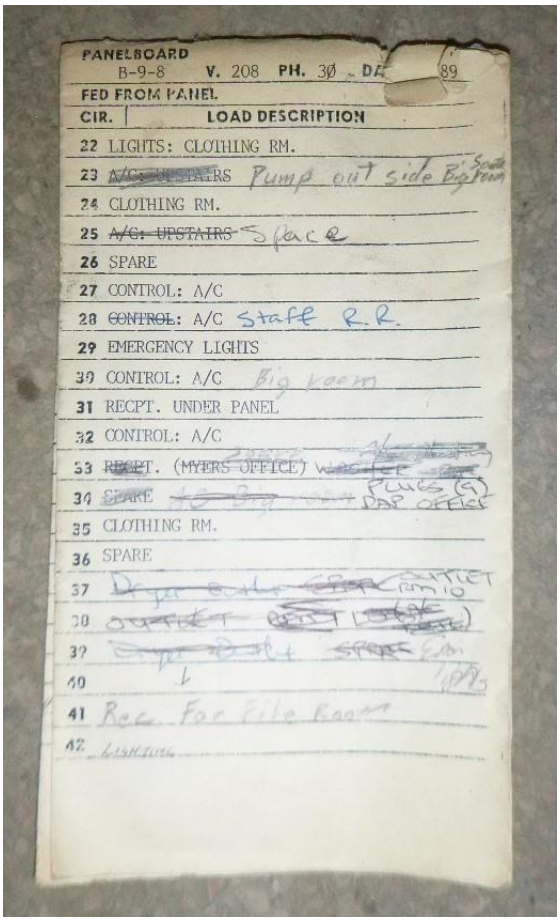


GENERAL ALARM
SUPERVISORY
SYSTEM TROUBLE
SYSTEM SILENCE
SYSTEM POWER
FIRE ALARM ANNUNCIATOR
TROUBLE cnt[2]
09/08/26 11:10:36
SILENT KNIGHT
by Honeywell
RESET
SILENCE
1 2 3
4 5 6
7 8 9
* 0 #
ENTER ACK


SILENT KNIGHT
by Honeywell
IntelliKnight


GENERAL ALARM
SUPERVISORY
SYSTEM TROUBLE
SYSTEM SILENCE
SYSTEM POWER
RESET
SILENCE
ENTER
ESC
EXPERT POWER

