Submittal Review Comments

PROJECT NAME:	NOAA HURRICANE REPAIRS AT AOML		
ADG PROJECT #:	13124-AO	SHEET #: 1 OF 1	
RECEIVED DATE:	02-05-21	REVIEWED DATE:	02-28-21
REVIEWED BY:	Shane Hernandez, P.E.		
SUBMITTAL:	(#180) Retrofit VAV Boxes/No Re-Heat, VAV boxes w/ Hot Water Product Data		

☐ NO EXCEPTION TAKEN ☒ MAKE CORRECTIONS NOTED ☐ REJECTED

☐ REVISE AND RESUBMIT ☐ SUBMIT SPECIFIC ITEM

Checking is only for general conformance with the design concept of the project and general compliance with the information given in the contract documents. Any action shown is subject to the requirements of the plans and specifications. Contractor is responsible for: dimensions which shall be confirmed and correlated at the jobsite; fabrication processes and techniques of construction; coordination of his work with that of all other trades; and the satisfactory performance of his work.

BY: Shane Hernandez, P.E. DATE: 02-28-21

The following comments refer to submittals on the above referenced project:

1. Materials furnished shall meet or exceed all scheduled capacities and/or performance ratings. Provide all specified options and accessories as well as manufacturer recommended accessories and options, for this specific installation, to provide a complete and working system, meeting or exceeding manufacturer installation instructions.

2. Coordinate the electrical requirements of the boxes with the electrical contractor.

3. Provide 24 Volt power to all kit assemblies for actuator and controls.

4. Provide controller, actuator and interface to existing facility building automation system.

5. Provide VAV-45 with a 9.0 kW electric heat capacity as scheduled in lieu of 8.0 kW submitted.

6. Install boxes with proper clearances for access and service.

END OF COMMENTS

SUBMITTAL

NORMAN S. WRIGHT CO.
MANUFACTURERS REPS.
2917 EAST GANLEY RD.
TUCSON, ARIZONA 85706

PHONE: (520) 790-4490
FAX: (520) 790-4673

CONTACT: Mike Felix
TITLE: Sales Engineer
E-MAIL: mike@nswtucson.com

Submittal / Material Schedule

Project: Miami Department of Commerce - NOAA
Contractor: Bergs Heating and Air Conditioning
Date: 10/05/20

VAV- SLIDE IN RETROFIT – NO RE-HEAT

Manufacturer: Price Industries

Mark VAV - Model SRDV5 Constant Volume to Variable Volume Retrofit Terminal Unit Digital Control, Pressure Independent, 120/24V Control Power Transformer, Metal Controls Enclosure, Non Fused Disconnect Switch
(Controls Field Mounted – Controls Provided By Others)

NOTE: See Attached Cut Sheets for Individual Performance

VAV 33 – 24x14 VAV Duct Size (34x22 on Plan. Contractor Transition Required)
VAV 34 – 18x10 VAV Duct Size (16x16 on Plan. Contractor Transition Required)
VAV 35 – 20x10 VAV Duct Size (20x10 NO Transition Required)
VAV 48 – 26x12 VAV Duct Size (25x12 on Plan. Contractor Transition Required)
VAV 49 – 20x16 VAV Duct Size (18x18 on Plan. Contractor Transition Required)
VAV 50 – 36x26 VAV Duct Size (35x26 on Plan. Contractor Transition Required)
VAV 51 – 22x10 VAV Duct Size (22x12 on Plan. Contractor Transition Required)
VAV 52 – 18x12 VAV Duct Size (15x12 on Plan. Contractor Transition Required)
VAV 53 – 24x12 VAV Duct Size (25x12 on Plan. Contractor Transition Required)
VAV 54 – 30x16 VAV Duct Size (25x26 on Plan. Contractor Transition Required)
VAV 55 – 16x12 VAV Duct Size (16x12 NO Transition Required)
VAV 56 – 26x16 VAV Duct Size (26x16 NO Transition Required)
VAV 57 – 30x20 VAV Duct Size (30x20 NO Transition Required)
VAV 58 – 30x20 VAV Duct Size (30x20 NO Transition Required))
VAV 59 – 30x24 VAV Duct Size (30x24 NO Transition Required)
VAV 60 – 30x12 VAV Duct Size (32x10 on Plan. Contractor Transition Required)
VAV 61 – 26x8 VAV Duct Size (26x8 NO Transition Required)
VAV 62 – 28x16 VAV Duct Size (32x12 on Plan. Contractor Transition Required)
VAV 63 – 18x10 VAV Duct Size (18x10 NO Transition Required)
VAV 64 – 28x12 VAV Duct Size (28x12 NO Transition Required)
VAV 65 – 26x16 VAV Duct Size (NO Transition Required)
VAV 66 – 30x18 VAV Duct Size (38x14 on Plan. Contractor Transition Required)
VAV 67 – 24x16 VAV Duct Size (22x18 on Plan. Contractor Transition Required)

CONFIDENTIAL - FOR YOUR USE ONLY

price®

All-In-One
Detailed Submittal Schedule
Terminals

Tag	VAV 33	VAV 34	VAV 35	VAV 48
#	13	14	15	16
Qty	1	1	1	1
Model	SRDV5	SRDV5	SRDV5	SRDV5
Size 1	24	18	20	26
Size 2	14	10	10	12
Inlet SP (in. w.g.)	1.00	1.00	1.00	1.00
Downstream SP (in. w.g.)	0.25	0.25	0.25	0.25
Coil Amps	0	0	0	0
Accessories 1	PS	PS	PS	PS
Accessories 2	CCF	CCF	CCF	CCF
Accessories 3	DSW	DSW	DSW	DSW
Altitude (ft)	2556	2556	2556	2556

Tag	VAV 49	VAV 50	VAV 51	VAV 52
#	17	18	19	20
Qty	1	1	1	1
Model	SRDV5	SRDV5	SRDV5	SRDV5
Size 1	20	36	22	18
Size 2	16	26	10	12
Inlet SP (in. w.g.)	1.00	1.00	1.00	1.00
Downstream SP (in. w.g.)	0.25	0.25	0.25	0.25
Coil Amps	0	0	0	0
Accessories 1	PS	PS	PS	PS
Accessories 2	CCF	CCF	CCF	CCF
Accessories 3	DSW	DSW	DSW	DSW
Altitude (ft)	2556	2556	2556	2556

Tag	VAV 53	VAV 54	VAV 55	VAV 56
#	21	22	23	24
Qty	1	1	1	1
Model	SRDV5	SRDV5	SRDV5	SRDV5
Size 1	24	30	16	26
Size 2	12	16	12	16
Inlet SP (in. w.g.)	1.00	1.00	1.00	1.00
Downstream SP (in. w.g.)	0.25	0.25	0.25	0.25
Coil Amps	0	0	0	0
Accessories 1	PS	PS	PS	PS
Accessories 2	CCF	CCF	CCF	CCF
Accessories 3	DSW	DSW	DSW	DSW
Altitude (ft)	2556	2556	2556	2556

Tag	VAV 57	VAV 58	VAV 59	VAV 60
#	25	26	27	28
Qty	1	1	1	1
Model	SRDV5	SRDV5	SRDV5	SRDV5
Size 1	30	30	30	30
Size 2	20	20	24	12
Inlet SP (in. w.g.)	1.00	1.00	1.00	1.00
Downstream SP (in. w.g.)	0.25	0.25	0.25	0.25
Coil Amps	0	0	0	0
Accessories 1	PS	PS	PS	PS
Accessories 2	CCF	CCF	CCF	CCF
Accessories 3	DSW	DSW	DSW	DSW
Altitude (ft)	2556	2556	2556	2556

Tag	VAV 61	VAV 62	VAV 63	VAV 64
#	29	30	31	32
Qty	1	1	1	1
Model	SRDV5	SRDV5	SRDV5	SRDV5
Size 1	26	28	18	28
Size 2	8	16	10	12
Inlet SP (in. w.g.)	1.00	1.00	1.00	1.00
Downstream SP (in. w.g.)	0.25	0.25	0.25	0.25
Coil Amps	0	0	0	0
Accessories 1	PS	PS	PS	PS
Accessories 2	CCF	CCF	CCF	CCF
Accessories 3	DSW	DSW	DSW	DSW
Altitude (ft)	2556	2556	2556	2556


Tag	VAV 65	VAV 66	VAV 67
#	33	34	35
Qty	1	1	1
Model	SRDV5	SRDV5	SRDV5
Size 1	26	30	24
Size 2	16	18	16
Inlet SP (in. w.g.)	1.00	1.00	1.00
Downstream SP (in. w.g.)	0.25	0.25	0.25
Coil Amps	0	0	0
Accessories 1	PS	PS	PS
Accessories 2	CCF	CCF	CCF
Accessories 3	DSW	DSW	DSW
Altitude (ft)	2556	2556	2556


Performance Notes


Date Printed: 10/5/2020


1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. Airflow is given in cubic feet per minute (cfm).
7. Air pressure drop is given in inches water gauge (in. w.g.), and water pressure drop is given in feet of water gauge (ft. w.g.).
8. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.

Submittal Sheet

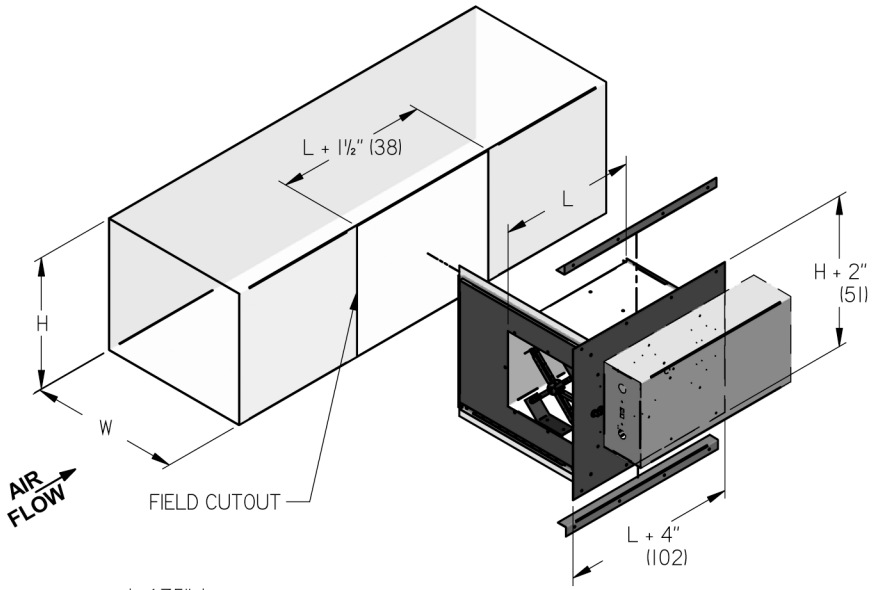

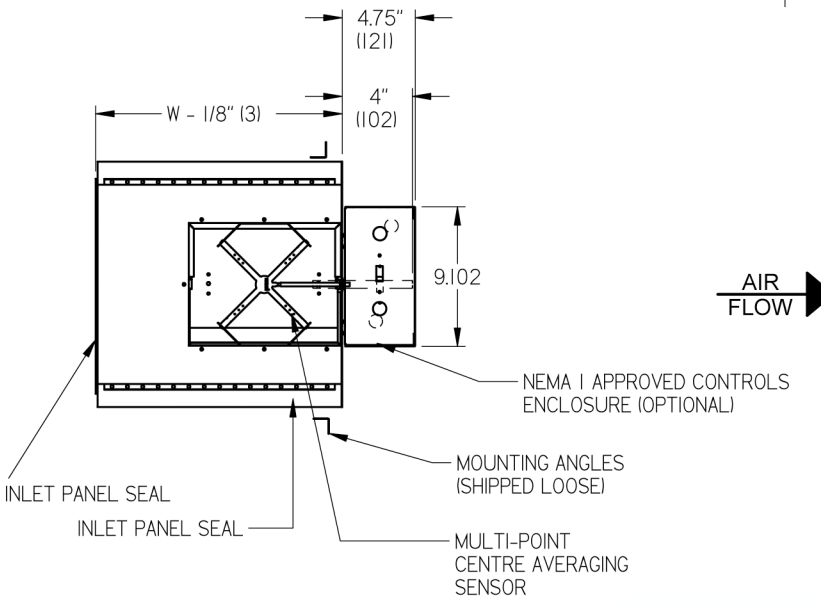

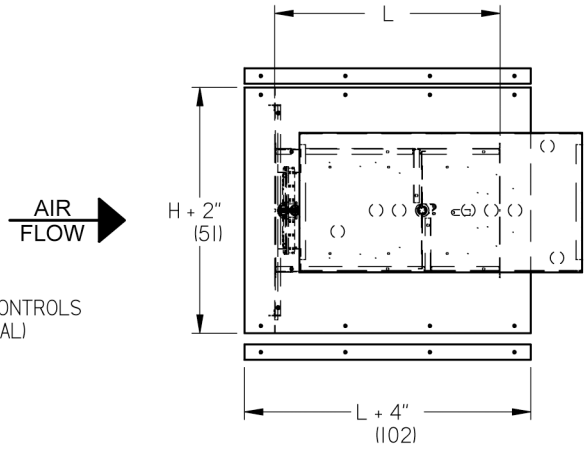

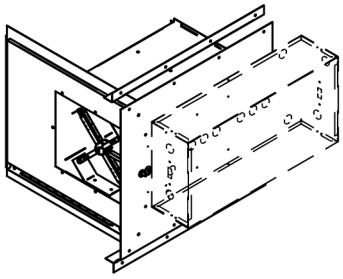

SINGLE DAMPER

NOTE: CUSTOM SIZES AND CONFIGURATIONS ALSO AVAILABLE

ALL METRIC DIMENSIONS ( ) ARE SOFT CONVERTED. IMPERIAL DIMENSIONS ARE CONVERTED TO METRIC AND ROUNDED TO THE NEAREST MILLIMETER.

PROJECT: US Dept of Commerce NOAA		
ENGINEER: ADG Engineering	BG	**SRDV5000** **SLIDE-IN RETROFIT UNIT**
CUSTOMER: US Dept of Commerce NOAA	245425	
SUBMITTAL DATE: 10/5/2020 **SPEC. SYMBOL:**	2011/04/18	**DIGITAL CONTROL** VAV 33,VAV 34,VAV 35,VAV 48,VAV 49,VAV 50,VAV 51,VAV 52,VAV

© Copyright E.H.PRICE LIMITED 2011

Submittal Sheet

	Damper Size BxC (in)	Total CFM Range	Available Duct Sizes — Width W (in)	Height H (in)	L (in)
SINGLE BLADE DAMPER	5x5	0 To 200	5 6 8 10 12 / 6 8 10 12 / 8 10 12 / 10 12	5 6 8 9	$14^{5/8}$
	6x6	0 To 350	6 8 10 12 14 / 8 10 12 14 / 10 12 14	6 8 9 10	$14^{5/8}$
	8x6	0 To 500	8 10 12 14 16 / 8 10 12 14 16 / 10 12 14 16	6 8 9 10	$14^{5/8}$
	8x8	0 To 675	8 10 12 14 16 18 / 8 10 12 14 16 18 / 10 12 14 16 18 / 12 14 16 18	8 10 12 14	$14^{5/8}$
	10x8	0 To 875	10 12 14 16 18 / 10 12 14 16 18 / 10 12 14 16 18 / 12 14 16 18	8 9 10 12 14	$14^{5/8}$
	14x8	0 To 1250	14 16 18 20 22 24 / 14 16 18 20 22 24 / 14 16 18 20 22 24 / 14 16 18 20 22 24 / 14 16 18 20 22 24	8 9 10 12 14	$14^{5/8}$
	18x6	0 To 1400	18 20 22 24 26 / 18 20 22 24 26 / 18 20 22 24 26 / 18 20 22 24 26	6 8 9 10	$14^{5/8}$
	12x10	0 To 1300	12 14 16 18 20 22 24 / 12 14 16 18 20 22 24 / 14 16 18 20 22 24 / 16 18 20 22 24	10 12 14 16	$14^{5/8}$
	18x10	0 To 2400	18 20 22 24 26 28 30 / 18 20 22 24 26 28 30 / 18 20 22 24 26 28 30	10 12 14	$14^{5/8}$
	18x12	0 To 3100	18 20 22 24 26 28 / 18 20 22 24 26 28 / 18 20 22 24 26 28	12 14 16	$18^{5/8}$
	20x14	0 To 4250	20 22 24 26 28 30 / 20 22 24 26 28 30 / 20 22 24 26 28 30	14 16 18	$18^{5/8}$
	30x12	0 To 6350	30 32 34 36 / 30 32 34 36 / 30 32 34 36	12 14 16	$18^{5/8}$
	22x16	0 To 5150	22 24 26 28 30 32 34 36 / 22 24 26 28 30 32 34 36 / 22 24 26 28 30 32 34 36	16 18 20	$20^{5/8}$
DUAL BLADE DAMPER	24x18	0 To 6000	24 26 28 30 32 34 36 / 24 26 28 30 32 34 36 / 24 26 28 30 32 34 36 / 24 26 28 30 32 34 36	18 20 24 26	$14^{5/8}$
	30x20	0 To 9000	30 32 34 36 38 40 42 44 46 / 30 32 34 36 38 40 42 44 46 / 30 32 34 36 38 40 42 44 46	20 24 26	$14^{5/8}$
	40x20	0 To 13500	40 42 44 46 48 50 52 / 40 42 44 46 48 50 52 / 40 42 44 46 48 50 52	20 24 26	$14^{5/8}$

	Damper Size BxC (mm)	Total L/s Range	Available Duct Sizes — Width W (mm)	Height H (mm)	L (mm)
SINGLE BLADE DAMPER	127x127	0 To 94	127 152 203 254 305 / 152 203 254 305 / 203 254 305 / 254 305	127 152 203 229	371
	152x152	0 To 165	152 203 254 305 356 / 203 254 305 356 / 254 305 356 / 254 305 356	152 203 229 254	371
	203x152	0 To 236	203 254 305 356 406 / 203 254 305 356 406 / 254 305 356 406 / 254 305 356 406	152 203 229 254	371
	203x203	0 To 307	203 254 305 356 406 457 / 203 254 305 356 406 457 / 254 305 356 406 457 / 305 356 406 457	203 254 305 356	371
	254x203	0 To 413	254 305 356 406 457 / 254 305 356 406 457 / 254 305 356 406 457 / 305 356 406 457 / 356 406 457	203 229 254 305 356	371
	356x203	0 To 590	356 406 457 508 559 610 / 356 406 457 508 559 610 / 356 406 457 508 559 610 / 356 406 457 508 559 610 / 356 406 457 508 559 610	203 229 254 305 356	371
	457x152	0 To 661	457 508 559 610 660 / 457 508 559 610 660 / 457 508 559 610 660 / 457 508 559 610 660	152 203 229 254	371
	305x254	0 To 614	305 356 406 457 508 559 610 / 305 356 406 457 508 559 610 / 356 406 457 508 559 610 / 406 457 508 559 610	254 305 356 406	371
	457x254	0 To 1133	457 508 559 610 660 711 762 / 457 508 559 610 660 711 762 / 457 508 559 610 660 711 762	254 305 356	371
	457x305	0 To 1463	457 508 559 610 660 711 / 457 508 559 610 660 711 / 457 508 559 610 660 711	305 356 406	473
	508x356	0 To 2006	508 559 610 660 711 762 / 508 559 610 660 711 762 / 508 559 610 660 711 762	356 406 457	473
	762x305	0 To 2997	762 813 864 914 / 762 813 864 914 / 762 813 864 914	305 356 406	473
	559x406	0 To 2431	559 610 660 711 762 813 864 914 / 559 610 660 711 762 813 864 914 / 559 610 660 711 762 813 864 914	406 457 508	524
DUAL BLADE DAMPER	610x457	0 To 2832	610 660 711 762 813 864 914 / 610 660 711 762 813 864 914 / 610 660 711 762 813 864 914 / 610 660 711 762 813 864 914	457 508 610 660	371
	762x508	0 To 4248	762 813 864 914 965 1016 1067 1118 1168 / 762 813 864 914 965 1016 1067 1118 1168 / 762 813 864 914 965 1016 1067 1118 1168	508 610 660	371
	1016x508	0 To 6371	1016 1067 1118 1168 1219 1270 1321 / 1016 1067 1118 1168 1219 1270 1321 / 1016 1067 1118 1168 1219 1270 1321	508 610 660	371

CONSTRUCTION:
- HOUSING 22 GA. ZINC COATED STEEL CONSTRUCTION.
- CONTROL PANEL FABRICATED FROM 20 GA. ZINC COATED STEEL.
- UNIT IS SUPPLIED WITH TWO MOUNTING ANGLES MADE FROM 20 GA. ZINC COATED STEEL.

SRDV5000 FEATURES:
- FLOW IS FULLY PRESSURE INDEPENDENT.
- CONTROLS PANEL ON RIGHT (AS SHOWN) AND UNITS ARE ALSO REVERSIBLE FOR LH CONFIGURATIONS.
- CONTROLS FIELD MOUNTED, SUPPLIED BY OTHERS.
- MULTI-POINT SENSOR SUPPLIED BY PRICE

NOTES:
H = DUCT HEIGHT (INCHES)
W = DUCT WIDTH (INCHES)
BxC = DAMPER SIZE
DUCT OPENING BY OTHERS = H x L + 1½" (38)
*MODELS WHERE B = W OR C = H ARE ZERO CLEARANCE

OPTIONS:
- [x] NEMA 1 CONTROLS ENCLOSURE
- [x] DISCONNECT SWITCH
- [ ] GT - BRASS AIRFLOW SENSOR GAUGE TAPS

ALL METRIC DIMENSIONS ( ) ARE SOFT CONVERTED. IMPERIAL DIMENSIONS ARE CONVERTED TO METRIC AND ROUNDED TO THE NEAREST MILLIMETER.

PROJECT: US Dept of Commerce NOAA

ENGINEER: ADG Engineering

CUSTOMER: US Dept of Commerce NOAA

SUBMITTAL DATE: 10/5/2020

SPEC. SYMBOL:

BG

245425

2013/02/21

SRDV5000

SLIDE-IN RETROFIT UNIT

DIGITAL CONTROL

VAV 33,VAV 34,VAV 35,VAV 48,VAV 49,VAV 50,VAV 51,VAV 52,VAV

© Copyright PRICE INDUSTRIES 2013

SUBMITTAL

NORMAN S. WRIGHT CO.
MANUFACTURERS REPS.
2917 EAST GANLEY RD.
TUCSON, ARIZONA 85706

PHONE: (520) 790-4490
FAX: (520) 790-4673

CONTACT: Mike Felix
TITLE: Sales Engineer
E-MAIL: mike@nswtucson.com

Submittal / Material Schedule

Project: Miami Department of Commerce - NOAA
Contractor: Bergs Heating and Air Conditioning
Date: 10/05/20

TERMINAL UNITS

Manufacturer: Price Industries

Mark Box – SDV5 Single Duct Terminal Unit, Direct Digital Control, Pressure Independent, 1" Fiberglass Insulation, 480V/24V Control Power Transformer, Controls Enclosure, HW Coil Reheat Section (See Individual Performance Selections)
(Controls Field Mounted – Controls Provided By Others

***RH/LH Controls Panel / Electrical Access Location Determined Looking in the Direction of Air Flow (Air Hitting Back of the Head)**

CONFIDENTIAL - FOR YOUR USE ONLY

price®

All-In-One
Detailed Submittal Schedule
Terminals

Tag	VAV 36	VAV 37	VAV 38	VAV 39
#	1	2	3	4
Qty	1	1	1	1
Model	SDV5	SDV5	SDV5	SDV5
Size 1	10	8	10	8
Unit Size	10	8	10	8
Max Primary (CFM)	1000	830	940	760
Min Primary (CFM)	200	200	240	190
Inlet SP (in. w.g.)	1.00	1.00	1.00	1.00
Downstream SP (in. w.g.)	0.25	0.25	0.25	0.25
Dis. H (in)	12.50	10.00	12.50	10.00
Dis. W (in)	14.00	12.00	14.00	12.00
Max Dis NC	21 (2)	28 (2)	20 (2)	27 (2)
Max Rad NC	--	23 (2)	--	22 (2)
Terminal Liner	FG1	FG1	FG1	FG1
Reheat (CFM)	200	200	320	200
EC Capacity (kW)	2.50	2.50	4.00	2.50
EAT (°F)	55.00	55.00	55.00	55.00
Heating Solution Method	Cap	Cap	Cap	Cap
LAT (°F)	96.80	96.80	96.80	96.80
Volts	480-3	480-3	480-3	120-1
Steps	SCRV-DAT	SCRV-DAT	SCRV-DAT	SCRV-DAT
Coil Amps	3.01	3.01	4.81	20.83
Rows	EC	EC	EC	EC
Accessories 1	PS	PS	PS	PS
Accessories 2	CCF	CCF	CCF	CCF
MOP	15.00	15.00	15.00	30.00
MCA	4.10	4.10	6.60	28.40
Weight (lbs)	51	43	51	43
Altitude (ft)	2556	2556	2556	2556

Tag	VAV 40	VAV 41	VAV 42	VAV 43
#	5	6	7	8
Qty	1	1	1	1
Model	SDV5	SDV5	SDV5	SDV5
Size 1	8	8	14	16
Unit Size	8	8	14	16
Max Primary (CFM)	840	610	2270	4000
Min Primary (CFM)	200	155	240	400
Inlet SP (in. w.g.)	1.00	1.00	1.00	1.00
Downstream SP (in. w.g.)	0.25	0.25	0.25	0.25
Dis. H (in)	10.00	10.00	17.50	18.00
Dis. W (in)	12.00	12.00	20.00	24.00
Max Dis NC	29 (2)	26 (2)	20 (2)	23 (2)
Max Rad NC	23 (2)	--	20 (3)	26 (4)
Terminal Liner	FG1	FG1	FG1	FG1
Reheat (CFM)	200	200	240	400
EC Capacity (kW)	2.50	2.50	3.00	3.00
EAT (°F)	55.00	55.00	55.00	55.00
Heating Solution Method	Cap	Cap	Cap	Cap
LAT (°F)	96.80	96.80	96.80	80.10
Volts	480-3	480-3	480-3	480-3
Steps	SCRV-DAT	SCRV-DAT	SCRV-DAT	SCRV-DAT
Coil Amps	3.01	3.01	3.61	3.61
Rows	EC	EC	EC	EC
Accessories 1	PS	PS	PS	PS
Accessories 2	CCF	CCF	CCF	CCF
MOP	15.00	15.00	15.00	15.00
MCA	4.10	4.10	4.90	4.90
Weight (lbs)	43	43	72	82
Altitude (ft)	2556	2556	2556	2556


Tag	VAV 44	VAV 45	VAV 46	VAV 47
#	9	10	11	12
Qty	1	1	1	1
Model	SDV5	SDV5	SDV5	SDV5
Size 1	8	14	24x16	24x16
Unit Size	8	14	24x16	24x16
Max Primary (CFM)	590	2700	5000	5000
Min Primary (CFM)	150	680	1250	1250
Inlet SP (in. w.g.)	1.00	1.00	1.00	1.00
Downstream SP (in. w.g.)	0.25	0.25	0.25	0.25
Dis. H (in)	10.00	17.50	18.00	18.00
Dis. W (in)	12.00	20.00	38.00	38.00
Max Dis NC	25 (2)	21 (2)	33 (3)	33 (3)
Max Rad NC	--	22 (4)	35 (2)	35 (2)
Terminal Liner	FG1	FG1	FG1	FG1
Reheat (CFM)	200	720	1580	1580
EC Capacity (kW)	2.50	8.00	20.00	20.00
EAT (°F)	55.00	55.00	55.00	55.00
Heating Solution Method	Cap	Cap	Cap	Cap
LAT (°F)	96.80	92.20	97.40	97.40
Volts	480-3	480-3	480-3	480-3
Steps	SCRV-DAT	SCRV-DAT	SCRV-DAT	SCRV-DAT
Coil Amps	3.01	9.62	24.06	24.06
Rows	EC	EC	EC	EC
Accessories 1	PS	PS	PS	PS
Accessories 2	CCF	CCF	CCF	CCF
MOP	15.00	15.00	35.00	35.00
MCA	4.10	13.10	32.80	32.80
Weight (lbs)	43	72	139	139
Altitude (ft)	2556	2556	2556	2556

Performance Notes

Date Printed: 10/5/2020


1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. Airflow is given in cubic feet per minute (cfm).
7. Air pressure drop is given in inches water gauge (in. w.g.), and water pressure drop is given in feet of water gauge (ft. w.g.).
8. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
9. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

SDV5 Single Duct w/ Electric Coil

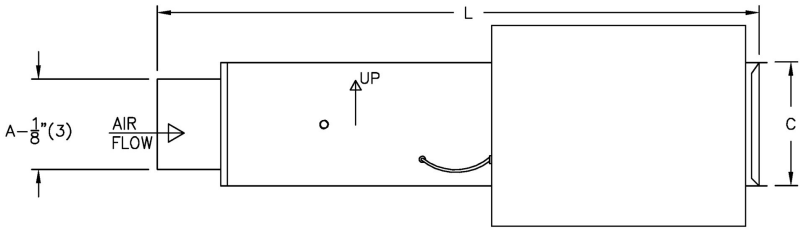

Unit Size	Max Airflow	Outlet		Inlet	Length
		B	C	A	L
8	1100	12	10	8	40 1/4
10	1800	14	12 1/2	10	40 1/4
14	3700	20	17 1/2	14	40 1/4
16	5000	24	18	16	40 1/4

Digital Controls

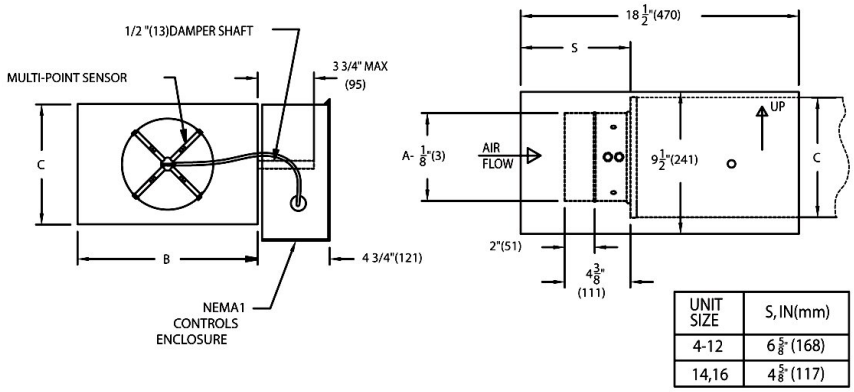

UNIT SIZE	S, IN(mm)
4-12	6 5/8"(168)
14,16	4 5/8"(117)

- Controls are supplied by controls contractor and field installed
- Controls Enclosure will be supplied as illustrated on right hand side unless specified otherwise
- CCF - Control circuit fusing
- Multi-point Primary Airflow Sensor supplied by Price

Notes

- 22 Ga. zinc coated terminal and 20 Ga. heater, mechanically sealed, leak resistant construction
- Rectangular discharge opening with slip and drive cleat duct connection


AHRI CERTIFIED™ www.ahridirectory.org VAV Terminals AHRI Standard 880

C ETL LISTED US Intertek

Assembly UL1995 & CSA236 certified

Liner FG1

Internal Insulation - Fiberglass 1" (25 mm) thick, min. 1.5 lb/cu.ft density, meets requirements of NFPA90A and UL 181.
R-Value = 4.1

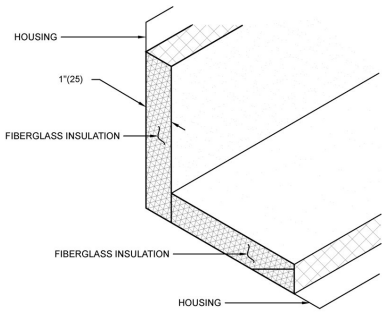


PROJECT: US Dept of Commerce NOAA **SUBMITTAL NO:** 258148-M **SUBMITTAL DATE:** 10/5/2020
ENGINEER: ADG Engineering **CUSTOMER:** US Dept of Commerce NOAA
DESCRIPTION: Single Duct - DDC By Others
SDV5//I/2000/10,8,14,16/FLD/CFM//EC/2.5,4.0,3.0/480-3/SCRV-DAT/IDSW/////////FG1//PS/CCF/////////////////////SCR-112/

© Copyright Price Industries 2020

All metric dimensions () are soft converted. Imperial dimensions are converted to metric and rounded to the nearest millimeter.
Information within this document is subject to change without notice.

Electric Coil

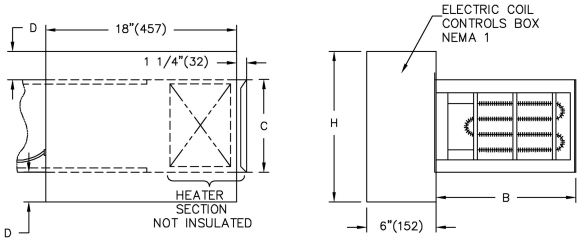

Unit Size	B	C	H	D
8	12	10	12	1
10	14	12 1/2	12	See Notes
14	20	17 1/2	17	See Notes
16	24	18	17	See Notes

Standard Coil Notes

- Automatic reset thermal cutout
- Manual reset thermal cutout
- Hinged access door
- Refer to submitted control diagrams for standard control components to be supplied
- Control box doesn't overhang SDV if the Unit Size is 9,10,14,16, or 24x16
- Low watt density elements, high grade nickel-chrome alloy
- Air flow switch
- Single point electrical connection
- Magnetic Contactors
- 24 VAC / 50 VAC Class 2 Transformer

Electrical Configuration

Supply Voltage:

- 480/3ø (3 Wire)

Stages/Control: SCRV-DAT

- SCR voltage control with 0-10 VDC control signal & DAT control
- SCR-112 (3 Phase SCR, 10 Amps Max / 480 Volts Max)

Selected Coil Features


- IDSW - Door Interlock Disconnect
- CCF - Control circuit fuses

PROJECT: US Dept of Commerce NOAA **SUBMITTAL NO:** 258148-M **SUBMITTAL DATE:** 10/5/2020
ENGINEER: ADG Engineering **CUSTOMER:** US Dept of Commerce NOAA
DESCRIPTION: Single Duct - DDC By Others
SDV5//I/2000/10,8,14,16/FLD/CFM//EC/2.5,4.0,3.0/480-3/SCRV-DAT/IDSW/////////FG1//PS/CCF//////////////////////SCR-112/

© Copyright Price Industries 2020


All metric dimensions () are soft converted. Imperial dimensions are converted to metric and rounded to the nearest millimeter.
Information within this document is subject to change without notice.

SDV5 Single Duct w/ Electric Coil

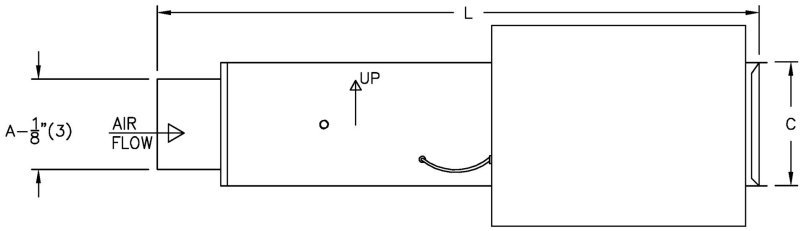

Unit Size	Max Airflow	Outlet		Inlet	Length
		B	C	A	L
8	1100	12	10	8	40 1/4

Digital Controls

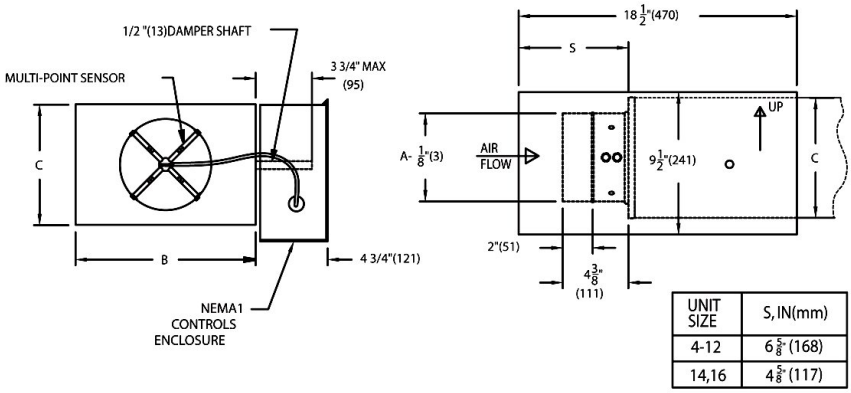

UNIT SIZE	S, IN(mm)
4-12	6 5/8"(168)
14,16	4 5/8"(117)

- Controls are supplied by controls contractor and field installed
- Controls Enclosure will be supplied as illustrated on right hand side unless specified otherwise
- CCF - Control circuit fusing
- Multi-point Primary Airflow Sensor supplied by Price

Notes

- 22 Ga. zinc coated terminal and 20 Ga. heater, mechanically sealed, leak resistant construction
- Rectangular discharge opening with slip and drive cleat duct connection


AHRI CERTIFIED™ www.ahridirectory.org VAV Terminals AHRI Standard 880

C ETL LISTED US Intertek

Assembly UL1995 & CSA236 certified

Liner FG1


Internal Insulation - Fiberglass 1" (25 mm) thick, min. 1.5 lb/cu.ft density, meets requirements of NFPA90A and UL 181.
R-Value = 4.1

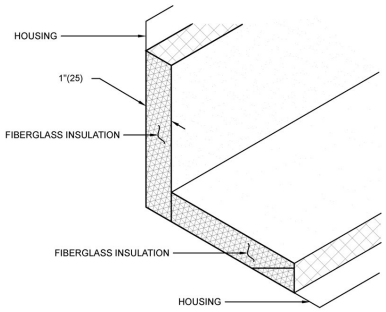

PROJECT: US Dept of Commerce NOAA **SUBMITTAL NO:** 258148-M **SUBMITTAL DATE:** 10/5/2020
ENGINEER: ADG Engineering **CUSTOMER:** US Dept of Commerce NOAA
DESCRIPTION: Single Duct - DDC By Others
SDV5//I/2000/8/FLD/CFM//EC/2.5/120-1/SCRV-DAT/IDSW////////FG1//PS/CCF/////////////////////SCR-109/

© Copyright Price Industries 2020

Electric Coil

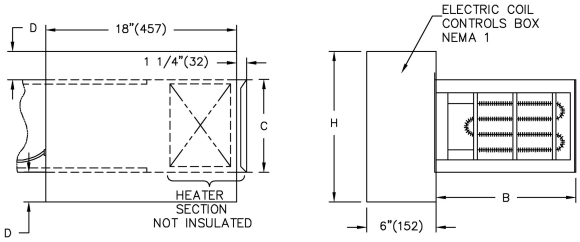

Unit Size	B	C	H	D
8	12	10	12	1

Standard Coil Notes

- Automatic reset thermal cutout
- Manual reset thermal cutout
- Hinged access door
- Refer to submitted control diagrams for standard control components to be supplied
- 24 VAC / 50 VAC Class 2 Transformer
- Low watt density elements, high grade nickel-chrome alloy
- Air flow switch
- Single point electrical connection
- Magnetic Contactors

Electrical Configuration

Supply Voltage:

- 120/1ø (2 Wire)

Stages/Control: SCRV-DAT

- SCR voltage control with 0-10 VDC control signal & DAT control
- SCR-109 (1 Phase SCR, 45 Amps Max / 480 volts Max)


Selected Coil Features

- IDSW - Door Interlock Disconnect
- CCF - Control circuit fuses

PROJECT: US Dept of Commerce NOAA **SUBMITTAL NO:** 258148-M **SUBMITTAL DATE:** 10/5/2020
ENGINEER: ADG Engineering **CUSTOMER:** US Dept of Commerce NOAA
DESCRIPTION: Single Duct - DDC By Others
SDV5//I/2000/8/FLD/CFM//EC/2.5/120-1/SCRV-DAT/IDSW/////////FG1//PS/CCF/////////////////////SCR-109/


© Copyright Price Industries 2020

SDV5 Single Duct w/ Electric Coil

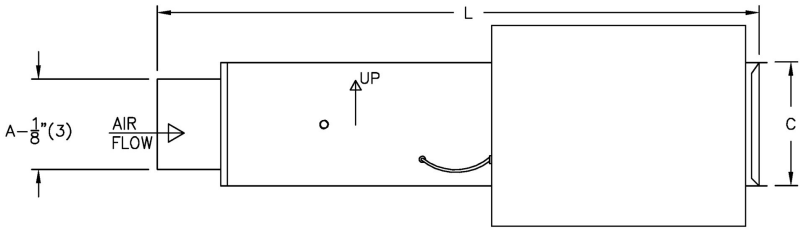

Unit Size	Max Airflow	Outlet		Inlet	Length
		B	C	A	L
14	3700	20	17 1/2	14	40 1/4

Digital Controls

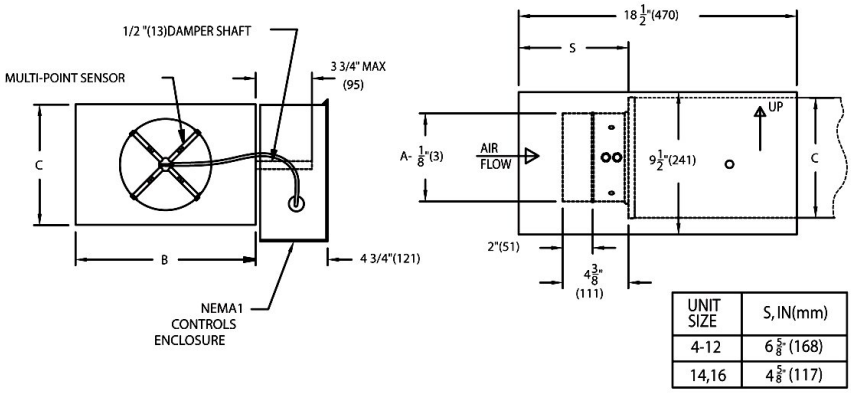

UNIT SIZE	S, IN(mm)
4-12	6 5/8"(168)
14,16	4 5/8"(117)

- Controls are supplied by controls contractor and field installed
- Controls Enclosure will be supplied as illustrated on right hand side unless specified otherwise
- CCF - Control circuit fusing
- Multi-point Primary Airflow Sensor supplied by Price

Notes

- 22 Ga. zinc coated terminal and 20 Ga. heater, mechanically sealed, leak resistant construction
- Rectangular discharge opening with slip and drive cleat duct connection


AHRI CERTIFIED™ www.ahridirectory.org VAV Terminals AHRI Standard 880

C ETL LISTED US Intertek

Assembly UL1995 & CSA236 certified

Liner FG1

Internal Insulation - Fiberglass 1" (25 mm) thick, min. 1.5 lb/cu.ft density, meets requirements of NFPA90A and UL 181.
R-Value = 4.1

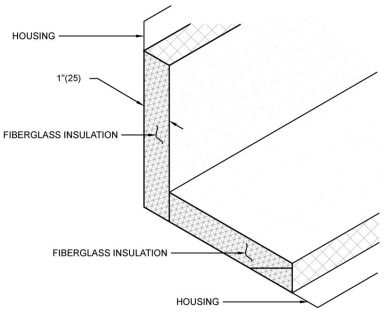


PROJECT: US Dept of Commerce NOAA **SUBMITTAL NO:** 258148-M **SUBMITTAL DATE:** 10/5/2020
ENGINEER: ADG Engineering **CUSTOMER:** US Dept of Commerce NOAA
DESCRIPTION: Single Duct - DDC By Others
SDV5//I/2000/14/FLD/CFM//EC/8.0/480-3/SCRV-DAT/IDSW/////////FG1//PS/CCF//////////////////////SCR-108/

© Copyright Price Industries 2020

All metric dimensions () are soft converted. Imperial dimensions are converted to metric and rounded to the nearest millimeter.
Information within this document is subject to change without notice.

Electric Coil

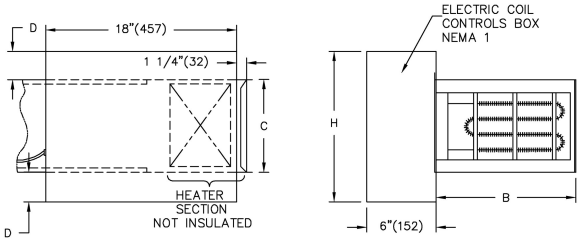

Unit Size	B	C	H	D
14	20	17 1/2	17	See Notes

Standard Coil Notes

- Automatic reset thermal cutout
- Manual reset thermal cutout
- Hinged access door
- Refer to submitted control diagrams for standard control components to be supplied
- Control box doesn't overhang SDV if the Unit Size is 9,10,14,16, or 24x16
- Low watt density elements, high grade nickel-chrome alloy
- Air flow switch
- Single point electrical connection
- Magnetic Contactors
- 24 VAC / 50 VAC Class 2 Transformer

Electrical Configuration

Supply Voltage:

- 480/3ø (3 Wire)

Stages/Control: SCRV-DAT

- SCR voltage control with 0-10 VDC control signal & DAT control
- SCR-108 (3 Phase SCR, 25 Amps Max / 480 Volts Max)


Selected Coil Features

- IDSW - Door Interlock Disconnect
- CCF - Control circuit fuses

PROJECT: US Dept of Commerce NOAA
SUBMITTAL NO: 258148-M
SUBMITTAL DATE: 10/5/2020
ENGINEER: ADG Engineering
CUSTOMER: US Dept of Commerce NOAA
DESCRIPTION: Single Duct - DDC By Others
SDV5//I/2000/14/FLD/CFM//EC/8.0/480-3/SCRV-DAT/IDSW/////////FG1//PS/CCF//////////////////////SCR-108/


© Copyright Price Industries 2020

SDV5 Single Duct w/ Electric Coil

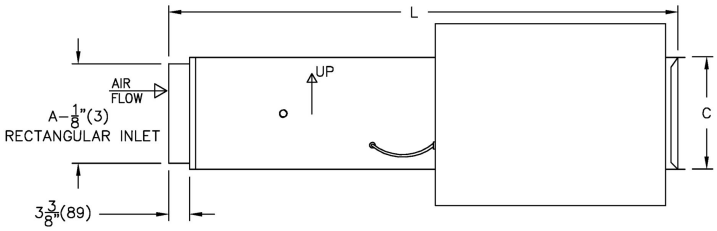

Unit Size	Max Airflow	Outlet		Inlet	Length
		B	C	A	L
24x16	8400	38	18	24x16	38 1/2

Digital Controls

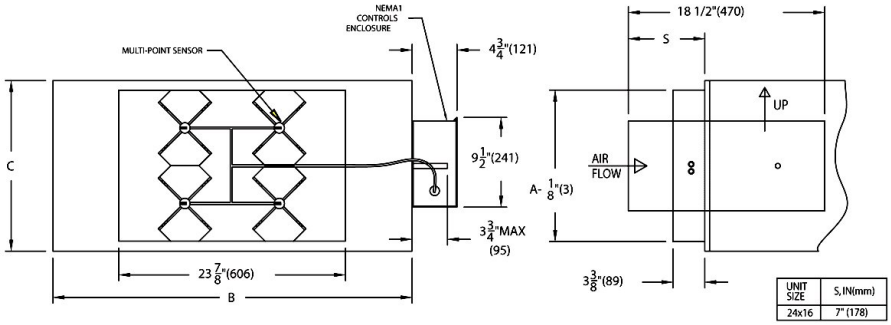

- Controls are supplied by controls contractor and field installed
- Controls Enclosure will be supplied as illustrated on right hand side unless specified otherwise
- CCF - Control circuit fusing
- Multi-point Primary Airflow Sensor supplied by Price

Notes

- 22 Ga. zinc coated terminal and 20 Ga. heater, mechanically sealed, leak resistant construction
- Rectangular discharge opening with slip and drive cleat duct connection


AHRI CERTIFIED™ www.ahridirectory.org VAV Terminals AHRI Standard 880

C ETL LISTED US Intertek

Assembly UL1995 & CSA236 certified

Liner FG1

Internal Insulation - Fiberglass 1" (25 mm) thick, min. 1.5 lb/cu.ft density, meets requirements of NFPA90A and UL 181.
R-Value = 4.1

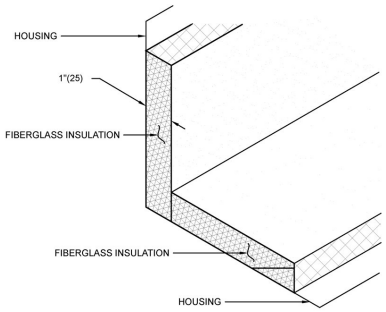


PROJECT: US Dept of Commerce NOAA **SUBMITTAL NO:** 258148-M **SUBMITTAL DATE:** 10/5/2020
ENGINEER: ADG Engineering **CUSTOMER:** US Dept of Commerce NOAA
DESCRIPTION: Single Duct - DDC By Others
SDV5//I/2000/24x16/FLD/CFM//EC/20.0/480-3/SCRV-DAT/IDSW/////////FG1//PS/CCF//////////////////////SCR-108/

© Copyright Price Industries 2020

All metric dimensions () are soft converted. Imperial dimensions are converted to metric and rounded to the nearest millimeter.
Information within this document is subject to change without notice.

Electric Coil

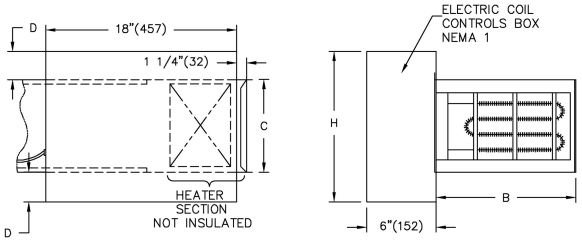

Unit Size	B	C	H	D
24x16	38	18	17	See Notes

Standard Coil Notes

- Automatic reset thermal cutout
- Manual reset thermal cutout
- Hinged access door
- Refer to submitted control diagrams for standard control components to be supplied
- Control box doesn't overhang SDV if the Unit Size is 9,10,14,16, or 24x16
- Low watt density elements, high grade nickel-chrome alloy
- Air flow switch
- Single point electrical connection
- Magnetic Contactors
- 24 VAC / 50 VAC Class 2 Transformer

Electrical Configuration

Supply Voltage:

- 480/3ø (3 Wire)

Stages/Control: SCRV-DAT

- SCR voltage control with 0-10 VDC control signal & DAT control
- SCR-108 (3 Phase SCR, 25 Amps Max / 480 Volts Max)

Selected Coil Features

- IDSW - Door Interlock Disconnect
- CCF - Control circuit fuses

PROJECT: US Dept of Commerce NOAA **SUBMITTAL NO:** 258148-M **SUBMITTAL DATE:** 10/5/2020
ENGINEER: ADG Engineering **CUSTOMER:** US Dept of Commerce NOAA
DESCRIPTION: Single Duct - DDC By Others
SDV5//I/2000/24x16/FLD/CFM//EC/20.0/480-3/SCRV-DAT/IDSW/////////FG1//PS/CCF//////////////////////SCR-108/

© Copyright Price Industries 2020

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 36 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	10	1000	200	1.00	0.25	0.75	0.01	4.1	15.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
2.5	200	55.0	96.8	480-3	SCRV-DAT	3.0

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
57	50	42	35	28	27	--	70	63	54	53	49	46	21 (2)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 37 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	8	830	200	1.00	0.25	0.75	0.01	4.1	15.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
2.5	200	55.0	96.8	480-3	SCRV-DAT	3.0

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
61	53	43	38	31	26	23 (2)	76	68	59	56	51	46	28 (2)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 38 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	10	940	240	1.00	0.25	0.75	0.01	6.6	15.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
4.0	320	55.0	96.8	480-3	SCRV-DAT	4.8

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
56	49	42	34	28	27	--	69	63	53	52	49	46	20 (2)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 39 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	8	760	190	1.00	0.25	0.75	0.01	28.4	30.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
2.5	200	55.0	96.8	120-1	SCRV-DAT	20.8

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
59	52	42	37	31	25	22 (2)	74	66	58	55	50	45	27 (2)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 40 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	8	840	200	1.00	0.25	0.75	0.01	4.1	15.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
2.5	200	55.0	96.8	480-3	SCRV-DAT	3.0

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
61	53	43	38	32	26	23 (2)	76	68	59	57	51	46	29 (2)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 41 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	8	610	155	1.00	0.25	0.75	0.01	4.1	15.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
2.5	200	55.0	96.8	480-3	SCRV-DAT	3.0

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
57	49	40	35	29	24	--	72	63	54	52	48	44	26 (2)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 42 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	14	2270	240	1.00	0.25	0.75	0.01	4.9	15.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
3.0	240	55.0	96.8	480-3	SCRV-DAT	3.6

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
58	52	46	38	34	33	20 (3)	69	61	61	55	53	50	20 (2)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 43 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	16	4000	400	1.00	0.25	0.75	0.01	4.9	15.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
3.0	400	55.0	80.1	480-3	SCRV-DAT	3.6

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
61	57	52	47	45	38	26 (4)	71	63	63	60	56	53	23 (2)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 44 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	8	590	150	1.00	0.25	0.75	0.01	4.1	15.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
2.5	200	55.0	96.8	480-3	SCRV-DAT	3.0

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
56	49	39	34	29	24	--	71	63	54	51	47	43	25 (2)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 45 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	14	2700	680	1.00	0.25	0.75	0.01	13.1	15.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
8.0	720	55.0	92.2	480-3	SCRV-DAT	9.6

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
60	54	49	40	36	35	22 (4)	70	62	64	57	54	51	21 (2)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 46 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	24x16	5000	1250	1.00	0.25	0.75	0.01	32.8	35.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
20.0	1580	55.0	97.4	480-3	SCRV-DAT	24.1

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
69	64	58	50	45	37	35 (2)	77	74	67	65	64	58	33 (3)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.

PRICE ALL-IN-ONE

Terminal Unit Selection - SDV5

Project: US Dept of Commerce NOAA **Location:** Miami, Florida **Altitude:** 2556 (ft) **Model:** SDV5

Tag: VAV 47 **Quantity:** 1

Selection

Model	Size	Primary (CFM)		Static Pressure (in. w.g.)				Electrical	
	Unit	Max	Min	Inlet SP	Downstream SP	Differential PD	Min Oper. PD	MCA	MOP
SDV5	24x16	5000	1250	1.00	0.25	0.75	0.01	32.8	35.0

Heating Coil Performance

EC Capacity (kW)	Reheat (CFM)	Coil Performance				
		EAT (°F)	LAT (°F)	Volts (V)	Steps	Coil Amps (A)
20.0	1580	55.0	97.4	480-3	SCRV-DAT	24.1

Accessories

Terminal Liner : FG1 **Accessory 1 :** PS **Accessory 2 :** CCF

Coil Options

Coil Option 1 : IDSW

Sound Performance

Max Radiated Sound Power Levels (dB)						Max Radiated NC	Max Discharge Sound Power Levels (dB)						Max Discharge NC
Octave Band							Octave Band						
2	3	4	5	6	7		2	3	4	5	6	7	
69	64	58	50	45	37	35 (2)	77	74	67	65	64	58	33 (3)

Performance Notes:

1. Dashes (--) indicate NC values less than 20.
2. NC values are calculated based on procedures outlined in AHRI Standard 885-2008, “A Procedure for Estimating Occupied Space Sound Levels in the Application of Air Terminals and Air Outlets.”
3. Sound power levels are given in decibels (dB).
4. Dashes (--) indicate sound power levels below 36-29-26-22-19-17 for each octave band; values below these sound power levels are considered below significance per AHRI 880.
5. Minimum operating pressure is the minimum static pressure required to operate the terminal unit assembly at maximum primary flow with a wide open damper.
6. NC values are derived from sound power levels obtained in accordance with ASHRAE Standard 130-2016 and AHRI Standard 880-2017, which include duct end reflection corrections.
7. Terminal unit assembly is ETL certified in accordance with UL1995 and CSA 22.2.236.

The Results of this program are only an aid to the designer, and are not a substitute for professional design services.
Price Industries accepts no liability for the adequacy of any resulting design or installation. All data subject to change without notice.