FCU BASEMENT Unit

The **Magic Aire Model HBB40ABAAAAABA7B7BAABBM** is the larger version of the previous unit, moving up to a **4.0-Ton (48,000 BTU/hr)** capacity commercial-grade, **Horizontal Belt-Drive Fan Coil / Air Handling Unit.**

The model breakdown for this specific configuration includes:

HBB: Represents the Magic Aire HBB Series, signifying a ceiling-suspended, **Horizontal Belt-Drive Blower Coil Unit** built for commercial applications.

40: Specifies the nominal capacity or size. In this product line, **40 represents a 4.0-Ton / 48,000 BTU/hr** chassis.

ABAAAAABA7B7BAABBM: This complex options string tells the factory exactly how to assemble the interior. Compared to your previous 2-ton model, this specific string alters the mechanical drive package (indicated by the **7B7** segment rather than the 6CB5 segment), matching a different motor horsepower, voltage phase, or pulley/sheave configuration to safely push the higher static air pressure needed for a 4-ton system..

Comparative Look: HBB20 vs. HBB40

Because these two units share the same underlying architecture but exist in different sizes, their fundamental capabilities scale up as detailed in the direct comparison below:

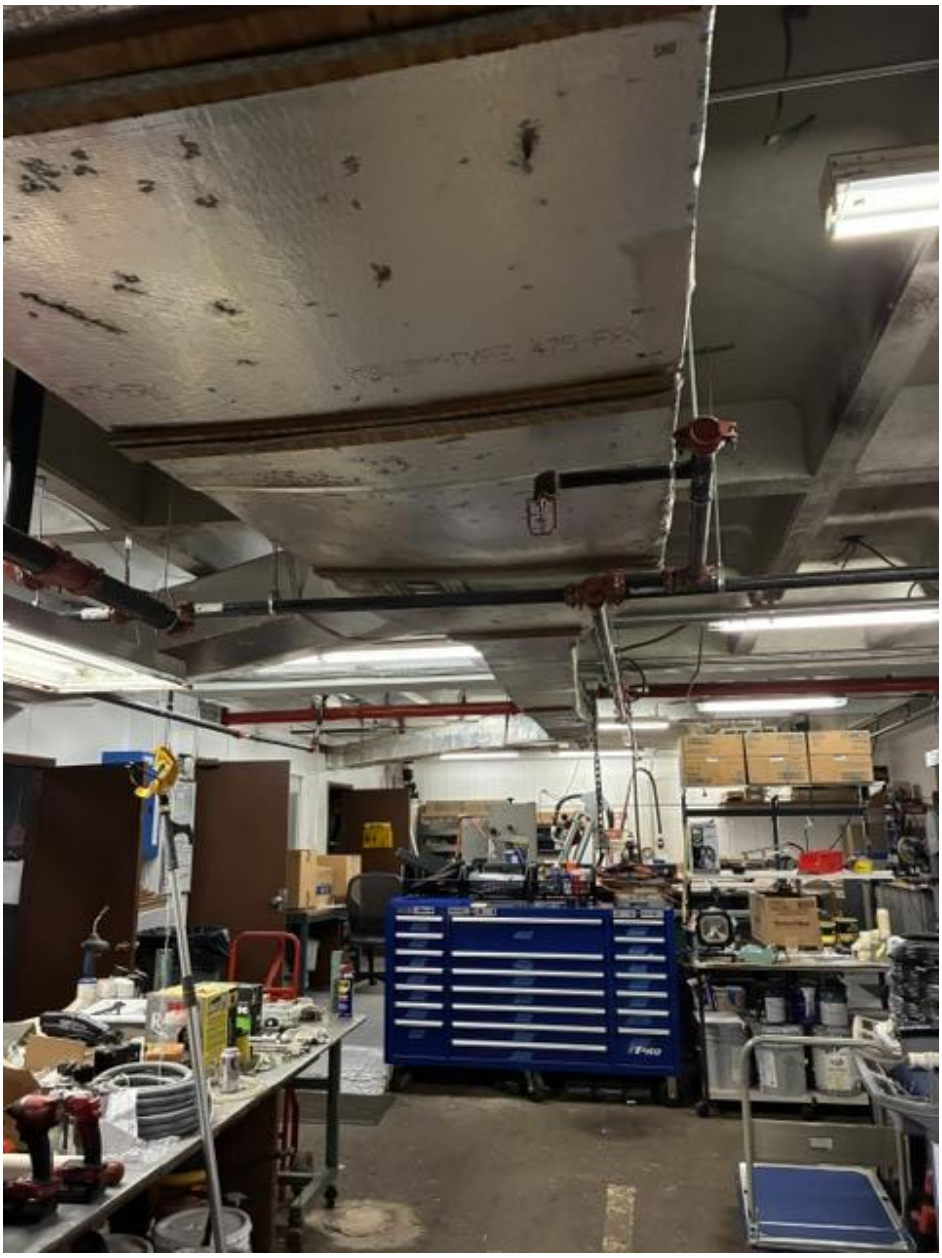
Feature / Specification	Model HBB20... (2-Ton)	Model HBB40... (4-Ton)
Nominal Cooling Capacity	2.0 Tons (24,000 BTU/hr)	**4.0 Tons (48,000 BTU/hr)**
Typical Airflow Range	~800 CFM	**~1,600 CFM**
Chassis Dimensions	Narrower/lighter framework	**Wider cabinet footprint** to house larger blower wheels and higher-surface-area coils
Drive Package Variant	Equipped with a 6CB5 motor/sheave kit	**Equipped with a 7B7 motor/sheave kit**
Installation Focus	Small commercial zones, individual office suites	**Large commercial zones, wider common areas**

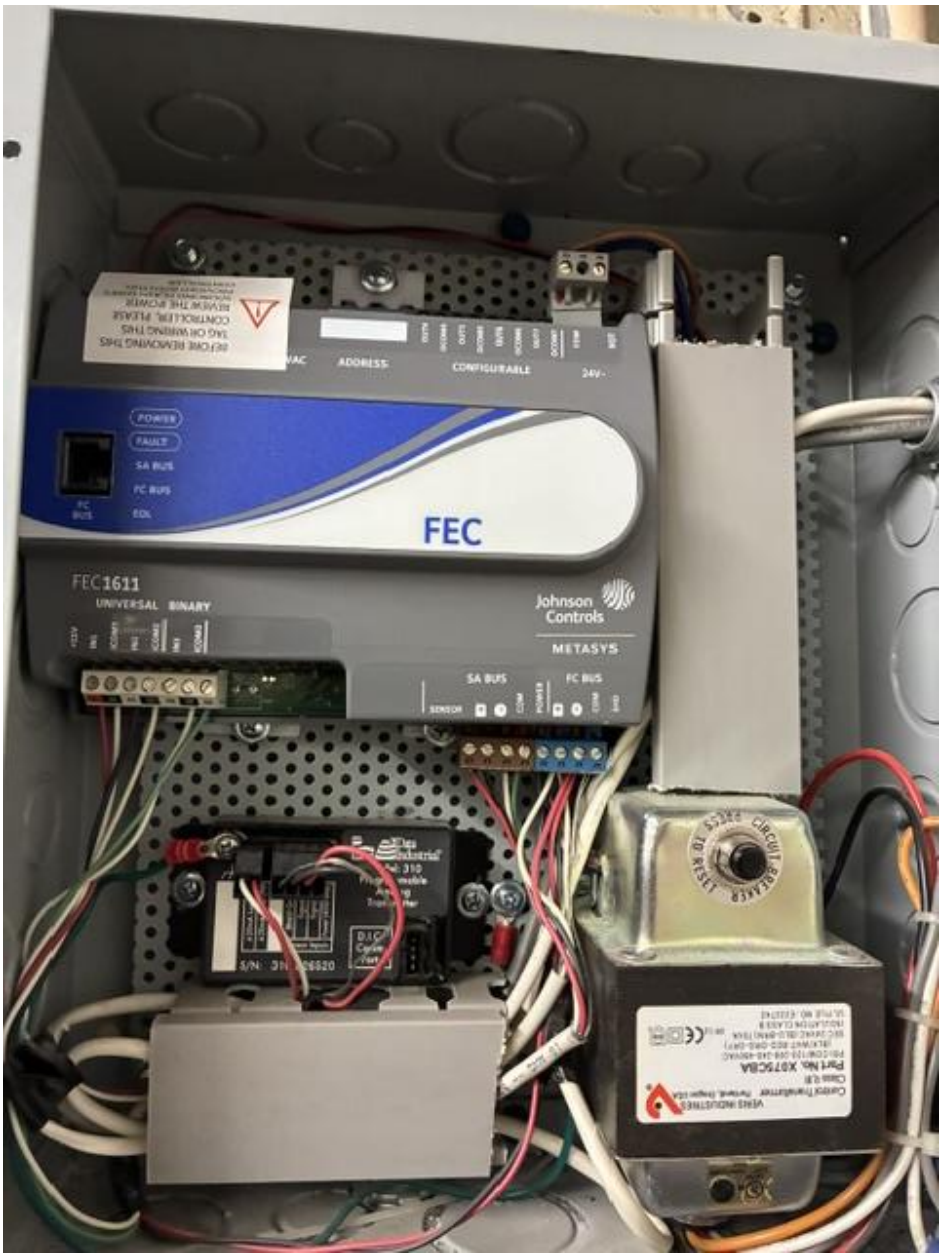

AVERTISSEMENT
WARNING
MODEL NO: HBB40ABAAAAA/SK/RYBAABBM
SN:
CATEGORY NO: HBB40-4W
TAG:
UNIT / Appareil: 115 VOLTS 1 PHASE 60 Hz
Permissible Voltage at Unit
Tension induit dans l'appareil
MINIMUM CIRCUIT AMPS:
Amp res min du circuit: 27.5
108 MIN 126 MAX
MAXIMUM OVERCURRENT PROTECTIVE DEVICE:
Courant nominal maximal du dispositifde protection contre les surintensit s:
50
FAN COIL UNIT AND ROOM FAN HEATER UNIT CONFORM TO ANSI/UL STD 1995 CERTIFIED TO CAN/CSA STD C22.2 NO. 236
INDOOR FAN MOTOR:
Moteur du ventilateur int rieur:
22 FLA / Int. Max.
2 HP
ELECTRIC HEAT/ Chaleur lectrique
AMPS KW
REFRIGERANT / Frigorig ne: R-
DESIGN PRESSURE PSIG/ Pression nominale en PSI manom trique
HIGH SIDE / C t HP
LOW SIDE / C t BP
Intertek
MAX.STEAM PRESSURE PSIG:
Pression de vapeur max. en PSI manom trique:
MAXIMUM OUTLET AIR TEMP:
Temp rature maxima de la sortie:
130 oF
MAX WATER TEMP:
Temp. de l'eau max.
180 oF
Minimum Clearance Required: 0 inches. L' espace de d gagement minimum est de 0 po.
Use Copper Supply Wires. Utiliser des fils d'alimentation en cuivre.
Use 8 AWG or Larger Wire Suitable for at least 75o C.
Utiliser des conducteur convenant au moins 75o C.
Tested at 2.2 inches W.C. External Static Pressure.
Test sous pression statique externe de 2.2 po.
Units with a refrigerant designation are for use with a remote condenser.
Les appareils avec la d signation frigorig ne sont pr vus pour utilisation avec condenseur distance.
United Electric Company 501 Galveston Street Wichita Falls TX 76301
HBLABELF ETL 0812




CINTAS


NOT AN
EXIT
CINTAS




FEC
FEC1611
UNIVERSAL BINARY
Johnson Controls
METASYS
SA BUS
FC BUS
POWER
FAULT
ADDRESS
CONFIGURABLE
24V-


FOR SERVICE AND PARTS CALL:
DCI
MANUFACTURER SERVICE REPRESENTATIVE
BASEMENT UNIT CONTOLLER
BLDG FLOW METER
EMS