
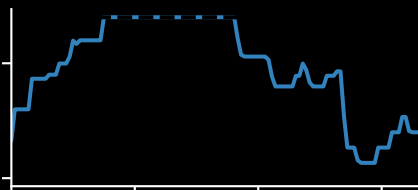




# Single Phase Constraints

# Three Phase Constraints



Aggregate  
Power (kW)

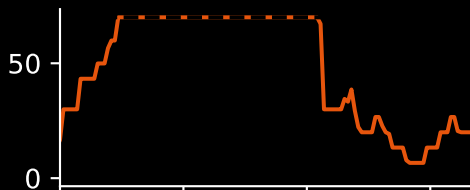

Secondary  
Line Currents (A)

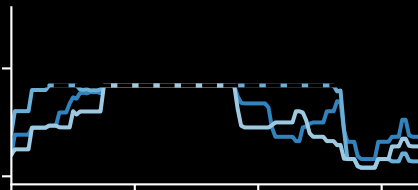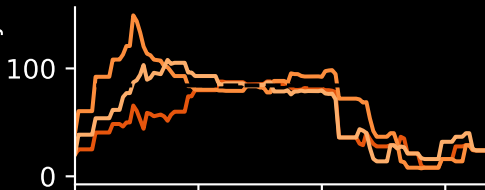

Primary  
Line Currents (A)

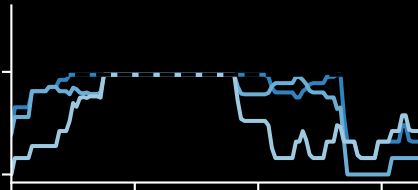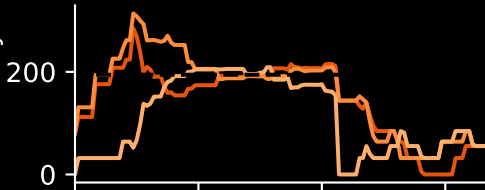

7:00 10:00 13:00 16:00

7:00 10:00 13:00 16:00