


E51SB-1027, -29, -32 - roof bollard connection space added

APPROVED FOR CONSTRUCTION 16.06.2026

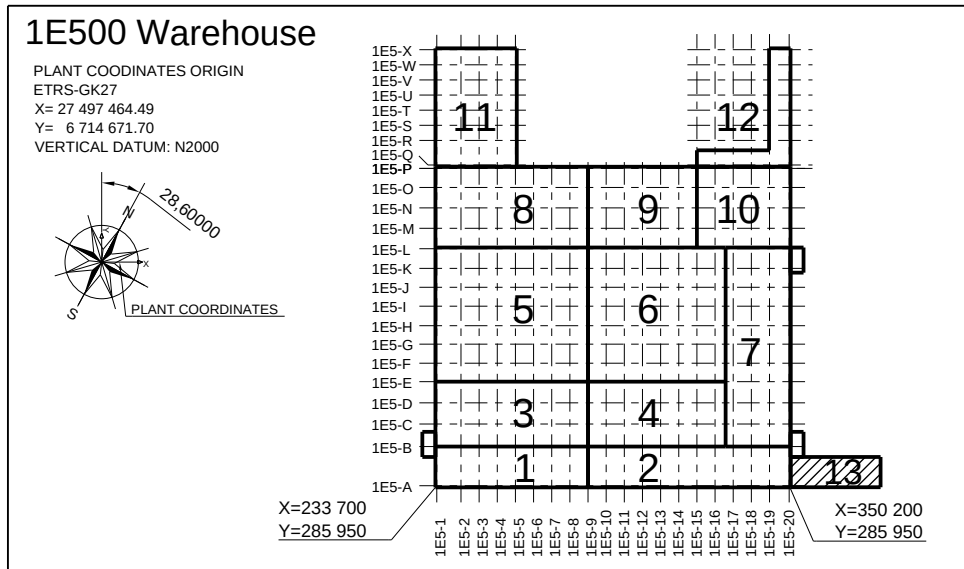

01	Roof bollard connection zone added				FIALES	29.06.2026	FIKJER	
REV.		REVISION			CHANGED BY		DATE	CHECKED BY
Date		Designed	Checked	Approved	Status			
16.06.2026		FIALES	FIKJER	FIKOPE	AFC			
Document ID			Area	Relates			Scale	Size
25019443-ICC250-0600-0660-001344			1E500					A4
Project ID			Sub area	Position ID			Discipline	
25019443							CIVIL	
			Title Easpring New Materials Oy FAIR phase 1 Warehouse, Steel Structures, Access bridge between 1A100-1E500, Rolled Beams, Assembly Drawings					
Drawing number							Revision	Page/Pages
25019443-ICC250-0600-0660-001344							01	1/1

 Sustainable engineering and design Sweco Finland Oy Ilmalantori 4 00240 Helsinki Puh. 0207 393 000 etunimi.sukunimi@sweco.fi					ASSEMBLY PART LIST															
					CONTENT:		Access bridge between 1A100-1E500, Rolled Beams													
Project number:			25019443			DOCUMENT:		25019443-ICC250-0600-0660-001344												
Project name:			Easpring New Materials Oy			STATUS		Approved For Construction				Revision:			1					
Project address:			FAIR Phase 1									List date:			29.06.2026					
Author:			FIALES			Inspector:		FIKJER				Approver:			FIPEKO					
Kommenttirivi		Roof bollard connection zone added																		
Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date		Drw. incl.	Note!			
9000	E51B-1004	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3580.0	727.0	710.0	494.4	545	9.96	16.06.2026							
9000	E51BL-1083		PL8X98		S355J2+N	1	515.0	98.0	8.0	3.2	3		16.06.2026							
9000	E51BL-1122		PL15X220		S355J2+N	1	530.0	220.0	15.0	13.7	14		16.06.2026							
9000	E51BL-1141		PL20X220		S355J2+N	1	670.0	220.0	20.0	23.1	23		16.06.2026							
9000	E51BL-1151		PL15X234		S355J2	1	515.0	234.0	15.0	13.1	13		16.06.2026							
9000	E51BL-1160		PL5X37		S355J2+N	3	94.0	37.0	5.0	0.1	0		16.06.2026							
9000	E51BL-1164		PL5X34		S355J2+N	1	94.0	34.0	5.0	0.1	0		16.06.2026							
9000	E51BL-1169		PL15X89		S355J2	1	515.0	89.0	15.0	5.4	5		16.06.2026							
9000	E51BL-1170		PL15X110		S355J2+N	1	300.0	110.0	15.0	3.7	4		16.06.2026							
9000	E51BP-1033		IPE550		S355J2	1	3560.0			374.5	375		16.06.2026							
9000	E51BP-1145		IPE550		S355J2	2	474.0			49.9	100		16.06.2026							
9000	E51BP-1153		CFRHS100X40X3		S355J2H	1	545.0			3.3	3		16.06.2026							
9000	E51BP-1156		CFRHS100X40X3		S355J2H	1	702.0			4.3	4		16.06.2026							
9000	E51B-1010	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	20740.0	770.0	640.0	2331.1	3398	65.01	16.06.2026							
9000	E51BL-1083		PL8X98		S355J2+N	16	515.0	98.0	8.0	3.2	51		16.06.2026							
9000	E51BL-1122		PL15X220		S355J2+N	11	530.0	220.0	15.0	13.7	151		16.06.2026							
9000	E51BL-1135		PL10X92		S355J2+N	2	515.0	92.0	10.0	3.7	7		16.06.2026							
9000	E51BL-1160		PL5X37		S355J2+N	22	94.0	37.0	5.0	0.1	3		16.06.2026							
9000	E51BL-1164		PL5X34		S355J2+N	10	94.0	34.0	5.0	0.1	1		16.06.2026							
9000	E51BL-1165		PL5X47		S355J2+N	32	144.0	47.0	5.0	0.3	9		16.06.2026							
9000	E51BP-1031		IPE550		S355J2	1	20740.0			2181.6	2182		16.06.2026							
9000	E51BP-1145		IPE550		S355J2	6	474.0			49.9	299		16.06.2026							
9000	E51BP-1147		IPE550		S355J2	10	479.0			50.4	504		16.06.2026							

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BP-1153		CFRHS100X40X3		S355J2H	6	545.0			3.3	20		16.06.2026			
9000	E51BP-1154		CFRHS150X50X5		S355J2H	6	545.0			7.8	47		16.06.2026			
9000	E51BP-1158		CFRHS150X50X5		S355J2H	10	550.0			7.9	79		16.06.2026			
9000	E51BP-1159		CFRHS100X40X3		S355J2H	4	745.0			4.6	18		16.06.2026			
9000	E51BP-1160		CFRHS100X40X3		S355J2H	6	707.0			4.3	26		16.06.2026			
9000	E51B-1011	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	20740.0	770.0	640.0	2327.4	3390	64.79	16.06.2026			
9000	E51BL-1083		PL8X98		S355J2+N	16	515.0	98.0	8.0	3.2	51		16.06.2026			
9000	E51BL-1122		PL15X220		S355J2+N	11	530.0	220.0	15.0	13.7	151		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	22	94.0	37.0	5.0	0.1	3		16.06.2026			
9000	E51BL-1164		PL5X34		S355J2+N	10	94.0	34.0	5.0	0.1	1		16.06.2026			
9000	E51BL-1165		PL5X47		S355J2+N	32	144.0	47.0	5.0	0.3	9		16.06.2026			
9000	E51BP-1031		IPE550		S355J2	1	20740.0			2181.6	2182		16.06.2026			
9000	E51BP-1145		IPE550		S355J2	6	474.0			49.9	299		16.06.2026			
9000	E51BP-1147		IPE550		S355J2	10	479.0			50.4	504		16.06.2026			
9000	E51BP-1153		CFRHS100X40X3		S355J2H	6	545.0			3.3	20		16.06.2026			
9000	E51BP-1154		CFRHS150X50X5		S355J2H	6	545.0			7.8	47		16.06.2026			
9000	E51BP-1158		CFRHS150X50X5		S355J2H	10	550.0			7.9	79		16.06.2026			
9000	E51BP-1159		CFRHS100X40X3		S355J2H	4	745.0			4.6	18		16.06.2026			
9000	E51BP-1160		CFRHS100X40X3		S355J2H	6	707.0			4.3	26		16.06.2026			
9000	E51B-1025	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3585.0	725.0	1040.0	591.7	601	11.05	16.06.2026			
9000	E51BL-1083		PL8X98		S355J2+N	1	515.0	98.0	8.0	3.2	3		16.06.2026			
9000	E51BL-1122		PL15X220		S355J2+N	1	530.0	220.0	15.0	13.7	14		16.06.2026			
9000	E51BL-1139		PL20X290		S355J2+N	1	550.0	290.0	20.0	24.9	25		16.06.2026			
9000	E51BL-1140		PL25X210		S355J2+N	1	420.0	210.0	25.0	17.3	17		16.06.2026			
9000	E51BL-1149		PL15X234		S355J2	1	515.0	234.0	15.0	13.1	13		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	4	94.0	37.0	5.0	0.1	1		16.06.2026			
9000	E51BL-1164		PL5X34		S355J2+N	1	94.0	34.0	5.0	0.1	0		16.06.2026			
9000	E51BL-1165		PL5X47		S355J2+N	4	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51BL-1171		PL12X80		S355J2+N	1	200.0	80.0	12.0	1.4	1		16.06.2026			
9000	E51BP-1032		IPE550		S355J2	1	3475.0			365.6	366		16.06.2026			
9000	E51BP-1145		IPE550		S355J2	1	474.0			49.9	50		16.06.2026			
9000	E51BP-1147		IPE550		S355J2	1	479.0			50.4	50		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BP-1149		HEB200		S355J2	1	415.0			25.4	25		16.06.2026			
9000	E51BP-1153		CFRHS100X40X3		S355J2H	1	545.0			3.3	3		16.06.2026			
9000	E51BP-1154		CFRHS150X50X5		S355J2H	2	545.0			7.8	16		16.06.2026			
9000	E51BP-1161		CFRHS100X40X3		S355J2H	1	453.0			2.8	3		16.06.2026			
9000	E51BP-1163		CFRHS100X40X3		S355J2H	1	228.0			1.4	1		16.06.2026			
9000	E51WCL-1126		PL15X335		S355J2+N	1	323.0	335.0	15.0	10.9	11		16.06.2026			
9000	E51B-1026	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3585.0	725.0	1040.0	591.7	601	11.05	16.06.2026			
9000	E51BL-1083		PL8X98		S355J2+N	1	515.0	98.0	8.0	3.2	3		16.06.2026			
9000	E51BL-1122		PL15X220		S355J2+N	1	530.0	220.0	15.0	13.7	14		16.06.2026			
9000	E51BL-1139		PL20X290		S355J2+N	1	550.0	290.0	20.0	24.9	25		16.06.2026			
9000	E51BL-1140		PL25X210		S355J2+N	1	420.0	210.0	25.0	17.3	17		16.06.2026			
9000	E51BL-1149		PL15X234		S355J2	1	515.0	234.0	15.0	13.1	13		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	4	94.0	37.0	5.0	0.1	1		16.06.2026			
9000	E51BL-1164		PL5X34		S355J2+N	1	94.0	34.0	5.0	0.1	0		16.06.2026			
9000	E51BL-1165		PL5X47		S355J2+N	4	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51BL-1171		PL12X80		S355J2+N	1	200.0	80.0	12.0	1.4	1		16.06.2026			
9000	E51BP-1032		IPE550		S355J2	1	3475.0			365.6	366		16.06.2026			
9000	E51BP-1145		IPE550		S355J2	1	474.0			49.9	50		16.06.2026			
9000	E51BP-1147		IPE550		S355J2	1	479.0			50.4	50		16.06.2026			
9000	E51BP-1149		HEB200		S355J2	1	415.0			25.4	25		16.06.2026			
9000	E51BP-1153		CFRHS100X40X3		S355J2H	1	545.0			3.3	3		16.06.2026			
9000	E51BP-1154		CFRHS150X50X5		S355J2H	2	545.0			7.8	16		16.06.2026			
9000	E51BP-1161		CFRHS100X40X3		S355J2H	1	453.0			2.8	3		16.06.2026			
9000	E51BP-1163		CFRHS100X40X3		S355J2H	1	228.0			1.4	1		16.06.2026			
9000	E51WCL-1126		PL15X335		S355J2+N	1	323.0	335.0	15.0	10.9	11		16.06.2026			
9000	E51B-1030	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3496.0	970.0	1147.0	706.9	710	10.86	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1047		PL30X569		S355J2+N	1	1122.0	569.0	30.0	130.7	131		16.06.2026			
9000	E51BL-1120		PL15X145		S355J2+N	1	296.0	145.0	15.0	5.0	5		16.06.2026			
9000	E51BL-1136		PL20X310		S355J2+N	1	1000.0	310.0	20.0	48.7	49		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date		Drw. incl.	Note!
9000	E51BL-1157		PL10X92		S355J2+N	1	145.0	92.0	10.0	1.0	1		16.06.2026				
9000	E51BL-1157		PL10X93		S355J2+N	1	145.0	93.0	10.0	1.0	1		16.06.2026				
9000	E51BL-1162		PL5X47		S355J2+N	1	94.0	47.0	5.0	0.2	0		16.06.2026				
9000	E51BL-1163		PL5X44		S355J2+N	3	94.0	44.0	5.0	0.2	1		16.06.2026				
9000	E51BL-1166		PL15X136		S355J2+N	1	296.0	136.0	15.0	4.7	5		16.06.2026				
9000	E51BP-1127		HEA340		S355J2	1	3436.0			360.1	360		16.06.2026				
9000	E51BP-1164		IPE330		S355J2	1	485.0			23.8	24		16.06.2026				
9000	E51BP-1168		CFRHS100X50X5		S355J2H	1	685.0			7.2	7		16.06.2026				
9000	E51BP-1173		HEA200		S355J2	1	620.0			26.2	26		16.06.2026				
9000	E51BP-1174		CFRHS100X50X5		S355J2H	2	260.0			2.7	6		16.06.2026				
9000	E51B-1032	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2525.0	965.0	550.0	497.2	507	7.89	16.06.2026				
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026				
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026				
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026				
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026				
9000	E51BL-1162		PL5X47		S355J2+N	3	94.0	47.0	5.0	0.2	1		16.06.2026				
9000	E51BL-1163		PL5X44		S355J2+N	3	94.0	44.0	5.0	0.2	1		16.06.2026				
9000	E51BL-1166		PL15X136		S355J2+N	3	296.0	136.0	15.0	4.7	14		16.06.2026				
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026				
9000	E51BP-1012		HEA340		S355J2	1	2445.0			256.2	256		16.06.2026				
9000	E51BP-1164		IPE330		S355J2	1	485.0			23.8	24		16.06.2026				
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026				
9000	E51BP-1166		CFRHS100X50X5		S355J2H	1	560.0			5.9	6		16.06.2026				
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026				
9000	E51BP-1168		CFRHS100X50X5		S355J2H	1	685.0			7.2	7		16.06.2026				
9000	E51B-1034	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2563.0	760.0	550.0	470.3	491	7.41	16.06.2026				
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026				
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026				
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026				
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026				
9000	E51BL-1162		PL5X47		S355J2+N	2	94.0	47.0	5.0	0.2	0		16.06.2026				
9000	E51BL-1163		PL5X44		S355J2+N	4	94.0	44.0	5.0	0.2	1		16.06.2026				

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BL-1166		PL15X136		S355J2+N	4	296.0	136.0	15.0	4.7	19		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1035		HEA340		S355J2	1	2483.0			260.2	260		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	2	560.0			5.9	12		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			
9000	E51B-1035	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2742.0	760.0	550.0	489.0	510	7.73	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	2	94.0	47.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	4	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	4	296.0	136.0	15.0	4.7	19		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1013		HEA340		S355J2	1	2662.0			278.9	279		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	2	560.0			5.9	12		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			
9000	E51B-1036	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2845.0	760.0	550.0	499.7	521	7.92	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	2	94.0	47.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	4	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	4	296.0	136.0	15.0	4.7	19		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1002		HEA340		S355J2	1	2765.0			289.7	290		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	2	560.0			5.9	12		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51B-1037	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2742.0	760.0	550.0	489.0	510	7.73	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	2	94.0	47.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	4	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	4	296.0	136.0	15.0	4.7	19		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1013		HEA340		S355J2	1	2662.0			278.9	279		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	2	560.0			5.9	12		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			
9000	E51B-1038	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2845.0	760.0	550.0	499.7	521	7.92	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	2	94.0	47.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	4	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	4	296.0	136.0	15.0	4.7	19		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1002		HEA340		S355J2	1	2765.0			289.7	290		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	2	560.0			5.9	12		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			
9000	E51B-1039	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2563.0	760.0	550.0	470.3	491	7.41	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BL-1162		PL5X47		S355J2+N	2	94.0	47.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	4	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	4	296.0	136.0	15.0	4.7	19		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1035		HEA340		S355J2	1	2483.0			260.2	260		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	2	560.0			5.9	12		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			
9000	E51B-1040	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2693.0	760.0	550.0	487.0	502	7.64	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	2	94.0	47.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	4	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	2	296.0	136.0	15.0	4.7	9		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1130		HEA340		S355J2	1	2613.0			273.8	274		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	2	560.0			5.9	12		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			
9000	E51WCL-1176		PL10X138		S355J2+N	2	296.0	138.0	10.0	3.2	6		16.06.2026			
9000	E51B-1041	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2513.0	965.0	550.0	496.1	506	7.87	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	3	94.0	47.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	3	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	3	296.0	136.0	15.0	4.7	14		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1129		HEA340		S355J2	1	2433.0			255.0	255		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BP-1164		IPE330		S355J2	1	485.0			23.8	24		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	1	560.0			5.9	6		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			
9000	E51BP-1168		CFRHS100X50X5		S355J2H	1	685.0			7.2	7		16.06.2026			
9000	E51B-1042	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2654.0	965.0	550.0	510.0	520	8.11	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	4	94.0	47.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	2	94.0	44.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	3	296.0	136.0	15.0	4.7	14		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1131		HEA340		S355J2	1	2574.0			269.8	270		16.06.2026			
9000	E51BP-1164		IPE330		S355J2	1	485.0			23.8	24		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	1	560.0			5.9	6		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			
9000	E51BP-1170		CFRHS100X50X5		S355J2H	1	610.0			6.4	6		16.06.2026			
9000	E51B-1043	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3596.0	970.0	1149.0	710.9	714	10.92	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1048		PL30X579		S355J2+N	1	1124.0	579.0	30.0	133.2	133		16.06.2026			
9000	E51BL-1072		PL10X145		S355J2+N	1	296.0	145.0	10.0	3.3	3		16.06.2026			
9000	E51BL-1136		PL20X310		S355J2+N	1	1000.0	310.0	20.0	48.7	49		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1159		PL10X92		S355J2+N	1	145.0	92.0	10.0	1.0	1		16.06.2026			
9000	E51BL-1159		PL10X93		S355J2+N	1	145.0	93.0	10.0	1.0	1		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	1	94.0	47.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	3	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	1	296.0	136.0	15.0	4.7	5		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BP-1014		HEA340		S355J2	1	3536.0			370.6	371		16.06.2026			
9000	E51BP-1164		IPE330		S355J2	1	485.0			23.8	24		16.06.2026			
9000	E51BP-1168		CFRHS100X50X5		S355J2H	1	685.0			7.2	7		16.06.2026			
9000	E51BP-1174		CFRHS100X50X5		S355J2H	2	260.0			2.7	6		16.06.2026			
9000	E51BP-1176		HEA160		S355J2	1	620.0			18.9	19		16.06.2026			
9000	E51B-1044	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3596.0	965.0	1149.0	712.3	715	10.91	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1048		PL30X579		S355J2+N	1	1124.0	579.0	30.0	133.2	133		16.06.2026			
9000	E51BL-1120		PL15X145		S355J2+N	1	296.0	145.0	15.0	5.0	5		16.06.2026			
9000	E51BL-1136		PL20X310		S355J2+N	1	1000.0	310.0	20.0	48.7	49		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1159		PL10X92		S355J2+N	1	145.0	92.0	10.0	1.0	1		16.06.2026			
9000	E51BL-1159		PL10X93		S355J2+N	1	145.0	93.0	10.0	1.0	1		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	1	94.0	47.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	3	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	1	296.0	136.0	15.0	4.7	5		16.06.2026			
9000	E51BP-1003		HEA340		S355J2	1	3536.0			370.6	371		16.06.2026			
9000	E51BP-1164		IPE330		S355J2	1	485.0			23.8	24		16.06.2026			
9000	E51BP-1168		CFRHS100X50X5		S355J2H	1	685.0			7.2	7		16.06.2026			
9000	E51BP-1172		CFRHS100X50X5		S355J2H	2	245.0			2.6	5		16.06.2026			
9000	E51BP-1175		HEA160		S355J2	1	615.0			18.7	19		16.06.2026			
9000	E51B-1045	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3629.0	1099.0	290.0	334.4	335	7.53	16.06.2026			
9000	E51BL-1004		PL8X125		S355J2+N	1	224.0	125.0	8.0	1.7	2		16.06.2026			
9000	E51BL-1056		PL12X200		S355J2+N	1	236.0	200.0	12.0	4.4	4		16.06.2026			
9000	E51BL-1119		PL15X180		S355J2+N	1	236.0	180.0	15.0	5.0	5		16.06.2026			
9000	E51BL-1125		PL10X246		S355J2+N	1	236.0	246.0	10.0	4.6	5		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	4	94.0	37.0	5.0	0.1	1		16.06.2026			
9000	E51BP-1009		HEA260		S355J2	1	3607.0			245.8	246		16.06.2026			
9000	E51BP-1058		CFRHS100X40X3		S355J2H	1	234.0			1.4	1		16.06.2026			
9000	E51BP-1178		CFRHS100X40X3		S355J2H	1	1054.0			6.5	7		16.06.2026			
9000	E51BP-1179		HEA260		S355J2	1	951.0			64.8	65		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51B-1048	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3389.0	621.0	830.0	397.5	398	6.88	16.06.2026			
9000	E51BL-1003		PL12X180		S355J2+N	1	236.0	180.0	12.0	4.0	4		16.06.2026			
9000	E51BL-1004		PL8X125		S355J2+N	1	224.0	125.0	8.0	1.7	2		16.06.2026			
9000	E51BL-1055		PL12X200		S355J2+N	1	260.0	200.0	12.0	4.9	5		16.06.2026			
9000	E51BL-1121		PL15X126		S355J2+N	1	224.0	126.0	15.0	3.3	3		16.06.2026			
9000	E51BL-1126		PL40X230		S355J2+N	1	821.0	230.0	40.0	58.9	59		16.06.2026			
9000	E51BL-1145		PL30X526		S355J2+N	1	771.0	526.0	30.0	85.5	86		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1021		HEA260		S355J2	1	3337.0			227.4	227		16.06.2026			
9000	E51BP-1180		CFRHS100X40X3		S355J2H	1	579.0			3.5	4		16.06.2026			
9000	E51BP-1181		T120		S235JR	1	349.0			8.1	8		16.06.2026			
9000	E51B-1049	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3729.0	621.0	290.0	283.9	284	6.37	16.06.2026			
9000	E51BL-1003		PL12X180		S355J2+N	1	236.0	180.0	12.0	4.0	4		16.06.2026			
9000	E51BL-1004		PL8X125		S355J2+N	1	224.0	125.0	8.0	1.7	2		16.06.2026			
9000	E51BL-1056		PL12X200		S355J2+N	1	236.0	200.0	12.0	4.4	4		16.06.2026			
9000	E51BL-1121		PL15X126		S355J2+N	1	224.0	126.0	15.0	3.3	3		16.06.2026			
9000	E51BL-1125		PL10X246		S355J2+N	1	236.0	246.0	10.0	4.6	5		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	4	94.0	37.0	5.0	0.1	1		16.06.2026			
9000	E51BP-1020		HEA260		S355J2	1	3707.0			252.6	253		16.06.2026			
9000	E51BP-1058		CFRHS100X40X3		S355J2H	1	234.0			1.4	1		16.06.2026			
9000	E51BP-1180		CFRHS100X40X3		S355J2H	1	579.0			3.5	4		16.06.2026			
9000	E51BP-1181		T120		S235JR	1	349.0			8.1	8		16.06.2026			
9000	E51B-1050	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3629.0	627.0	290.0	277.3	278	6.23	16.06.2026			
9000	E51BL-1003		PL12X180		S355J2+N	1	236.0	180.0	12.0	4.0	4		16.06.2026			
9000	E51BL-1004		PL8X125		S355J2+N	1	224.0	125.0	8.0	1.7	2		16.06.2026			
9000	E51BL-1056		PL12X200		S355J2+N	1	236.0	200.0	12.0	4.4	4		16.06.2026			
9000	E51BL-1121		PL15X126		S355J2+N	1	224.0	126.0	15.0	3.3	3		16.06.2026			
9000	E51BL-1125		PL10X246		S355J2+N	1	236.0	246.0	10.0	4.6	5		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	4	94.0	37.0	5.0	0.1	1		16.06.2026			
9000	E51BP-1008		HEA260		S355J2	1	3607.0			245.8	246		16.06.2026			
9000	E51BP-1050		T120		S235JR	1	355.0			8.2	8		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BP-1058		CFRHS100X40X3		S355J2H	1	234.0			1.4	1		16.06.2026			
9000	E51BP-1177		CFRHS100X40X3		S355J2H	1	585.0			3.6	4		16.06.2026			
9000	E51B-1054	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3729.0	627.0	290.0	284.1	285	6.38	16.06.2026			
9000	E51BL-1003		PL12X180		S355J2+N	1	236.0	180.0	12.0	4.0	4		16.06.2026			
9000	E51BL-1004		PL8X125		S355J2+N	1	224.0	125.0	8.0	1.7	2		16.06.2026			
9000	E51BL-1056		PL12X200		S355J2+N	1	236.0	200.0	12.0	4.4	4		16.06.2026			
9000	E51BL-1121		PL15X126		S355J2+N	1	224.0	126.0	15.0	3.3	3		16.06.2026			
9000	E51BL-1125		PL10X246		S355J2+N	1	236.0	246.0	10.0	4.6	5		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	4	94.0	37.0	5.0	0.1	1		16.06.2026			
9000	E51BP-1020		HEA260		S355J2	1	3707.0			252.6	253		16.06.2026			
9000	E51BP-1050		T120		S235JR	1	355.0			8.2	8		16.06.2026			
9000	E51BP-1058		CFRHS100X40X3		S355J2H	1	234.0			1.4	1		16.06.2026			
9000	E51BP-1177		CFRHS100X40X3		S355J2H	1	585.0			3.6	4		16.06.2026			
9000	E51B-1056	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2693.0	760.0	550.0	483.8	505	7.64	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	2	94.0	47.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	4	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	4	296.0	136.0	15.0	4.7	19		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	2	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1130		HEA340		S355J2	1	2613.0			273.8	274		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	2	560.0			5.9	12		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			
9000	E51B-1196	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	9470.0	424.0	639.0	1144.6	1193	17.97	16.06.2026			
9000	E51BL-1128		PL15X140		S355J2+N	4	261.0	140.0	15.0	4.2	17		16.06.2026			
9000	E51BL-1129		PL15X280		S355J2+N	2	300.0	280.0	15.0	9.8	20		16.06.2026			
9000	E51BL-1130		PL10X140		S355J2+N	4	261.0	140.0	10.0	2.8	11		16.06.2026			
9000	E51BL-1134		PL16X266		S355J2+N	1	279.0	266.0	16.0	6.0	6		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BP-1142		HEB300		S355J2	1	9440.0			1104.9	1105		16.06.2026			
9000	E51WCL-1103		PL20X339		S355J2+N	2	563.0	339.0	20.0	16.9	34		16.06.2026			
9000	E51B-1197	BRACE_VER		EXC2	RAL 7024 (Graphite Gray) / ISO	1	1611.0	150.0	150.0	54.4	54	0.94	16.06.2026			
9000	E51BP-1148		L150*15		S355J2	1	1611.0			54.4	54		16.06.2026			
9000	E51B-1198	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3580.0	1268.0	720.0	579.8	681	12.48	16.06.2026			
9000	E51BL-1083		PL8X98		S355J2+N	1	515.0	98.0	8.0	3.2	3		16.06.2026			
9000	E51BL-1123		PL15X220		S355J2+N	1	530.0	220.0	15.0	13.7	14		16.06.2026			
9000	E51BL-1150		PL20X220		S355J2+N	1	680.0	220.0	20.0	23.4	23		16.06.2026			
9000	E51BL-1158		PL20X210		S355J2+N	1	550.0	210.0	20.0	18.0	18		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	4	94.0	37.0	5.0	0.1	1		16.06.2026			
9000	E51BL-1164		PL5X34		S355J2+N	3	94.0	34.0	5.0	0.1	0		16.06.2026			
9000	E51BL-1170		PL15X110		S355J2+N	1	300.0	110.0	15.0	3.7	4		16.06.2026			
9000	E51BP-1039		IPE550		S355J2	1	3560.0			374.5	375		16.06.2026			
9000	E51BP-1151		IPE550		S355J2	2	954.0			100.4	201		16.06.2026			
9000	E51BP-1152		IPE550		S355J2	1	275.0			28.9	29		16.06.2026			
9000	E51BP-1155		CFRHS100X40X3		S355J2H	1	620.0			3.8	4		16.06.2026			
9000	E51BP-1157		CFRHS100X40X3		S355J2H	1	1030.0			6.3	6		16.06.2026			
9000	E51BP-1162		CFRHS100X40X3		S355J2H	1	593.0			3.6	4		16.06.2026			
9000	E51B-1199	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2940.0	930.0	582.0	331.8	335	6.52	16.06.2026			
9000	E51BL-1152		PL15X226		S355J2+N	1	237.0	226.0	15.0	5.3	5		16.06.2026			
9000	E51BL-1153		PL20X930		S355J2+N	1	460.0	930.0	20.0	65.6	66		16.06.2026			
9000	E51BL-1154		PL16X374		S355J2+N	1	777.0	374.0	16.0	34.5	35		16.06.2026			
9000	E51BL-1155		PL20X250		S355J2+N	1	460.0	250.0	20.0	18.1	18		16.06.2026			
9000	E51BL-1172		PL10X121		S355J2+N	1	224.0	121.0	10.0	2.1	2		16.06.2026			
9000	E51BL-1174		PL10X224		S355J2+N	1	326.0	224.0	10.0	5.5	6		16.06.2026			
9000	E51BP-1128		HEA260		S355J2	1	2900.0			197.7	198		16.06.2026			
9000	E51BP-1138		L100*10		S355J2	2	200.0			3.0	6		16.06.2026			
9000	E51B-1200	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2940.0	930.0	582.0	332.3	340	6.64	16.06.2026			
9000	E51BL-1152		PL15X226		S355J2+N	1	237.0	226.0	15.0	5.3	5		16.06.2026			
9000	E51BL-1153		PL20X930		S355J2+N	1	460.0	930.0	20.0	65.6	66		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BL-1155		PL20X250		S355J2+N	1	460.0	250.0	20.0	18.1	18		16.06.2026			
9000	E51BL-1172		PL10X121		S355J2+N	3	224.0	121.0	10.0	2.1	6		16.06.2026			
9000	E51BL-1173		PL16X374		S355J2+N	1	777.0	374.0	16.0	35.0	35		16.06.2026			
9000	E51BL-1174		PL10X224		S355J2+N	1	326.0	224.0	10.0	5.5	6		16.06.2026			
9000	E51BP-1128		HEA260		S355J2	1	2900.0			197.7	198		16.06.2026			
9000	E51BP-1138		L100*10		S355J2	2	200.0			3.0	6		16.06.2026			
9000	E51B-1201	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2940.0	930.0	581.0	331.8	335	6.52	16.06.2026			
9000	E51BL-1153		PL20X930		S355J2+N	1	460.0	930.0	20.0	65.6	66		16.06.2026			
9000	E51BL-1154		PL16X374		S355J2+N	1	777.0	374.0	16.0	34.5	35		16.06.2026			
9000	E51BL-1155		PL20X250		S355J2+N	1	460.0	250.0	20.0	18.1	18		16.06.2026			
9000	E51BL-1156		PL15X239		S355J2+N	1	228.0	239.0	15.0	5.4	5		16.06.2026			
9000	E51BL-1172		PL10X121		S355J2+N	1	224.0	121.0	10.0	2.1	2		16.06.2026			
9000	E51BL-1174		PL10X224		S355J2+N	1	326.0	224.0	10.0	5.5	6		16.06.2026			
9000	E51BP-1128		HEA260		S355J2	1	2900.0			197.7	198		16.06.2026			
9000	E51BP-1138		L100*10		S355J2	2	200.0			3.0	6		16.06.2026			
9000	E51B-1202	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2940.0	930.0	581.0	332.4	340	6.64	16.06.2026			
9000	E51BL-1153		PL20X930		S355J2+N	1	460.0	930.0	20.0	65.6	66		16.06.2026			
9000	E51BL-1155		PL20X250		S355J2+N	1	460.0	250.0	20.0	18.1	18		16.06.2026			
9000	E51BL-1156		PL15X239		S355J2+N	1	228.0	239.0	15.0	5.4	5		16.06.2026			
9000	E51BL-1172		PL10X121		S355J2+N	3	224.0	121.0	10.0	2.1	6		16.06.2026			
9000	E51BL-1173		PL16X374		S355J2+N	1	777.0	374.0	16.0	35.0	35		16.06.2026			
9000	E51BL-1174		PL10X224		S355J2+N	1	326.0	224.0	10.0	5.5	6		16.06.2026			
9000	E51BP-1128		HEA260		S355J2	1	2900.0			197.7	198		16.06.2026			
9000	E51BP-1138		L100*10		S355J2	2	200.0			3.0	6		16.06.2026			
9000	E51B-1203	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3997.0	372.0	190.0	176.3	177	4.76	16.06.2026			
9000	E51BL-1131		PL8X176		S355J2+N	1	186.0	176.0	8.0	2.1	2		16.06.2026			
9000	E51BL-1133		PL16X176		S355J2+N	1	276.0	176.0	16.0	4.8	5		16.06.2026			
9000	E51BL-1137		PL8X90		S355J2+N	2	169.0	90.0	8.0	0.9	2		16.06.2026			
9000	E51BP-1139		HEA200		S355J2	1	3989.0			168.6	169		16.06.2026			
9000	E51B-1204	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3997.0	372.0	190.0	176.3	177	4.76	16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BL-1131		PL8X176		S355J2+N	1	186.0	176.0	8.0	2.1	2		16.06.2026			
9000	E51BL-1133		PL16X176		S355J2+N	1	276.0	176.0	16.0	4.8	5		16.06.2026			
9000	E51BL-1137		PL8X90		S355J2+N	2	169.0	90.0	8.0	0.9	2		16.06.2026			
9000	E51BP-1140		HEA200		S355J2	1	3989.0			168.6	169		16.06.2026			
9000	E51B-1205	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3997.0	372.0	200.0	178.4	178	4.70	16.06.2026			
9000	E51BL-1131		PL8X176		S355J2+N	1	186.0	176.0	8.0	2.1	2		16.06.2026			
9000	E51BL-1132		PL15X180		S355J2+N	1	200.0	180.0	15.0	4.2	4		16.06.2026			
9000	E51BL-1133		PL16X176		S355J2+N	1	276.0	176.0	16.0	4.8	5		16.06.2026			
9000	E51BP-1141		HEA200		S355J2	1	3736.0			157.9	158		16.06.2026			
9000	E51BP-1143		WI200-6-10X200		S355J2	1	238.0			9.5	10		16.06.2026			
9000	E51B-1206	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3997.0	372.0	200.0	178.4	178	4.70	16.06.2026			
9000	E51BL-1131		PL8X176		S355J2+N	1	186.0	176.0	8.0	2.1	2		16.06.2026			
9000	E51BL-1132		PL15X180		S355J2+N	1	200.0	180.0	15.0	4.2	4		16.06.2026			
9000	E51BL-1133		PL16X176		S355J2+N	1	276.0	176.0	16.0	4.8	5		16.06.2026			
9000	E51BP-1141		HEA200		S355J2	1	3736.0			157.9	158		16.06.2026			
9000	E51BP-1144		WI200-6-10X200		S355J2	1	238.0			9.5	10		16.06.2026			
9000	E51B-1207	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3496.0	1450.0	1147.0	729.3	732	11.41	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1047		PL30X569		S355J2+N	1	1122.0	569.0	30.0	130.7	131		16.06.2026			
9000	E51BL-1120		PL15X144		S355J2+N	1	296.0	144.0	15.0	5.0	5		16.06.2026			
9000	E51BL-1120		PL15X145		S355J2+N	1	296.0	145.0	15.0	5.0	5		16.06.2026			
9000	E51BL-1136		PL20X310		S355J2+N	1	1000.0	310.0	20.0	48.7	49		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1157		PL10X92		S355J2+N	1	145.0	92.0	10.0	1.0	1		16.06.2026			
9000	E51BL-1157		PL10X93		S355J2+N	1	145.0	93.0	10.0	1.0	1		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	1	94.0	47.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	3	94.0	44.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	1	296.0	136.0	15.0	4.7	5		16.06.2026			
9000	E51BP-1011		HEA340		S355J2	1	3436.0			360.1	360		16.06.2026			
9000	E51BP-1146		HEA200		S355J2	1	1100.0			46.5	47		16.06.2026			
9000	E51BP-1164		IPE330		S355J2	1	485.0			23.8	24		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BP-1168		CFRHS100X50X5		S355J2H	1	685.0			7.2	7		16.06.2026			
9000	E51BP-1172		CFRHS100X50X5		S355J2H	2	245.0			2.6	5		16.06.2026			
9000	E51B-1208	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2654.0	965.0	550.0	557.2	568	9.00	16.06.2026			
9000	E51BL-1035		PL20X220		S355J2+N	1	435.0	220.0	20.0	15.0	15		16.06.2026			
9000	E51BL-1036		PL8X144		S355J2+N	1	296.0	144.0	8.0	2.7	3		16.06.2026			
9000	E51BL-1142		PL40X430		S355J2+N	1	550.0	430.0	40.0	74.3	74		16.06.2026			
9000	E51BL-1143		PL40X450		S355J2+N	1	550.0	450.0	40.0	77.7	78		16.06.2026			
9000	E51BL-1162		PL5X47		S355J2+N	6	94.0	47.0	5.0	0.2	1		16.06.2026			
9000	E51BL-1163		PL5X44		S355J2+N	2	94.0	44.0	5.0	0.2	0		16.06.2026			
9000	E51BL-1166		PL15X136		S355J2+N	3	296.0	136.0	15.0	4.7	14		16.06.2026			
9000	E51BL-1167		PL15X210		S355J2+N	1	395.0	210.0	15.0	9.8	10		16.06.2026			
9000	E51BL-1175		PL5X50		S355J2+N	3	65.0	50.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1038		HEA340		S355J2	1	2574.0			269.8	270		16.06.2026			
9000	E51BP-1164		IPE330		S355J2	1	485.0			23.8	24		16.06.2026			
9000	E51BP-1165		IPE330		S355J2	1	470.0			23.1	23		16.06.2026			
9000	E51BP-1166		CFRHS100X50X5		S355J2H	1	560.0			5.9	6		16.06.2026			
9000	E51BP-1167		CFRHS100X50X5		S355J2H	1	595.0			6.2	6		16.06.2026			
9000	E51BP-1169		HEA340		S355J2	1	315.0			33.0	33		16.06.2026			
9000	E51BP-1170		CFRHS100X50X5		S355J2H	1	610.0			6.4	6		16.06.2026			
9000	E51BP-1171		CFRHS100X50X5		S355J2H	1	415.0			4.4	4		16.06.2026			
9000	E51B-1209	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	8	3590.0	100.0	200.0	46.9	375	2.43	16.06.2026			
9000	E51BP-1124		CFJ100-200-50-5-5		S355J2	8	3590.0			46.9	375		16.06.2026			
9000	E51B-1210	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3425.0	100.0	200.0	44.8	45	2.32	16.06.2026			
9000	E51BP-1134		CFJ100-200-50-5-5		S355J2	1	3425.0			44.8	45		16.06.2026			
9000	E51B-1211	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3425.0	100.0	200.0	44.8	45	2.32	16.06.2026			
9000	E51BP-1136		CFJ100-200-50-5-5		S355J2	1	3425.0			44.8	45		16.06.2026			
9000	E51B-1212	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3881.0	100.0	200.0	50.7	51	2.63	16.06.2026			
9000	E51BP-1126		CFJ100-200-50-5-5		S355J2	1	3881.0			50.7	51		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51B-1213	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3881.0	100.0	200.0	50.7	51	2.63	16.06.2026			
9000	E51BP-1135		CFJ100-200-50-5-5		S355J2	1	3881.0			50.7	51		16.06.2026			
9000	E51B-1214	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3880.0	100.0	200.0	50.7	51	2.63	16.06.2026			
9000	E51BP-1132		CFJ100-200-50-5-5		S355J2	1	3880.0			50.7	51		16.06.2026			
9000	E51B-1215	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	4180.0	100.0	200.0	54.6	55	2.83	16.06.2026			
9000	E51BP-1125		CFJ100-200-50-5-5		S355J2	1	4180.0			54.6	55		16.06.2026			
9000	E51B-1216	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3425.0	100.0	200.0	44.8	45	2.32	16.06.2026			
9000	E51BP-1133		CFJ100-200-50-5-5		S355J2	1	3425.0			44.8	45		16.06.2026			
9000	E51B-1217	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	2960.0	100.0	200.0	38.7	39	2.01	16.06.2026			
9000	E51BP-1137		CFJ100-200-50-5-5		S355J2	1	2960.0			38.7	39		16.06.2026			
9000	E51B-1218	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3389.0	621.0	830.0	427.5	428	7.50	16.06.2026			
9000	E51BL-1003		PL12X180		S355J2+N	1	236.0	180.0	12.0	4.0	4		16.06.2026			
9000	E51BL-1004		PL8X125		S355J2+N	1	224.0	125.0	8.0	1.7	2		16.06.2026			
9000	E51BL-1055		PL12X200		S355J2+N	1	260.0	200.0	12.0	4.9	5		16.06.2026			
9000	E51BL-1121		PL15X126		S355J2+N	1	224.0	126.0	15.0	3.3	3		16.06.2026			
9000	E51BL-1138		PL40X230		S355J2+N	1	824.0	230.0	40.0	59.0	59		16.06.2026			
9000	E51BL-1147		PL30X528		S355J2+N	1	774.0	528.0	30.0	86.3	86		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026			
9000	E51BL-1168		PL15X270		S355J2+N	1	236.0	270.0	15.0	7.5	8		16.06.2026			
9000	E51BP-1018		HEA260		S355J2	1	3337.0			227.4	227		16.06.2026			
9000	E51BP-1180		CFRHS100X40X3		S355J2H	1	579.0			3.5	4		16.06.2026			
9000	E51BP-1181		T120		S235JR	1	349.0			8.1	8		16.06.2026			
9000	E51BP-1182		HEA260		S355J2	1	315.0			21.5	22		16.06.2026			
9000	E51B-1219	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	4	3310.0	759.0	300.0	248.0	1012	5.63	16.06.2026			
9000	E51BL-1055		PL12X200		S355J2+N	8	260.0	200.0	12.0	4.9	39		16.06.2026			
9000	E51BL-1121		PL15X126		S355J2+N	4	224.0	126.0	15.0	3.3	13		16.06.2026			
9000	E51BL-1127		PL10X276		S355J2+N	4	224.0	276.0	10.0	4.1	16		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	8	94.0	37.0	5.0	0.1	1		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BP-1010		HEA260		S355J2	4	3286.0			224.0	896		16.06.2026			
9000	E51BP-1180		CFRHS100X40X3		S355J2H	4	579.0			3.5	14		16.06.2026			
9000	E51BP-1181		T120		S235JR	4	349.0			8.1	32		16.06.2026			
9000	E51B-1220	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3439.0	754.0	865.0	417.4	418	7.26	16.06.2026			
9000	E51BL-1003		PL12X180		S355J2+N	1	236.0	180.0	12.0	4.0	4		16.06.2026			
9000	E51BL-1004		PL8X125		S355J2+N	1	224.0	125.0	8.0	1.7	2		16.06.2026			
9000	E51BL-1055		PL12X200		S355J2+N	1	260.0	200.0	12.0	4.9	5		16.06.2026			
9000	E51BL-1063		PL15X120		S355J2+N	1	223.0	120.0	15.0	3.0	3		16.06.2026			
9000	E51BL-1064		PL8X120		S355J2+N	1	223.0	120.0	8.0	1.6	2		16.06.2026			
9000	E51BL-1121		PL15X126		S355J2+N	1	224.0	126.0	15.0	3.3	3		16.06.2026			
9000	E51BL-1126		PL40X230		S355J2+N	1	821.0	230.0	40.0	58.9	59		16.06.2026			
9000	E51BL-1144		PL30X529		S355J2+N	1	818.0	529.0	30.0	91.8	92		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1017		HEA260		S355J2	1	3387.0			230.8	231		16.06.2026			
9000	E51BP-1050		T120		S235JR	1	355.0			8.2	8		16.06.2026			
9000	E51BP-1177		CFRHS100X40X3		S355J2H	1	585.0			3.6	4		16.06.2026			
9000	E51SBL-1056		PL12X254		S355J2+N	1	302.0	254.0	12.0	5.3	5		16.06.2026			
9000	E51B-1221	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	4	3310.0	765.0	300.0	248.2	1013	5.63	16.06.2026			
9000	E51BL-1055		PL12X200		S355J2+N	8	260.0	200.0	12.0	4.9	39		16.06.2026			
9000	E51BL-1121		PL15X126		S355J2+N	4	224.0	126.0	15.0	3.3	13		16.06.2026			
9000	E51BL-1127		PL10X276		S355J2+N	4	224.0	276.0	10.0	4.1	16		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	8	94.0	37.0	5.0	0.1	1		16.06.2026			
9000	E51BP-1010		HEA260		S355J2	4	3286.0			224.0	896		16.06.2026			
9000	E51BP-1050		T120		S235JR	4	355.0			8.2	33		16.06.2026			
9000	E51BP-1177		CFRHS100X40X3		S355J2H	4	585.0			3.6	14		16.06.2026			
9000	E51B-1222	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	3439.0	754.0	865.0	417.4	418	7.26	16.06.2026			
9000	E51BL-1003		PL12X180		S355J2+N	1	236.0	180.0	12.0	4.0	4		16.06.2026			
9000	E51BL-1004		PL8X125		S355J2+N	1	224.0	125.0	8.0	1.7	2		16.06.2026			
9000	E51BL-1055		PL12X200		S355J2+N	1	260.0	200.0	12.0	4.9	5		16.06.2026			
9000	E51BL-1063		PL15X120		S355J2+N	1	223.0	120.0	15.0	3.0	3		16.06.2026			
9000	E51BL-1064		PL8X120		S355J2+N	1	223.0	120.0	8.0	1.6	2		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BL-1121		PL15X126		S355J2+N	1	224.0	126.0	15.0	3.3	3		16.06.2026			
9000	E51BL-1126		PL40X230		S355J2+N	1	821.0	230.0	40.0	58.9	59		16.06.2026			
9000	E51BL-1144		PL30X529		S355J2+N	1	818.0	529.0	30.0	91.8	92		16.06.2026			
9000	E51BL-1160		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026			
9000	E51BP-1050		T120		S235JR	1	355.0			8.2	8		16.06.2026			
9000	E51BP-1150		HEA260		S355J2	1	3387.0			230.8	231		16.06.2026			
9000	E51BP-1177		CFRHS100X40X3		S355J2H	1	585.0			3.6	4		16.06.2026			
9000	E51SBL-1056		PL12X254		S355J2+N	1	302.0	254.0	12.0	5.3	5		16.06.2026			
9000	E51SB-1001	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8276.0	389.0	590.0	937.0	941	18.13	16.06.2026			
9000	E51SBL-1026		PL10X65		S355J2+N	2	220.0	65.0	10.0	1.1	2		16.06.2026			
9000	E51SBL-1053		PL20X210		S355J2+N	1	550.0	210.0	20.0	18.0	18		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	8	94.0	37.0	5.0	0.1	1		16.06.2026	1	29.06.2026	
9000	E51SBP-1001		IPE550		S355J2	1	8256.0			868.5	869		16.06.2026			
9000	E51SBP-1077		CFRHS100X40X3		S355J2H	1	2515.0			15.4	15		16.06.2026			
9000	E51SBP-1082		CFRHS100X40X3		S355J2H	2	280.0			1.7	3		16.06.2026			
9000	E51SBP-1083		CFRHS100X40X3		S355J2H	1	5232.0			32.1	32		16.06.2026			
9000	E51SB-1002	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	220.0	590.0	965.1	965	18.60	16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	1	530.0	220.0	15.0	13.7	14		16.06.2026			
9000	E51SBL-1048		PL15X220		S355J2+N	1	530.0	220.0	15.0	13.7	14		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBP-1009		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SBP-1076		CFRHS100X40X3		S355J2H	1	8384.0			51.4	51		16.06.2026			
9000	E51SB-1003	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	573.0	640.0	1107.7	1124	22.56	16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1036		PL15X304		S355J2+N	1	969.0	304.0	15.0	33.9	34		16.06.2026			
9000	E51SBL-1043		PL10X99		S355J2+N	2	215.0	99.0	10.0	1.7	3		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1021		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1076		CFRHS100X40X3		S355J2H	1	8384.0			51.4	51		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51SB-1004	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	573.0	640.0	1094.2	1112	22.36	16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1026		PL10X65		S355J2+N	2	220.0	65.0	10.0	1.1	2		16.06.2026			
9000	E51SBL-1051		PL15X534		S355J2+N	1	528.0	534.0	15.0	23.3	23		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	8	94.0	37.0	5.0	0.1	1		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1005		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1077		CFRHS100X40X3		S355J2H	1	2515.0			15.4	15		16.06.2026			
9000	E51SBP-1082		CFRHS100X40X3		S355J2H	2	280.0			1.7	3		16.06.2026			
9000	E51SBP-1084		CFRHS100X40X3		S355J2H	1	5217.0			32.0	32		16.06.2026			
9000	E51SB-1005	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	574.0	640.0	1100.7	1117	22.55	16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1037		PL12X305		S355J2+N	1	961.0	305.0	12.0	27.0	27		16.06.2026			
9000	E51SBL-1044		PL10X99		S355J2+N	2	220.0	99.0	10.0	1.7	3		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1076		CFRHS100X40X3		S355J2H	1	8384.0			51.4	51		16.06.2026			
9000	E51SBP-1088		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SB-1006	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	528.0	640.0	1087.7	1106	22.32	16.06.2026			
9000	E51BL-1148		PL12X471		S355J2+N	1	522.0	471.0	12.0	16.6	17		16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1026		PL10X65		S355J2+N	2	220.0	65.0	10.0	1.1	2		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	8	94.0	37.0	5.0	0.1	1		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1006		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1077		CFRHS100X40X3		S355J2H	1	2515.0			15.4	15		16.06.2026			
9000	E51SBP-1081		CFRHS100X40X3		S355J2H	1	5255.0			32.2	32		16.06.2026			
9000	E51SBP-1082		CFRHS100X40X3		S355J2H	2	280.0			1.7	3		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51SB-1007	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	482.0	640.0	1093.5	1109	22.39	16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1039		PL12X255		S355J2+N	1	841.0	255.0	12.0	19.7	20		16.06.2026			
9000	E51SBL-1044		PL10X99		S355J2+N	2	220.0	99.0	10.0	1.7	3		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1076		CFRHS100X40X3		S355J2H	1	8384.0			51.4	51		16.06.2026			
9000	E51SBP-1087		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SB-1008	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	482.0	640.0	1084.9	1103	22.25	16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1026		PL10X65		S355J2+N	2	220.0	65.0	10.0	1.1	2		16.06.2026			
9000	E51SBL-1052		PL12X457		S355J2+N	1	459.0	457.0	12.0	14.0	14		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	8	94.0	37.0	5.0	0.1	1		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1067		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1078		CFRHS100X40X3		S355J2H	1	2477.0			15.2	15		16.06.2026			
9000	E51SBP-1081		CFRHS100X40X3		S355J2H	1	5255.0			32.2	32		16.06.2026			
9000	E51SBP-1082		CFRHS100X40X3		S355J2H	2	280.0			1.7	3		16.06.2026			
9000	E51SB-1009	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	482.0	640.0	1093.5	1109	22.39	16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1039		PL12X255		S355J2+N	1	841.0	255.0	12.0	19.7	20		16.06.2026			
9000	E51SBL-1044		PL10X99		S355J2+N	2	220.0	99.0	10.0	1.7	3		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1076		CFRHS100X40X3		S355J2H	1	8384.0			51.4	51		16.06.2026			
9000	E51SBP-1087		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SB-1010	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	574.0	640.0	1100.7	1117	22.55	16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1037		PL12X305		S355J2+N	1	961.0	305.0	12.0	27.0	27		16.06.2026			
9000	E51SBL-1044		PL10X99		S355J2+N	2	220.0	99.0	10.0	1.7	3		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1076		CFRHS100X40X3		S355J2H	1	8384.0			51.4	51		16.06.2026			
9000	E51SBP-1088		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SB-1011	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	573.0	640.0	1107.7	1124	22.56	16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1036		PL15X304		S355J2+N	1	969.0	304.0	15.0	33.9	34		16.06.2026			
9000	E51SBL-1043		PL10X99		S355J2+N	2	215.0	99.0	10.0	1.7	3		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1021		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1076		CFRHS100X40X3		S355J2H	1	8384.0			51.4	51		16.06.2026			
9000	E51SB-1012	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	355.0	640.0	1080.5	1095	22.15	16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1023		PL10X120		S355J2+N	1	120.0	120.0	10.0	1.1	1		16.06.2026			
9000	E51SBL-1024		PL8X99		S355J2+N	1	107.0	99.0	8.0	0.7	1		16.06.2026			
9000	E51SBL-1025		PL10X120		S355J2+N	1	99.0	120.0	10.0	0.9	1		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	6	94.0	37.0	5.0	0.1	1		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1008		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SBP-1036		HEA140		S355J2	1	234.0			5.8	6		16.06.2026			
9000	E51SBP-1074		CFRHS100X40X3		S355J2H	1	2737.0			16.8	17		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1079		CFRHS100X40X3		S355J2H	1	5477.0			33.6	34		16.06.2026			
9000	E51SBP-1080		CFRHS100X40X3		S355J2H	1	150.0			0.9	1		16.06.2026			
9000	E51SB-1015	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8460.0	426.0	640.0	1077.8	1078	21.83	16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51SBL-1023		PL10X120		S355J2+N	1	120.0	120.0	10.0	1.1	1		16.06.2026			
9000	E51SBL-1024		PL8X99		S355J2+N	1	107.0	99.0	8.0	0.7	1		16.06.2026			
9000	E51SBL-1025		PL10X120		S355J2+N	1	99.0	120.0	10.0	0.9	1		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1002		IPE550		S355J2	1	8460.0			889.9	890		16.06.2026			
9000	E51SBP-1073		HEA200		S355J2	1	306.0			12.9	13		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1076		CFRHS100X40X3		S355J2H	1	8384.0			51.4	51		16.06.2026			
9000	E51SB-1021	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8070.0	260.0	415.0	553.8	556	12.15	16.06.2026			
9000	E51SBL-1021		PL10X120		S355J2+N	1	165.0	120.0	10.0	1.6	2		16.06.2026			
9000	E51SBL-1022		PL10X126		S355J2+N	2	224.0	126.0	10.0	2.2	4		16.06.2026			
9000	E51SBP-1020		HEA260		S355J2	1	8070.0			550.0	550		16.06.2026			
9000	E51SB-1022	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8432.0	476.0	290.0	646.8	648	15.29	16.06.2026			
9000	E51SBL-1034		PL12X250		S355J2+N	1	849.0	250.0	12.0	19.6	20		16.06.2026			
9000	E51SBL-1041		PL10X126		S355J2+N	2	93.0	126.0	10.0	0.9	2		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBP-1024		HEA260		S355J2	1	8432.0			574.7	575		16.06.2026			
9000	E51SBP-1032		CFRHS100X40X3		S355J2H	1	8402.0			51.5	52		16.06.2026			
9000	E51SB-1023	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8432.0	476.0	290.0	646.8	648	15.29	16.06.2026			
9000	E51SBL-1034		PL12X250		S355J2+N	1	849.0	250.0	12.0	19.6	20		16.06.2026			
9000	E51SBL-1041		PL10X126		S355J2+N	2	93.0	126.0	10.0	0.9	2		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBP-1024		HEA260		S355J2	1	8432.0			574.7	575		16.06.2026			
9000	E51SBP-1032		CFRHS100X40X3		S355J2H	1	8402.0			51.5	52		16.06.2026			
9000	E51SB-1024	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8432.0	476.0	290.0	646.8	648	15.29	16.06.2026			
9000	E51SBL-1034		PL12X250		S355J2+N	1	849.0	250.0	12.0	19.6	20		16.06.2026			
9000	E51SBL-1041		PL10X126		S355J2+N	2	93.0	126.0	10.0	0.9	2		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBP-1032		CFRHS100X40X3		S355J2H	1	8402.0			51.5	52		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51SBP-1069		HEA260		S355J2	1	8432.0			574.7	575		16.06.2026			
9000	E51SB-1025	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8432.0	476.0	290.0	646.8	648	15.29	16.06.2026			
9000	E51SBL-1034		PL12X250		S355J2+N	1	849.0	250.0	12.0	19.6	20		16.06.2026			
9000	E51SBL-1041		PL10X126		S355J2+N	2	93.0	126.0	10.0	0.9	2		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBP-1032		CFRHS100X40X3		S355J2H	1	8402.0			51.5	52		16.06.2026			
9000	E51SBP-1070		HEA260		S355J2	1	8432.0			574.7	575		16.06.2026			
9000	E51SB-1026	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	10013.0	521.0	1372.0	834.1	855	19.78	16.06.2026			
9000	E51SBL-1003		PL12X200		S355J2+N	3	260.0	200.0	12.0	4.9	15		16.06.2026			
9000	E51SBL-1004		PL8X125		S355J2+N	3	224.0	125.0	8.0	1.7	5		16.06.2026			
9000	E51SBL-1005		PL8X175		S355J2+N	1	224.0	175.0	8.0	2.4	2		16.06.2026			
9000	E51SBL-1006		PL12X200		S355J2+N	1	260.0	200.0	12.0	4.9	5		16.06.2026			
9000	E51SBL-1007		PL12X234		S355J2+N	1	414.0	234.0	12.0	6.4	6		16.06.2026			
9000	E51SBL-1010		PL12X200		S355J2+N	2	50.0	200.0	12.0	0.9	2		16.06.2026			
9000	E51SBL-1028		PL12X279		S355J2+N	1	507.0	279.0	12.0	10.0	10		16.06.2026			
9000	E51SBL-1050		PL15X220		S355J2+N	2	280.0	220.0	15.0	7.3	15		16.06.2026			
9000	E51SBP-1014		HEA260		S355J2	1	9697.0			660.9	661		16.06.2026			
9000	E51SBP-1071		T140-15-15-150		S355J2+N	1	945.0			31.0	31		16.06.2026			
9000	E51SBP-1072		T140-15-15-150		S355J2+N	1	1354.0			44.4	44		16.06.2026			
9000	E51SBP-1086		CFRHS100X40X3		S355J2H	1	9686.0			59.4	59		16.06.2026	1	29.06.2026	
9000	E51SB-1027	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	10013.0	560.0	1372.0	827.8	885	20.56	16.06.2026	1	29.06.2026	
9000	E51SBL-1002		PL12X234		S355J2+N	2	410.0	234.0	12.0	6.4	13		16.06.2026			
9000	E51SBL-1003		PL12X200		S355J2+N	4	260.0	200.0	12.0	4.9	20		16.06.2026			
9000	E51SBL-1004		PL8X125		S355J2+N	4	224.0	125.0	8.0	1.7	7		16.06.2026			
9000	E51SBL-1050		PL15X220		S355J2+N	2	280.0	220.0	15.0	7.3	15		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBL-1059		PL5X34		S355J2+N	4	54.0	34.0	5.0	0.1	0		29.06.2026			
9000	E51SBL-1060		PL12X150		S355J2+N	2	539.0	150.0	12.0	7.5	15		29.06.2026			
9000	E51SBL-1061		PL10X224		S355J2+N	4	265.0	224.0	10.0	4.2	17		29.06.2026			
9000	E51SBP-1016		HEA260		S355J2	1	9697.0			660.9	661		16.06.2026	1	29.06.2026	
9000	E51SBP-1071		T140-15-15-150		S355J2+N	1	945.0			31.0	31		16.06.2026			




Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date		Drw. incl.	Note!
9000	E51SBP-1072		T140-15-15-150		S355J2+N	1	1354.0			44.4	44		16.06.2026				
9000	E51SBP-1090		CFRHS100X40X3		S355J2H	1	5231.0			32.1	32		29.06.2026				
9000	E51SBP-1092		CFRHS100X40X3		S355J2H	1	3946.0			24.2	24		29.06.2026				
9000	E51SBP-1093		CFRHS60X40X5		S355J2H	2	569.0			3.1	6		29.06.2026				
9000	E51SB-1028	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	10013.0	521.0	1372.0	834.1	856	19.78	16.06.2026				
9000	E51SBL-1002		PL12X234		S355J2+N	1	410.0	234.0	12.0	6.4	6		16.06.2026				
9000	E51SBL-1003		PL12X200		S355J2+N	3	260.0	200.0	12.0	4.9	15		16.06.2026				
9000	E51SBL-1004		PL8X125		S355J2+N	3	224.0	125.0	8.0	1.7	5		16.06.2026				
9000	E51SBL-1005		PL8X175		S355J2+N	1	224.0	175.0	8.0	2.4	2		16.06.2026				
9000	E51SBL-1006		PL12X200		S355J2+N	1	260.0	200.0	12.0	4.9	5		16.06.2026				
9000	E51SBL-1010		PL12X200		S355J2+N	2	50.0	200.0	12.0	0.9	2		16.06.2026				
9000	E51SBL-1030		PL12X279		S355J2+N	1	504.0	279.0	12.0	10.0	10		16.06.2026				
9000	E51SBL-1050		PL15X220		S355J2+N	2	280.0	220.0	15.0	7.3	15		16.06.2026				
9000	E51SBP-1014		HEA260		S355J2	1	9697.0			660.9	661		16.06.2026				
9000	E51SBP-1071		T140-15-15-150		S355J2+N	1	945.0			31.0	31		16.06.2026				
9000	E51SBP-1072		T140-15-15-150		S355J2+N	1	1354.0			44.4	44		16.06.2026				
9000	E51SBP-1086		CFRHS100X40X3		S355J2H	1	9686.0			59.4	59		16.06.2026	1	29.06.2026		
9000	E51SB-1029	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8419.0	560.0	350.0	895.7	924	18.25	16.06.2026	1	29.06.2026		
9000	E51SBL-1001		PL12X180		S355J2+N	1	292.0	180.0	12.0	5.0	5		16.06.2026				
9000	E51SBL-1047		PL15X180		S355J2+N	1	292.0	180.0	15.0	6.2	6		16.06.2026				
9000	E51SBL-1054		PL5X37		S355J2+N	4	94.0	37.0	5.0	0.1	1		16.06.2026	1	29.06.2026		
9000	E51SBL-1057		PL15X130		S355J2+N	2	539.0	130.0	15.0	8.1	16		29.06.2026				
9000	E51SBL-1058		PL10X265		S355J2+N	4	278.0	265.0	10.0	5.4	21		29.06.2026				
9000	E51SBL-1059		PL5X34		S355J2+N	4	54.0	34.0	5.0	0.1	0		29.06.2026				
9000	E51SBP-1018		HEA320		S355J2	1	8392.0			819.5	820		16.06.2026	1	29.06.2026		
9000	E51SBP-1089		CFRHS100X40X3		S355J2H	1	4565.0			28.0	28		29.06.2026				
9000	E51SBP-1091		CFRHS100X40X3		S355J2H	1	3294.0			20.2	20		29.06.2026				
9000	E51SBP-1093		CFRHS60X40X5		S355J2H	2	569.0			3.1	6		29.06.2026				
9000	E51SB-1030	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8422.0	567.0	350.0	906.7	914	17.99	16.06.2026				
9000	E51SBL-1001		PL12X180		S355J2+N	2	292.0	180.0	12.0	5.0	10		16.06.2026				
9000	E51SBL-1033		PL12X298		S355J2+N	1	1034.0	298.0	12.0	28.5	29		16.06.2026				

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51SBL-1040		PL10X146		S355J2+N	2	150.0	146.0	10.0	1.7	3		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBP-1022		HEA320		S355J2	1	8398.0			820.1	820		16.06.2026			
9000	E51SBP-1029		CFRHS100X40X3		S355J2H	1	8368.0			51.3	51		16.06.2026	1	29.06.2026	
9000	E51SB-1031	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8422.0	567.0	350.0	906.7	914	17.99	16.06.2026			
9000	E51SBL-1001		PL12X180		S355J2+N	2	292.0	180.0	12.0	5.0	10		16.06.2026			
9000	E51SBL-1033		PL12X298		S355J2+N	1	1034.0	298.0	12.0	28.5	29		16.06.2026			
9000	E51SBL-1040		PL10X146		S355J2+N	2	150.0	146.0	10.0	1.7	3		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBP-1022		HEA320		S355J2	1	8398.0			820.1	820		16.06.2026			
9000	E51SBP-1029		CFRHS100X40X3		S355J2H	1	8368.0			51.3	51		16.06.2026	1	29.06.2026	
9000	E51SB-1032	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8422.0	560.0	350.0	890.1	923	18.26	16.06.2026	1	29.06.2026	
9000	E51SBL-1001		PL12X180		S355J2+N	2	292.0	180.0	12.0	5.0	10		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	4	94.0	37.0	5.0	0.1	1		16.06.2026	1	29.06.2026	
9000	E51SBL-1057		PL15X130		S355J2+N	2	539.0	130.0	15.0	8.1	16		29.06.2026			
9000	E51SBL-1058		PL10X265		S355J2+N	4	278.0	265.0	10.0	5.4	21		29.06.2026			
9000	E51SBL-1059		PL5X34		S355J2+N	4	54.0	34.0	5.0	0.1	0		29.06.2026			
9000	E51SBP-1017		HEA320		S355J2	1	8398.0			820.1	820		16.06.2026	1	29.06.2026	
9000	E51SBP-1089		CFRHS100X40X3		S355J2H	1	4565.0			28.0	28		29.06.2026			
9000	E51SBP-1091		CFRHS100X40X3		S355J2H	1	3294.0			20.2	20		29.06.2026			
9000	E51SBP-1093		CFRHS60X40X5		S355J2H	2	569.0			3.1	6		29.06.2026			
9000	E51SB-1033	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	10345.0	402.0	1027.0	1111.2	1132	22.28	16.06.2026			
9000	E51SBL-1008		PL12X200		S355J2+N	2	296.0	200.0	12.0	5.6	11		16.06.2026			
9000	E51SBL-1009		PL8X145		S355J2+N	4	278.0	145.0	8.0	2.5	10		16.06.2026			
9000	E51SBL-1012		PL10X233		S355J2+N	1	296.0	233.0	10.0	5.4	5		16.06.2026			
9000	E51SBL-1014		PL8X90		S355J2+N	1	104.0	90.0	8.0	0.5	1		16.06.2026			
9000	E51SBL-1015		PL8X90		S355J2+N	1	120.0	90.0	8.0	0.6	1		16.06.2026			
9000	E51SBL-1049		PL15X230		S355J2+N	2	290.0	230.0	15.0	7.9	16		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	2	94.0	37.0	5.0	0.1	0		16.06.2026	1	29.06.2026	
9000	E51SBP-1003		HEA320		S355J2	1	10159.0			992.1	992		16.06.2026			
9000	E51SBP-1027		L150*15		S355J2	1	1020.0			34.4	34		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51SBP-1030		CFRHS100X40X3		S355J2H	1	10129.0			62.1	62		16.06.2026			
9000	E51SB-1034	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	10037.0	312.0	1448.0	1107.1	1130	22.11	16.06.2026			
9000	E51SBL-1008		PL12X200		S355J2+N	2	296.0	200.0	12.0	5.6	11		16.06.2026			
9000	E51SBL-1009		PL8X145		S355J2+N	4	278.0	145.0	8.0	2.5	10		16.06.2026			
9000	E51SBL-1013		PL10X96		S355J2+N	2	296.0	96.0	10.0	2.2	4		16.06.2026			
9000	E51SBL-1049		PL15X230		S355J2+N	2	290.0	230.0	15.0	7.9	16		16.06.2026			
9000	E51SBP-1004		HEA320		S355J2	1	9700.0			947.3	947		16.06.2026			
9000	E51SBP-1027		L150*15		S355J2	1	1020.0			34.4	34		16.06.2026			
9000	E51SBP-1028		L150*15		S355J2	1	1420.0			47.9	48		16.06.2026			
9000	E51SBP-1086		CFRHS100X40X3		S355J2H	1	9686.0			59.4	59		16.06.2026	1	29.06.2026	
9000	E51SB-1035	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	10013.0	476.0	1372.0	822.3	849	19.63	16.06.2026			
9000	E51SBL-1002		PL12X234		S355J2+N	1	410.0	234.0	12.0	6.4	6		16.06.2026			
9000	E51SBL-1003		PL12X200		S355J2+N	4	260.0	200.0	12.0	4.9	20		16.06.2026			
9000	E51SBL-1004		PL8X125		S355J2+N	4	224.0	125.0	8.0	1.7	7		16.06.2026			
9000	E51SBL-1029		PL12X234		S355J2+N	1	410.0	234.0	12.0	6.4	6		16.06.2026			
9000	E51SBL-1050		PL15X220		S355J2+N	2	280.0	220.0	15.0	7.3	15		16.06.2026			
9000	E51SBP-1015		HEA260		S355J2	1	9697.0			660.9	661		16.06.2026			
9000	E51SBP-1071		T140-15-15-150		S355J2+N	1	945.0			31.0	31		16.06.2026			
9000	E51SBP-1072		T140-15-15-150		S355J2+N	1	1354.0			44.4	44		16.06.2026			
9000	E51SBP-1086		CFRHS100X40X3		S355J2H	1	9686.0			59.4	59		16.06.2026	1	29.06.2026	
9000	E51SB-1036	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	10013.0	476.0	1372.0	815.9	849	19.63	16.06.2026			
9000	E51SBL-1002		PL12X234		S355J2+N	2	410.0	234.0	12.0	6.4	13		16.06.2026			
9000	E51SBL-1003		PL12X200		S355J2+N	4	260.0	200.0	12.0	4.9	20		16.06.2026			
9000	E51SBL-1004		PL8X125		S355J2+N	4	224.0	125.0	8.0	1.7	7		16.06.2026			
9000	E51SBL-1050		PL15X220		S355J2+N	2	280.0	220.0	15.0	7.3	15		16.06.2026			
9000	E51SBP-1015		HEA260		S355J2	1	9697.0			660.9	661		16.06.2026			
9000	E51SBP-1071		T140-15-15-150		S355J2+N	1	945.0			31.0	31		16.06.2026			
9000	E51SBP-1072		T140-15-15-150		S355J2+N	1	1354.0			44.4	44		16.06.2026			
9000	E51SBP-1086		CFRHS100X40X3		S355J2H	1	9686.0			59.4	59		16.06.2026	1	29.06.2026	
9000	E51SB-1067	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	528.0	640.0	1087.7	1106	22.32	16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date	Drw. incl.	Note!
9000	E51BL-1148		PL12X471		S355J2+N	1	522.0	471.0	12.0	16.6	17		16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1026		PL10X65		S355J2+N	2	220.0	65.0	10.0	1.1	2		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	8	94.0	37.0	5.0	0.1	1		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1006		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1077		CFRHS100X40X3		S355J2H	1	2515.0			15.4	15		16.06.2026			
9000	E51SBP-1081		CFRHS100X40X3		S355J2H	1	5255.0			32.2	32		16.06.2026			
9000	E51SBP-1082		CFRHS100X40X3		S355J2H	2	280.0			1.7	3		16.06.2026			
9000	E51SB-1068	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8454.0	573.0	640.0	1094.5	1112	22.37	16.06.2026			
9000	E51SBL-1019		PL15X220		S355J2+N	2	530.0	220.0	15.0	13.7	28		16.06.2026			
9000	E51SBL-1026		PL10X65		S355J2+N	2	220.0	65.0	10.0	1.1	2		16.06.2026			
9000	E51SBL-1051		PL15X534		S355J2+N	1	528.0	534.0	15.0	23.3	23		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	8	94.0	37.0	5.0	0.1	1		16.06.2026	1	29.06.2026	
9000	E51SBL-1055		PL5X47		S355J2+N	2	144.0	47.0	5.0	0.3	1		16.06.2026			
9000	E51SBP-1005		IPE550		S355J2	1	8424.0			886.1	886		16.06.2026			
9000	E51SBP-1075		CFRHS150X50X5		S355J2H	1	8384.0			120.4	120		16.06.2026			
9000	E51SBP-1077		CFRHS100X40X3		S355J2H	1	2515.0			15.4	15		16.06.2026			
9000	E51SBP-1081		CFRHS100X40X3		S355J2H	1	5255.0			32.2	32		16.06.2026			
9000	E51SBP-1082		CFRHS100X40X3		S355J2H	2	280.0			1.7	3		16.06.2026			
9000	E51SB-1069	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	1623.0	160.0	173.0	41.7	45	1.51	16.06.2026			
9000	E51SBL-1023		PL10X120		S355J2+N	2	121.0	120.0	10.0	1.1	2		16.06.2026			
9000	E51SBL-1054		PL5X37		S355J2+N	6	94.0	37.0	5.0	0.1	1		16.06.2026	1	29.06.2026	
9000	E51SBP-1035		HEA140		S355J2	1	1603.0			39.5	40		16.06.2026			
9000	E51SBP-1080		CFRHS100X40X3		S355J2H	3	150.0			0.9	3		16.06.2026			
9000	E51SB-1070	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8070.0	260.0	415.0	553.8	556	12.15	16.06.2026			
9000	E51SBL-1021		PL10X120		S355J2+N	1	165.0	120.0	10.0	1.6	2		16.06.2026			
9000	E51SBL-1022		PL10X126		S355J2+N	2	224.0	126.0	10.0	2.2	4		16.06.2026			
9000	E51SBP-1019		HEA260		S355J2	1	8070.0			550.0	550		16.06.2026			

Phase	Position	Main part name	Main part profile	Exec. class	Shade (assembly) / Material (part)	Pcs.	Length [mm]	Width [mm]	Height [mm]	Paino [kg]	Weight sum [kg]	Area [m²]	Date	Revision, date		Drw. incl.	Note!
9000	E51SB-1071	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8070.0	260.0	415.0	553.8	556	12.15	16.06.2026				
9000	E51SBL-1021		PL10X120		S355J2+N	1	165.0	120.0	10.0	1.6	2		16.06.2026				
9000	E51SBL-1022		PL10X126		S355J2+N	2	224.0	126.0	10.0	2.2	4		16.06.2026				
9000	E51SBP-1013		HEA260		S355J2	1	8070.0			550.0	550		16.06.2026				
9000	E51SB-1072	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8070.0	260.0	415.0	551.6	552	12.02	16.06.2026				
9000	E51SBL-1021		PL10X120		S355J2+N	1	165.0	120.0	10.0	1.6	2		16.06.2026				
9000	E51SBP-1068		HEA260		S355J2	1	8070.0			550.0	550		16.06.2026				
9000	E51SB-1073	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8070.0	260.0	415.0	551.6	552	12.02	16.06.2026				
9000	E51SBL-1021		PL10X120		S355J2+N	1	165.0	120.0	10.0	1.6	2		16.06.2026				
9000	E51SBP-1012		HEA260		S355J2	1	8070.0			550.0	550		16.06.2026				
9000	E51SB-1074	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8070.0	260.0	415.0	551.6	552	12.02	16.06.2026				
9000	E51SBL-1021		PL10X120		S355J2+N	1	165.0	120.0	10.0	1.6	2		16.06.2026				
9000	E51SBP-1011		HEA260		S355J2	1	8070.0			550.0	550		16.06.2026				
9000	E51SB-1075	Beam		EXC2	RAL 7024 (Graphite Gray) / ISO	1	8070.0	260.0	415.0	553.8	556	12.15	16.06.2026				
9000	E51SBL-1021		PL10X120		S355J2+N	1	165.0	120.0	10.0	1.6	2		16.06.2026				
9000	E51SBL-1022		PL10X126		S355J2+N	2	224.0	126.0	10.0	2.2	4		16.06.2026				
9000	E51SBP-1010		HEA260		S355J2	1	8070.0			550.0	550		16.06.2026				

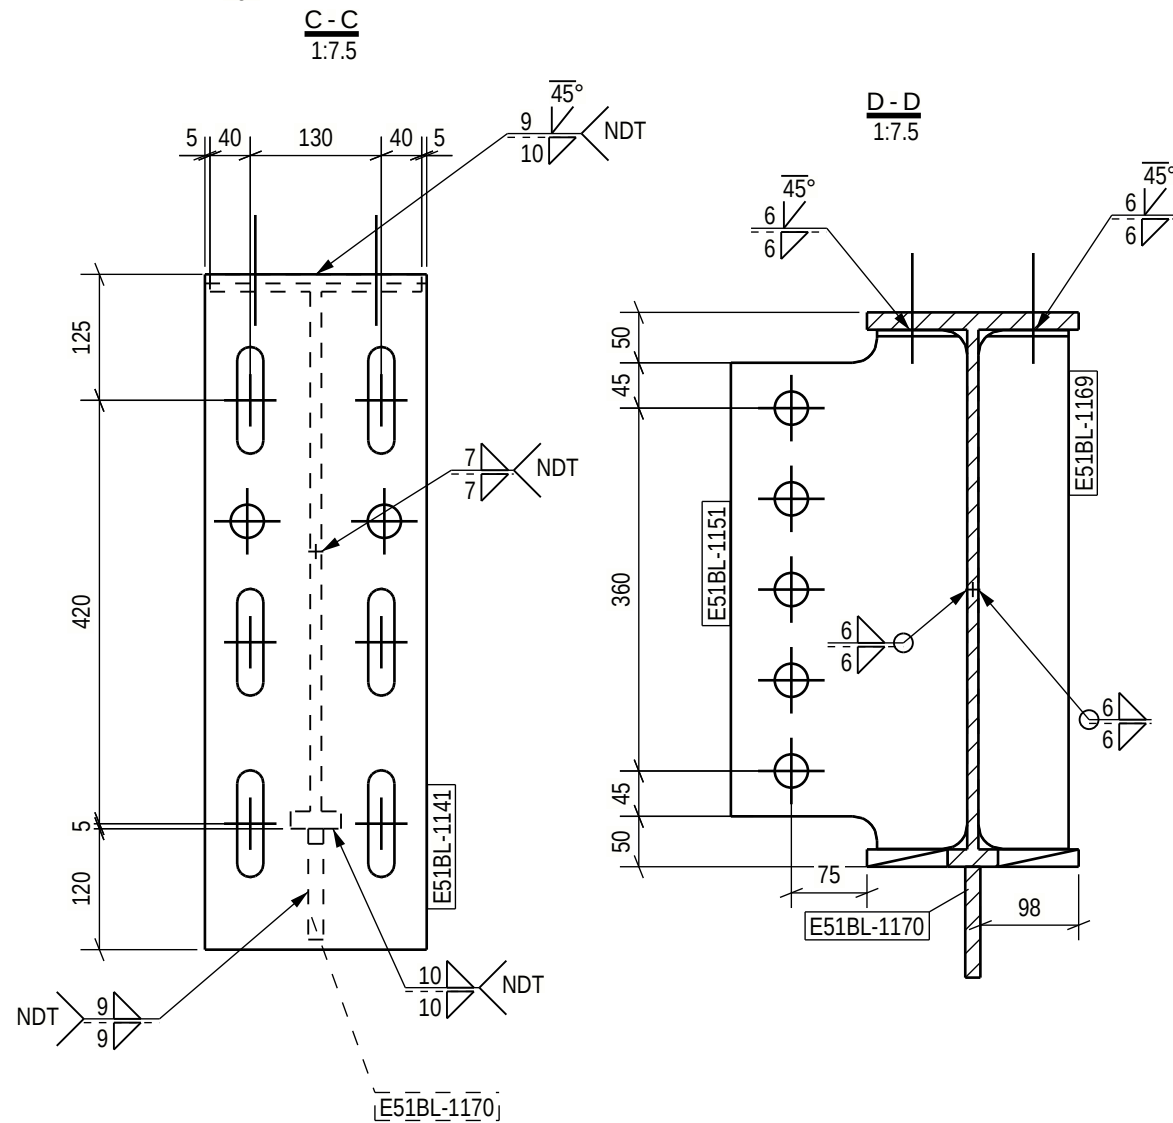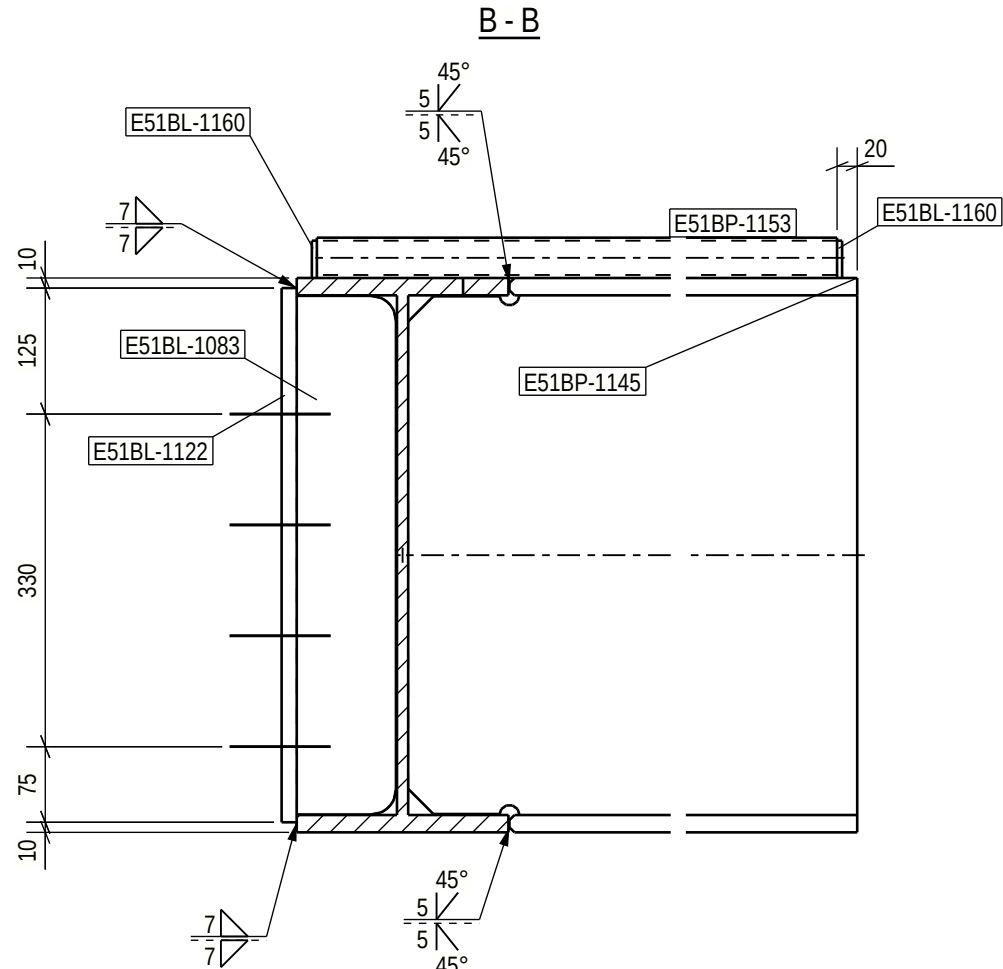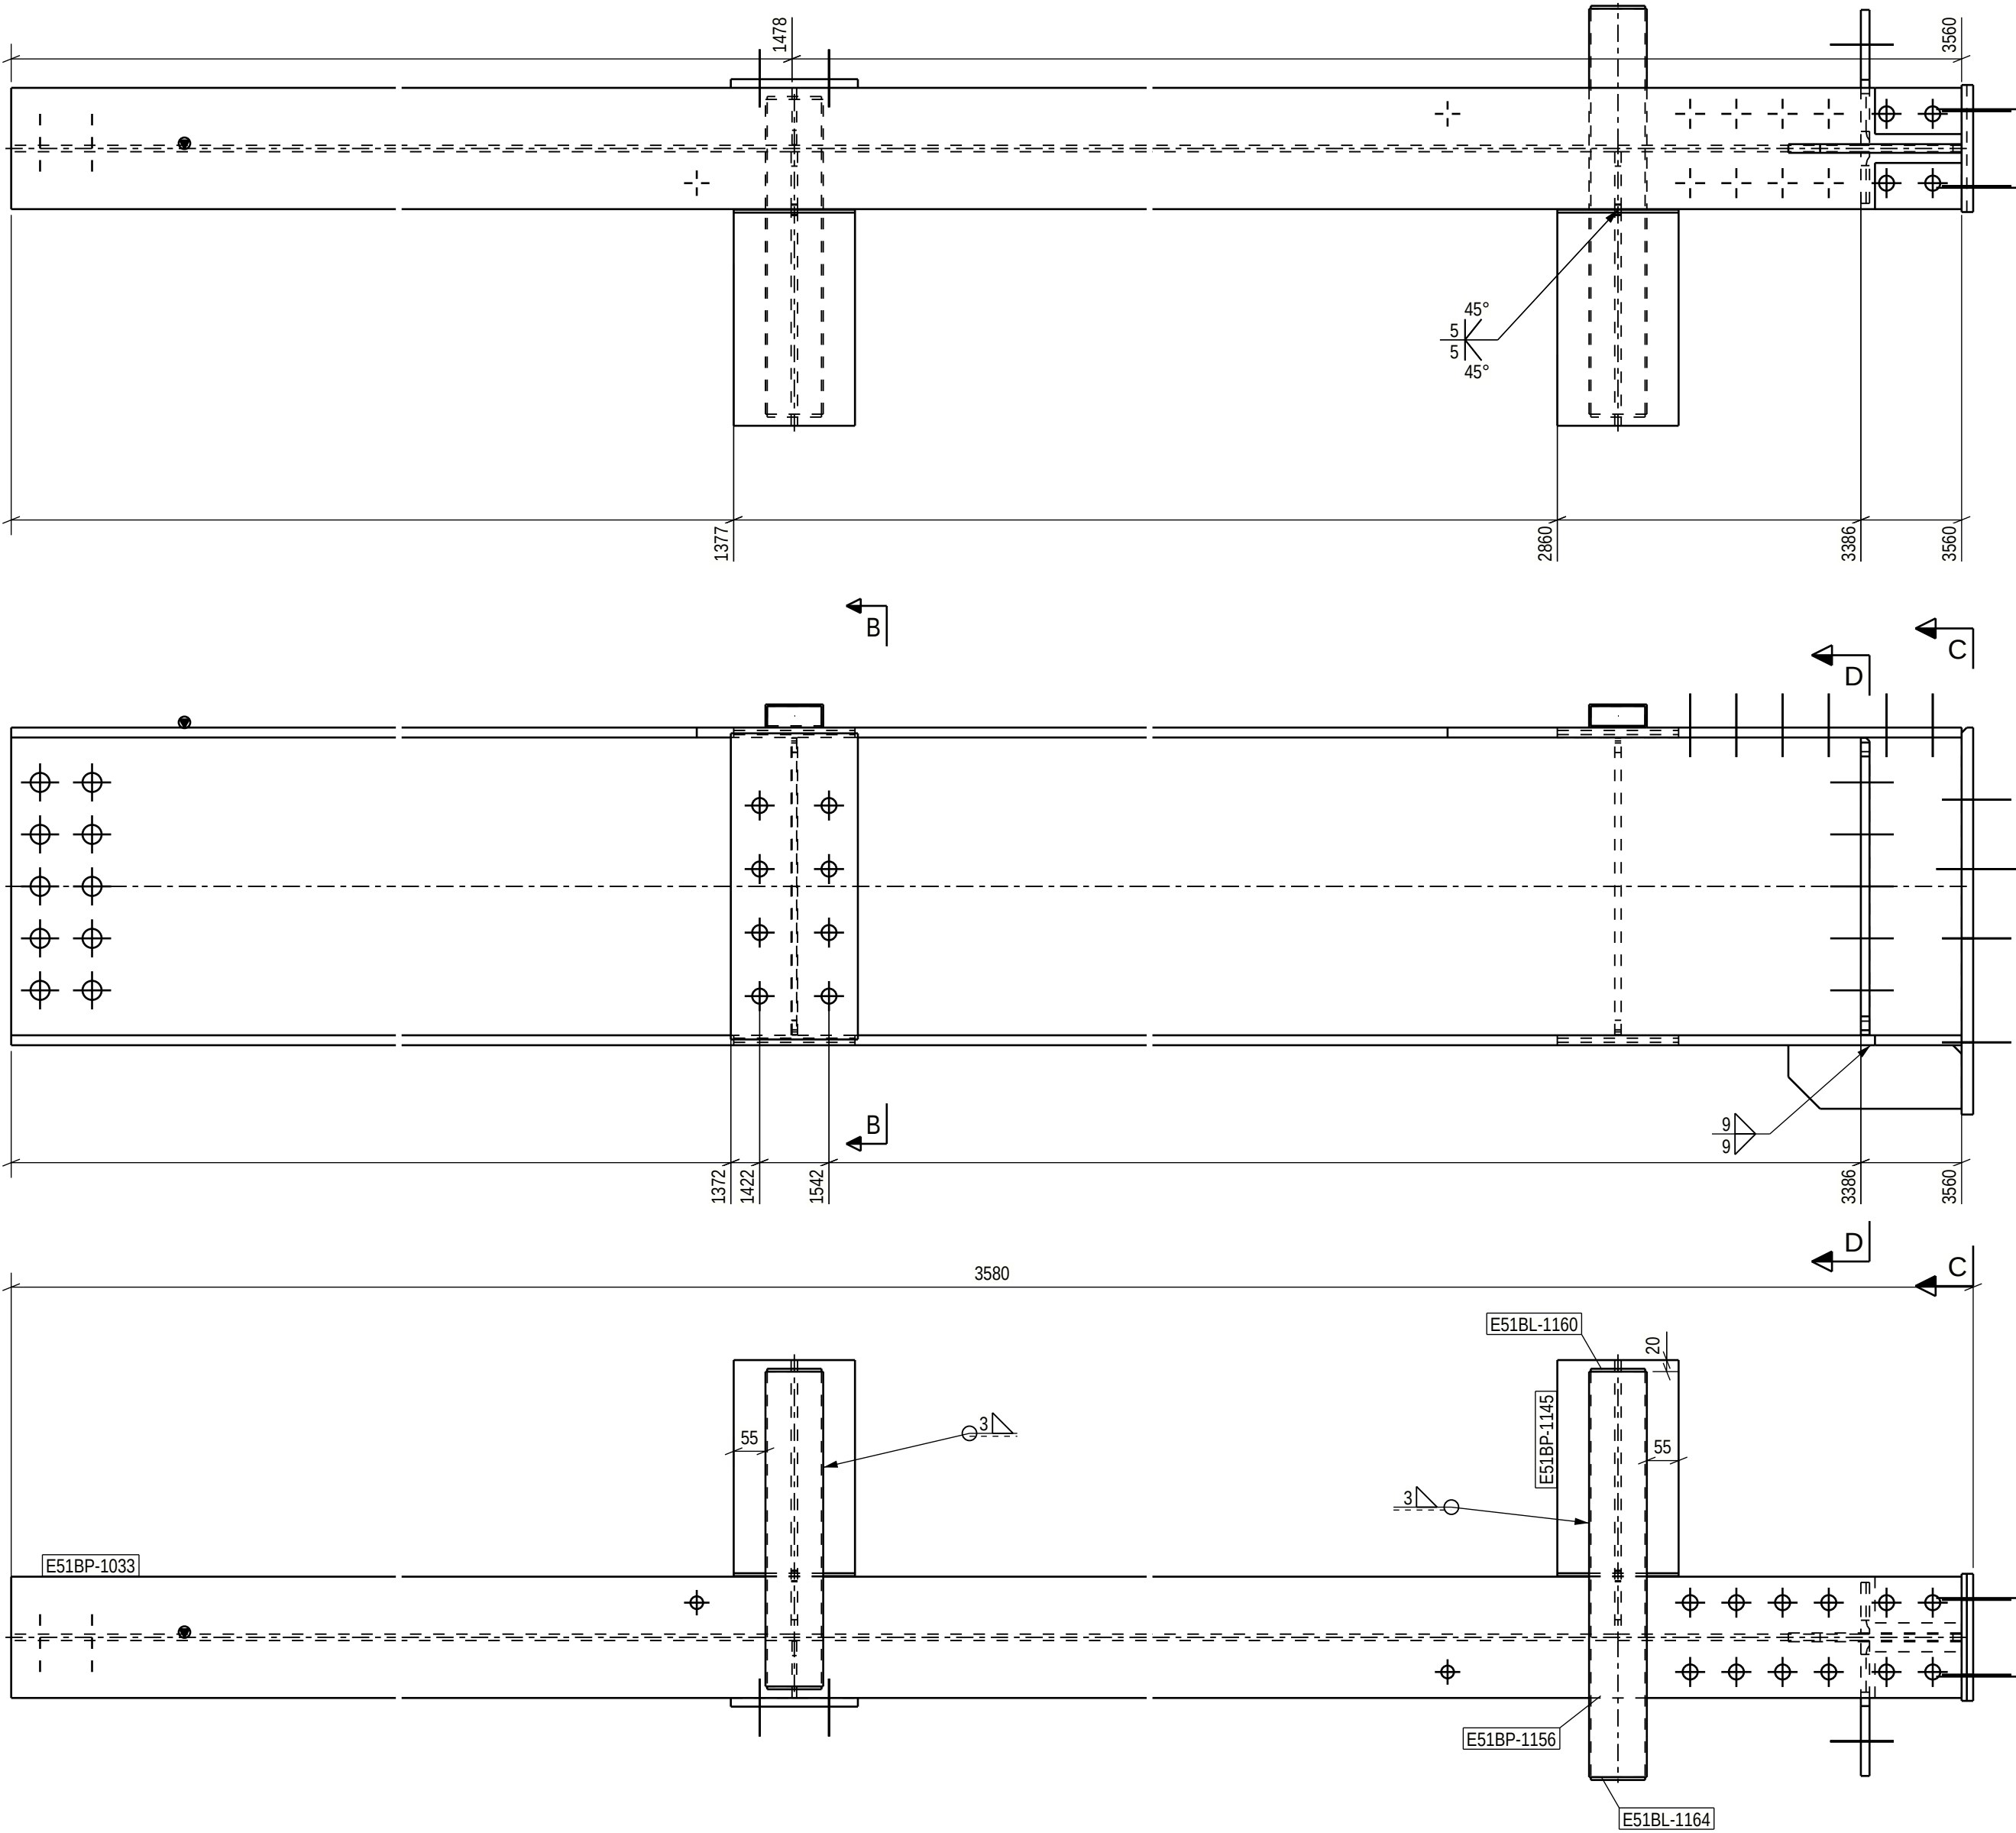


PART LIST FOR ASSEMBLY E51B-1004, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1083	PL8X98	S355J2+N	515	0.11	3.2	1
E51BL-1122	PL15X220	S355J2+N	530	0.26	13.7	1
E51BL-1141	PL20X220	S355J2+N	670	0.33	23.1	1
E51BL-1151	PL15X234	S355J2	515	0.24	13.1	1
E51BL-1160	PL5X37	S355J2+N	94	0.02	0.1	3
E51BL-1164	PL5X34	S355J2+N	94	0.01	0.1	1
E51BL-1169	PL15X89	S355J2	515	0.11	5.4	1
E51BL-1170	PL15X110	S355J2+N	300	0.07	3.7	1
E51BP-1033	IPE550	S355J2	3560	6.68	374.5	1
E51BP-1145	IPE550	S355J2	474	1.78	49.9	2
E51BP-1153	CFRHS100X40X3	S355J2H	545	0.15	3.3	1
E51BP-1156	CFRHS100X40X3	S355J2H	702	0.19	4.3	1
TOTAL:				9.96	544.6	

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005		Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg.
Surface preparation grade ISO8501-3, grade P2		Weld inspection, requirements EN 1090-2, Table 24, U>0.5
Surface treatment ISO12944-5		Extent of NDT, fillet welds MT-EN1290, 20% of welds
Additional requirements on surface treatment C3.07, EPPUR 240/2		Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds
Shade RAL 7024 (Graphite Gray)		Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds
Welding of built up steel section Appendix 1 / Project spec.		Requirements on holing EN1090-2 Section 6.6.3
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Weld class C, EN ISO 5817
		Additional material inspection Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1004

SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi


DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Kivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443			

E51B-1004



PART LIST FOR ASSEMBLY E51B-1010, MANUFACTURING AMOUNT 1 PIECES

PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m²]	WEIGHT [kg]	PCS
E51BL-1083	PL80X6	S355J2+N	515	1.77	3.2	16
E51BL-1122	PL15X220	S355J2+N	530	2.81	13.7	11
E51BL-1135	PL10X92	S355J2+N	515	0.21	3.7	2
E51BL-1160	PL5X37	S355J2+N	94	0.18	0.1	22
E51BL-1164	PL5X34	S355J2+N	94	0.08	0.1	10
E51BL-1165	PL5X47	S355J2+N	144	0.49	0.3	32
E51BP-1101	IP6550	S355J2	20740	38.93	2164.6	1
E51BP-1145	IP6550	S355J2	474	5.34	49.9	6
E51BP-1147	IP6550	S355J2	479	9.00	50.4	10
E51BP-1153	CFRHS100X40X3	S355J2H	545	0.88	3.3	6
E51BP-1154	CFRHS150X50X5	S355J2H	545	1.25	7.8	6
E51BP-1158	CFRHS150X50X5	S355J2H	550	2.11	7.9	10
E51BP-1159	CFRHS100X40X3	S355J2H	745	0.80	4.6	4
E51BP-1160	CFRHS100X40X3	S355J2H	707	1.15	4.3	6
TOTAL:			65.01		3397.5	

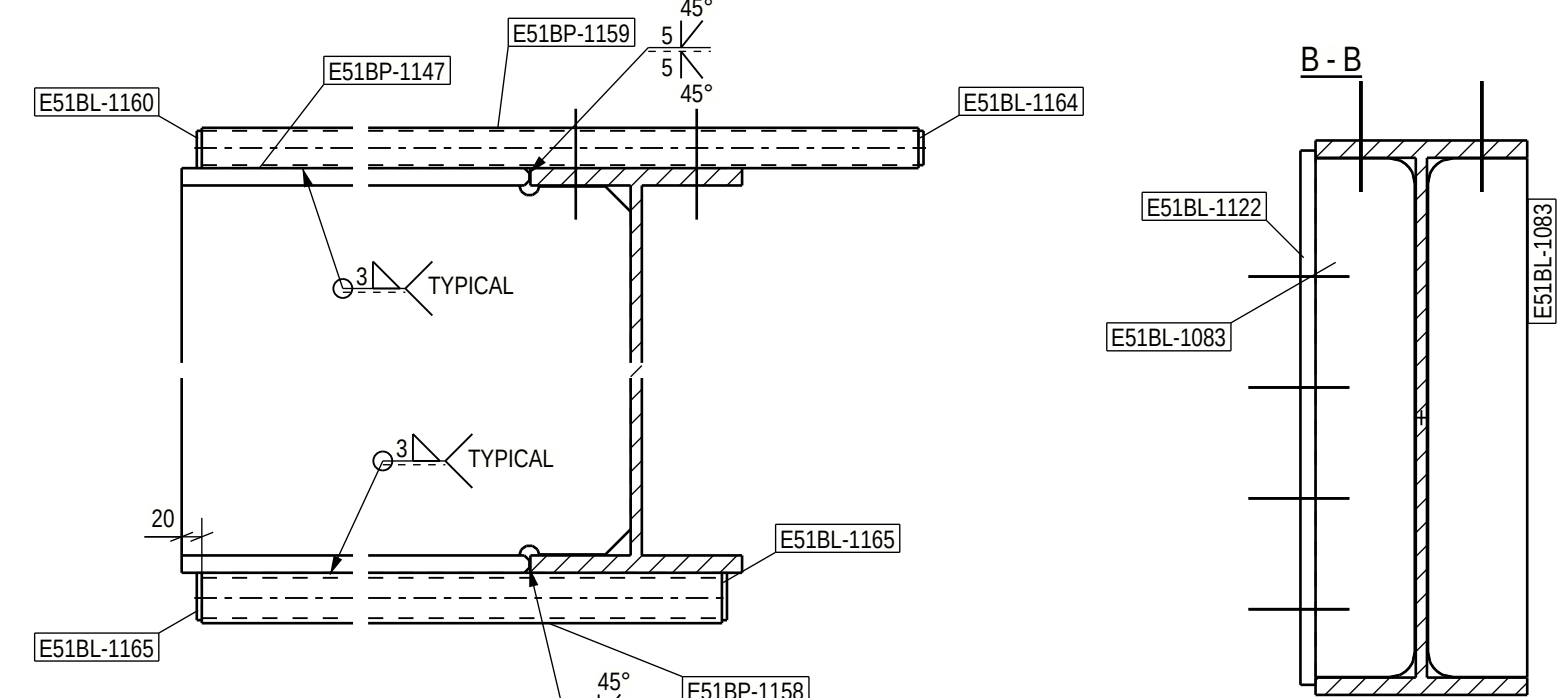

Technical fabrication requirements:

EN1090-2, table A3 - EXC2	EN1090-2, table A3 - EXC2
25019443-ICC250-0600-0600-000005	Project specification/ shown on drwg.
ISO8801-3, grade P2	EN1090-2, Table 24, U=0.5
ISO12944-5	MT-EN1290, 20% of welds
EN1090-2, table A3 - EXC2	UT-EN1090-2, 20% of welds
EN1090-2, table A3 - EXC2	UT-EN1090-2, 20% of welds
EN1090-2, table A3 - EXC2	EN1090-2, Section 6.6.3
EN1090-2, table A3 - EXC2	C, EN ISO 9817

For special tolerances of bolt hole location see specification for steel structures
Approved For Construction





PROJECT NAME: Easpring New Materials Oy
FAIR Phase 1

DESIGNED: ASSEMBLY DRAWING
Beam E51B-1010

DATE: 18.06.2026
DESIGNER: Alexey Seregin
CHECKED: Alexey Seregin
APPROVED: Alexey Seregin

SWECO RAKENNETEKNIIKA OY
00540 HELSINKI
Puh: +358 201 282 000
www.sweco.fi

25019443_FAI_E501

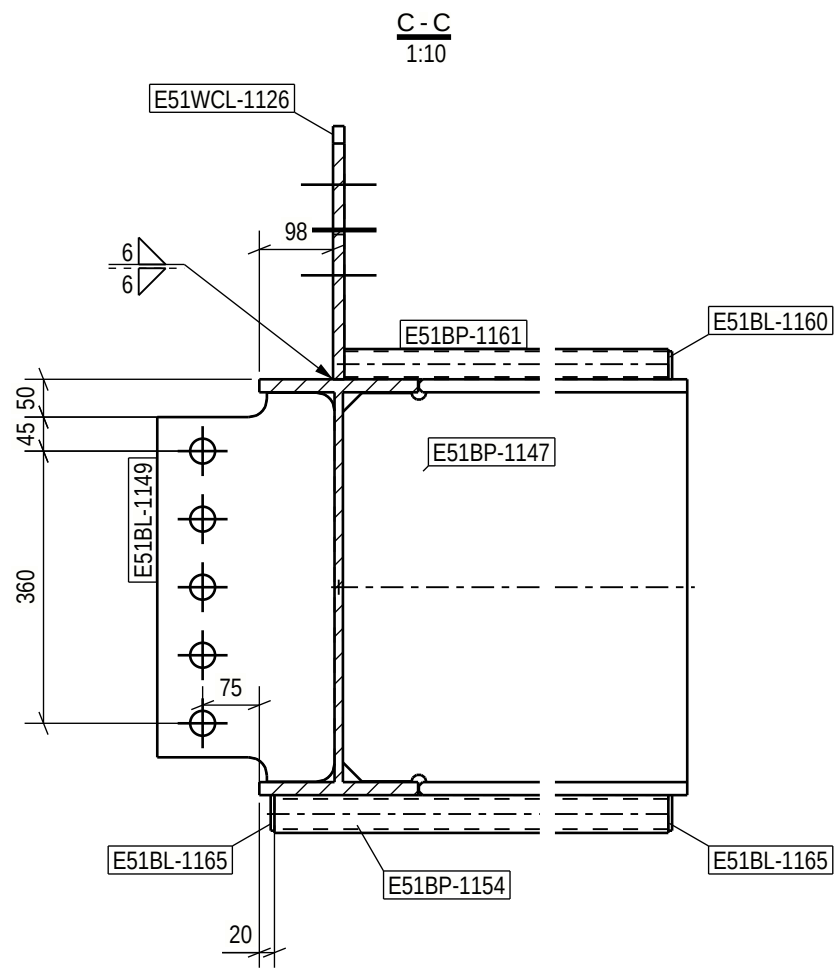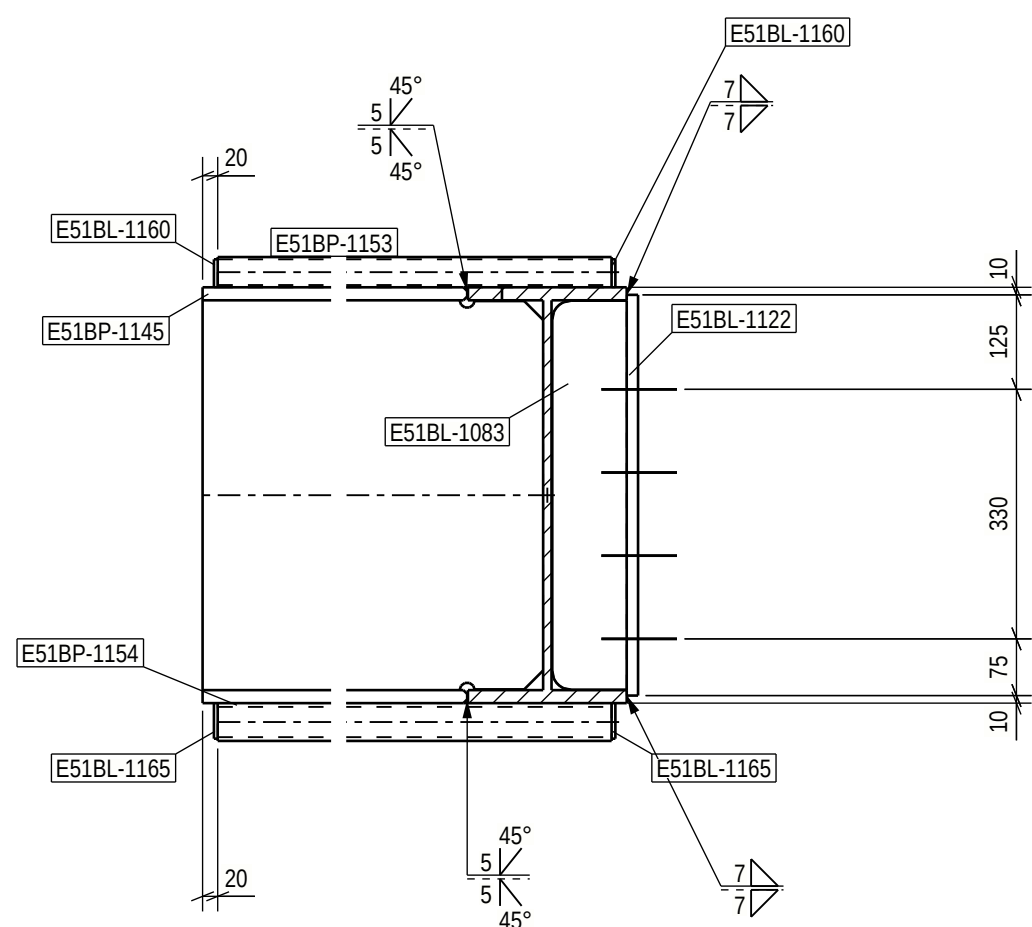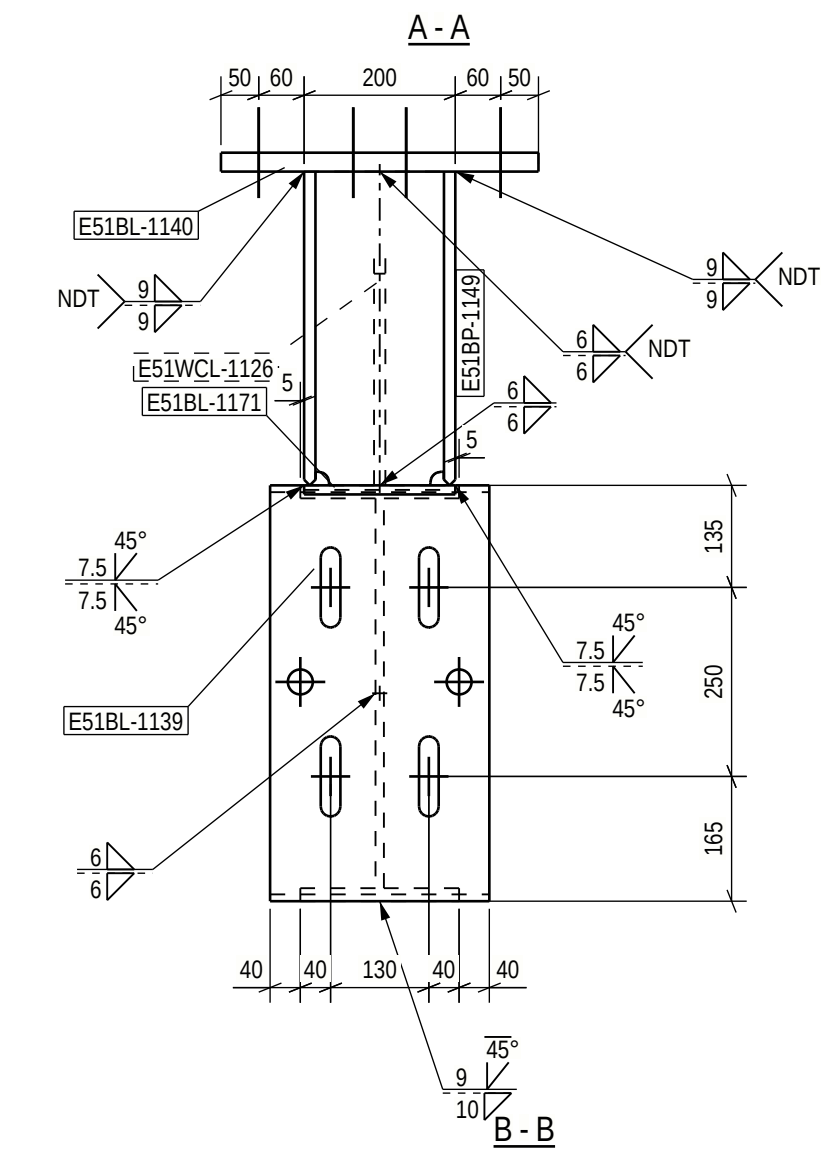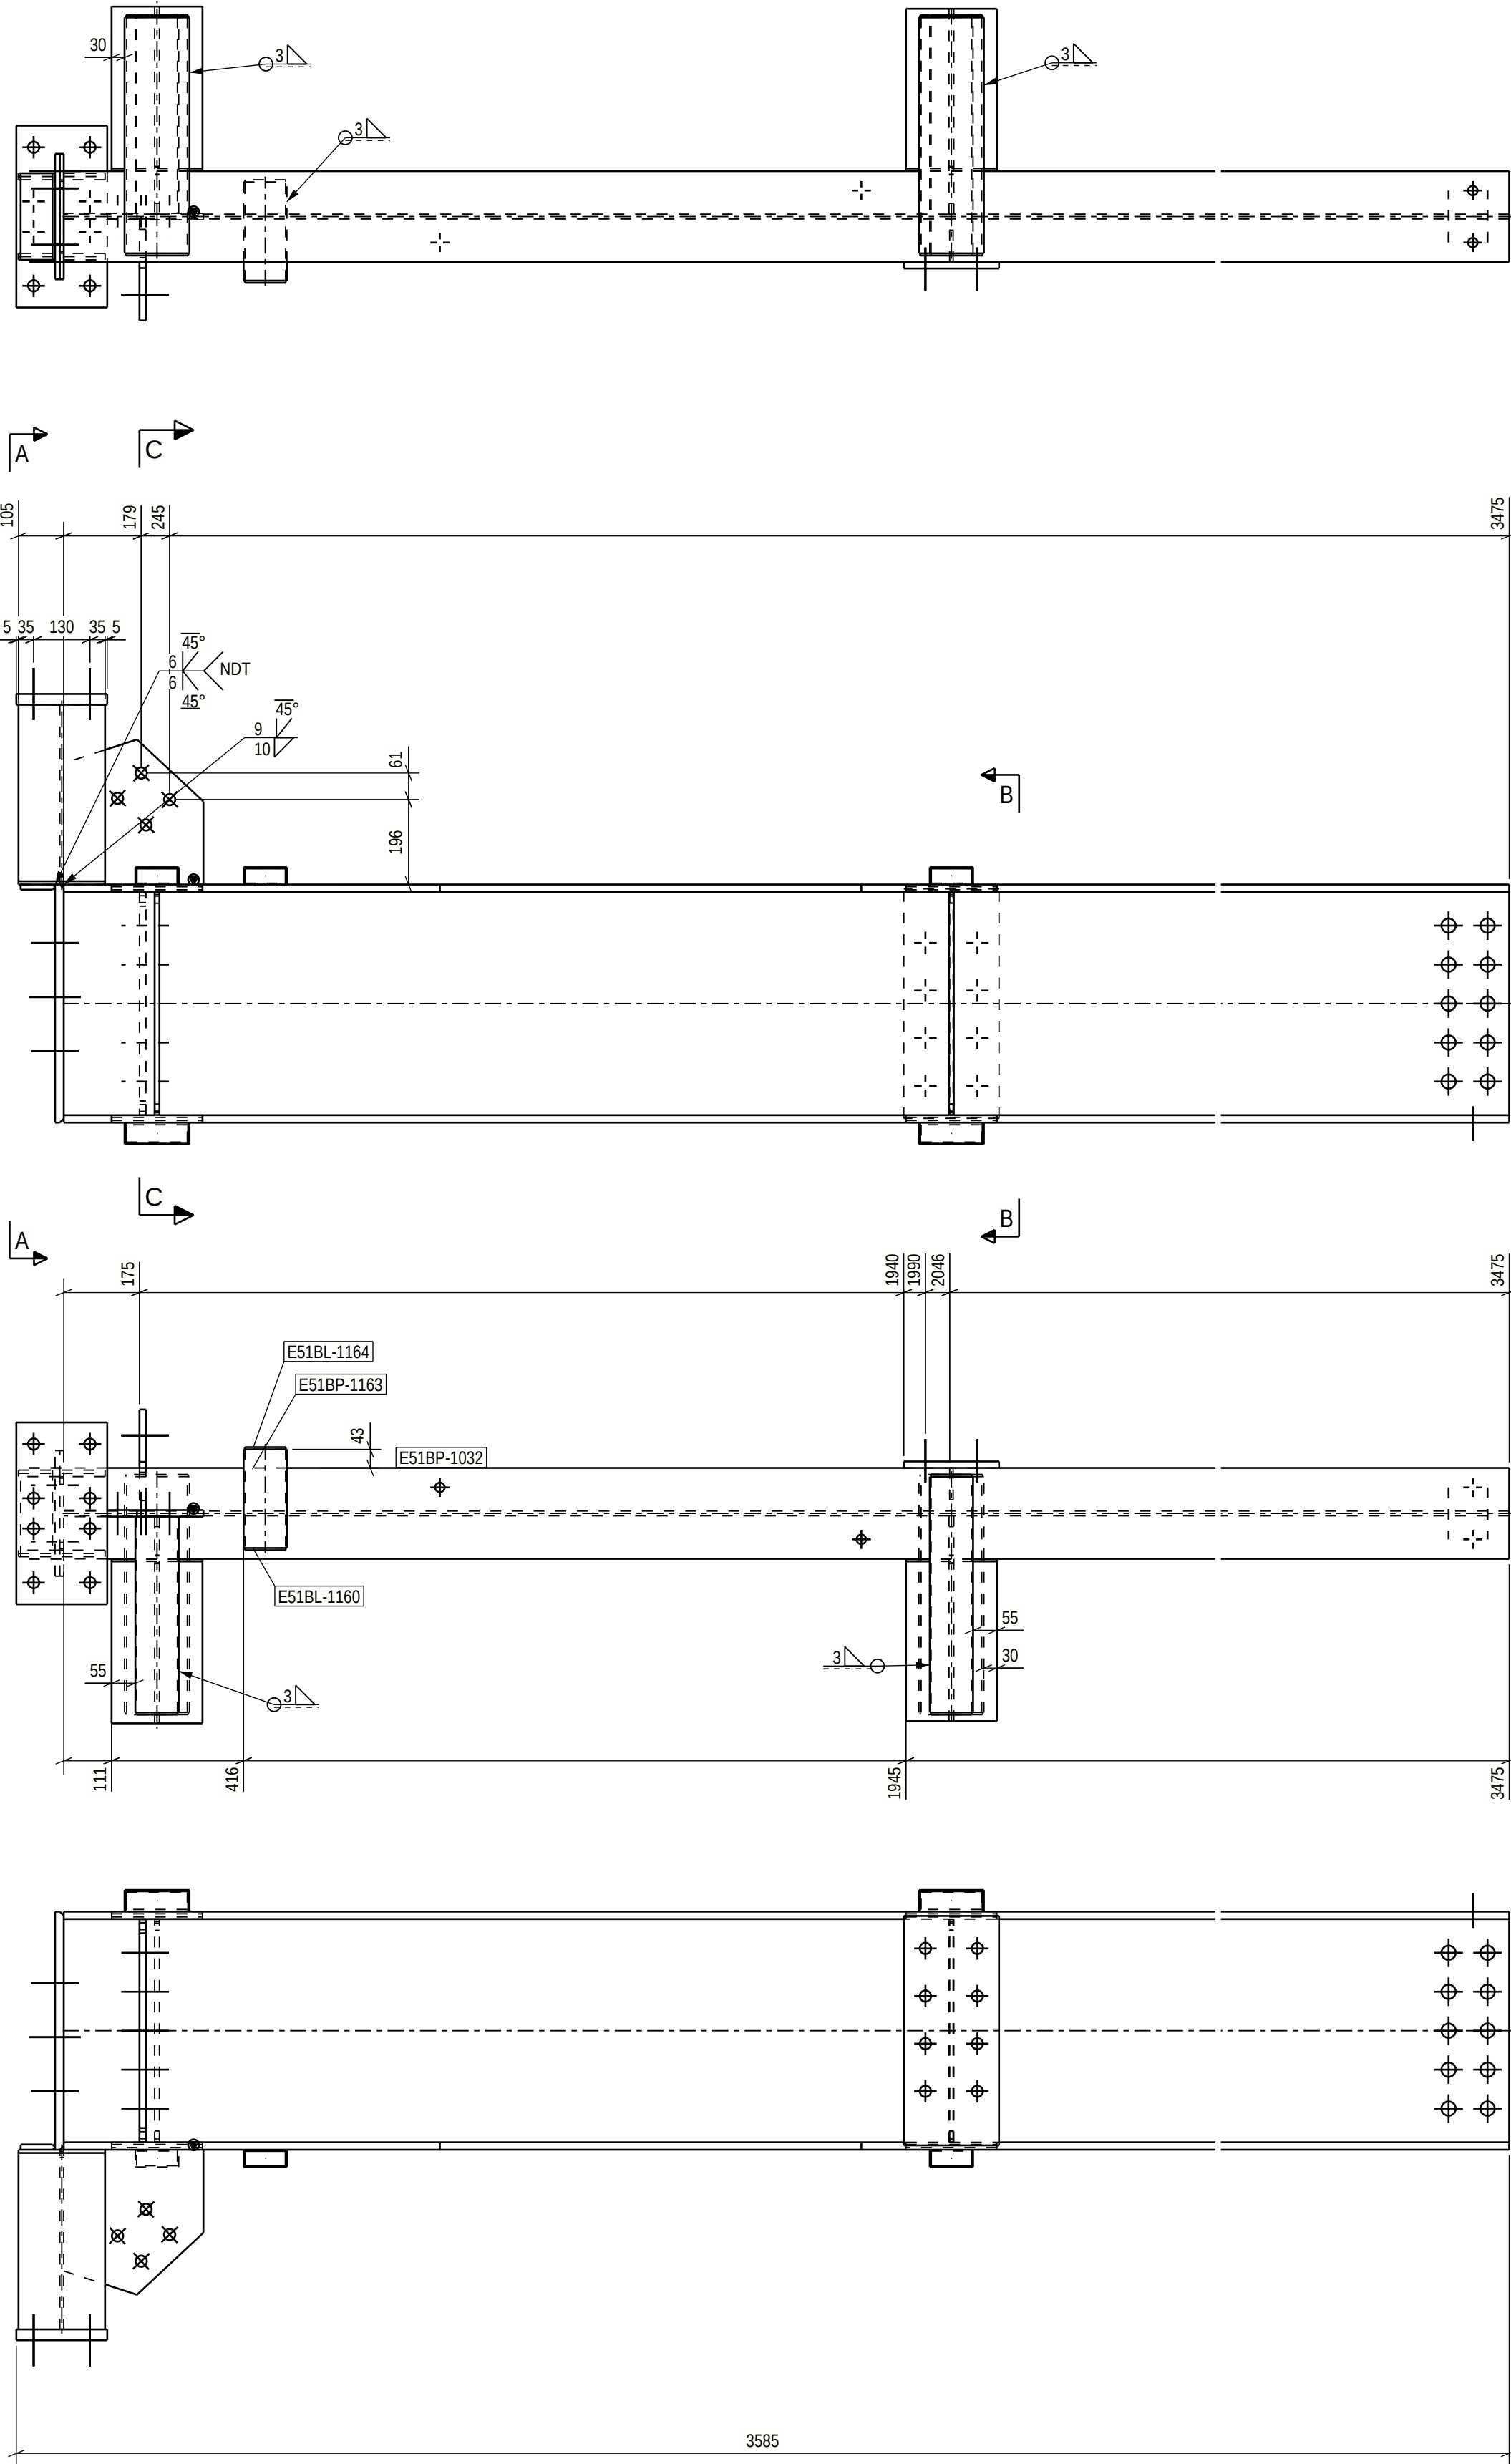

PART LIST FOR ASSEMBLY E51B-1025, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1083	PL8X98	S355J2+N	515	0.11	3.2	1
E51BL-1122	PL15X220	S355J2+N	530	0.26	13.7	1
E51BL-1139	PL20X290	S355J2+N	550	0.35	24.9	1
E51BL-1140	PL25X210	S355J2+N	420	0.21	17.3	1
E51BL-1149	PL15X234	S355J2	515	0.24	13.1	1
E51BL-1160	PL5X37	S355J2+N	94	0.03	0.1	4
E51BL-1164	PL5X34	S355J2+N	94	0.01	0.1	1
E51BL-1165	PL5X47	S355J2+N	144	0.06	0.3	4
E51BL-1171	PL12X80	S355J2+N	200	0.04	1.4	1
E51BP-1032	IPE550	S355J2	3475	6.52	365.6	1
E51BP-1145	IPE550	S355J2	474	0.89	49.9	1
E51BP-1147	IPE550	S355J2	479	0.90	50.4	1
E51BP-1149	HEB200	S355J2	415	0.48	25.4	1
E51BP-1153	CFRHS100X40X3	S355J2H	545	0.15	3.3	1
E51BP-1154	CFRHS150X50X5	S355J2H	545	0.42	7.8	2
E51BP-1161	CFRHS100X40X3	S355J2H	453	0.12	2.8	1
E51BP-1163	CFRHS100X40X3	S355J2H	228	0.06	1.4	1
E51WCL-1126	PL15X335	S355J2+N	323	0.20	10.9	1
TOTAL:				11.05	600.8	





Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard	Fabrication tolerances	
EN1090-2, table A.3: EXC2	EN 1090-2, Appendix B	
Execution Specification document nr	Special fabrication requirements	
25019443-ICC250-0600-0600-000005	Project specification/ shown on drwg.	
Surface preparation grade	Weld inspection requirements	
ISO8501-3, grade P2	EN 1090-2, Table 24, U>0.5	
Surface treatment	Extent of NDT, after welds	
ISO12944-5	MT-EN1290, 20% of welds	
Additional requirements on surface treatment	Extent of NDT, butt welds	
C3.07, EPPUR 240/2	UT, EN-ISO17640, 20% of welds	
Grades	UT, EN-ISO17640, 100% of welds	
RAL 7024 (Graphite Gray)	Requirements on testing	
Appendix 1 / Project spec.	EN1090-2 Section 6.6.3	
Welds, first specified otherwise	Weld class	
EN 9692-1, EN 9692-2	C, EN ISO 5817	
	Additional material inspection	
	Shown on drwg	

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME		DRAWING CONTENT	
Easpring New Materials Oy		ASSEMBLY DRAWING	
FAIR Phase 1		Beam	
		E51B-1025	
DATE		ARCHIVING CODE	PAGE
16.06.2026			
DESIGNER		APPROVED	DESIGN GROUP
Aleksy Serius		Periti Koluvaarahto	STR
PROJECT NUMBER		DWG. NO.	REVISION
25019443			
		E51B-1025	



SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
WWW.SWECO.FI

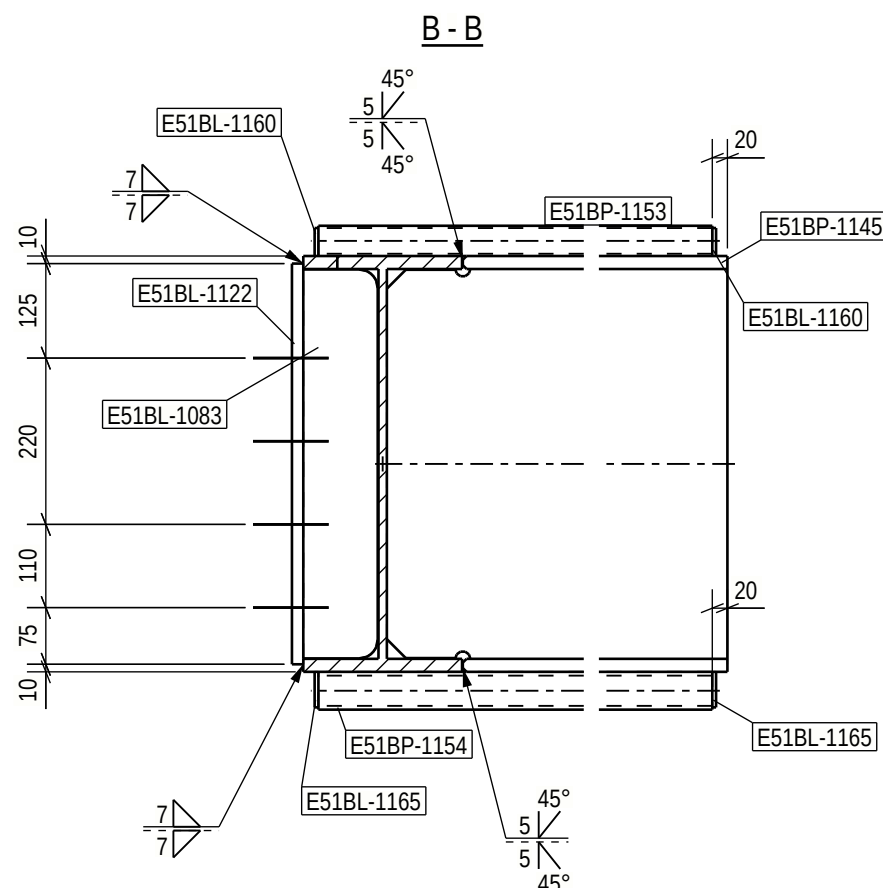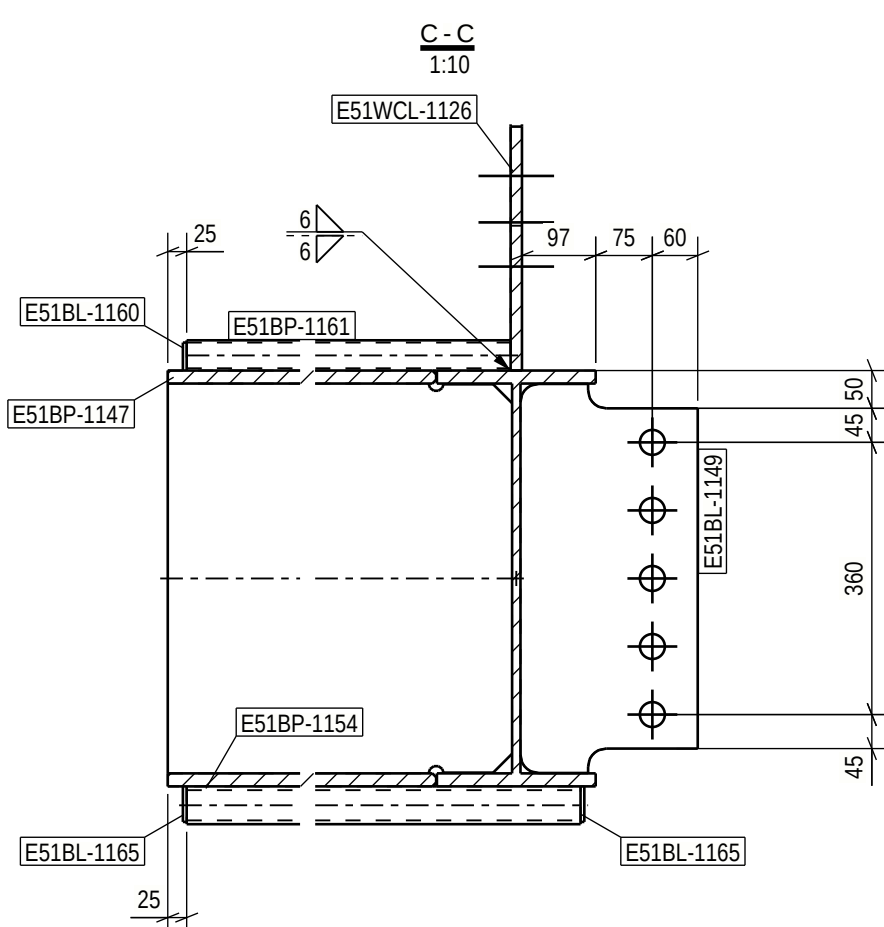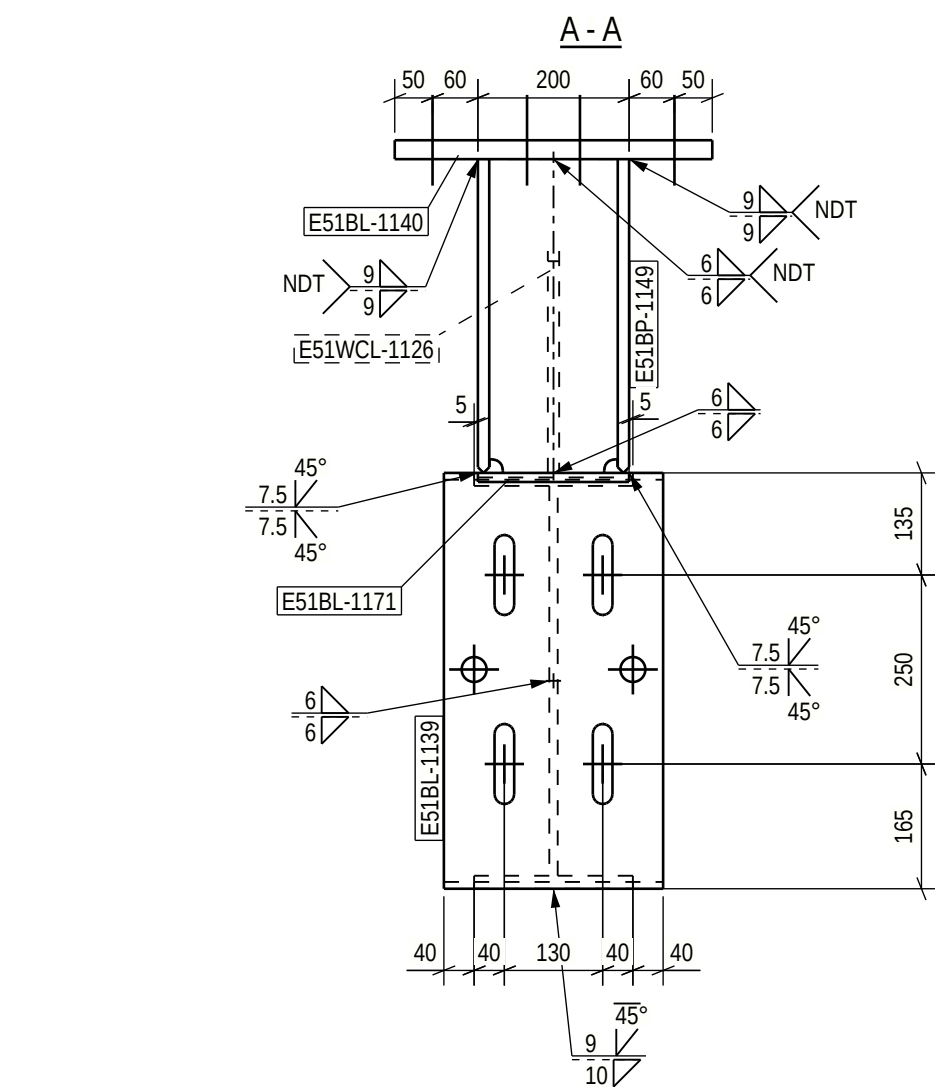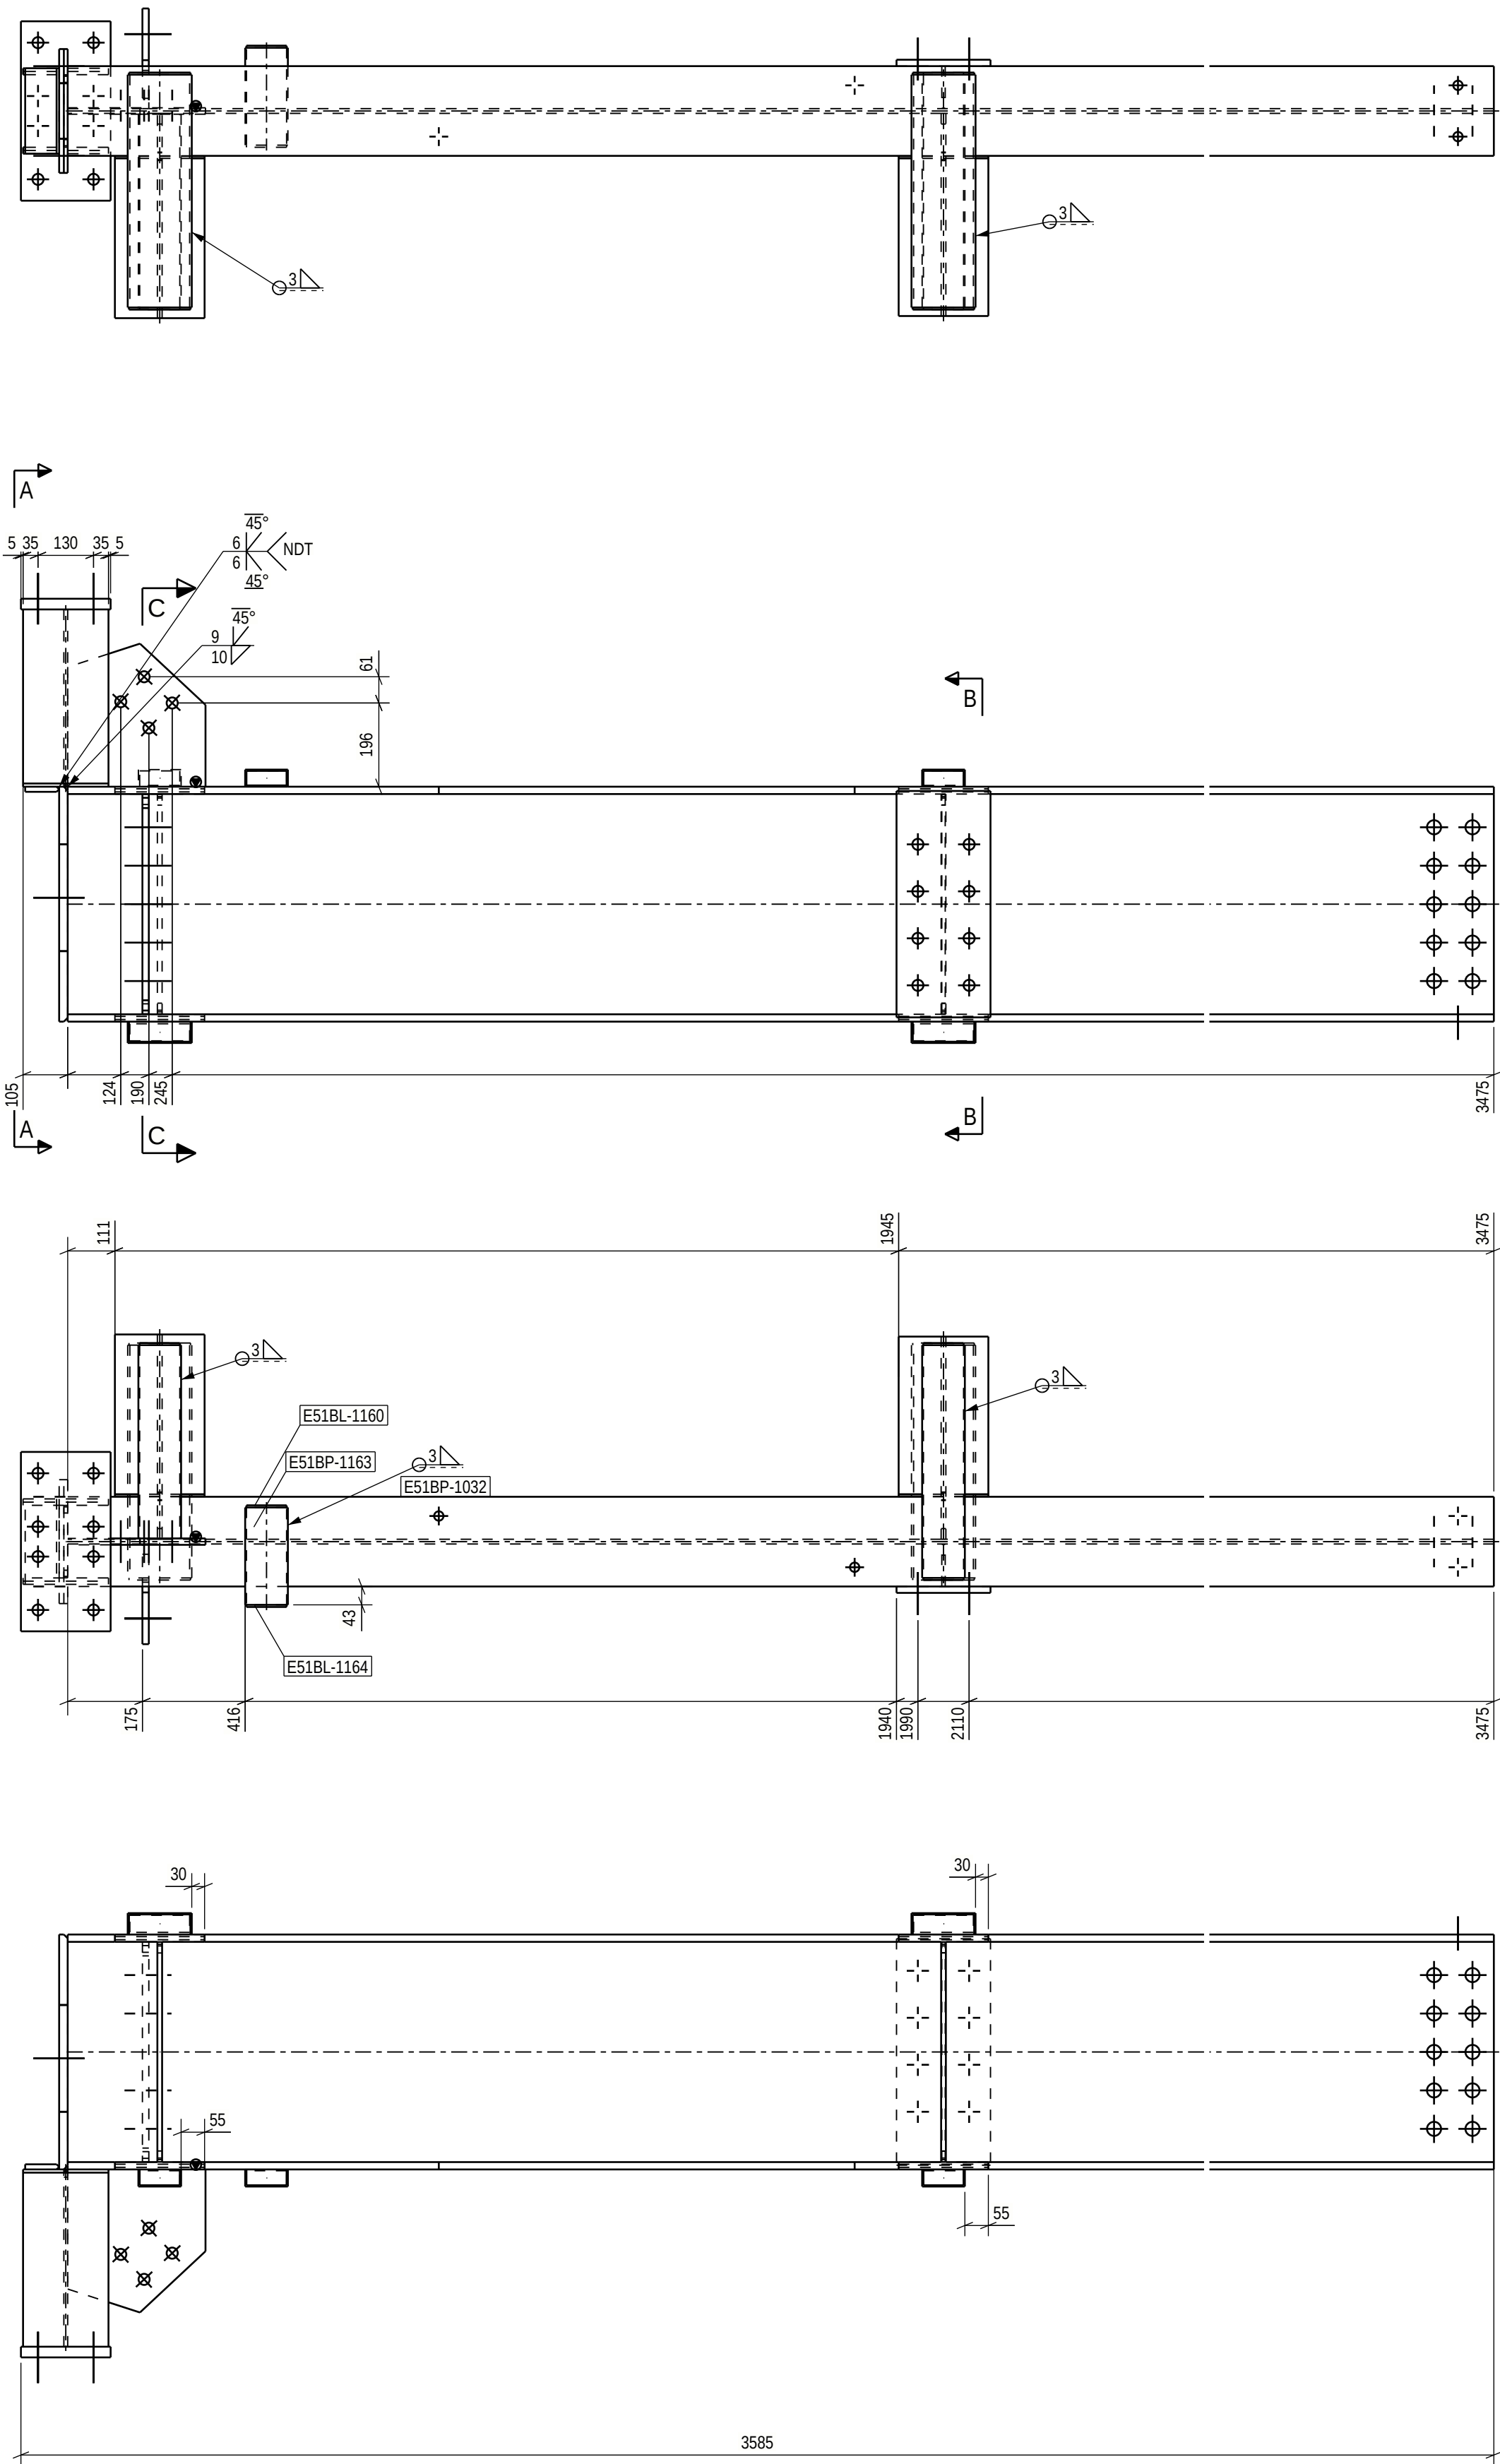




PART LIST FOR ASSEMBLY E51B-1026, MANUFACTURING AMOUNT 1 PIECES

PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1083	PL8X98	S355J2+N	515	0.11	3.2	1
E51BL-1122	PL15X220	S355J2+N	530	0.26	13.7	1
E51BL-1139	PL20X290	S355J2+N	550	0.35	24.9	1
E51BL-1140	PL25X210	S355J2+N	420	0.21	17.3	1
E51BL-1149	PL15X234	S355J2	515	0.24	13.1	1
E51BL-1160	PL5X37	S355J2+N	94	0.03	0.1	4
E51BL-1164	PL5X34	S355J2+N	94	0.01	0.1	1
E51BL-1165	PL5X47	S355J2+N	144	0.06	0.3	4
E51BL-1171	PL12X80	S355J2+N	200	0.04	1.4	1
E51BP-1032	IPE550	S355J2	3475	6.52	365.6	1
E51BP-1145	IPE550	S355J2	474	0.89	49.9	1
E51BP-1147	IPE550	S355J2	479	0.90	50.4	1
E51BP-1149	HEB200	S355J2	415	0.48	25.4	1
E51BP-1153	CFRHS100X40X3	S355J2H	545	0.15	3.3	1
E51BP-1154	CFRHS150X50X5	S355J2H	545	0.42	7.8	2
E51BP-1161	CFRHS100X40X3	S355J2H	453	0.12	2.8	1
E51BP-1163	CFRHS100X40X3	S355J2H	228	0.06	1.4	1
E51WCL-1126	PL15X335	S355J2+N	323	0.20	10.9	1
TOTAL:				11.05	600.8	

Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard	EN 1090-2, Appendix B	
Execution Specification document nr	25019443-ICC250-0600-0660-000005	
Surface preparation grade	ISO8501-3, grade P2	
Surface treatment	MT-EN1290, 20% of welds	
ISO12944-5	Extent of NDT, full welds	
Additional requirements on surface treatment	UT, EN-ISO17640, 20% of welds	
Grades	RAL 7024 (Graphite Gray)	
Welding of bulk up steel section	UT, EN-ISO17640, 100% of welds	
Appendix 1 / Project spec.	EN1090-2 Section 6.6.3	
Weld class	C, EN ISO 5817	
Additional material inspection	Shown on drwg	

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction






PROJECT NAME		DRAWING CONTENT	
Easpring New Materials Oy		ASSEMBLY DRAWING	
FAIR Phase 1		Beam	
		E51B-1026	
SWECO		DATE	
Sustainable engineering and design		16.06.2026	
ILMALANPORTTI 2		ARCHIVING CODE	
00240 HELSINKI		PAGE	
PUH. +358 207 393 000		DESIGNER	
WWW.SWECO.FI		Alley Serius	
		APPROVED	
		Periti Kouvolaanaho	
		CHECKED	
		Jere Kalliosalmi	
		REVISION	
		25019443	
		E51B-1026	

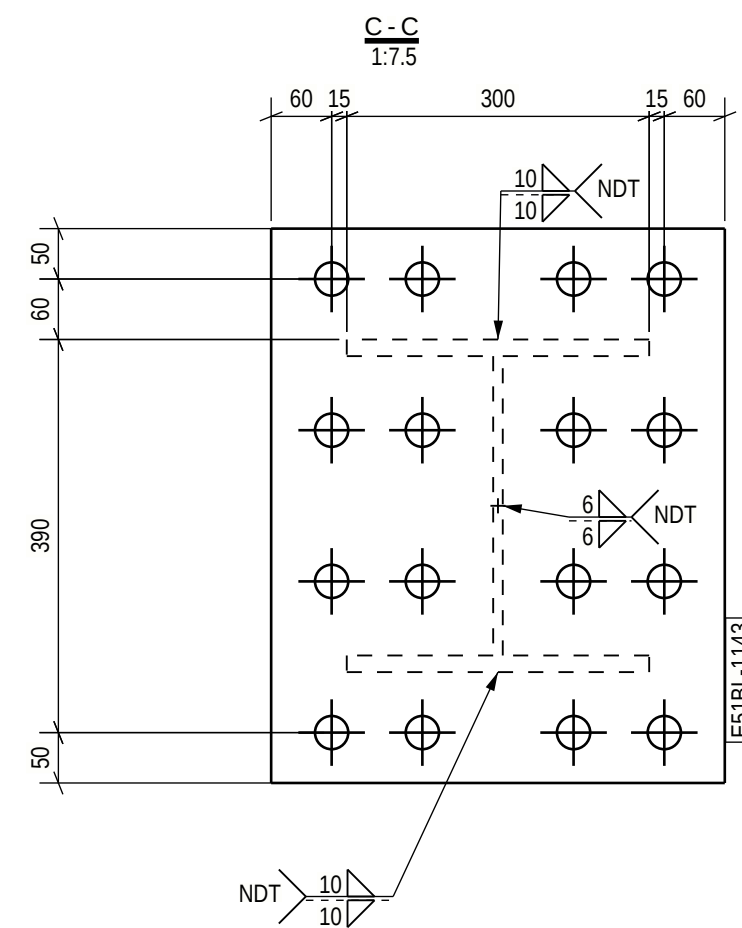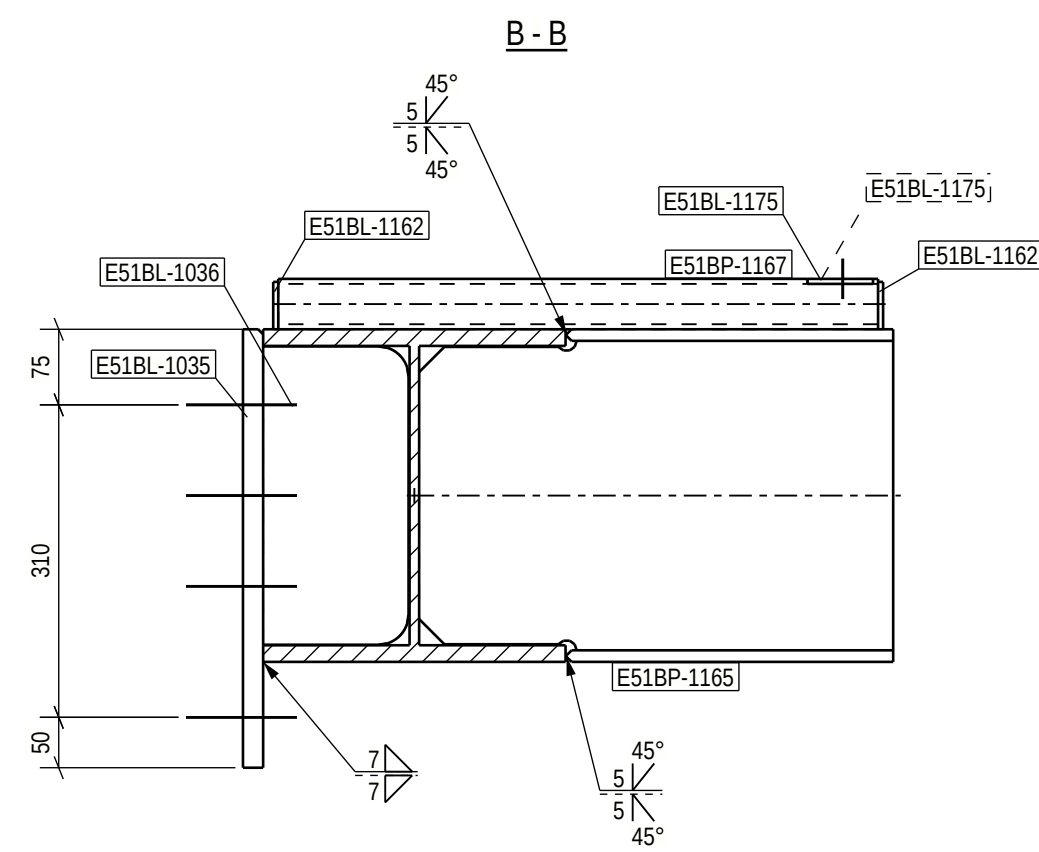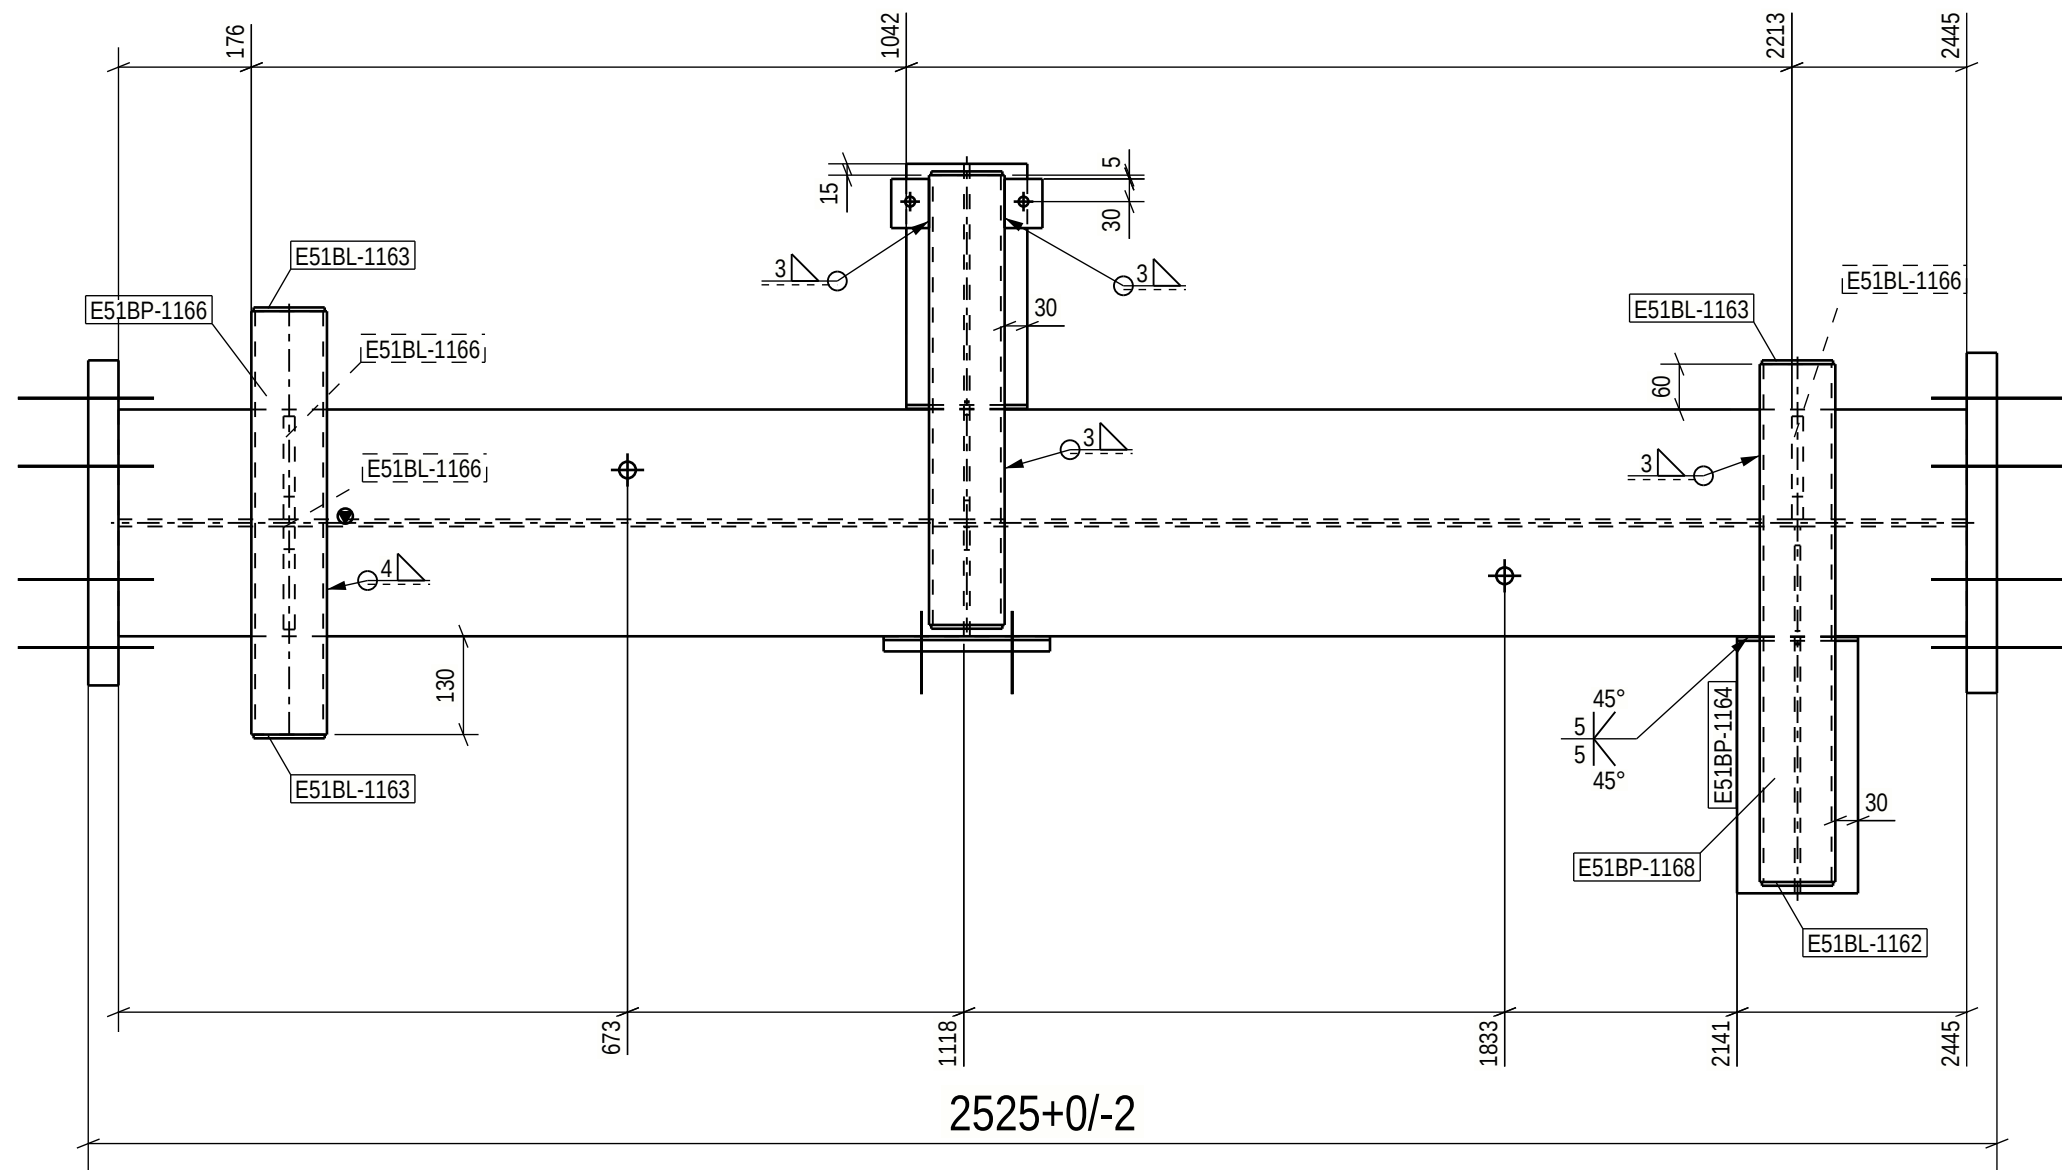

		Execution class
Technical fabrication requirements:		EXC2
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution specification document nr 25019443-ICC250-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 / Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2	Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on healing EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817	
	Additional material inspection Shown on drwg.	

SWECO 
Sustainable engineering and design

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51B-1032	REVISION	

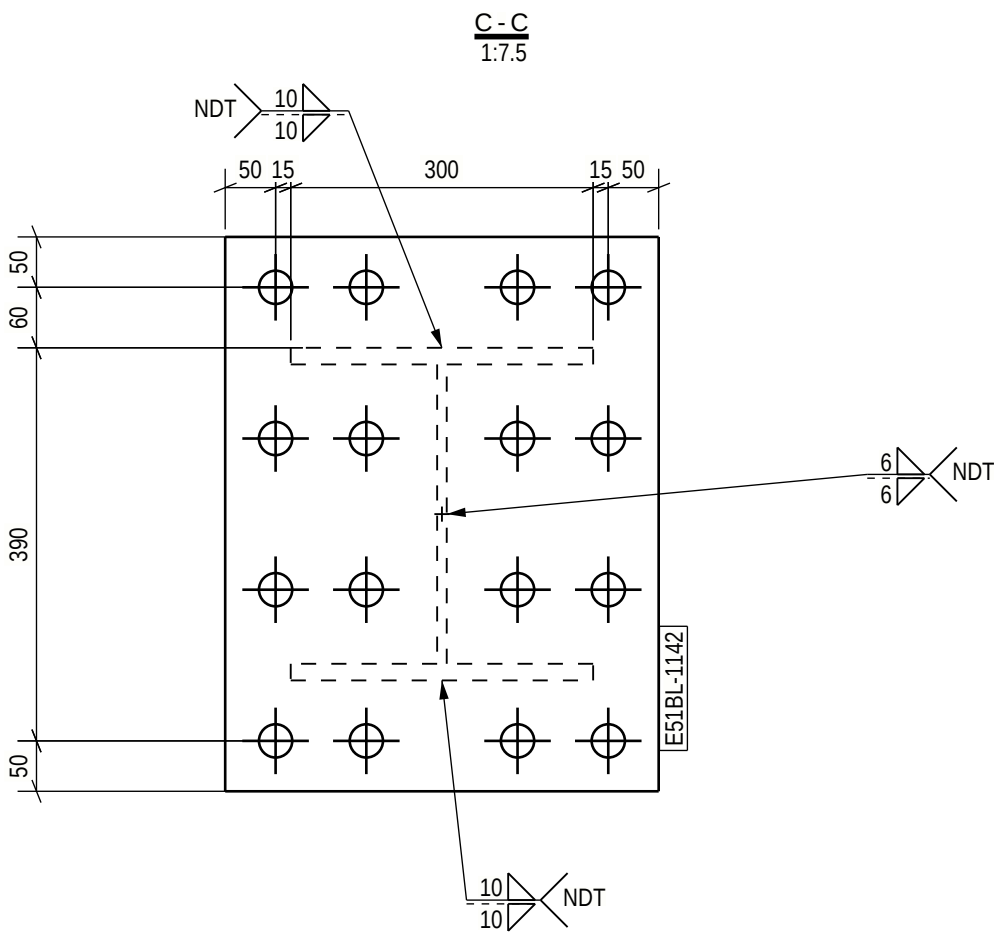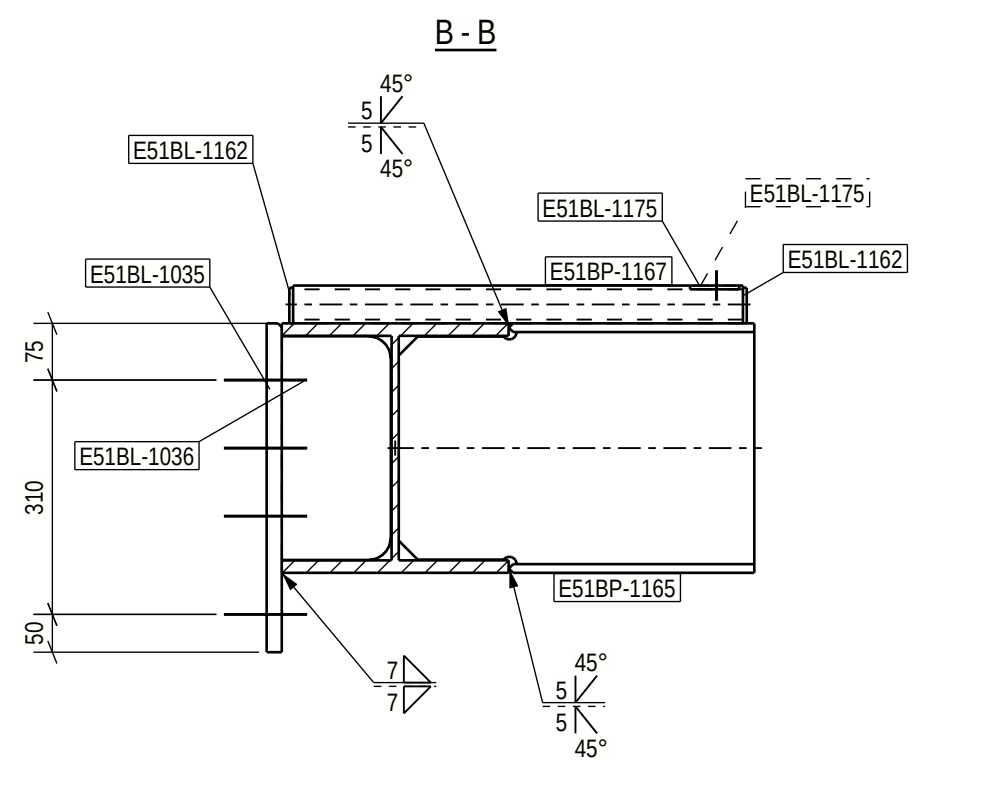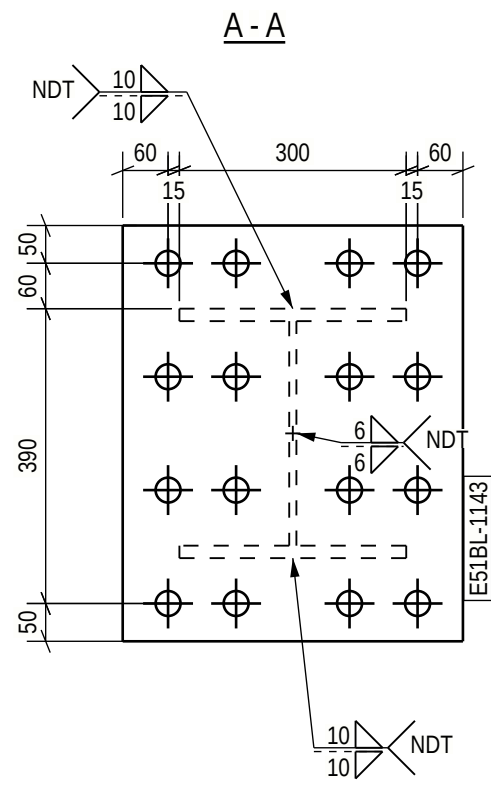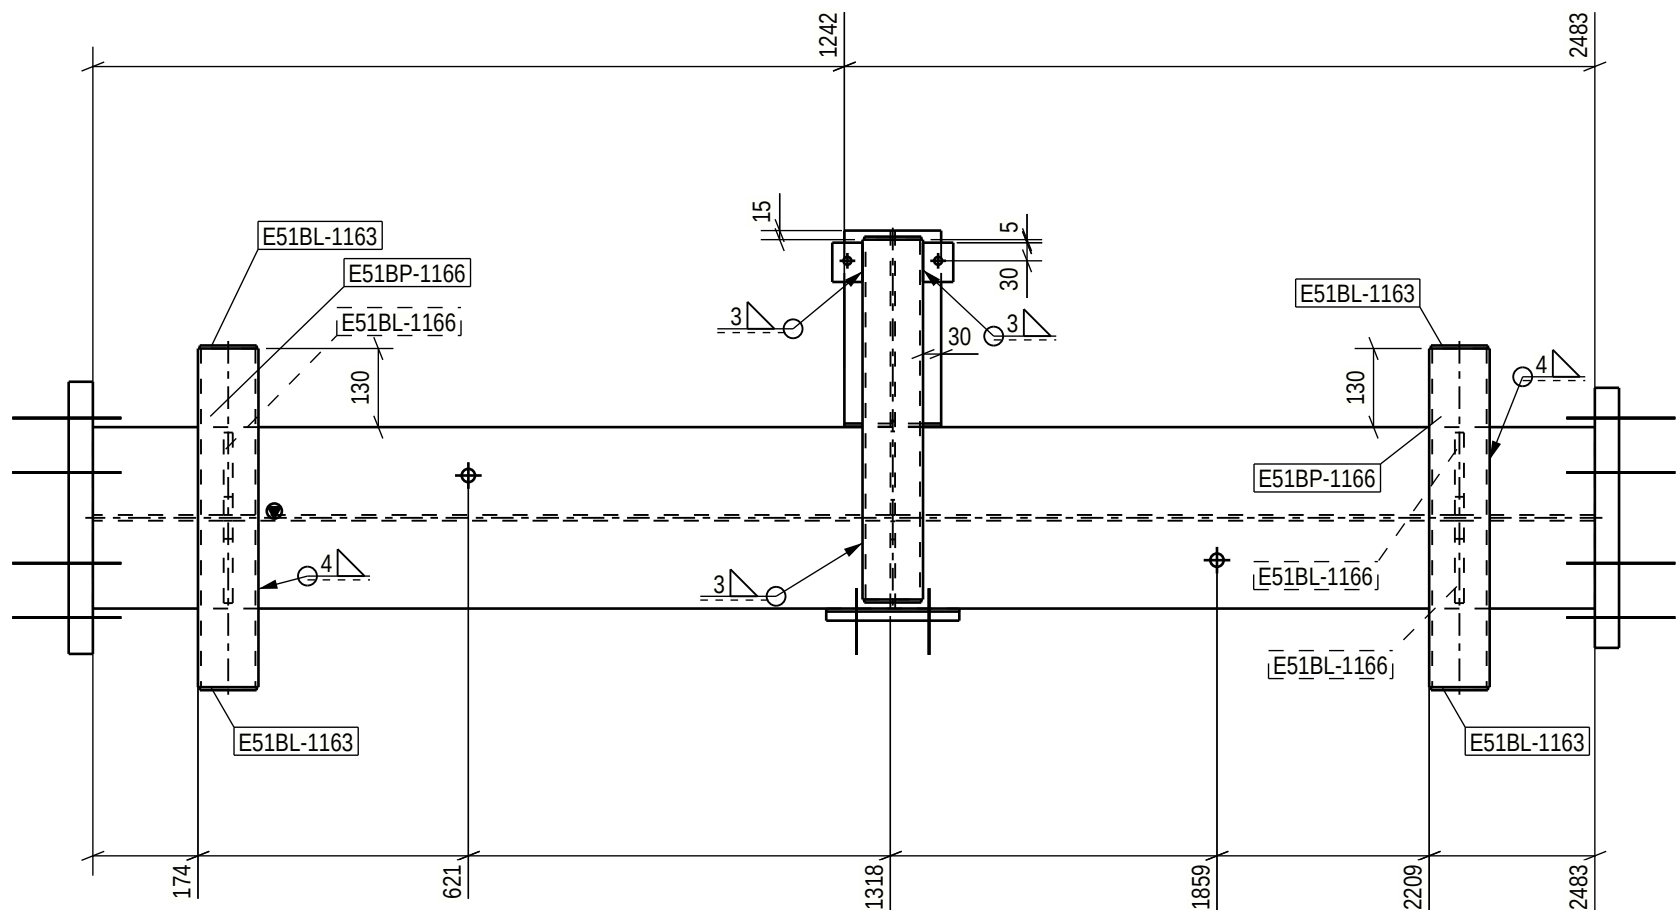
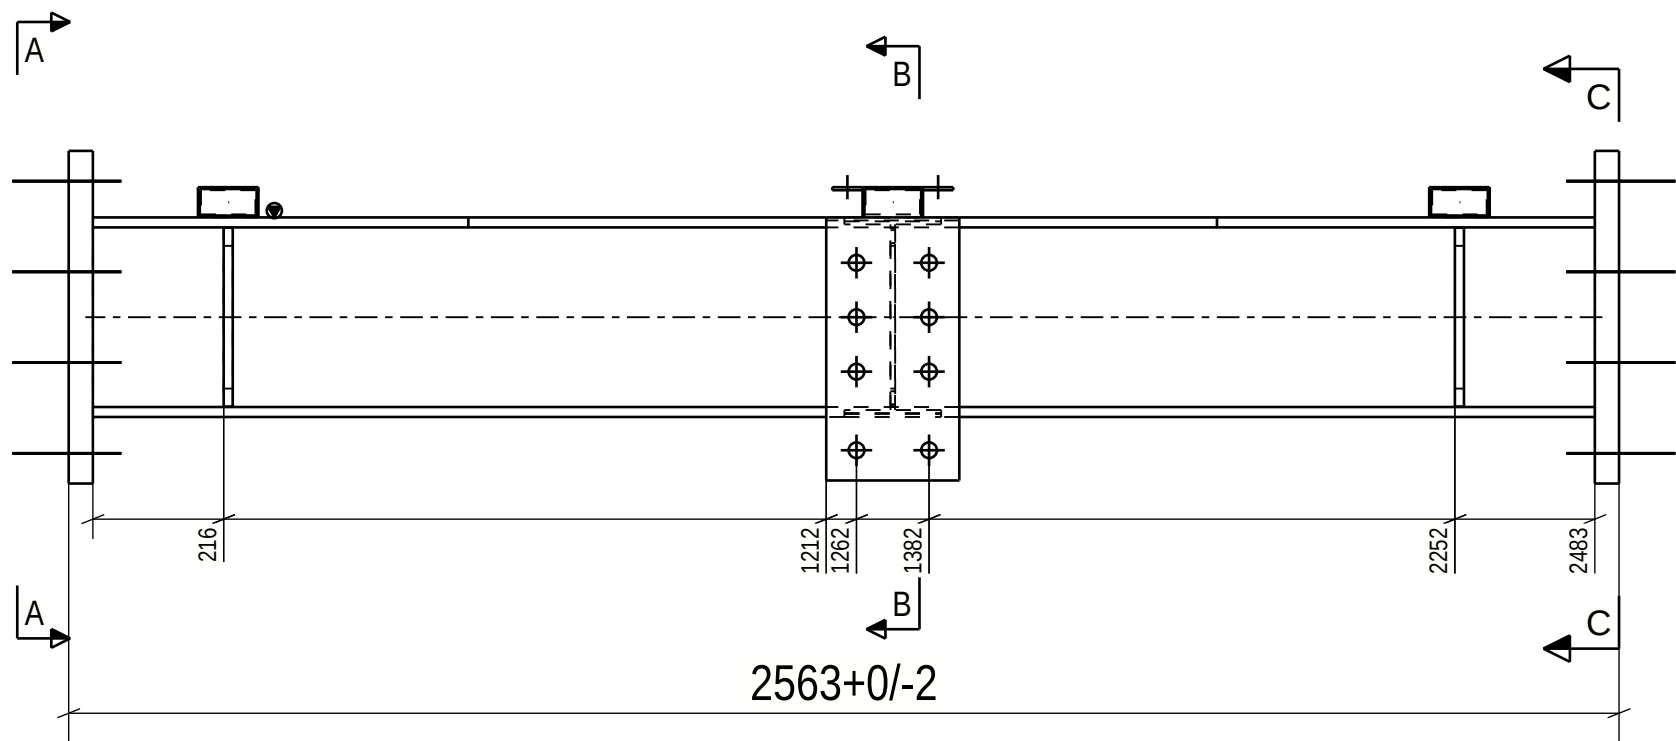


PART LIST FOR ASSEMBLY E51B-1034, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1035	PL20X220	S355J2+N	435	0.22	15.0	1
E51BL-1036	PL8X144	S355J2+N	296	0.09	2.7	1
E51BL-1142	PL40X430	S355J2+N	550	0.55	74.3	1
E51BL-1143	PL40X450	S355J2+N	550	0.58	77.7	1
E51BL-1162	PL5X47	S355J2+N	94	0.02	0.2	2
E51BL-1163	PL5X44	S355J2+N	94	0.04	0.2	4
E51BL-1166	PL15X136	S355J2+N	296	0.37	4.7	4
E51BL-1175	PL5X50	S355J2+N	65	0.02	0.1	2
E51BP-1035	HEA340	S355J2	2483	4.46	260.2	1
E51BP-1165	IPE330	S355J2	470	0.59	23.1	1
E51BP-1166	CFRHS100X50X5	S355J2H	560	0.32	5.9	2
E51BP-1167	CFRHS100X50X5	S355J2H	595	0.17	6.2	1
TOTAL:				7.41	491.0	

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3: EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005	Fabrication tolerances EN 1090-2, Appendix B	
Surface preparation grade ISO8501-3, grade P2	Special fabrication tolerances Project specification/ shown on drwg.	
Surface treatment ISO12944-5	Weld inspection, requirements EN 1090-2, Table 24, U>0.5	
Additional requirements on surface treatment C3.07, EPPUR 240/2	Extent of NDT, fillet welds MT-EN1290, 20% of welds	
Shade RAL 7024 (Graphite Gray)	Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Welding of built up steel section Appendix 1 / Project spec.	Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds	
Welds, if not specified otherwise EN 9692-1, EN 9692-2	Requirements on holing EN1090-2 Section 6.6.3	
	Weld class C, EN ISO 5817	Additional material inspection Shown on drwg.


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME		DRAWING CONTENT	
Easpring New Materials Oy FAIR Phase 1		ASSEMBLY DRAWING Beam E51B-1034	
PROJECT NUMBER 25019443		DATE 16.06.2026	ARCHIVING CODE PAGE
DRAWN Alexey Serous		DESIGNER Alexey Serous	APPROVED Pertti Koivumaa
DESIGNED Alexey Serous		CHECKED Jere Kallosalmi	REVISION
Sustainable engineering and design		25019443_Fair_E500	

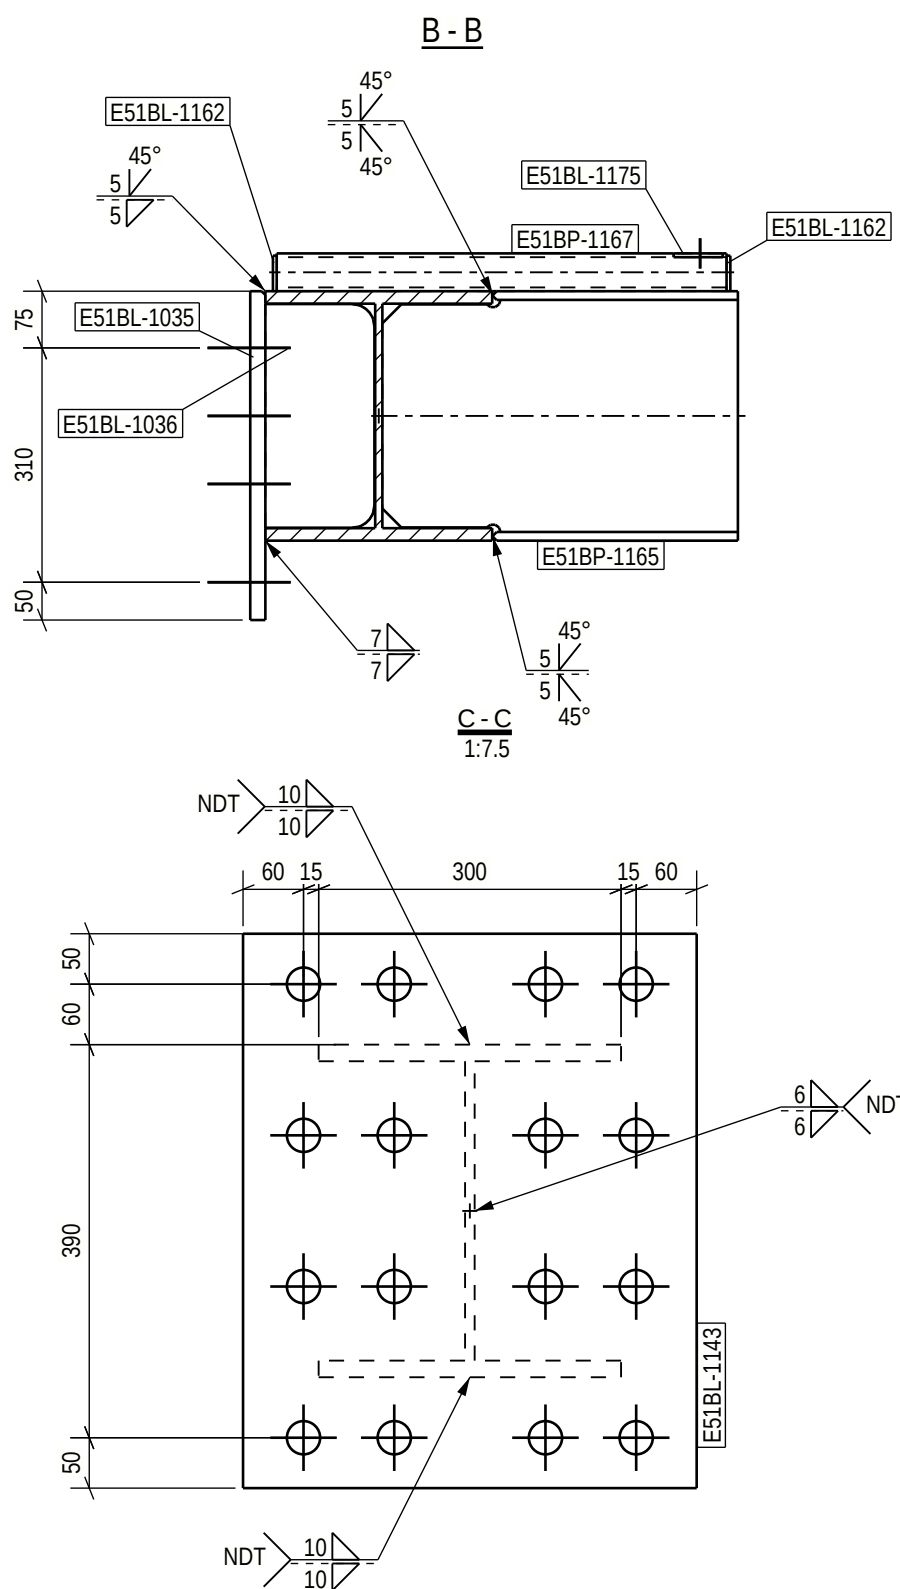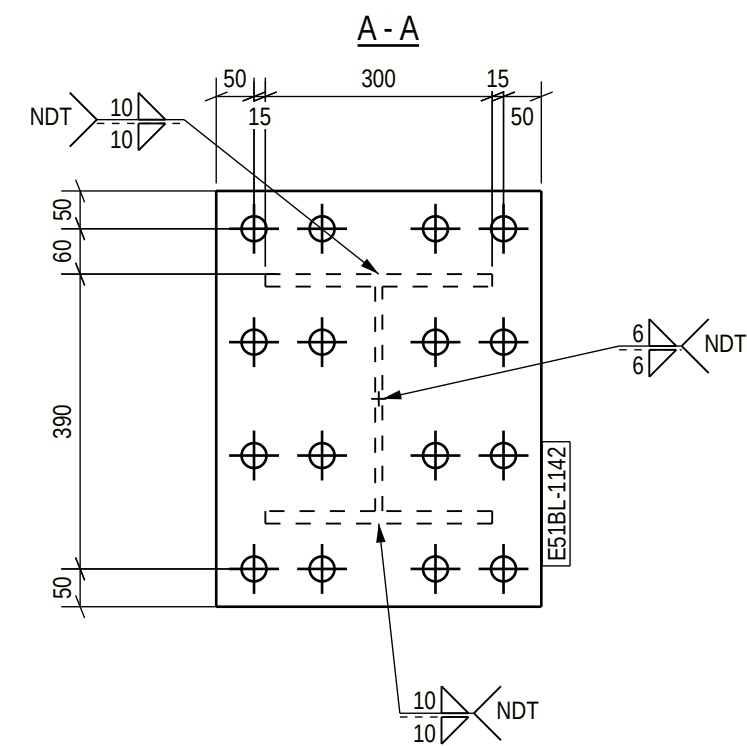

Technical fabrication requirements:		Execution class EXC2	
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution Specification document nr 25019443-ICC25-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 / Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2		Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on holding EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817	
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Additional material inspection Shown on drwg.	

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



DRAWING CONTENT

ASSEMBLY DRAWING

Beam


E51B-1035



SWECO RAKENNETEKNIikka Oy
ILMALANPORTTI 2
00240 HELSINKI

PUH. +358 207 393 000
www.sweco.fi

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51B-1035	REVISION	

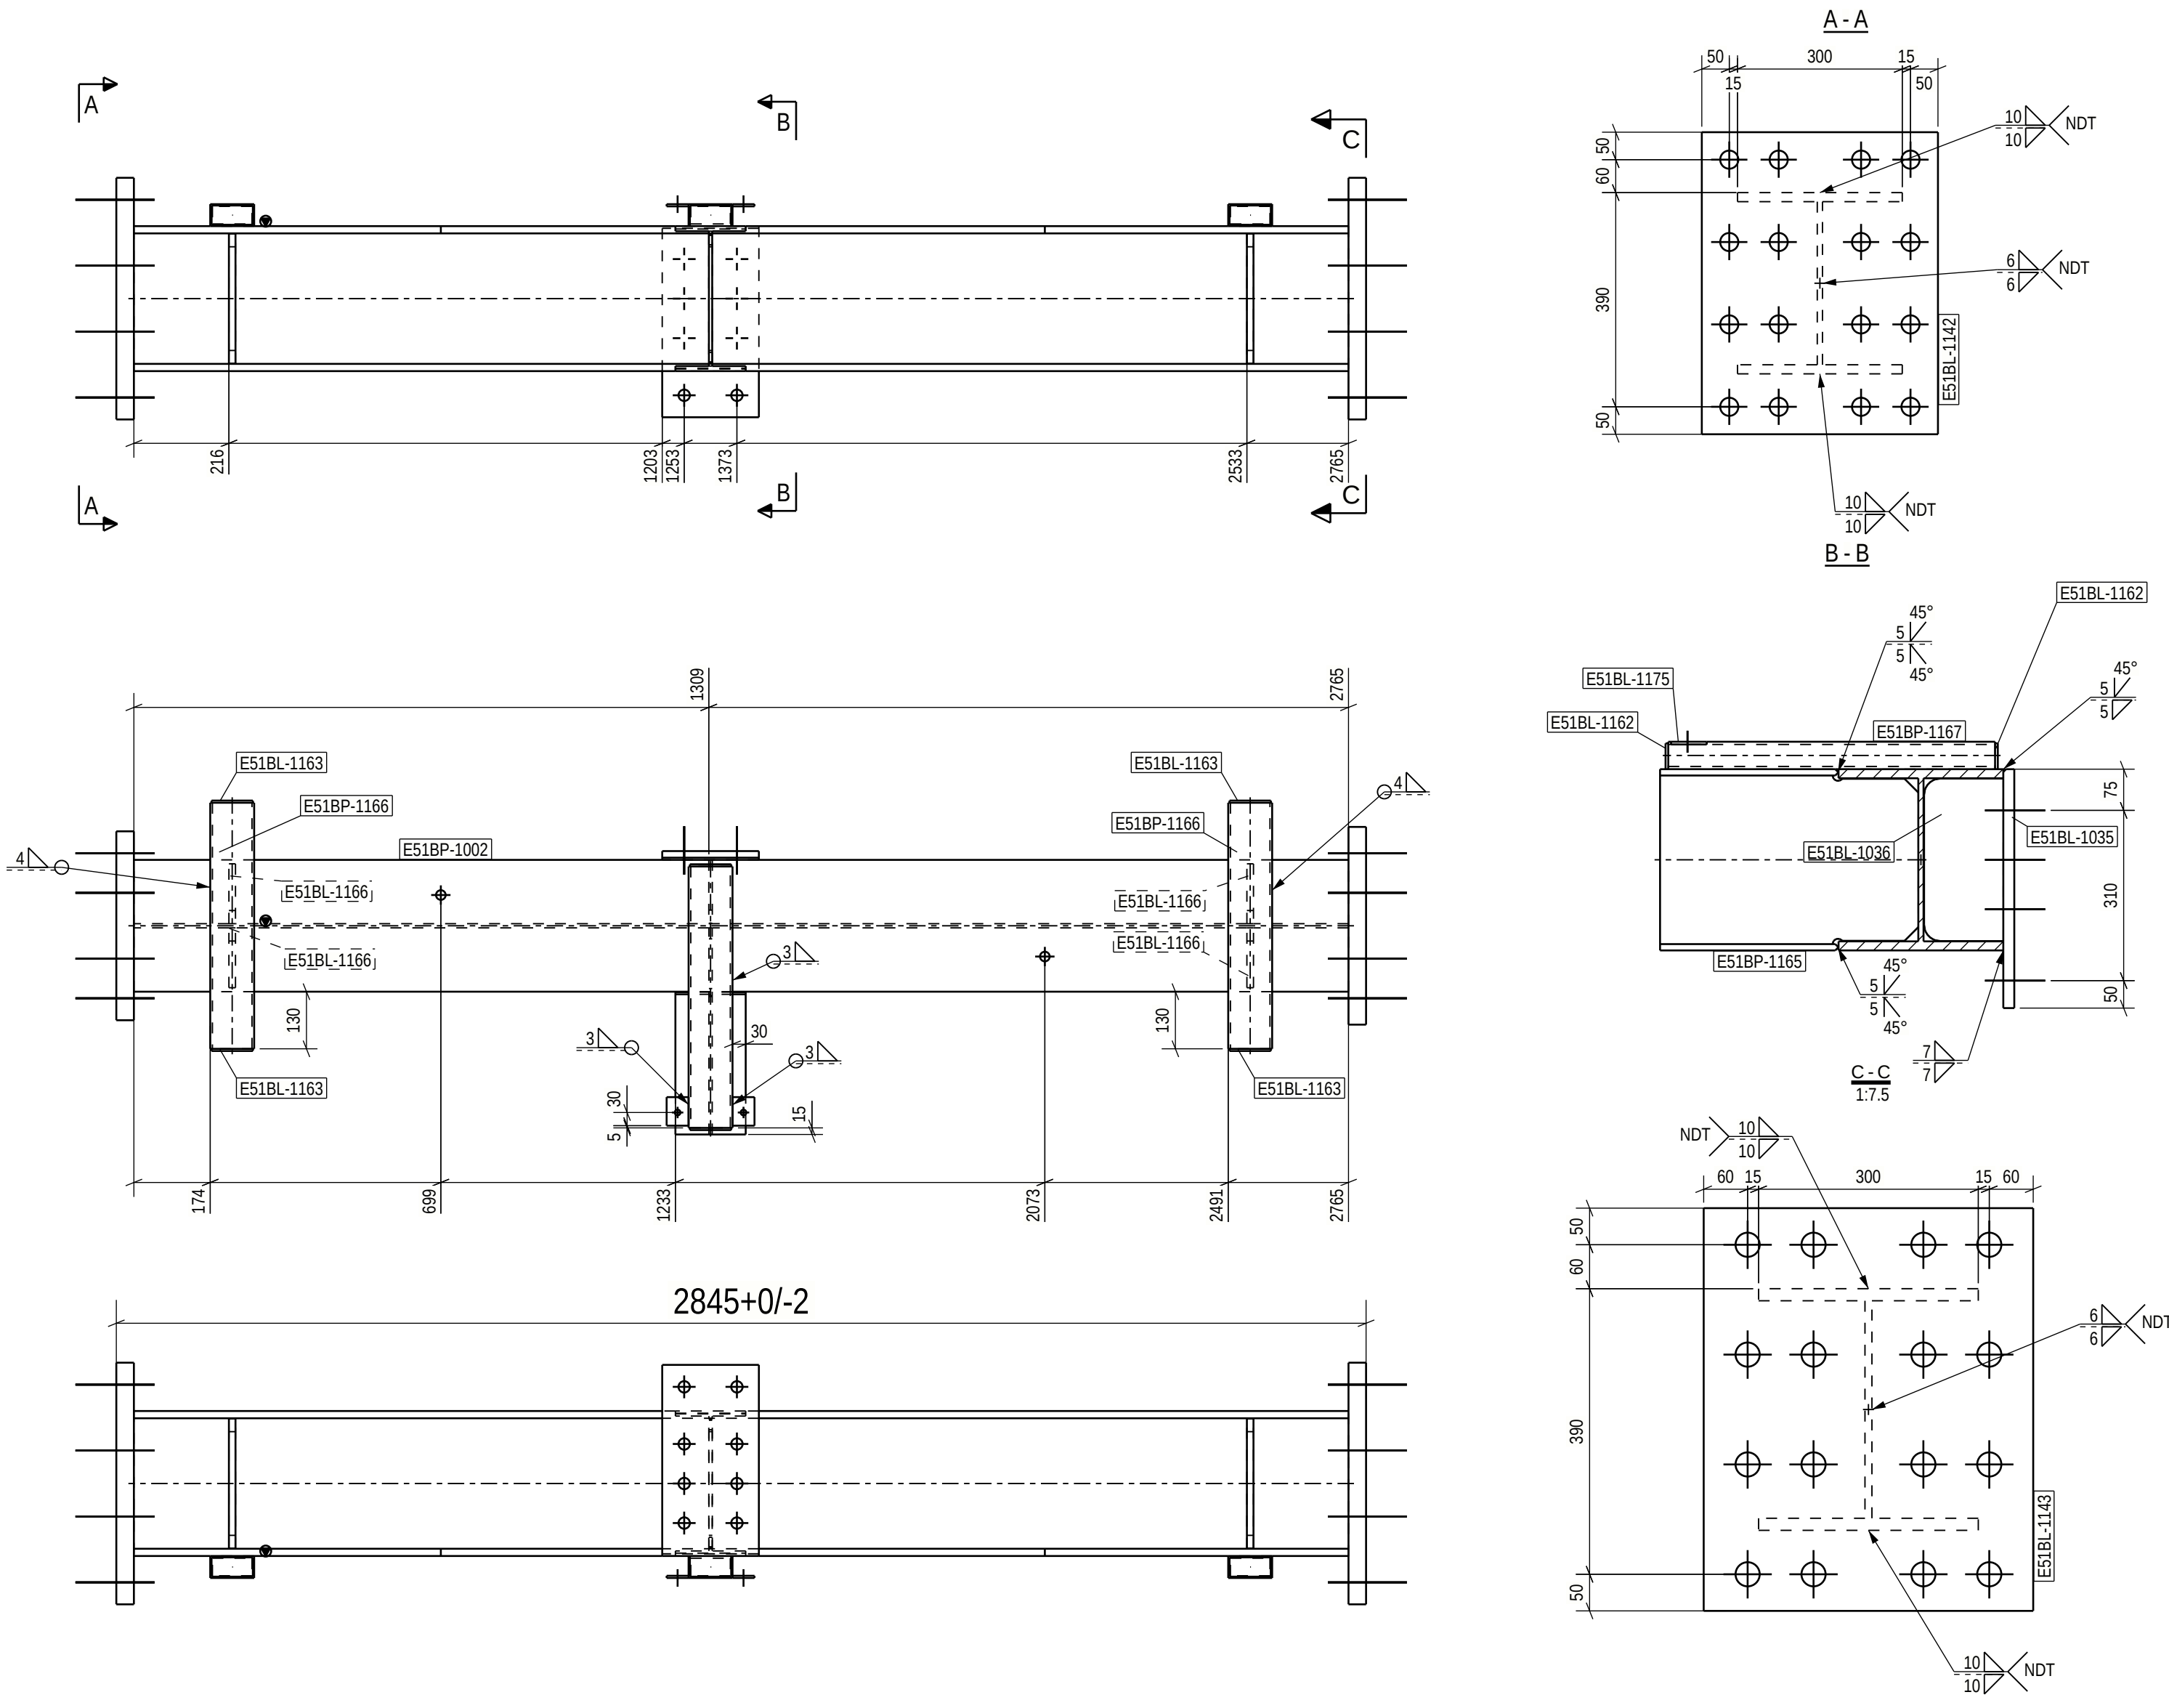

PART LIST FOR ASSEMBLY E51B-1036, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1035	PL20X220	S355J2+N	435	0.22	15.0	1
E51BL-1036	PL8X144	S355J2+N	296	0.09	2.7	1
E51BL-1142	PL40X430	S355J2+N	550	0.55	74.3	1
E51BL-1143	PL40X450	S355J2+N	550	0.58	77.7	1
E51BL-1162	PL5X47	S355J2+N	94	0.02	0.2	2
E51BL-1163	PL5X44	S355J2+N	94	0.04	0.2	4
E51BL-1166	PL15X136	S355J2+N	296	0.37	4.7	4
E51BL-1175	PL5X50	S355J2+N	65	0.02	0.1	2
E51BP-1002	HEA340	S355J2	2765	4.96	289.7	1
E51BP-1165	IPE330	S355J2	470	0.59	23.1	1
E51BP-1166	CFRHS100X50X5	S355J2H	560	0.32	5.9	2
E51BP-1167	CFRHS100X50X5	S355J2H	595	0.17	6.2	1
TOTAL:				7.92	520.5	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard
EN1090-2, table A.3 : EXC2
Execution Specification document nr
25019443-ICC250-0600-0660-000005

Fabrication tolerances
EN 1090-2, Appendix B
Special fabrication tolerances
Project specification/ shown on drwg.

Surface preparation grade
ISO8501-3, grade P2

Weld inspection, requirements
EN 1090-2, Table 24, U>0.5

Surface treatment
ISO12944-5

Extent of NDT, fillet welds
MT-EN1290, 20% of welds

Additional requirements on surface treatment
C3.07, EPPUR 240/2

Shade
RAL 7024 (Graphite Gray)

Extent of NDT for splices not shown on drawing
UT, EN-ISO17640, 100% of welds

Welding of built up steel section
Appendix 1 / Project spec.

Requirements on holing
EN1090-2 Section 6.6.3

Welds, if not specified otherwise
EN 9692-1, EN 9692-2

Weld class
C, EN ISO 5817

Additional material inspection
Shown on drwg.

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1








SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1036

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Kivumaa	CHECKED Jere Kallosalmi
PROJECT NUMBER 25019443	REVISION E51B-1036		

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

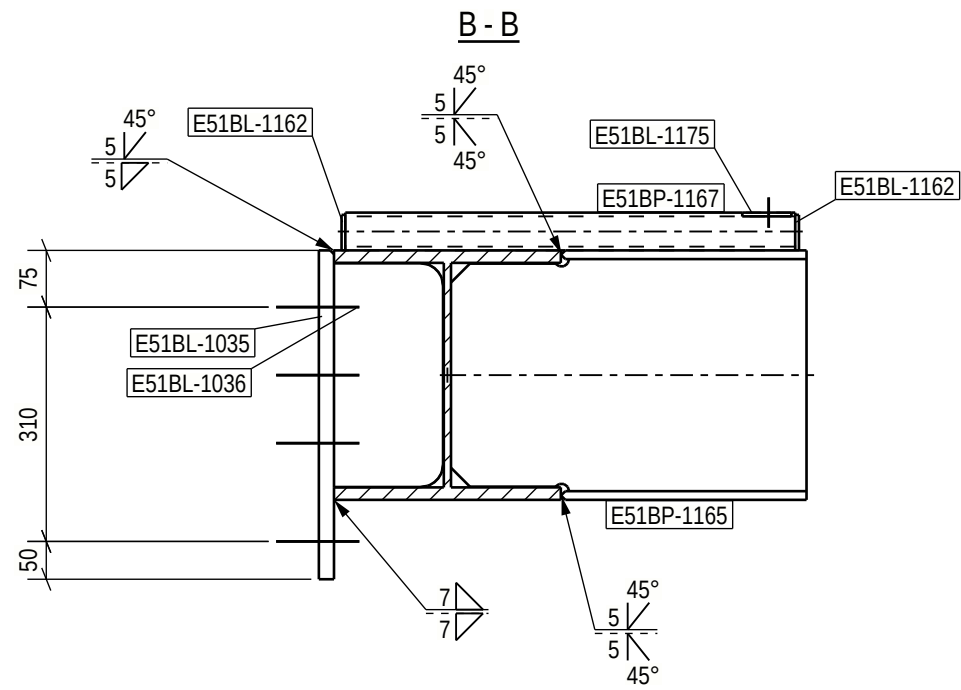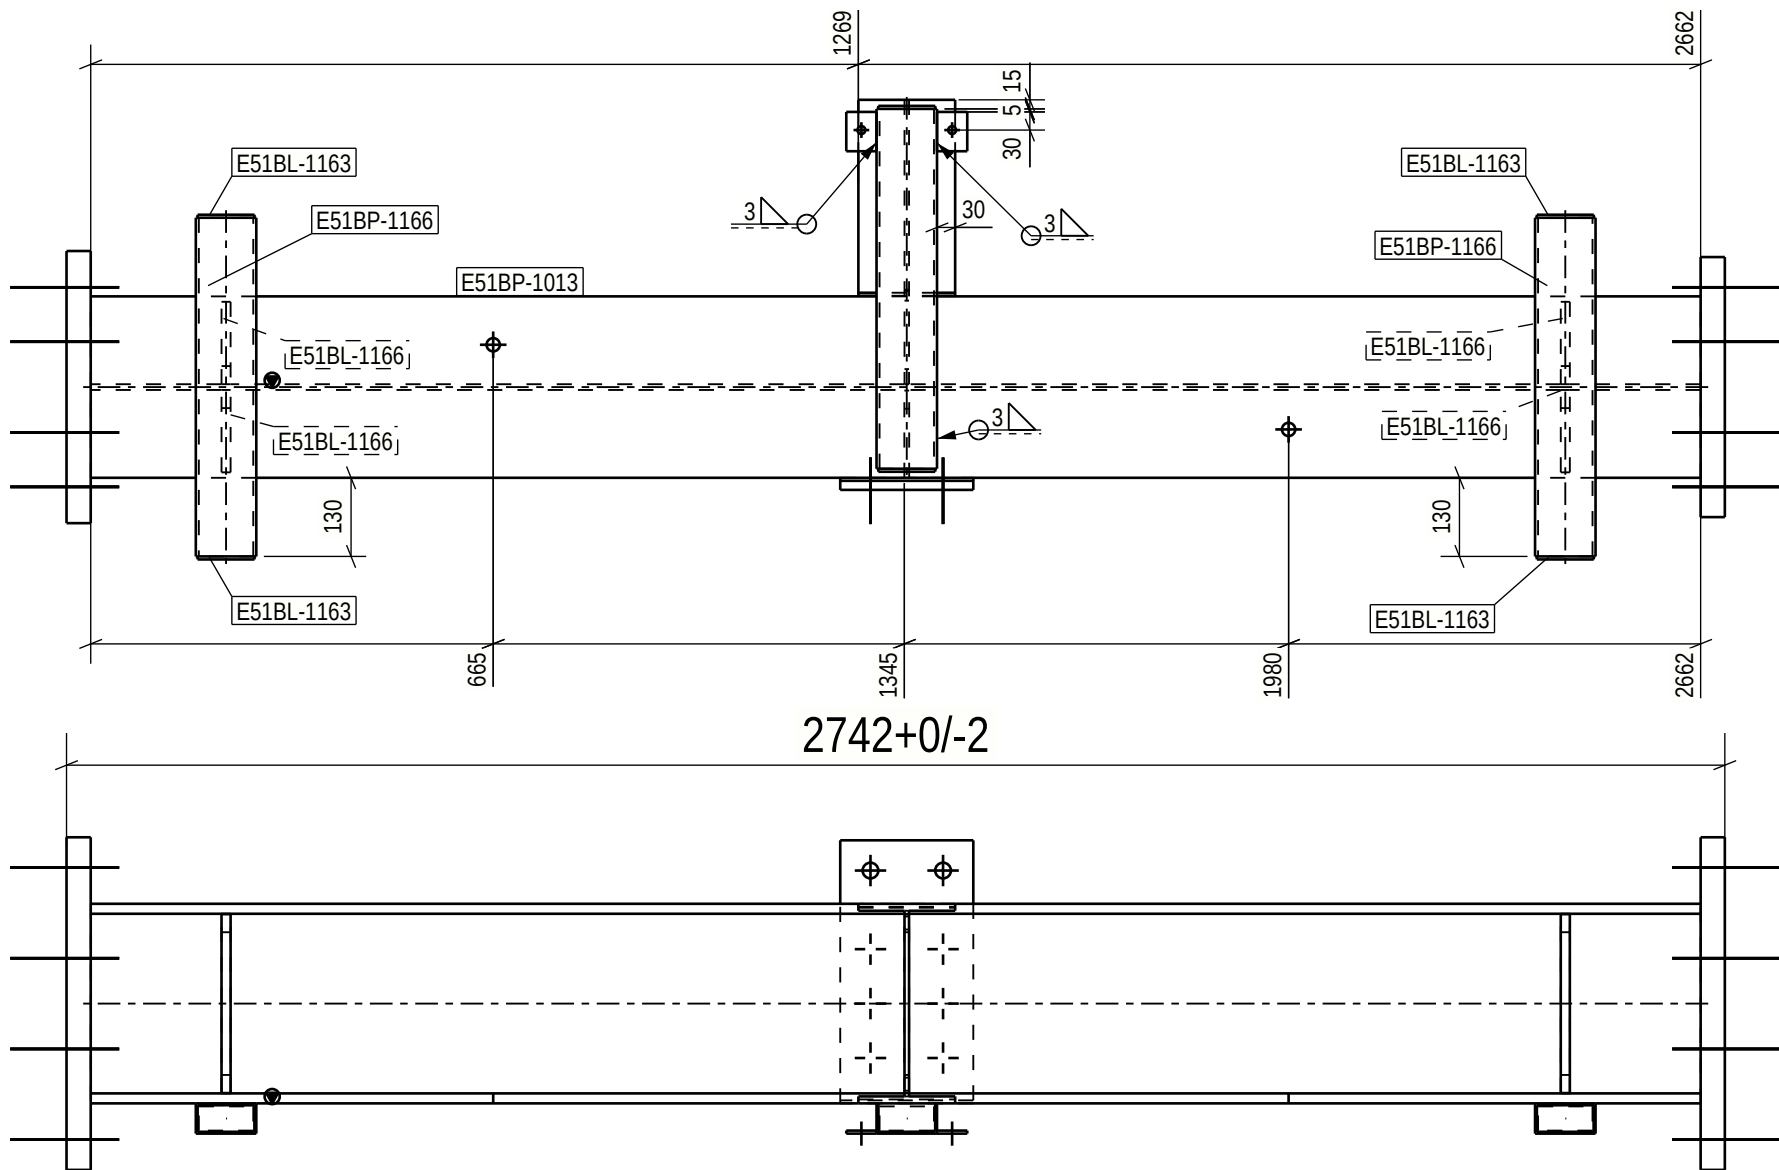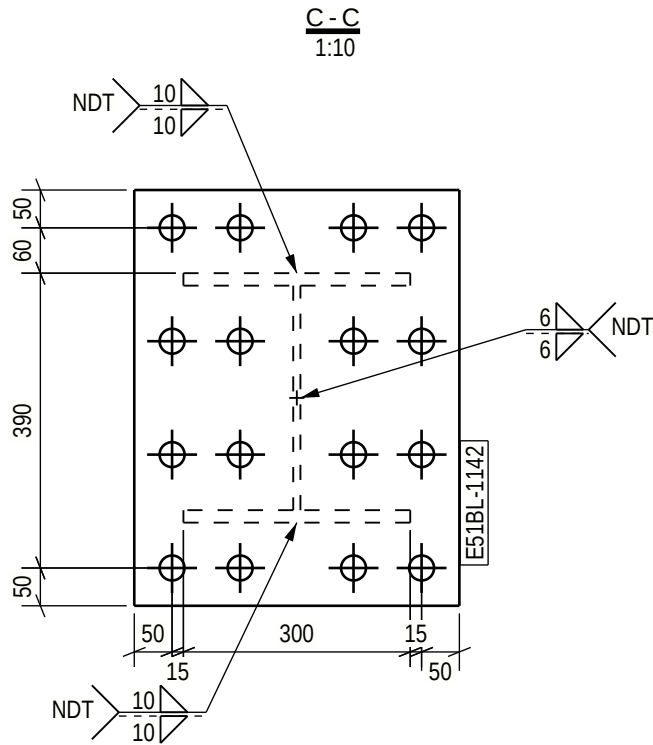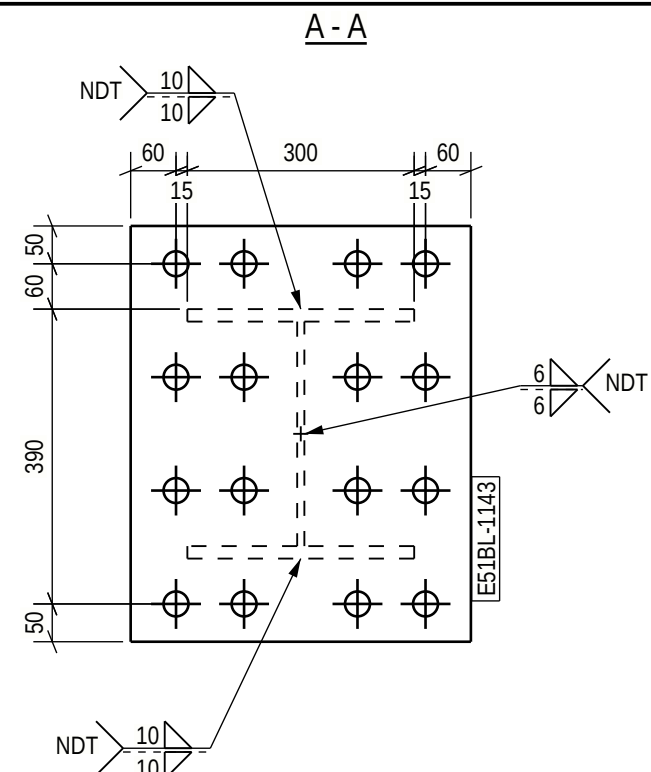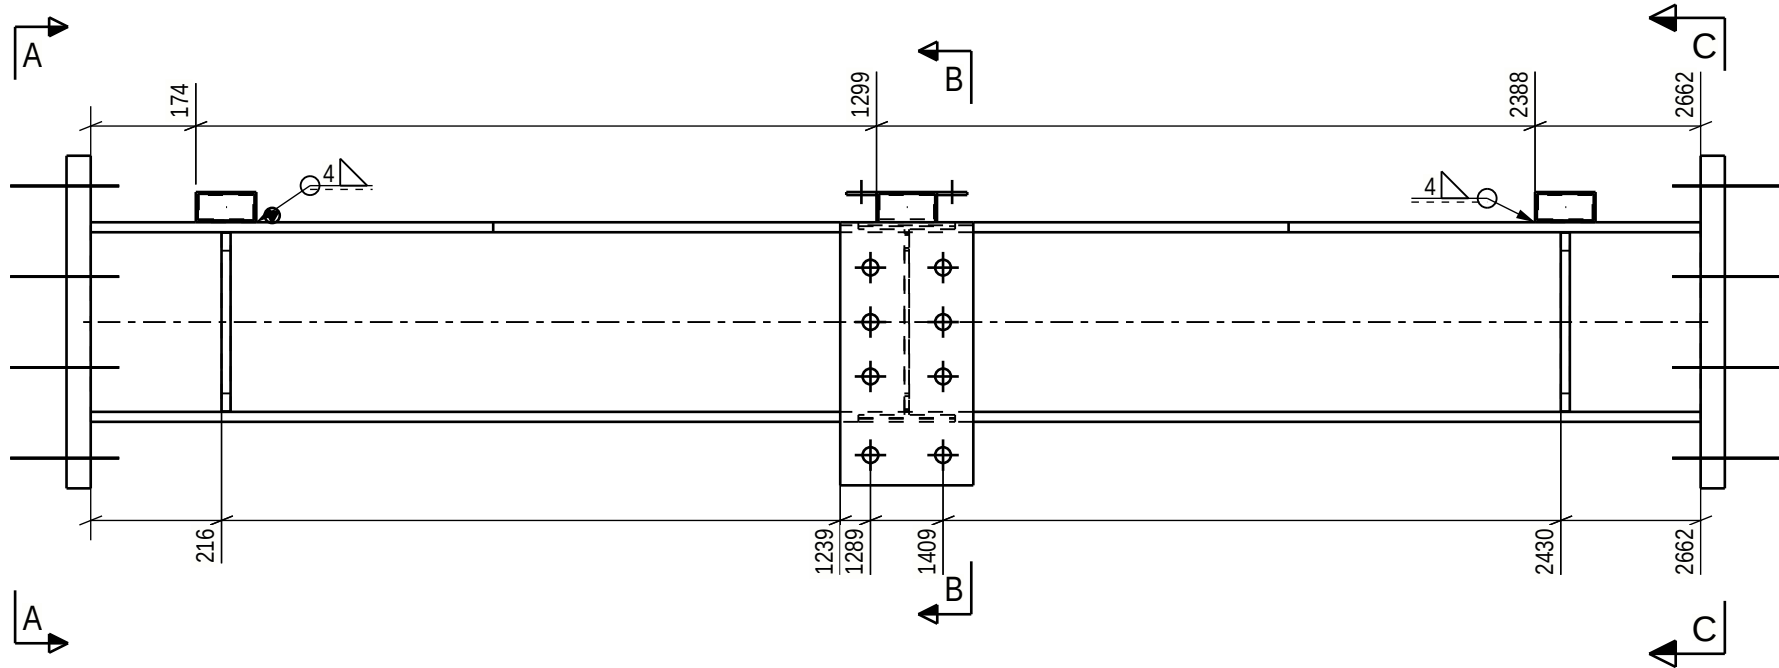


PART LIST FOR ASSEMBLY E51B-1037, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1035	PL20X220	S355J2+N	435	0.22	15.0	1
E51BL-1036	PL8X144	S355J2+N	296	0.09	2.7	1
E51BL-1142	PL40X430	S355J2+N	550	0.55	74.3	1
E51BL-1143	PL40X450	S355J2+N	550	0.58	77.7	1
E51BL-1162	PL5X47	S355J2+N	94	0.02	0.2	2
E51BL-1163	PL5X44	S355J2+N	94	0.04	0.2	4
E51BL-1166	PL15X136	S355J2+N	296	0.37	4.7	4
E51BL-1175	PL5X50	S355J2+N	65	0.02	0.1	2
E51BP-1013	HEA340	S355J2	2662	4.78	278.9	1
E51BP-1165	IPE330	S355J2	470	0.59	23.1	1
E51BP-1166	CFRHS100X50X5	S355J2H	560	0.32	5.9	2
E51BP-1167	CFRHS100X50X5	S355J2H	595	0.17	6.2	1
TOTAL:				7.73	509.7	

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005		Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg.
Surface preparation grade ISO8501-3, grade P2		Weld inspection, requirements EN 1090-2, Table 24, U>0.5
Surface treatment ISO12944-5		Extent of NDT, fillet welds MT-EN1290, 20% of welds
Additional requirements on surface treatment C3.07, EPPUR 240/2		Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds
Shade RAL 7024 (Graphite Gray)		Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds
Welding of built up steel section Appendix 1 / Project spec.		Requirements on holing EN1090-2 Section 6.6.3
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Weld class C, EN ISO 5817
		Additional material inspection Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1






DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1037

SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi


DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Koivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51B-1037		

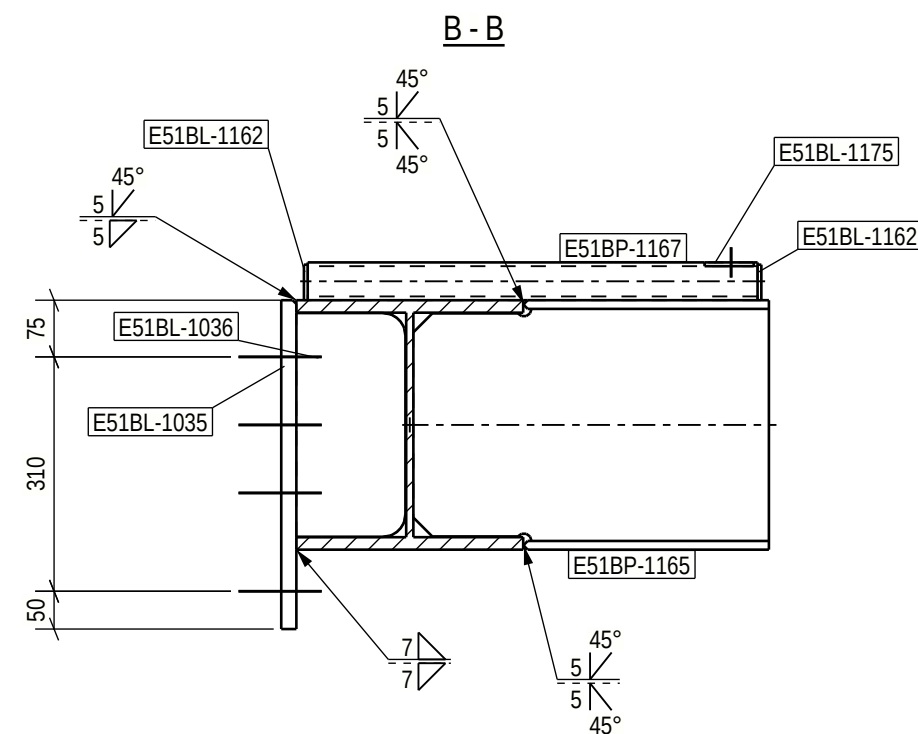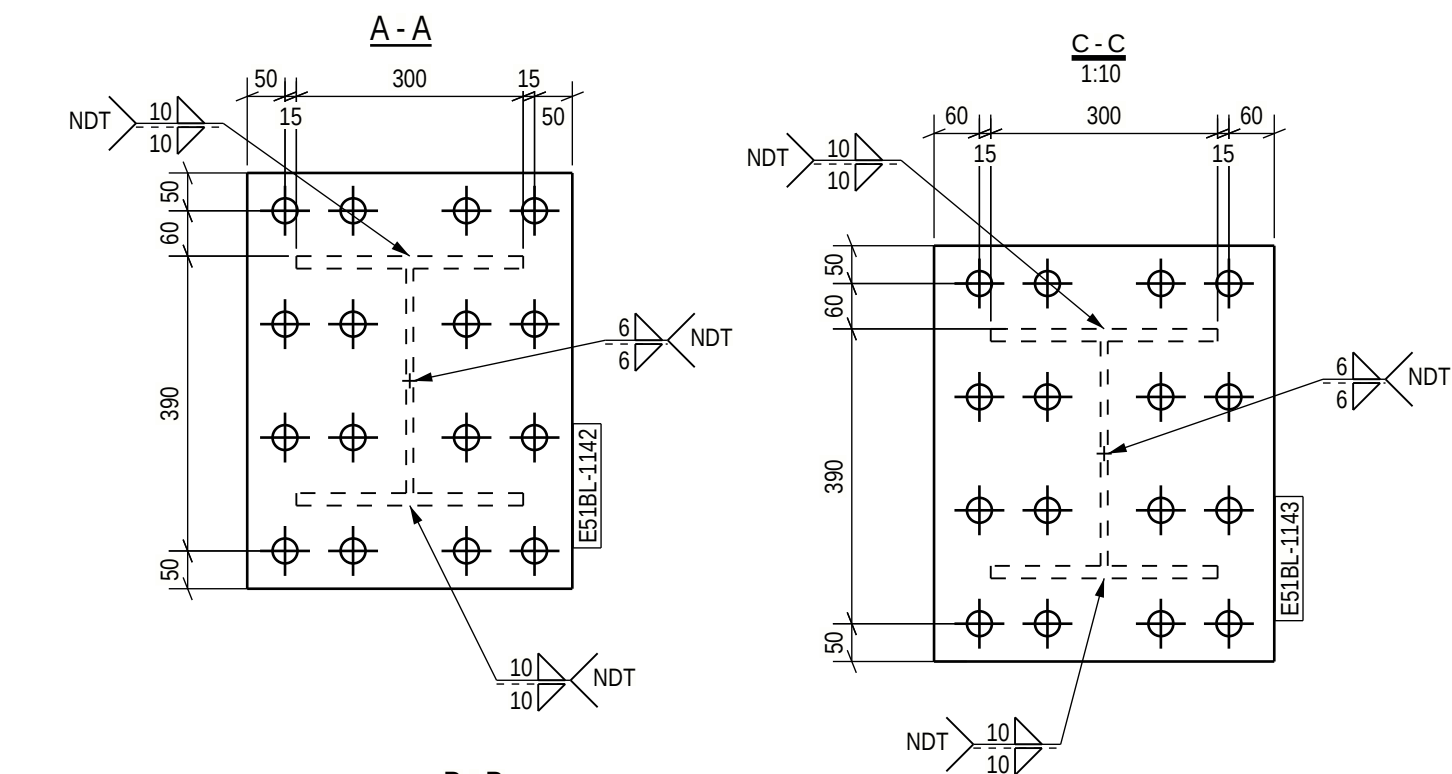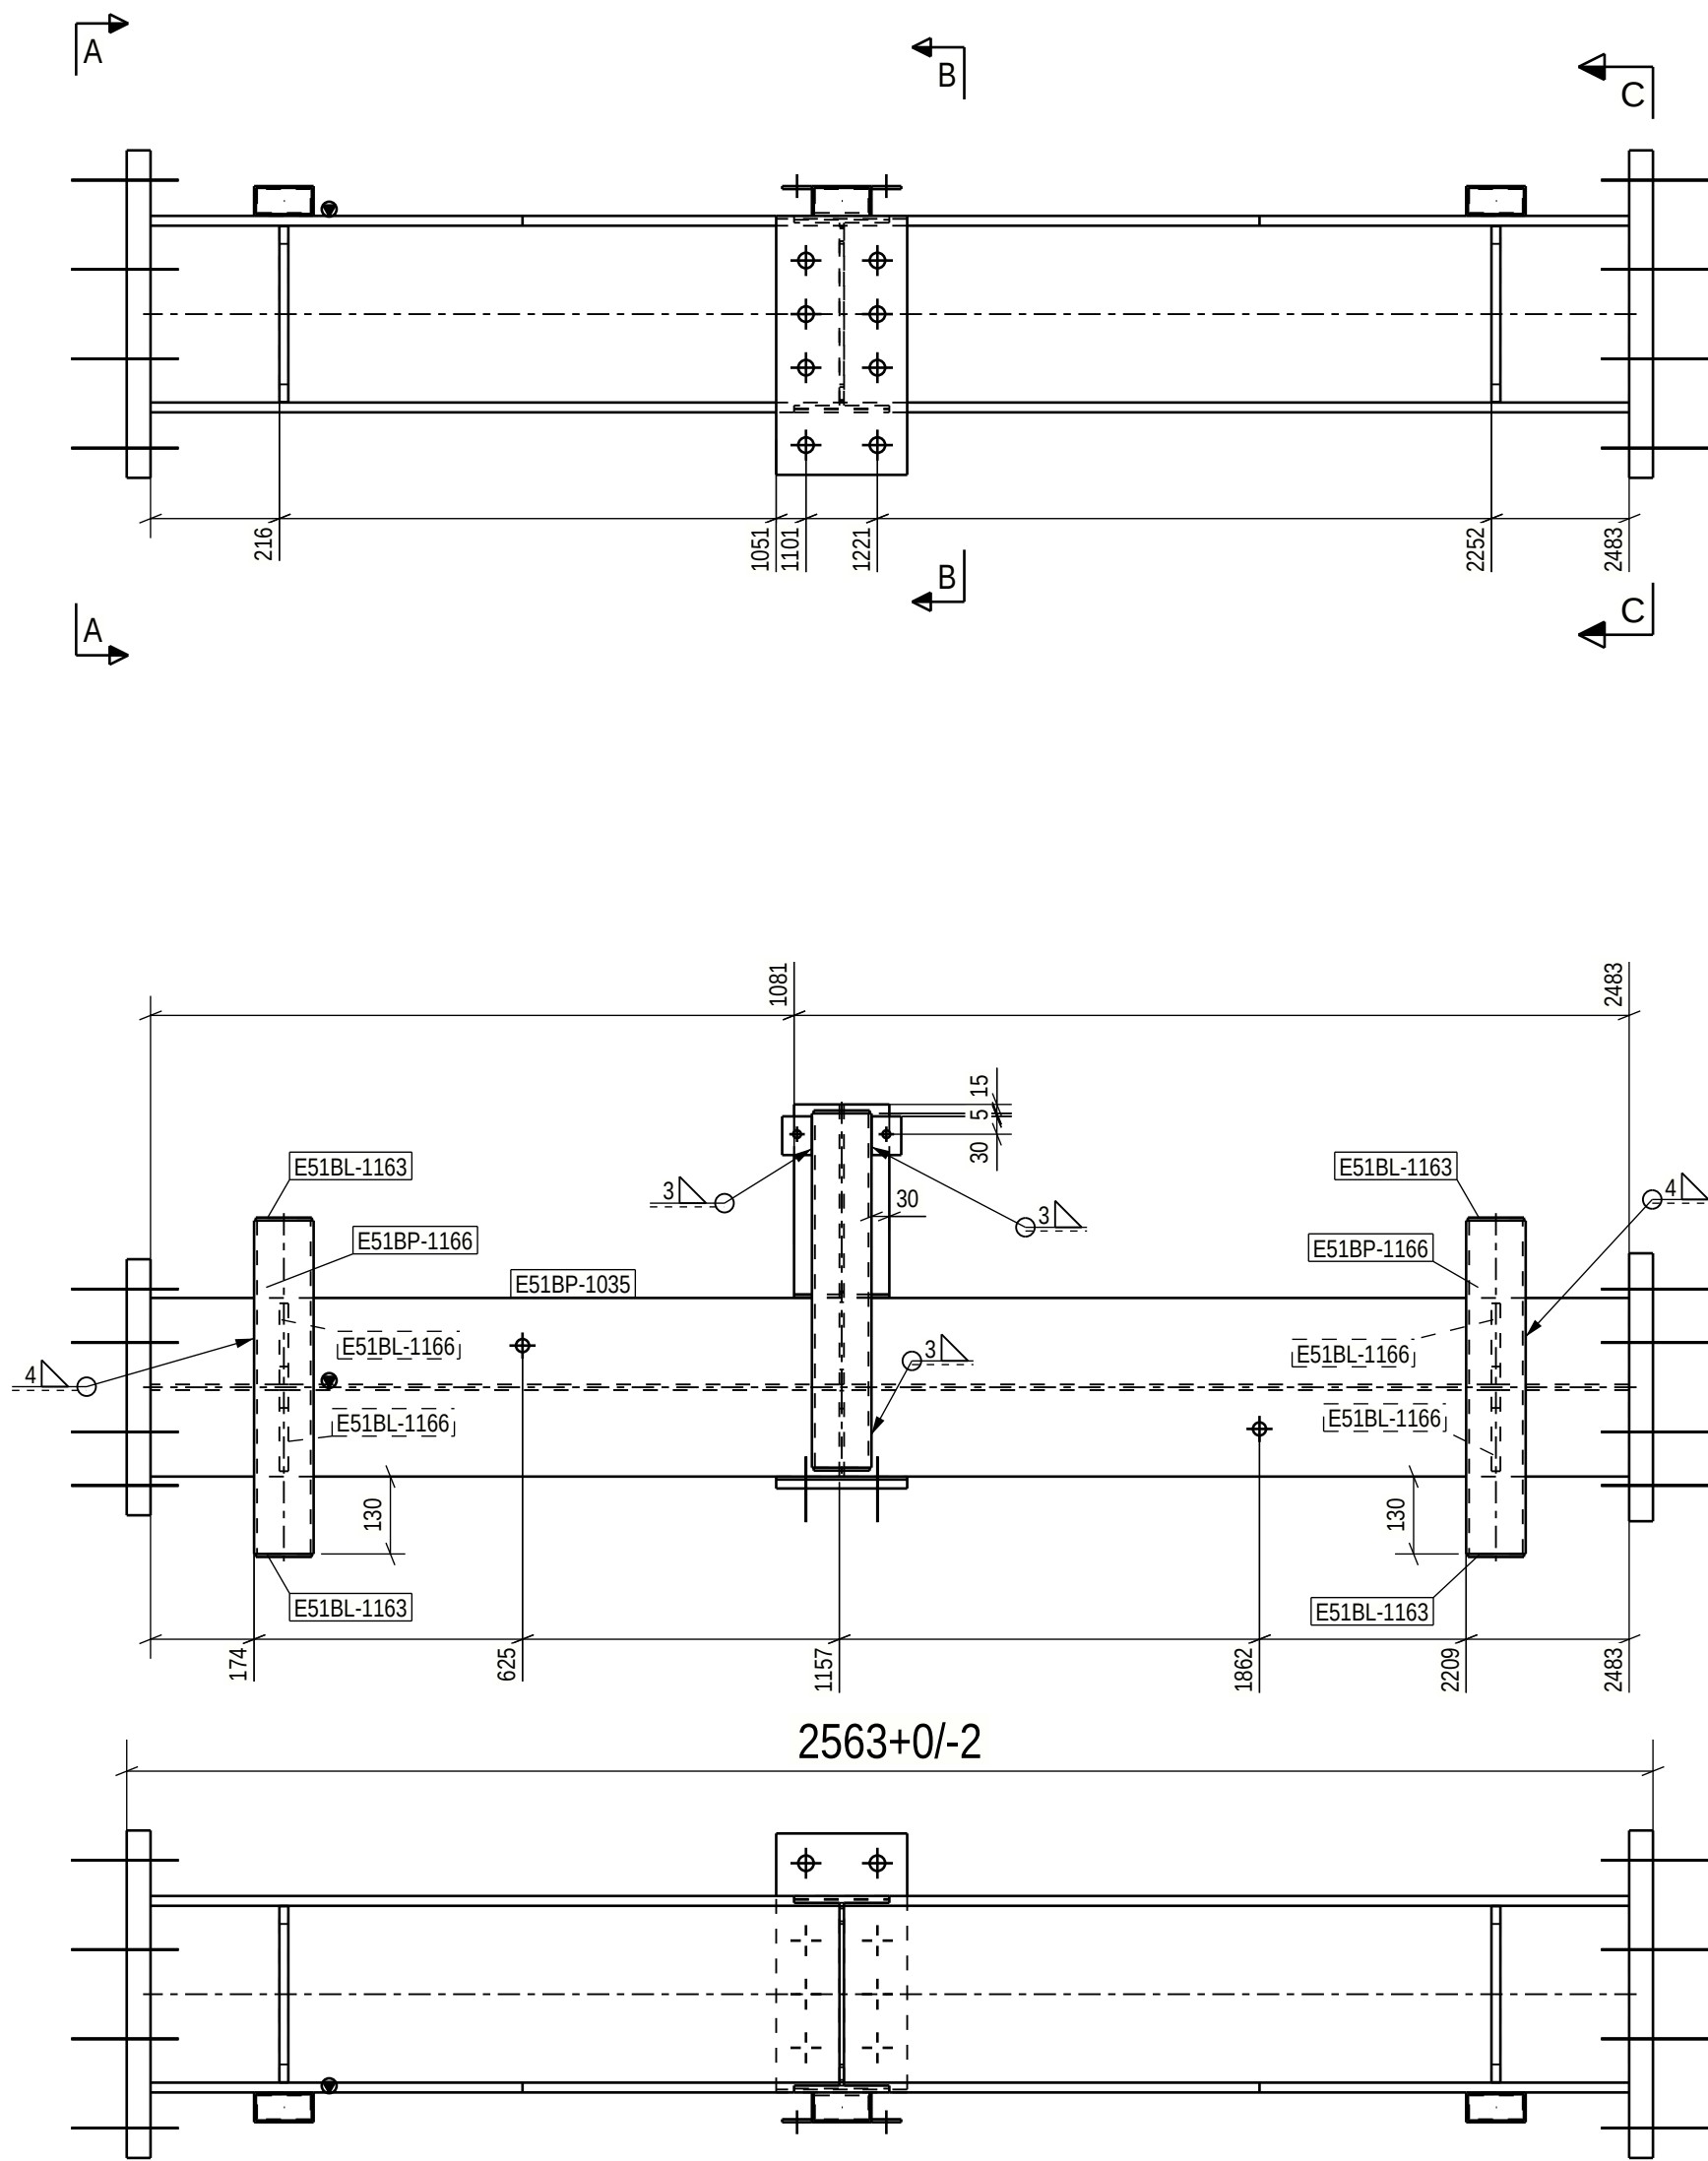


PART LIST FOR ASSEMBLY E51B-1039, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1035	PL20X220	S355J2+N	435	0.22	15.0	1
E51BL-1036	PL8X144	S355J2+N	296	0.09	2.7	1
E51BL-1142	PL40X430	S355J2+N	550	0.55	74.3	1
E51BL-1143	PL40X450	S355J2+N	550	0.58	77.7	1
E51BL-1162	PL5X47	S355J2+N	94	0.02	0.2	2
E51BL-1163	PL5X44	S355J2+N	94	0.04	0.2	4
E51BL-1166	PL15X136	S355J2+N	296	0.37	4.7	4
E51BL-1175	PL5X50	S355J2+N	65	0.02	0.1	2
E51BP-1035	HEA340	S355J2	2483	4.46	260.2	1
E51BP-1165	IPE330	S355J2	470	0.59	23.1	1
E51BP-1166	CFRHS100X50X5	S355J2H	560	0.32	5.9	2
E51BP-1167	CFRHS100X50X5	S355J2H	595	0.17	6.2	1
TOTAL:				7.41	491.0	

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3: EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005		Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg.
Surface preparation grade ISO8501-3, grade P2		Weld inspection, requirements EN 1090-2, Table 24, U>0.5
Surface treatment ISO12944-5		Extent of NDT, fillet welds MT-EN1290, 20% of welds
Additional requirements on surface treatment C3.07, EPPUR 240/2		Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds
Shade RAL 7024 (Graphite Gray)		Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds
Welding of built up steel section Appendix 1 / Project spec.		Requirements on holing EN1090-2 Section 6.6.3
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Weld class C, EN ISO 5817
		Additional material inspection Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME Easpring New Materials Oy FAIR Phase 1		 		DRAWING CONTENT ASSEMBLY DRAWING Beam E51B-1039			
 Sustainable engineering and design		SWECO RAKENNETEKNIikka OY ILMALANPORTTI 2 00240 HELSINKI		DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
		PUH. +358 207 393 000 www.sweco.fi		DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kallosalmi
				PROJECT NUMBER 25019443		DWG. NO. E51B-1039	

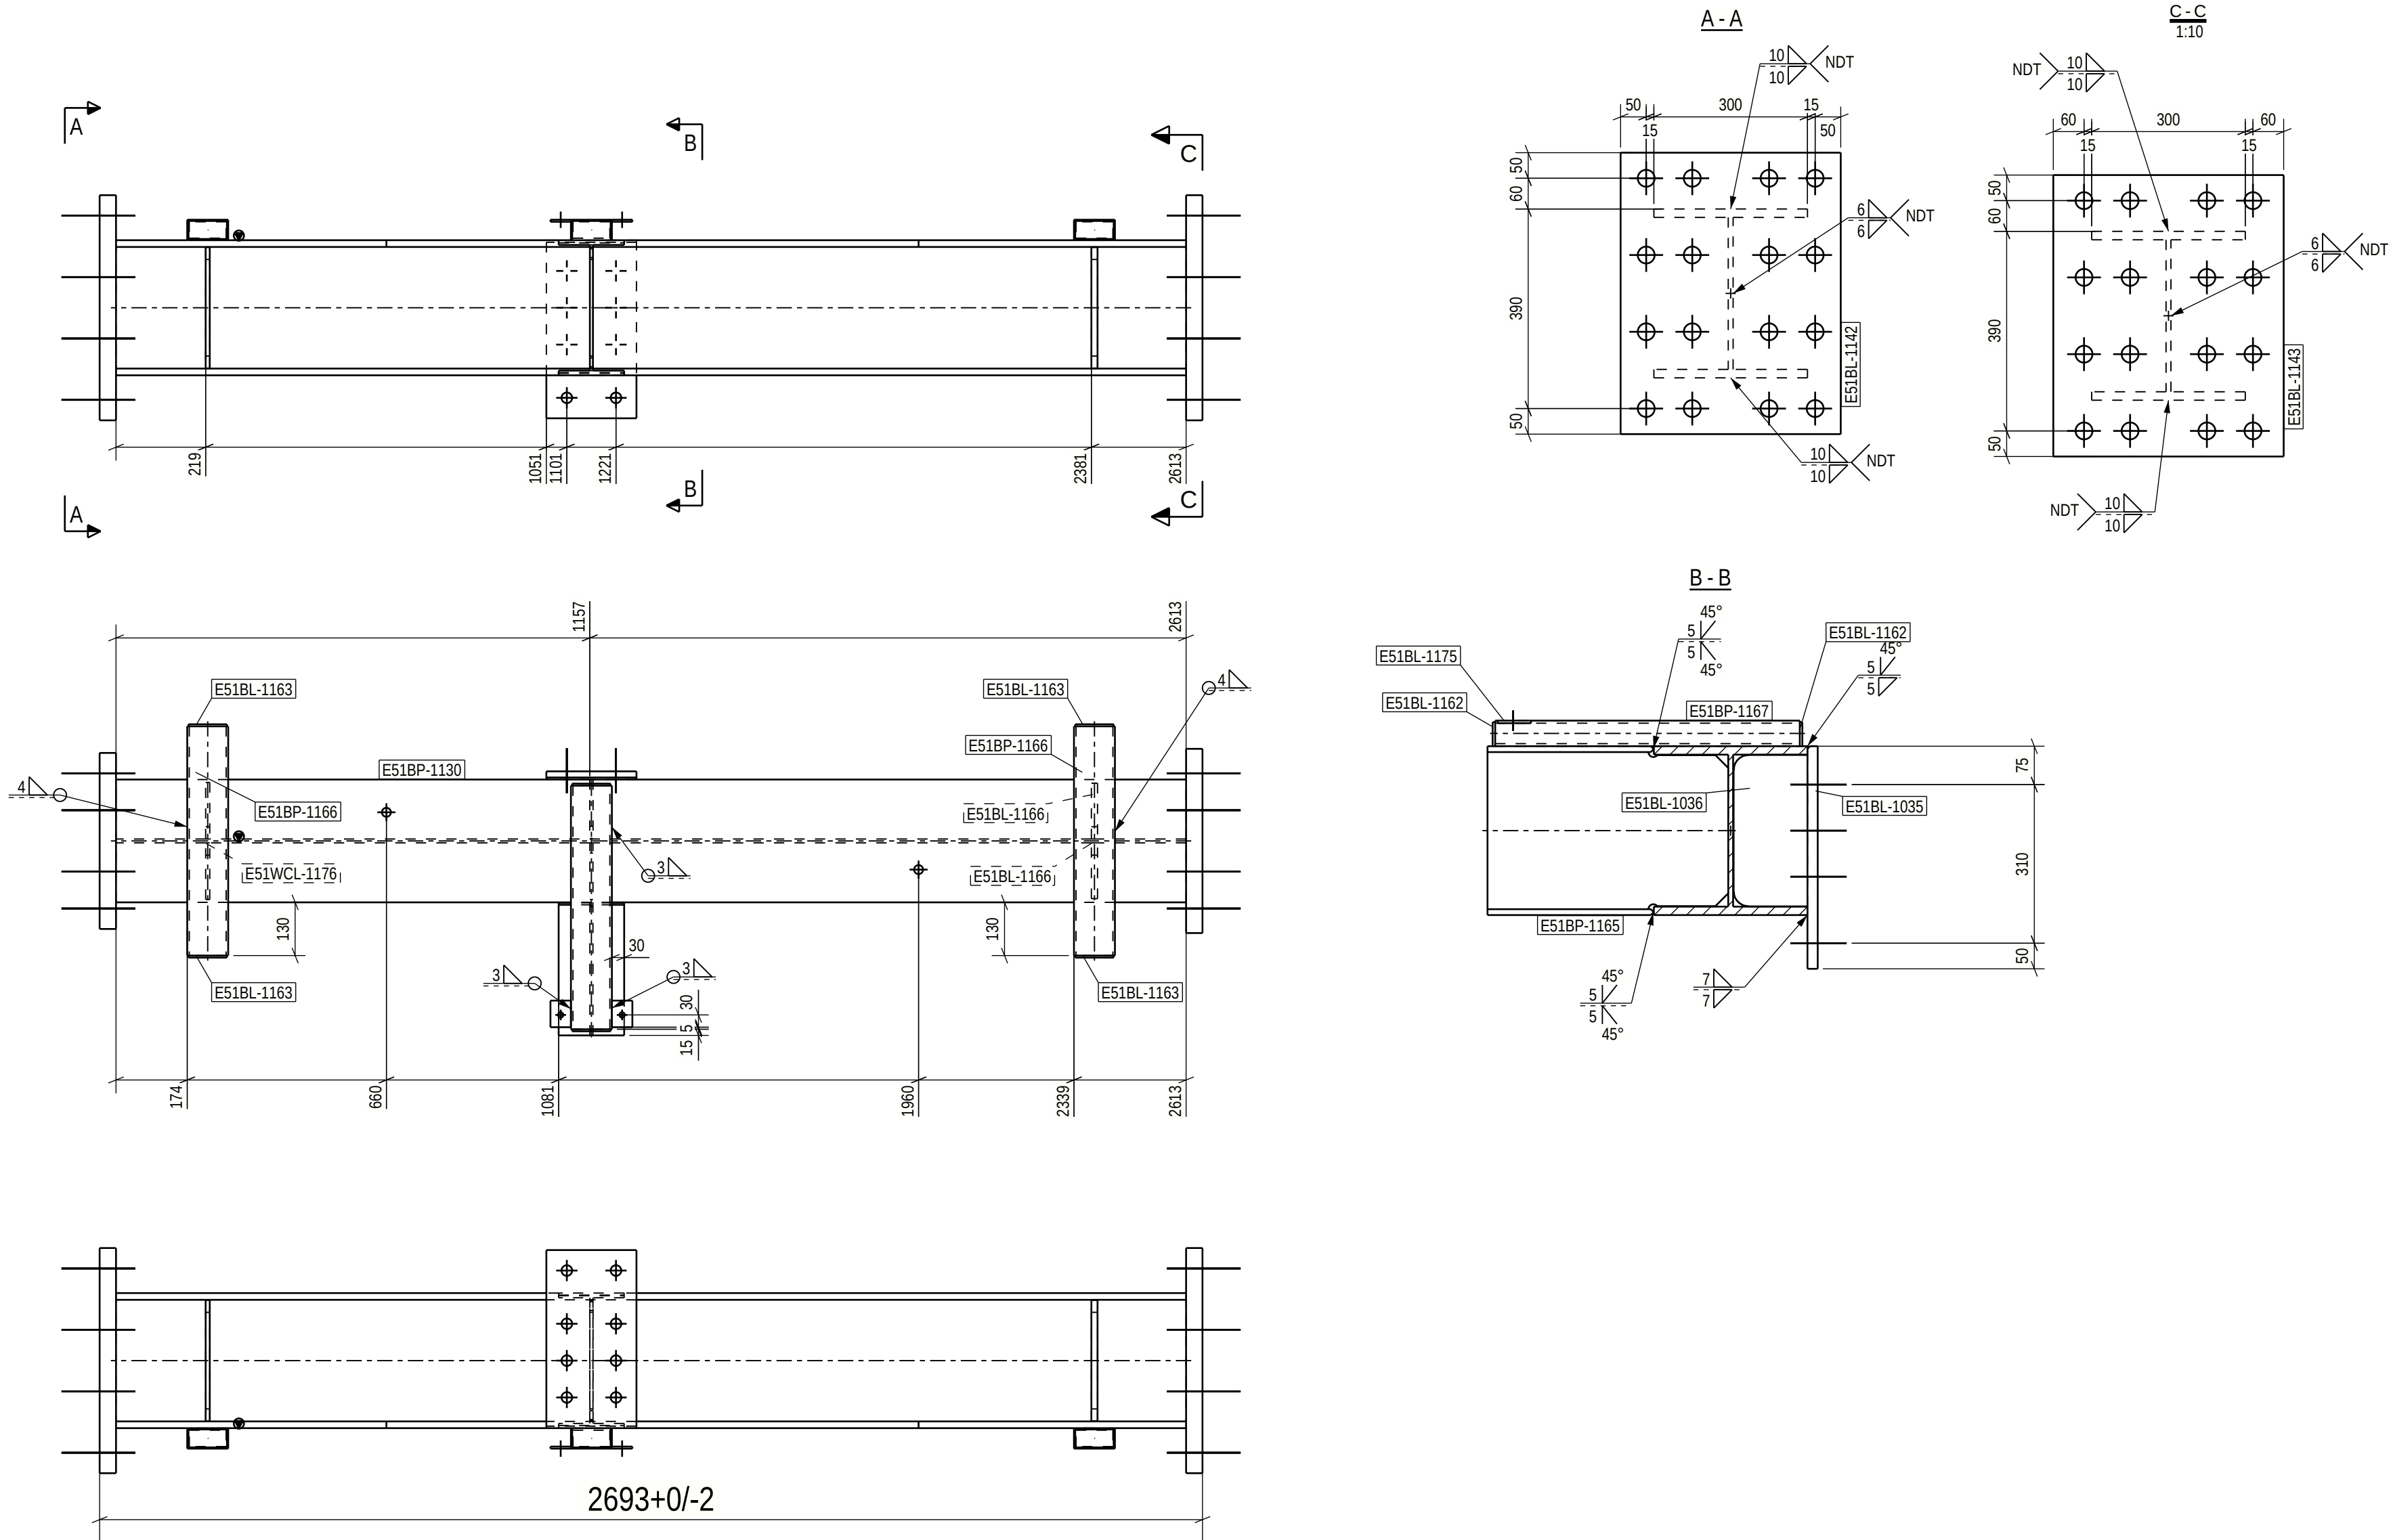

PART LIST FOR ASSEMBLY E51B-1040, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1035	PL20X220	S355J2+N	435	0.22	15.0	1
E51BL-1036	PL8X144	S355J2+N	296	0.09	2.7	1
E51BL-1142	PL40X430	S355J2+N	550	0.55	74.3	1
E51BL-1143	PL40X450	S355J2+N	550	0.58	77.7	1
E51BL-1162	PL5X47	S355J2+N	94	0.02	0.2	2
E51BL-1163	PL5X44	S355J2+N	94	0.04	0.2	4
E51BL-1166	PL15X136	S355J2+N	296	0.18	4.7	2
E51BL-1175	PL5X50	S355J2+N	65	0.02	0.1	2
E51BP-1130	HEA340	S355J2	2613	4.69	273.8	1
E51BP-1165	IPE330	S355J2	470	0.59	23.1	1
E51BP-1166	CFRHS100X50X5	S355J2H	560	0.32	5.9	2
E51BP-1167	CFRHS100X50X5	S355J2H	595	0.17	6.2	1
E51WCL-1176	PL10X138	S355J2+N	296	0.18	3.2	2
TOTAL:				7.64	501.6	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard

EN1090-2, table A.3 : EXC2

Execution Specification document nr

25019443-ICC250-0600-0660-000005

Surface preparation grade

ISO8501-3, grade P2

Surface treatment

ISO12944-5

Additional requirements on surface treatment

C3.07, EPPUR 240/2

Shade

RAL 7024 (Graphite Gray)

Welding of built up steel section

Appendix 1 / Project spec.

Welds, if not specified otherwise

EN 9692-1, EN 9692-2

Fabrication tolerances

EN 1090-2, Appendix B

Special fabrication tolerances

Project specification/ shown on drwg.

Weld inspection, requirements

EN 1090-2, Table 24, U>0.5

Extent of NDT, fillet welds

MT-EN1290, 20% of welds

Extent of NDT, butt welds

UT, EN-ISO17640, 20% of welds

Extent of NDT for splices not shown on drawing

UT, EN-ISO17640, 100% of welds

Requirements on holing

EN1090-2 Section 6.6.3

Weld class

C, EN ISO 5817

Additional material inspection

Shown on drwg.

PROJECT NAME

Easpring New Materials Oy

FAIR Phase 1

DRAWING CONTENT

ASSEMBLY DRAWING

Beam

E51B-1040

DATE

16.06.2026

ARCHIVING CODE

PAGE

DESIGN GROUP

STR

DRAWN

Alexey Serous

DESIGNER

Alexey Serous

APPROVED

Pertti Koivumaa

CHECKED

Jere Kallosalmi

REVISION

PROJECT NUMBER

25019443

DATE

16.06.2026

ARCHIVING CODE

PAGE

DESIGN GROUP

STR

SWECO

Sustainable engineering and design

SWECO RAKENNTEKNIikka OY

ILMALANPORTTI 2

00240 HELSINKI

PUH. +358 207 393 000

www.sweco.fi

DATE

16.06.2026

ARCHIVING CODE

PAGE

DESIGN GROUP

STR

DRAWN

Alexey Serous

DESIGNER

Alexey Serous

APPROVED

Pertti Koivumaa

CHECKED

Jere Kallosalmi

REVISION

PROJECT NUMBER

25019443

DATE

16.06.2026

ARCHIVING CODE

PAGE

DESIGN GROUP

STR

SWECO

Sustainable engineering and design

SWECO RAKENNTEKNIikka OY

ILMALANPORTTI 2

00240 HELSINKI

PUH. +358 207 393 000

www.sweco.fi

DATE

16.06.2026

ARCHIVING CODE

PAGE

DESIGN GROUP

STR

DRAWN

Alexey Serous

DESIGNER

Alexey Serous

APPROVED

Pertti Koivumaa

CHECKED

Jere Kallosalmi

REVISION

PROJECT NUMBER

25019443

DATE

16.06.2026

ARCHIVING CODE

PAGE

DESIGN GROUP

STR

SWECO

Sustainable engineering and design

SWECO RAKENNTEKNIikka OY






ILMALANPORTTI 2

00240 HELSINKI

PUH. +358 207 393 000

www.sweco.fi


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

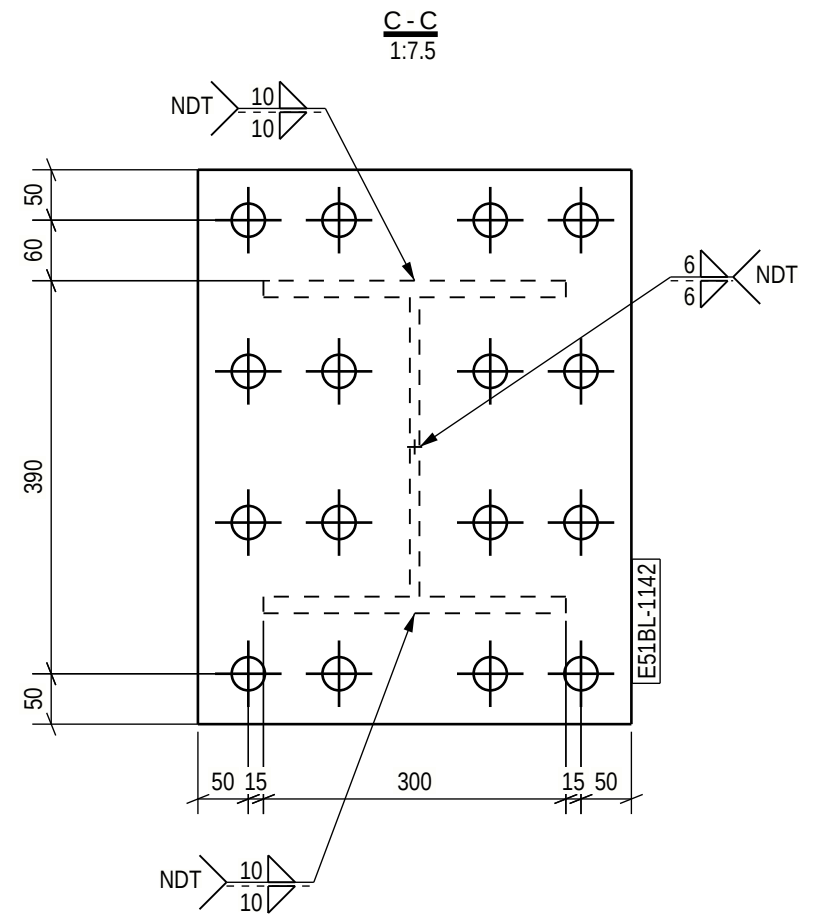
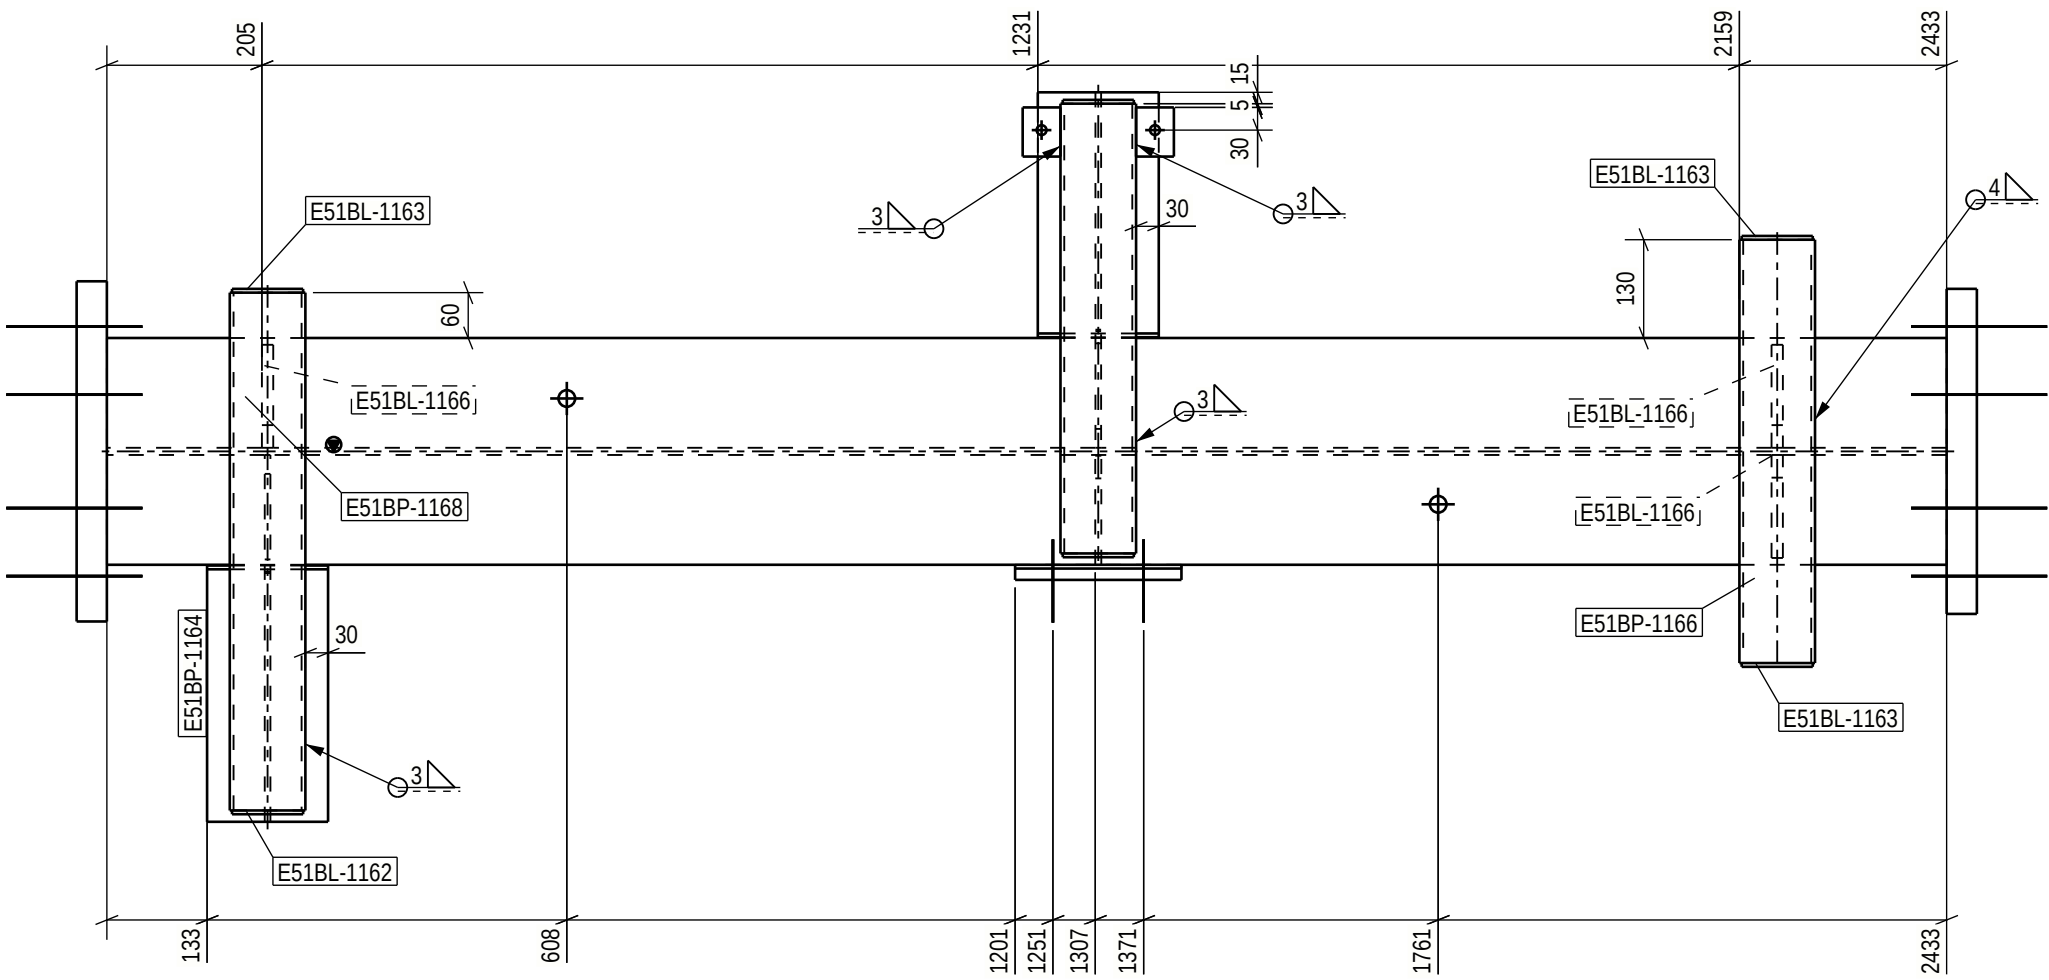
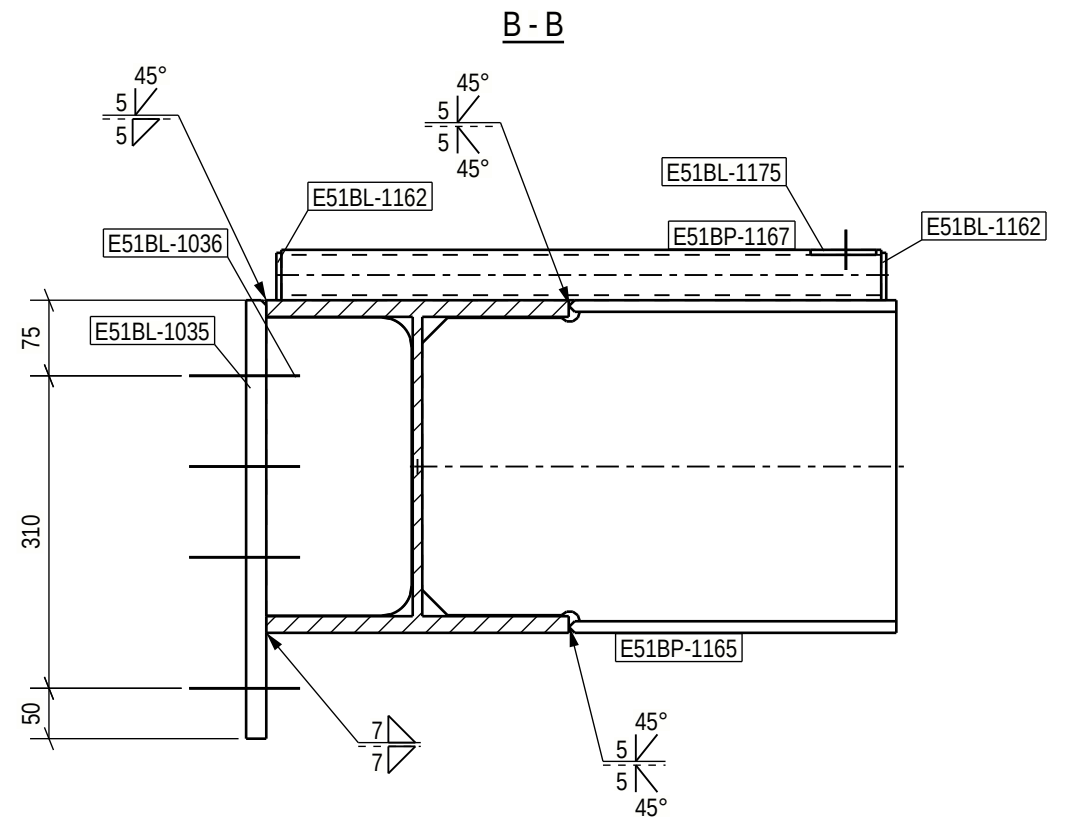
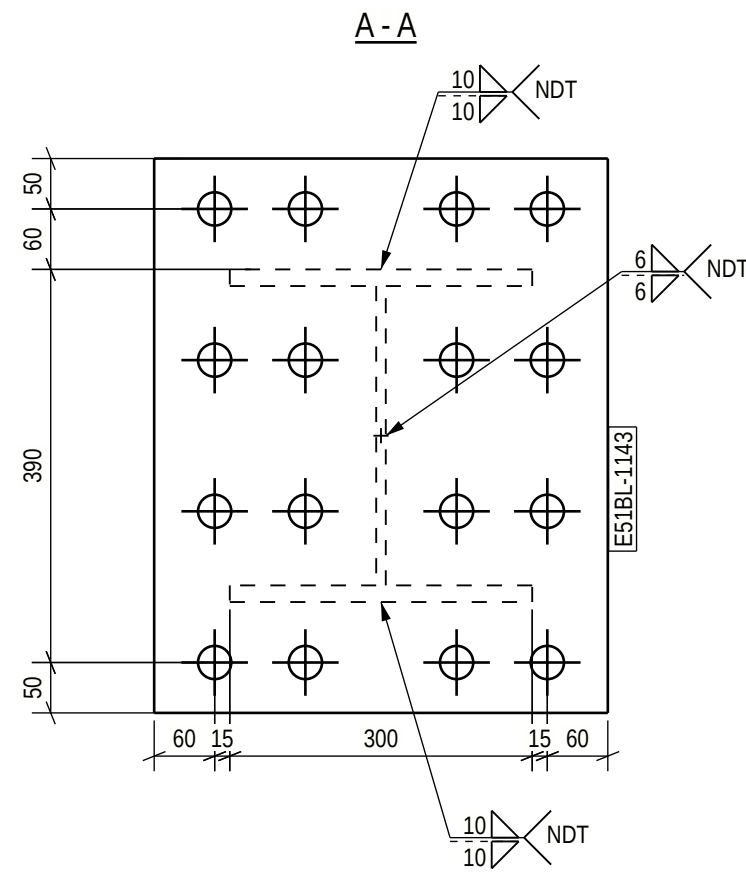
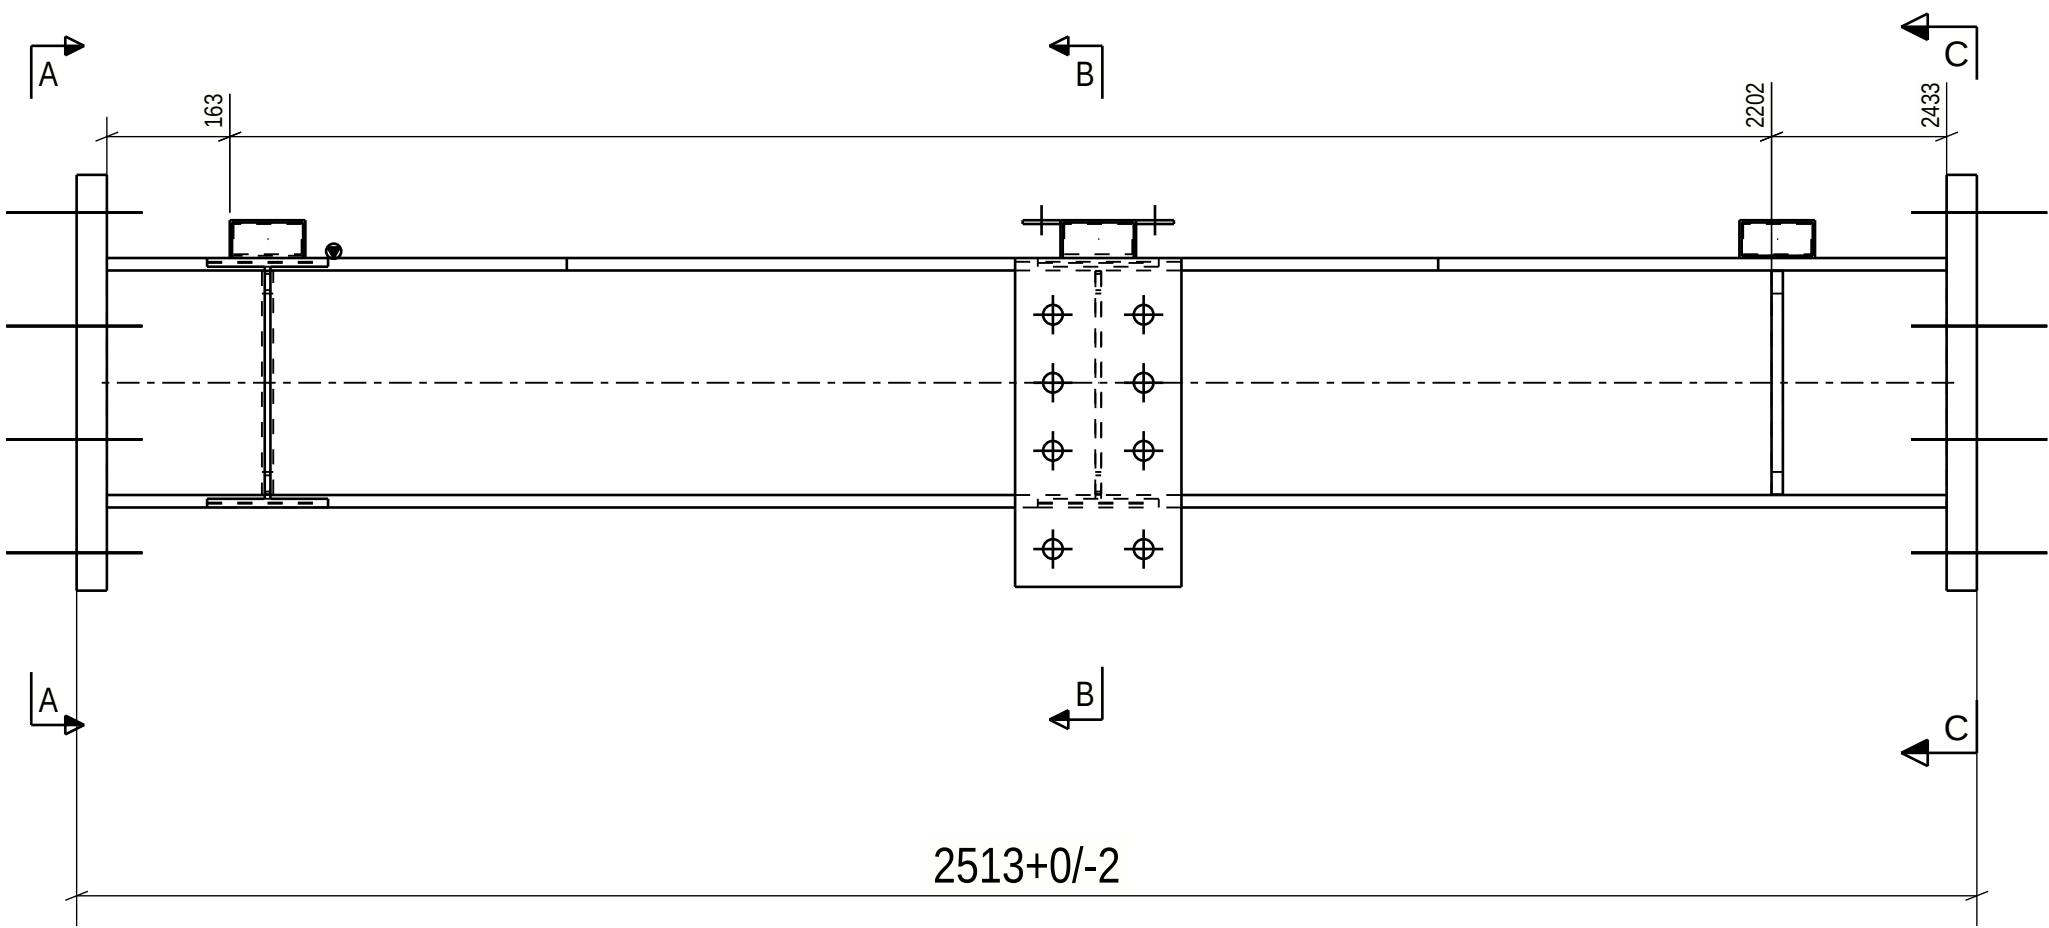


PART LIST FOR ASSEMBLY E51B-1041, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1035	PL20X220	S355J2+N	435	0.22	15.0	1
E51BL-1036	PL8X144	S355J2+N	296	0.09	2.7	1
E51BL-1142	PL40X430	S355J2+N	550	0.55	74.3	1
E51BL-1143	PL40X450	S355J2+N	550	0.58	77.7	1
E51BL-1162	PL5X47	S355J2+N	94	0.03	0.2	3
E51BL-1163	PL5X44	S355J2+N	94	0.03	0.2	3
E51BL-1166	PL15X136	S355J2+N	296	0.28	4.7	3
E51BL-1175	PL5X50	S355J2+N	65	0.02	0.1	2
E51BP-1129	HEA340	S355J2	2433	4.37	255.0	1
E51BP-1164	IPE330	S355J2	485	0.61	23.8	1
E51BP-1165	IPE330	S355J2	470	0.59	23.1	1
E51BP-1166	CFRHS100X50X5	S355J2H	560	0.16	5.9	1
E51BP-1167	CFRHS100X50X5	S355J2H	595	0.17	6.2	1
E51BP-1168	CFRHS100X50X5	S355J2H	685	0.19	7.2	1
TOTAL:				7.87	506.3	

Technical fabrication requirements:		Execution class
		EXC2
Requirements for fabrication, standard	Fabrication tolerances	
EN1090-2, table A.3 : EXC2	EN 1090-2, Appendix B	
Execution Specification document nr	Special fabrication tolerances	
25019443-ICC250-0600-0660-000005	Project specification/ shown on drwg.	
Surface preparation grade	Weld inspection, requirements	
ISO8501-3, grade P2	EN 1090-2, Table 24, U>0.5	
Surface treatment	Extent of NDT, fillet welds	
ISO12944-5	MT-EN1290, 20% of welds	
Additional requirements on surface treatment	Extent of NDT, butt welds	
C3.07, EPPUR 240/2	UT, EN-ISO17640, 20% of welds	
Shade	Extent of NDT for splices not shown on drawing	
RAL 7024 (Graphite Gray)	UT, EN-ISO17640, 100% of welds	
Welding of built up steel section	Requirements on holing	
Appendix 1 / Project spec.	EN1090-2 Section 6.6.3	
Welds, if not specified otherwise	Weld class	Additional material inspection
EN 9692-1, EN 9692-2	C, EN ISO 5817	Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME				DRAWING CONTENT							
Easpring New Materials Oy FAIR Phase 1				ASSEMBLY DRAWING							
				Beam							
				E51B-1041							
 SWECO Sustainable engineering and design		SWECO RAKENNETEKNIikka OY ILMALANPORTTI 2 00240 HELSINKI		DATE 16.06.2026		ARCHIVING CODE		PAGE		DESIGN GROUP STR	
		PUH. +358 207 393 000 www.sweco.fi		DRAWN Alexey Serous		DESIGNER Alexey Serous		APPROVED Pertti Kivumaaanaho		CHECKED Jere Kalliosalmi	
				PROJECT NUMBER		DWG. NO.		REVISION			
				25019443		E51B-1041					

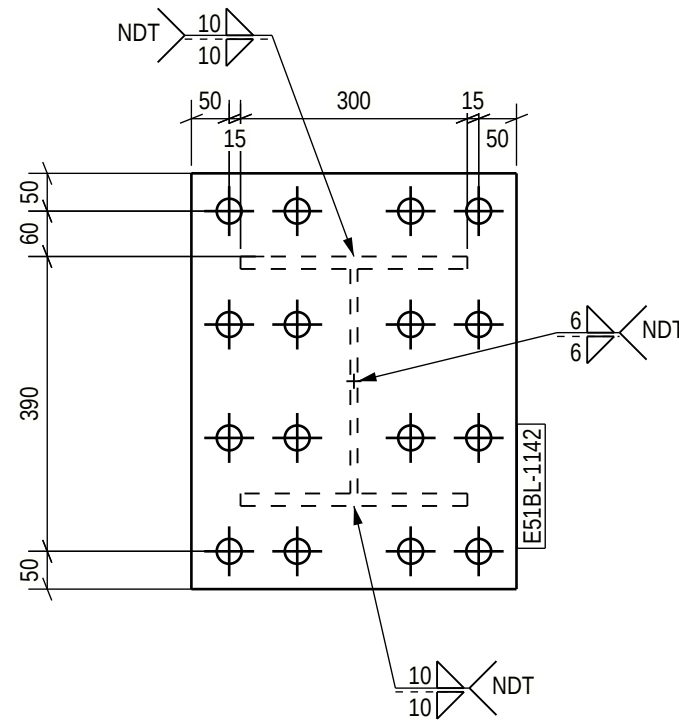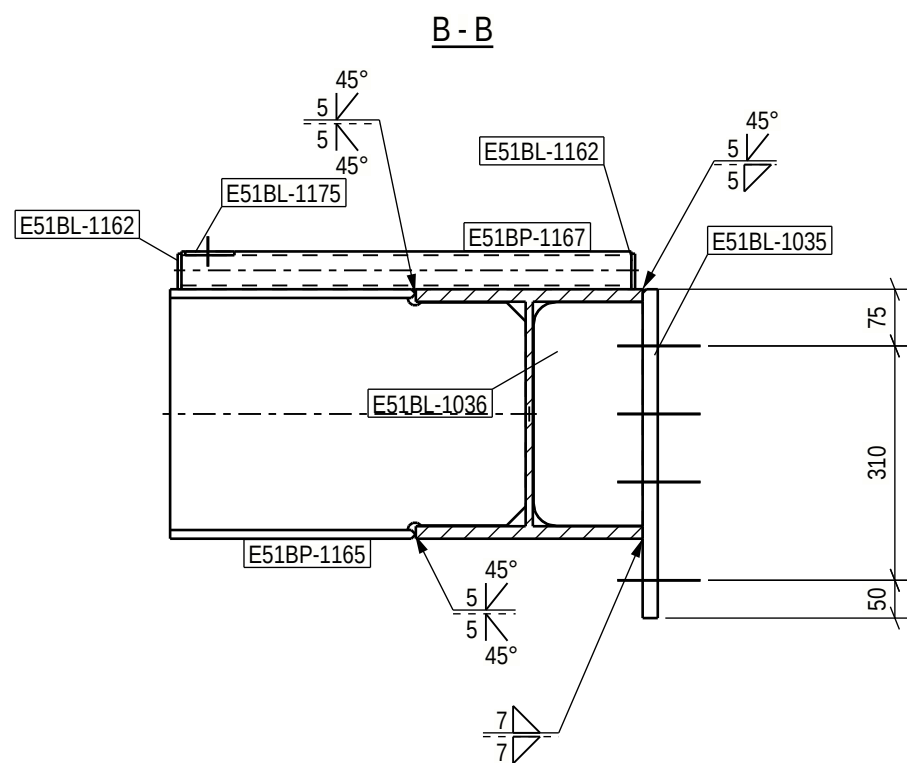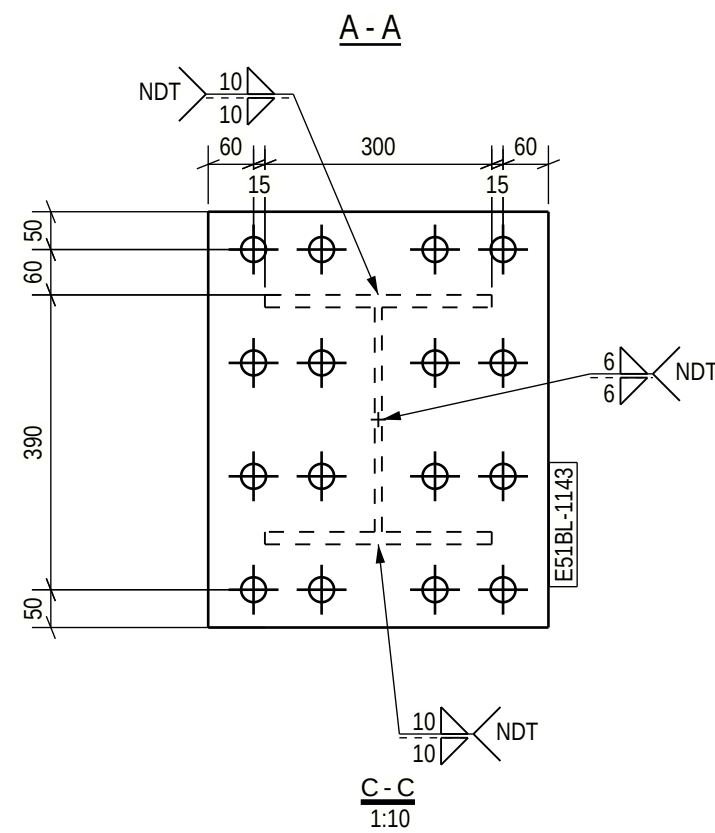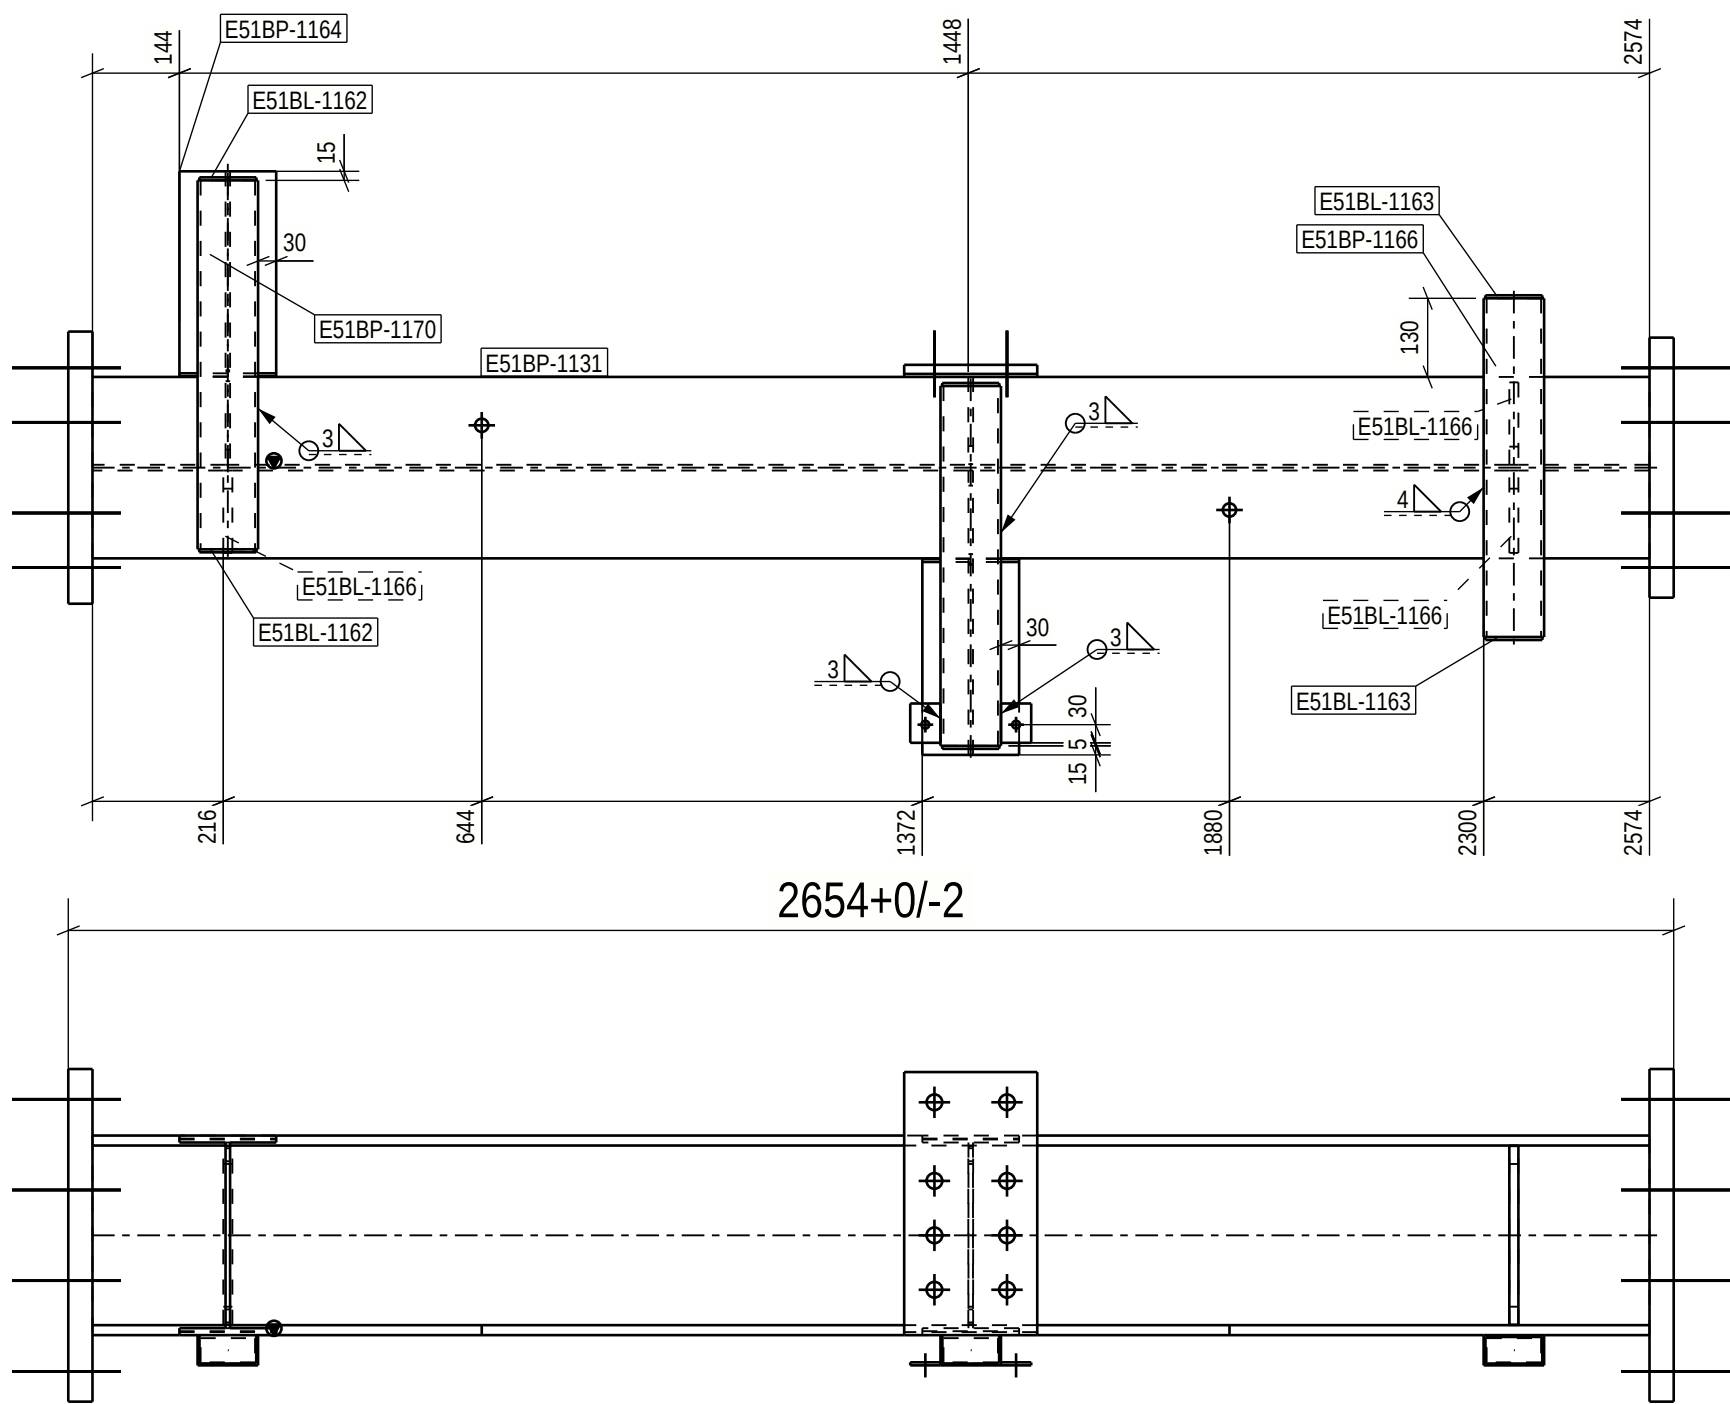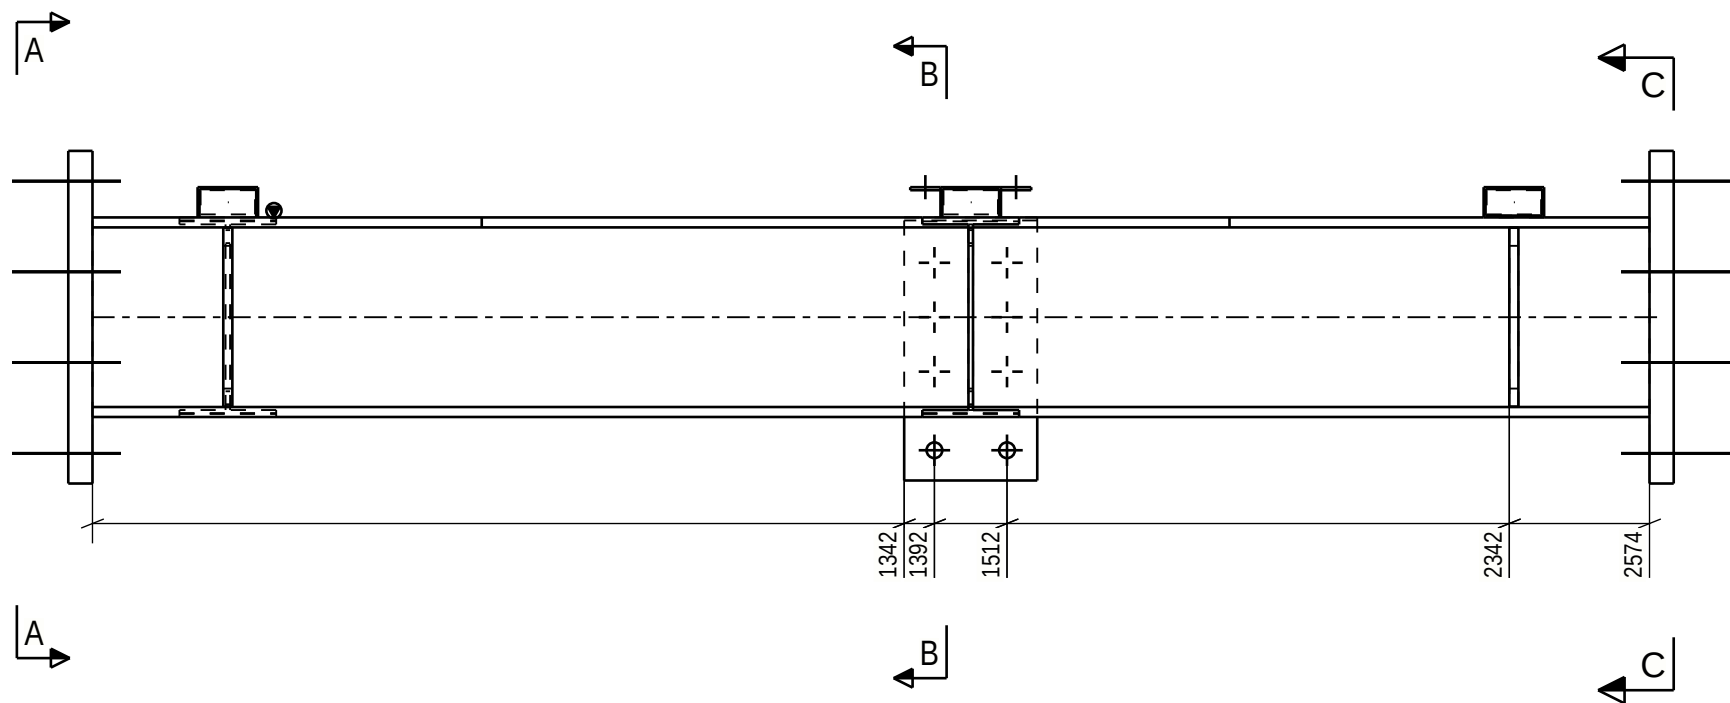

PART LIST FOR ASSEMBLY E51B-1042, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1035	PL20X220	S355J2+N	435	0.22	15.0	1
E51BL-1036	PL8X144	S355J2+N	296	0.09	2.7	1
E51BL-1142	PL40X430	S355J2+N	550	0.55	74.3	1
E51BL-1143	PL40X450	S355J2+N	550	0.58	77.7	1
E51BL-1162	PL5X47	S355J2+N	94	0.04	0.2	4
E51BL-1163	PL5X44	S355J2+N	94	0.02	0.2	2
E51BL-1166	PL15X136	S355J2+N	296	0.28	4.7	3
E51BL-1175	PL5X50	S355J2+N	65	0.02	0.1	2
E51BP-1131	HEA340	S355J2	2574	4.62	269.8	1
E51BP-1164	IPE330	S355J2	485	0.61	23.8	1
E51BP-1165	IPE330	S355J2	470	0.59	23.1	1
E51BP-1166	CFRHS100X50X5	S355J2H	560	0.16	5.9	1
E51BP-1167	CFRHS100X50X5	S355J2H	595	0.17	6.2	1
E51BP-1170	CFRHS100X50X5	S355J2H	610	0.17	6.4	1
TOTAL:				8.11	520.3	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard
EN1090-2, table A.3 : EXC2
Execution Specification document nr
25019443-ICC250-0600-0660-000005

Fabrication tolerances
EN 1090-2, Appendix B
Special fabrication tolerances
Project specification/ shown on drwg.

Surface preparation grade
ISO8501-3, grade P2

Weld inspection, requirements
EN 1090-2, Table 24, U>0.5

Surface treatment
ISO12944-5

Extent of NDT, fillet welds
MT-EN1290, 20% of welds

Additional requirements on surface treatment
C3.07, EPPUR 240/2

Extent of NDT for splices not shown on drawing
UT, EN-ISO17640, 20% of welds

Shade
RAL 7024 (Graphite Gray)

UT, EN-ISO17640, 100% of welds

Welding of built up steel section
Appendix 1 / Project spec.

EN1090-2 Section 6.6.3

Welds, if not specified otherwise
EN 9692-1, EN 9692-2

Weld class
C, EN ISO 5817

Additional material inspection
Shown on drwg.

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1042

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Kivumaa	CHECKED Jere Kallosalmi
PROJECT NUMBER 25019443		REVISION E51B-1042	

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction


25019443_Fair_E500

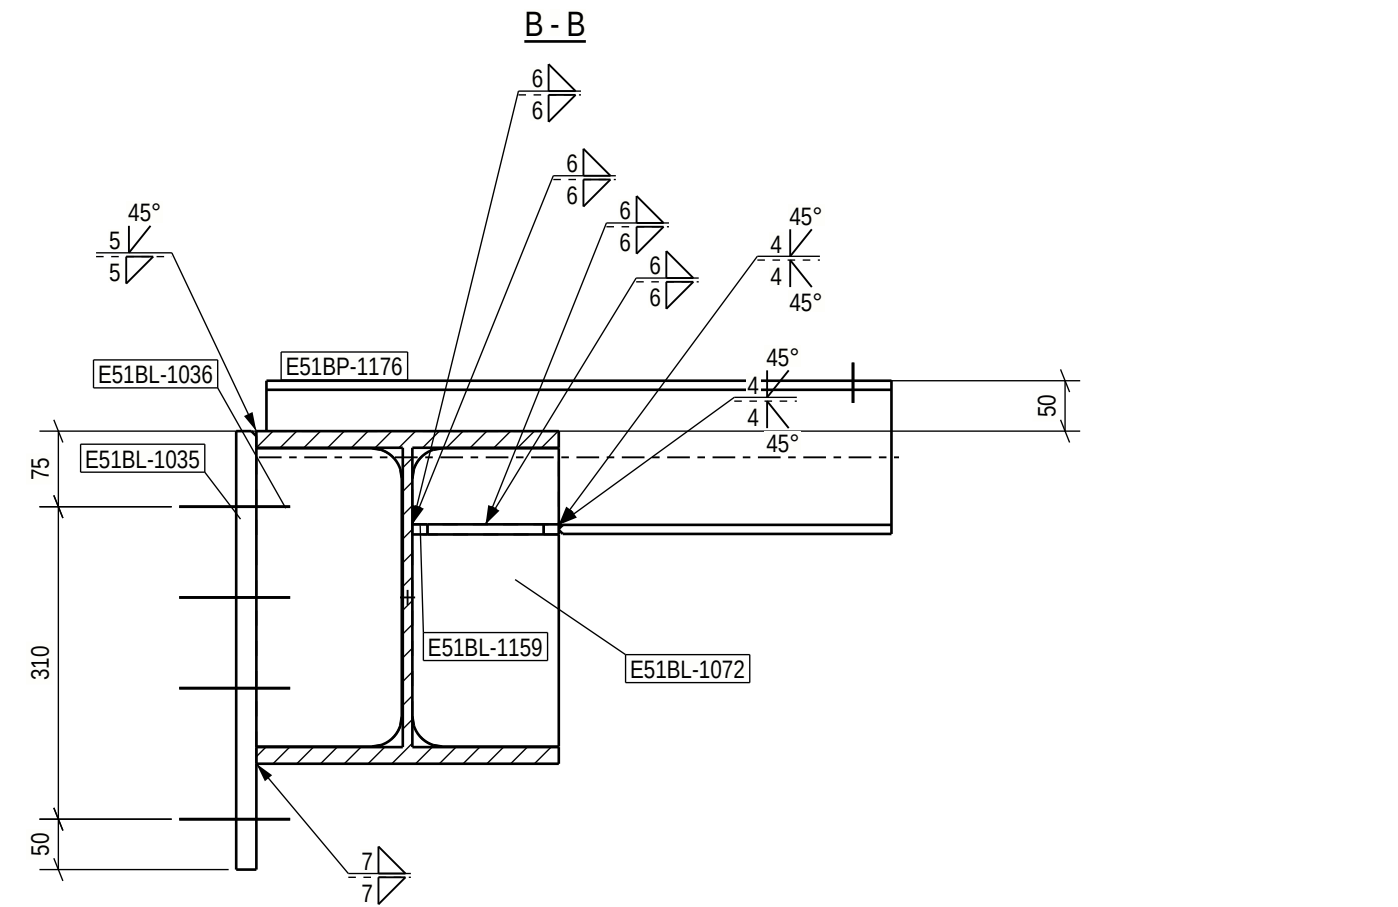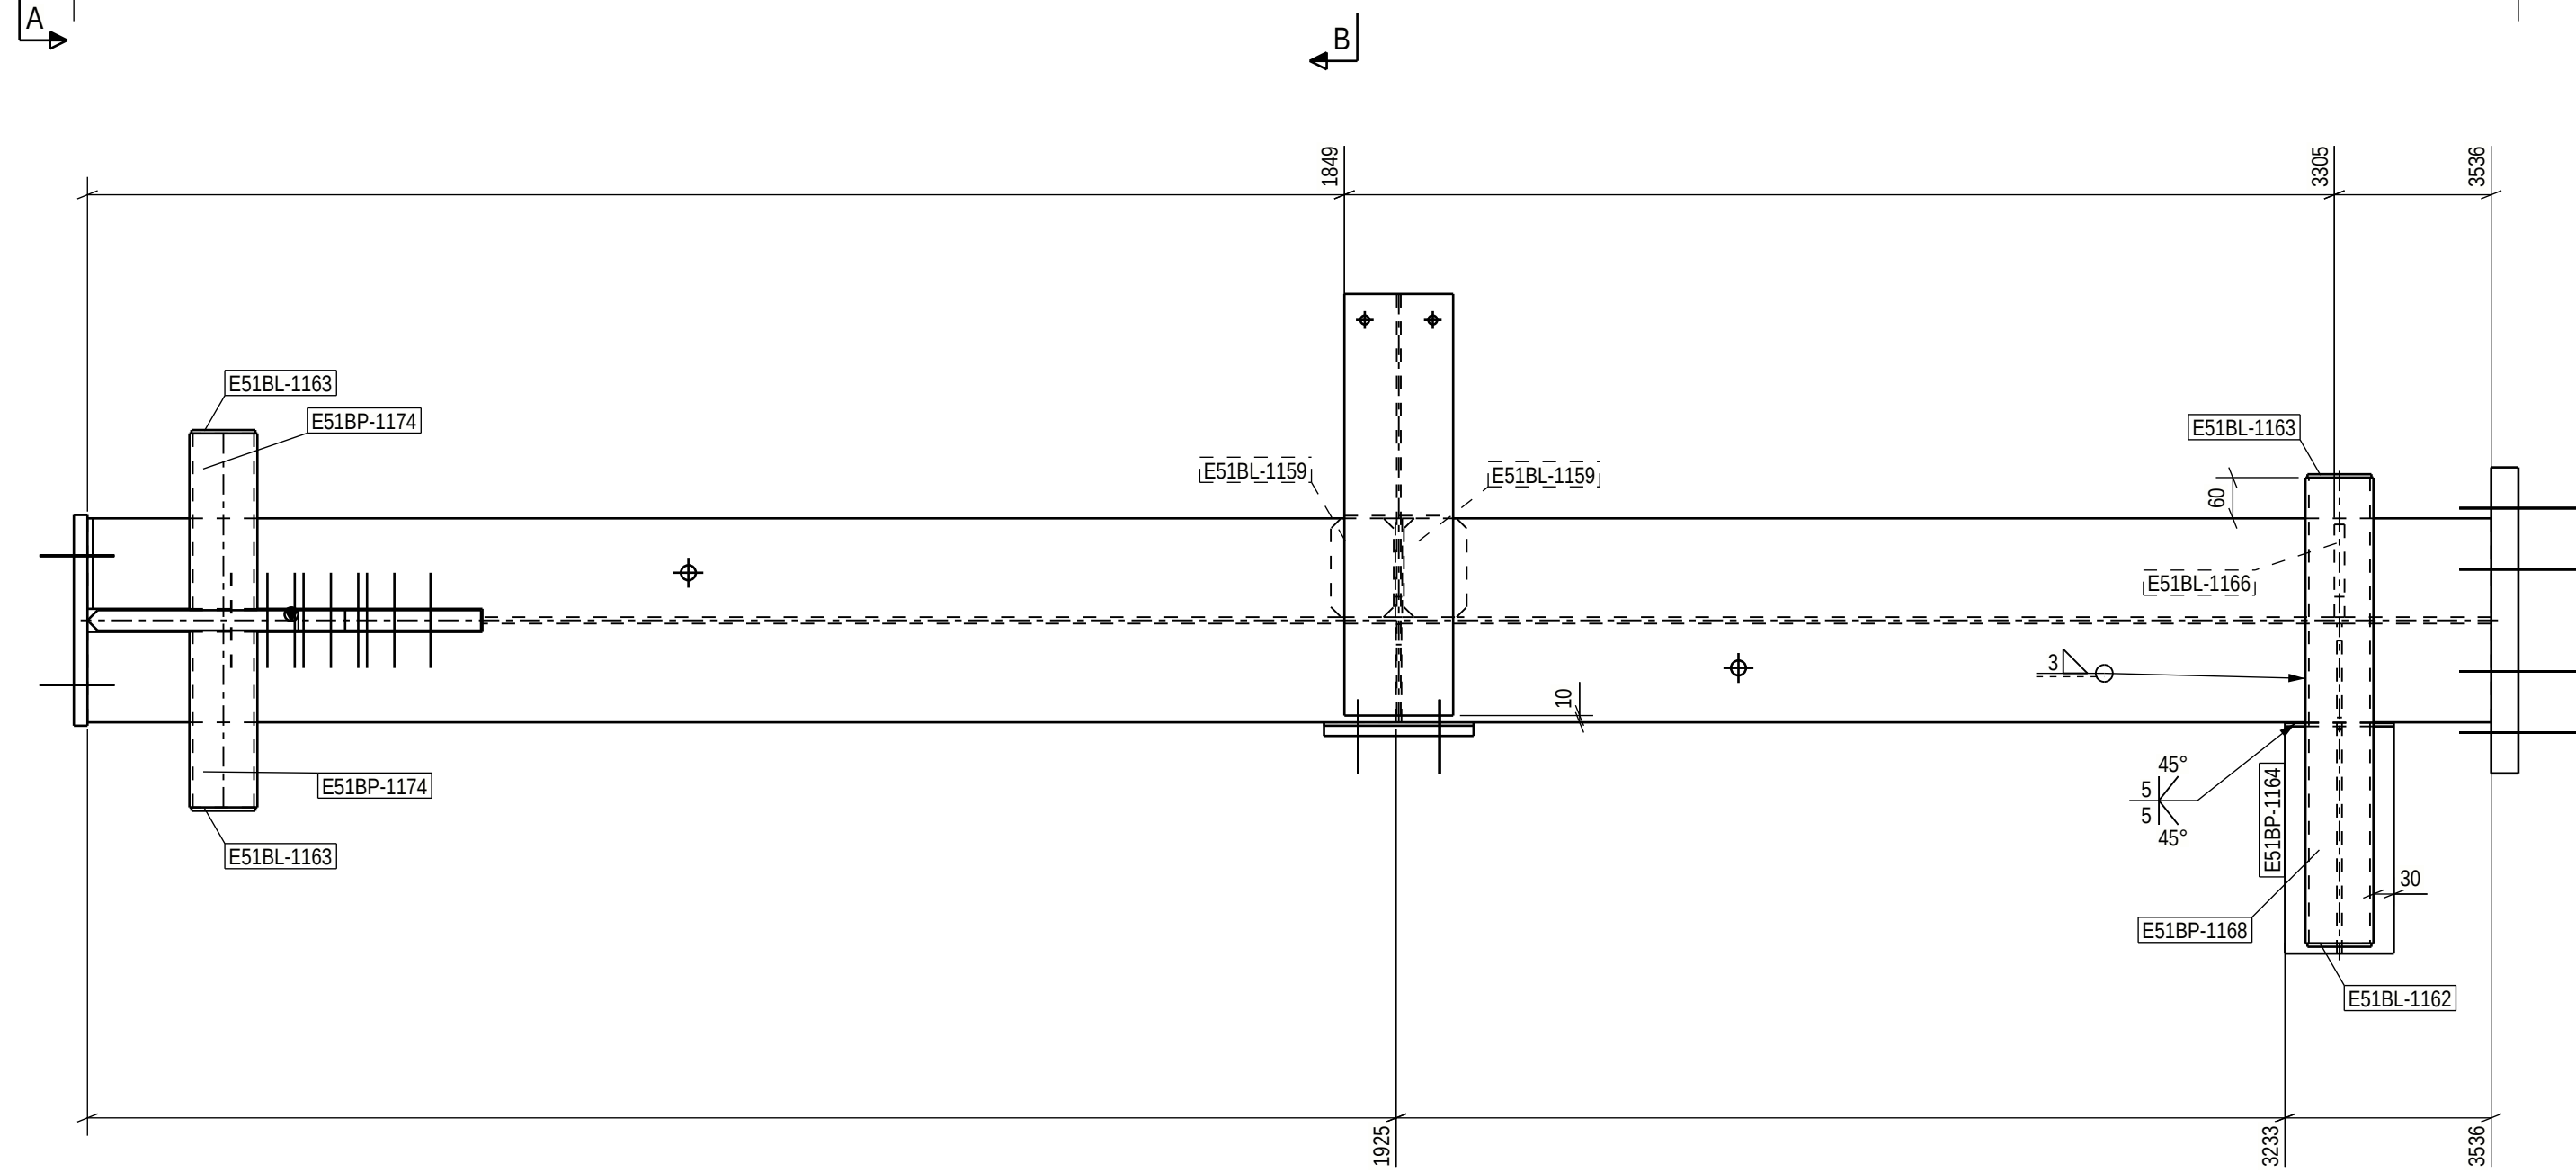

PART LIST FOR ASSEMBLY E51B-1043, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1035	PL20X220	S355J2+N	435	0.22	15.0	1
E51BL-1036	PL8X144	S355J2+N	296	0.09	2.7	1
E51BL-1048	PL30X579	S355J2+N	1124	1.22	133.2	1
E51BL-1072	PL10X145	S355J2+N	296	0.09	3.3	1
E51BL-1136	PL20X310	S355J2+N	1000	0.67	48.7	1
E51BL-1143	PL40X450	S355J2+N	550	0.58	77.7	1
E51BL-1159	PL10X93	S355J2+N	145	0.06	1.0	2
E51BL-1162	PL5X47	S355J2+N	94	0.01	0.2	1
E51BL-1163	PL5X44	S355J2+N	94	0.03	0.2	3
E51BL-1166	PL15X136	S355J2+N	296	0.09	4.7	1
E51BP-1014	HEA340	S355J2	3536	6.35	370.6	1
E51BP-1164	IPE330	S355J2	485	0.61	23.8	1
E51BP-1168	CFRHS100X50X5	S355J2H	685	0.19	7.2	1
E51BP-1174	CFRHS100X50X5	S355J2H	260	0.15	2.7	2
E51BP-1176	HEA160	S355J2	620	0.56	18.9	1
TOTAL:				10.92	713.9	

Technical fabrication requirements:		EXC2	
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution Specification document nr 25019443-ICC250-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 / Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2		Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on holding EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817	
Additional material inspection Shown on drwg.			

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1






DRAWING CONTENT

ASSEMBLY DRAWING

Beam

E51B-1043

 SWECO Sustainable engineering and design	SWECO RAKENNETEKNIikka OY ILMALANPORTTI 2 00240 HELSINKI PUH. +358 207 393 000 www.sweco.fi	DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
		DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
	PROJECT NUMBER 25019443	DWG. NO. E51B-1043	REVISION		

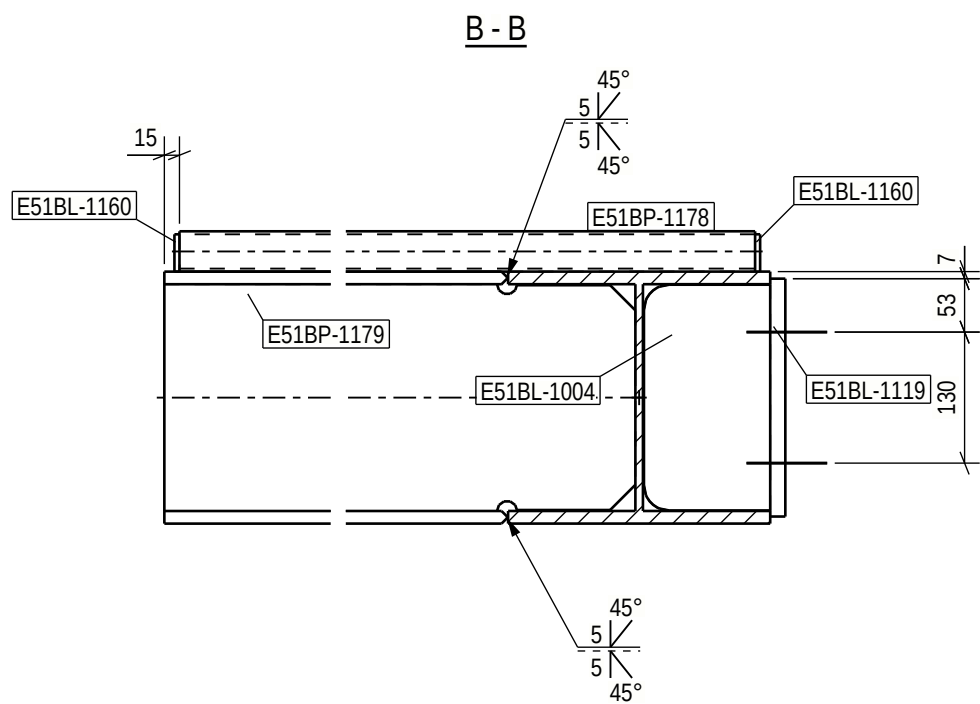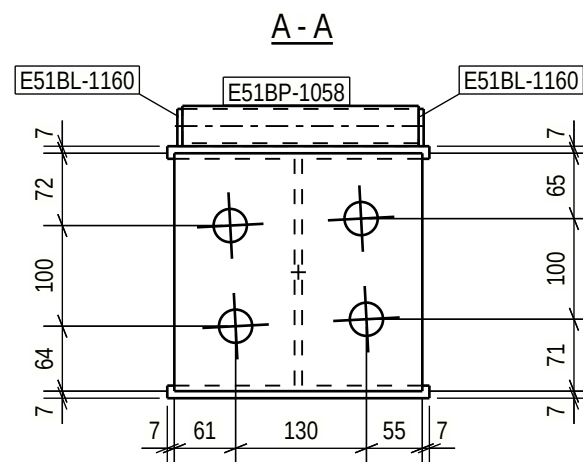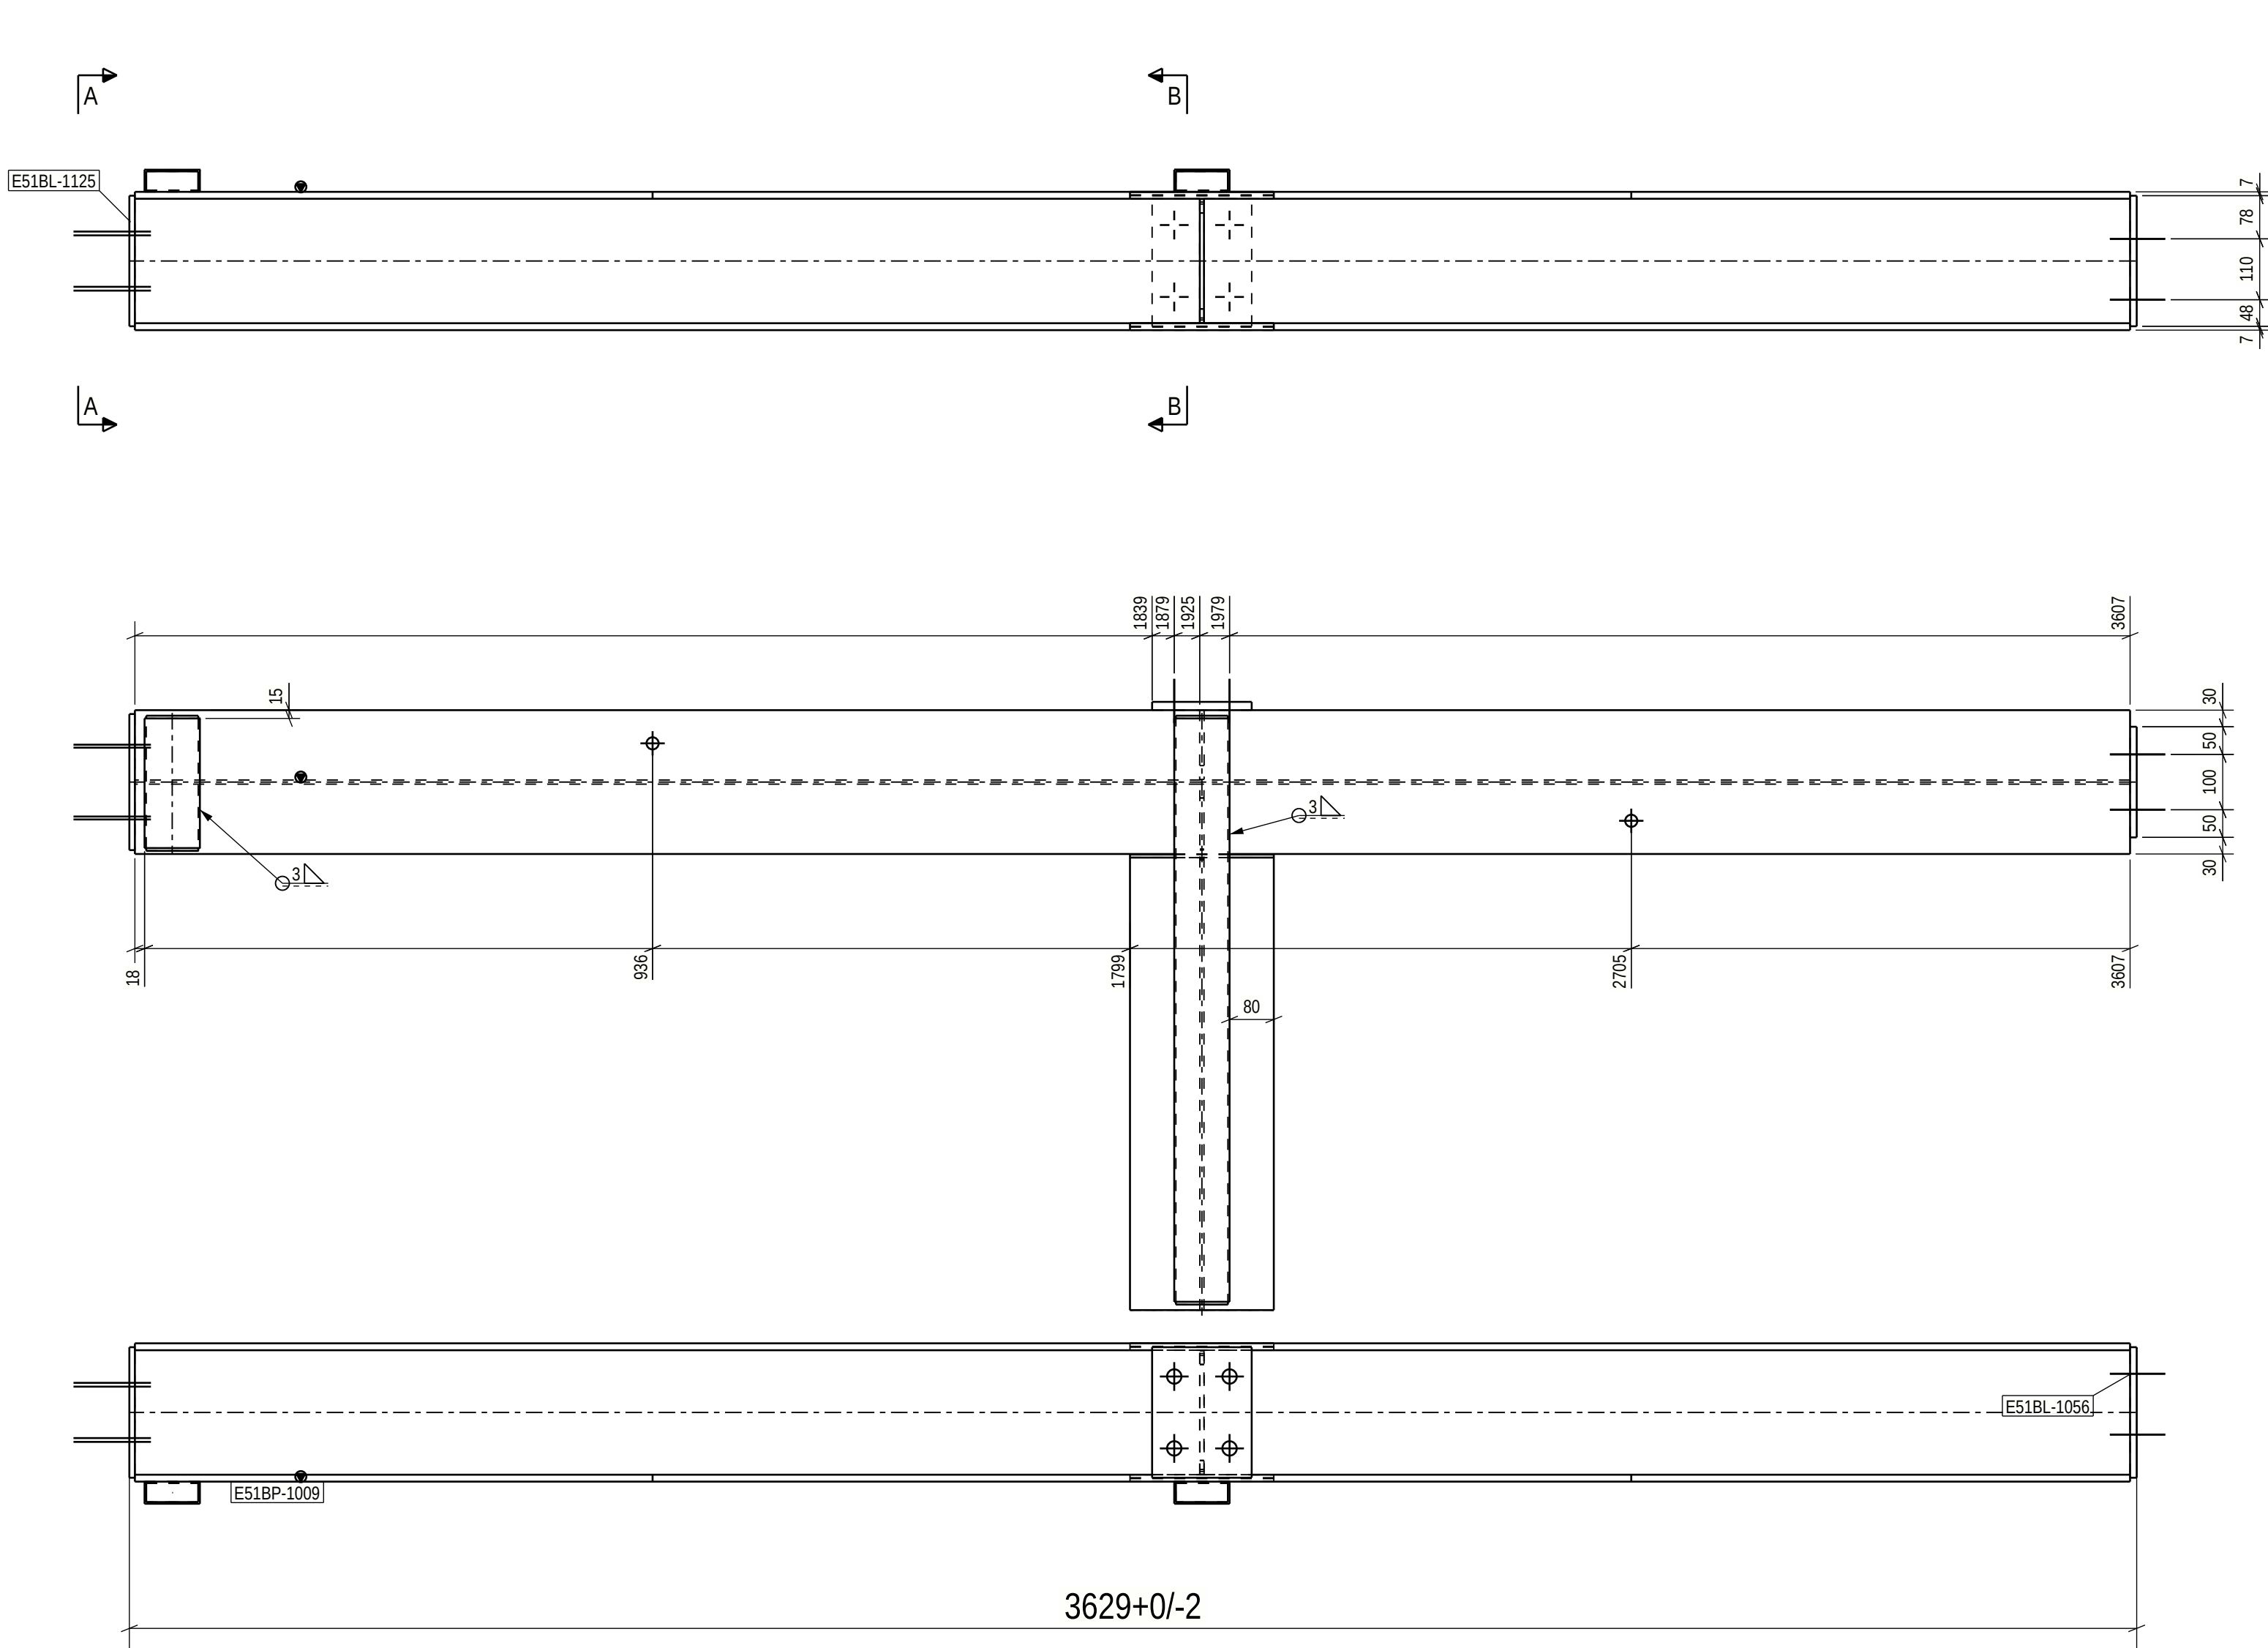

PART LIST FOR ASSEMBLY E51B-1045, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1004	PL8X125	S355J2+N	224	0.06	1.7	1
E51BL-1056	PL12X200	S355J2+N	236	0.10	4.4	1
E51BL-1119	PL15X180	S355J2+N	236	0.10	5.0	1
E51BL-1125	PL10X246	S355J2+N	236	0.13	4.6	1
E51BL-1160	PL5X37	S355J2+N	94	0.03	0.1	4
E51BP-1009	HEA260	S355J2	3607	5.35	245.8	1
E51BP-1058	CFRHS100X40X3	S355J2H	234	0.06	1.4	1
E51BP-1178	CFRHS100X40X3	S355J2H	1054	0.28	6.5	1
E51BP-1179	HEA260	S355J2	951	1.41	64.8	1
TOTAL:				7.53	334.8	


Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005	Fabrication tolerances EN 1090-2, Appendix B	
Surface preparation grade ISO8501-3, grade P2	Special fabrication tolerances Project specification/ shown on drwg.	
Surface treatment ISO12944-5	Weld inspection, requirements EN 1090-2, Table 24, U>0.5	
Additional requirements on surface treatment C3.07, EPPUR 240/2	Extent of NDT, fillet welds MT-EN1290, 20% of welds	
Shade RAL 7024 (Graphite Gray)	Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Welding of built up steel section Appendix 1 / Project spec.	Requirements on holing EN1090-2 Section 6.6.3	
Welds, if not specified otherwise EN 9692-1, EN 9692-2	Weld class C, EN ISO 5817	Additional material inspection Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1







SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi



DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1045

DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Kivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51B-1045		

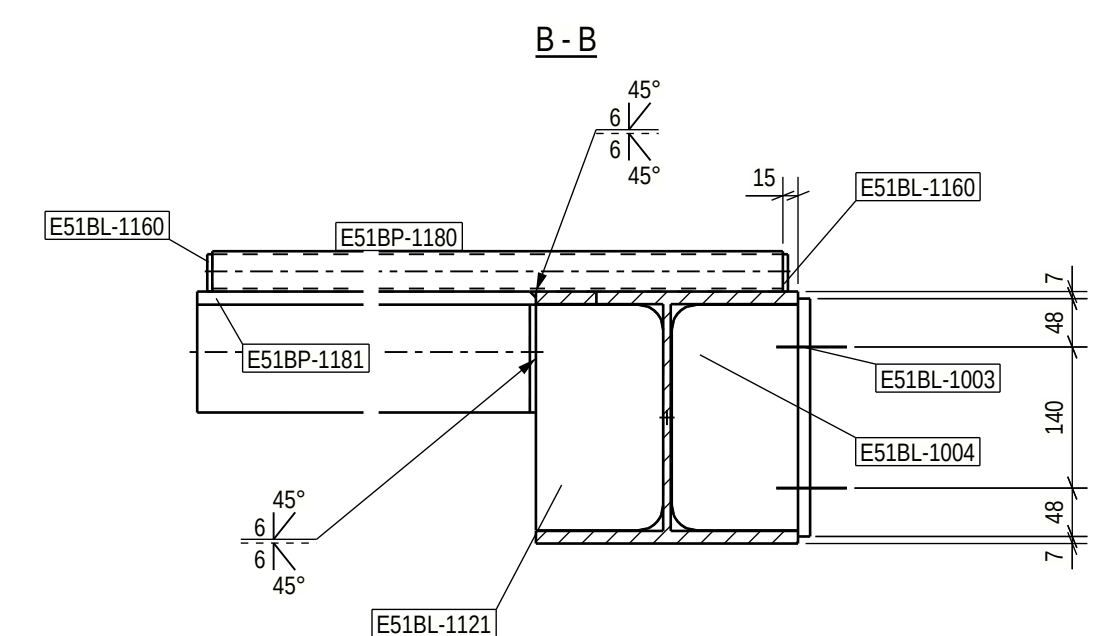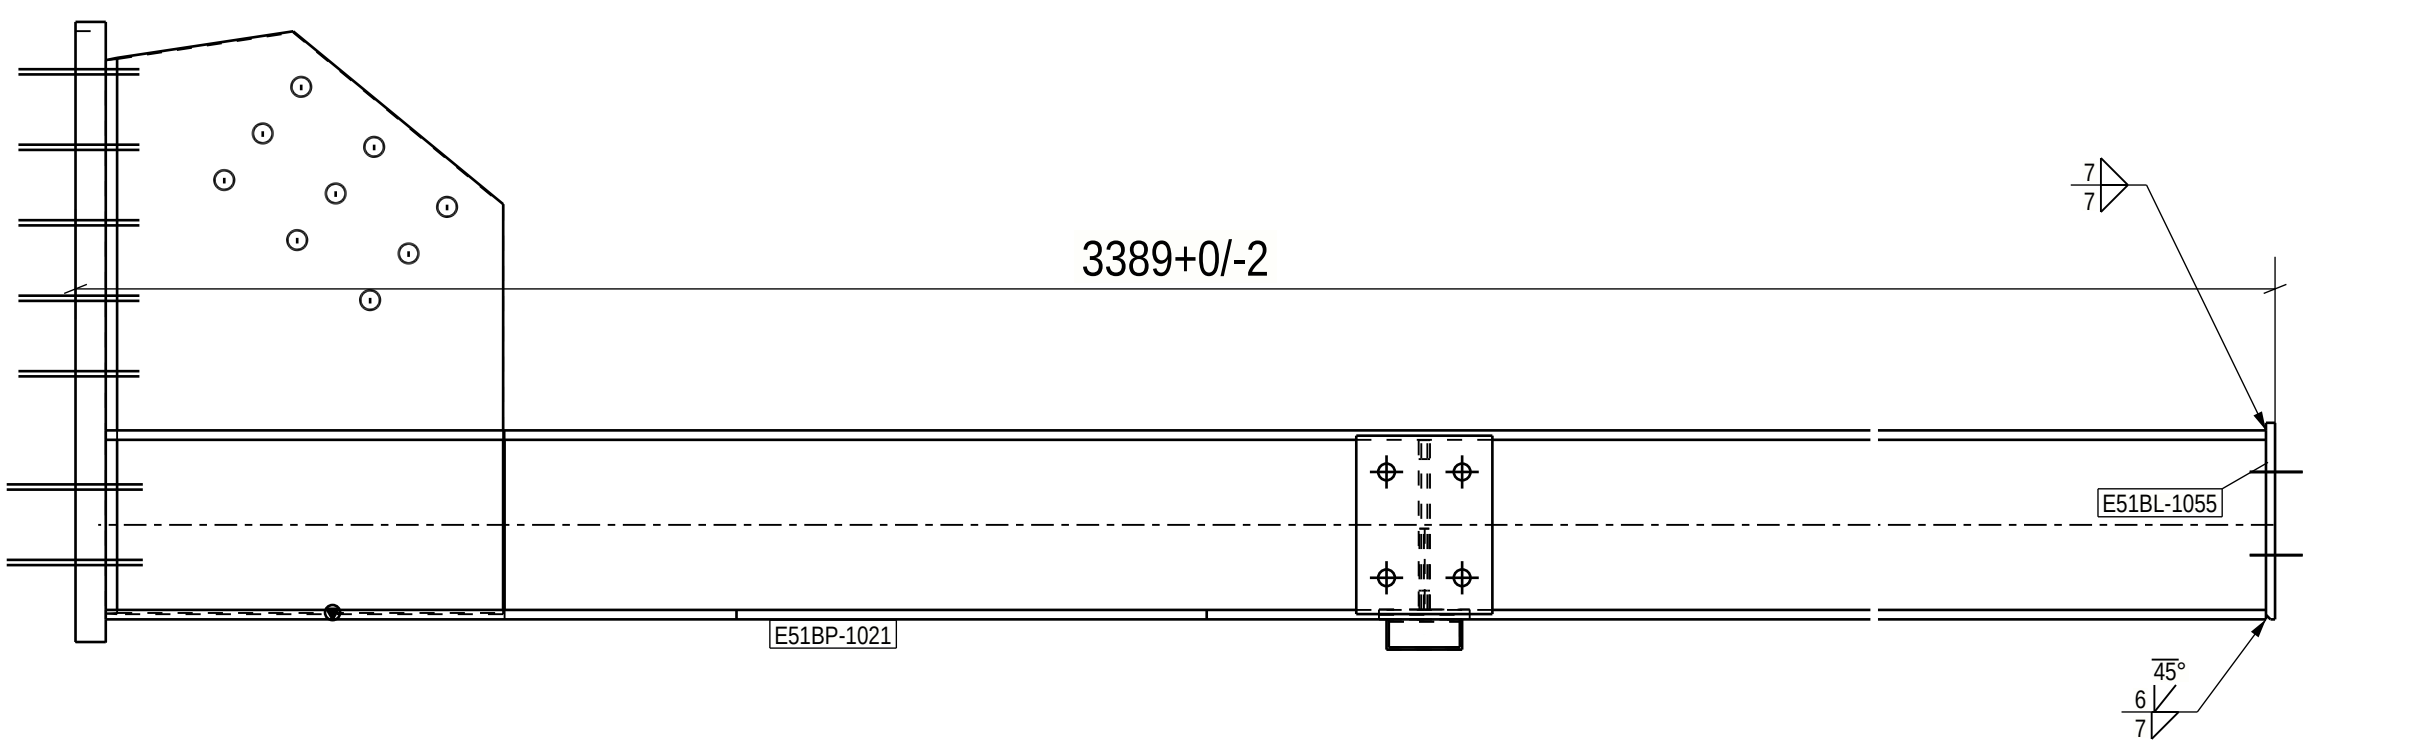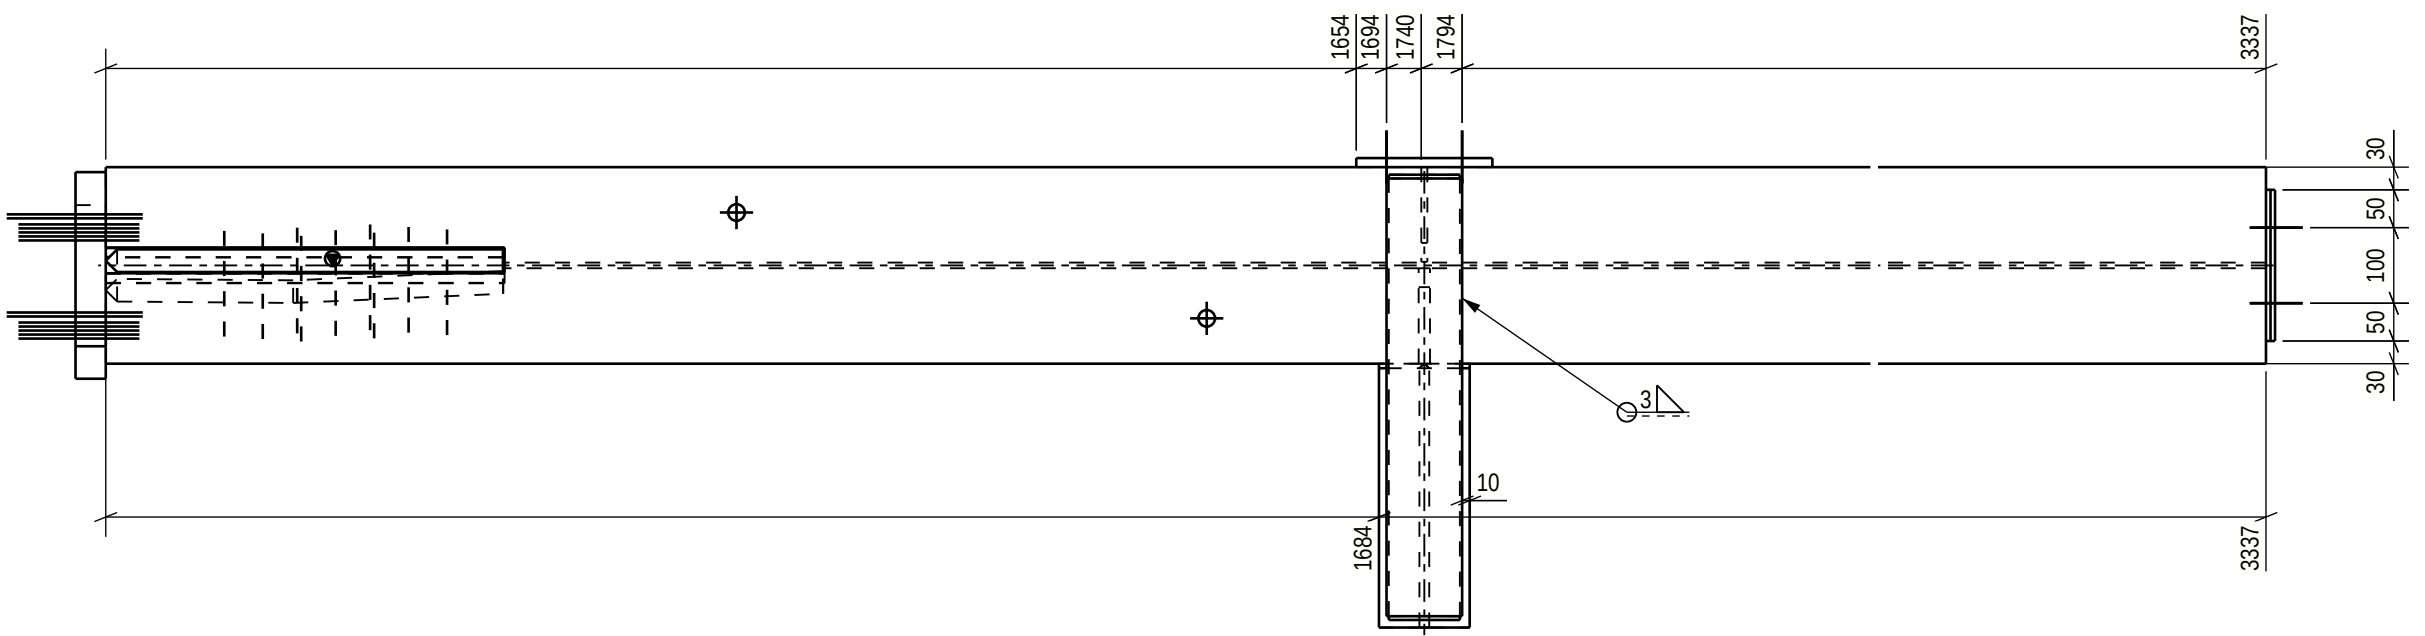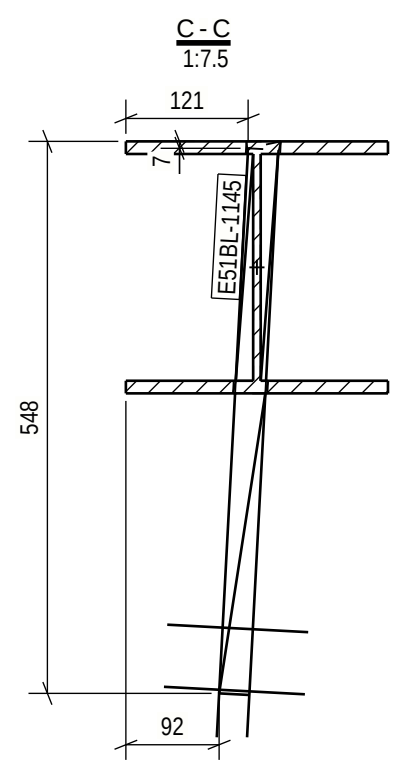
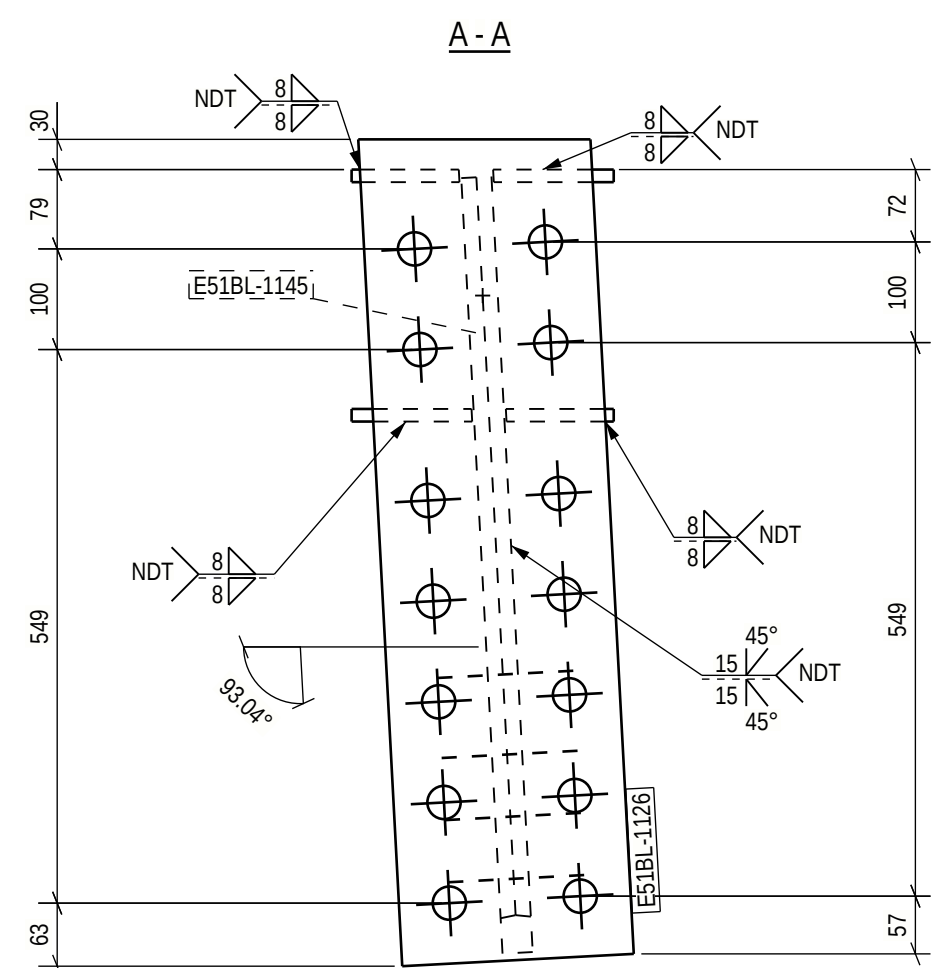
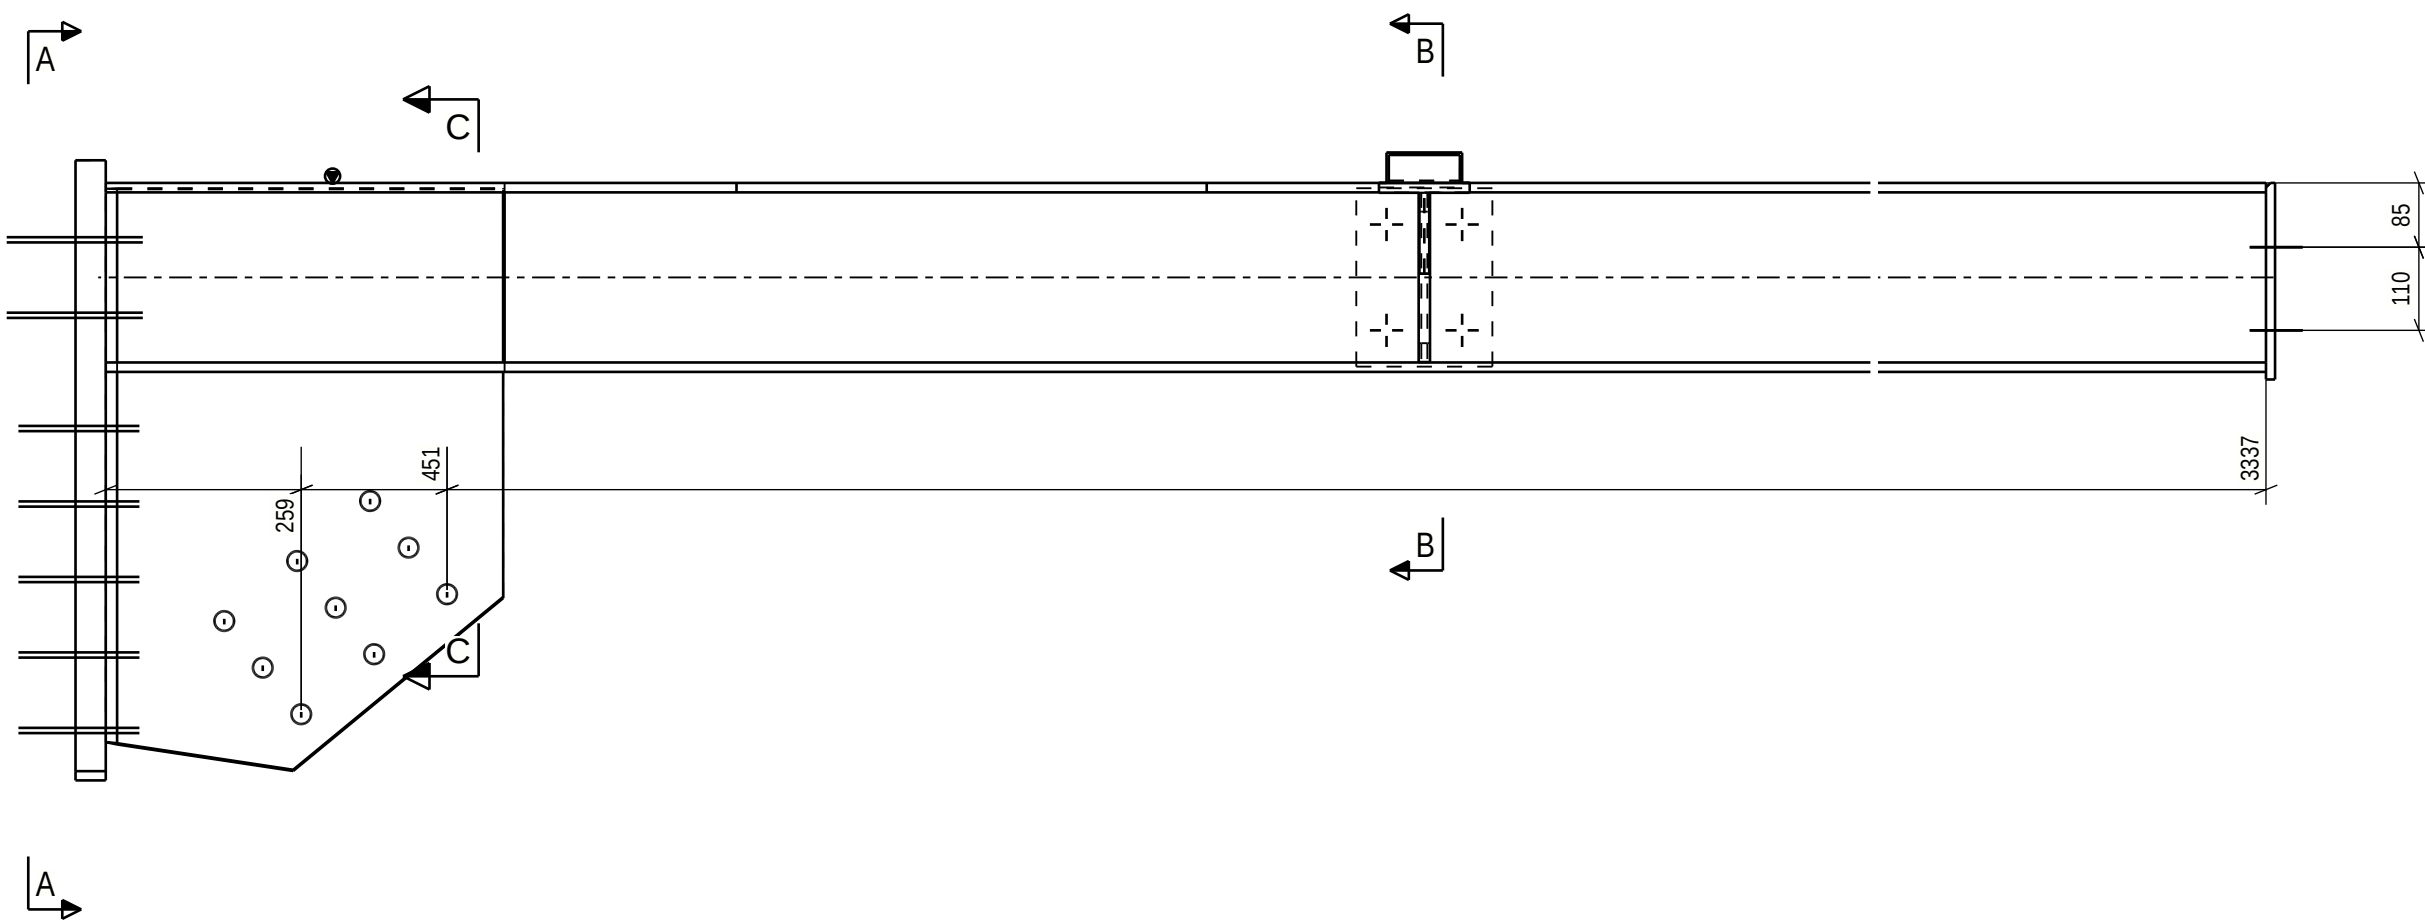


PART LIST FOR ASSEMBLY E51B-1048, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1003	PL12X180	S355J2+N	236	0.09	4.0	1
E51BL-1004	PL8X125	S355J2+N	224	0.06	1.7	1
E51BL-1055	PL12X200	S355J2+N	260	0.11	4.9	1
E51BL-1121	PL15X126	S355J2+N	224	0.07	3.3	1
E51BL-1126	PL40X230	S355J2+N	821	0.46	58.9	1
E51BL-1145	PL30X526	S355J2+N	771	0.80	85.5	1
E51BL-1160	PL5X37	S355J2+N	94	0.02	0.1	2
E51BP-1021	HEA260	S355J2	3337	4.95	227.4	1
E51BP-1180	CFRHS100X40X3	S355J2H	579	0.16	3.5	1
E51BP-1181	T120	S235JR	349	0.17	8.1	1
TOTAL:				6.88	397.7	

Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard	Fabrication tolerances	
EN1090-2, table A.3 : EXC2	EN 1090-2, Appendix B	
Execution Specification document nr	Special fabrication tolerances	
25019443-ICC250-0600-0660-000005	Project specification/ shown on drwg.	
Surface preparation grade	Weld inspection, requirements	
ISO8501-3, grade P2	EN 1090-2, Table 24, U>0.5	
Surface treatment	Extent of NDT, fillet welds	
ISO12944-5	MT-EN1290, 20% of welds	
Additional requirements on surface treatment	Extent of NDT, butt welds	
C3.07, EPPUR 240/2	UT, EN-ISO17640, 20% of welds	
Shade	Extent of NDT for splices not shown on drawing	
RAL 7024 (Graphite Gray)	UT, EN-ISO17640, 100% of welds	
Welding of built up steel section	Requirements on holing	
Appendix 1 / Project spec.	EN1090-2 Section 6.6.3	
Welds, if not specified otherwise	Weld class	Additional material inspection
EN 9692-1, EN 9692-2	C, EN ISO 5817	Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME		DRAWING CONTENT	
Easpring New Materials Oy		ASSEMBLY DRAWING	
FAIR Phase 1		Beam	
		E51B-1048	
PROJECT NUMBER		DATE	ARCHIVING CODE
25019443		16.06.2026	
DESIGNER		PAGE	DESIGN GROUP
Alexey Serous			STR
CHECKED		APPROVED	
Jere Kallosalmi		Pertti Koivumaa	
REVISION		DWG. NO.	
SWECO		SWECO RAKENNETEKNIikka OY	
Sustainable engineering and design		ILMALANPORTTI 2	
		00240 HELSINKI	
		PUH. +358 207 393 000	
		www.sweco.fi	

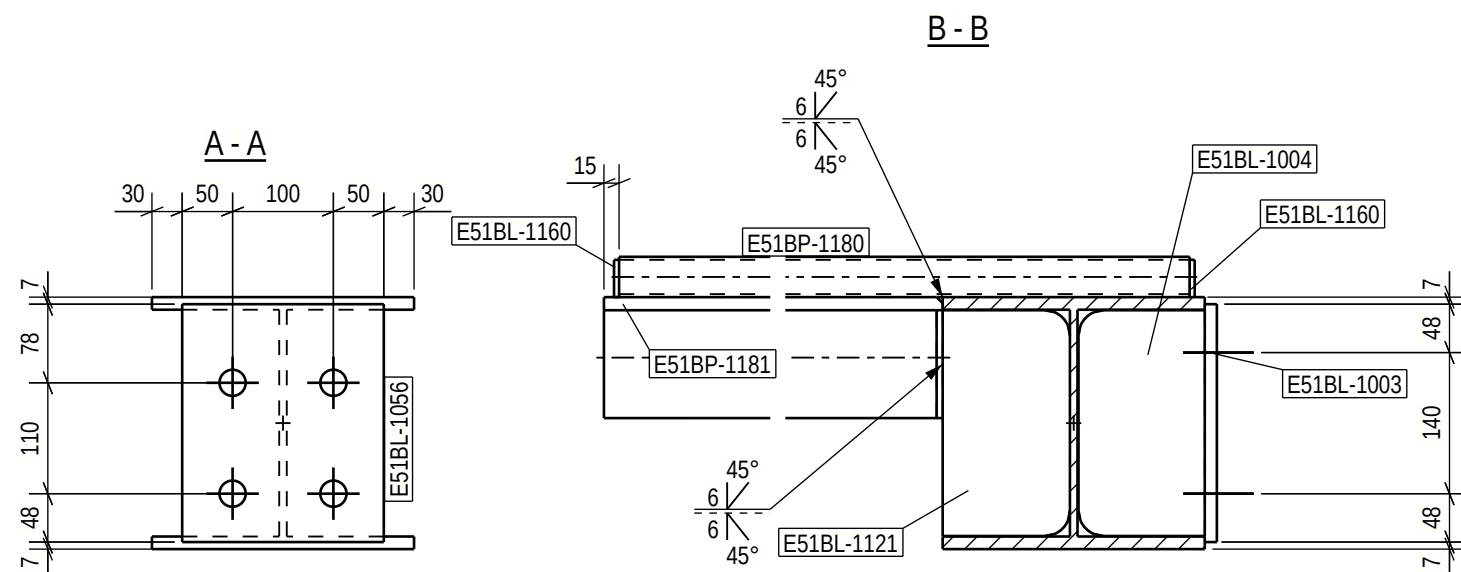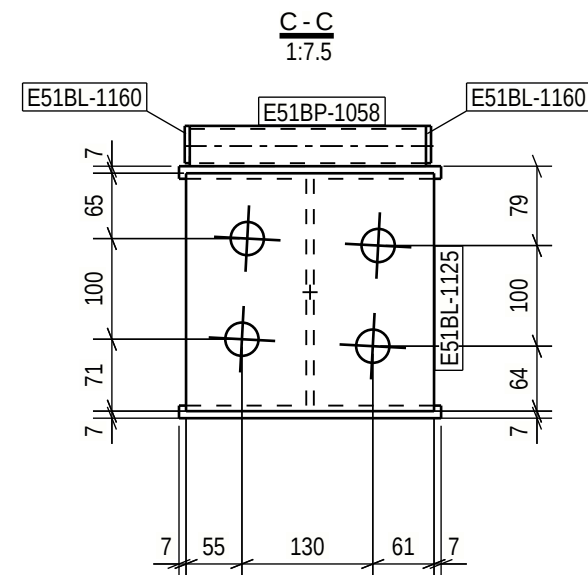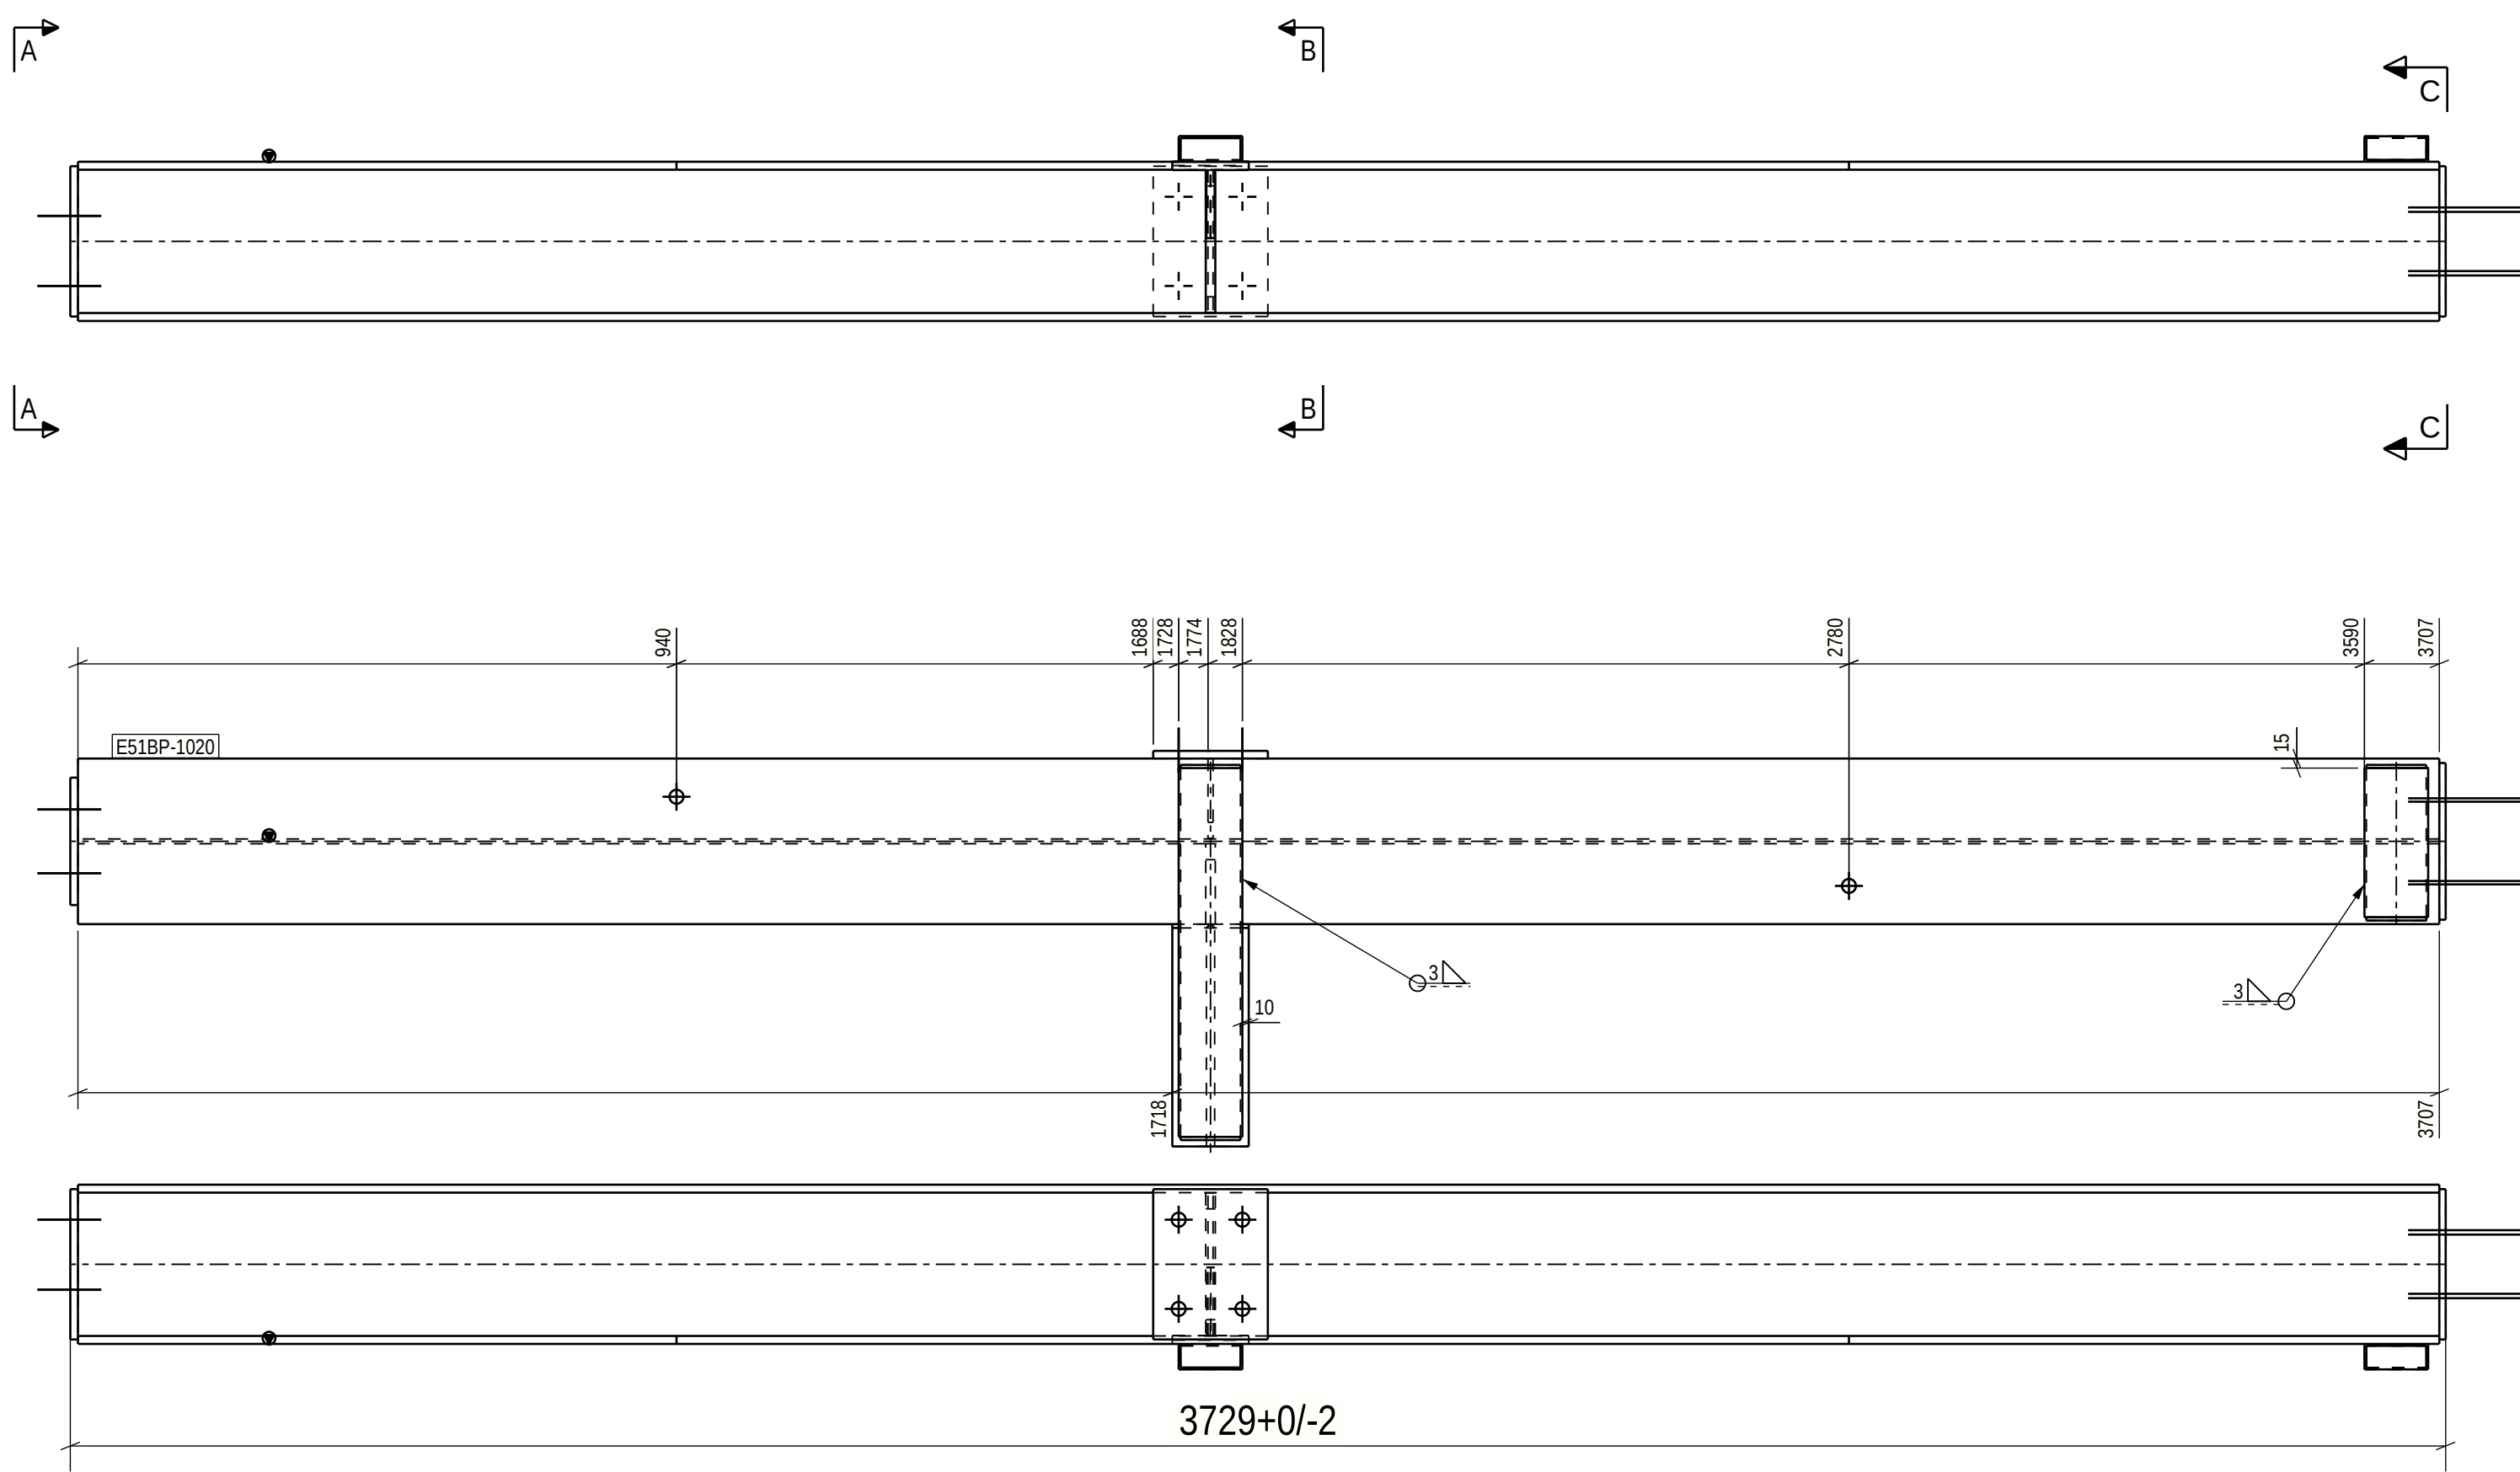


PART LIST FOR ASSEMBLY E51B-1049, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1003	PL12X180	S355J2+N	236	0.09	4.0	1
E51BL-1004	PL8X125	S355J2+N	224	0.06	1.7	1
E51BL-1056	PL12X200	S355J2+N	236	0.10	4.4	1
E51BL-1121	PL15X126	S355J2+N	224	0.07	3.3	1
E51BL-1125	PL10X246	S355J2+N	236	0.13	4.6	1
E51BL-1160	PL5X37	S355J2+N	94	0.03	0.1	4
E51BP-1020	HEA260	S355J2	3707	5.50	252.6	1
E51BP-1058	CFRHS100X40X3	S355J2H	234	0.06	1.4	1
E51BP-1180	CFRHS100X40X3	S355J2H	579	0.16	3.5	1
E51BP-1181	T120	S235JR	349	0.17	8.1	1
TOTAL:				6.37	284.3	

Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2	Fabrication tolerances EN 1090-2, Appendix B	
Execution Specification document nr 25019443-ICC250-0600-0660-000005	Special fabrication tolerances Project specification/ shown on drwg.	
Surface preparation grade ISO8501-3, grade P2	Weld inspection, requirements EN 1090-2, Table 24, U>0.5	
Surface treatment ISO12944-5	Extent of NDT, fillet welds MT-EN1290, 20% of welds	
Additional requirements on surface treatment C3.07, EPPUR 240/2	Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Shade RAL 7024 (Graphite Gray)	Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds	
Welding of built up steel section Appendix 1 / Project spec.	Requirements on holing EN1090-2 Section 6.6.3	
Welds, if not specified otherwise EN 9692-1, EN 9692-2	Weld class C, EN ISO 5817	Additional material inspection Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1049

SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi



DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Koivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51B-1049		

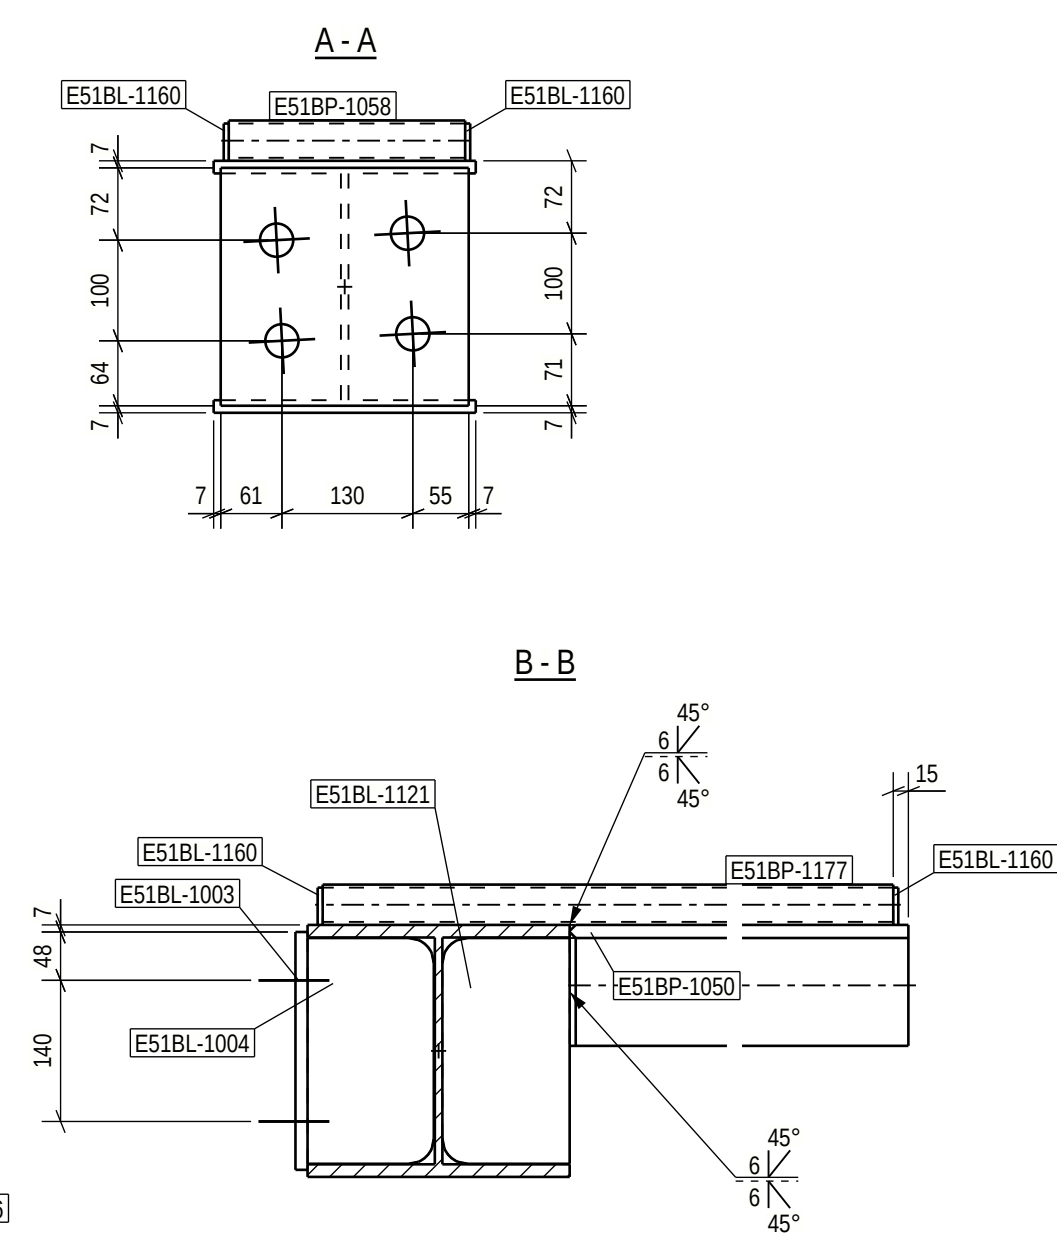

		Execution class	
Technical fabrication requirements:		EXC2	
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		Fabrication tolerances	
Execution Specification document nr 25019443-ICC250-0600-0660-000005		EN 1090-2, Appendix B	
Surface preparation grade ISO8501-3, grade P2		Special fabrication tolerances	
Surface treatment ISO12944-5		Project specification/ shown on drwg.	
Additional requirements on surface treatment C3.07, EPPUR 240/2		Weld inspection, requirements	
Shade RAL 7024 (Graphite Gray)		EN 1090-2, Table 24, U>0.5	
Welding of built up steel section Appendix 1 / Project spec.		Extent of NDT, fillet welds	
Welds, if not specified otherwise EN 9692-1, EN 9692-2		MT-EN1290, 20% of welds	
		Extent of NDT, butt welds	
		UT, EN-ISO17640, 20% of welds	
		Extent of NDT for splices not shown on drawing	
		UT, EN-ISO17640, 100% of welds	
		Requirements on holding	
		EN1090-2 Section 6.6.3	
		Weld class	
		C, EN ISO 5817	
		Additional material inspection	
		Shown on drwg.	

SWECO 
Sustainable engineering and design

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51B-1050		REVISION

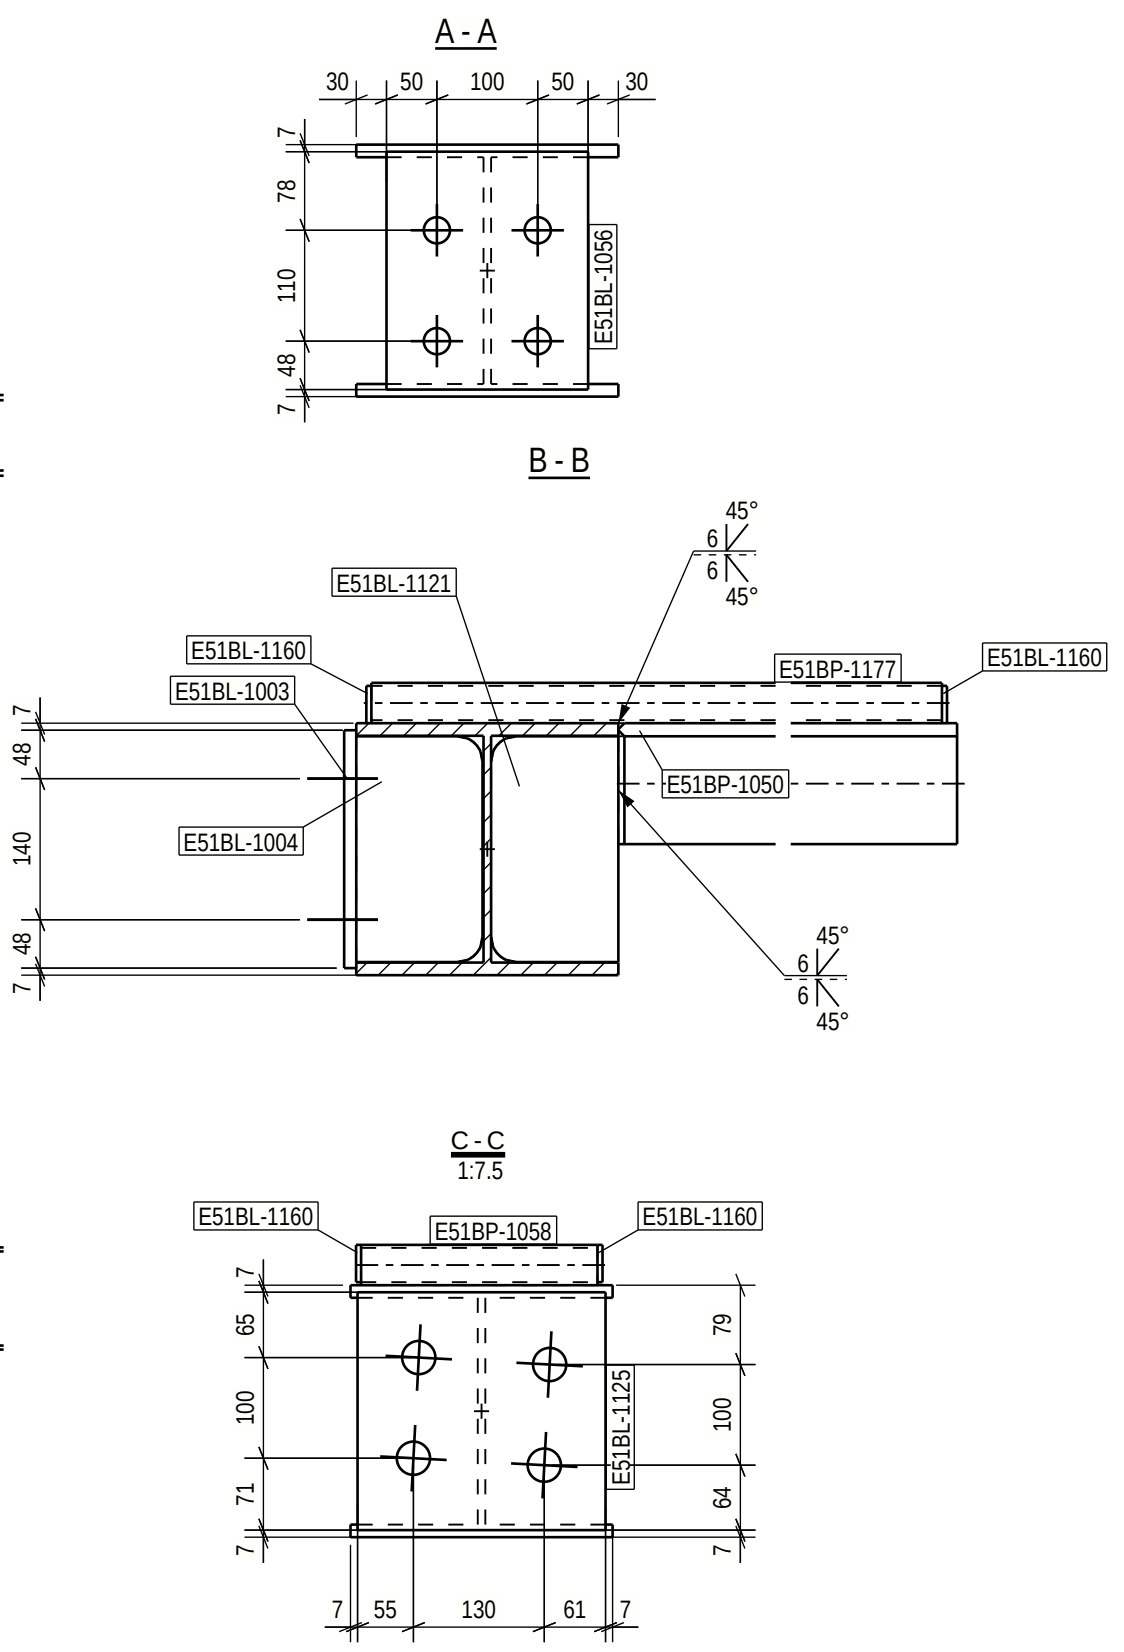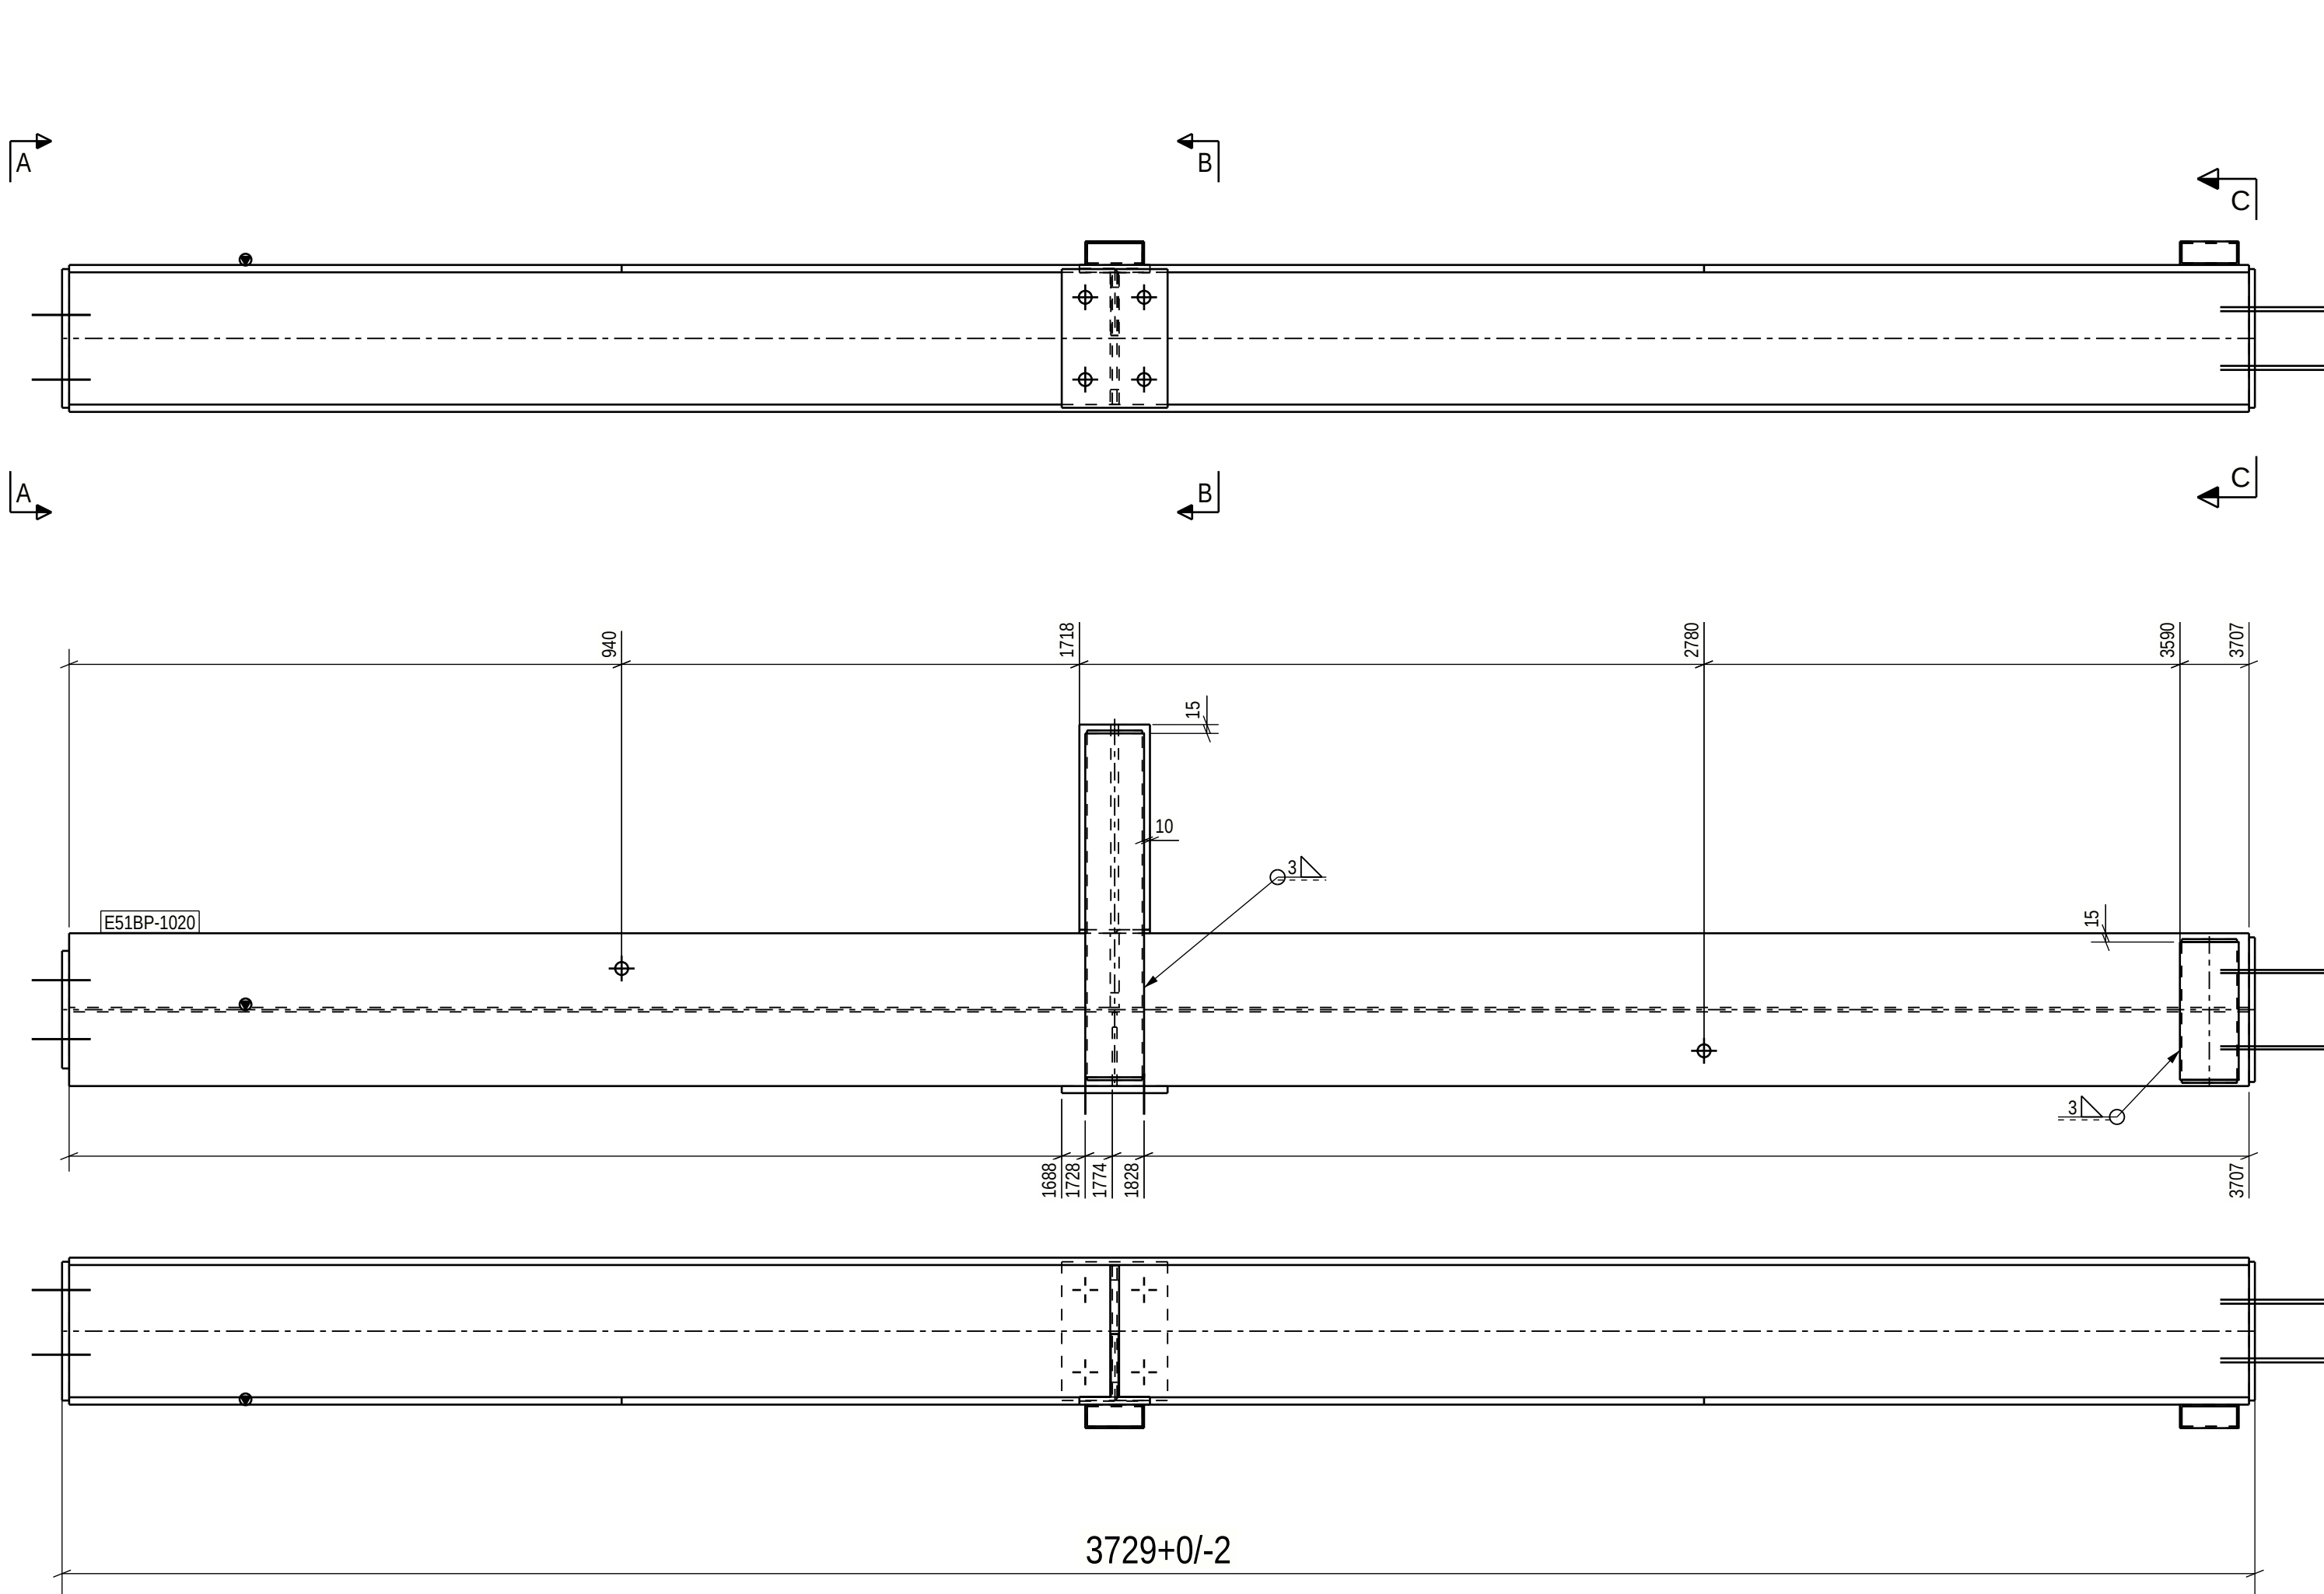

PART LIST FOR ASSEMBLY E51B-1054, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1003	PL12X180	S355J2+N	236	0.09	4.0	1
E51BL-1004	PL8X125	S355J2+N	224	0.06	1.7	1
E51BL-1056	PL12X200	S355J2+N	236	0.10	4.4	1
E51BL-1121	PL15X126	S355J2+N	224	0.07	3.3	1
E51BL-1125	PL10X246	S355J2+N	236	0.13	4.6	1
E51BL-1160	PL5X37	S355J2+N	94	0.03	0.1	4
E51BP-1020	HEA260	S355J2	3707	5.50	252.6	1
E51BP-1050	T120	S235JR	355	0.17	8.2	1
E51BP-1058	CFRHS100X40X3	S355J2H	234	0.06	1.4	1
E51BP-1177	CFRHS100X40X3	S355J2H	585	0.16	3.6	1
TOTAL:				6.38	284.5	

Technical fabrication requirements:

EXC2

Requirements for fabrication, standard
EN1090-2, table A.3: EXC2
Execution Specification document nr
25019443-ICC250-0600-0660-000005

ISO12944-5
Additional requirements on surface treatment
C3.07, EPPUR 240/2
Shade
RAL 7024 (Graphite Gray)
Welding of built up steel section
Appendix 1 / Project spec.
Welds, if not specified otherwise
EN 9692-1, EN 9692-2

Fabrication tolerances
EN 1090-2, Appendix B
Special fabrication tolerances
Project specification/ shown on drwg.

Weld inspection, requirements
EN 1090-2, Table 24, U>0.5
Extent of NDT, fillet welds
MT-EN1290, 20% of welds
Extent of NDT, butt welds
UT, EN-ISO17640, 20% of welds
UT, EN-ISO17640, 100% of welds
Requirements on holing
EN1090-2 Section 6.6.3
Weld class
C, EN ISO 5817

Execution class

EXC2

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1054


DATE
16.06.2026
DRAWN
Alexey Serous
PROJECT NUMBER
25019443

ARCHIVING CODE
DESIGNER
Alexey Serous
CHECKED
Pertti Koivumaa
DWG. NO.
E51B-1054

PAGE
DESIGN GROUP
STR

REVISION

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

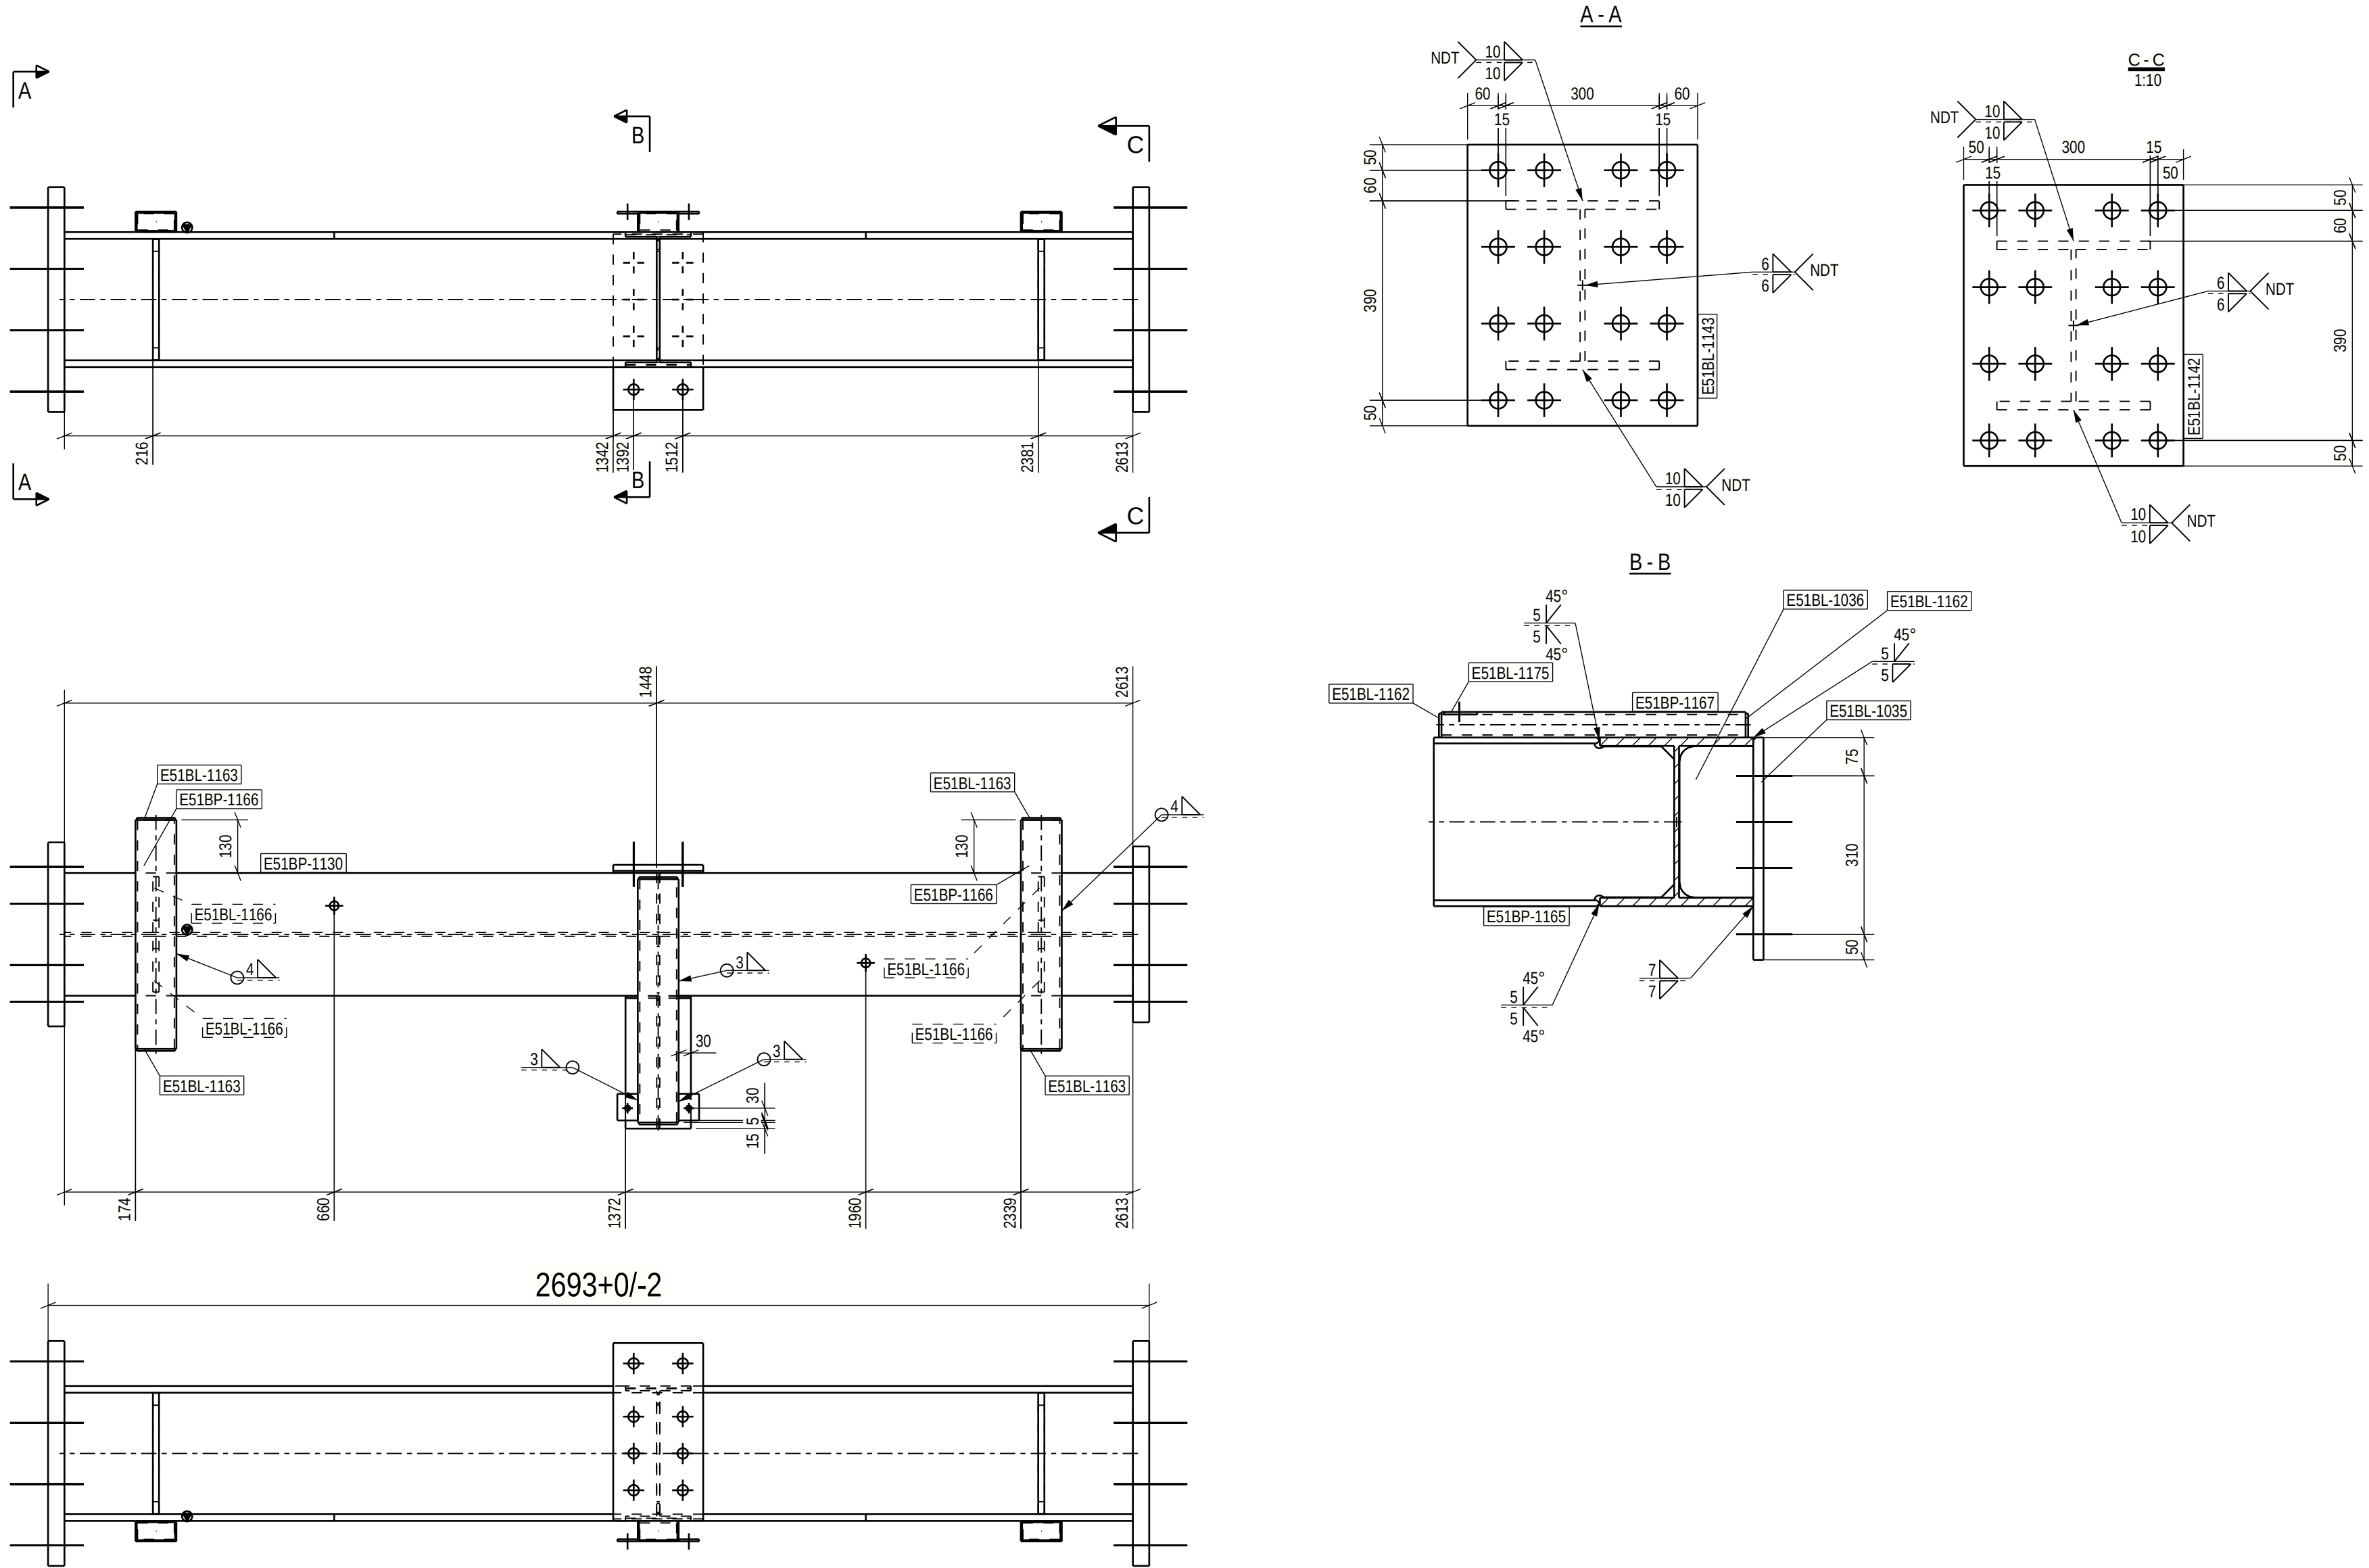

PART LIST FOR ASSEMBLY E51B-1056, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1035	PL20X220	S355J2+N	435	0.22	15.0	1
E51BL-1036	PL8X144	S355J2+N	296	0.09	2.7	1
E51BL-1142	PL40X430	S355J2+N	550	0.55	74.3	1
E51BL-1143	PL40X450	S355J2+N	550	0.58	77.7	1
E51BL-1162	PL5X47	S355J2+N	94	0.02	0.2	2
E51BL-1163	PL5X44	S355J2+N	94	0.04	0.2	4
E51BL-1166	PL15X136	S355J2+N	296	0.37	4.7	4
E51BL-1175	PL5X50	S355J2+N	65	0.02	0.1	2
E51BP-1130	HEA340	S355J2	2613	4.69	273.8	1
E51BP-1165	IPE330	S355J2	470	0.59	23.1	1
E51BP-1166	CFRHS100X50X5	S355J2H	560	0.32	5.9	2
E51BP-1167	CFRHS100X50X5	S355J2H	595	0.17	6.2	1
TOTAL:				7.64	504.6	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard
EN1090-2, table A.3 : EXC2
Execution Specification document nr
25019443-ICC250-0600-0660-000005

Fabrication tolerances
EN 1090-2, Appendix B
Special fabrication tolerances
Project specification/ shown on drwg.

Surface preparation grade
ISO8501-3, grade P2
Surface treatment
ISO12944-5
Additional requirements on surface treatment
C3.07, EPPUR 240/2
Shade
RAL 7024 (Graphite Gray)
Welding of built up steel section
Appendix 1 / Project spec.
Welds, if not specified otherwise
EN 9692-1, EN 9692-2

Weld inspection, requirements
EN 1090-2, Table 24, U>0.5
Extent of NDT, fillet welds
MT-EN1290, 20% of welds
Extent of NDT, butt welds
UT, EN-ISO17640, 20% of welds
UT, EN-ISO17640, 100% of welds
Requirements on holing
EN1090-2 Section 6.6.3
Weld class
C, EN ISO 5817

Additional material inspection
Shown on drwg.

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1

SWECO

Sustainable engineering and design

SWECO RAKENNTEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1056

DATE
16.06.2026
DRAWN
Alexey Serous
PROJECT NUMBER
25019443





ARCHIVING CODE
DESIGNER
Alexey Serous

PAGE
APPROVED
Pertti Koivumaa
Dwg. NO.
E51B-1056

DESIGN GROUP
STR
CHECKED
Jere Kallosalmi
REVISION

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

25019443_Fair_E500

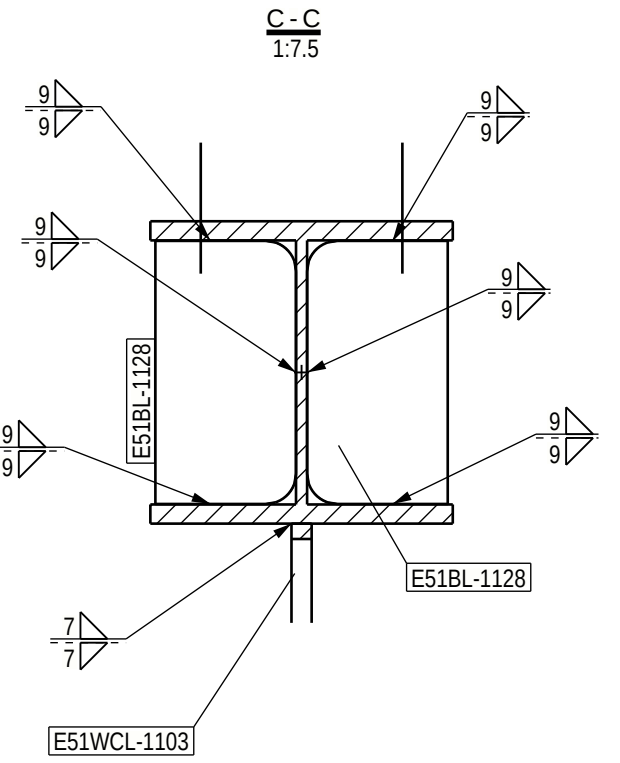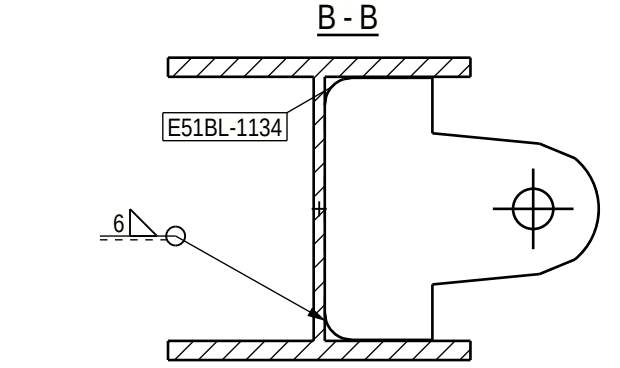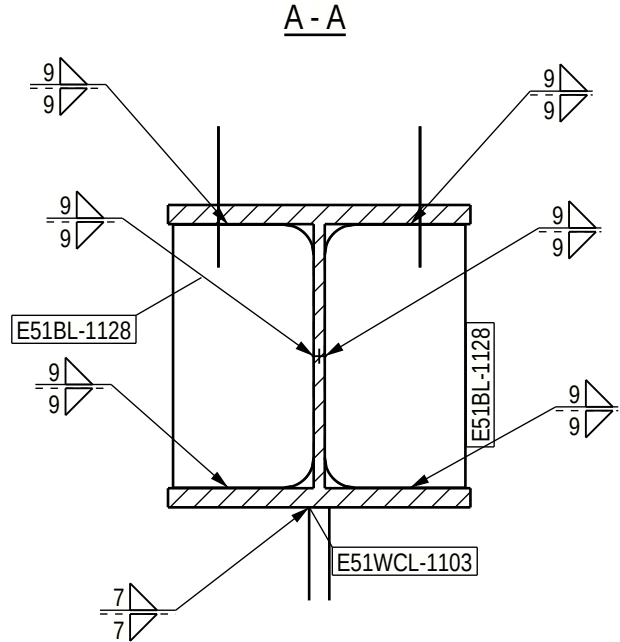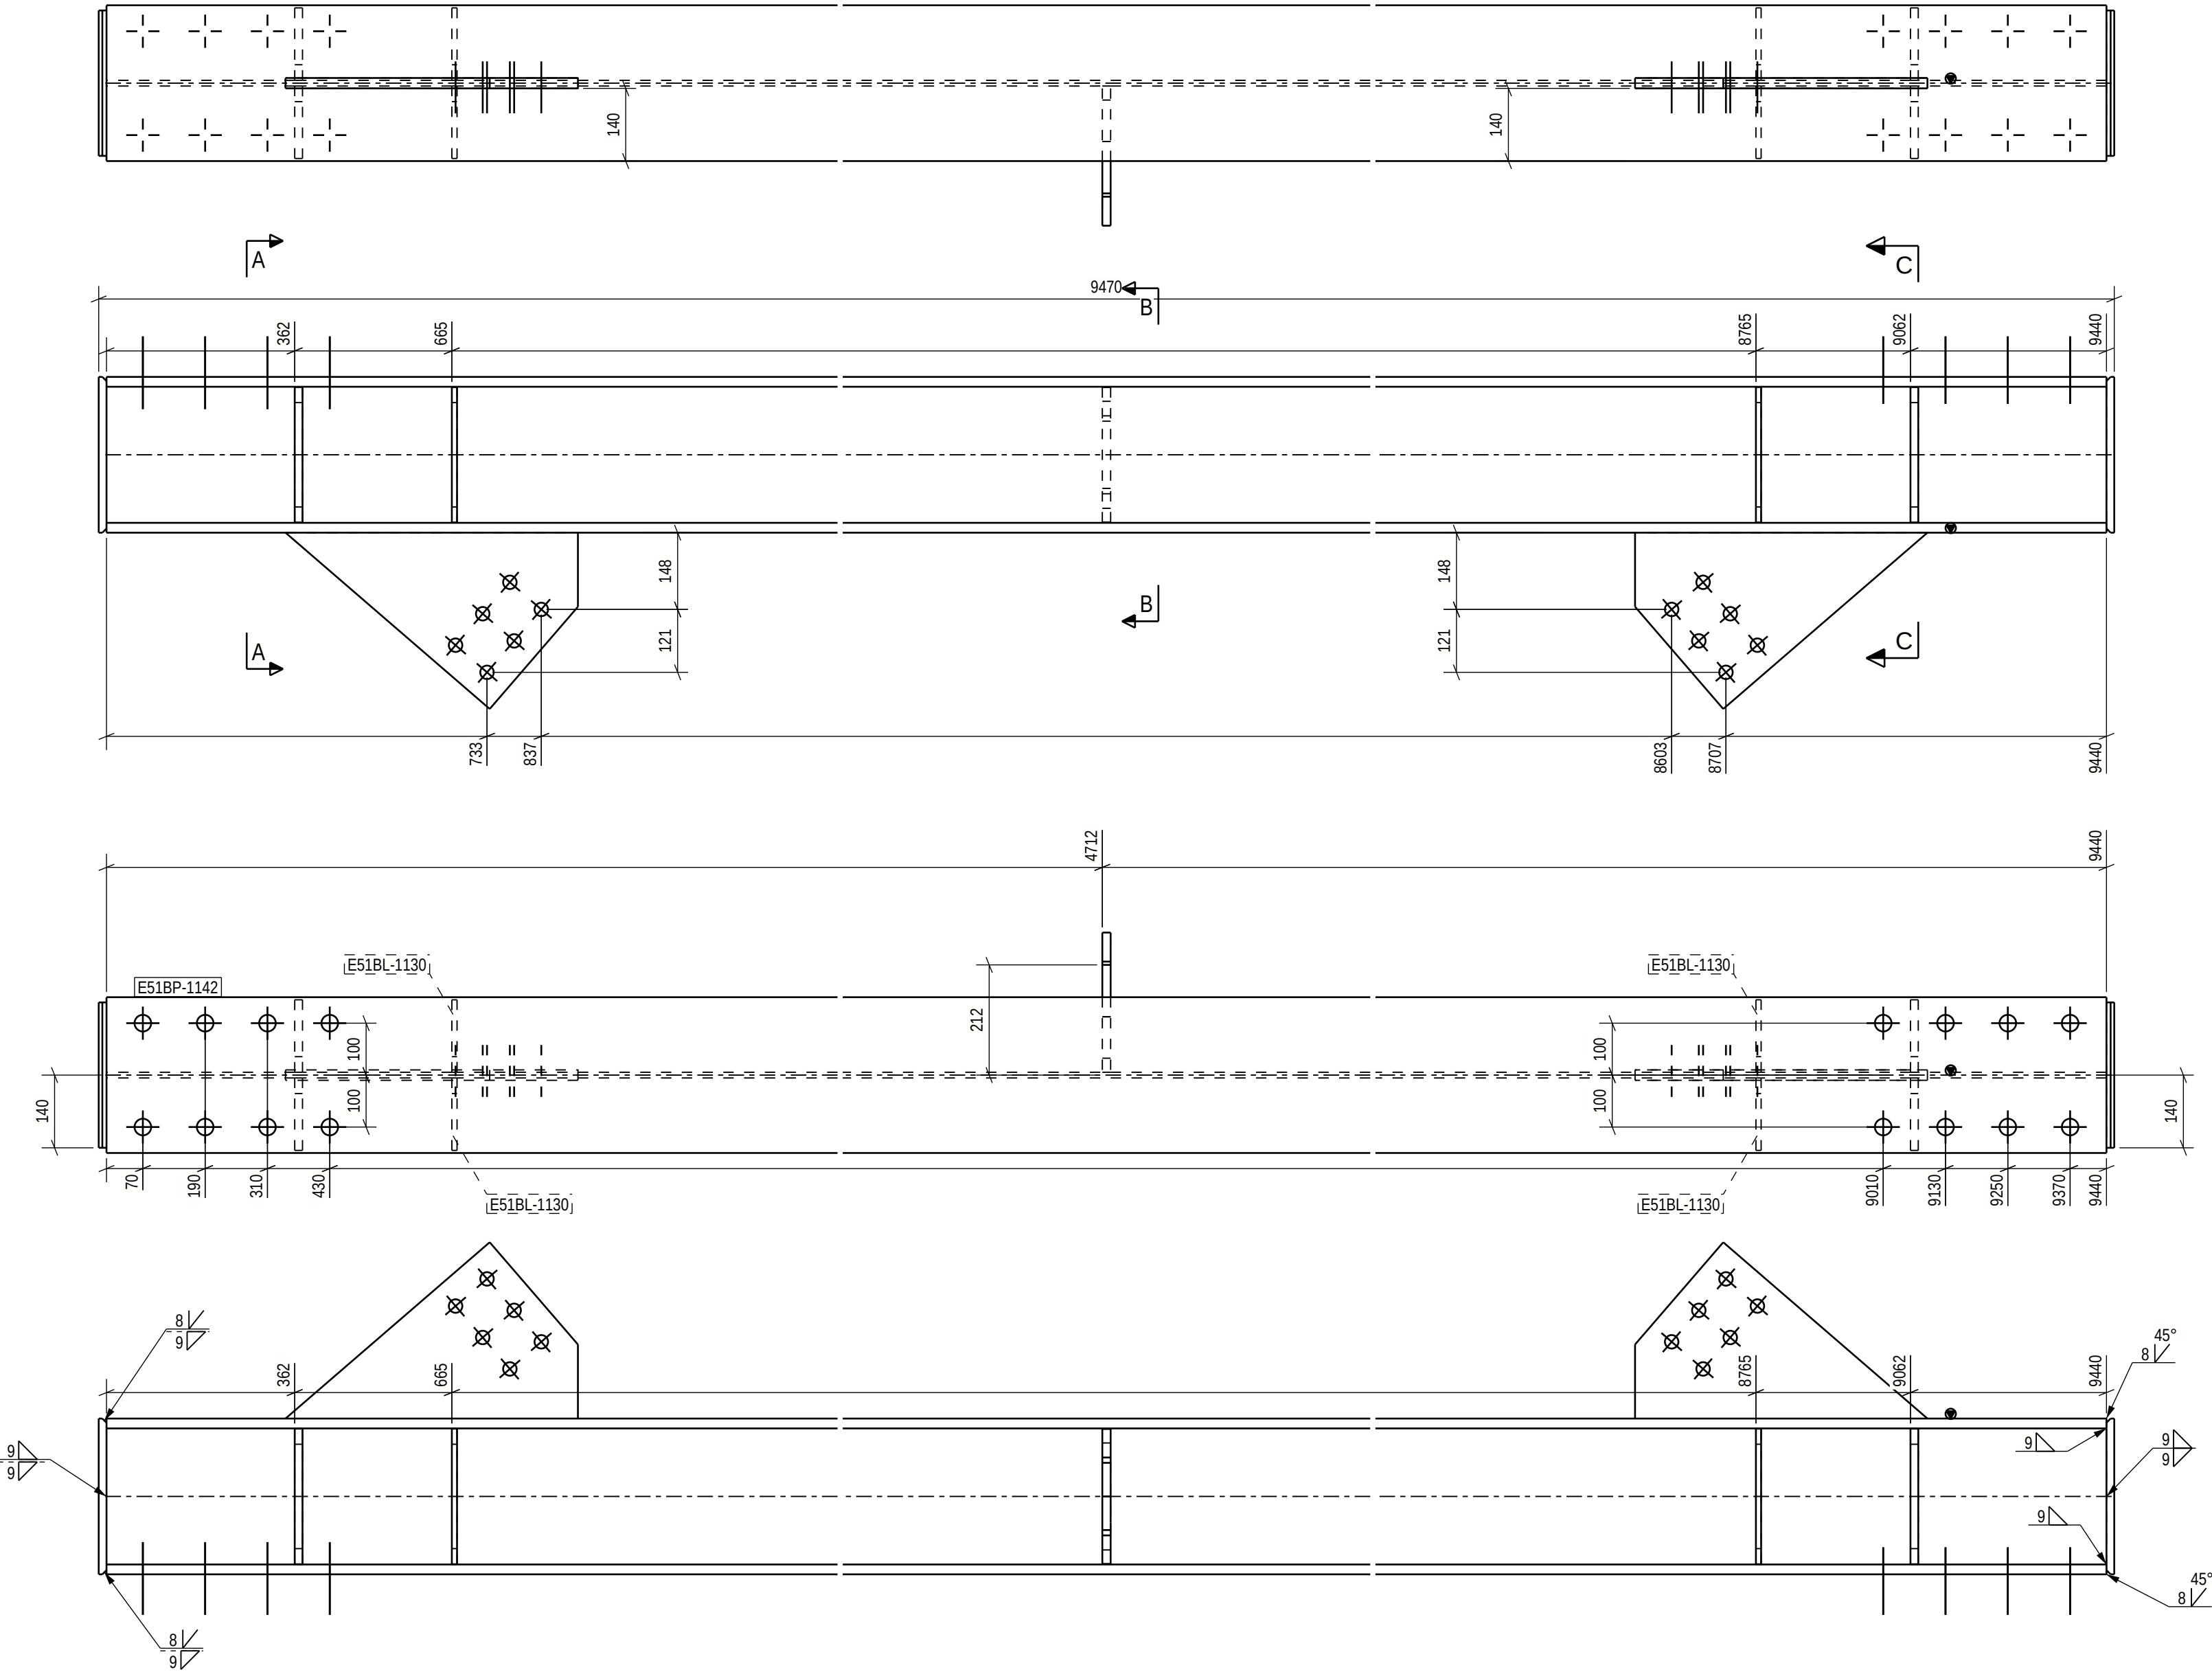

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction


PART LIST FOR ASSEMBLY E51B-1196, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1128	PL15X140	S355J2+N	261	0.33	4.2	4
E51BL-1129	PL15X280	S355J2+N	300	0.37	9.8	2
E51BL-1130	PL10X140	S355J2+N	261	0.32	2.8	4
E51BL-1134	PL16X266	S355J2+N	279	0.11	6.0	1
E51BP-1142	HEB300	S355J2	9440	16.35	1104.9	1
E51WCL-1103	PL20X339	S355J2+N	563	0.49	16.9	2
TOTAL:				17.97	1192.5	

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005		
Surface preparation grade ISO8501-3, grade P2		
Surface treatment ISO12944-5		
Additional requirements on surface treatment C3.07, EPPUR 240/2		
Shade RAL 7024 (Graphite Gray)		
Welding of built up steel section Appendix 1 / Project spec.		
Welds, if not specified otherwise EN 9692-1, EN 9692-2		
Fabrication tolerances EN 1090-2, Appendix B		
Special fabrication tolerances Project specification/ shown on drwg.		
Weld inspection, requirements EN 1090-2, Table 24, U>0.5		
Extent of NDT, fillet welds MT-EN1290, 20% of welds		
Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds		
Requirements on bolting UT, EN-ISO17640, 100% of welds		
EN1090-2 Section 6.6.3		
Weld class C, EN ISO 5817		
Additional material inspection Shown on drwg.		

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi



DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1196



DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Kivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51B-1196		

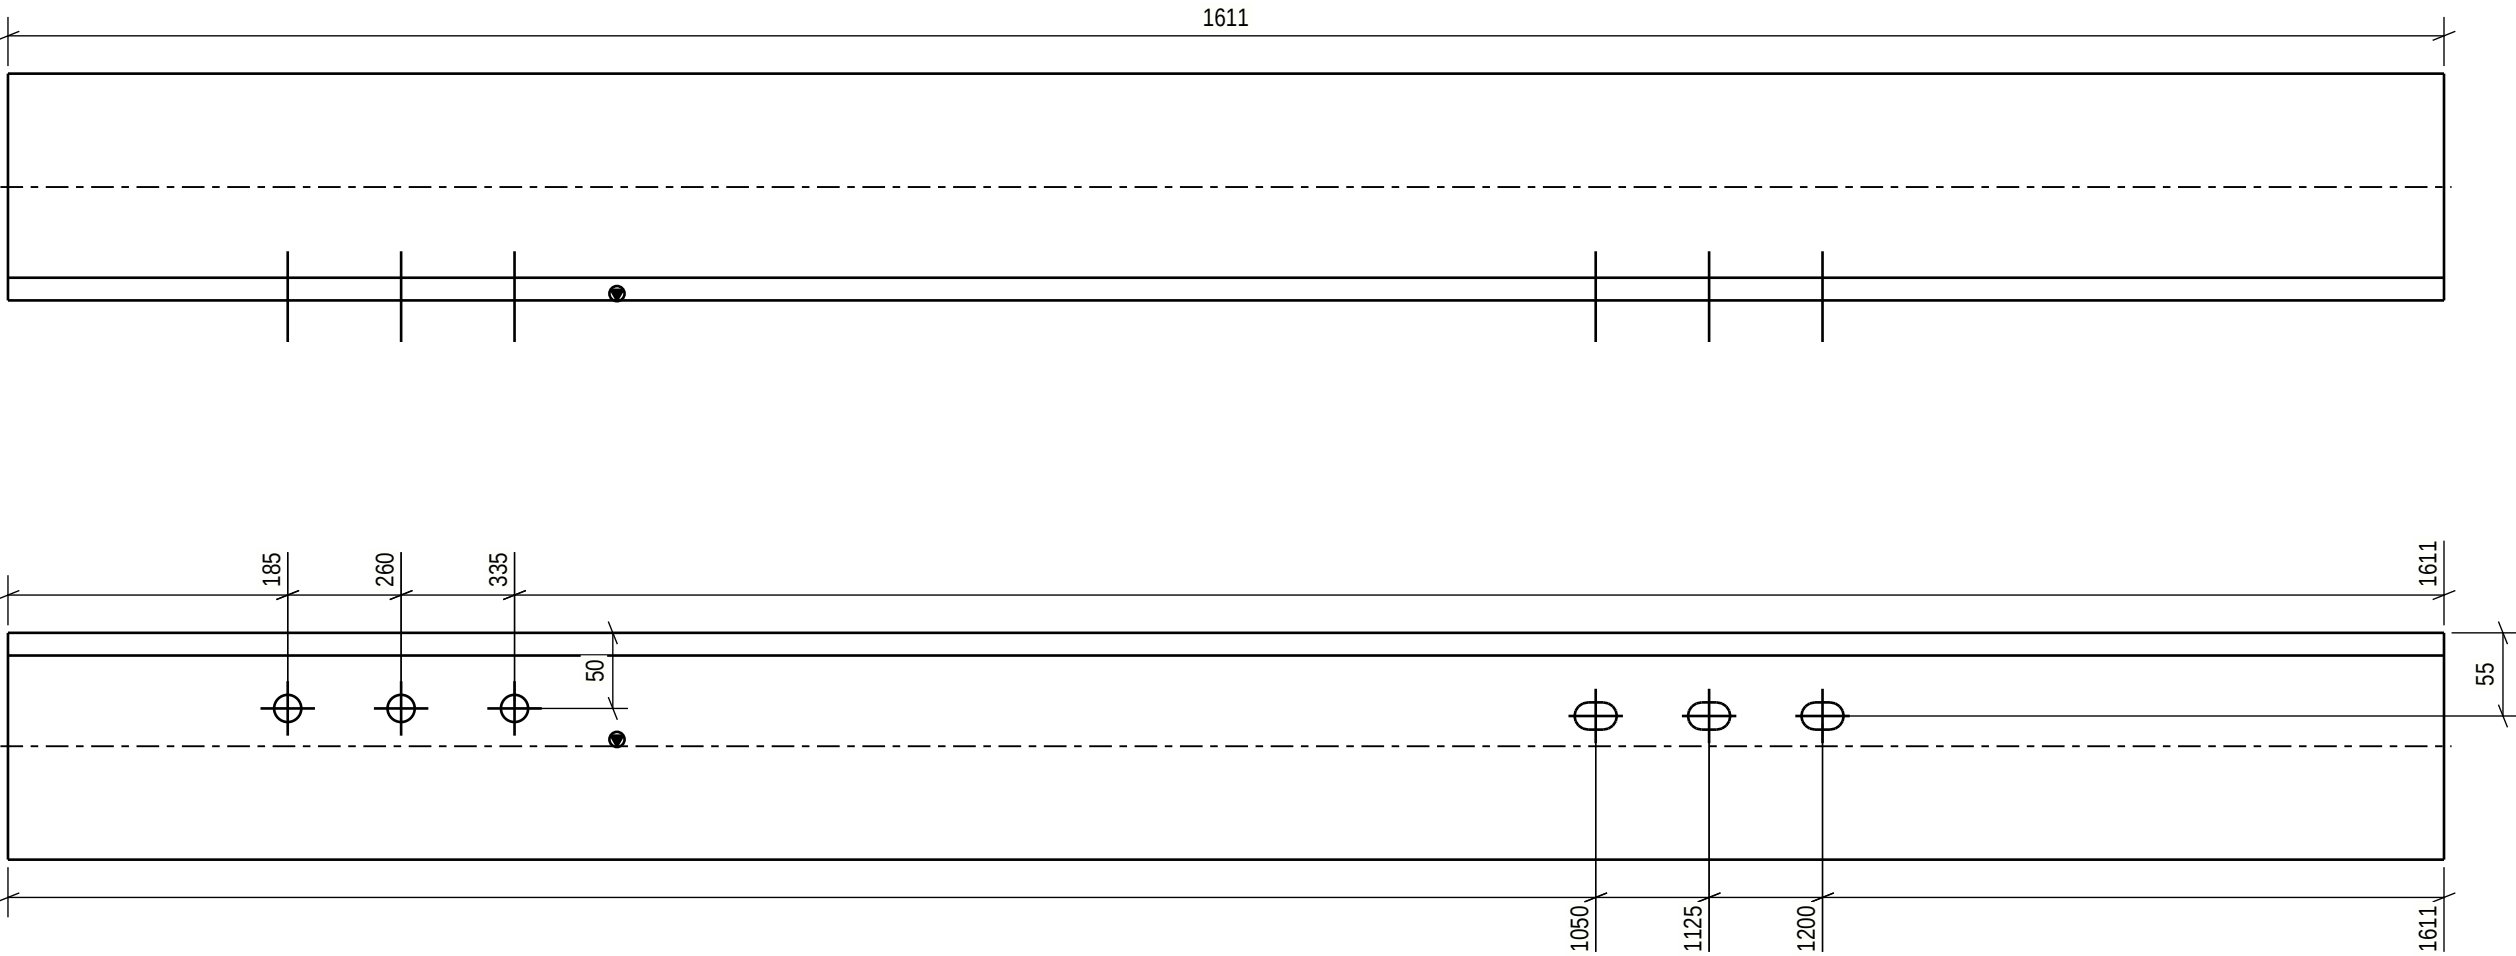

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PART LIST FOR ASSEMBLY E51B-1197, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BP-1148	L150*15	S355J2	1611	0.94	54.4	1
TOTAL:				0.94	54.4	

Technical fabrication requirements:		Execution class EXC2		Approved For Construction													
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		Fabrication tolerances EN 1090-2, Appendix B		PROJECT NAME Easpring New Materials Oy FAIR Phase 1  SWECO Sustainable engineering and design		DATE 16.06.2026 DRAWN Alexey Serous PROJECT NUMBER 25019443		DRAWING CONTENT ASSEMBLY DRAWING BRACE_VER E51B-1197 ARCHIVING CODE PAGE DESIGNER Alexey Serous APPROVED Pertti Koivumaaanaho CHECKED Jere Kallosalmi REVISION E51B-1197									
Execution Specification document nr 25019443-ICC250-0600-0660-000005		Special fabrication tolerances Project specification/ shown on drwg.															
Surface preparation grade ISO8501-3, grade P2		Weld inspection, requirements EN 1090-2,Table 24, U>0.5															
Surface treatment ISO12944-5		Extent of NDT, fillet welds MT-EN1290,20% of welds															
Additional requirements on surface treatment C3.07, EPPUR 240/2		Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds		SWECO RAKENNETEKNIikka OY ILMALANPORTTI 2 00240 HELSINKI PUH. +358 207 393 000 www.sweco.fi		DRAWING CONTENT ASSEMBLY DRAWING BRACE_VER E51B-1197		DATE 16.06.2026		ARCHIVING CODE PAGE DESIGNER Alexey Serous		APPROVED Pertti Koivumaaanaho		CHECKED Jere Kallosalmi		REVISION	
Shade RAL 7024 (Graphite Gray)		Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100%of welds															
Welding of built up steel section Appendix 1 / Project spec.		Requirements on holing EN1090-2 Section 6.6.3															
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Weld class C, EN ISO 5817		Additional inspection Shown on drwg.													

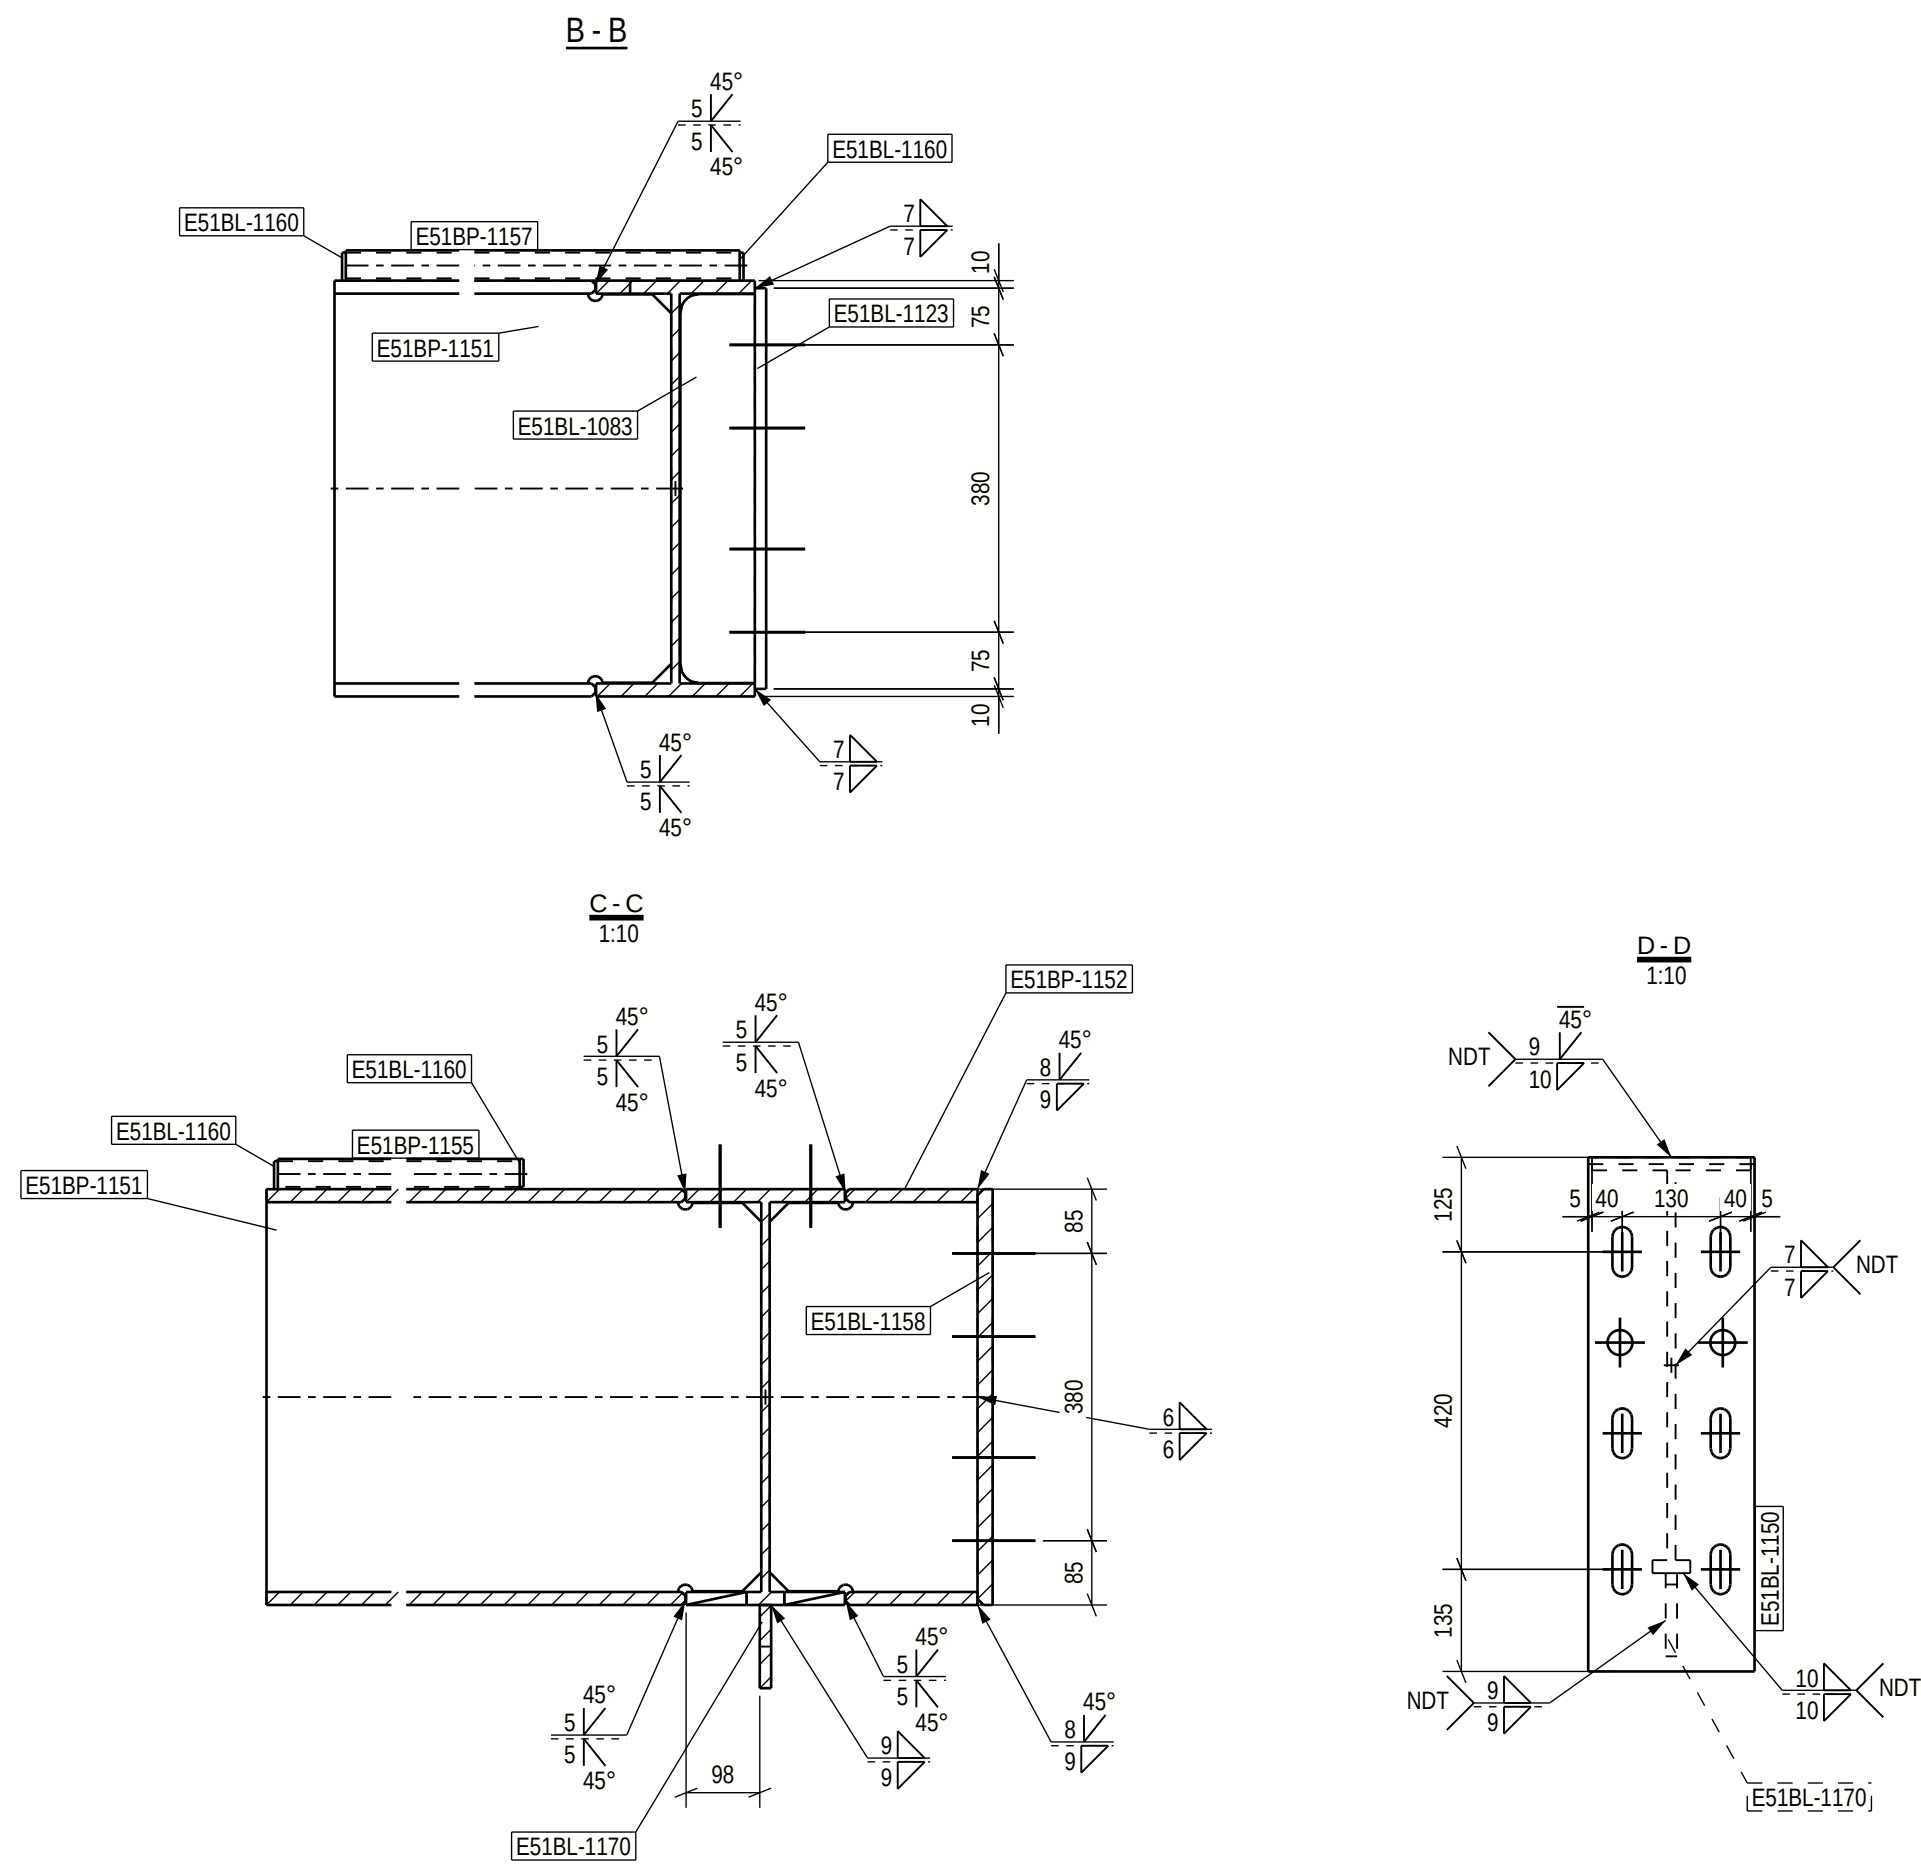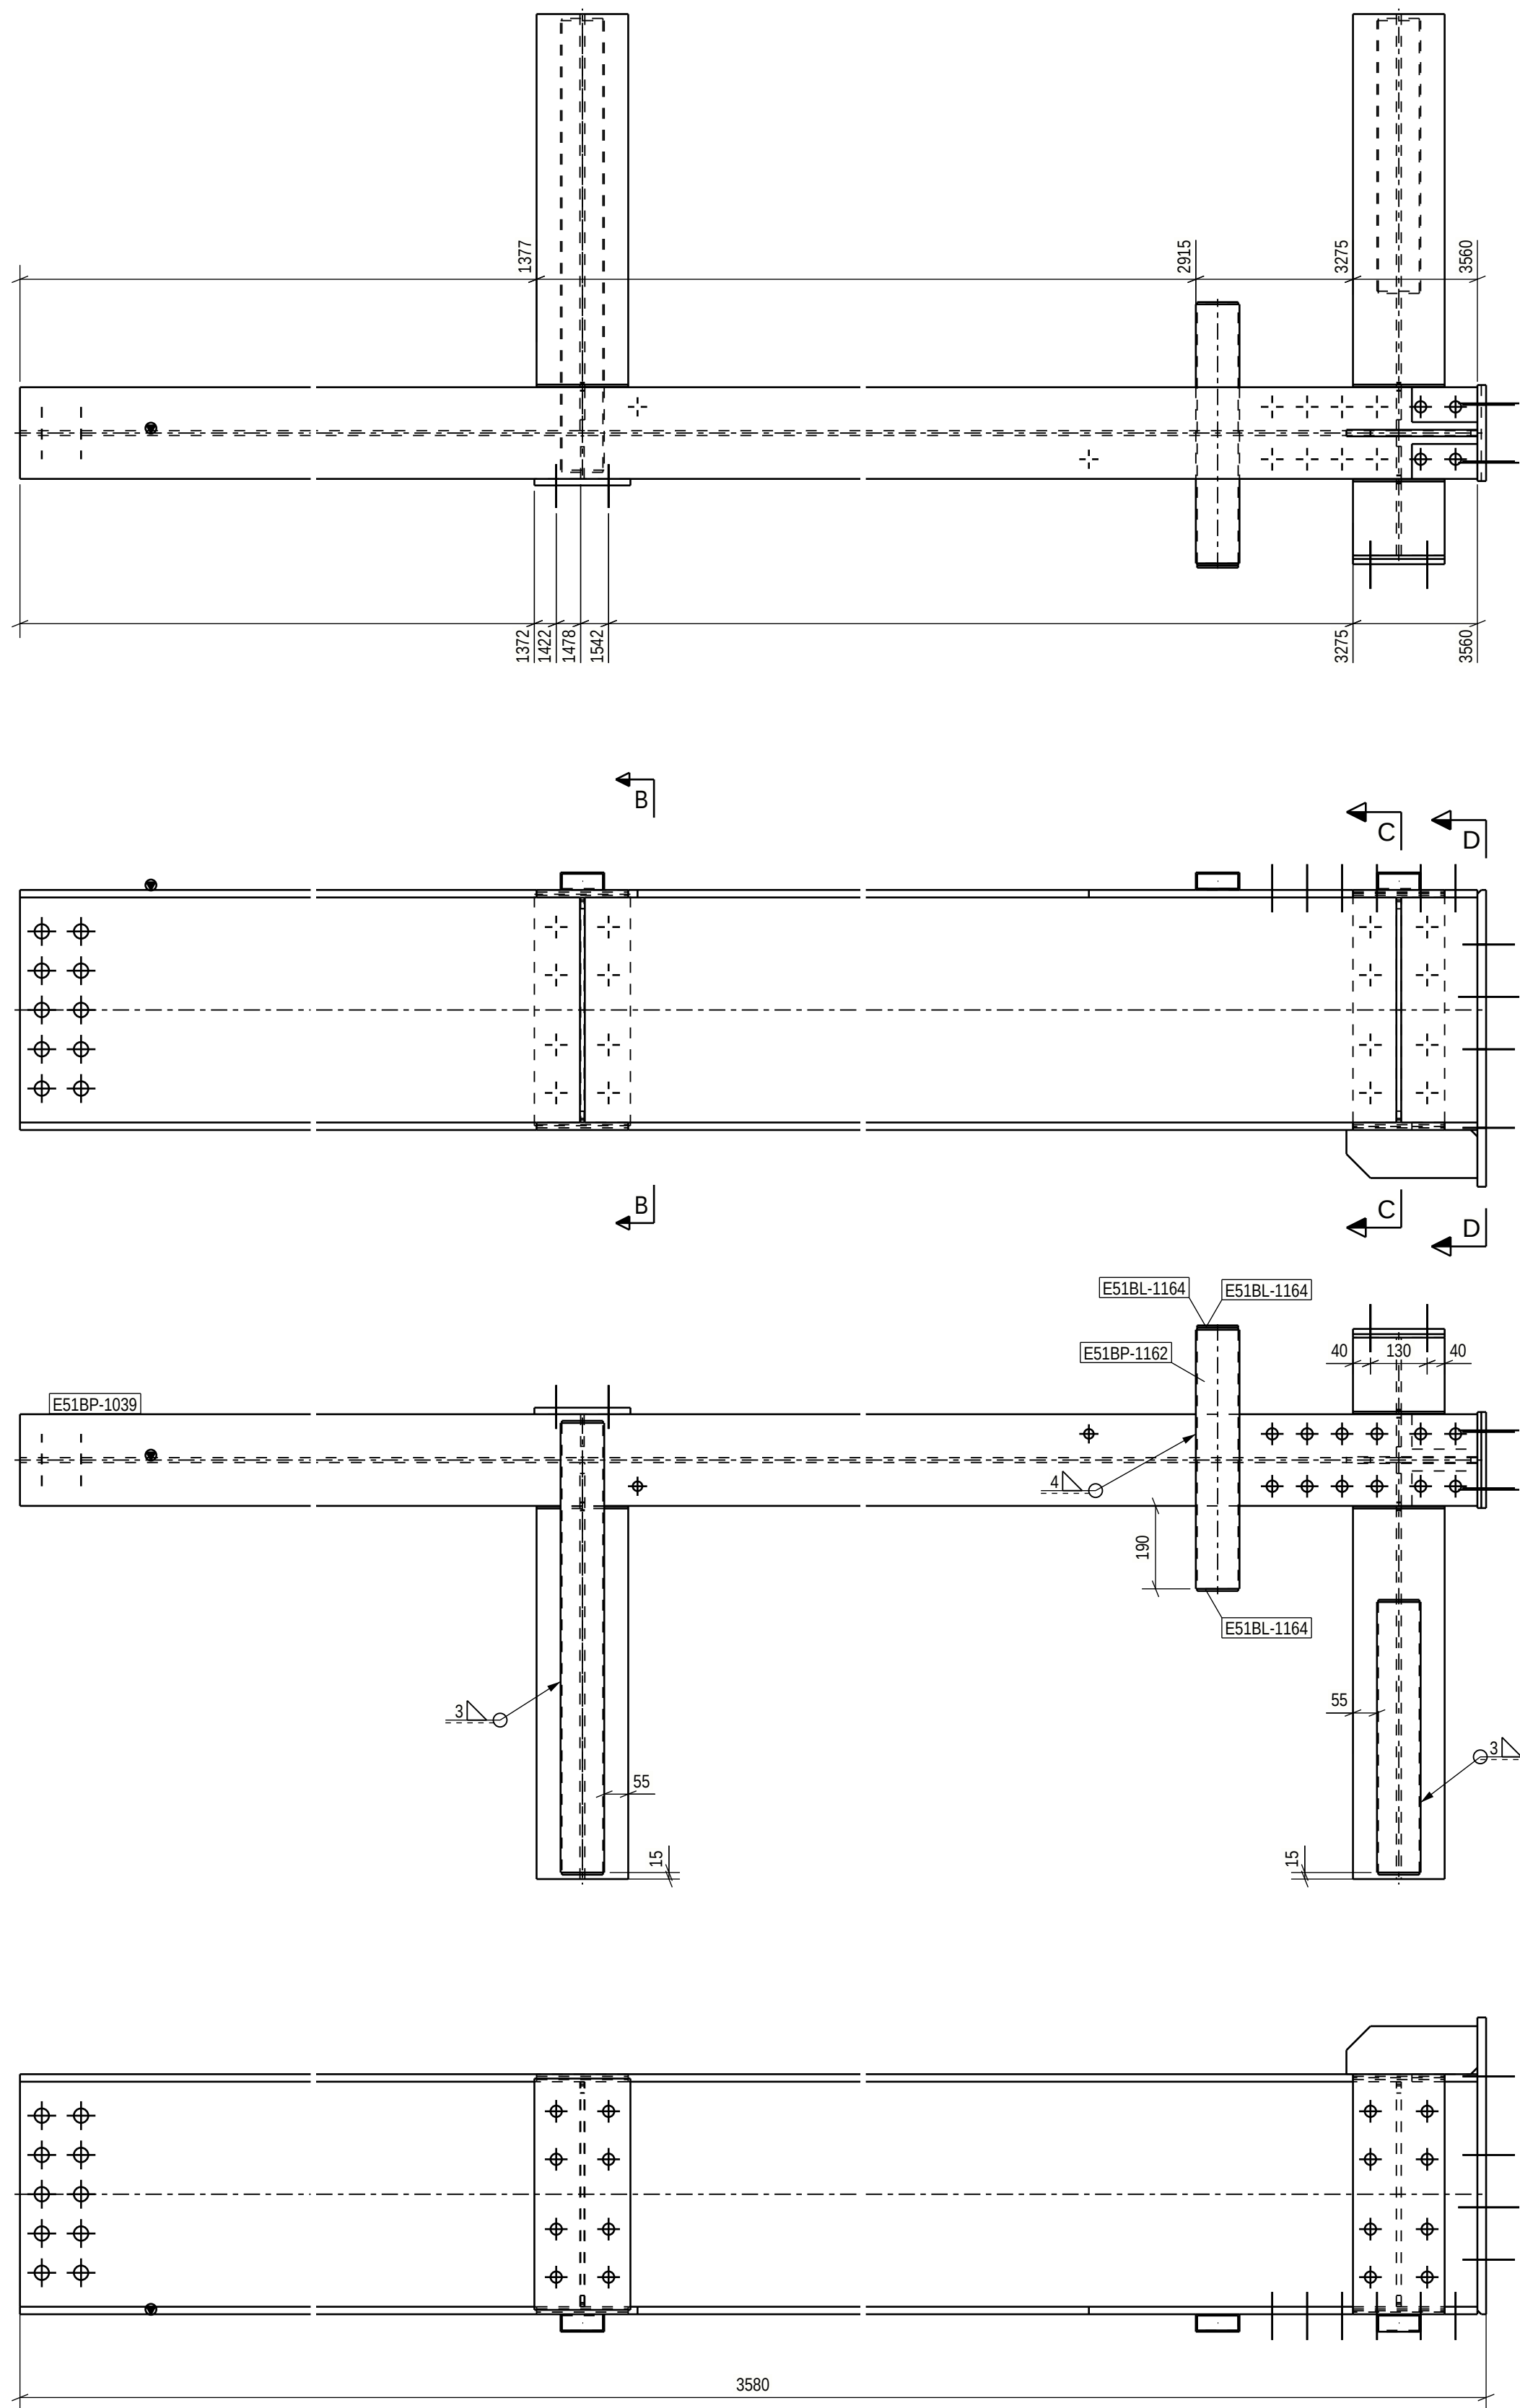

PART LIST FOR ASSEMBLY E51B-1198, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH (mm)	AREA (m ²)	WEIGHT (kg)	PCS
E51BL-1083	PL8X98	S355J2+N	515	0.11	3.2	1
E51BL-1123	PL15X220	S355J2+N	530	0.26	13.7	1
E51BL-1150	PL20X220	S355J2+N	680	0.33	23.4	1
E51BL-1158	PL20X210	S355J2+N	550	0.26	18.0	1
E51BL-1160	PL5X37	S355J2+N	94	0.03	0.1	4
E51BL-1164	PL5X34	S355J2+N	94	0.02	0.1	3
E51BL-1170	PL15X110	S355J2+N	300	0.07	3.7	1
E51BP-1039	IPE550	S355J2	3560	6.68	374.5	1
E51BP-1151	IPE550	S355J2	954	3.58	100.4	2
E51BP-1152	IPE550	S355J2	275	0.52	28.9	1
E51BP-1155	CFRHS100X40X3	S355J2H	620	0.17	3.8	1
E51BP-1157	CFRHS100X40X3	S355J2H	1030	0.28	6.3	1
E51BP-1162	CFRHS100X40X3	S355J2H	593	0.16	3.6	1
TOTAL:			12.48	680.9		






Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard	Fabrication tolerances	
EN1090-2, table A.3: EXC2	EN 1090-2, Appendix B	
Execution Specification document nr	Special fabrication tolerances	
25019443-ICC250-0600-0660-000005	Project specification/ shown on drwg.	
Surface preparation grade	Weld inspection: requirements	
ISO8501-3, grade P2	EN 1090-2, Table 24, U>0.5	
Surface treatment	Extent of NDT, after welds	
ISO12944-5	MT-EN1290, 20% of welds	
Additional requirements on surface treatment	Extent of NDT, butt welds	
RAL 7024 (Graphite Gray)	UT, EN-ISO17640, 20% of welds	
C3.07, EPPUR 240/2	UT, EN-ISO17640, 100% of welds	
Welding of bulk up steel section	Requirements on testing	
Appendix 1 / Project spec.	EN1090-2 Section 6.6.3	
Welds, first specified otherwise	Weld class	
EN 9692-1, EN 9692-2	C, EN ISO 5817	
Additional material inspection		Shown on drwg

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME		DRAWING CONTENT	
Easpring New Materials Oy		ASSEMBLY DRAWING	
FAIR Phase 1		Beam	
		E51B-1198	
DATE		ARCHIVING CODE	PAGE
16.06.2026			
DESIGNER		APPROVED	CHECKED
Aleksy Serius		Pertti Kalliojärvi	Jere Kalliojärvi
PROJECT NUMBER		DWG. NO.	REVISION
25019443			
E51B-1198			




SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
WWW.SWECO.FI

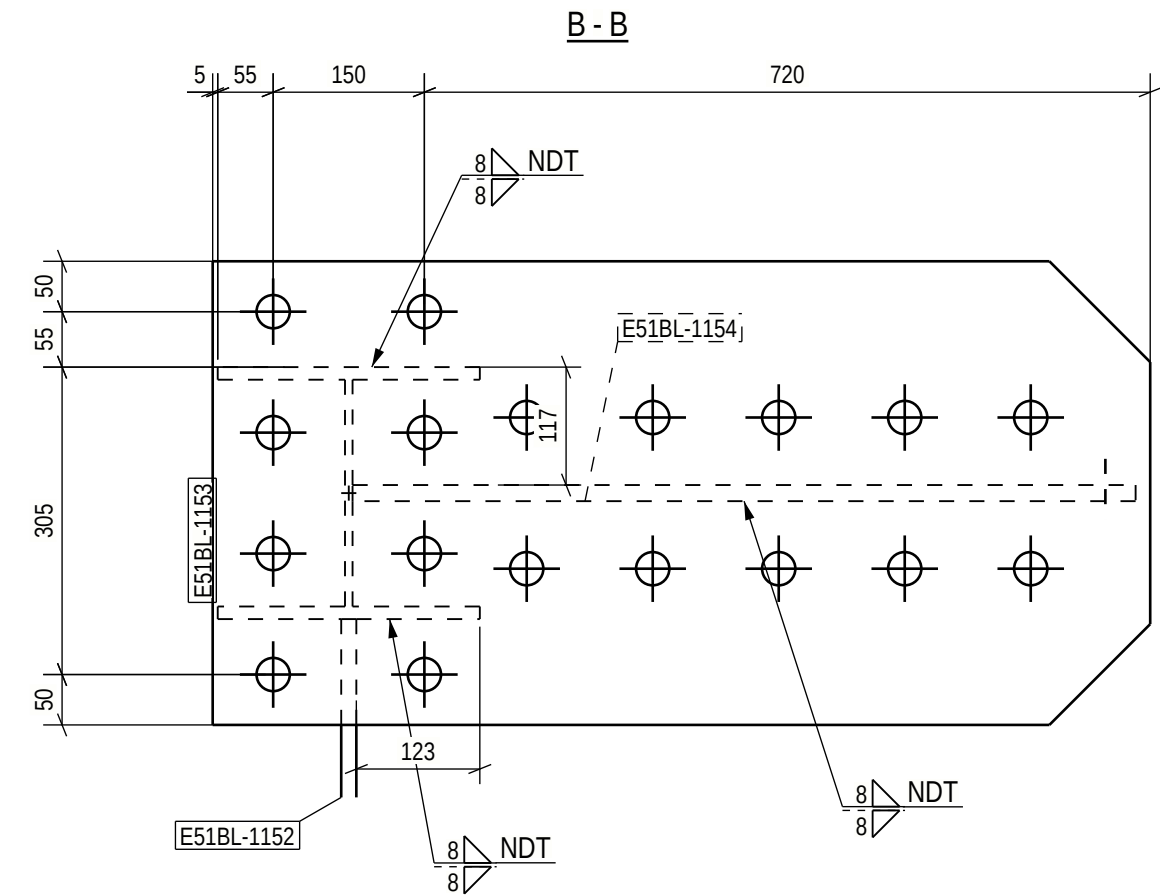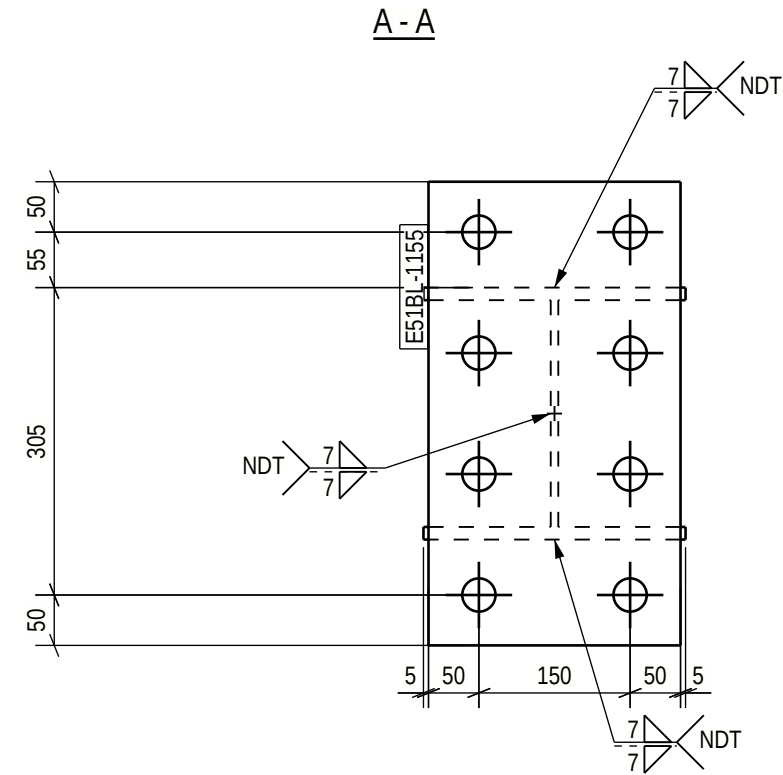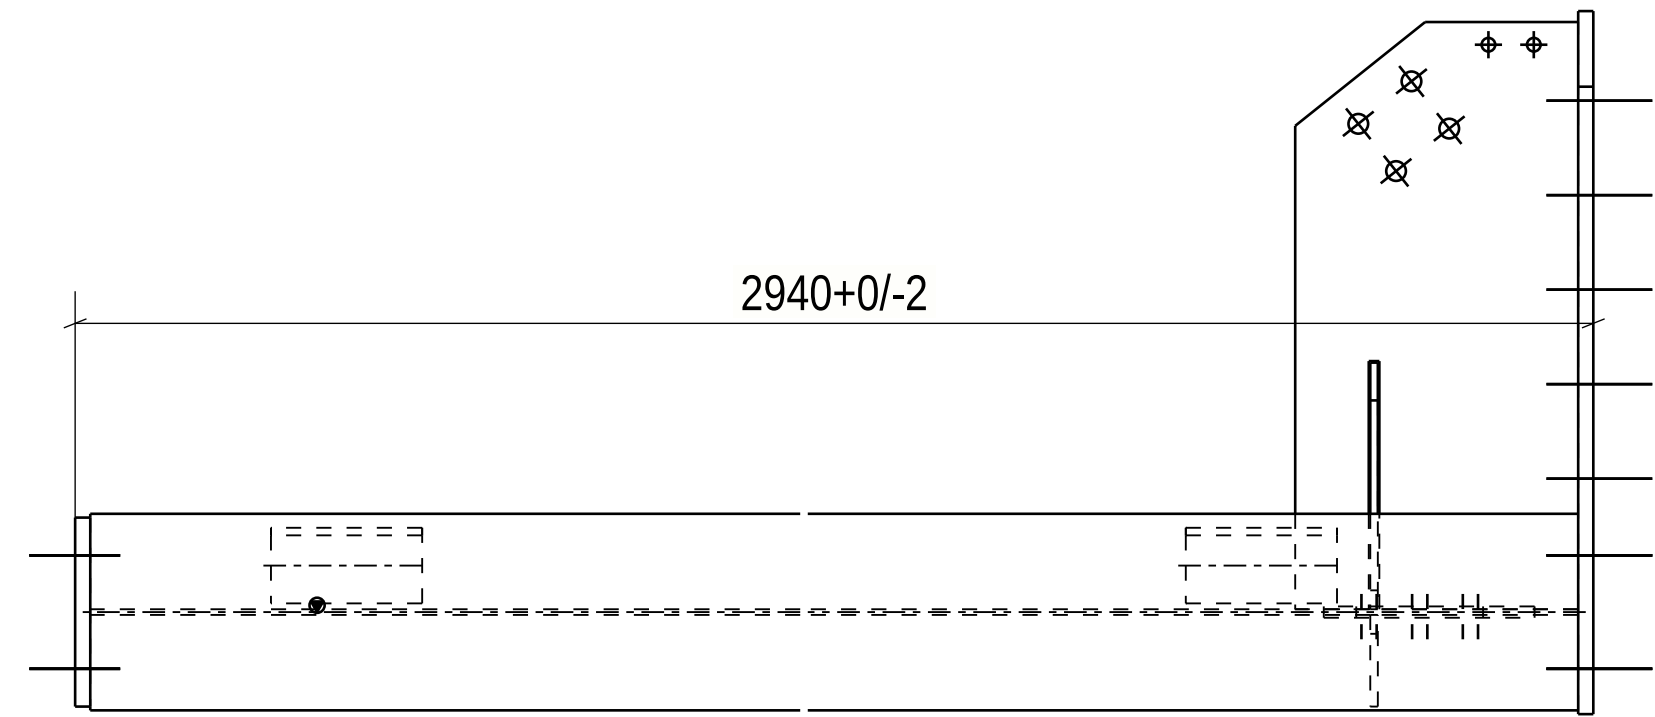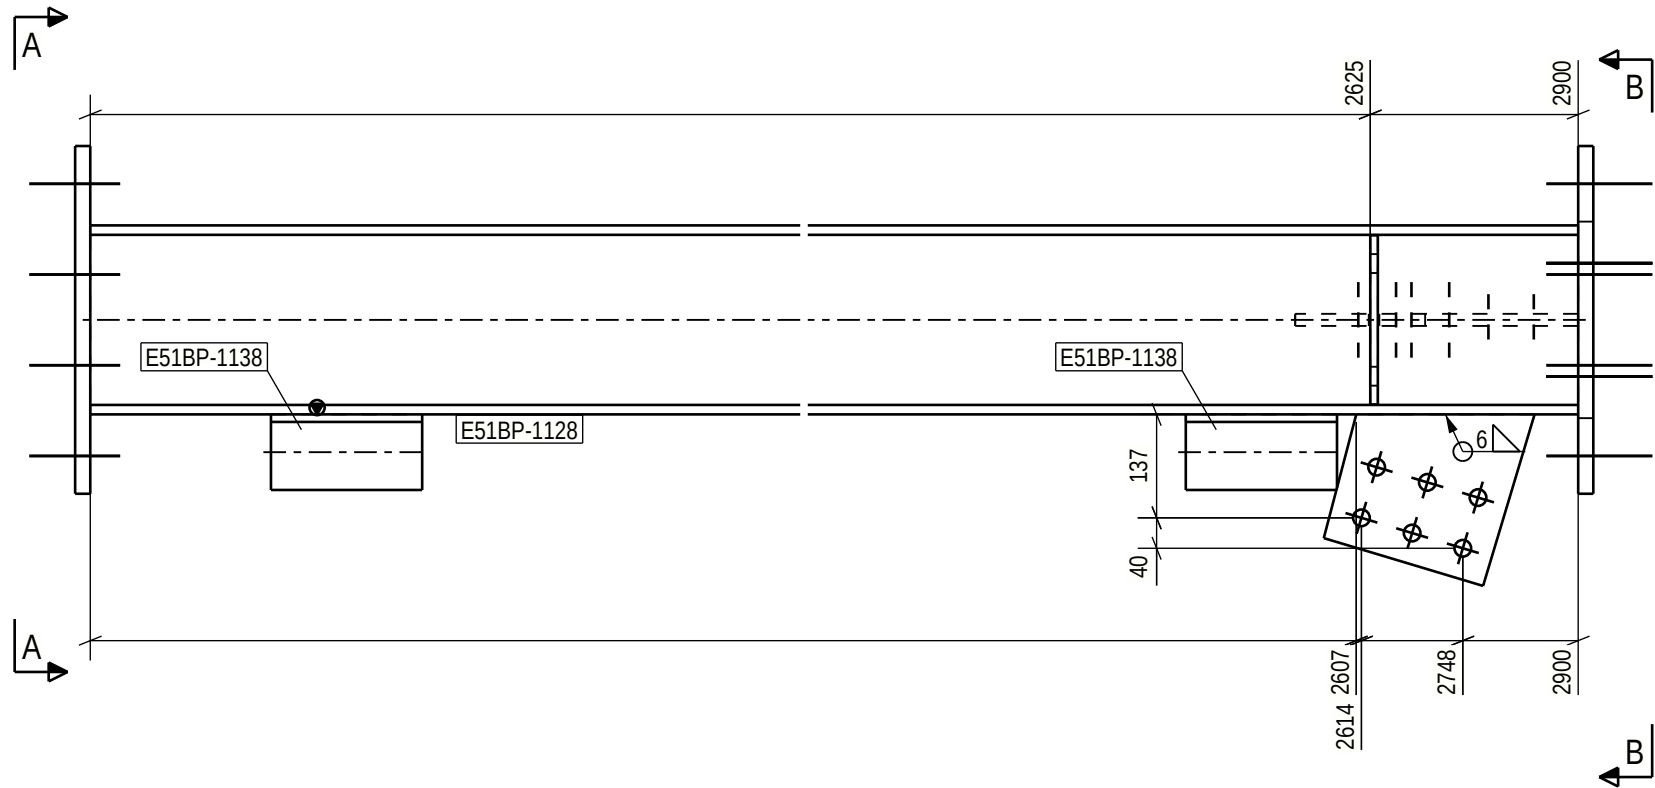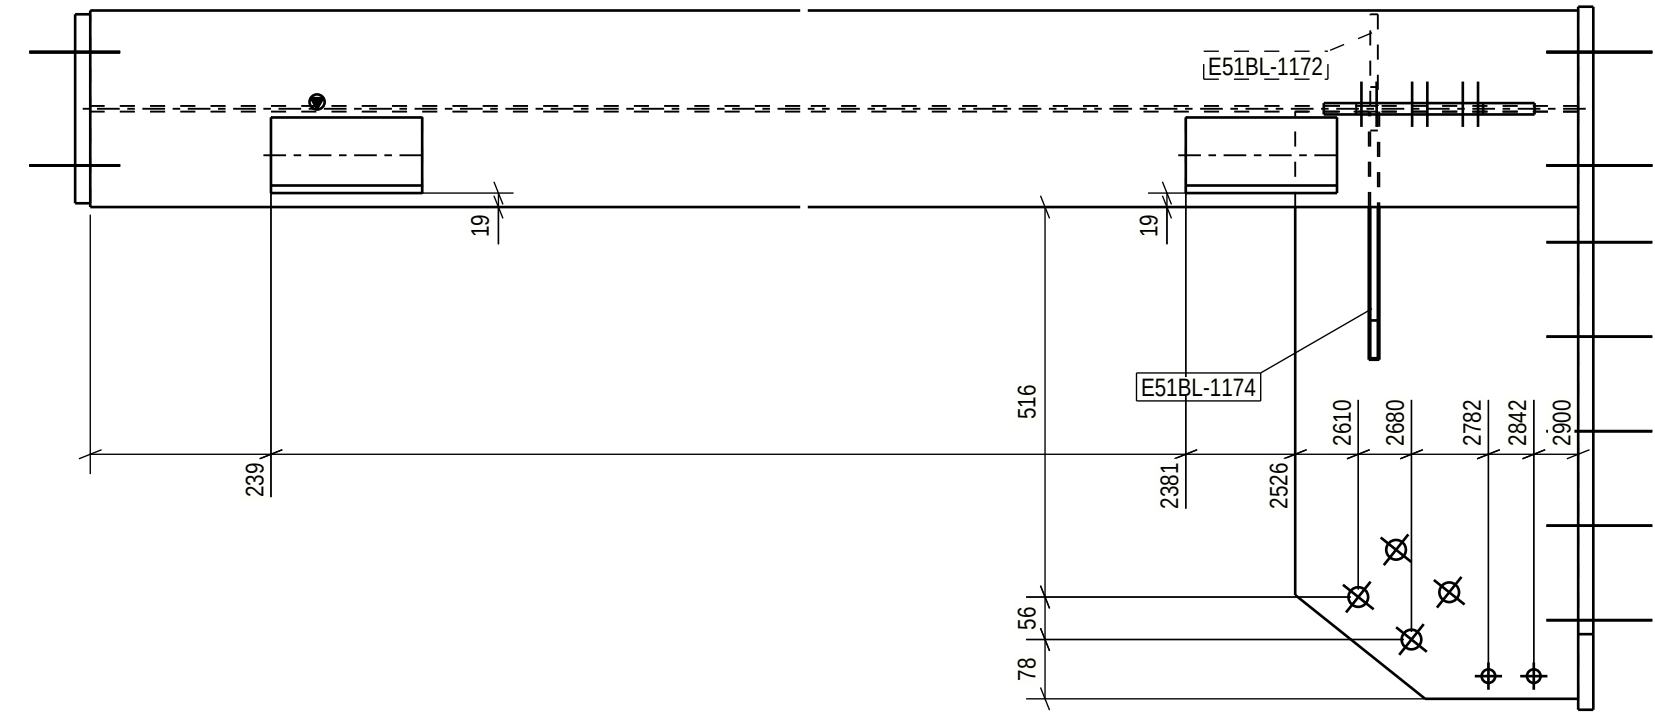

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1199

SWECO
Sustainable engineering and design



SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Kivumaa	Jere Kalliosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51B-1199		

25019443_Fair_E500

PART LIST FOR ASSEMBLY E51B-1199, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1152	PL15X226	S355J2+N	237	0.10	5.3	1
E51BL-1153	PL20X930	S355J2+N	460	0.89	65.6	1
E51BL-1154	PL16X374	S355J2+N	777	0.59	34.5	1
E51BL-1155	PL20X250	S355J2+N	460	0.26	18.1	1
E51BL-1172	PL10X121	S355J2+N	224	0.06	2.1	1
E51BL-1174	PL10X224	S355J2+N	326	0.15	5.5	1
E51BP-1128	HEA260	S355J2	2900	4.30	197.7	1
E51BP-1138	L100*10	S355J2	200	0.16	3.0	2
TOTAL:				6.52	334.8	

Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard EN1090-2, table A.3: EXC2 Execution Specification document nr 25019443-ICC250-0600-0660-000005	Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg.	
Surface preparation grade ISO8501-3, grade P2	Weld inspection, requirements EN 1090-2, Table 24, U>0.5	
Surface treatment ISO12944-5	Extent of NDT, fillet welds MT-EN1290, 20% of welds	
Additional requirements on surface treatment C3.07, EPPUR 240/2	Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Shade RAL 7024 (Graphite Gray)	Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds	
Welding of built up steel section Appendix 1 / Project spec.	Requirements on holing EN1090-2 Section 6.6.3	
Welds, if not specified otherwise EN 9692-1, EN 9692-2	Weld class C, EN ISO 5817	Additional material inspection Shown on drwg.

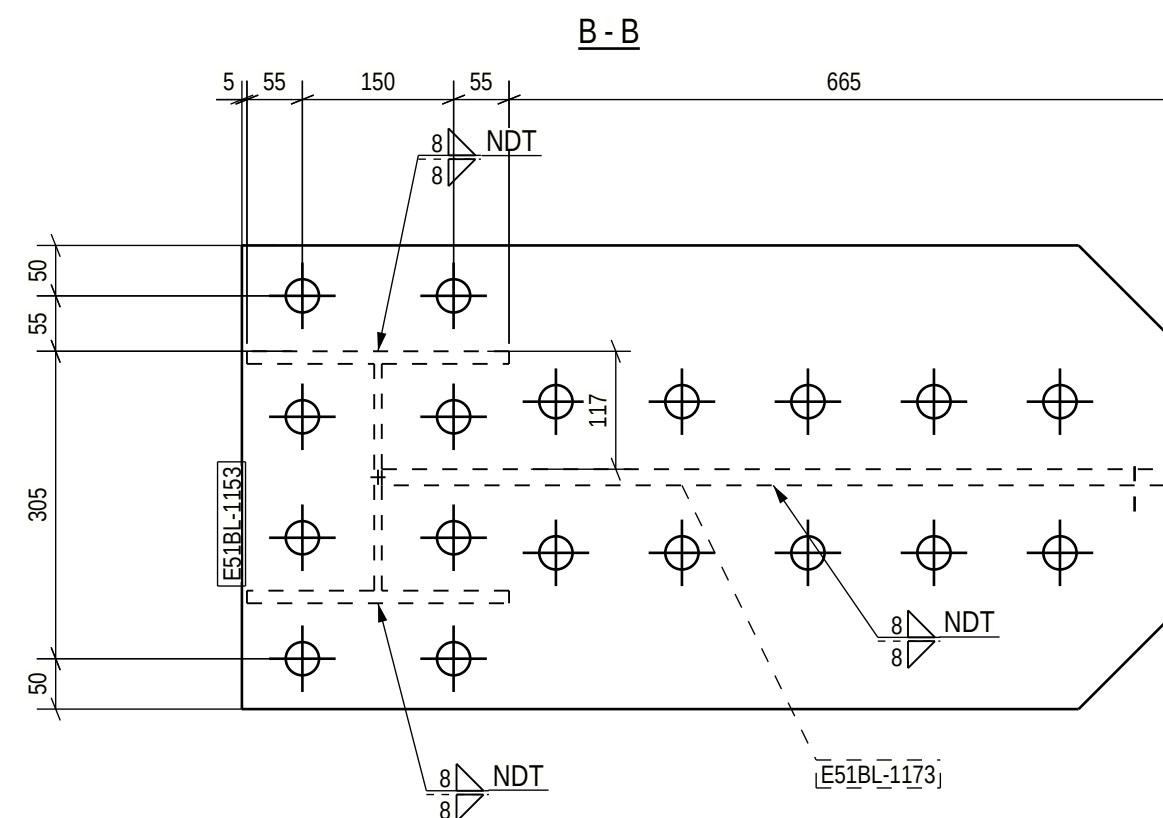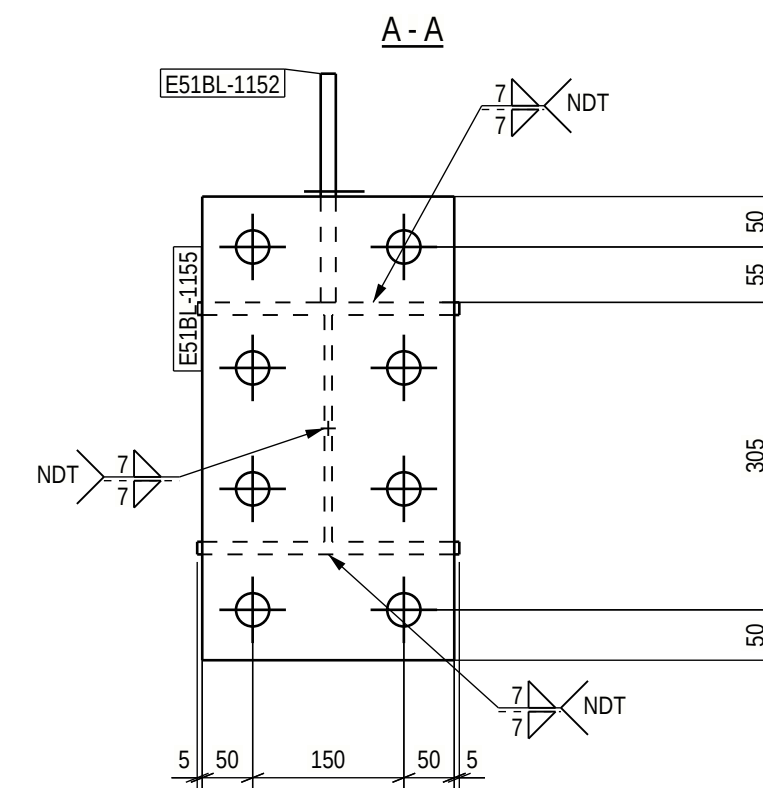




Technical fabrication requirements:		Execution class EXC2
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution specification document nr 25019443-ICC250-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 of Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2	Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on holding EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817	Additional material inspection Shown on drwg.

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1200

25019443 Fair F500

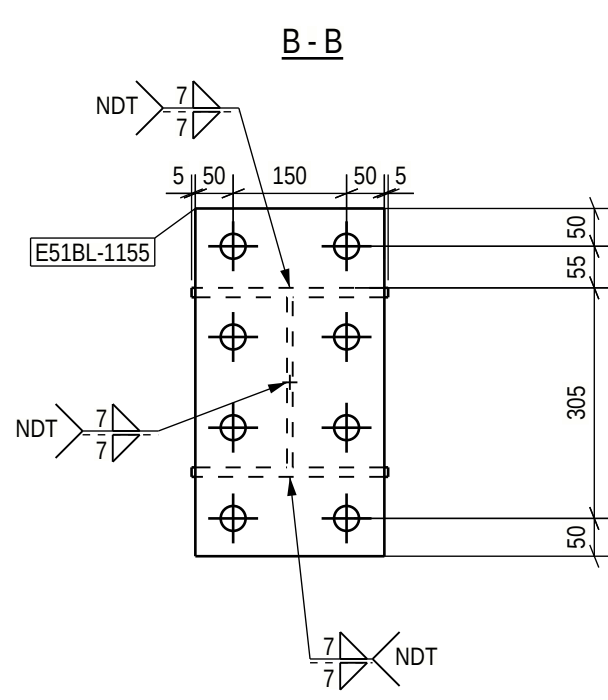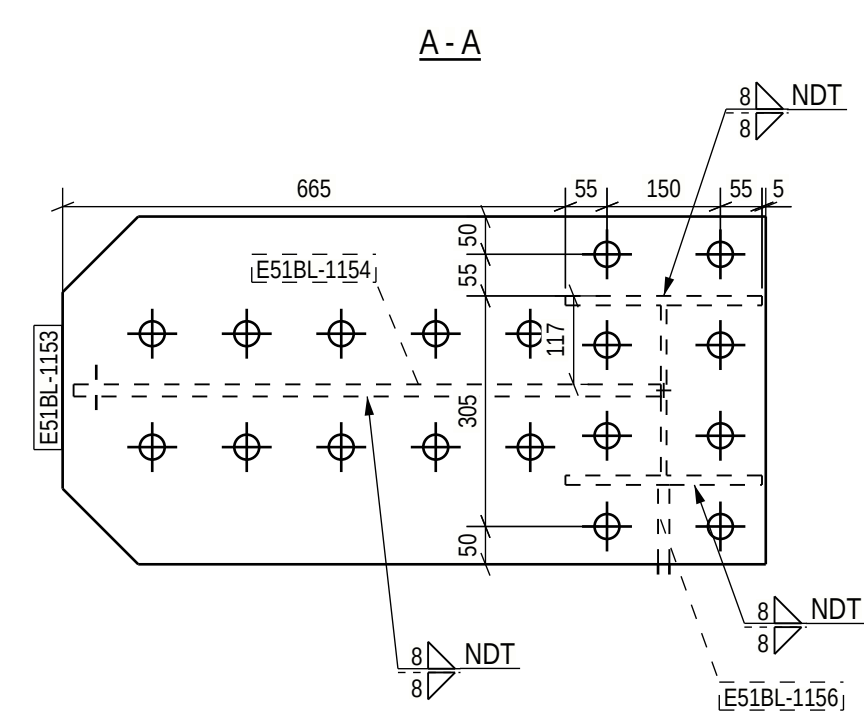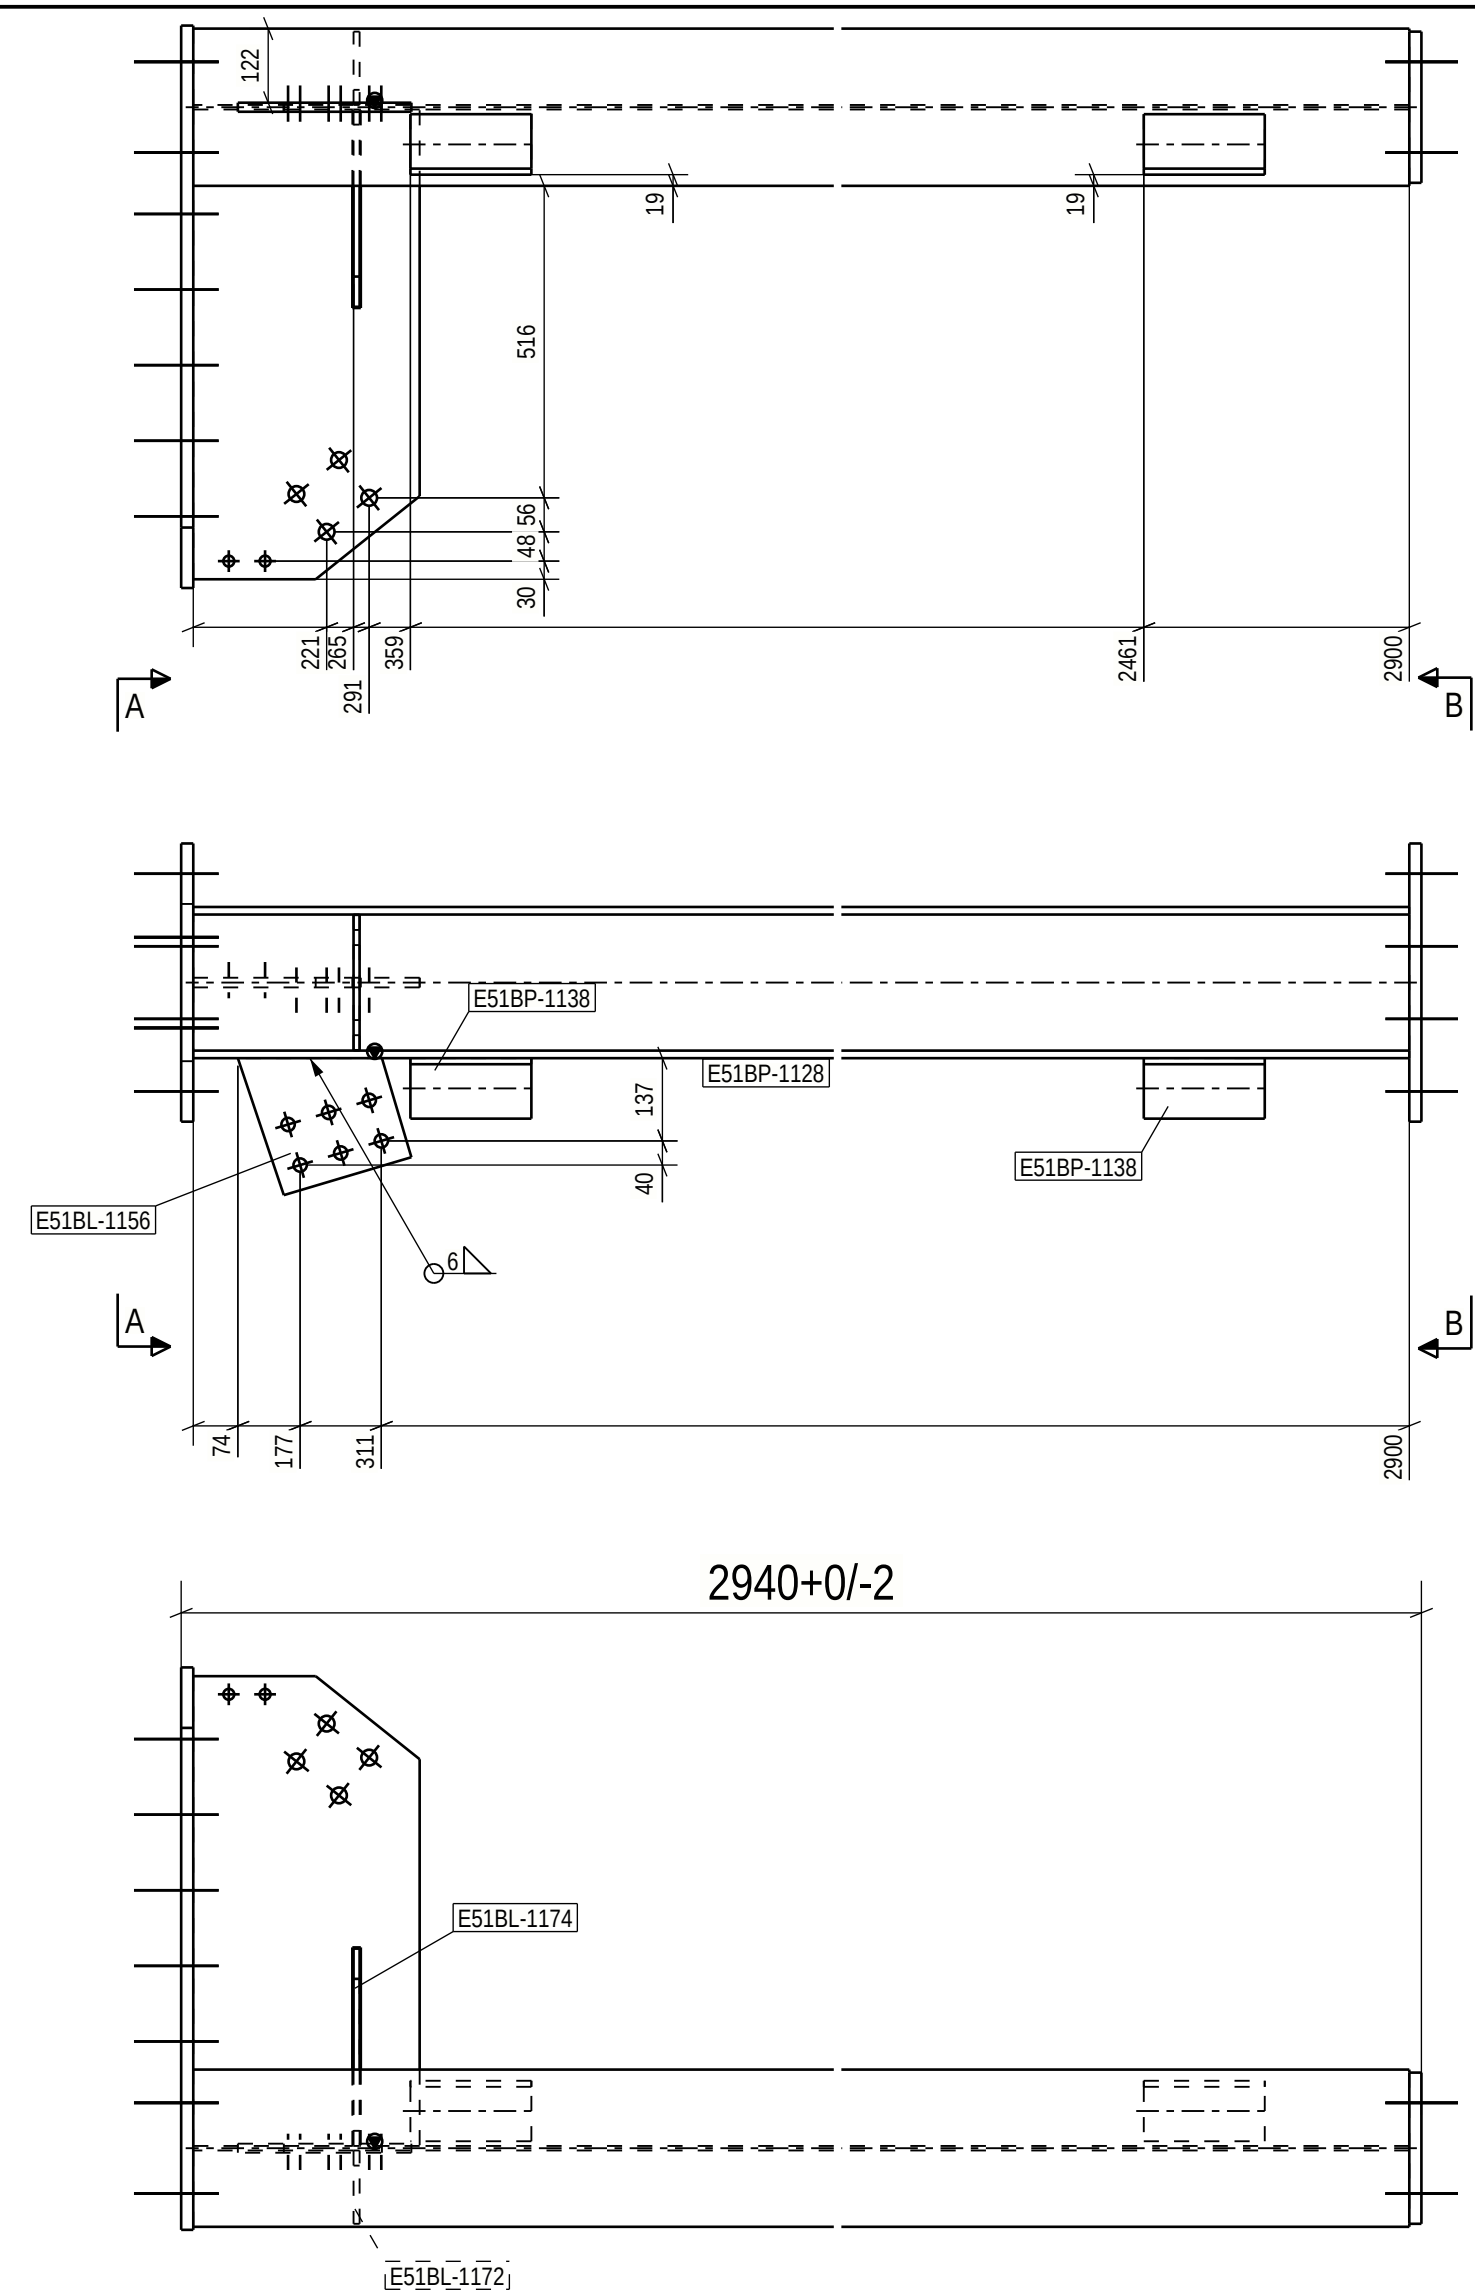

PART LIST FOR ASSEMBLY E51B-1201, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1153	PL20X930	S355J2+N	460	0.89	65.6	1
E51BL-1154	PL16X374	S355J2+N	777	0.59	34.5	1
E51BL-1155	PL20X250	S355J2+N	460	0.26	18.1	1
E51BL-1156	PL15X239	S355J2+N	228	0.10	5.4	1
E51BL-1172	PL10X121	S355J2+N	224	0.06	2.1	1
E51BL-1174	PL10X224	S355J2+N	326	0.15	5.5	1
E51BP-1128	HEA260	S355J2	2900	4.30	197.7	1
E51BP-1138	L100*10	S355J2	200	0.16	3.0	2
TOTAL:				6.52	334.8	

Technical fabrication requirements:

EXC2

Requirements for fabrication, standard
EN1090-2, table A.3 : EXC2
Execution Specification document nr
25019443-ICC250-0600-0660-000005
Surface preparation grade
ISO8501-3, grade P2
Surface treatment
ISO12944-5
Additional requirements on surface treatment
C3.07, EPPUR 240/2
Shade
RAL 7024 (Graphite Gray)
Welding of built up steel section
Appendix 1 / Project spec.
Welds, if not specified otherwise
EN 9692-1, EN 9692-2

Fabrication tolerances
EN 1090-2, Appendix B
Special fabrication tolerances
Project specification/ shown on drwg.
Weld inspection, requirements
EN 1090-2, Table 24, U>0.5
Extent of NDT, fillet welds
MT-EN1290, 20% of welds
Extent of NDT, butt welds
UT, EN-ISO17640, 20% of welds
UT, EN-ISO17640, 100% of welds
Requirements on holing
EN1090-2 Section 6.6.3
Weld class
C, EN ISO 5817

Execution class
EXC2
Additional material inspection
Shown on drwg.

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



SWECO RAKENNTEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi




DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1201

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalilosalmi
PROJECT NUMBER 25019443	DWG. NO.	REVISION	

E51B-1201

25019443_Fair_E500

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

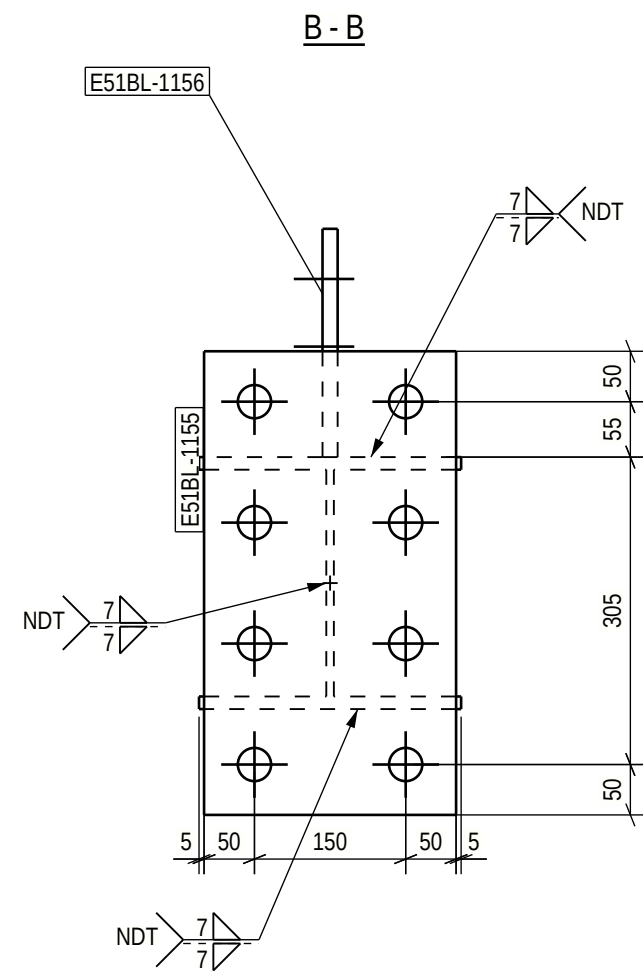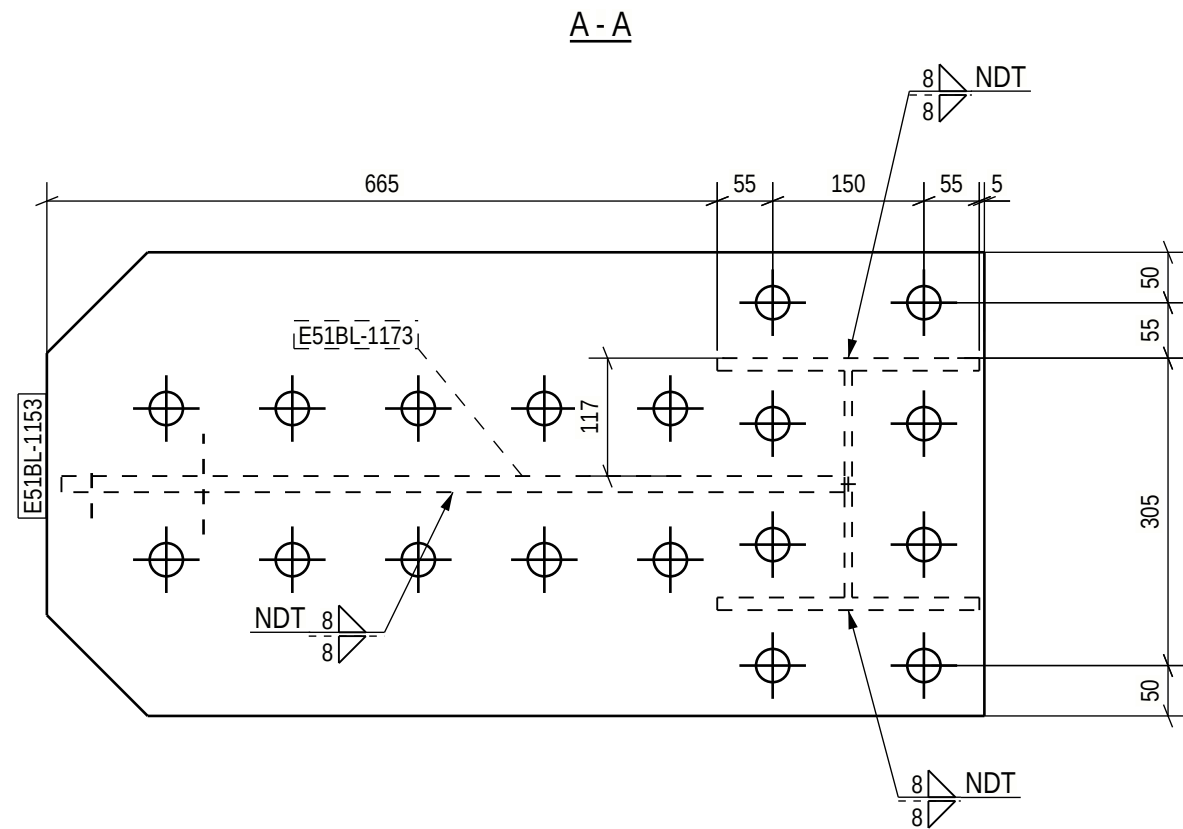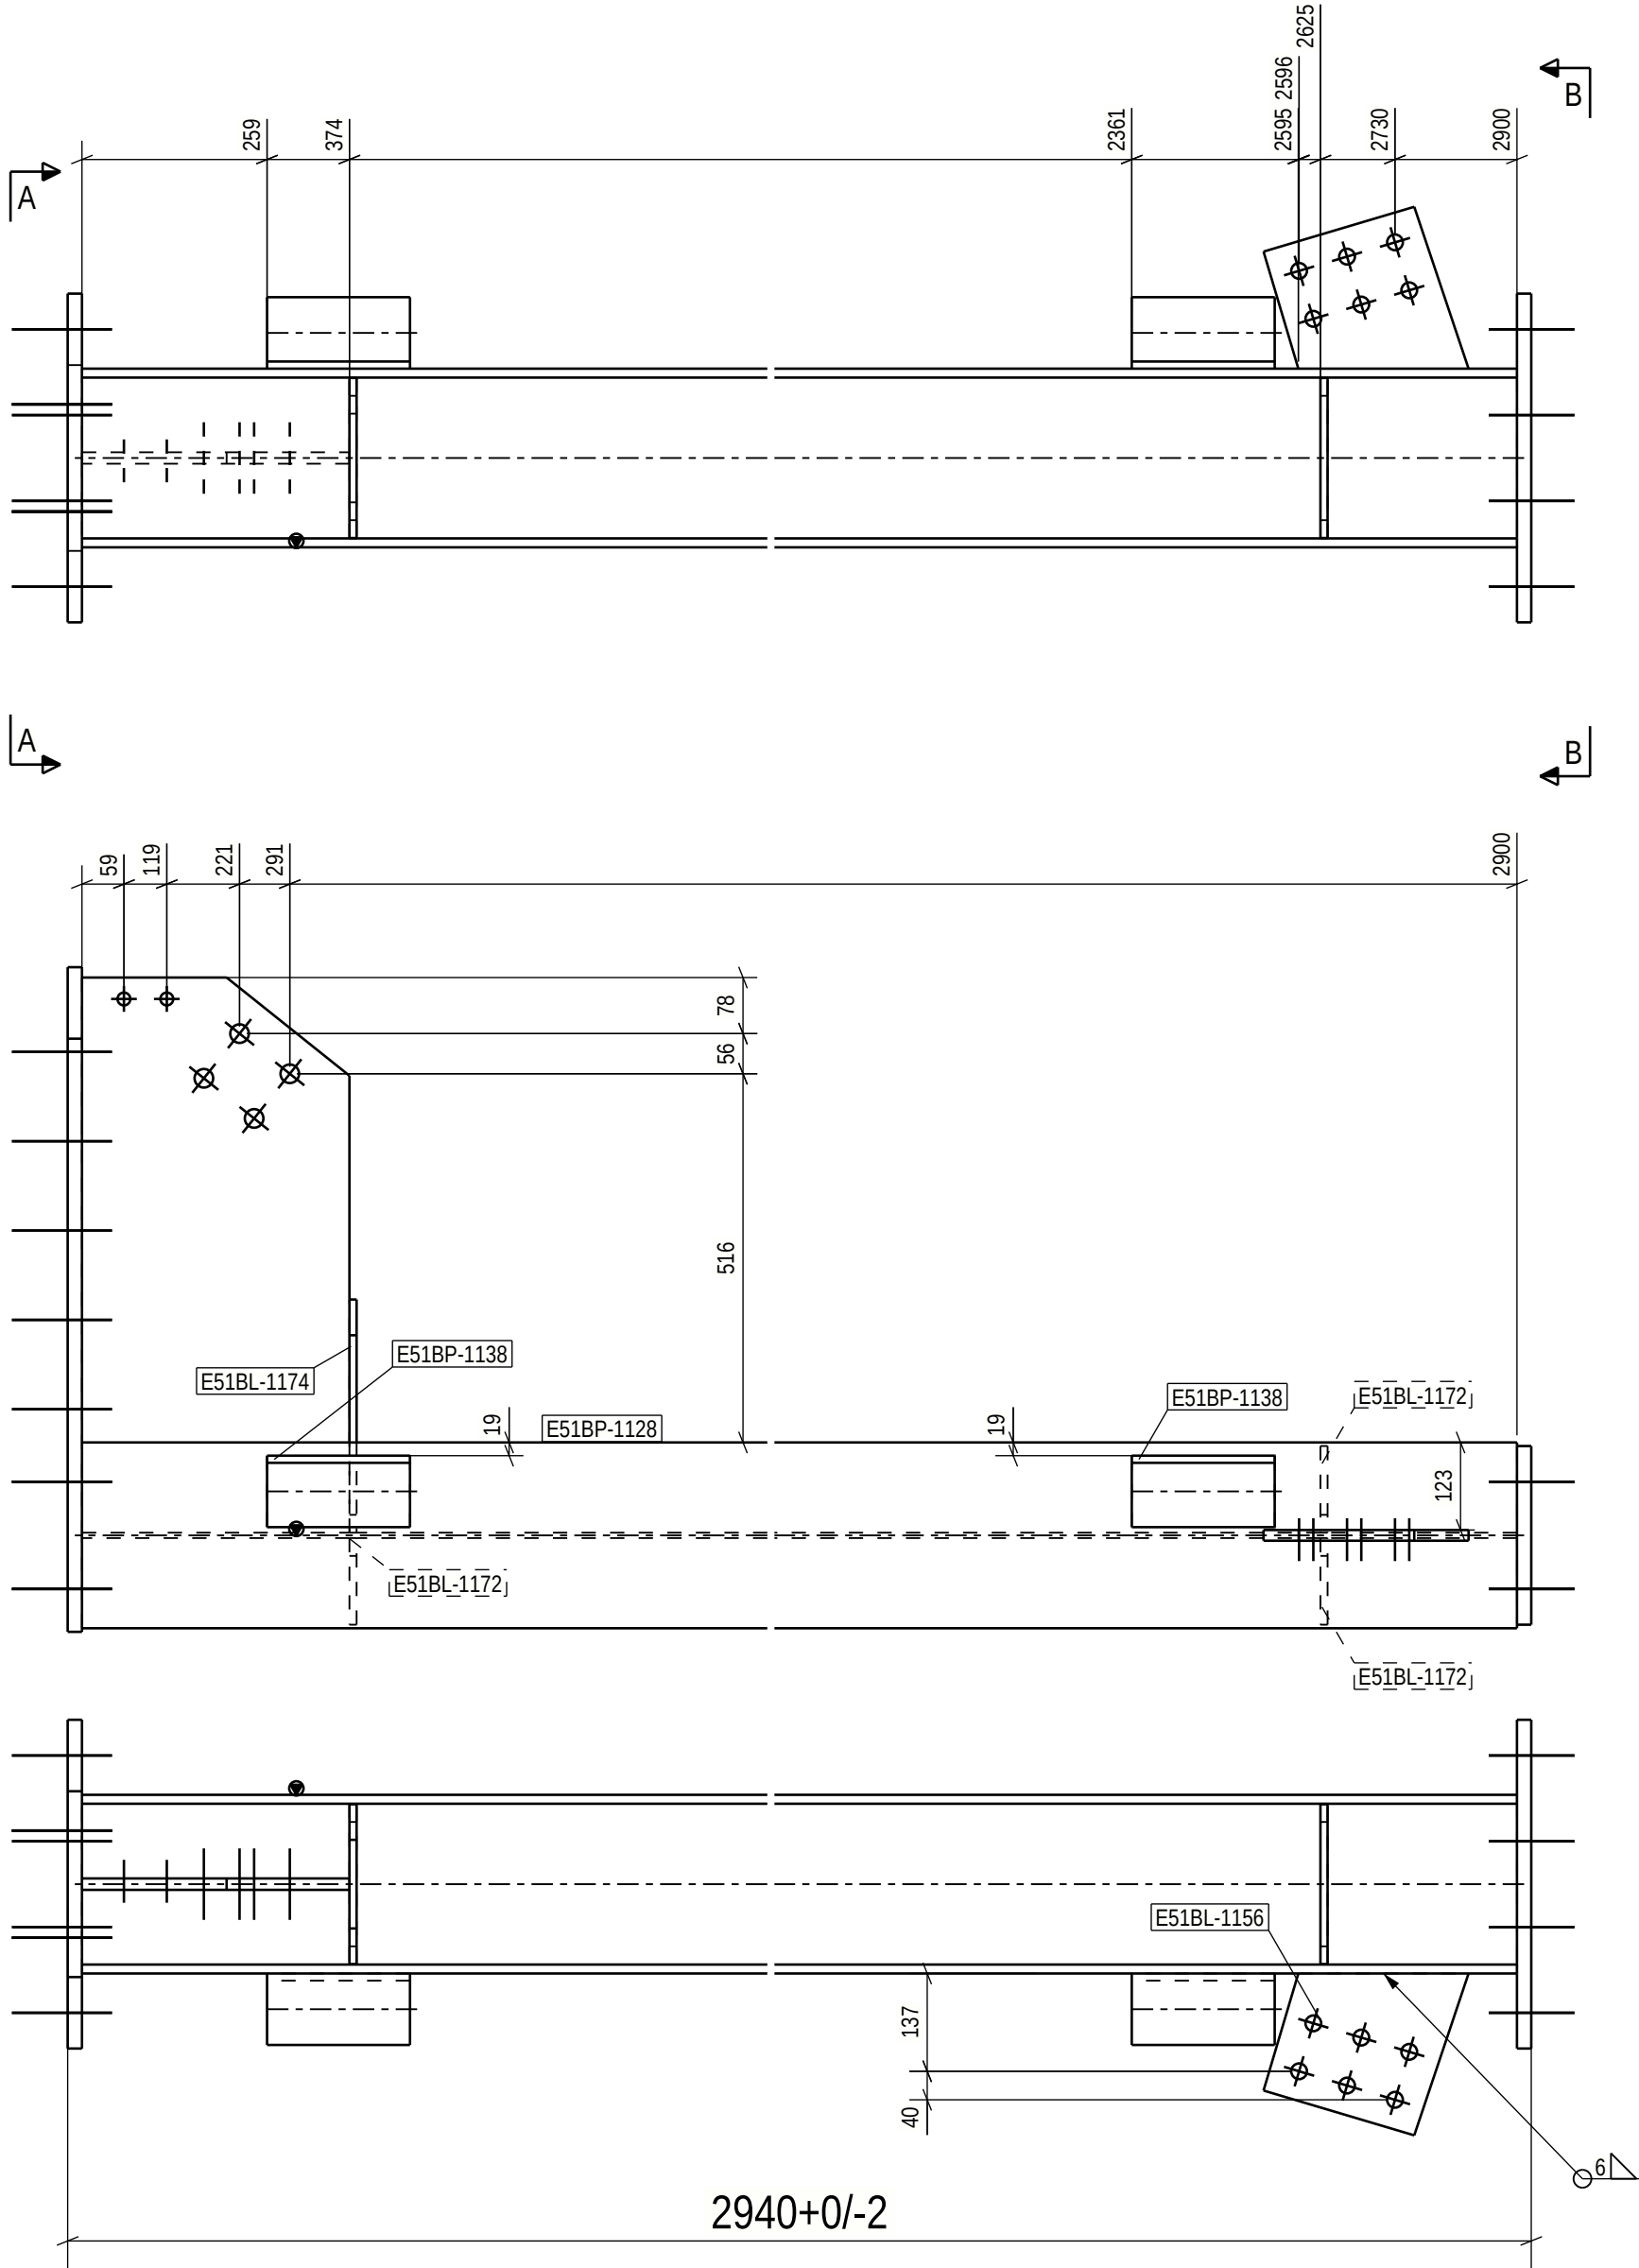


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PART LIST FOR ASSEMBLY E51B-1202, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1153	PL20X930	S355J2+N	460	0.89	65.6	1
E51BL-1155	PL20X250	S355J2+N	460	0.26	18.1	1
E51BL-1156	PL15X239	S355J2+N	228	0.10	5.4	1
E51BL-1172	PL10X121	S355J2+N	224	0.18	2.1	3
E51BL-1173	PL16X374	S355J2+N	777	0.59	35.0	1
E51BL-1174	PL10X224	S355J2+N	326	0.15	5.5	1
E51BP-1128	HEA260	S355J2	2900	4.30	197.7	1
E51BP-1138	L100*10	S355J2	200	0.16	3.0	2
TOTAL:				6.64	339.6	

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005		
Surface preparation grade ISO8501-3, grade P2		
Surface treatment ISO12944-5		
Additional requirements on surface treatment C3.07, EPPUR 240/2		
Shade RAL 7024 (Graphite Gray)		
Welding of built up steel section Appendix 1 / Project spec.		
Welds, if not specified otherwise EN 9692-1, EN 9692-2		
Fabrication tolerances EN 1090-2, Appendix B		
Special fabrication tolerances Project specification/ shown on drwg.		
Weld inspection, requirements EN 1090-2, Table 24, U>0.5		
Extent of NDT, fillet welds MT-EN1290, 20% of welds		
Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds		
Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds		
Requirements on bolting EN1090-2 Section 6.6.3		
Weld class C, EN ISO 5817		
Additional material inspection Shown on drwg.		

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1202

SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi


DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Koivumaaaho	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51B-1202		

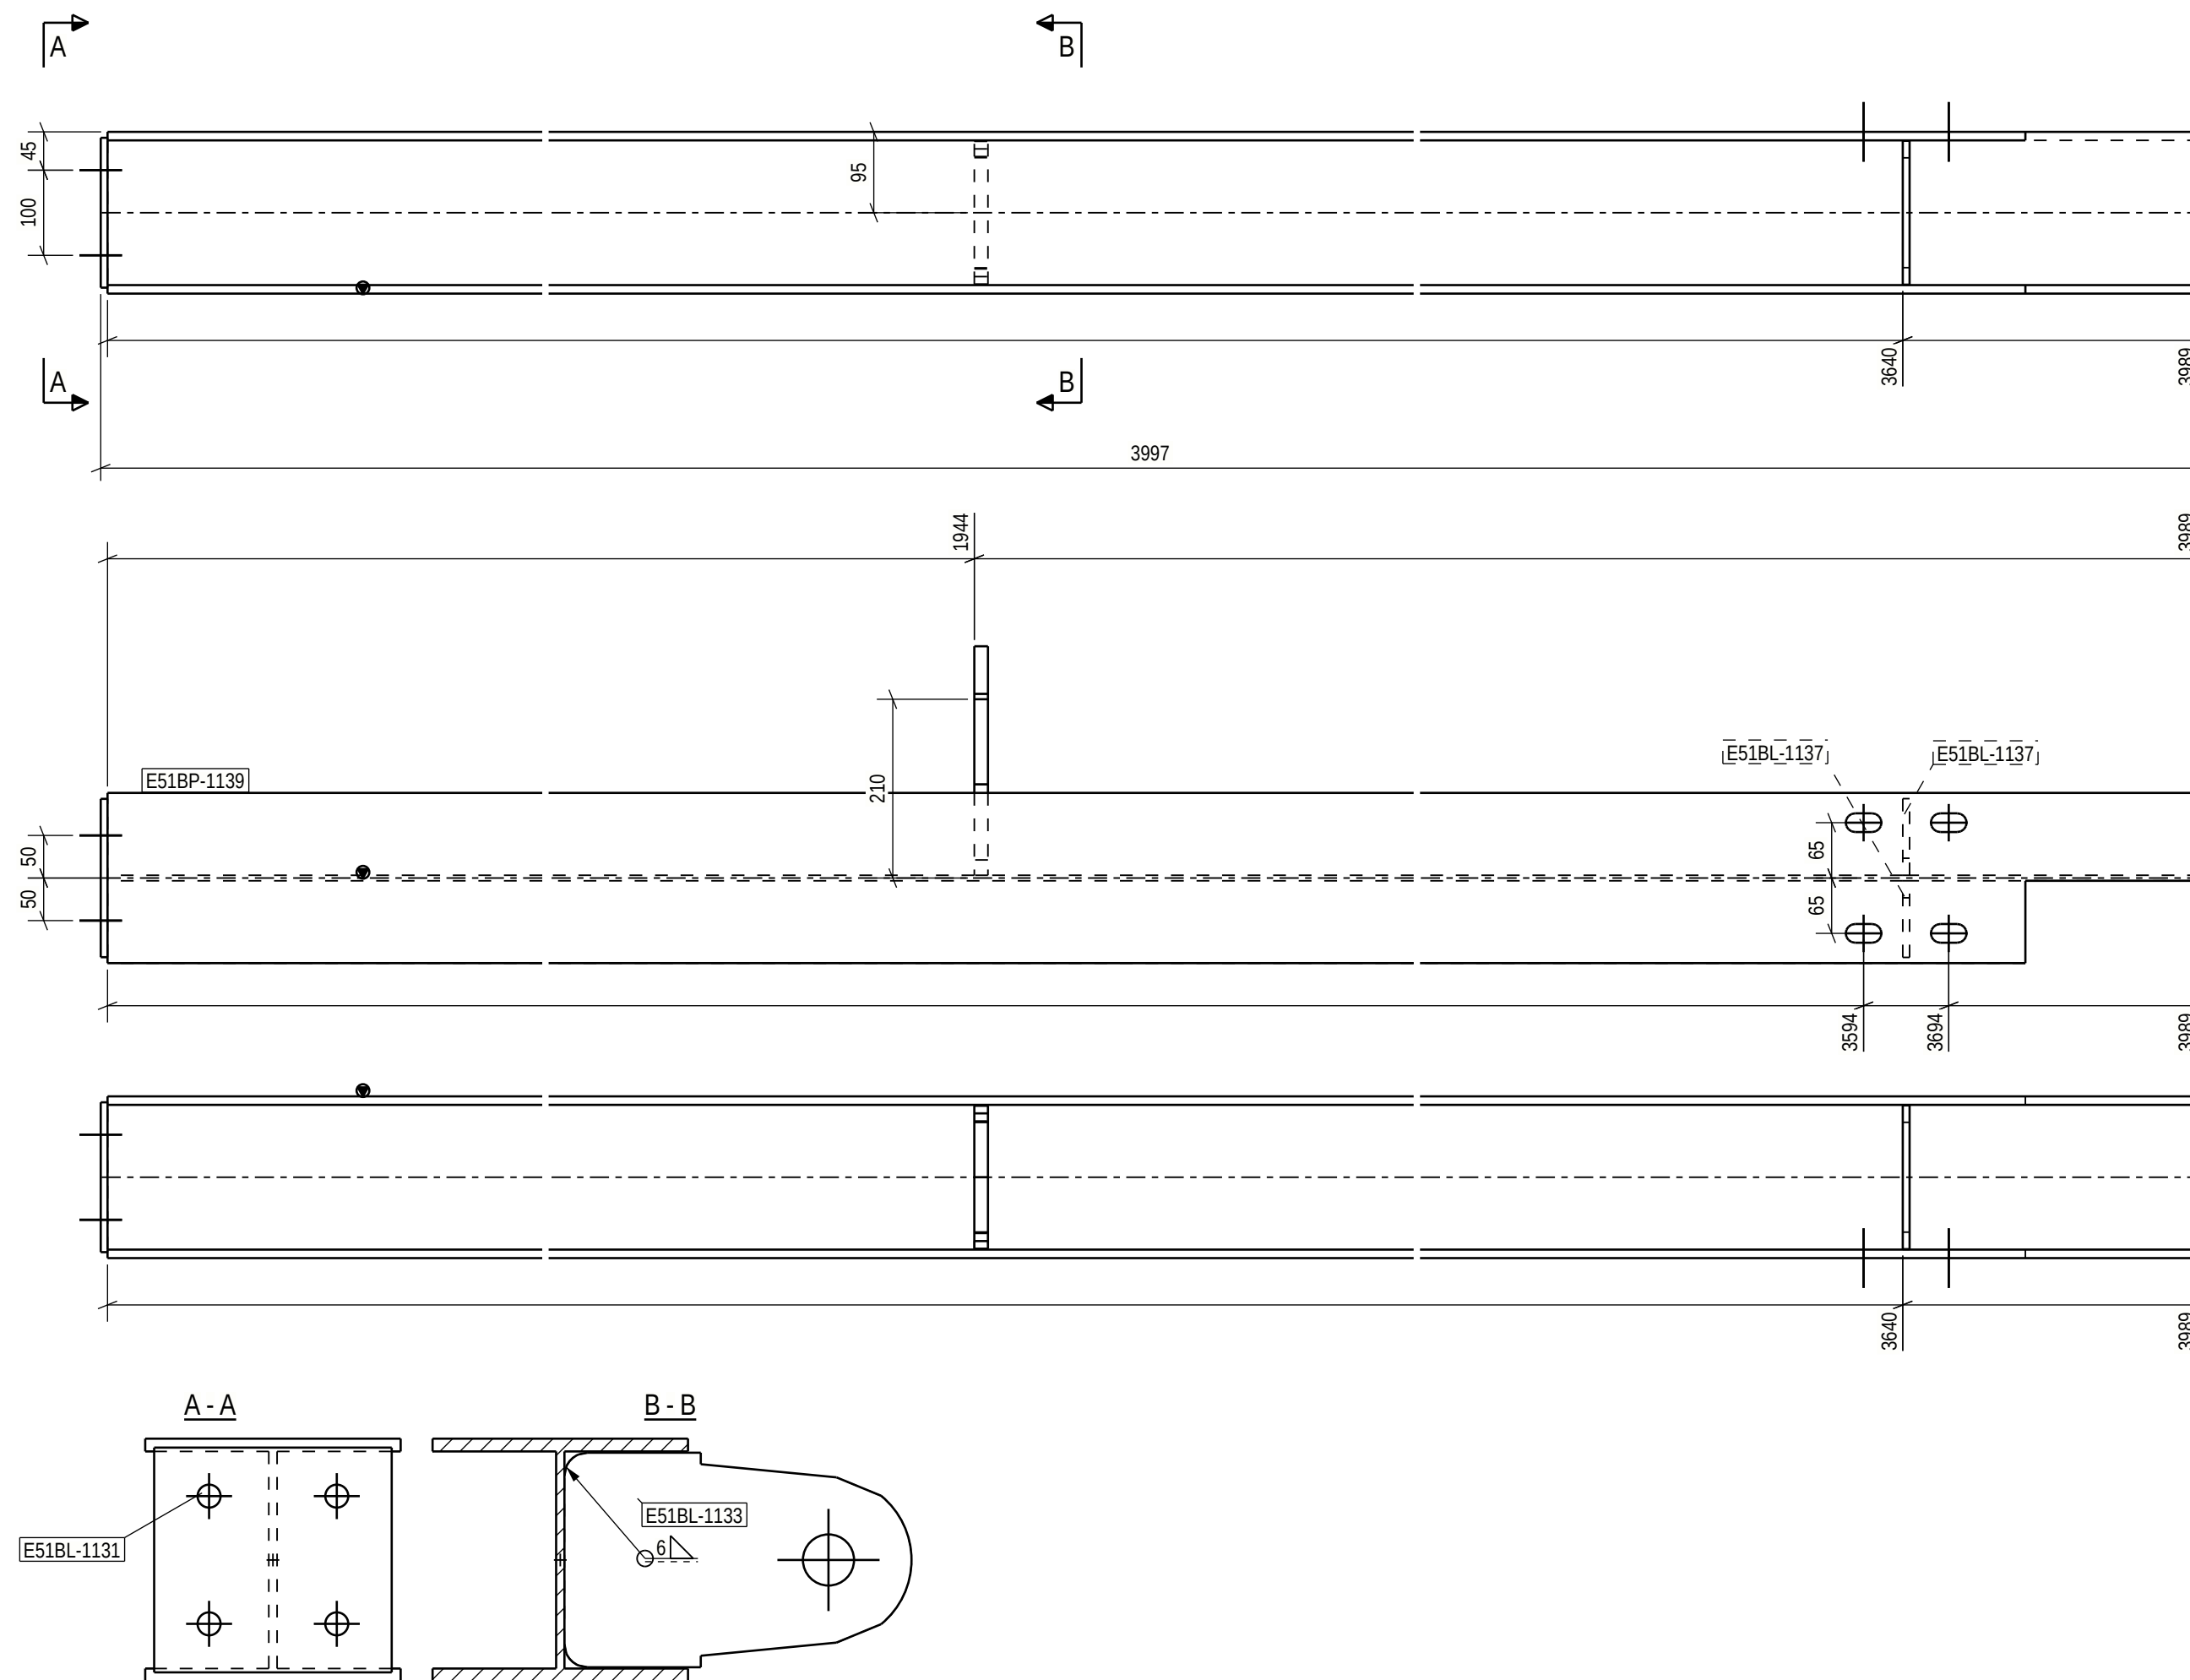


PART LIST FOR ASSEMBLY E51B-1203, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1131	PL8X176	S355J2+N	186	0.07	2.1	1
E51BL-1133	PL16X176	S355J2+N	276	0.09	4.8	1
E51BL-1137	PL8X90	S355J2+N	169	0.07	0.9	2
E51BP-1139	HEA200	S355J2	3989	4.53	168.6	1
TOTAL:				4.76	177.3	

Technical fabrication requirements:		Execution class EXC2	
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution Specification document nr 25019443-ICC250-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 / Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2		Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on holding EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817	
		Additional material inspection Shown on drwg	

For special tolerances of bolt hole location
see specification for steel structures

PROJECT NAME				DRAWING CONTENT			
Easpring New Materials Oy FAIR Phase 1				ASSEMBLY DRAWING Beam E51B-1203			
 SWECO Sustainable engineering and design		SWECO RAKENNETEKNIIKKA OY ILMALANPORTTI 2 00240 HELSINKI PUH. +358 207 393 000 www.sweco.fi		DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
				16.06.2026			STR
				DRAWN	DESIGNER	APPROVED	CHECKED
				Alexey Serous	Alexey Serous	Pertti Koivumaaanaho	Jere Kalliosalmi
		PROJECT NUMBER		DWG. NO.		REVISION	
		25019443		E51B-1203			

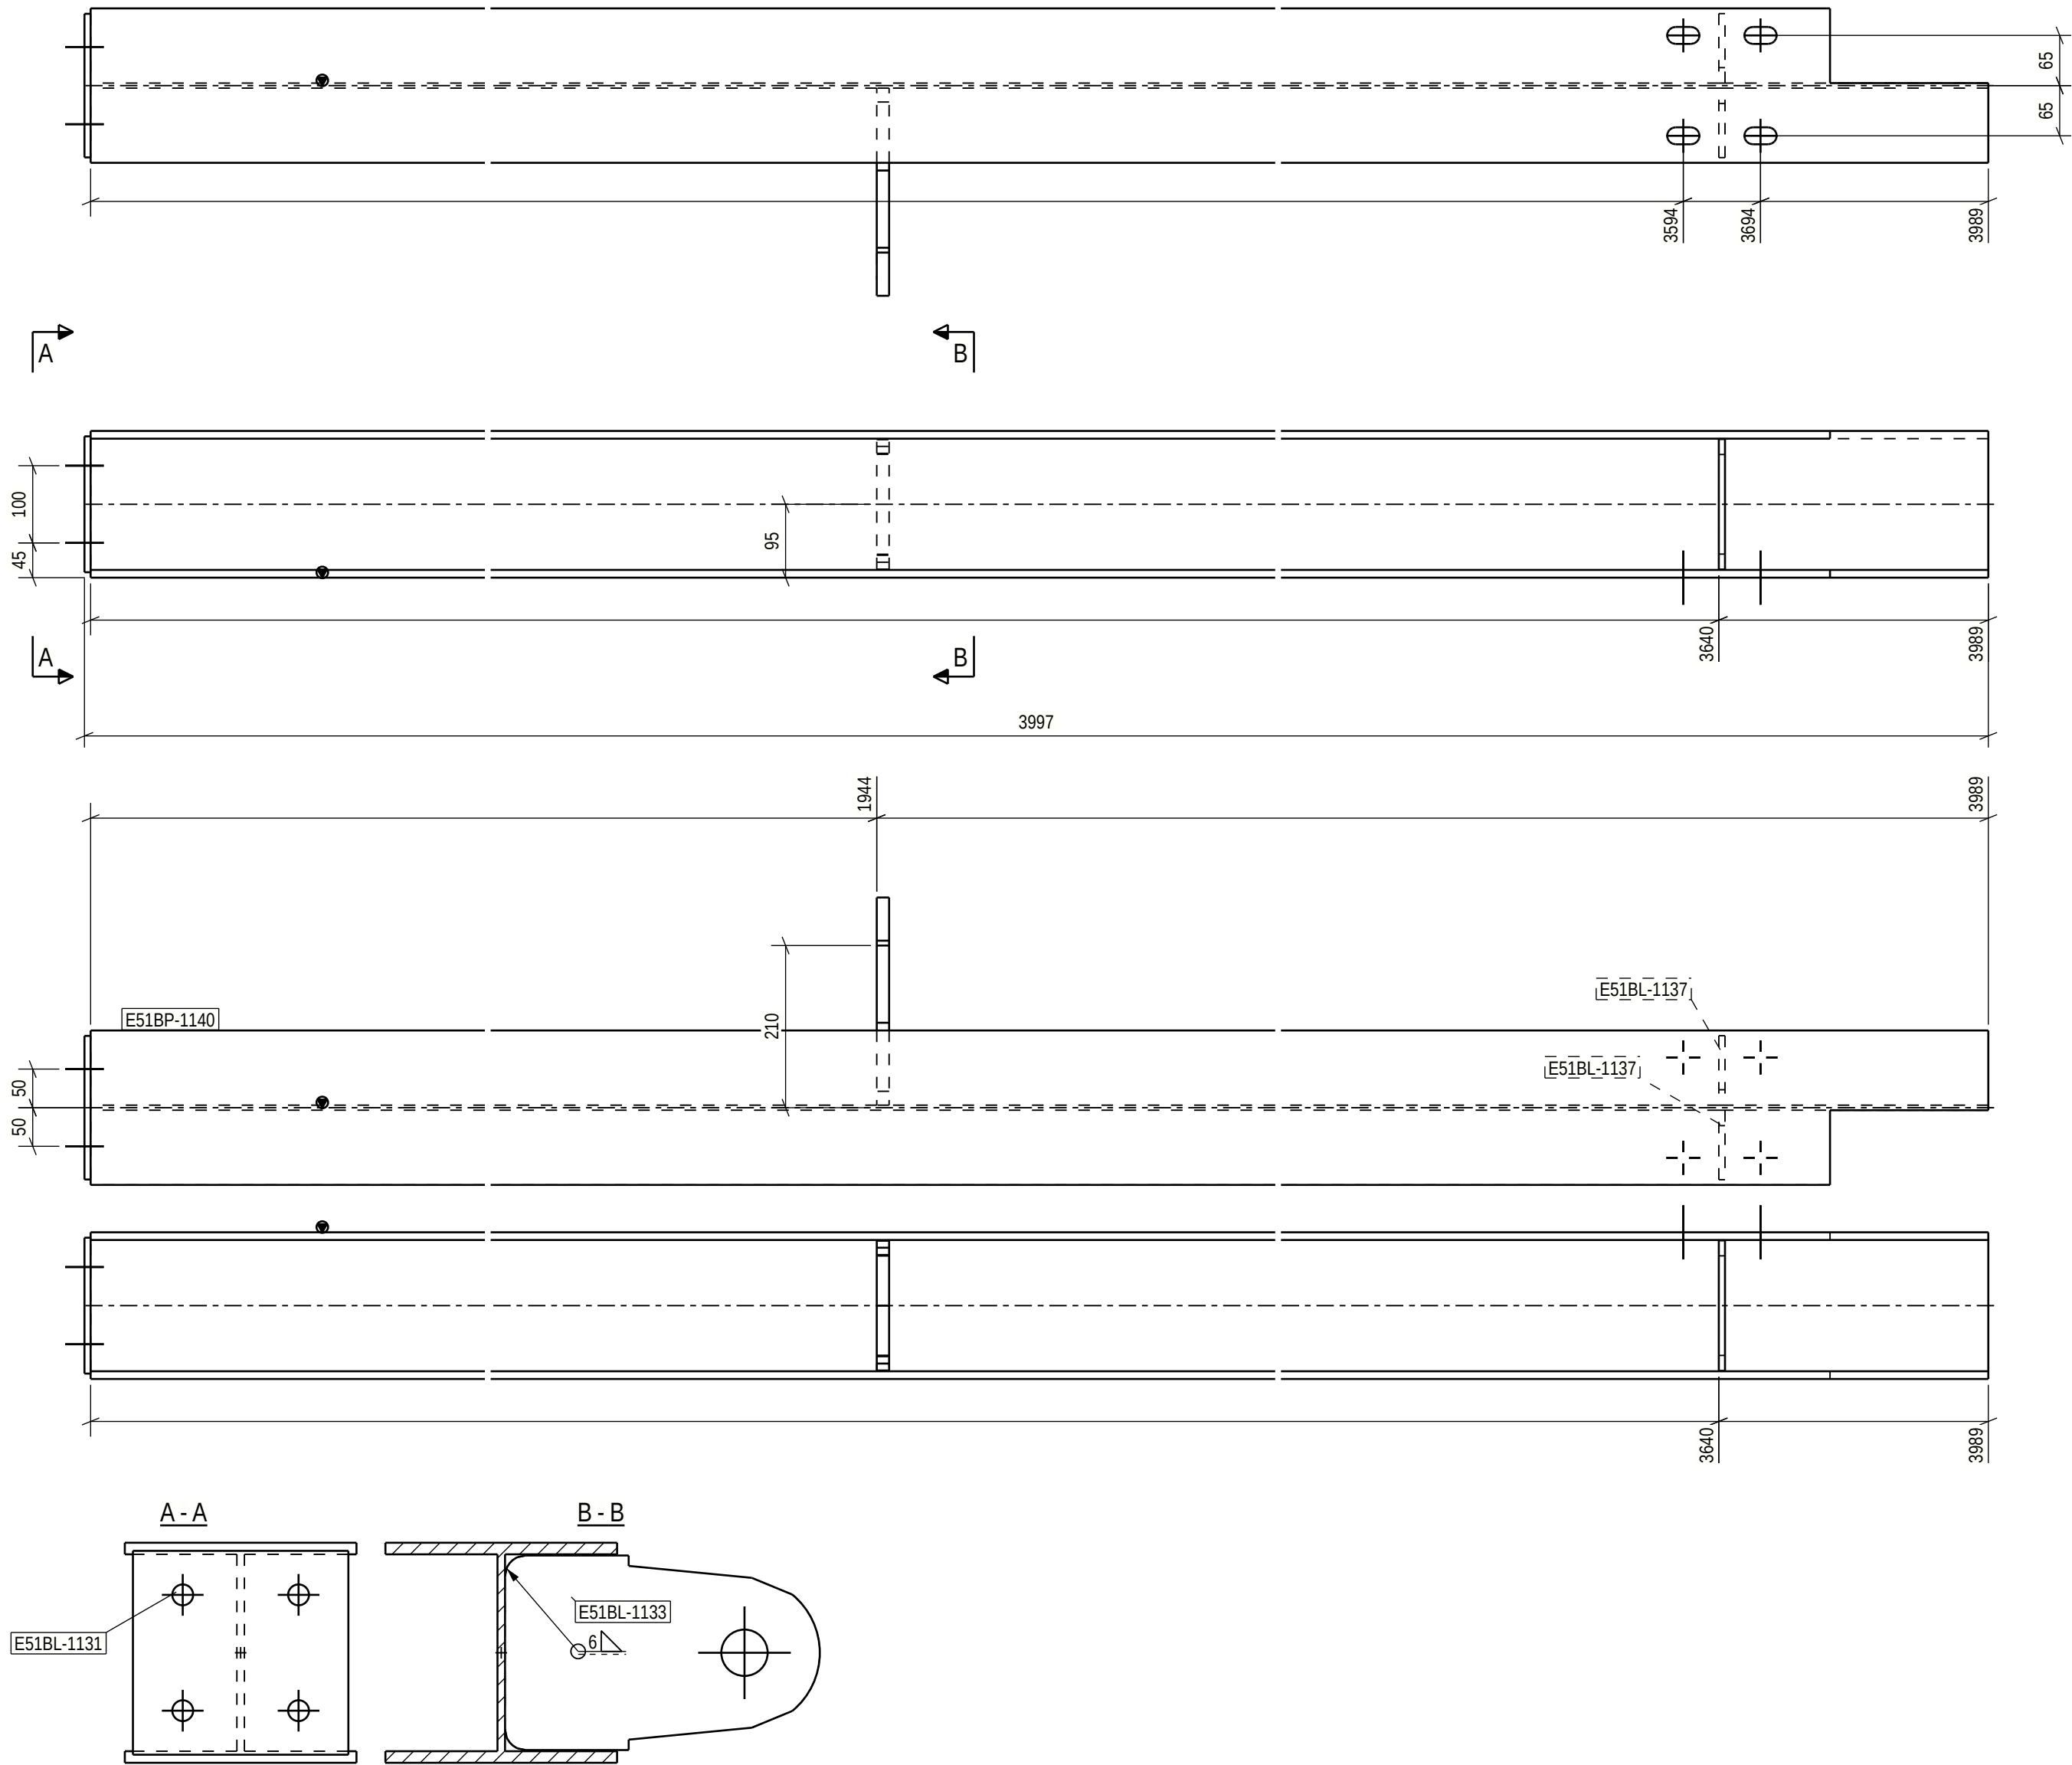

PART LIST FOR ASSEMBLY E51B-1204, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1131	PL8X176	S355J2+N	186	0.07	2.1	1
E51BL-1133	PL16X176	S355J2+N	276	0.09	4.8	1
E51BL-1137	PL8X90	S355J2+N	169	0.07	0.9	2
E51BP-1140	HEA200	S355J2	3989	4.53	168.6	1
TOTAL:				4.76	177.3	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard

EN1090-2, table A.3 : EXC2

Execution Specification document nr

25019443-ICC250-0600-0660-000005

Surface preparation grade

ISO8501-3, grade P2

Surface treatment

ISO12944-5

Additional requirements on surface treatment

C3.07, EPPUR 240/2

Shade

RAL 7024 (Graphite Gray)

Welding of built up steel section

Appendix 1 / Project spec.

Welds, if not specified otherwise

EN 9692-1, EN 9692-2

Fabrication tolerances

EN 1090-2, Appendix B

Special fabrication tolerances

Project specification/ shown on drwg.

Weld inspection, requirements

EN 1090-2,Table 24, U>0.5

Extent of NDT, fillet welds

MT-EN1290,20% of welds

Extent of NDT, butt welds

UT, EN-ISO17640, 20% of welds

Extent of NDT for splices not shown on drawing

UT, EN-ISO17640, 100%of welds

Requirements on holing

EN1090-2 Section 6.6.3

Weld class

C, EN ISO 5817

Additional material inspection

Shown on drwg.

PROJECT NAME

Easpring New Materials Oy

FAIR Phase 1

 SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT


ASSEMBLY DRAWING


Beam

E51B-1204

DATE	16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP
DRAWN	Alexey Serous	DESIGNER	APPROVED	CHECKED
PROJECT NUMBER	25019443	DWG. NO.	REVISION	


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

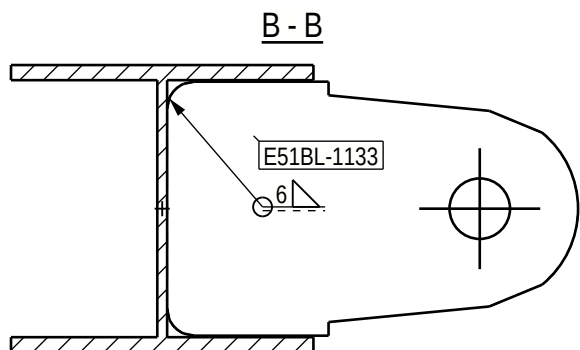

		Execution class	
Technical fabrication requirements:		EXC2	
Requirements for fabrication, standard		Fabrication tolerances	
EN1090-2, table A.3 : EXC2		EN 1090-2, Appendix B	
Execution Specification document nr		Special fabrication tolerances	
25019443-ICC250-0600-0660-000005		Project specification/ shown on drwg.	
Surface preparation grade		Weld inspection, requirements	
ISO8501-3, grade P2		EN 1090-2, Table 24, U>0.5	
Surface treatment		Extent of NDT, fillet welds	
ISO12944-5		MT-EN1290, 20% of welds	
Additional requirements on surface treatment		Extent of NDT, butt welds	
C3.07, EPPUR 240/2		UT, EN-ISO17640, 20% of welds	
Shade		Extent of NDT for splices not shown on drawing	
RAL 7024 (Graphite Gray)		UT, EN-ISO17640, 100% of welds	
Welding of built up steel section		Requirements on hinging	
Appendix 1 / Project spec.		EN1090-2 Section 6.6.3	
Welds, if not specified otherwise		Weld class	
EN 9692-1, EN 9692-2		EN ISO 5817	
		Additional material inspection Shown on drwg.	

SWECO 
Sustainable engineering and design

DRAWING CONTENT			
ASSEMBLY DRAWING			
Beam			
E51B-1205			
DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexy Serous	DESIGNER Alexy Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER	DWG. NO.		REVISION
25019443	E51B-1205		


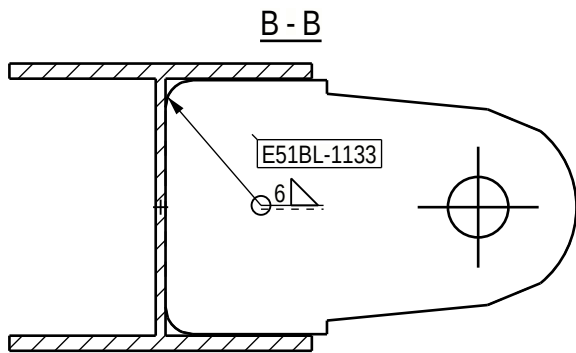


		Execution class	
Technical fabrication requirements:		EXC2	
Requirements for fabrication, standard		Fabrication tolerances	
EN1090-2, table A.3 : EXC2		EN 1090-2, Appendix B	
Execution Specification document nr		Special fabrication tolerances	
25019443-ICC250-0600-0660-000005		Project specification/ shown on drwg.	
Surface preparation grade		Weld inspection, requirements	
ISO8501-3, grade P2		EN 1090-2, Table 24, U>0.5	
Surface treatment		Extent of NDT, fillet welds	
ISO12944-5		MT-EN1290, 20% of welds	
Additional requirements on surface treatment		Extent of NDT, butt welds	
C3.07, EPPUR 240/2		UT, EN-ISO17640, 20% of welds	
Shade		Extent of NDT for splices not shown on drawing	
RAL 7024 (Graphite Gray)		UT, EN-ISO17640, 100% of welds	
Welding of built up steel section		Requirements on hinging	
Appendix 1 / Project spec.		EN1090-2 Section 6.6.3	
Welds, if not specified otherwise		Weld class	
EN 9692-1, EN 9692-2		EN ISO 5817	
		Additional material inspection Shown on drwg.	

SWECO 
Sustainable engineering and design



DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51B-1206	REVISION	

25019443 Fair E500

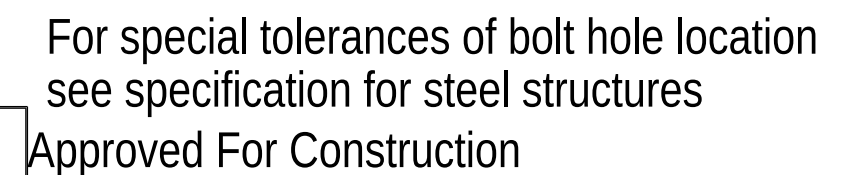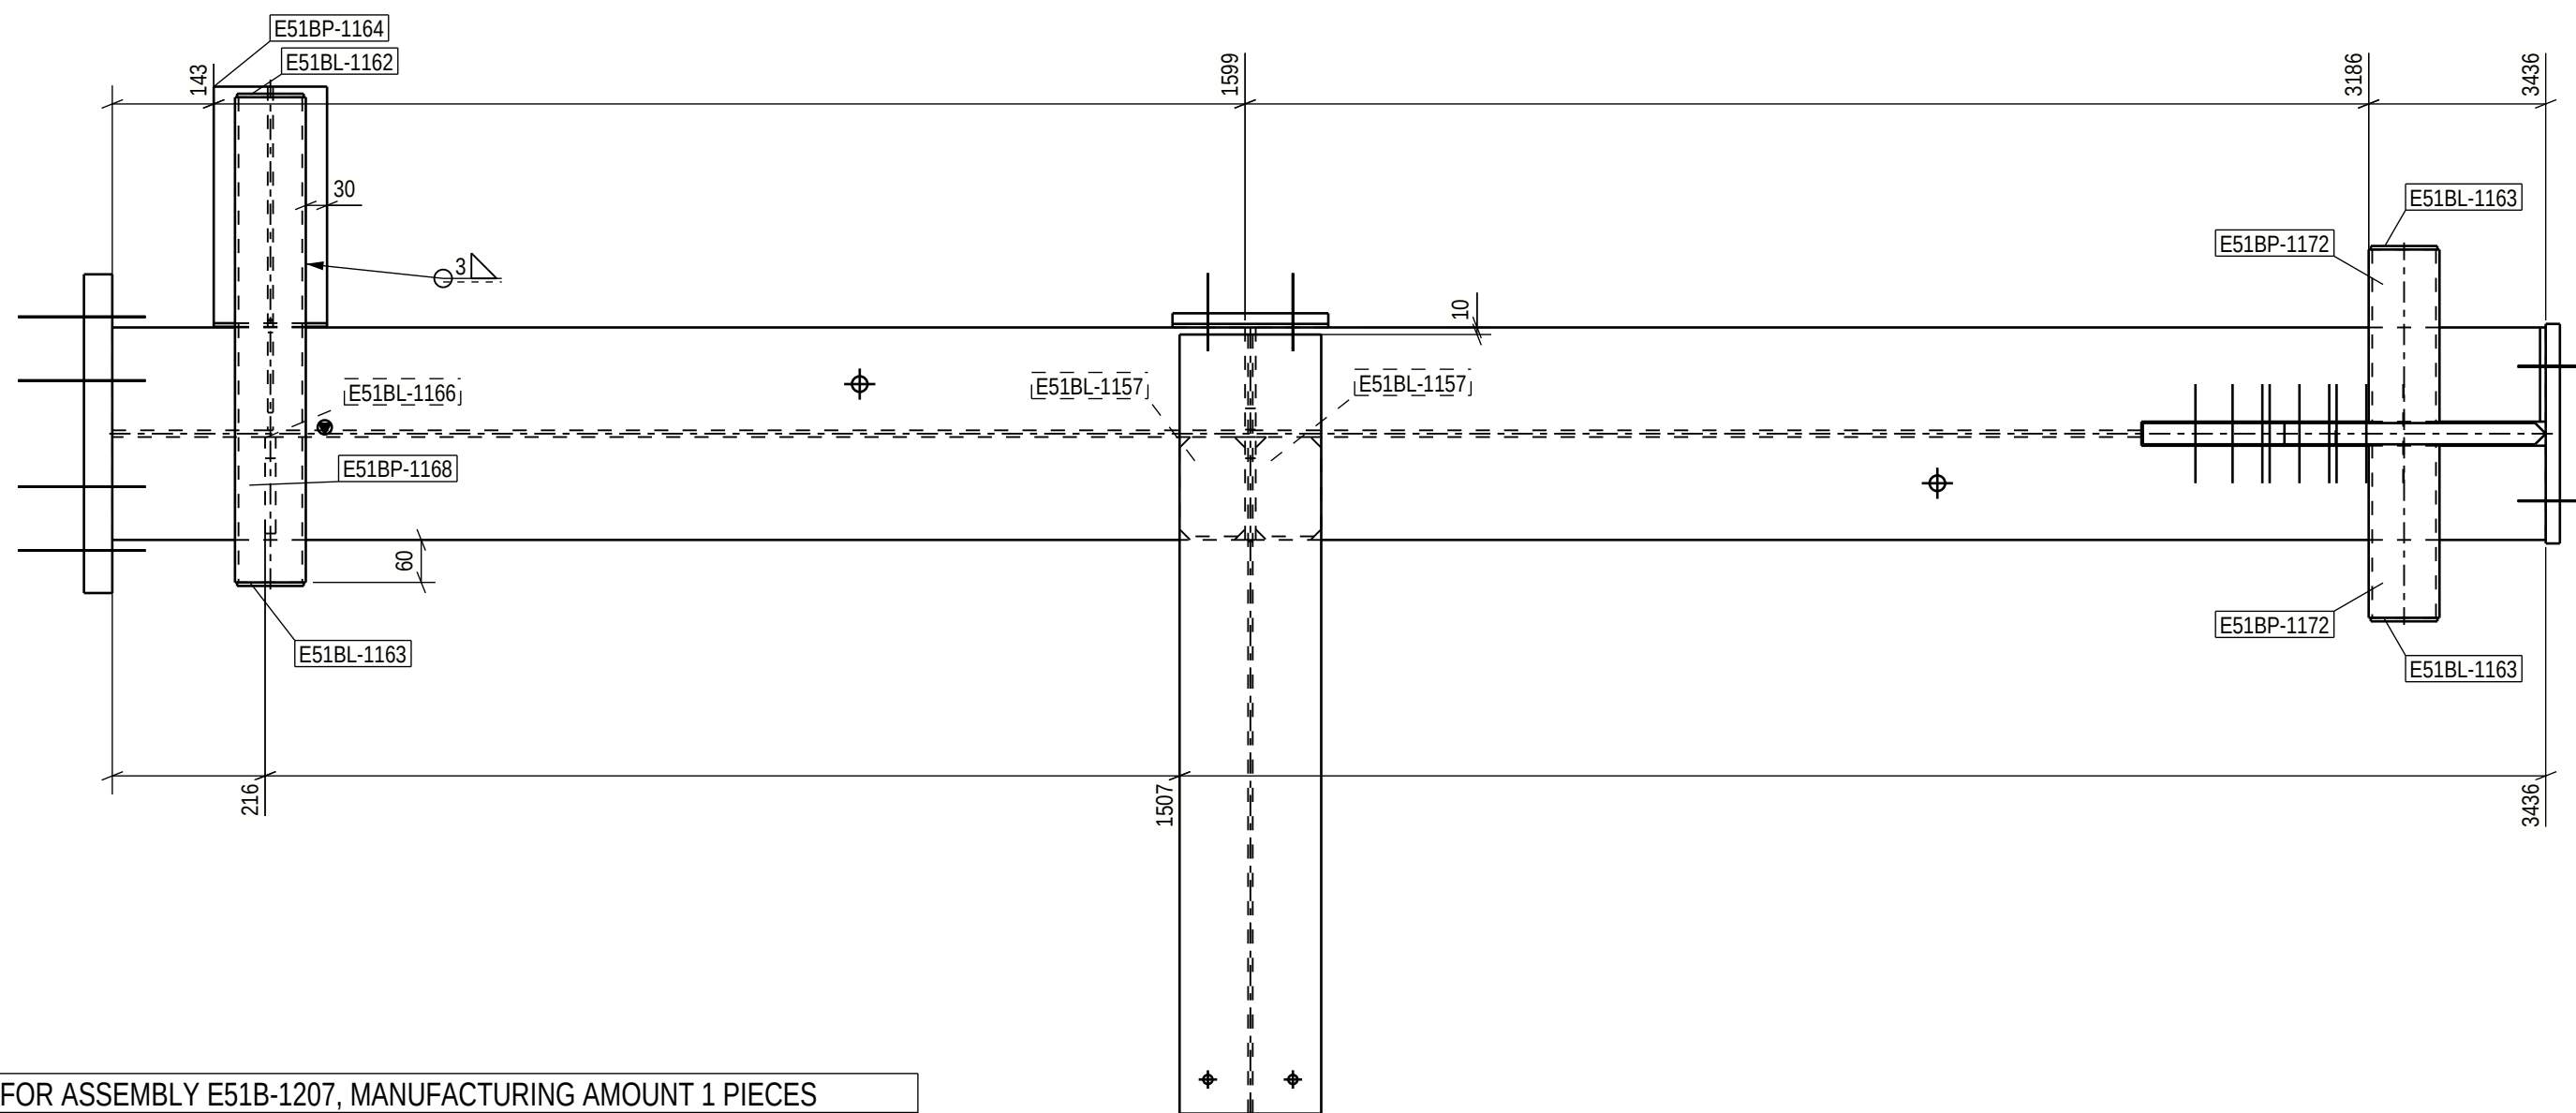

		Execution class	
Technical fabrication requirements:		EXC2	
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution specification document nr 25019443-ICC250-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 / Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2		Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on holing EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817	
		Additional material inspection	
		Shown on drawing	

25019443 Fair E500

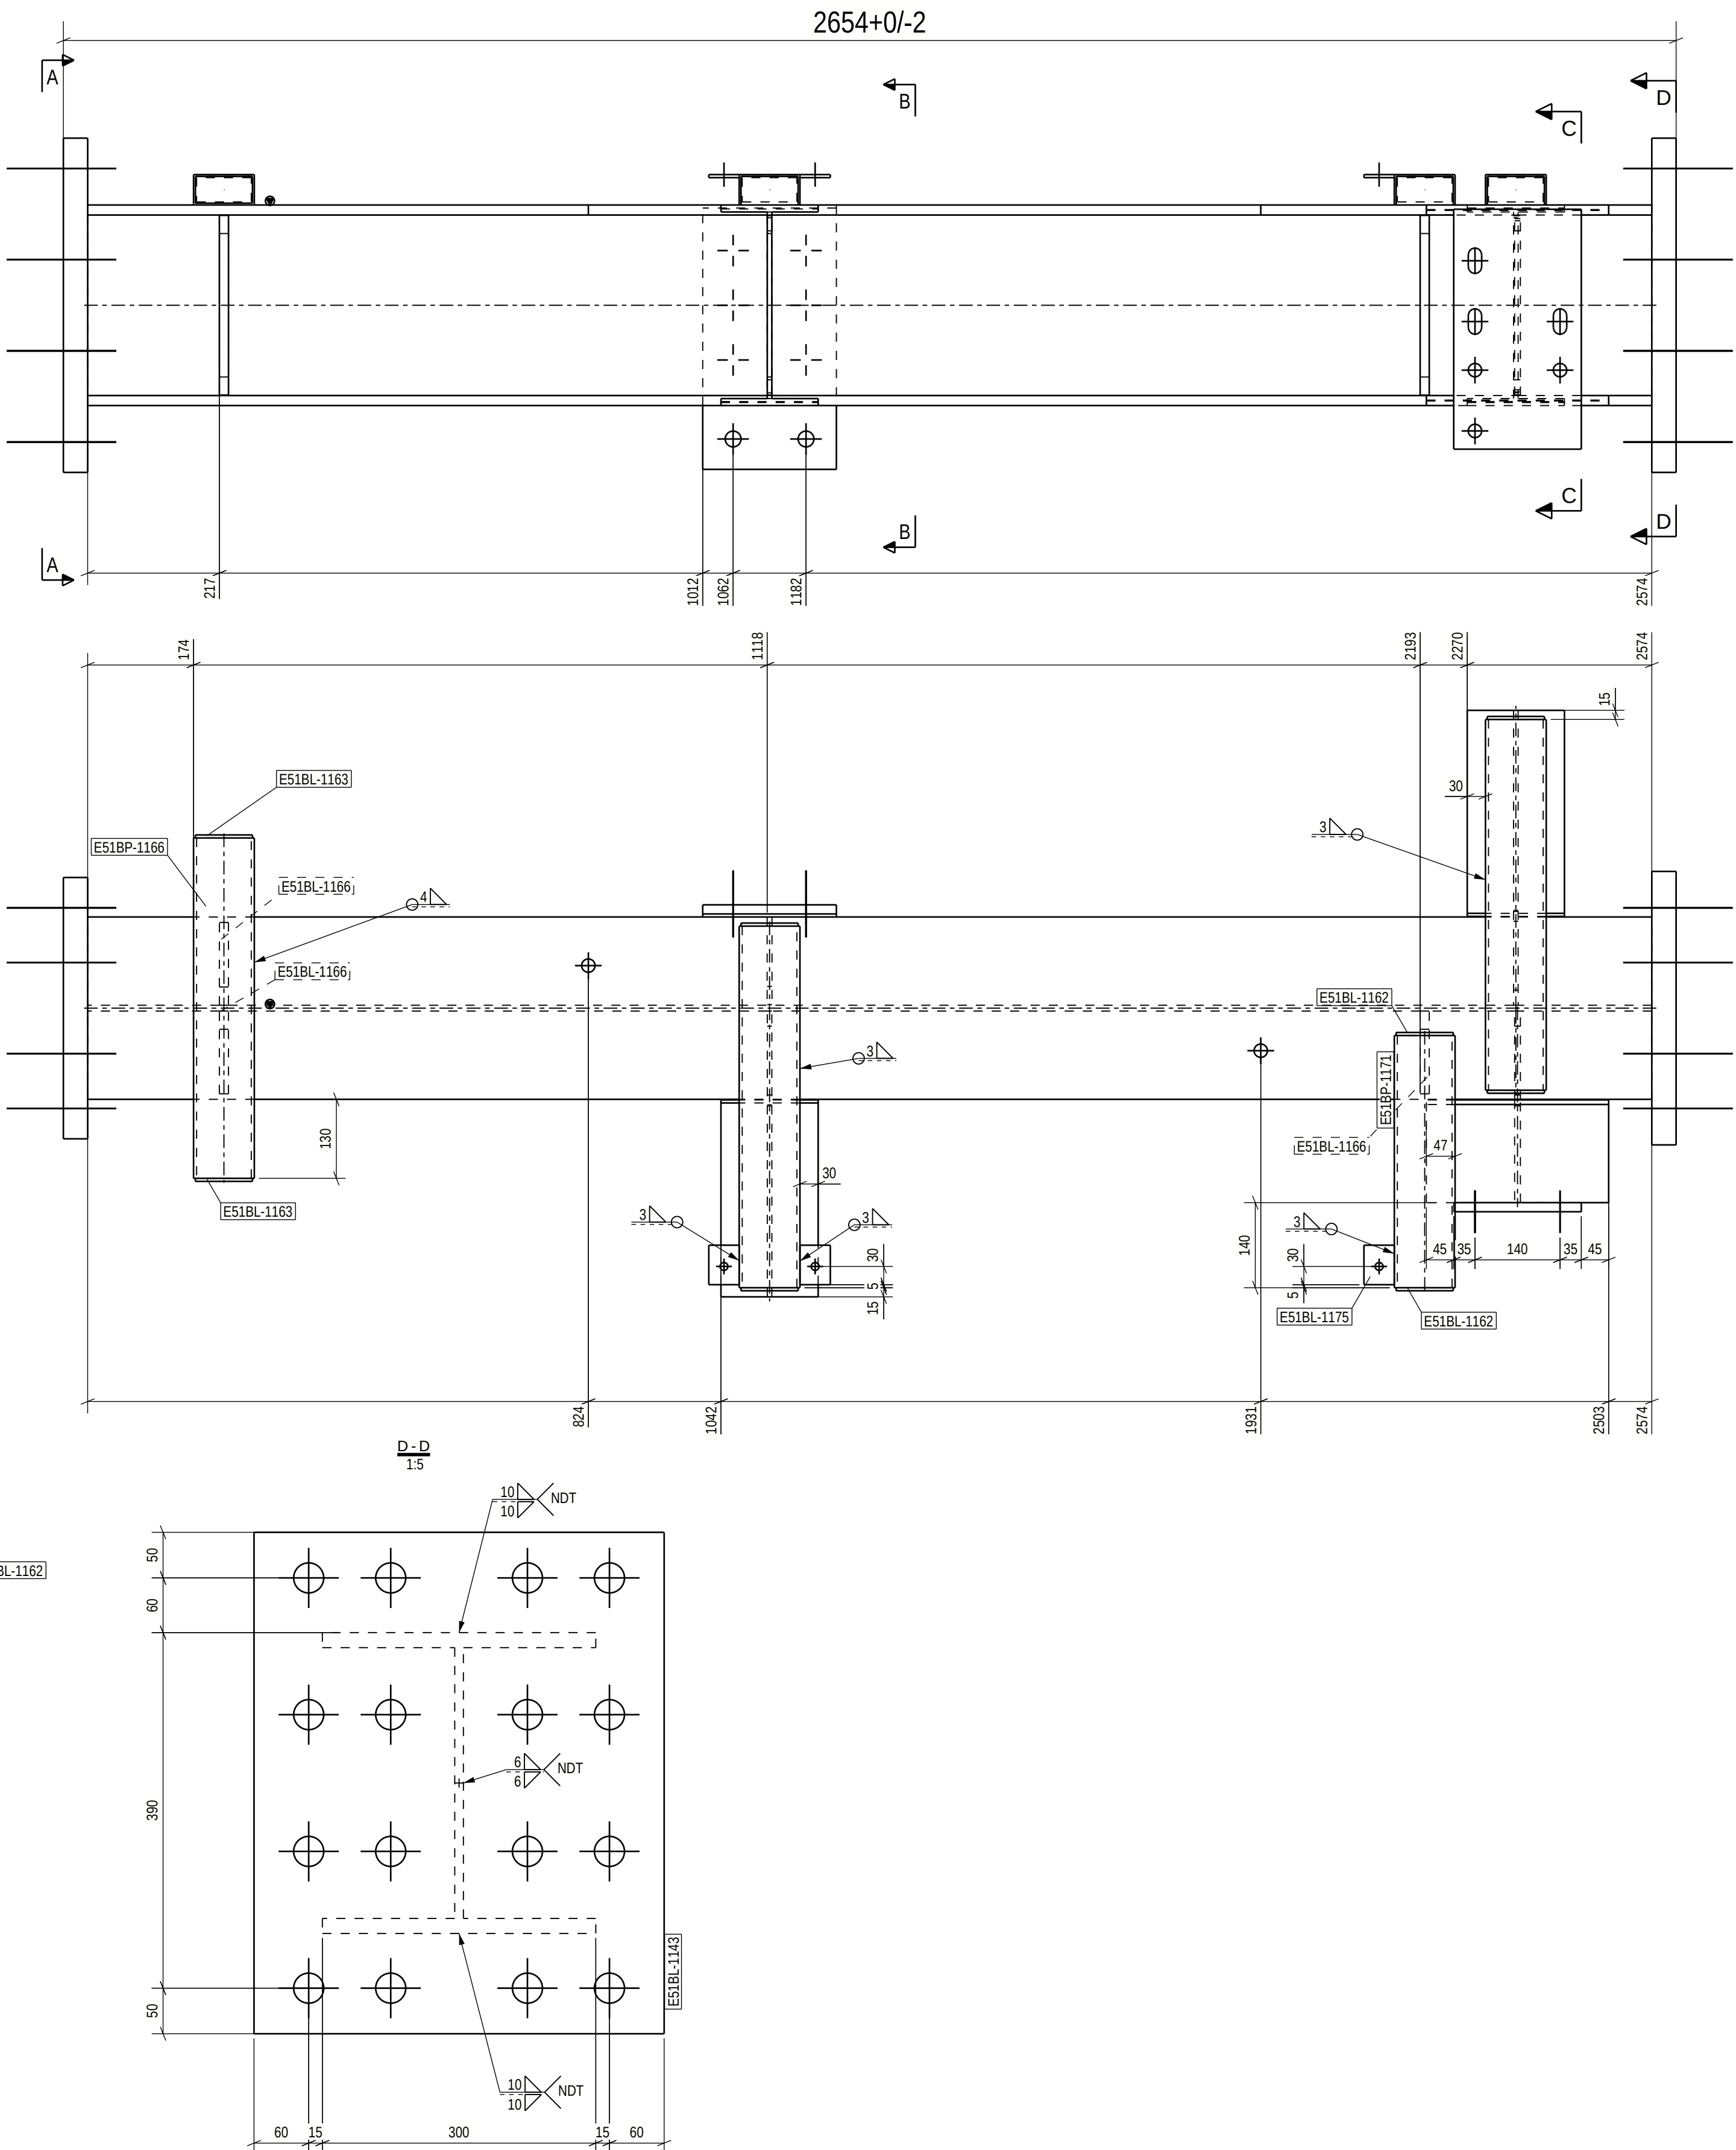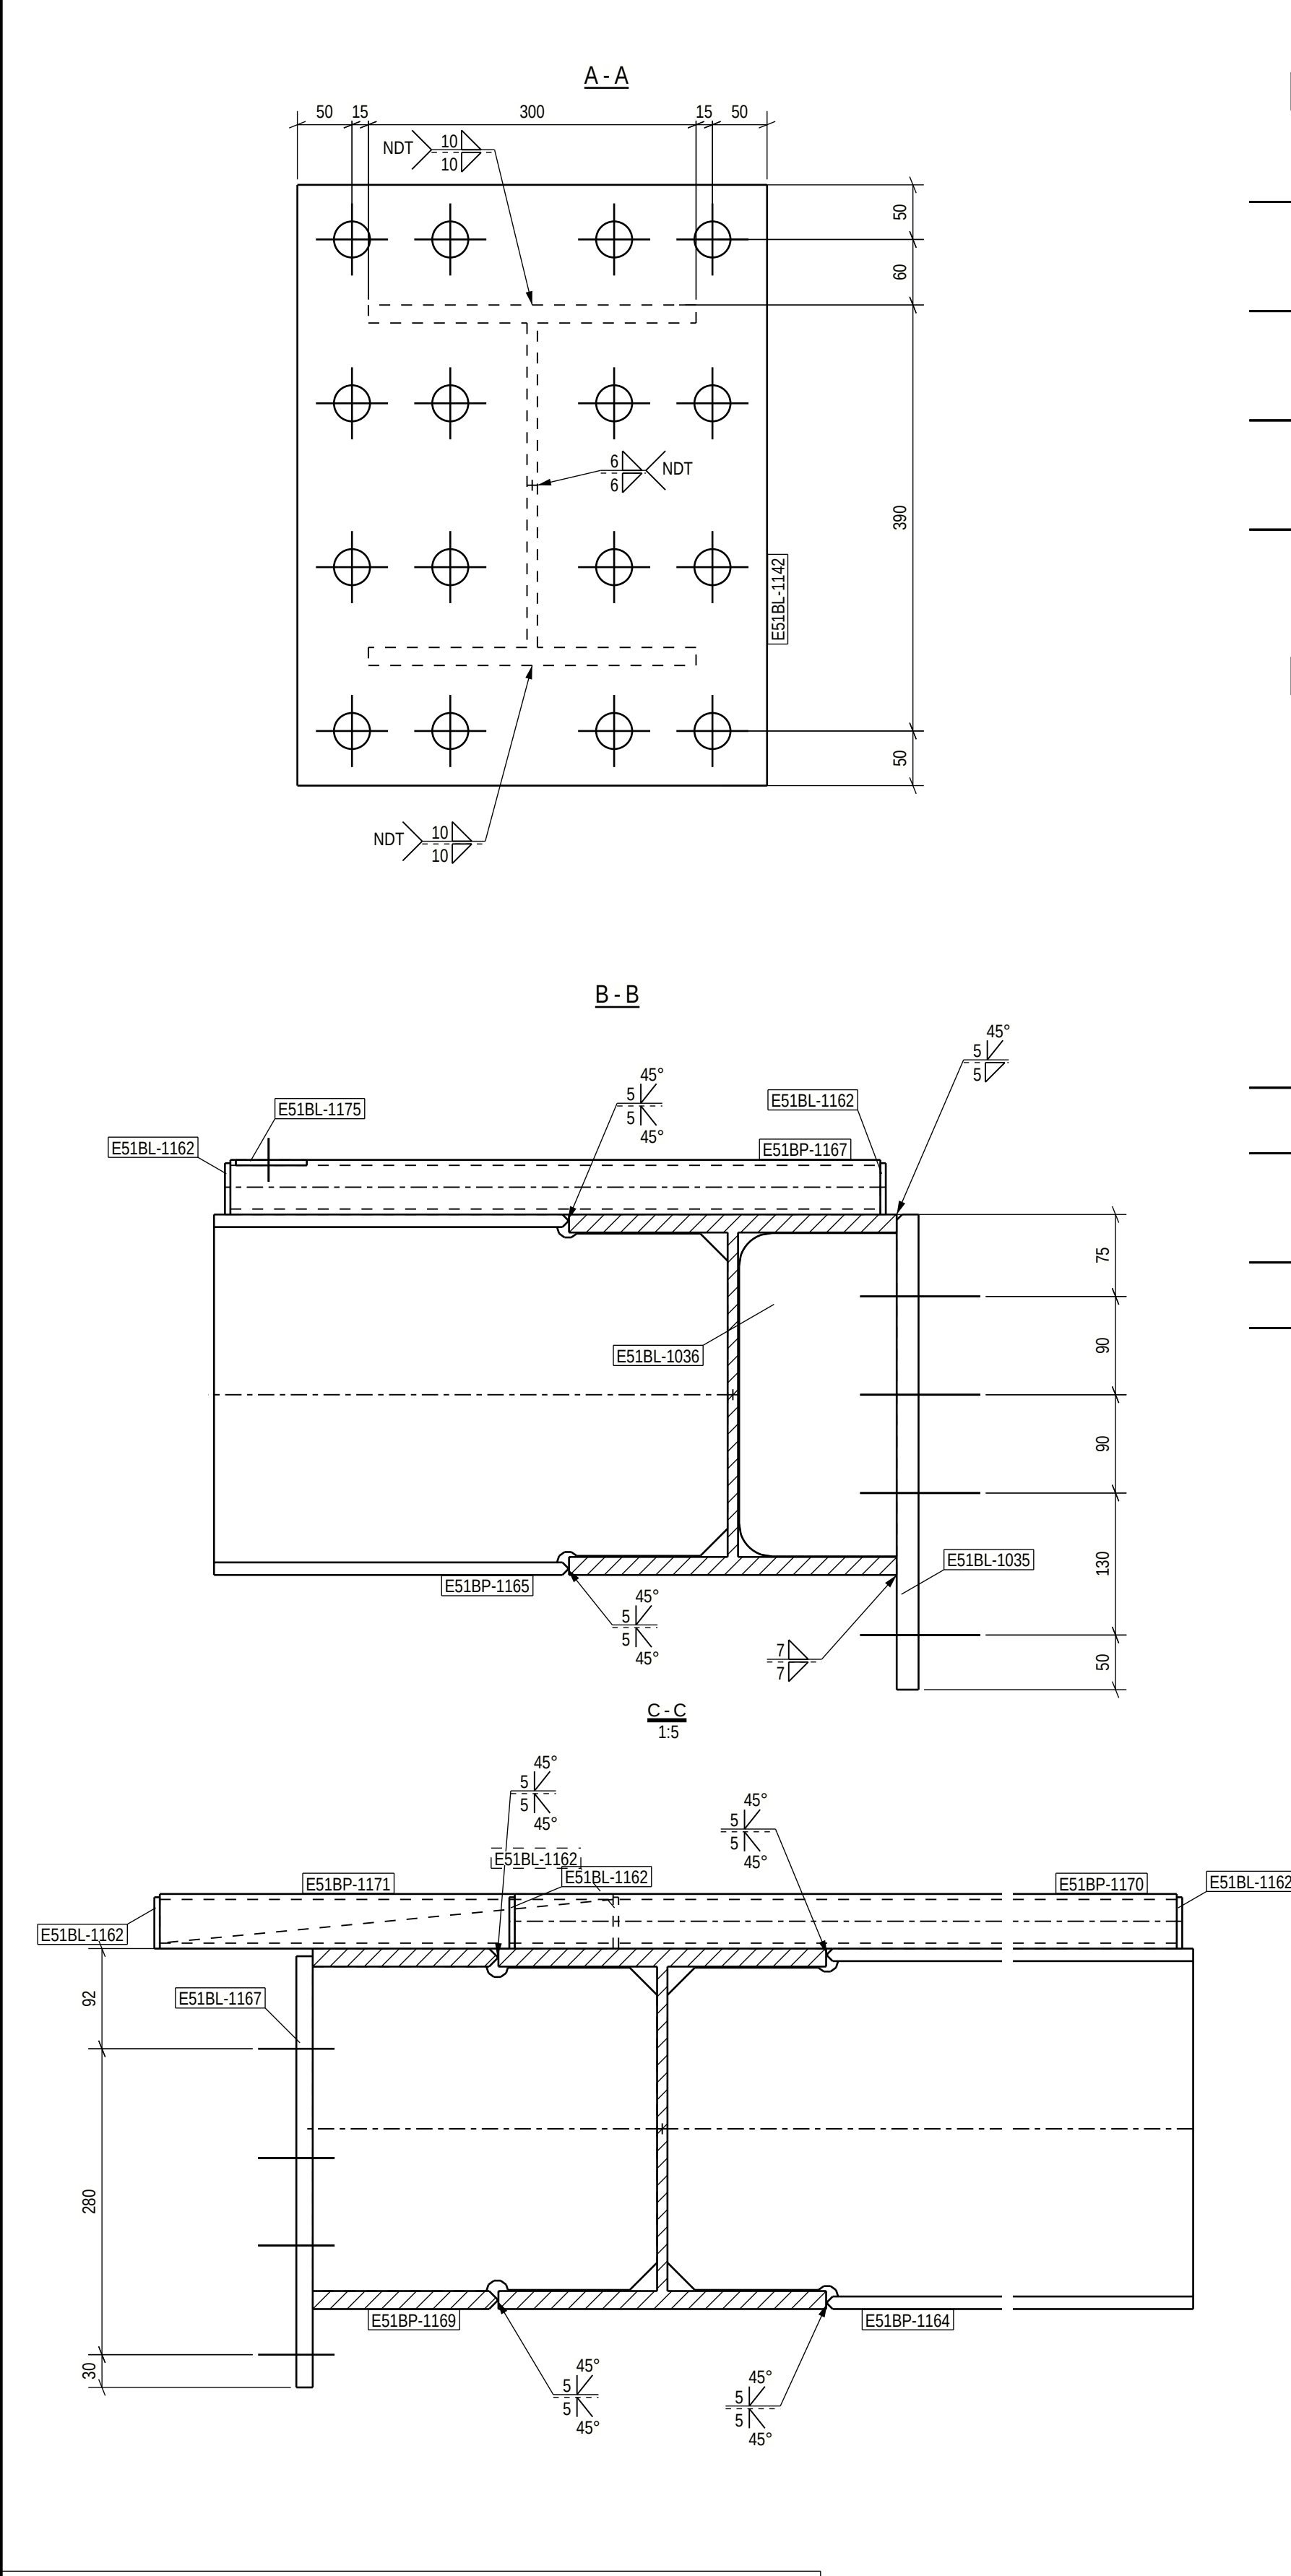

PART LIST FOR ASSEMBLY E51B-1208, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1035	PL20X220	S355J2+N	435	0.22	15.0	1
E51BL-1036	PL8X144	S355J2+N	296	0.09	2.7	1
E51BL-1142	PL40X430	S355J2+N	550	0.55	74.3	1
E51BL-1143	PL40X450	S355J2+N	550	0.58	77.7	1
E51BL-1162	PL5X47	S355J2+N	94	0.06	0.2	6
E51BL-1163	PL5X44	S355J2+N	94	0.02	0.2	2
E51BL-1166	PL15X136	S355J2+N	296	0.28	4.7	3
E51BL-1167	PL15X210	S355J2+N	395	0.18	9.8	1
E51BL-1175	PL5X50	S355J2+N	65	0.02	0.1	3
E51BP-1038	HEA340	S355J2	2574	4.62	269.8	1
E51BP-1164	IPE330	S355J2	485	0.61	23.8	1
E51BP-1165	IPE330	S355J2	470	0.59	23.1	1
E51BP-1166	CFRHS100X50X5	S355J2H	560	0.16	5.9	1
E51BP-1167	CFRHS100X50X5	S355J2H	595	0.17	6.2	1
E51BP-1169	HEA340	S355J2	315	0.57	33.0	1
E51BP-1170	CFRHS100X50X5	S355J2H	610	0.17	6.4	1
E51BP-1171	CFRHS100X50X5	S355J2H	415	0.12	4.4	1
TOTAL:			9.00		567.9	


Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard	Fabrication tolerances	
EN1090-2, table A3: EXC2	EN 1090-2, Appendix B	
Execution Specification document nr	Special fabrication tolerances	
25019443-IC250-0600-000005	Project specification/ shown on drwg.	
Surface preparation grade	Weld inspection requirements	
ISO8501-3, grade P2	EN 1090-2, Table 24, U>0.5	
Surface treatment	Extent of NDT, after welds	
ISO12944-5	MT-EN1290, 20% of welds	
Additional requirements on surface treatment	Extent of NDT, butt welds	
RAL 7024 (Graphite Gray)	UT, EN-ISO17640, 20% of welds	
Welding of bulk up steel section	UT, EN-ISO17640, 100% of welds	
Appendix 1 / Project spec.	Requirements on testing	
EN 9692-1, EN 9692-2	EN1090-2 Section 6.6.3	
	Weld class	Additional material inspection
	C, EN ISO 5817	Shown on drwg

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME		DRAWING CONTENT	
Easpring New Materials Oy		ASSEMBLY DRAWING	
FAIR Phase 1		Beam	
		E51B-1208	
DATE		ARCHIVING CODE	PAGE
16.06.2026			
DESIGNER		APPROVED	CHECKED
Aleksy Serous		Pertti Koluvaara	Jere Kallio
PROJECT NUMBER		DWG. NO.	REVISION
25019443			
E51B-1208			



SWECO RAKENNETEKNIKKA OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
WWW.SWECO.FI

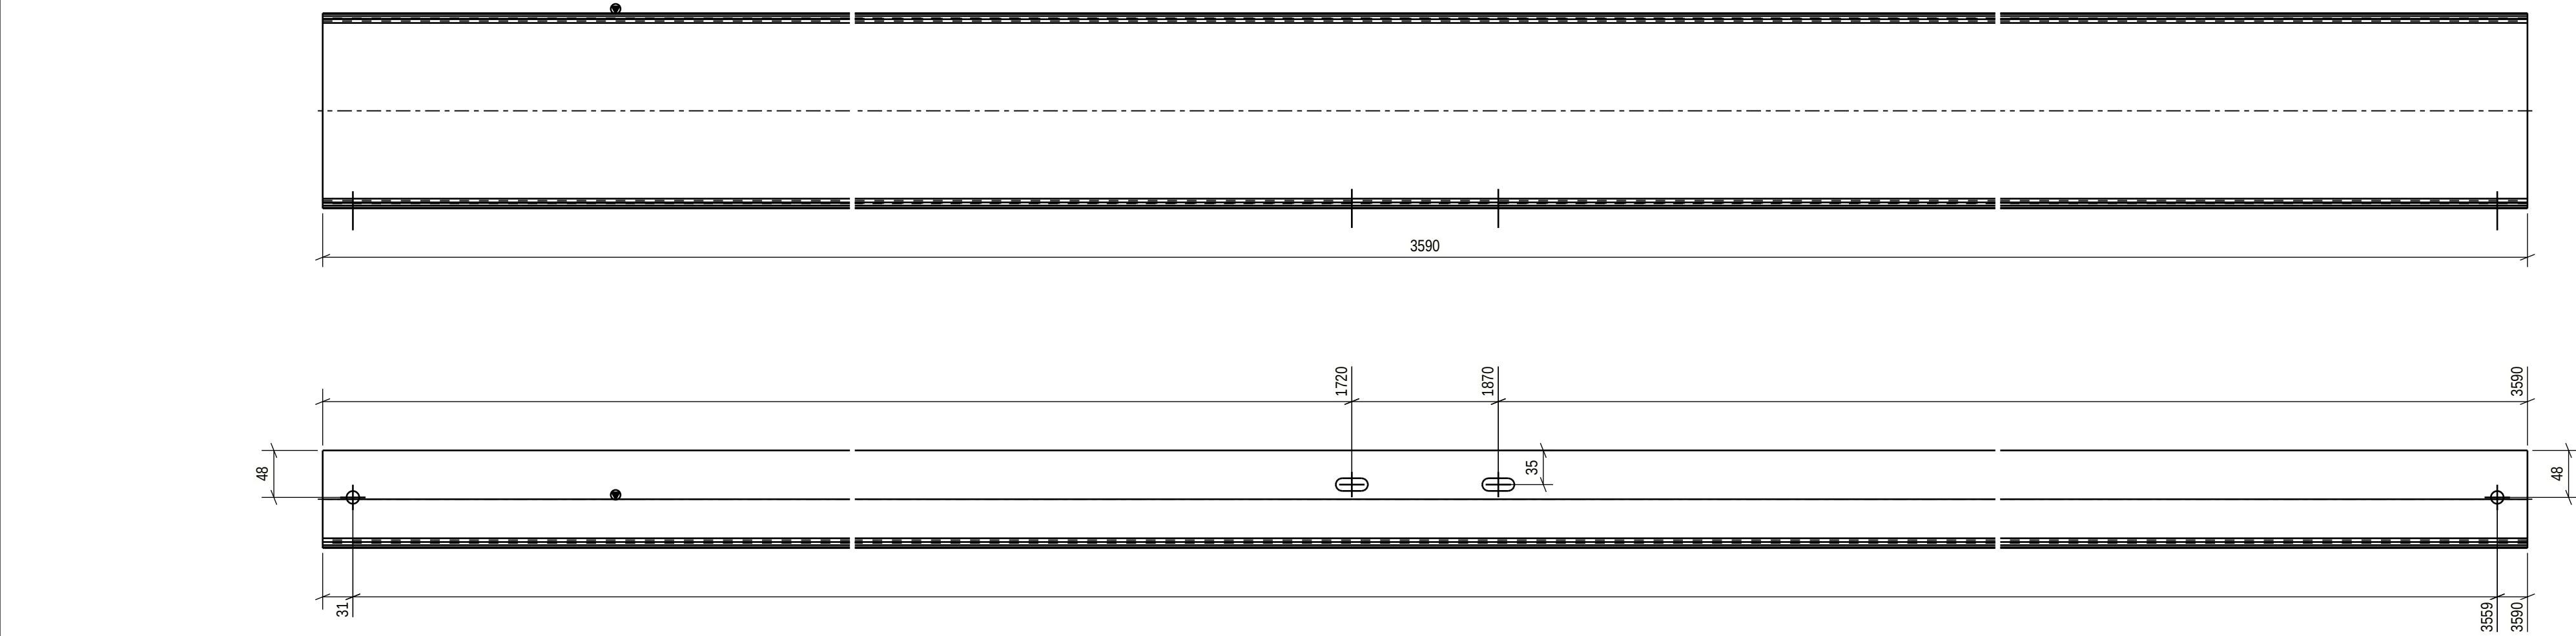

PART LIST FOR ASSEMBLY E51B-1209, MANUFACTURING AMOUNT 8 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BP-1124	CFJ100-200-50-5-5	S355J2	3590	2.43	46.9	1
TOTAL:				2.43	46.9	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard

EN1090-2, table A.3 : EXC2

Execution Specification document nr

25019443-ICC250-0600-0660-000005

Surface preparation grade

ISO8501-3, grade P2

Surface treatment

ISO12944-5

Additional requirements on surface treatment

C3.07, EPPUR 240/2

Shade

RAL 7024 (Graphite Gray)

Welding of built up steel section

Appendix 1 / Project spec.

Welds, if not specified otherwise

EN 9692-1, EN 9692-2

Fabrication tolerances

EN 1090-2, Appendix B

Special fabrication tolerances

Project specification/ shown on drwg.

Weld inspection, requirements

EN 1090-2,Table 24, U>0.5

Extent of NDT, fillet welds

MT-EN1290,20% of welds

Extent of NDT, butt welds

UT, EN-ISO17640, 20% of welds

Extent of NDT for splices not shown on drawing

UT, EN-ISO17640, 100%of welds

Requirements on holing

EN1090-2 Section 6.6.3

Weld class

C, EN ISO 5817

Additional material inspection

Shown on drwg.

PROJECT NAME

Easpring New Materials Oy

FAIR Phase 1

DRAWING CONTENT

ASSEMBLY DRAWING

Beam

E51B-1209

SWECO

Sustainable engineering and design

SWECO RAKENNETEKNIikka OY

ILMALANPORTTI 2

00240 HELSINKI

PUH. +358 207 393 000

www.sweco.fi

DATE

16.06.2026

DRAWN

Alexey Serous

PROJECT NUMBER

25019443

ARCHIVING CODE

PAGE

DESIGNER

Alexey Serous

APPROVED

Pertti Koivumaaanaho

CHECKED

Jere Kallosalmi

REVISION


DESIGN GROUP

STR

E51B-1209


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PART LIST FOR ASSEMBLY E51B-1210, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BP-1134	CFJ100-200-50-5-5	S355J2	3425	2.32	44.8	1
TOTAL:				2.32	44.8	

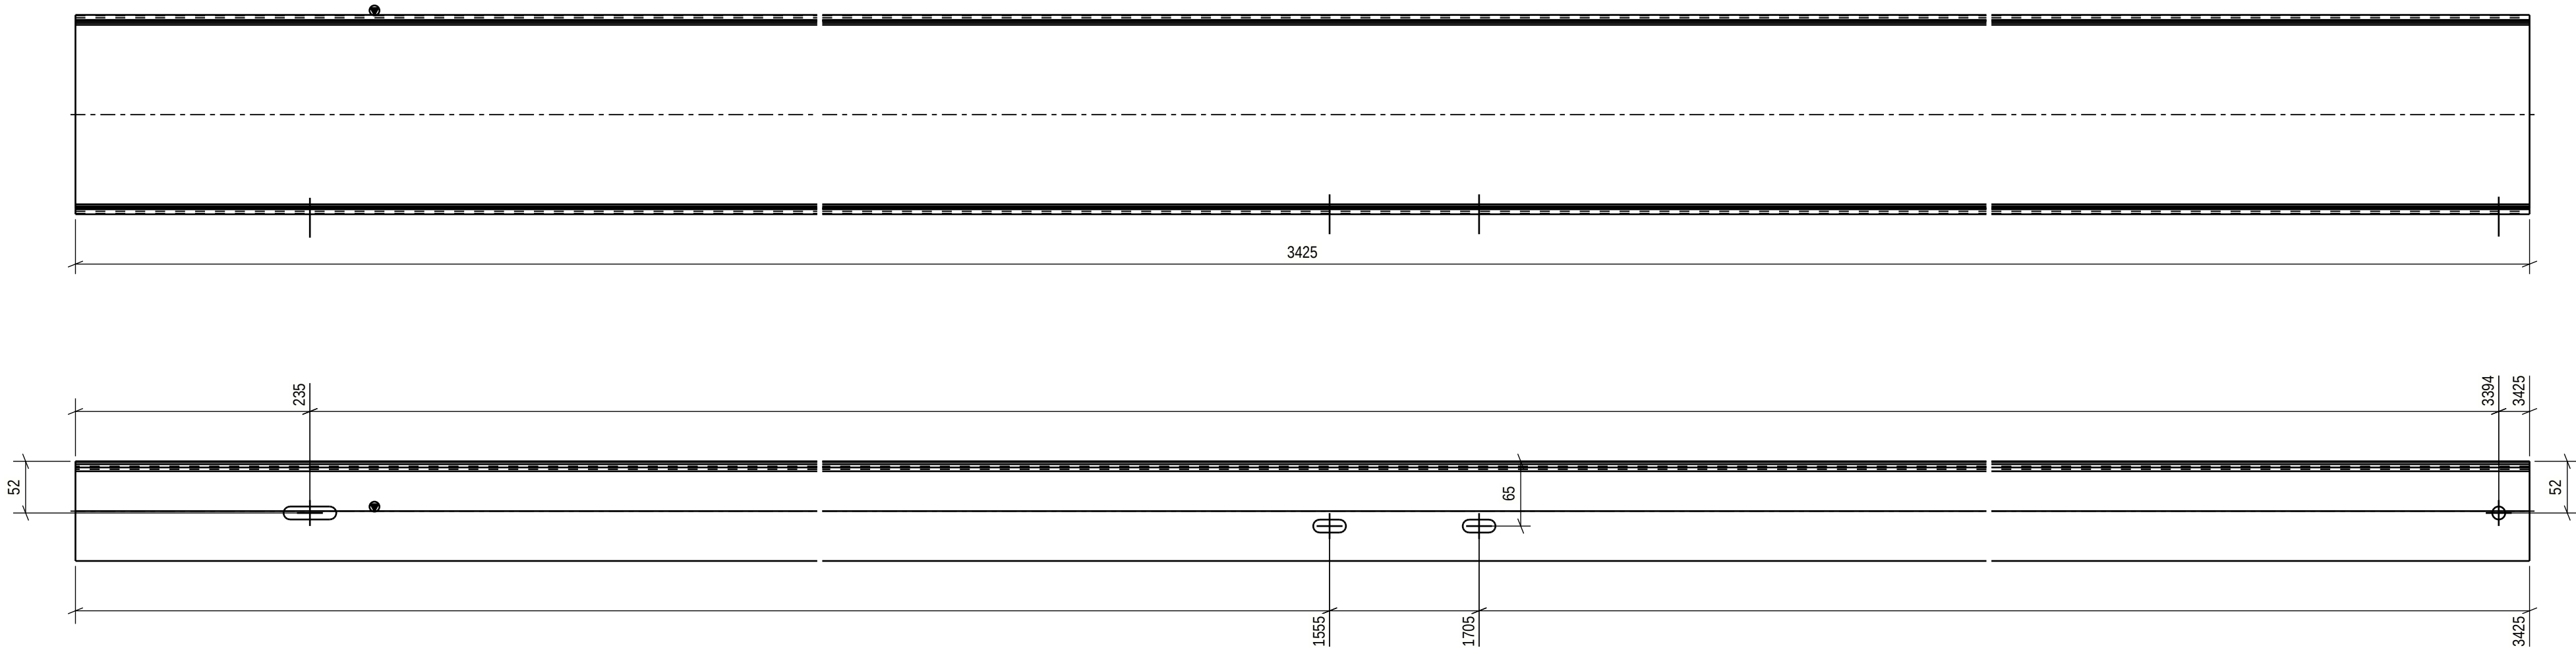

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

Technical fabrication requirements:		Execution class EXC2		Approved For Construction			
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution Specification document nr 25019443-ICC250-0600-0660-000005		Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg.		PROJECT NAME Easpring New Materials Oy FAIR Phase 1 		DRAWING CONTENT ASSEMBLY DRAWING Beam E51B-1210	
Surface preparation grade ISO8501-3, grade P2		Weld inspection, requirements EN 1090-2,Table 24, U>0.5					
Surface treatment ISO12944-5		Extent of NDT, fillet welds MT-EN1290,20% of welds					
Additional requirements on surface treatment C3.07, EPPUR 240/2		Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds					
Shade RAL 7024 (Graphite Gray)		Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100%of welds					
Welding of built up steel section Appendix 1 / Project spec.		Requirements on holing EN1090-2 Section 6.6.3		SWECO Sustainable engineering and design		SWECO RAKENNETEKNIikka Oy ILMALANPORTTI 2 00240 HELSINKI PUH. +358 207 393 000 www.sweco.fi	
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Weld class C, EN ISO 5817					
Additional material inspection Shown on drwg.						DATE 16.06.2026 DRAWN Alexey Serous PROJECT NUMBER 25019443	
						ARCHIVING CODE DESIGNER Alexey Serous REVISION	
						PAGE APPROVED Pertti Koivumaaanaho DESIGN GROUP STR	
						CHECKED Jere Kallosalmi	

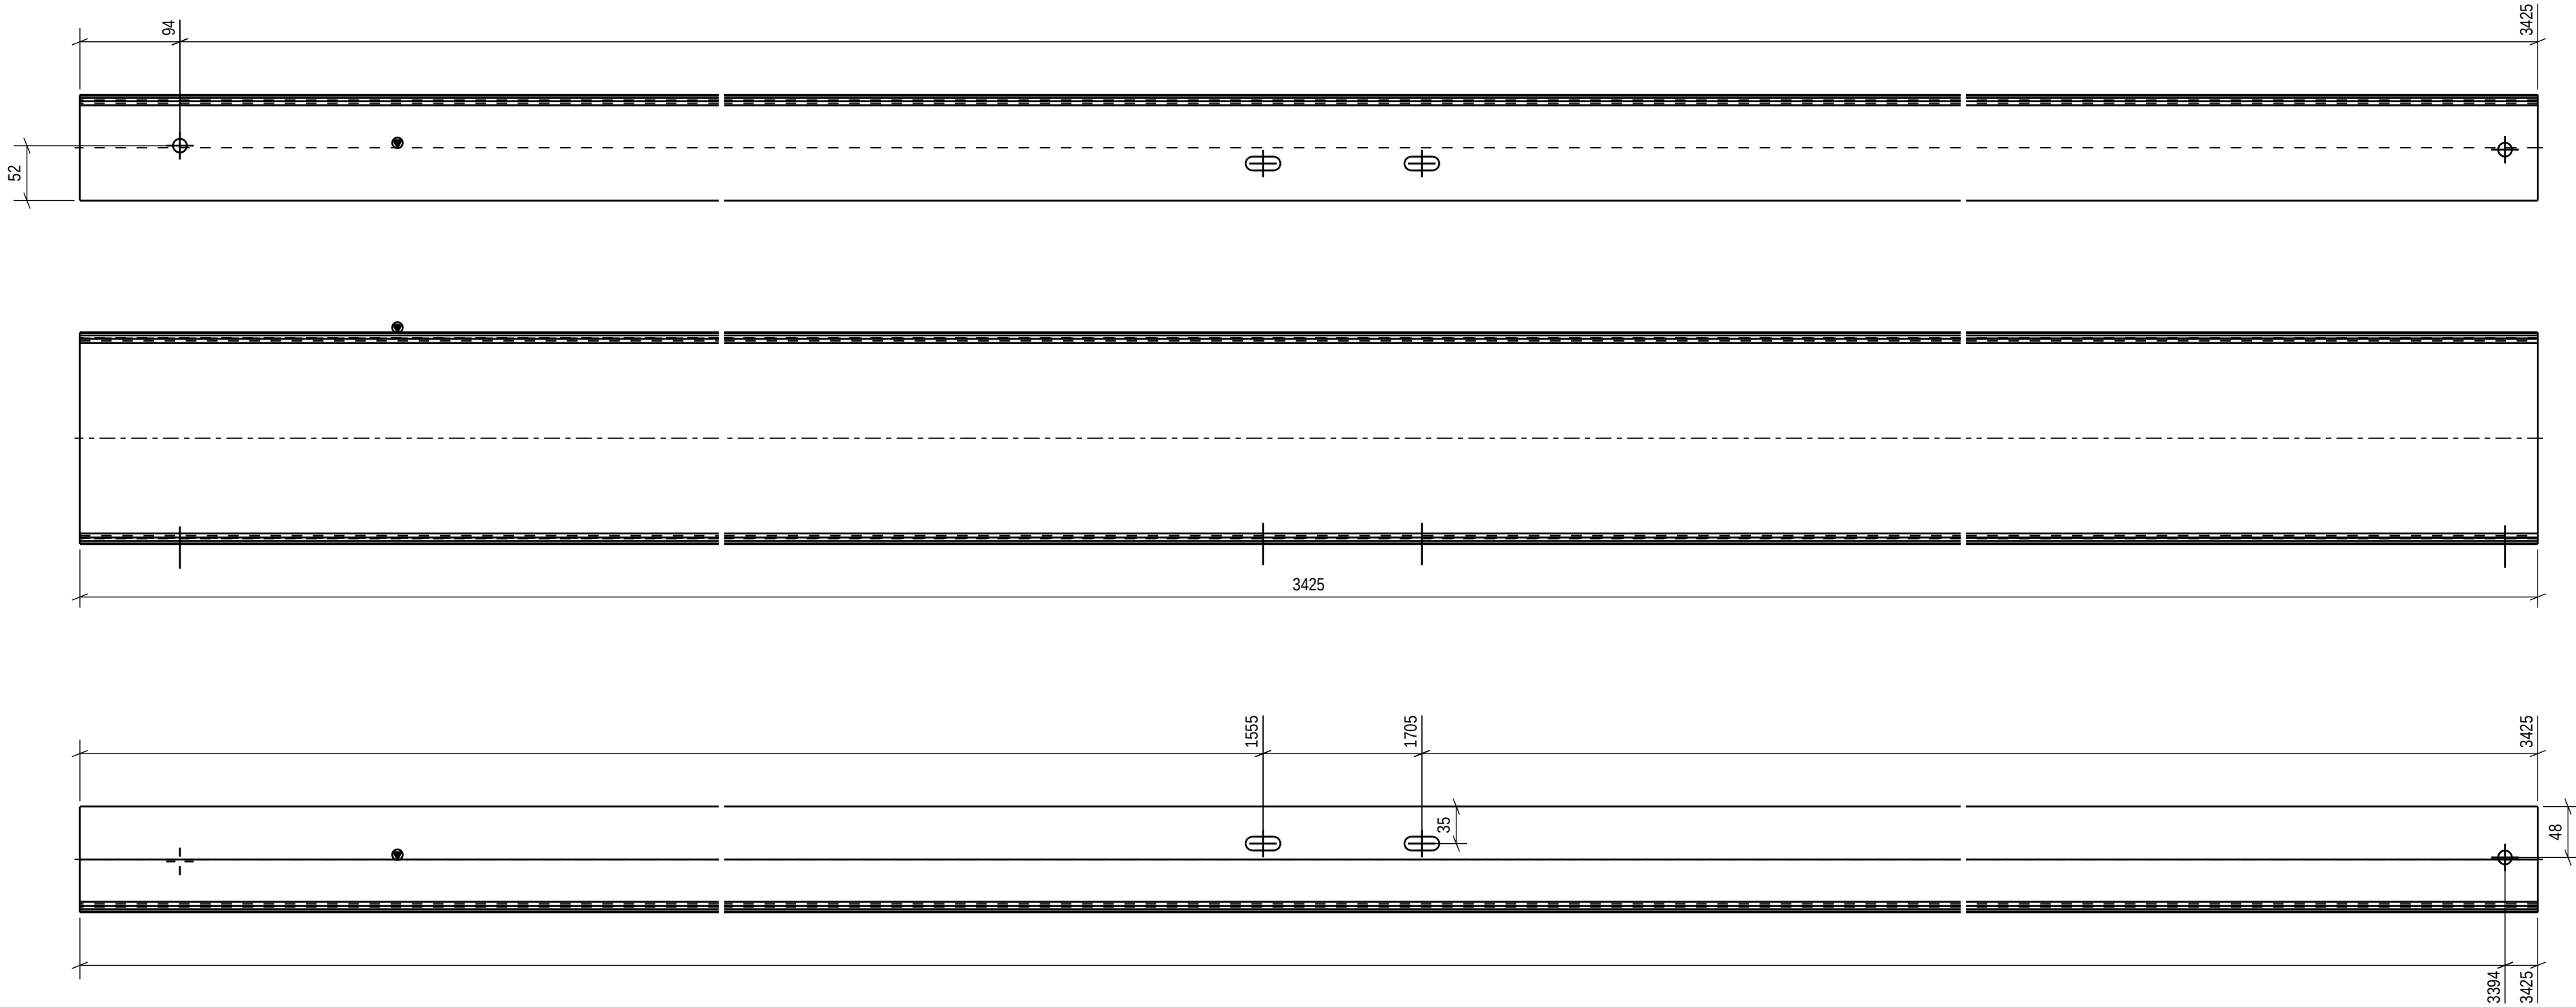

PART LIST FOR ASSEMBLY E51B-1211, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BP-1136	CFJ100-200-50-5-5	S355J2	3425	2.32	44.8	1
TOTAL:				2.32	44.8	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard

EN1090-2, table A.3 : EXC2

Execution Specification document nr

25019443-ICC250-0600-0660-000005

Surface preparation grade

ISO8501-3, grade P2

Surface treatment

ISO12944-5

Additional requirements on surface treatment

C3.07, EPPUR 240/2

Shade

RAL 7024 (Graphite Gray)

Welding of built up steel section

Appendix 1 / Project spec.

Welds, if not specified otherwise

EN 9692-1, EN 9692-2

Fabrication tolerances

EN 1090-2, Appendix B

Special fabrication tolerances

Project specification/ shown on drwg.

Weld inspection, requirements

EN 1090-2,Table 24, U>0.5

Extent of NDT, fillet welds

MT-EN1290,20% of welds

Extent of NDT, butt welds

UT, EN-ISO17640, 20% of welds

Extent of NDT for splices not shown on drawing

UT, EN-ISO17640, 100%of welds

Requirements on hoing

EN1090-2 Section 6.6.3

Weld class

C, EN ISO 5817

Additional material inspection

Shown on drwg.

PROJECT NAME

Easpring New Materials Oy

FAIR Phase 1

 SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT

ASSEMBLY DRAWING

Beam

E51B-1211

DATE

16.06.2026

ARCHIVING CODE

PAGE

DESIGN GROUP

STR

DRAWN

Alexey Serous

DESIGNER

Alexey Serous

APPROVED

Pertti Koivumaaanaho

CHECKED

Jere Kallosalmi

PROJECT NUMBER

25019443

DWG. NO.


REVISION

E51B-1211


For special tolerances of bolt hole location

see specification for steel structures

Approved For Construction

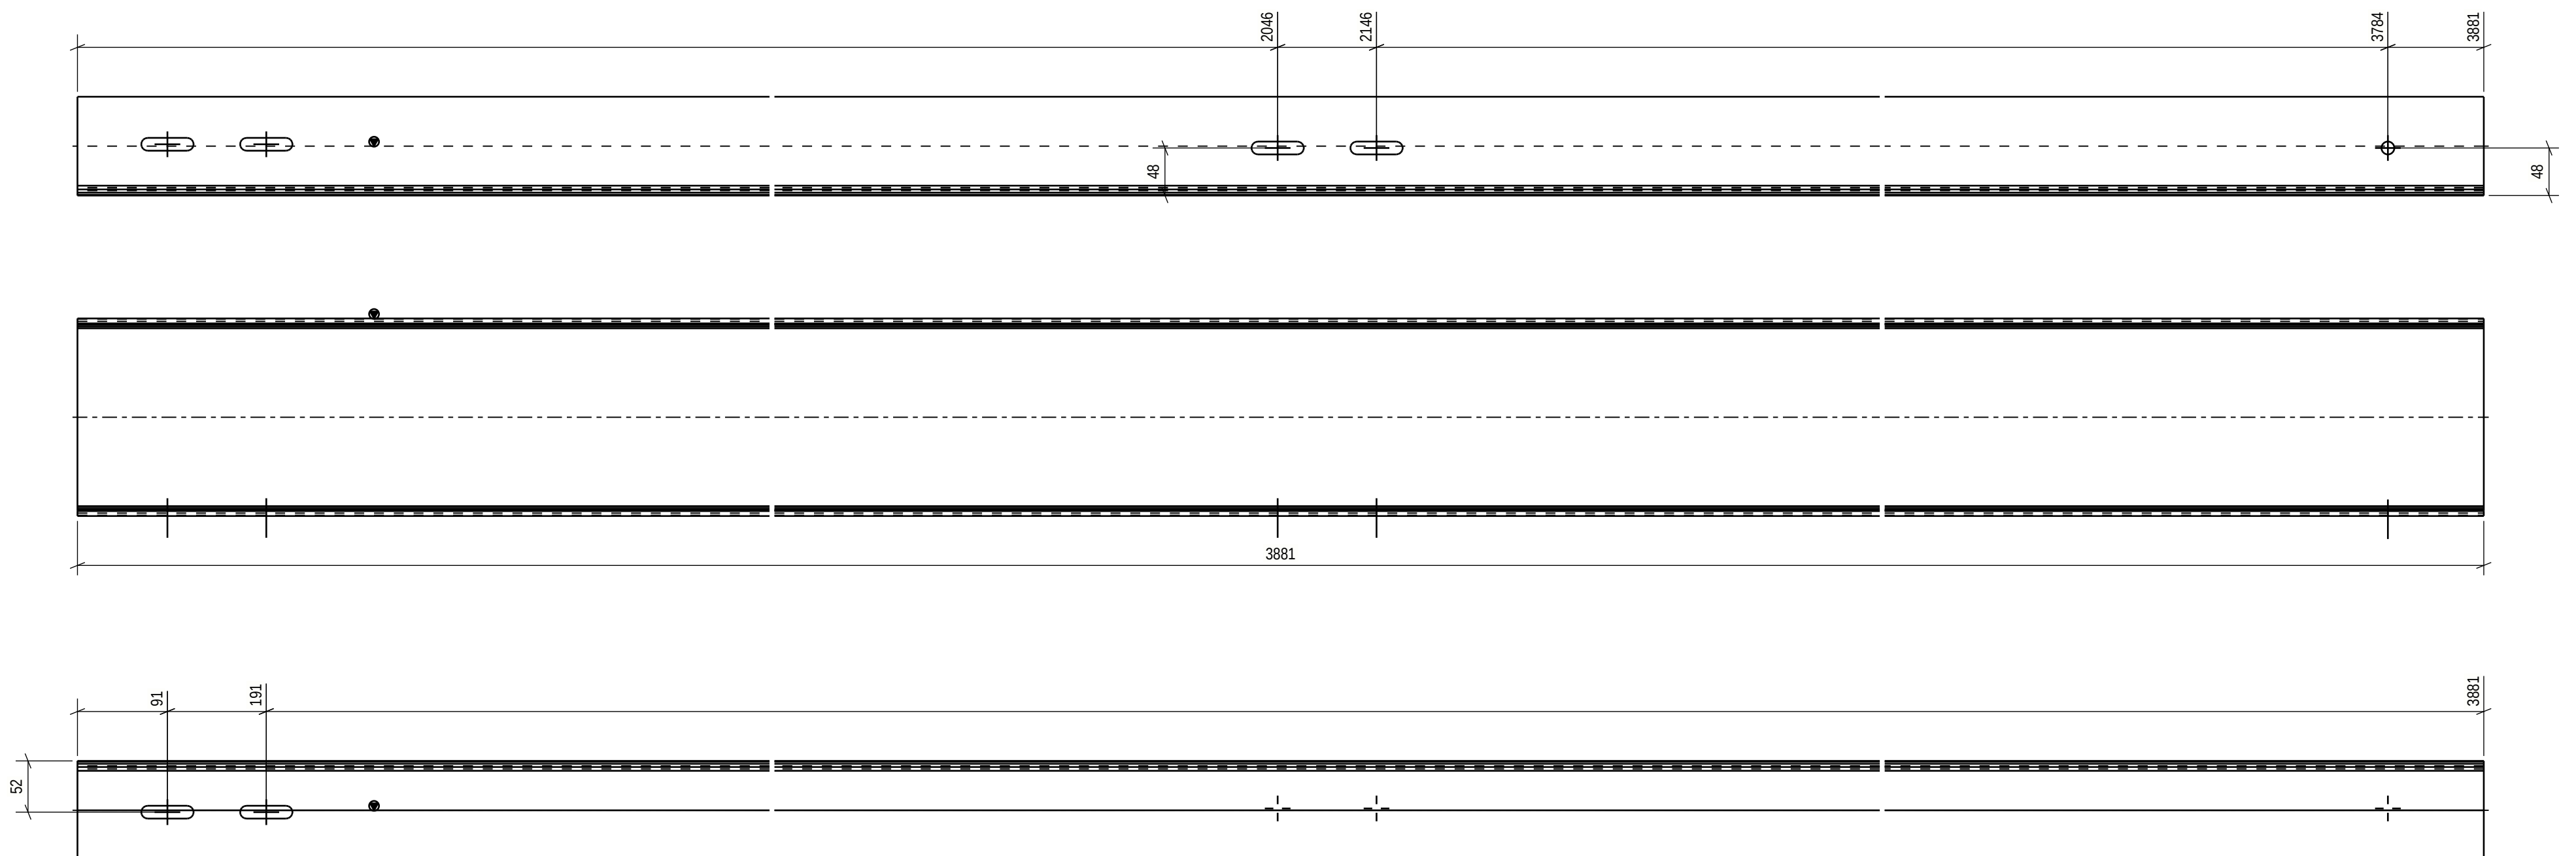


PART LIST FOR ASSEMBLY E51B-1212, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BP-1126	CFJ100-200-50-5-5	S355J2	3881	2.63	50.7	1
			TOTAL:	2.63	50.7	

Technical fabrication requirements:		Execution class EXC2		Approved For Construction				
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution Specification document nr 25019443-ICC250-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 / Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2		Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on holding EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817 Additional inspection Shown on drwg.		PROJECT NAME Easpring New Materials Oy FAIR Phase 1				
				SWECO RAKENNETEKNIikka OY ILMALANPORTTI 2 00240 HELSINKI PUH. +358 207 393 000 www.sweco.fi		DRAWING CONTENT ASSEMBLY DRAWING Beam E51B-1212		
				DATE 16.06.2026		ARCHIVING CODE	PAGE	DESIGN GROUP STR
				DRAWN Alexey Serous		DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
				PROJECT NUMBER 25019443		DWG. NO. E51B-1212		REVISION

For special tolerances of bolt hole location
see specification for steel structures

Approved For Construction

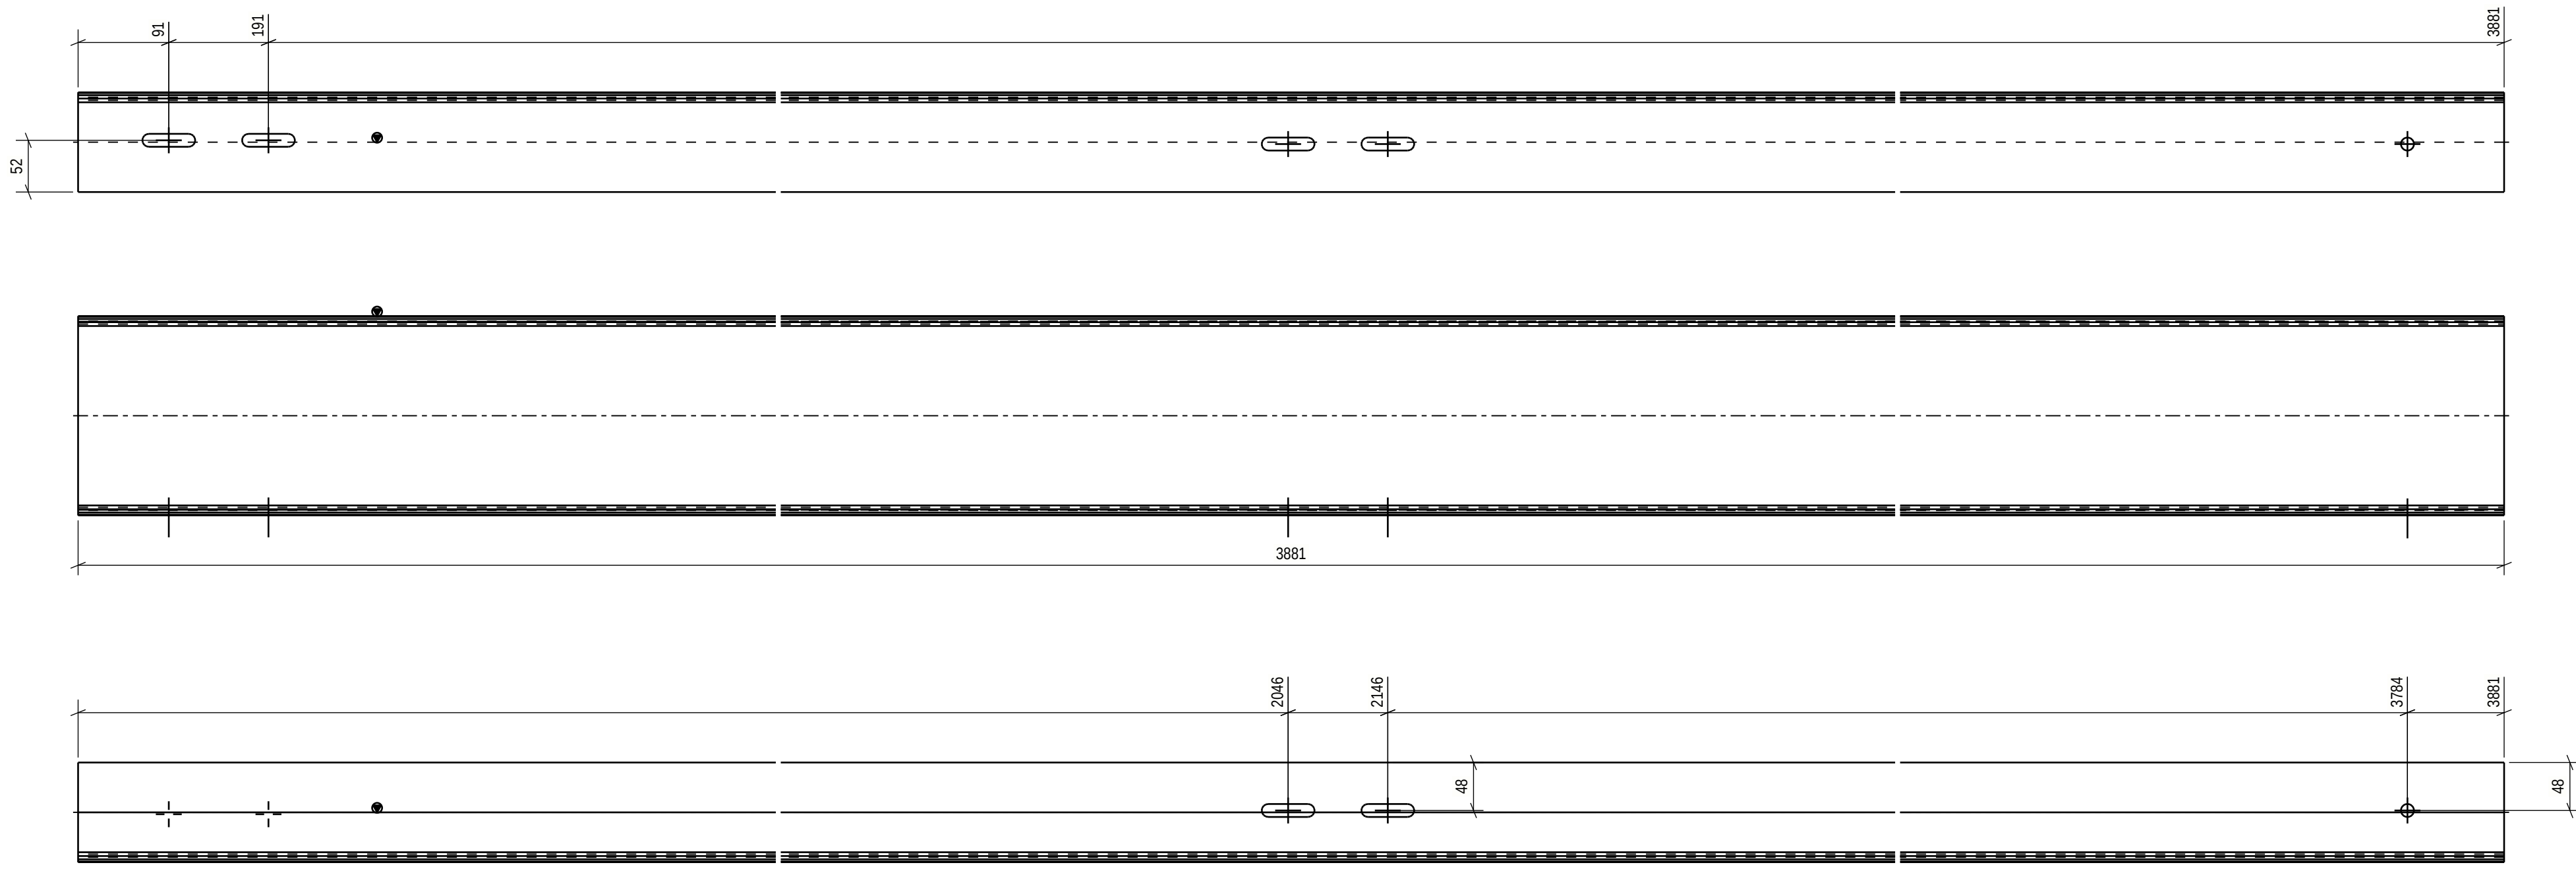

PART LIST FOR ASSEMBLY E51B-1213, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BP-1135	CFJ100-200-50-5-5	S355J2	3881	2.63	50.7	1
TOTAL:				2.63	50.7	

Technical fabrication requirements:		Execution class EXC2	
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		Fabrication tolerances EN 1090-2, Appendix B	
Execution Specification document nr 25019443-ICC250-0600-0660-000005		Special fabrication tolerances Project specification/ shown on drwg.	
Surface preparation grade ISO8501-3, grade P2		Weld inspection, requirements EN 1090-2, Table 24, U>0.5	
Surface treatment ISO12944-5		Extent of NDT, fillet welds MT-EN1290, 20% of welds	
Additional requirements on surface treatment C3.07, EPPUR 240/2		Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Shade RAL 7024 (Graphite Gray)		Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds	
Welding of built up steel section Appendix 1 / Project spec.		Requirements on holing EN1090-2 Section 6.6.3	
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Weld class C, EN ISO 5817	
		Additional material inspection Shown on drwg.	

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1

SWECO 
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI

PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1213

DATE
16.06.2026

DRAWN
Alexey Serous

PROJECT NUMBER
25019443

ARCHIVING CODE

PAGE

APPROVED
Pertti Koivumaaanaho


CHECKED
Jere Kallosalmi

DESIGN GROUP
STR

REVISION

E51B-1213

25019443_Fair_E500

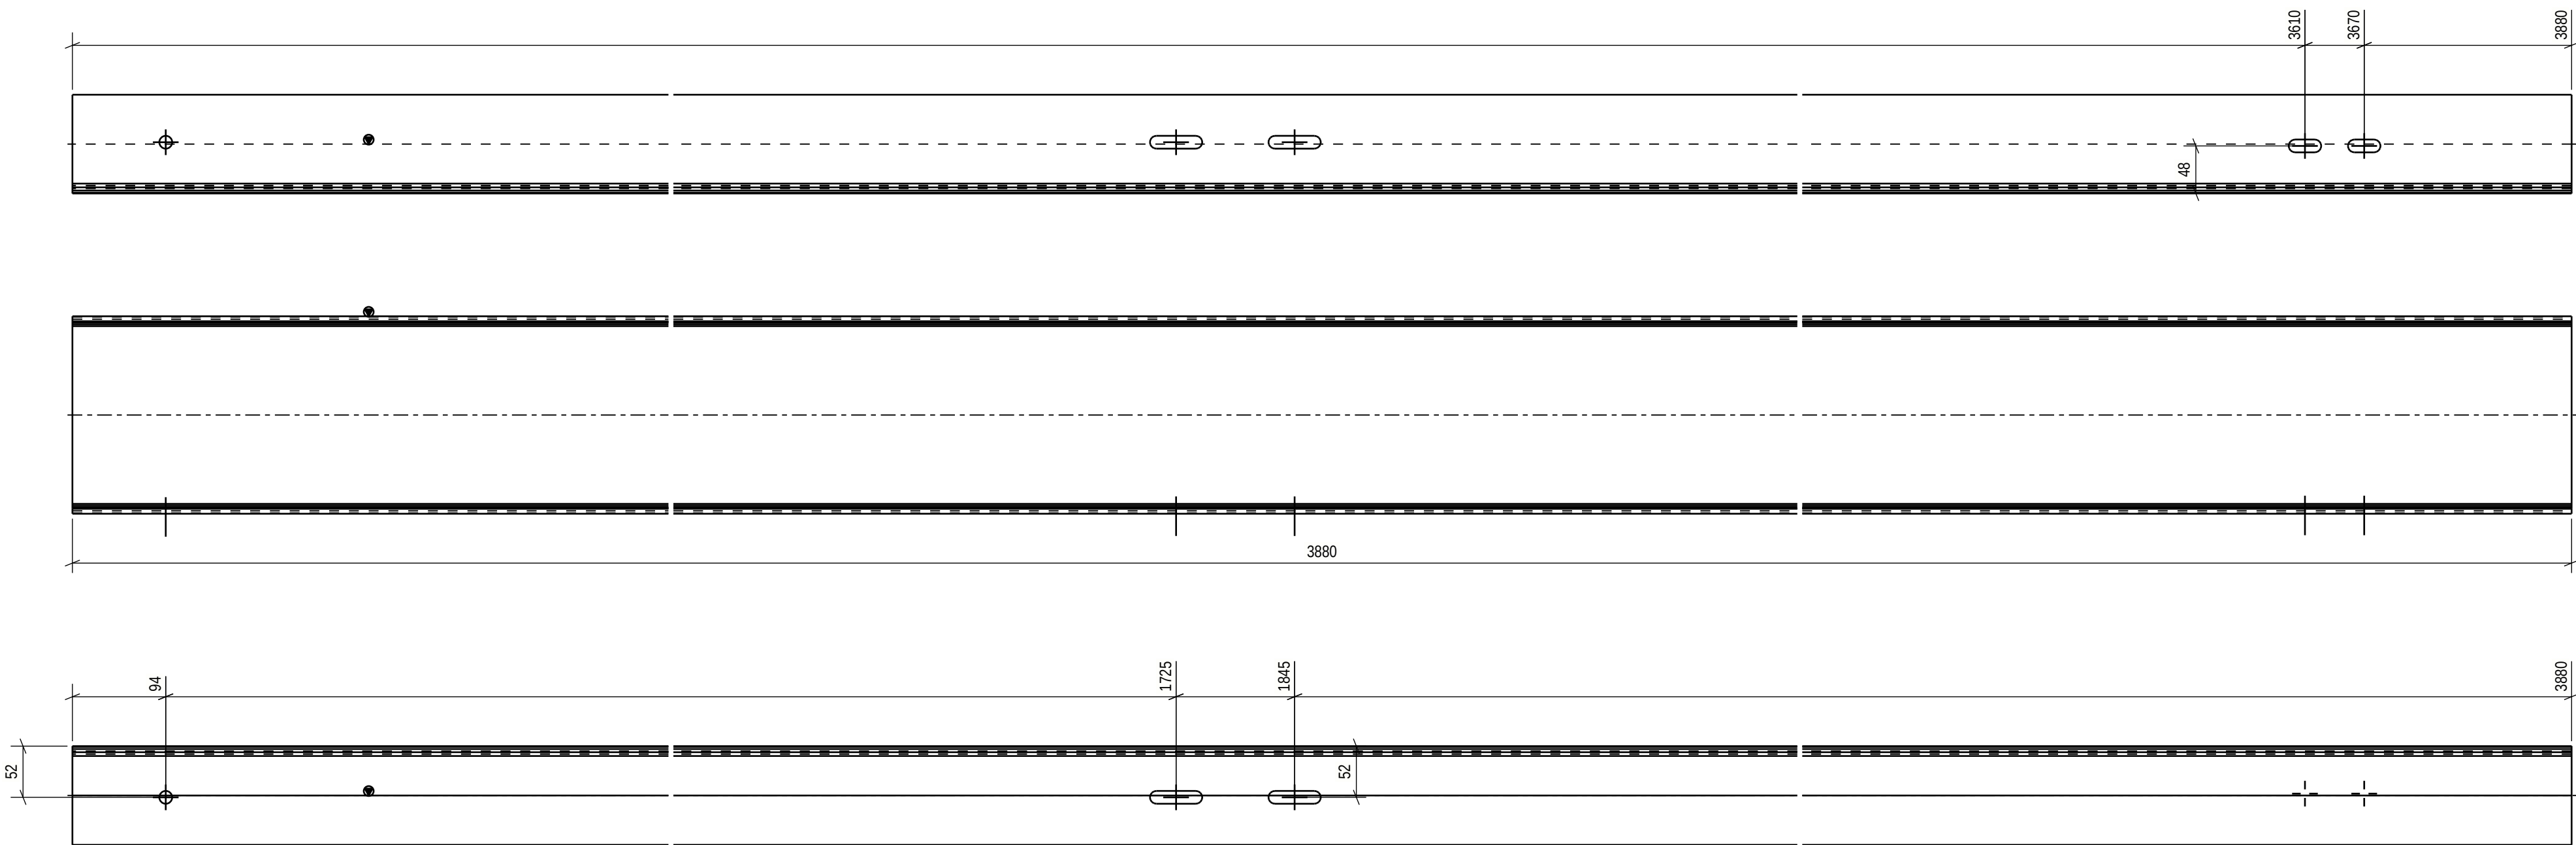

PART LIST FOR ASSEMBLY E51B-1214, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BP-1132	CFJ100-200-50-5-5	S355J2	3880	2.63	50.7	1
TOTAL:				2.63	50.7	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard

EN1090-2, table A.3 : EXC2

Execution Specification document nr

25019443-ICC250-0600-0660-000005

Surface preparation grade

ISO8501-3, grade P2

Surface treatment

ISO12944-5

Additional requirements on surface treatment

C3.07, EPPUR 240/2

Shade

RAL 7024 (Graphite Gray)

Welding of built up steel section

Appendix 1 / Project spec.

Welds, if not specified otherwise

EN 9692-1, EN 9692-2

Fabrication tolerances

EN 1090-2, Appendix B

Special fabrication tolerances

Project specification/ shown on drwg.

Weld inspection, requirements

EN 1090-2,Table 24, U>0.5

Extent of NDT, fillet welds

MT-EN1290,20% of welds

Extent of NDT, butt welds

UT, EN-ISO17640, 20% of welds

Extent of NDT for splices not shown on drawing

UT, EN-ISO17640, 100%of welds

Requirements on holing

EN1090-2 Section 6.6.3

Weld class

C, EN ISO 5817

Additional material inspection

Shown on drwg.

PROJECT NAME

Easpring New Materials Oy

FAIR Phase 1

 SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT

ASSEMBLY DRAWING

Beam

E51B-1214

DATE

16.06.2026

ARCHIVING CODE

PAGE

DESIGN GROUP

STR

DRAWN

Alexey Serous

DESIGNER

Alexey Serous

APPROVED

Pertti Koivumaaanaho

CHECKED

Jere Kalilosalmi

PROJECT NUMBER

25019443

DWG. NO.


E51B-1214

REVISION

For special tolerances of bolt hole location
see specification for steel structures

Approved For Construction

25019443_Fair_E500

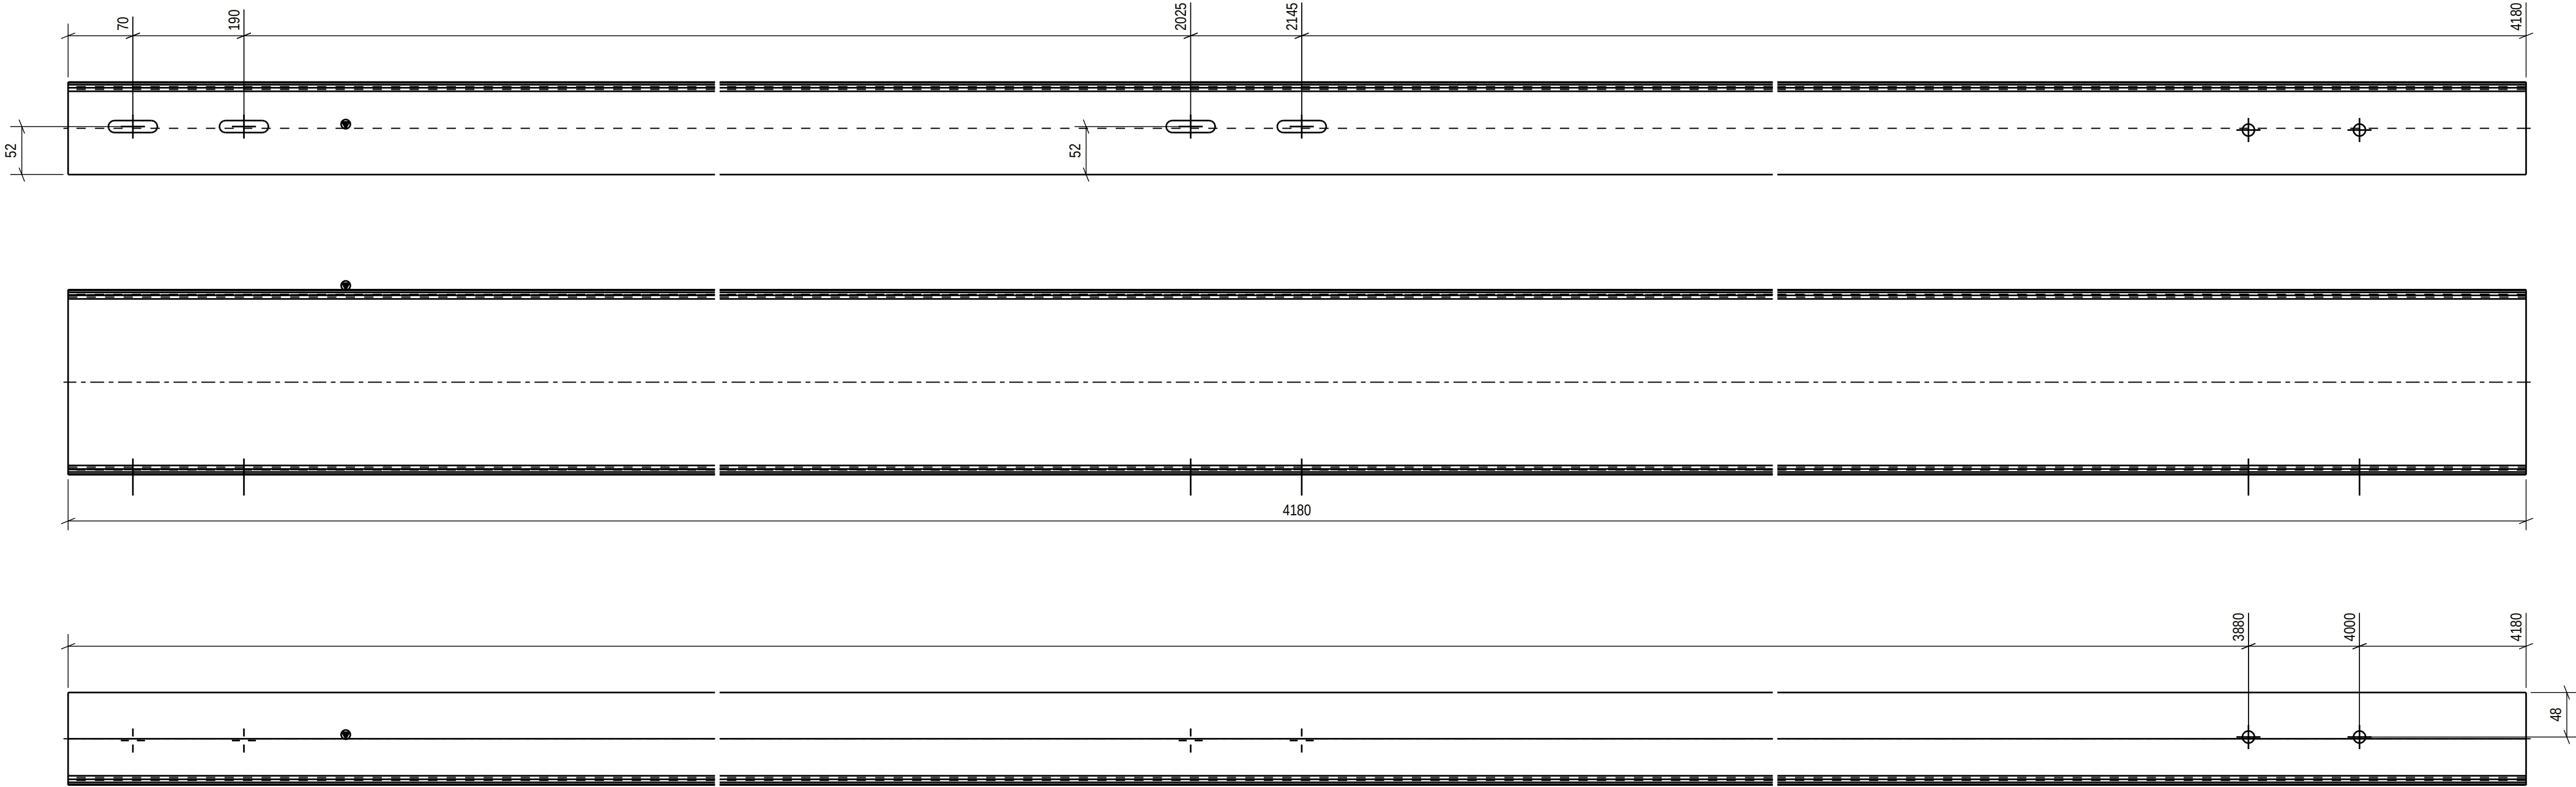

PART LIST FOR ASSEMBLY E51B-1215, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BP-1125	CFJ100-200-50-5-5	S355J2	4180	2.83	54.6	1
TOTAL:				2.83	54.6	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard

EN1090-2, table A.3 : EXC2

Execution Specification document nr

25019443-ICC250-0600-0660-000005

Surface preparation grade

ISO8501-3, grade P2

Surface treatment

ISO12944-5

Additional requirements on surface treatment

C3.07, EPPUR 240/2

Shade

RAL 7024 (Graphite Gray)

Welding of built up steel section

Appendix 1 / Project spec.

Welds, if not specified otherwise

EN 9692-1, EN 9692-2

Fabrication tolerances

EN 1090-2, Appendix B

Special fabrication tolerances

Project specification/ shown on drwg.

Weld inspection, requirements

EN 1090-2,Table 24, U>0.5

Extent of NDT, fillet welds

MT-EN1290,20% of welds

Extent of NDT, butt welds

UT, EN-ISO17640, 20% of welds

Extent of NDT for splices not shown on drawing

UT, EN-ISO17640, 100%of welds

Requirements on holing

EN1090-2 Section 6.6.3

Weld class

C, EN ISO 5817

Additional material inspection

Shown on drwg.

PROJECT NAME

Easpring New Materials Oy

FAIR Phase 1



SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT


ASSEMBLY DRAWING

Beam

E51B-1215

DATE	16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP
DRAWN	Alexey Serous	DESIGNER	Alexey Serous	PERITI KOIVUMAANAHJO
PROJECT NUMBER	25019443	DWG. NO.	E51B-1215	REVISION

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

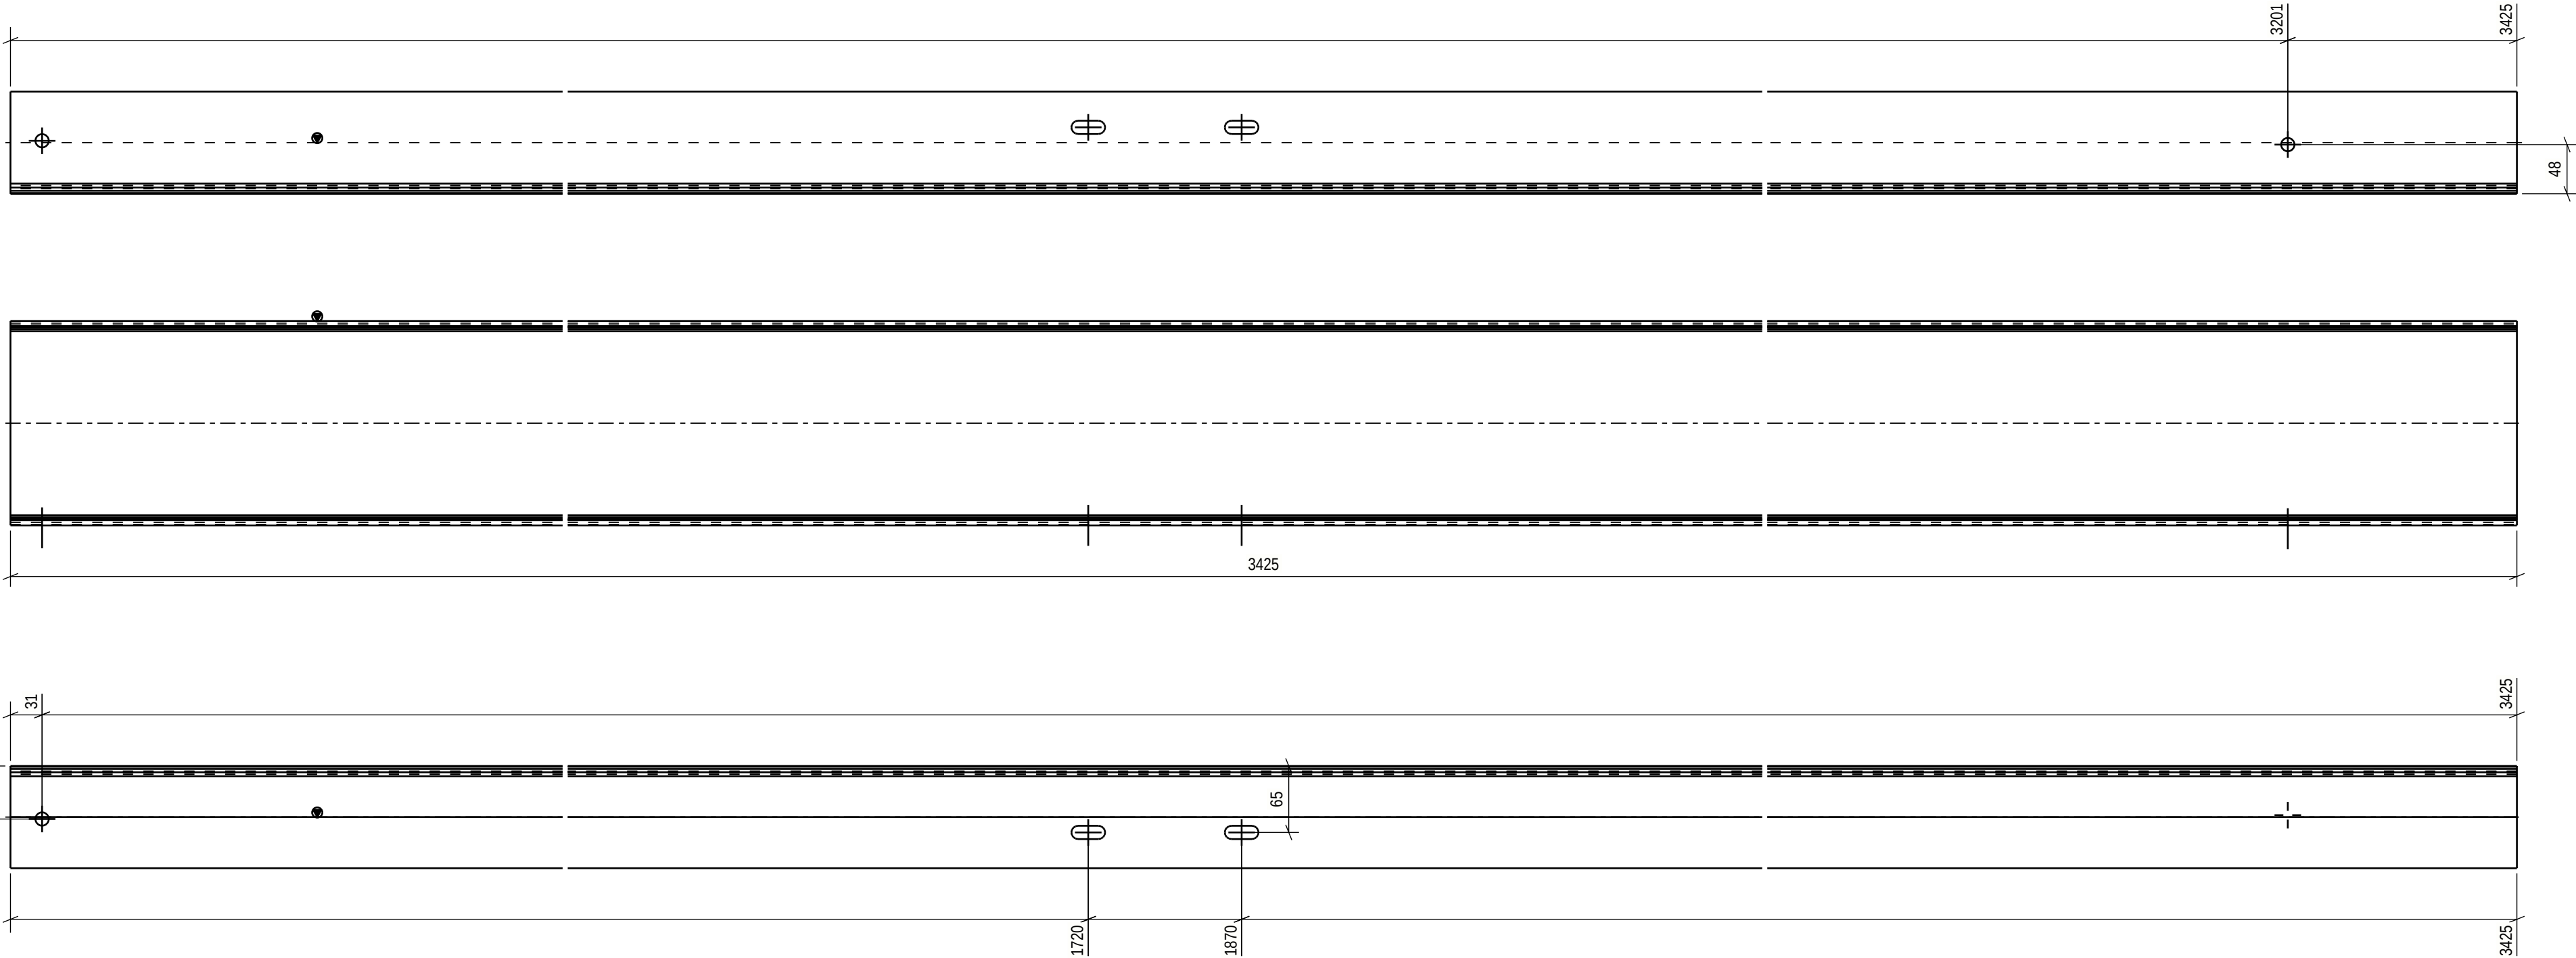

PART LIST FOR ASSEMBLY E51B-1216, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BP-1133	CFJ100-200-50-5-5	S355J2	3425	2.32	44.8	1
TOTAL:				2.32	44.8	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard

EN1090-2, table A.3 : EXC2

Execution Specification document nr

25019443-ICC250-0600-0660-000005

Surface preparation grade

ISO8501-3, grade P2

Surface treatment

ISO12944-5

Additional requirements on surface treatment

C3.07, EPPUR 240/2

Shade

RAL 7024 (Graphite Gray)

Welding of built up steel section

Appendix 1 / Project spec.

Welds, if not specified otherwise

EN 9692-1, EN 9692-2

Fabrication tolerances

EN 1090-2, Appendix B

Special fabrication tolerances

Project specification/ shown on drwg.

Weld inspection, requirements

EN 1090-2, Table 24, U>0.5

Extent of NDT, fillet welds

MT-EN1290, 20% of welds

Extent of NDT, butt welds

UT, EN-ISO17640, 20% of welds

Extent of NDT for splices not shown on drawing

UT, EN-ISO17640, 100% of welds

Requirements on bolting

EN1090-2 Section 6.6.3

Weld class

C, EN ISO 5817

Additional material inspection

Shown on drwg.

PROJECT NAME

Easpring New Materials Oy

FAIR Phase 1

DRAWING CONTENT

ASSEMBLY DRAWING

Beam

E51B-1216

SWECO



Sustainable engineering and design

SWECO RAKENNETEKNIikka OY

ILMALANPORTTI 2

00240 HELSINKI

PUH. +358 207 393 000

www.sweco.fi

DATE

16.06.2026

DRAWN

Alexey Serous

PROJECT NUMBER

25019443

ARCHIVING CODE

PAGE

DESIGN GROUP

STR

DESIGNER

Alexey Serous

APPROVED

Pertti Koivumaa

CHECKED


Jere Kallosalmi

DWG. NO.

E51B-1216

REVISION

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

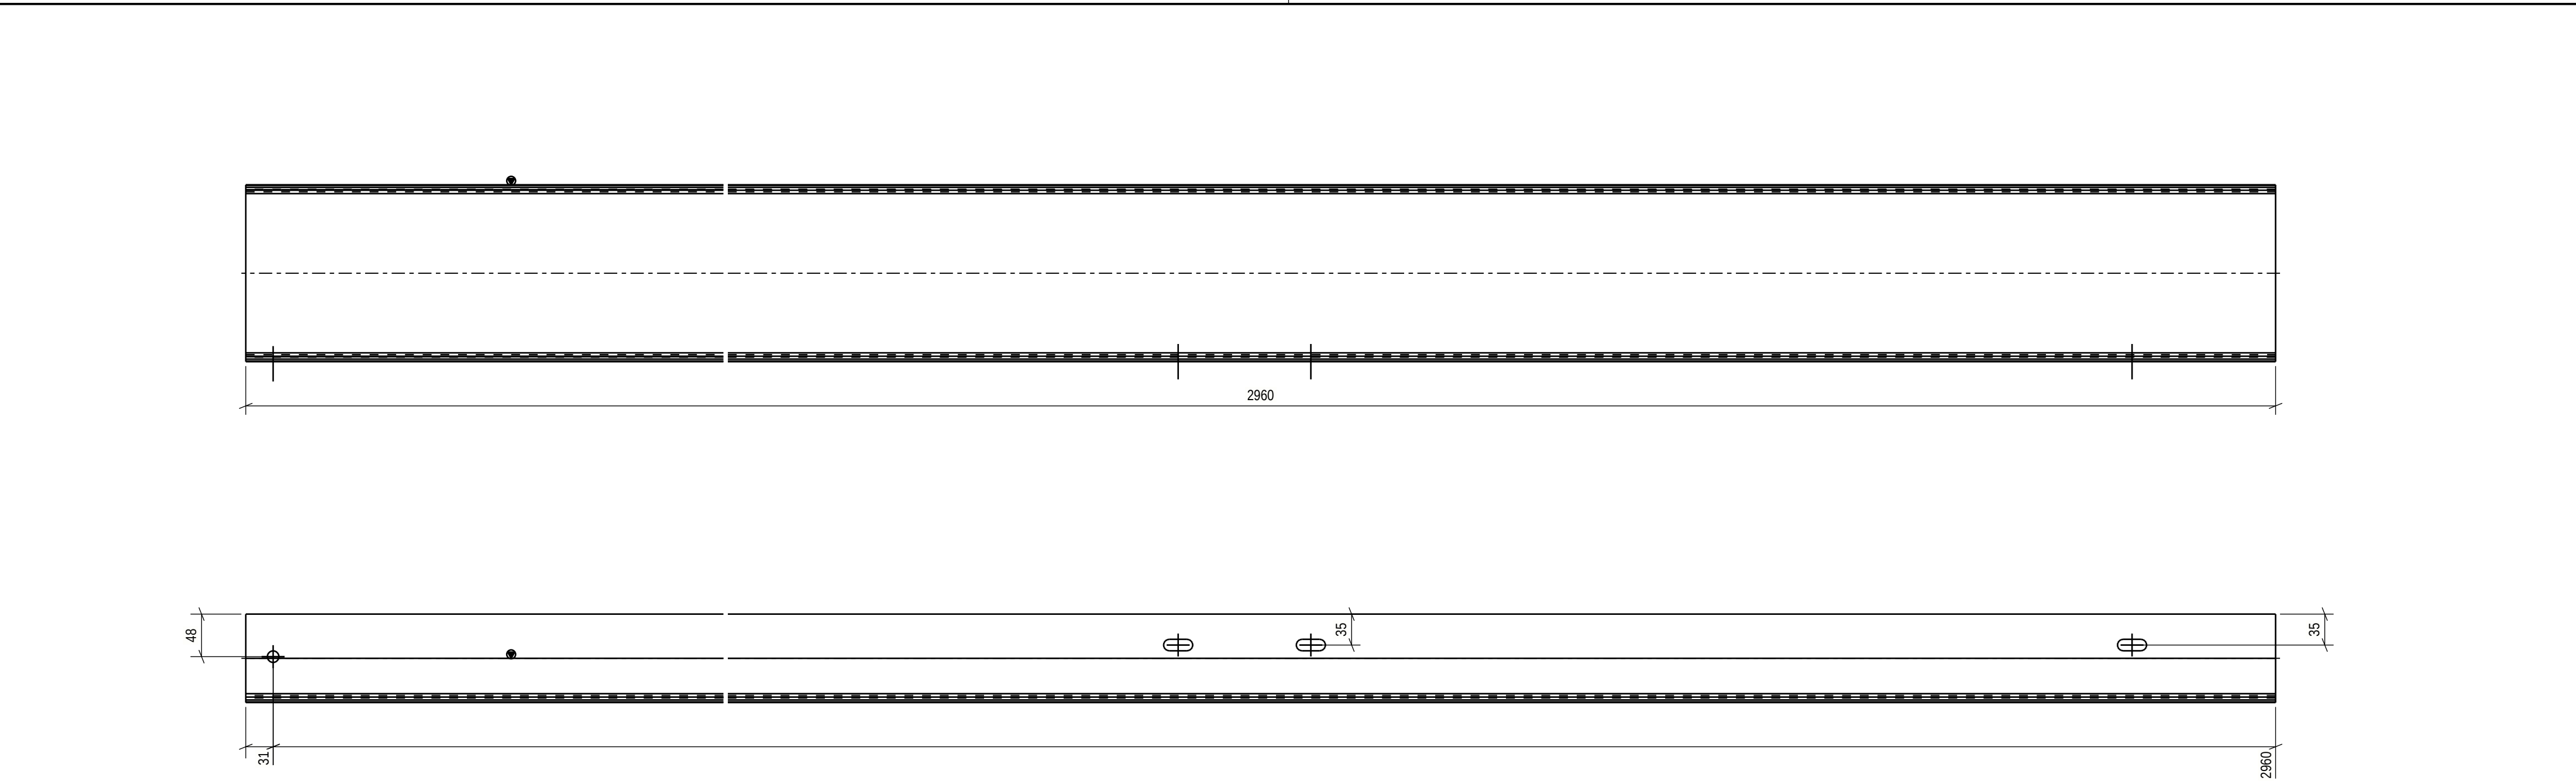

PART LIST FOR ASSEMBLY E51B-1217, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BP-1137	CFJ100-200-50-5-5	S355J2	2960	2.01	38.7	1
TOTAL:				2.01	38.7	

Technical fabrication requirements:		Execution class EXC2	
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		Fabrication tolerances EN 1090-2, Appendix B	
Execution Specification document nr 25019443-ICC250-0600-0660-000005		Special fabrication tolerances Project specification/ shown on drwg.	
Surface preparation grade ISO8501-3, grade P2		Weld inspection, requirements EN 1090-2,Table 24, U>0.5	
Surface treatment ISO12944-5		Extent of NDT, fillet welds MT-EN1290,20% of welds	
Additional requirements on surface treatment C3.07, EPPUR 240/2		Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Shade RAL 7024 (Graphite Gray)		Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100%of welds	
Welding of built up steel section Appendix 1 / Project spec.		Requirements on holing EN1090-2 Section 6.6.3	
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Weld class C, EN ISO 5817	
Additional material inspection Shown on drwg.			

For special tolerances of bolt hole location
see specification for steel structures

Approved For Construction




PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1

SWECO 
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1217

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kallosalmi
PROJECT NUMBER 25019443		REVISION E51B-1217	

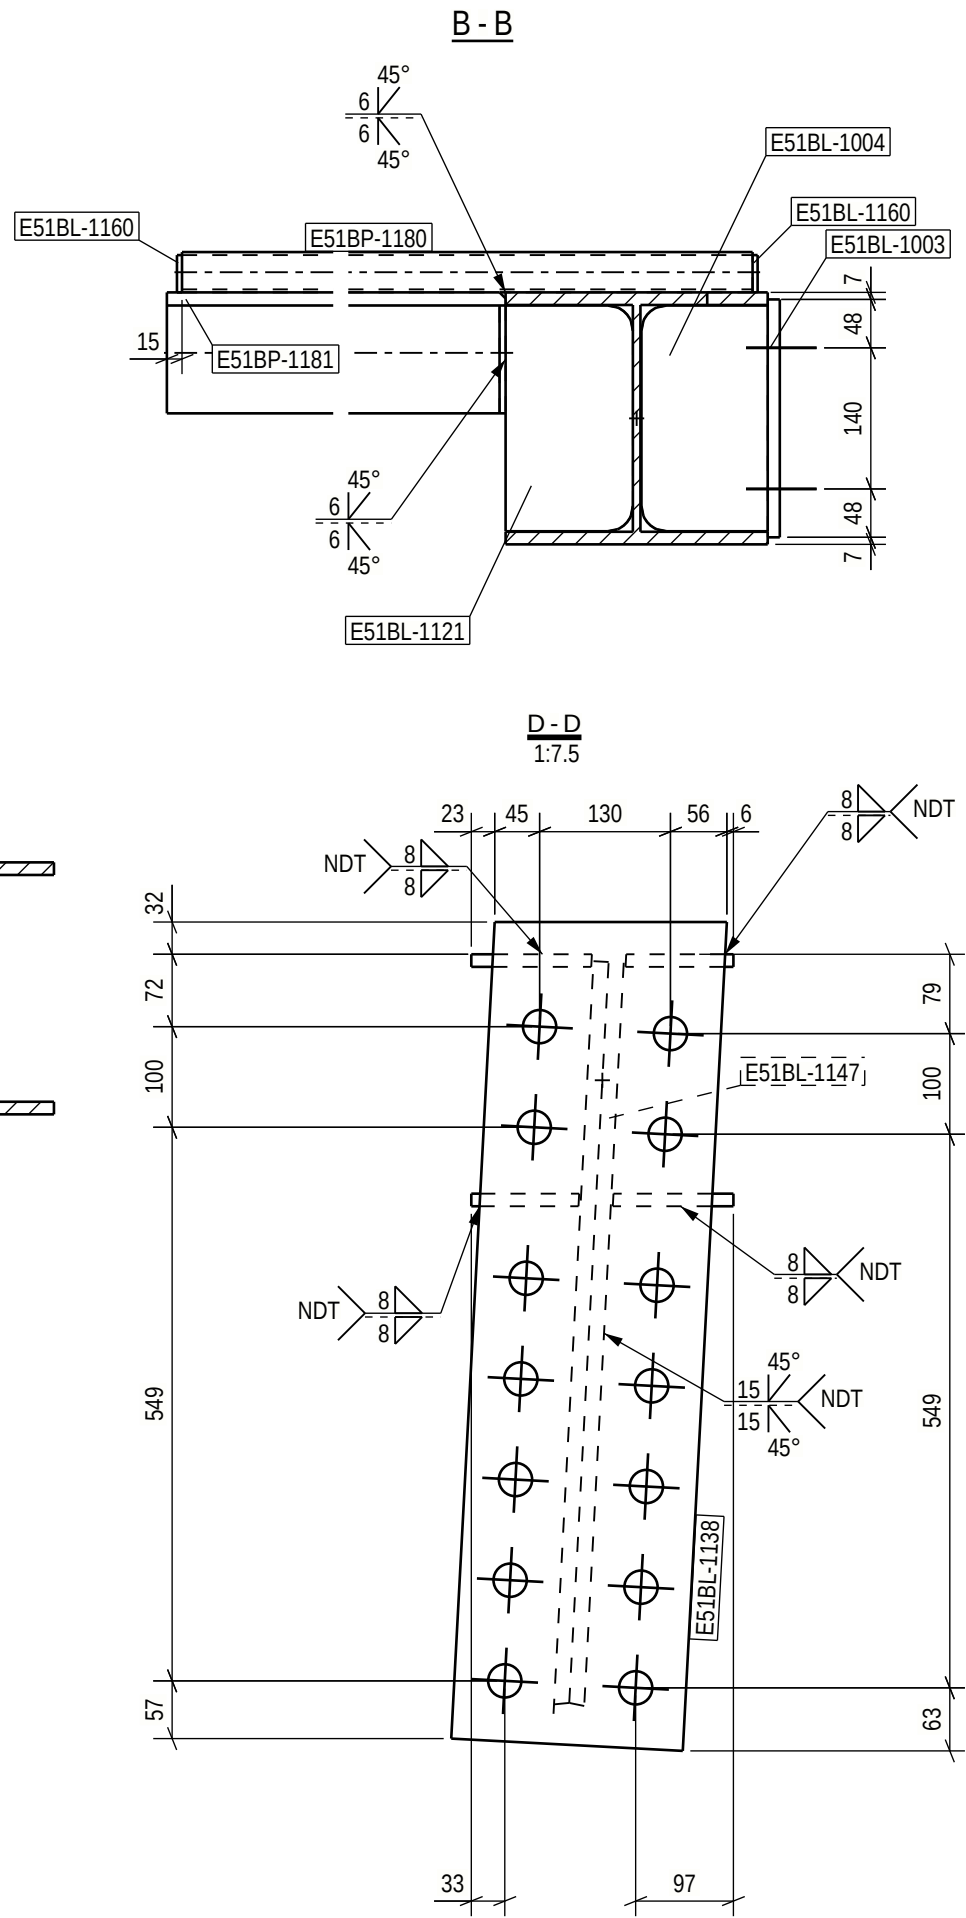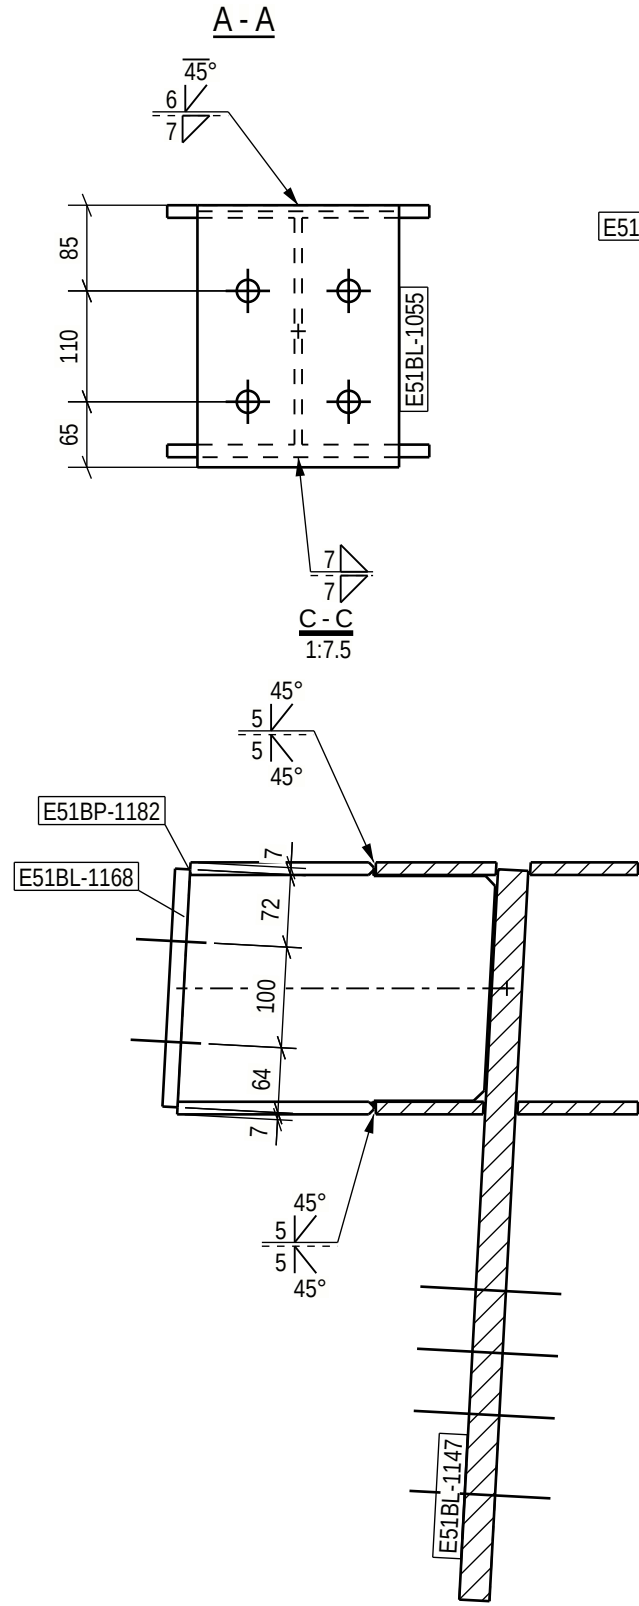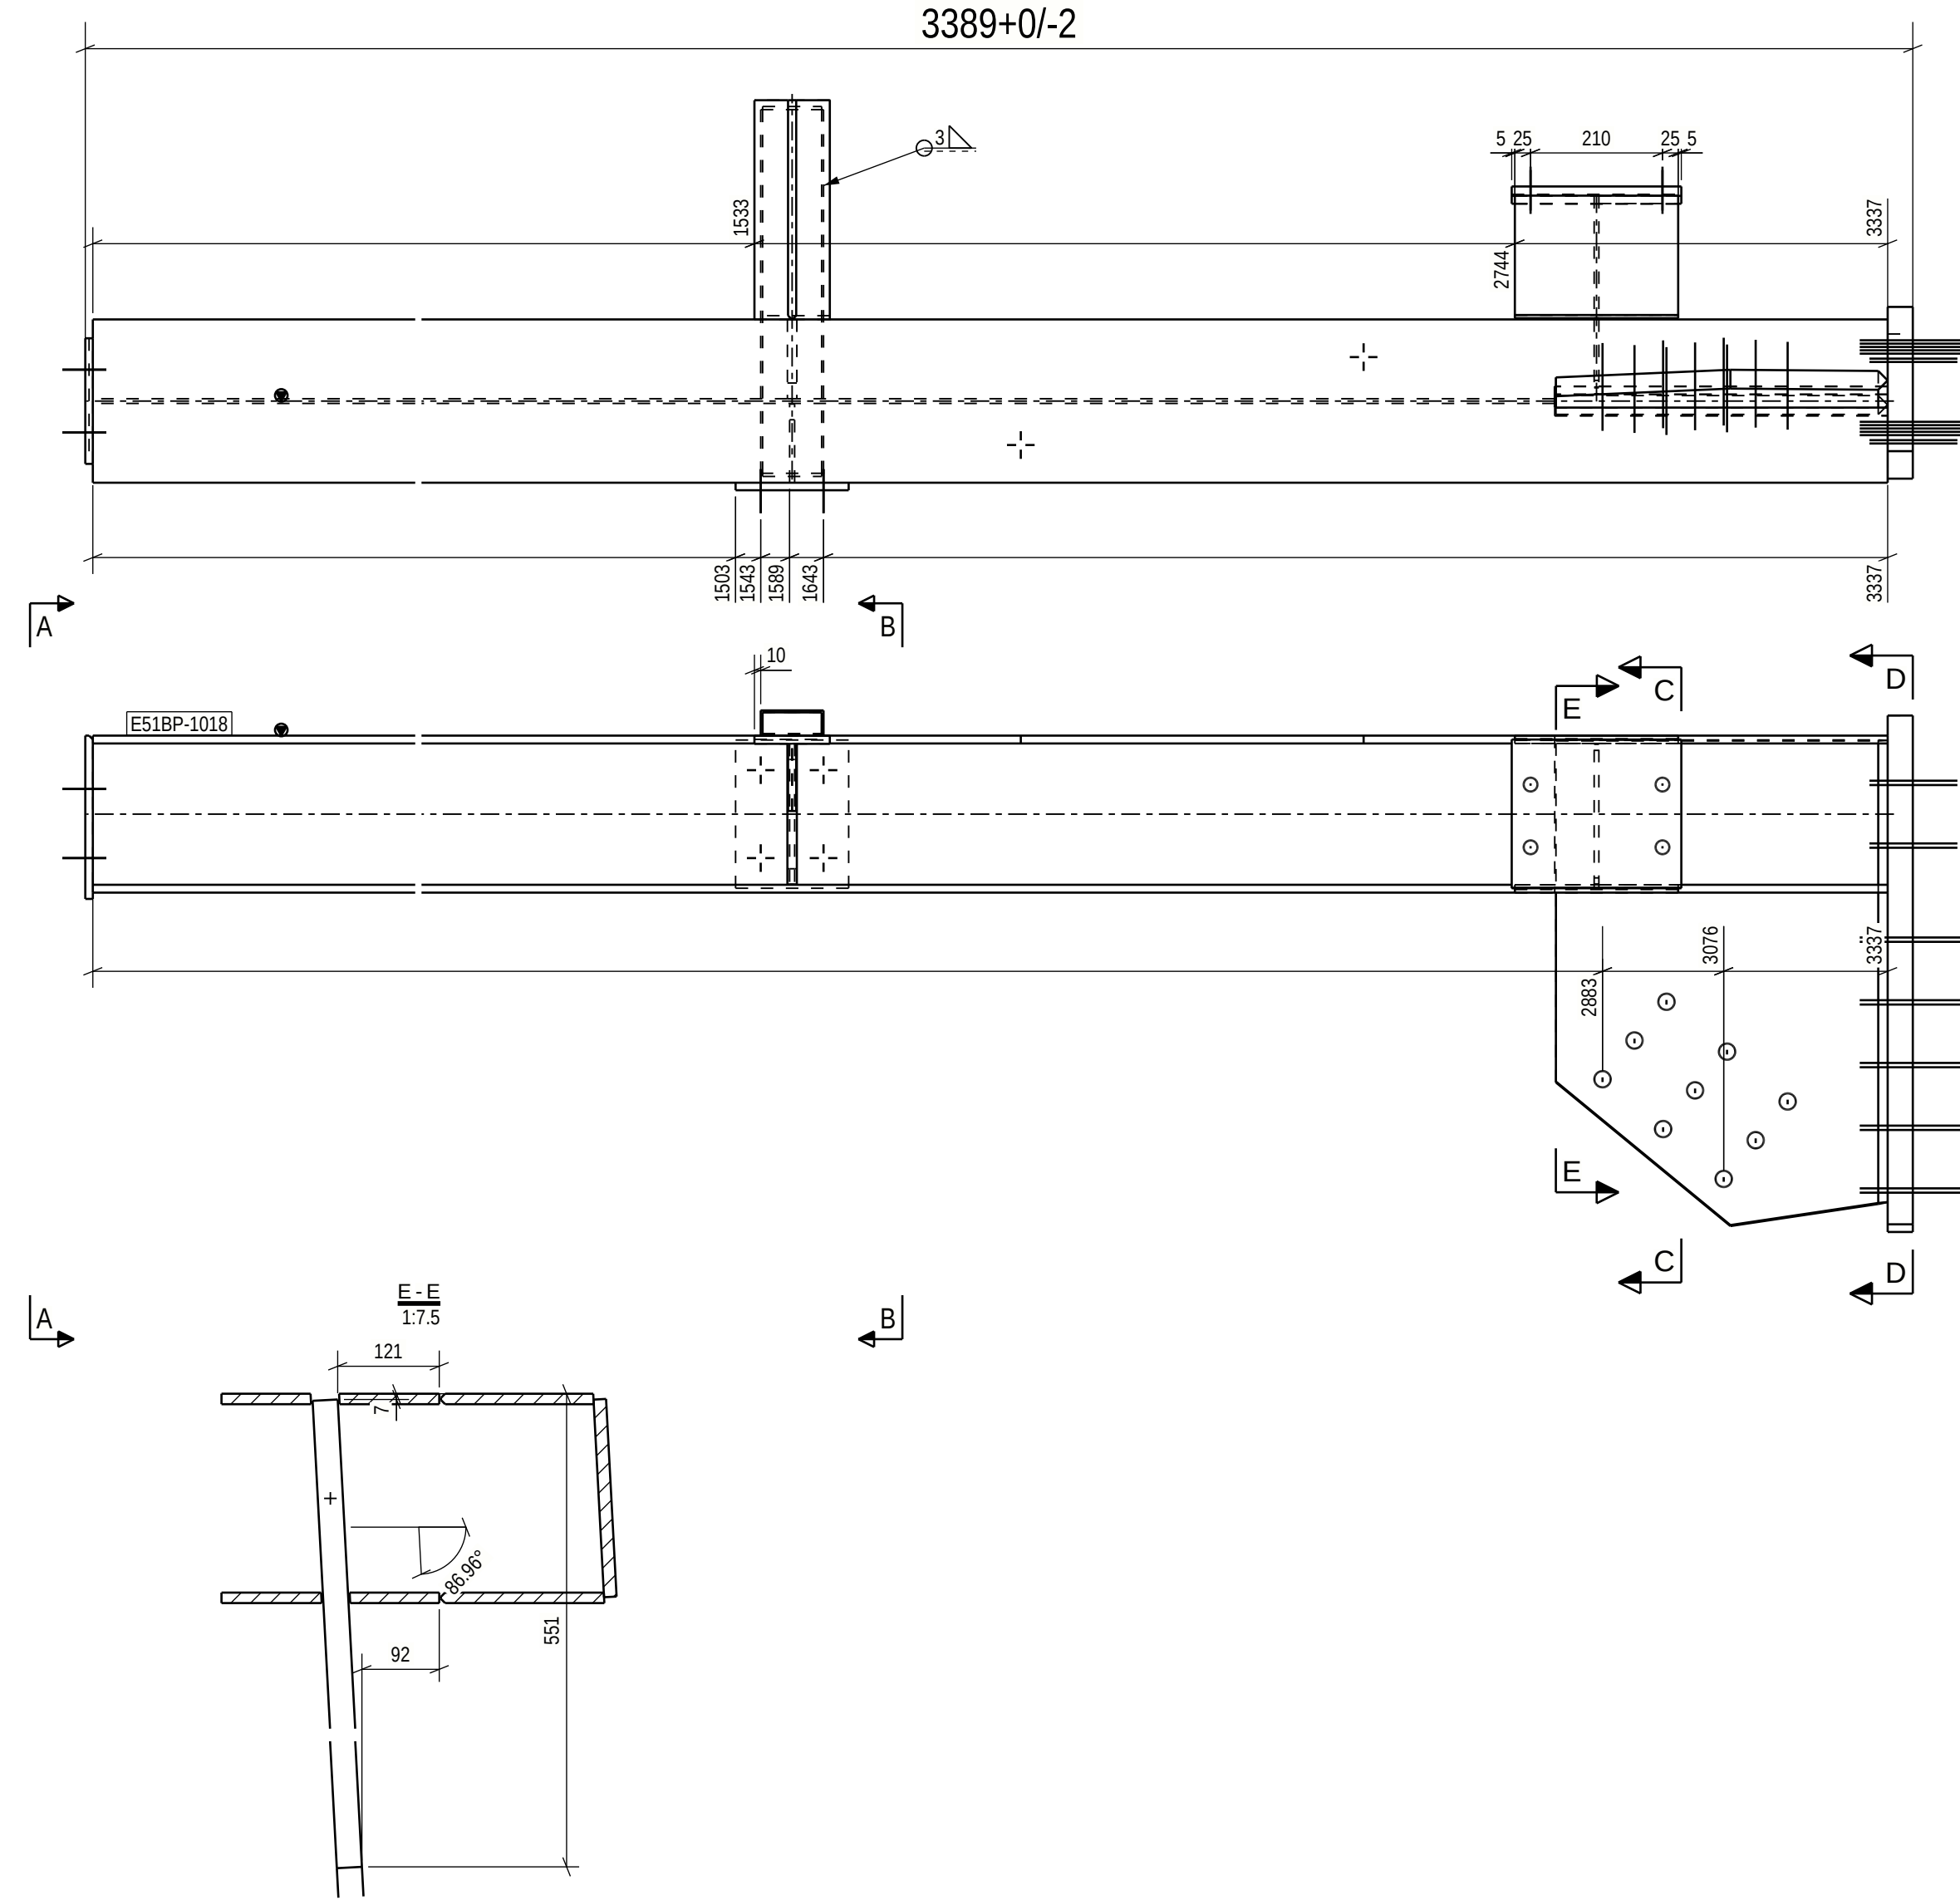

PART LIST FOR ASSEMBLY E51B-1218, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1003	PL12X180	S355J2+N	236	0.09	4.0	1
E51BL-1004	PL8X125	S355J2+N	224	0.06	1.7	1
E51BL-1055	PL12X200	S355J2+N	260	0.11	4.9	1
E51BL-1121	PL15X126	S355J2+N	224	0.07	3.3	1
E51BL-1138	PL40X230	S355J2+N	824	0.46	59.0	1
E51BL-1147	PL30X528	S355J2+N	774	0.80	86.3	1
E51BL-1160	PL5X37	S355J2+N	94	0.02	0.1	2
E51BL-1168	PL15X270	S355J2+N	236	0.14	7.5	1
E51BP-1018	HEA260	S355J2	3337	4.95	227.4	1
E51BP-1180	CFRHS100X40X3	S355J2H	579	0.16	3.5	1
E51BP-1181	T120	S235JR	349	0.17	8.1	1
E51BP-1182	HEA260	S355J2	315	0.47	21.5	1
TOTAL:				7.50	427.6	


Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005	Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg.	
Surface preparation grade ISO8501-3, grade P2	Weld inspection, requirements EN 1090-2, Table 24, U>0.5	
Surface treatment ISO12944-5	Extent of NDT, fillet welds MT-EN1290, 20% of welds	
Additional requirements on surface treatment C3.07, EPPUR 240/2	Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Shade RAL 7024 (Graphite Gray)	Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds	
Welding of built up steel section Appendix 1 / Project spec.	Requirements on holing EN1090-2 Section 6.6.3	
Welds, if not specified otherwise EN 9692-1, EN 9692-2	Weld class C, EN ISO 5817	Additional material inspection Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1





SWECO RAKENNTEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi



DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1218

DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Kivumaaanaho	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51B-1218		

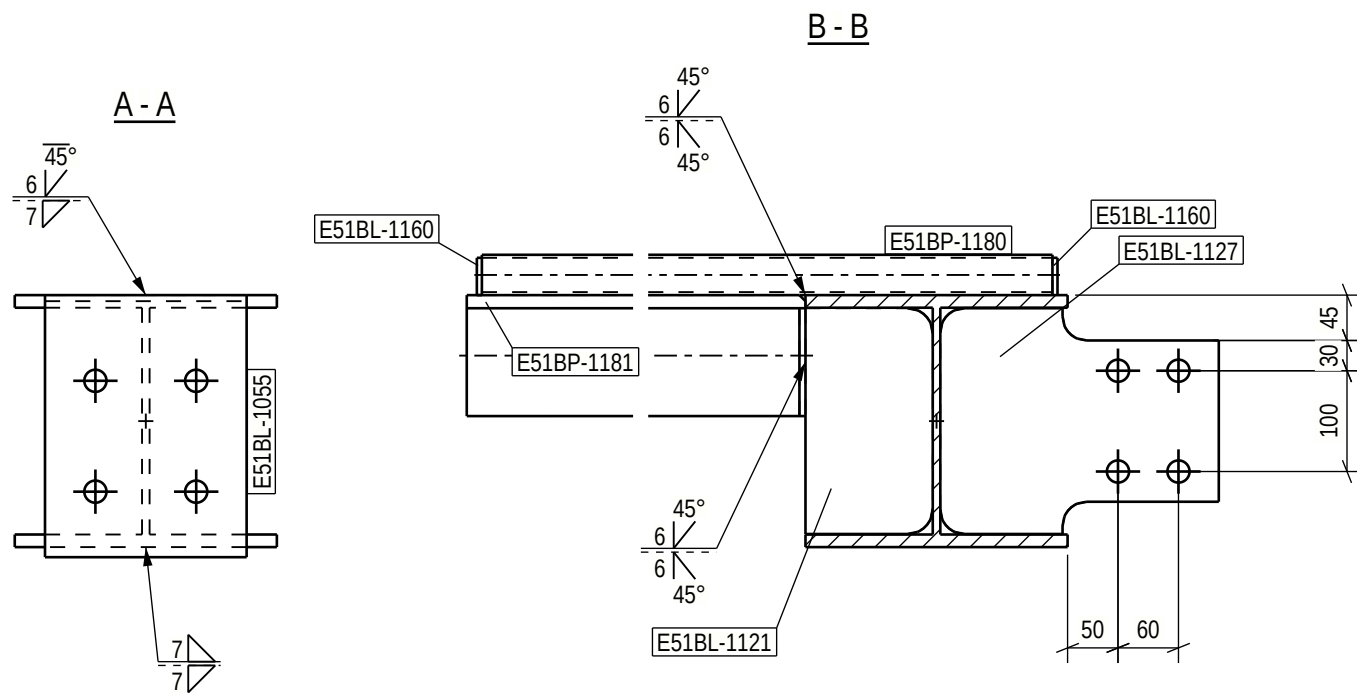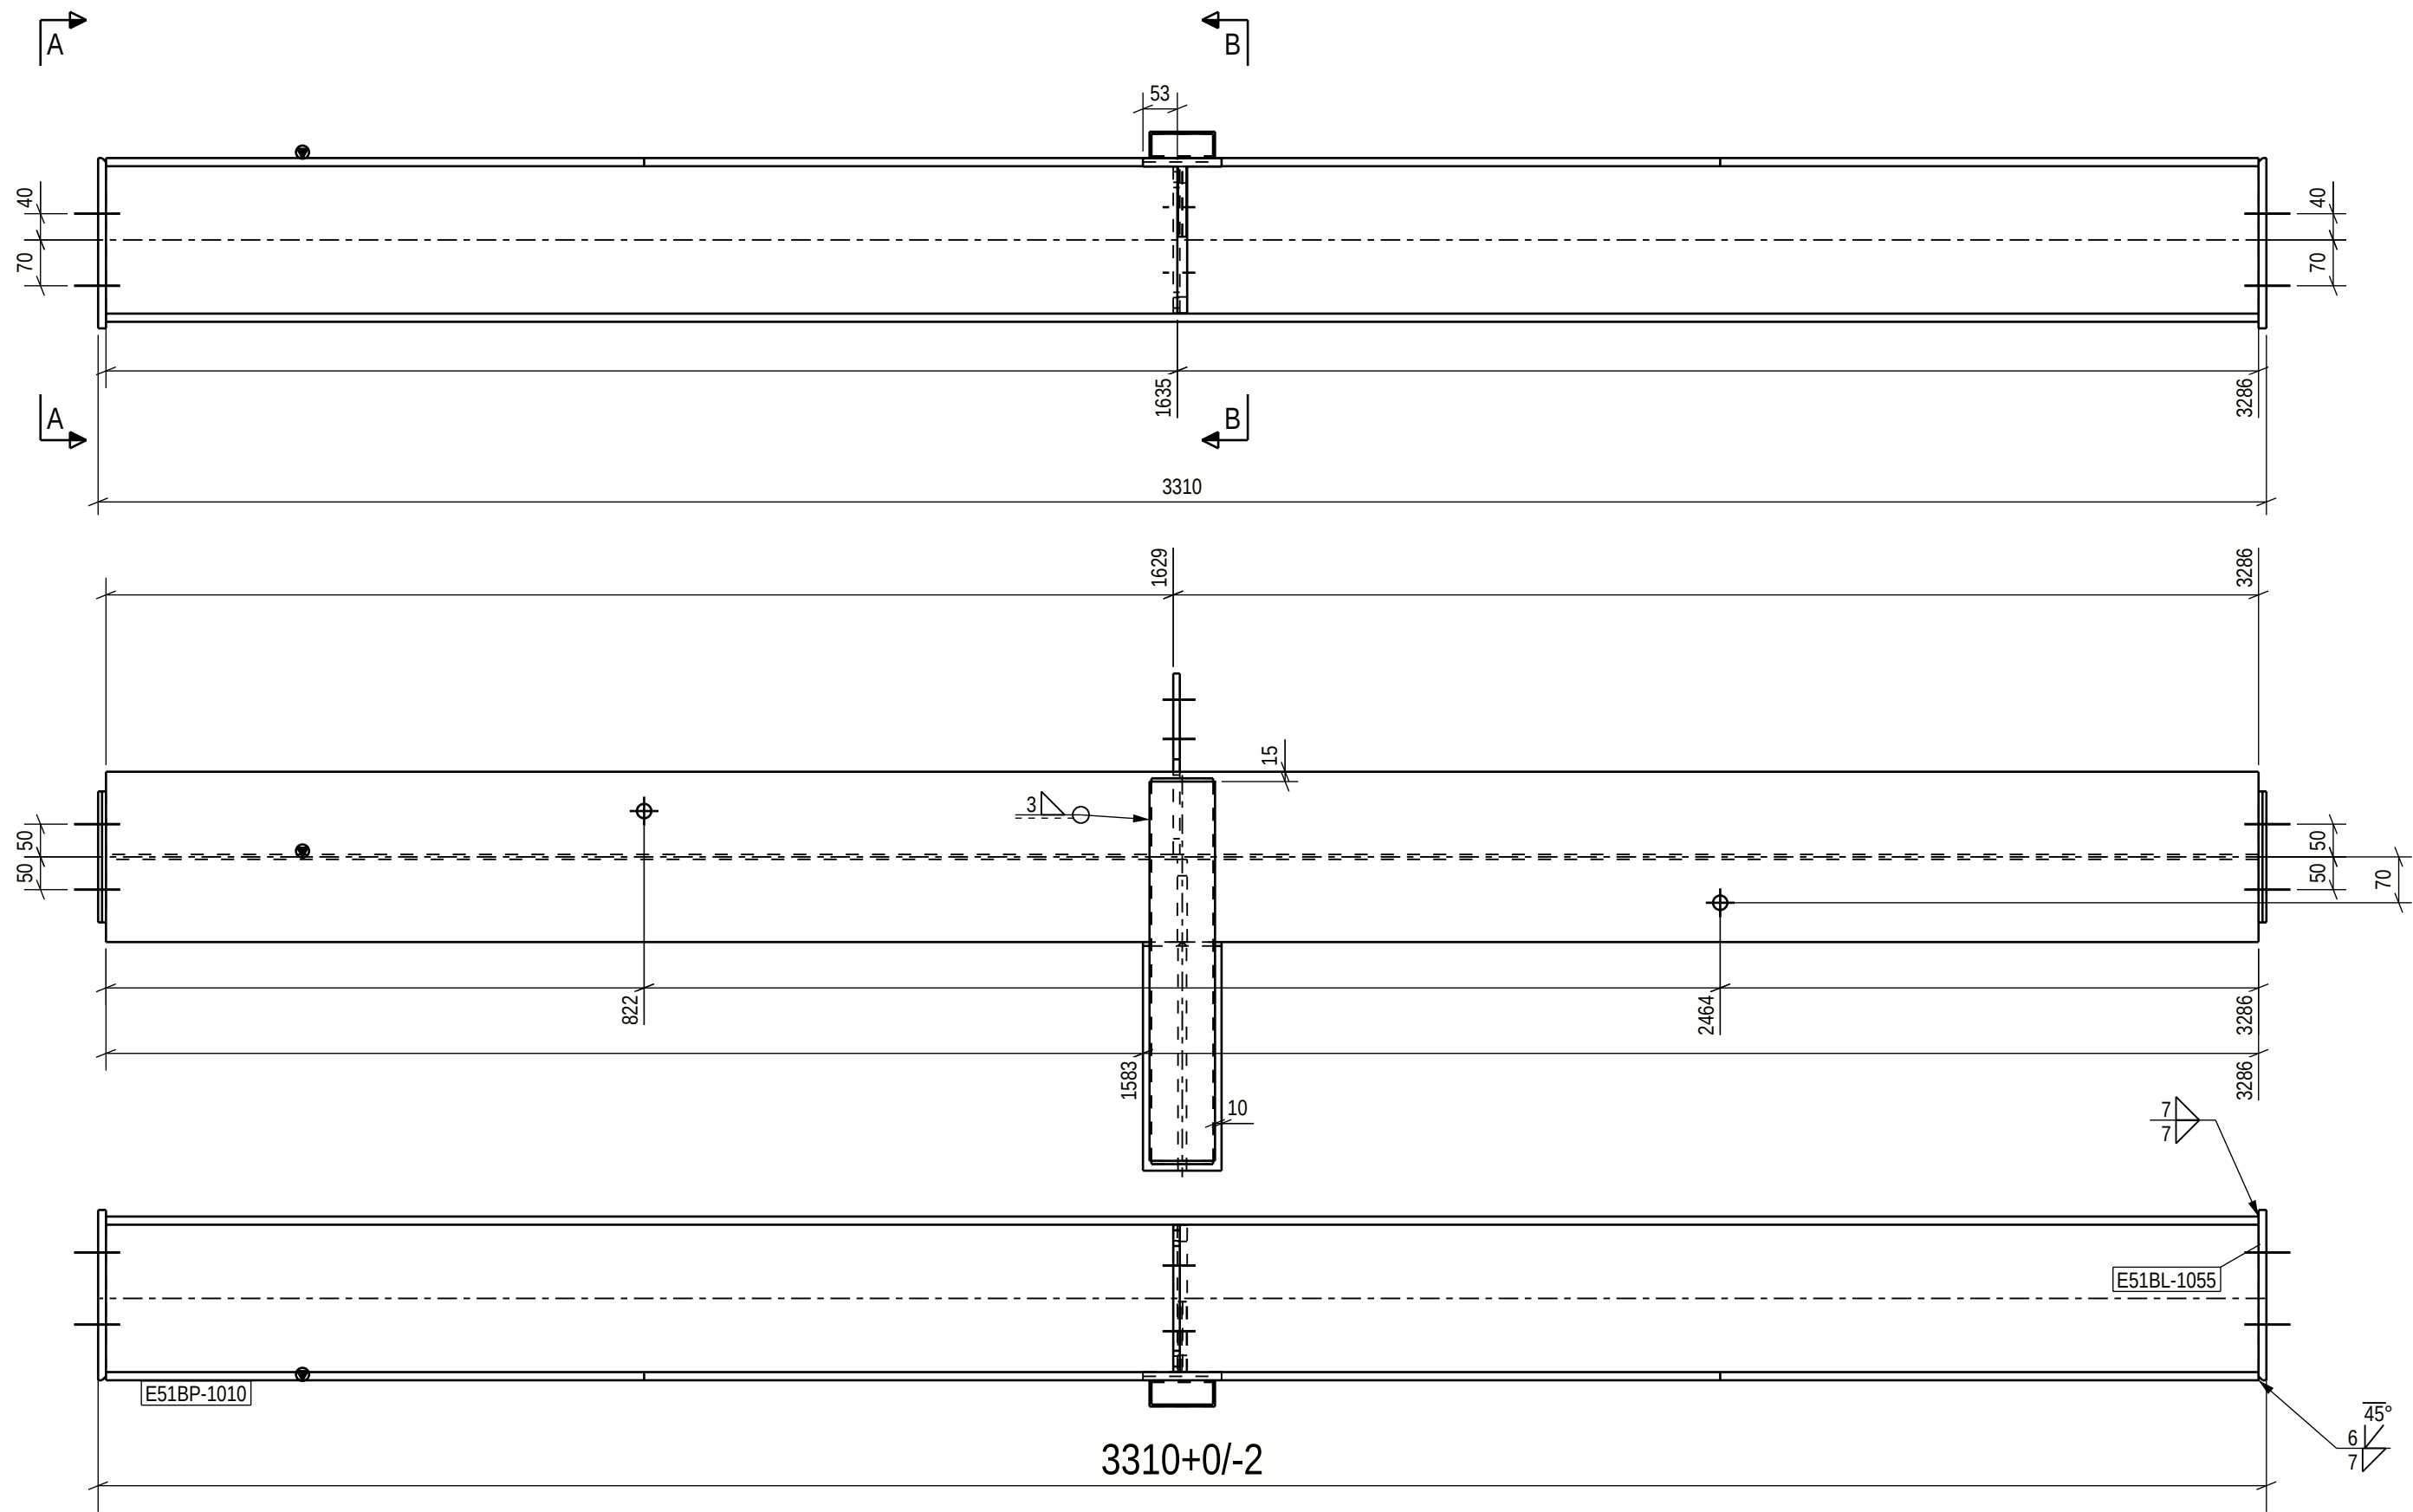


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PART LIST FOR ASSEMBLY E51B-1219, MANUFACTURING AMOUNT 4 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51BL-1055	PL12X200	S355J2+N	260	0.23	4.9	2
E51BL-1121	PL15X126	S355J2+N	224	0.07	3.3	1
E51BL-1127	PL10X276	S355J2+N	224	0.11	4.1	1
E51BL-1160	PL5X37	S355J2+N	94	0.02	0.1	2
E51BP-1010	HEA260	S355J2	3286	4.88	224.0	1
E51BP-1180	CFRHS100X40X3	S355J2H	579	0.16	3.5	1
E51BP-1181	T120	S235JR	349	0.17	8.1	1
TOTAL:				5.63	253.0	

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005		Fabrication tolerances EN 1090-2, Appendix B
Surface preparation grade ISO8501-3, grade P2		Special fabrication tolerances Project specification/ shown on drwg.
Surface treatment ISO12944-5		Weld inspection, requirements EN 1090-2, Table 24, U>0.5
Additional requirements on surface treatment C3.07, EPPUR 240/2		Extent of NDT, fillet welds MT-EN1290, 20% of welds
Shade RAL 7024 (Graphite Gray)		Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds
Welding of built up steel section Appendix 1 / Project spec.		Requirements on holing EN1090-2 Section 6.6.3
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Weld class C, EN ISO 5817
		Additional material inspection Shown on drwg.

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1219

SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi




DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Koivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51B-1219		

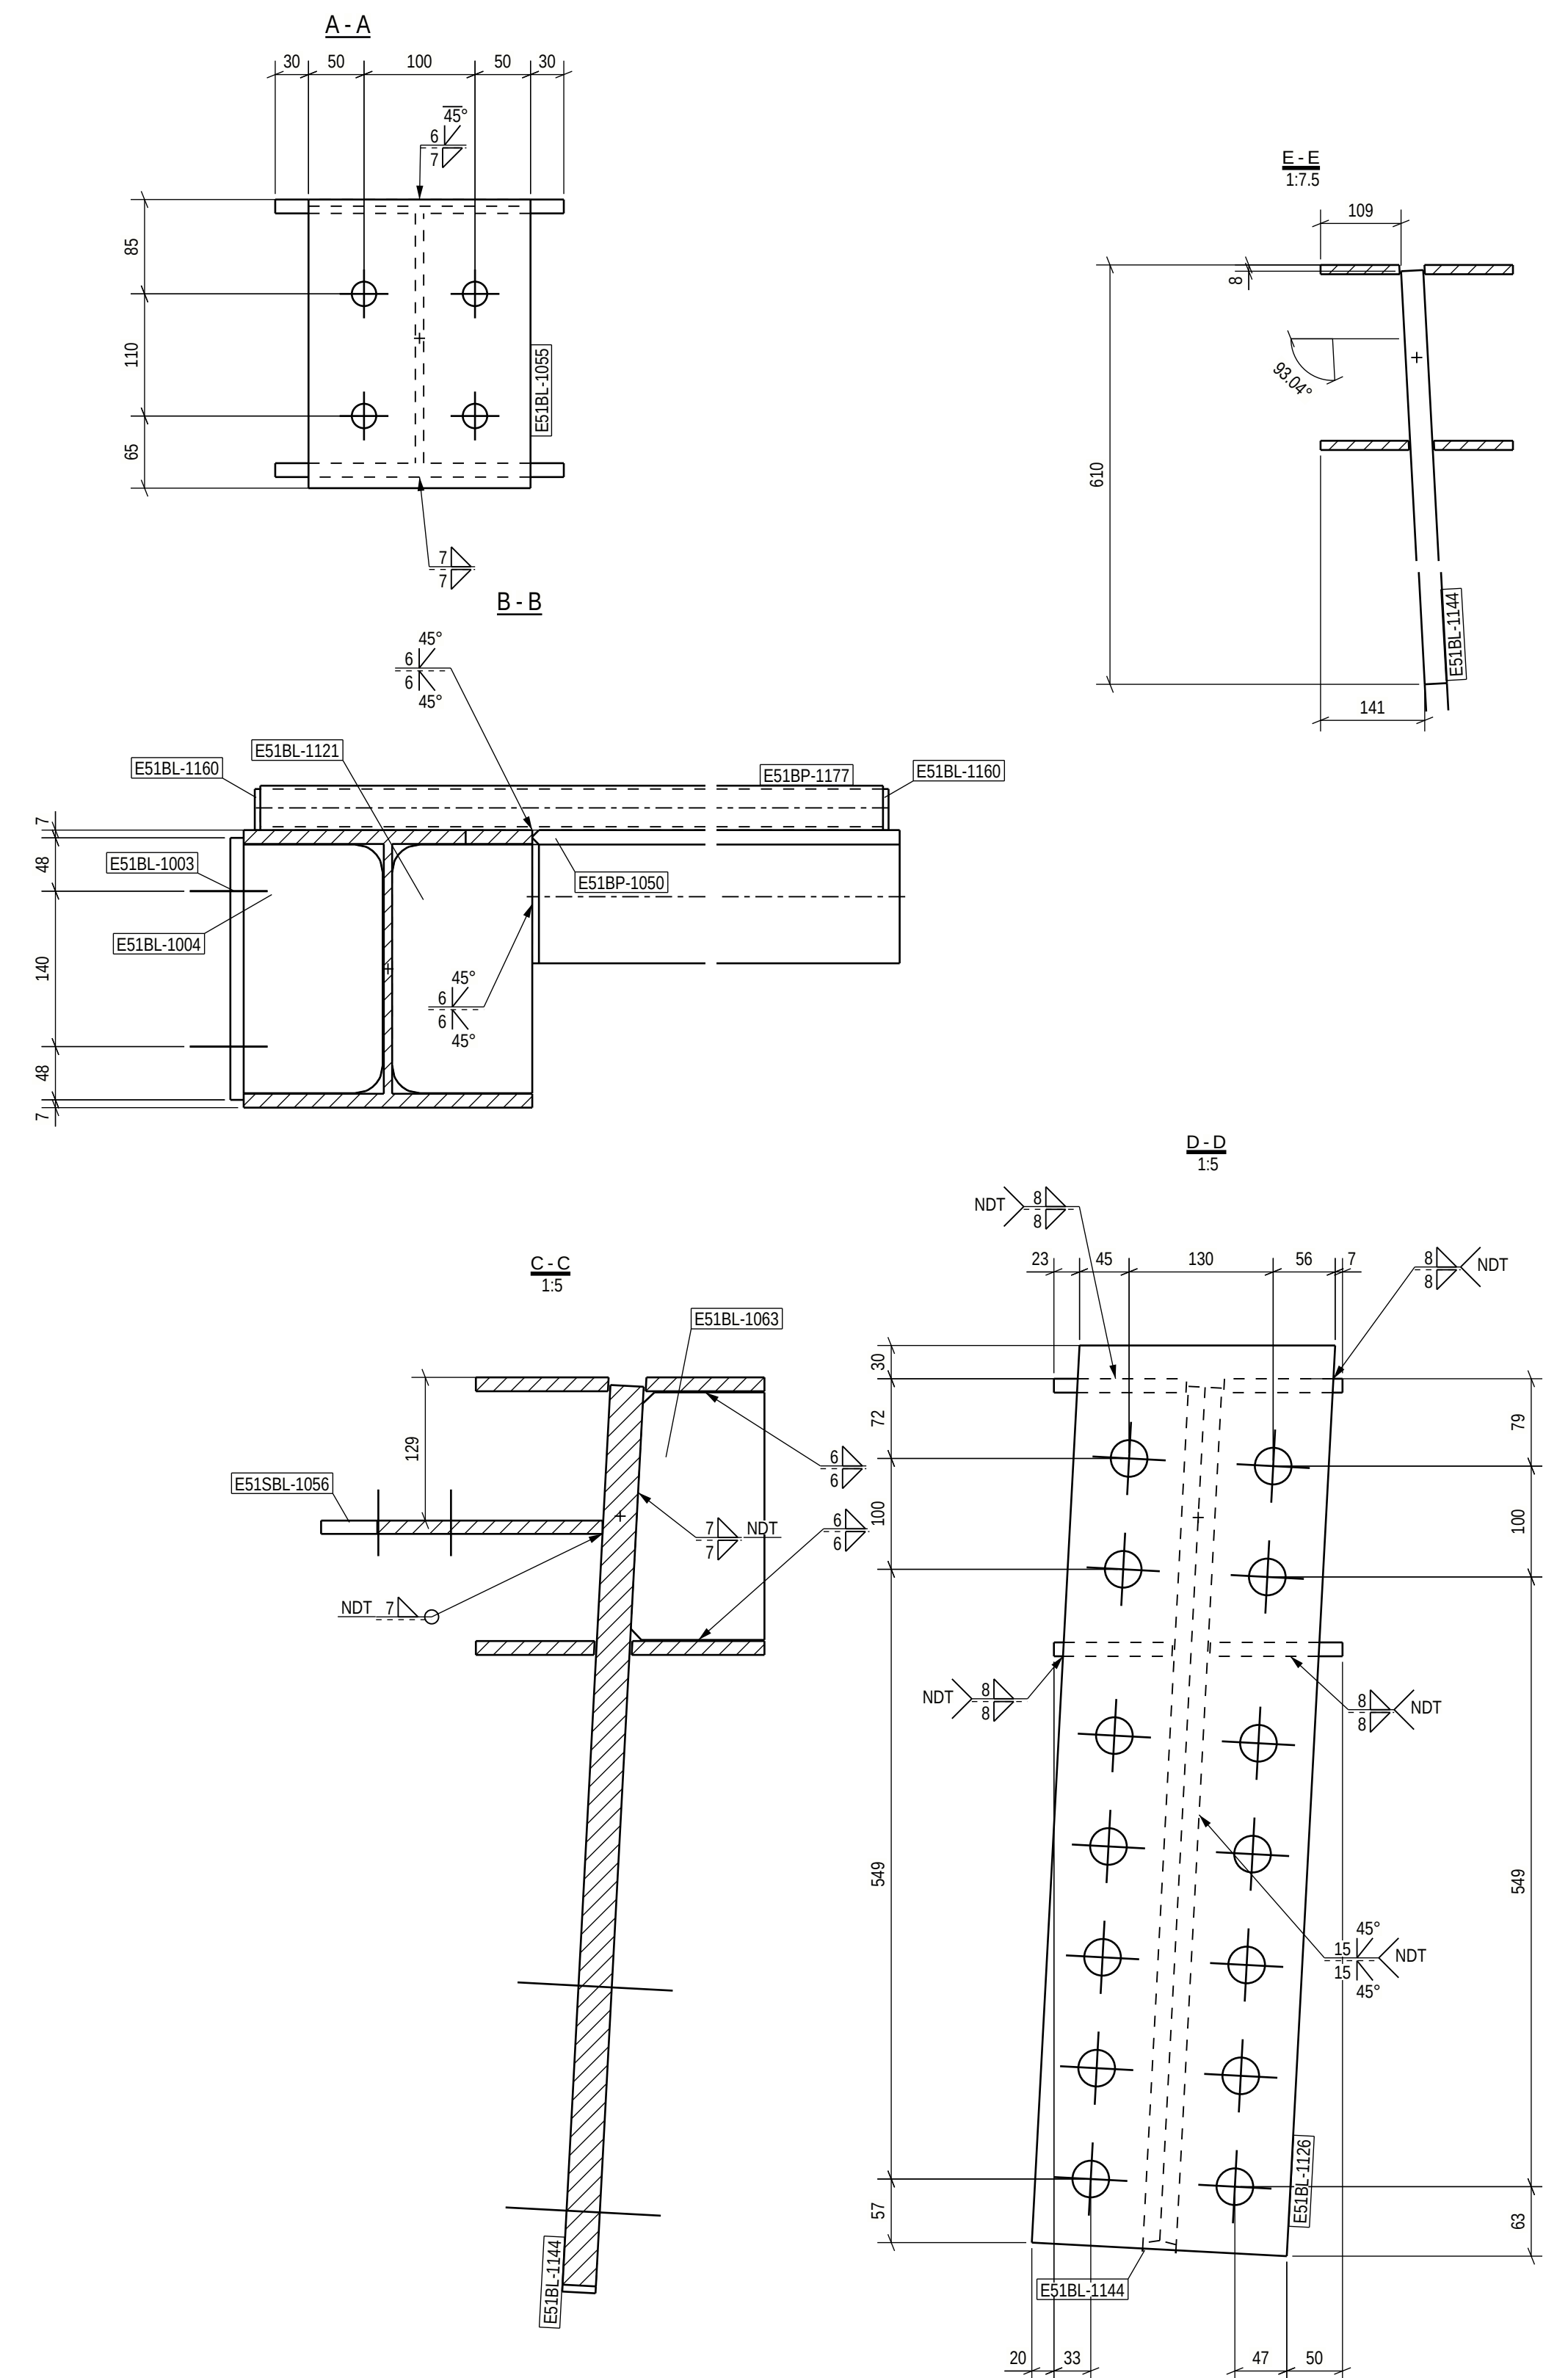

Technical fabrication requirements:		Execution class
		EXC2
Requirements for fabrication, overview EN1090-2, table A3: EXC2 Execution specification document nr 250109443-IC250-0600-0660-000005 Surface appearance ISO8501-3, grade PE2 Surface treatment EN12244-5 Additional requirements on surface treatment EN 607, EPPUR 2402	Fabrication tolerances EN 1090-2, Appendix B Special specification tolerances Project specification/ shown on drawing Weld requirements, requirements EN1090-2, Table 24, U+0-5 Exempt of NDT, HiVoids EN12290, 20% of welds Exempt of NDT, as shown EN1090-2, 20% of welds Exempt of NDT, as shown EN1090-2, 100% of welds Requirements on holding EN1090-2 Section 6.6.3	
RAL 7042 (Graphite Gray) Welding of joint (steel section) Appendix 1 / Project spec. EN 9602-1, EN 9602-2	Weld class EN ISO 5817 Shown on inspection	

SWECO 
Sustainable engineering and design

SWECO RAKENNETEKNIIKKA OY ILMALANPORTTI 2 00240 HELSINKI PUH. +358 207 393 000 www.sweco.fi	DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
	16.06.2026			STR
	DRAWN	DESIGNER	APPROVED	CHECKED
	Alexey Serous	Alexey Serous	Pertti Kuivamaanaho	Jere Kalliosalmi
	PROJECT NUMBER	DWG. NO.	REVISION	
	25019443	E51B-1220		

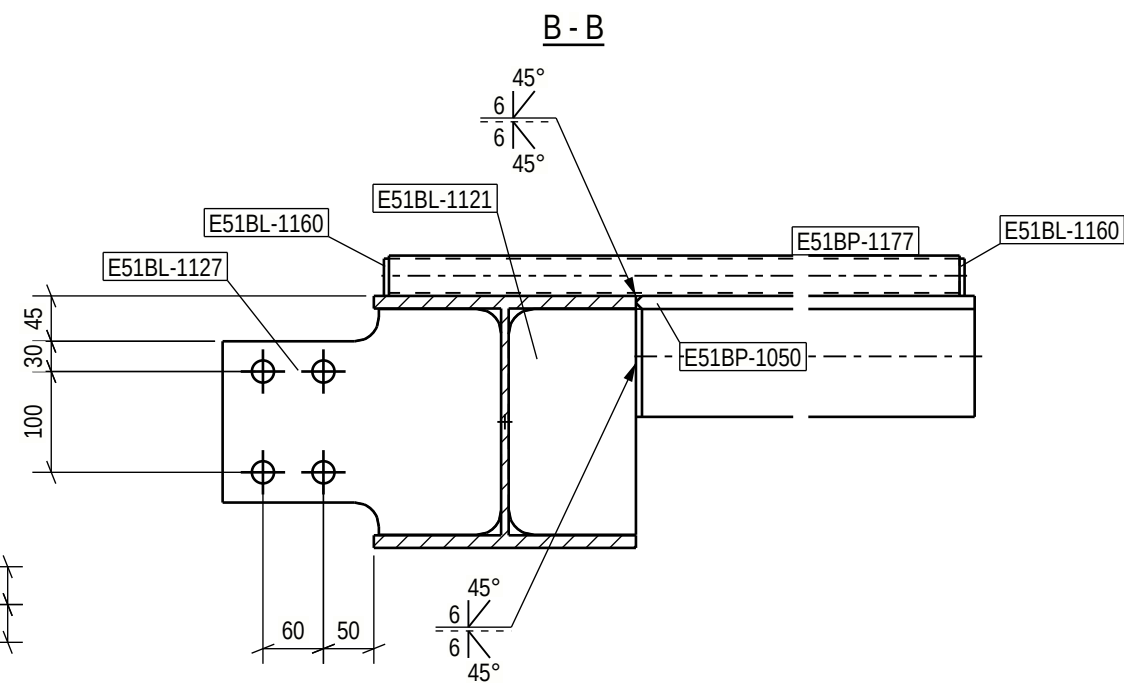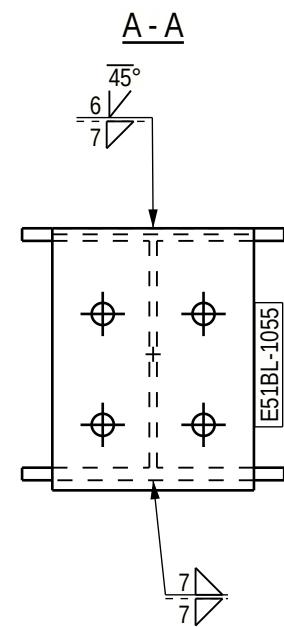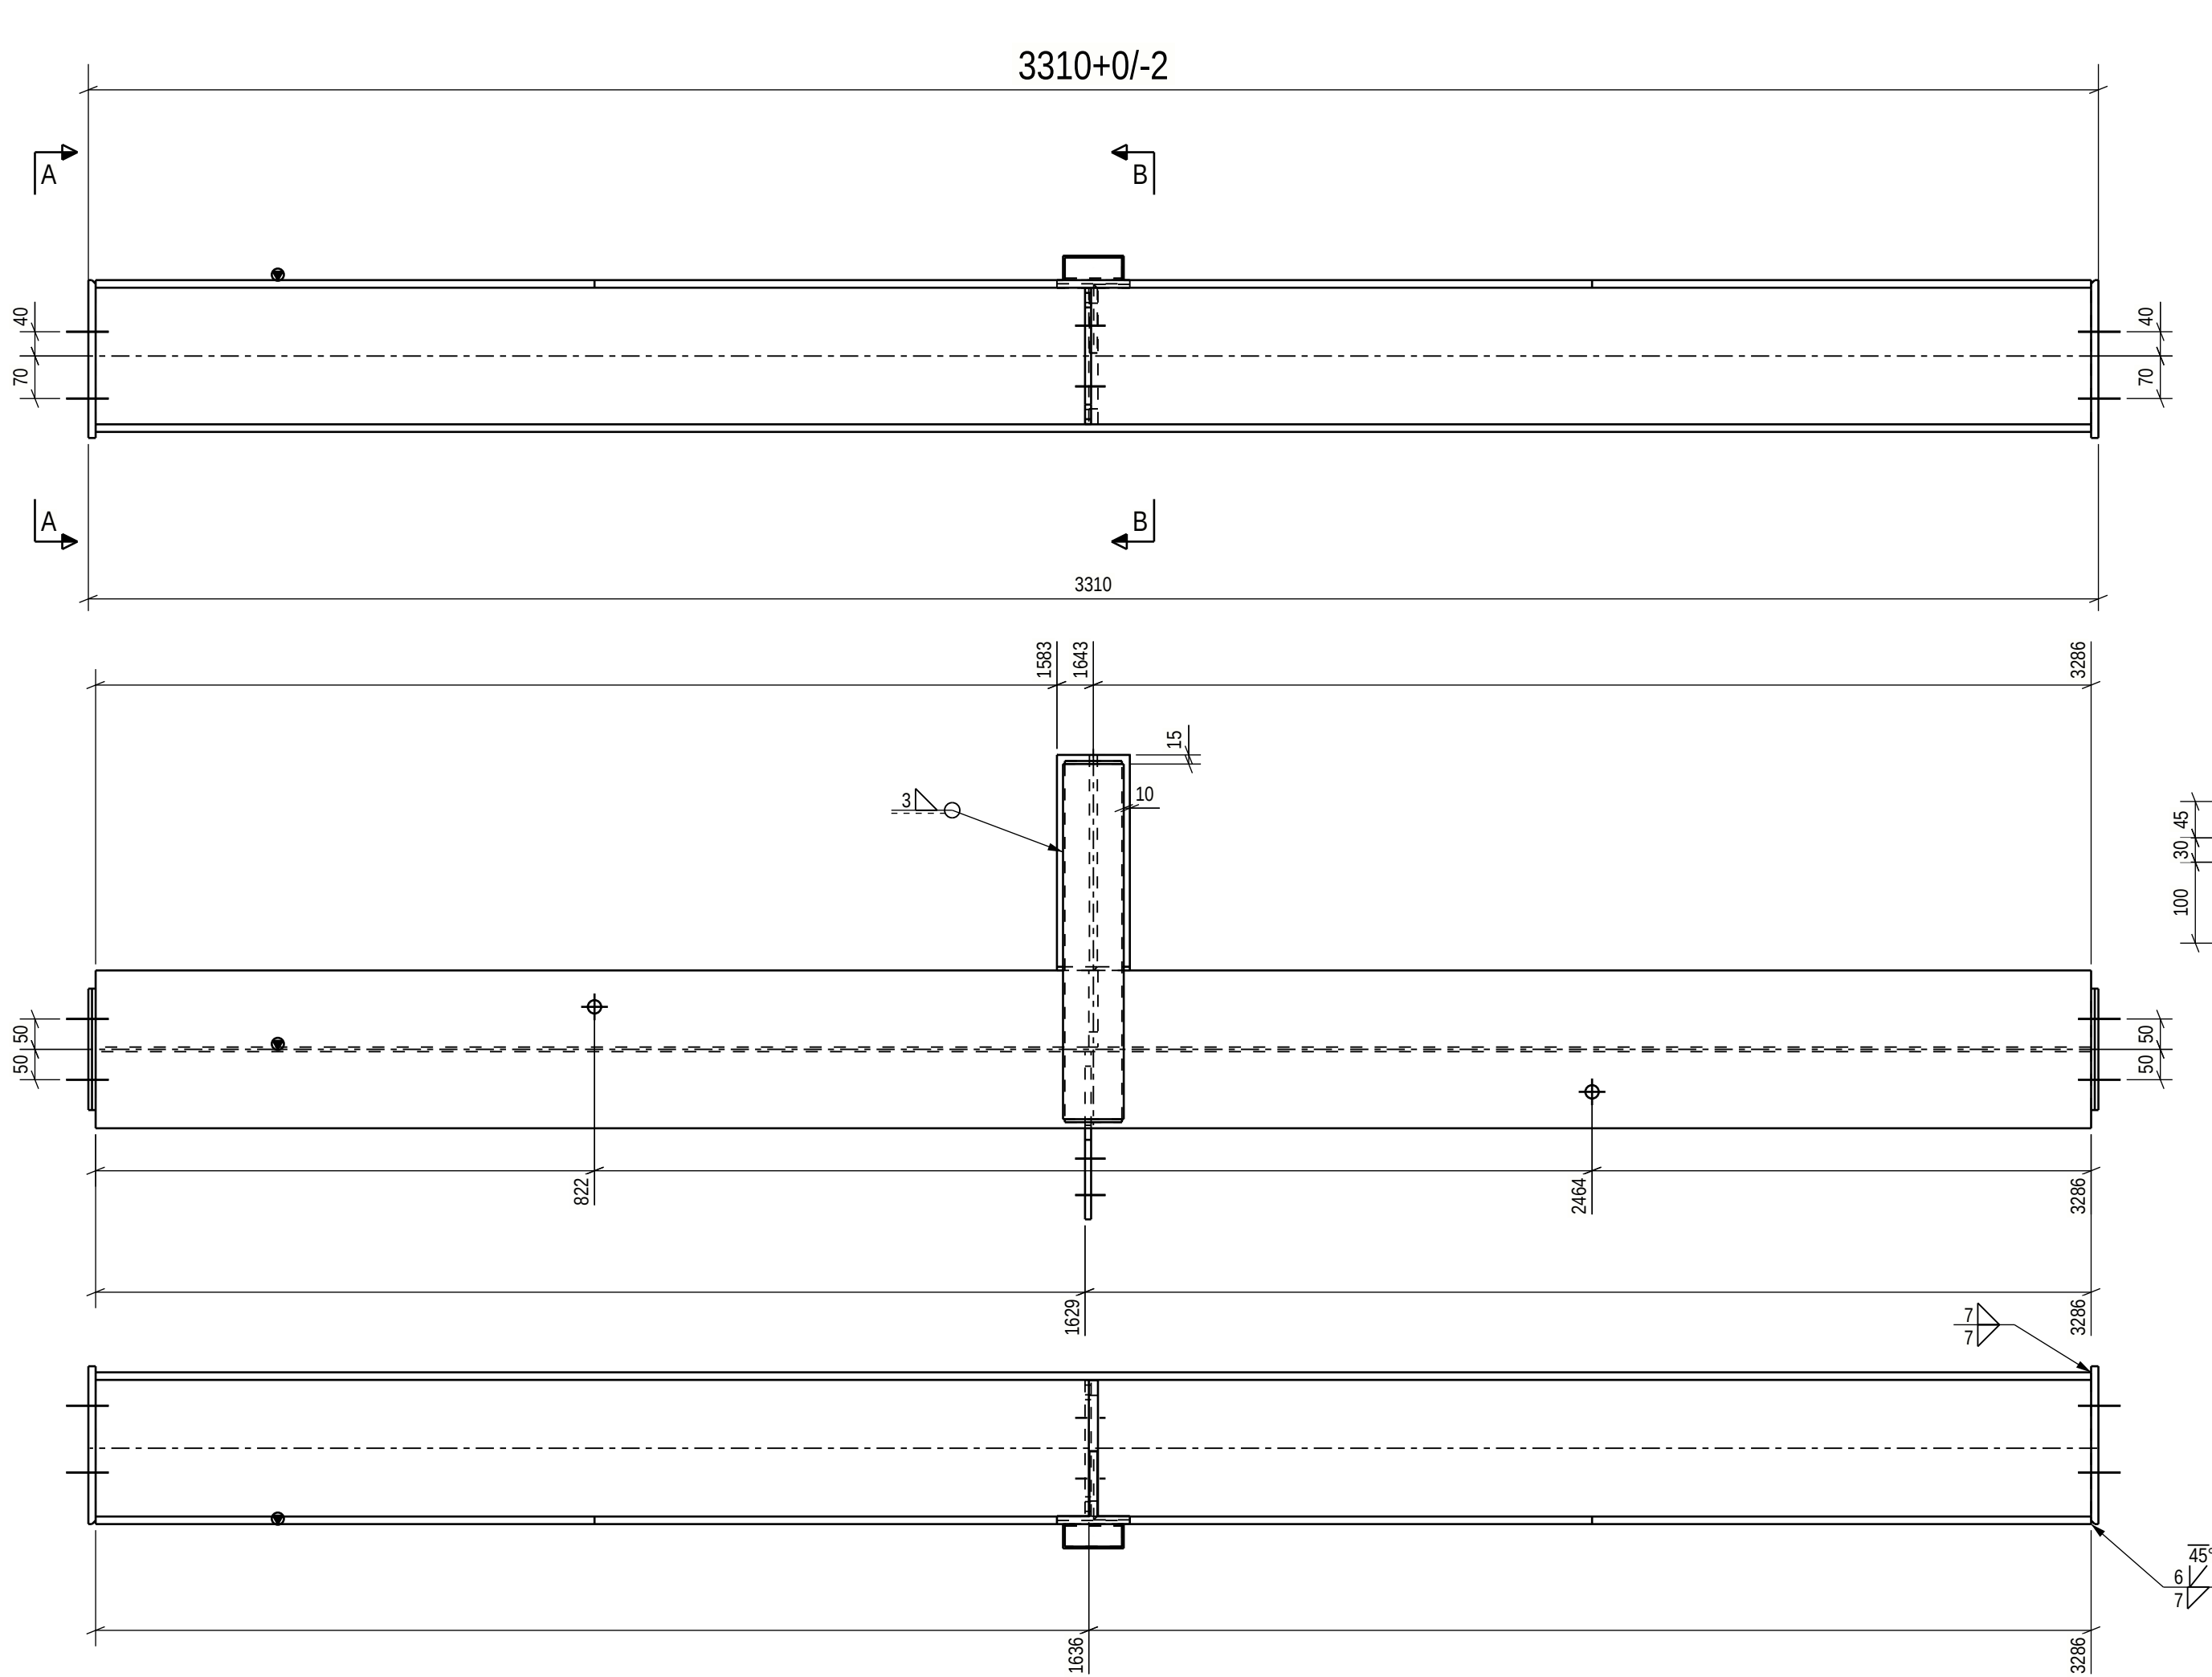


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PART LIST FOR ASSEMBLY E51B-1221, MANUFACTURING AMOUNT 4 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51BL-1055	PL12X200	S355J2+N	260	0.23	4.9	2
E51BL-1121	PL15X126	S355J2+N	224	0.07	3.3	1
E51BL-1127	PL10X276	S355J2+N	224	0.11	4.1	1
E51BL-1160	PL5X37	S355J2+N	94	0.02	0.1	2
E51BP-1010	HEA260	S355J2	3286	4.88	224.0	1
E51BP-1050	T120	S235JR	355	0.17	8.2	1
E51BP-1177	CFRHS100X40X3	S355J2H	585	0.16	3.6	1
TOTAL:				5.63	253.2	

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005		
Surface preparation grade ISO8501-3, grade P2		
Surface treatment ISO12944-5		
Additional requirements on surface treatment C3.07, EPPUR 240/2		
Shade RAL 7024 (Graphite Gray)		
Welding of built up steel section Appendix 1 / Project spec.		
Welds, if not specified otherwise EN 9692-1, EN 9692-2		
Fabrication tolerances EN 1090-2, Appendix B		
Special fabrication tolerances Project specification/ shown on drwg.		
Weld inspection, requirements EN 1090-2, Table 24, U>0.5		
Extent of NDT, fillet welds MT-EN1290, 20% of welds		
Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds		
Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds		
Requirements on bolting EN1090-2 Section 6.6.3		
Weld class C, EN ISO 5817		
Additional material inspection Shown on drwg.		

Easpring New Materials Oy
FAIR Phase 1








DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51B-1221

SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Koivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51B-1221		

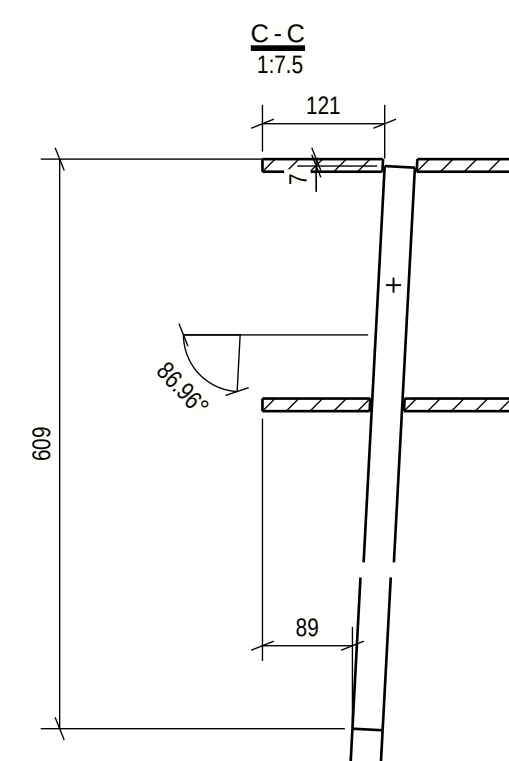25019443 Fair E500

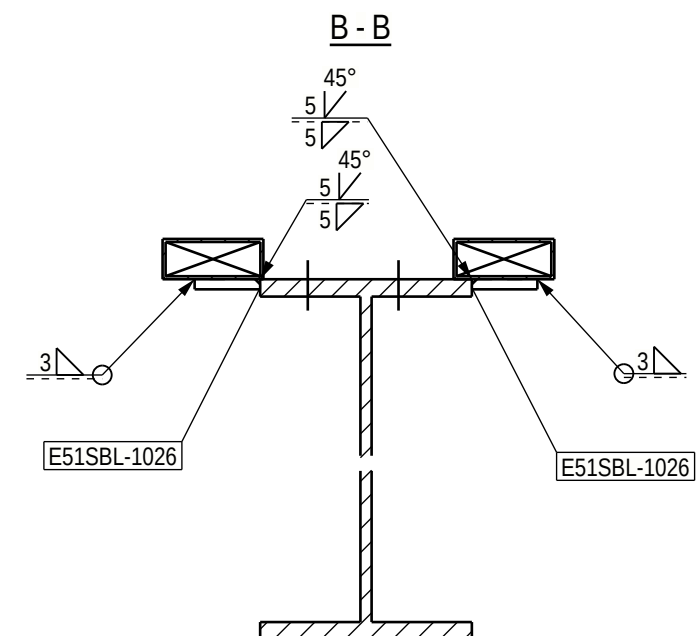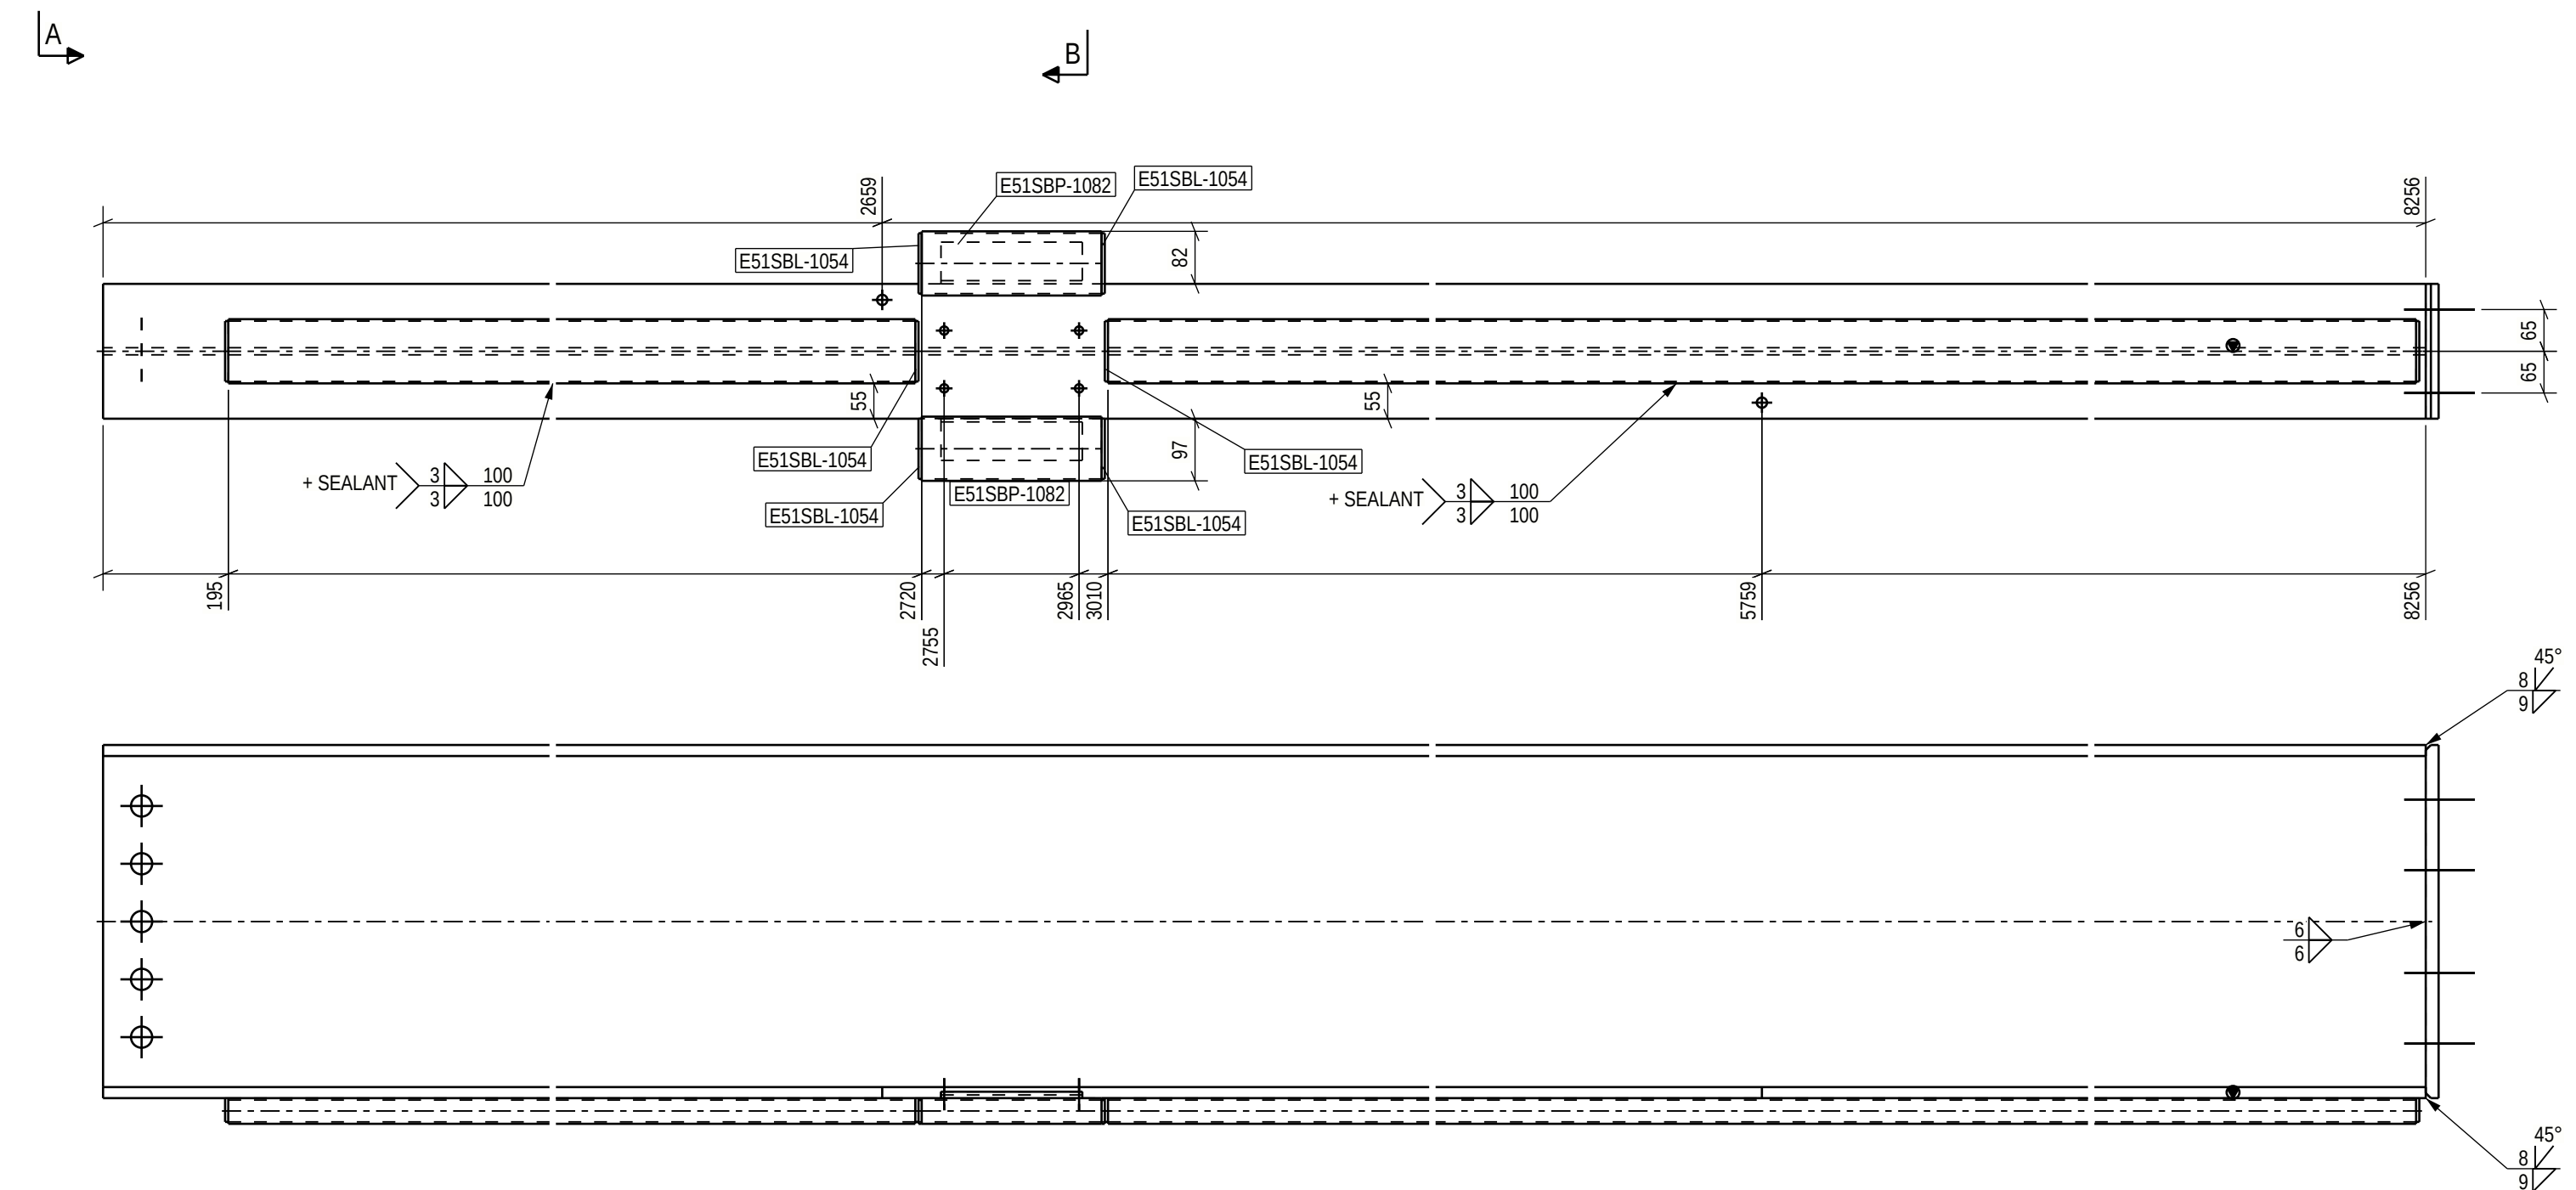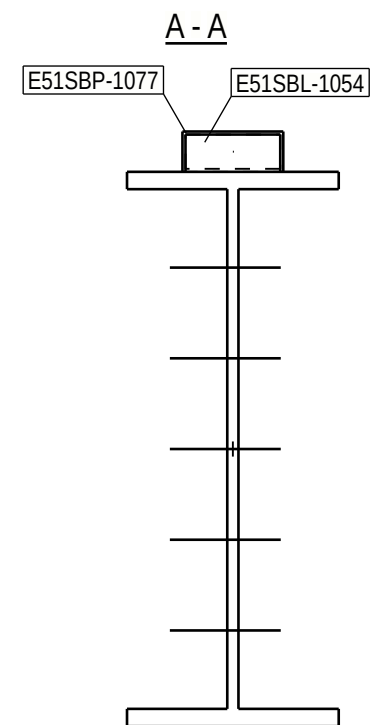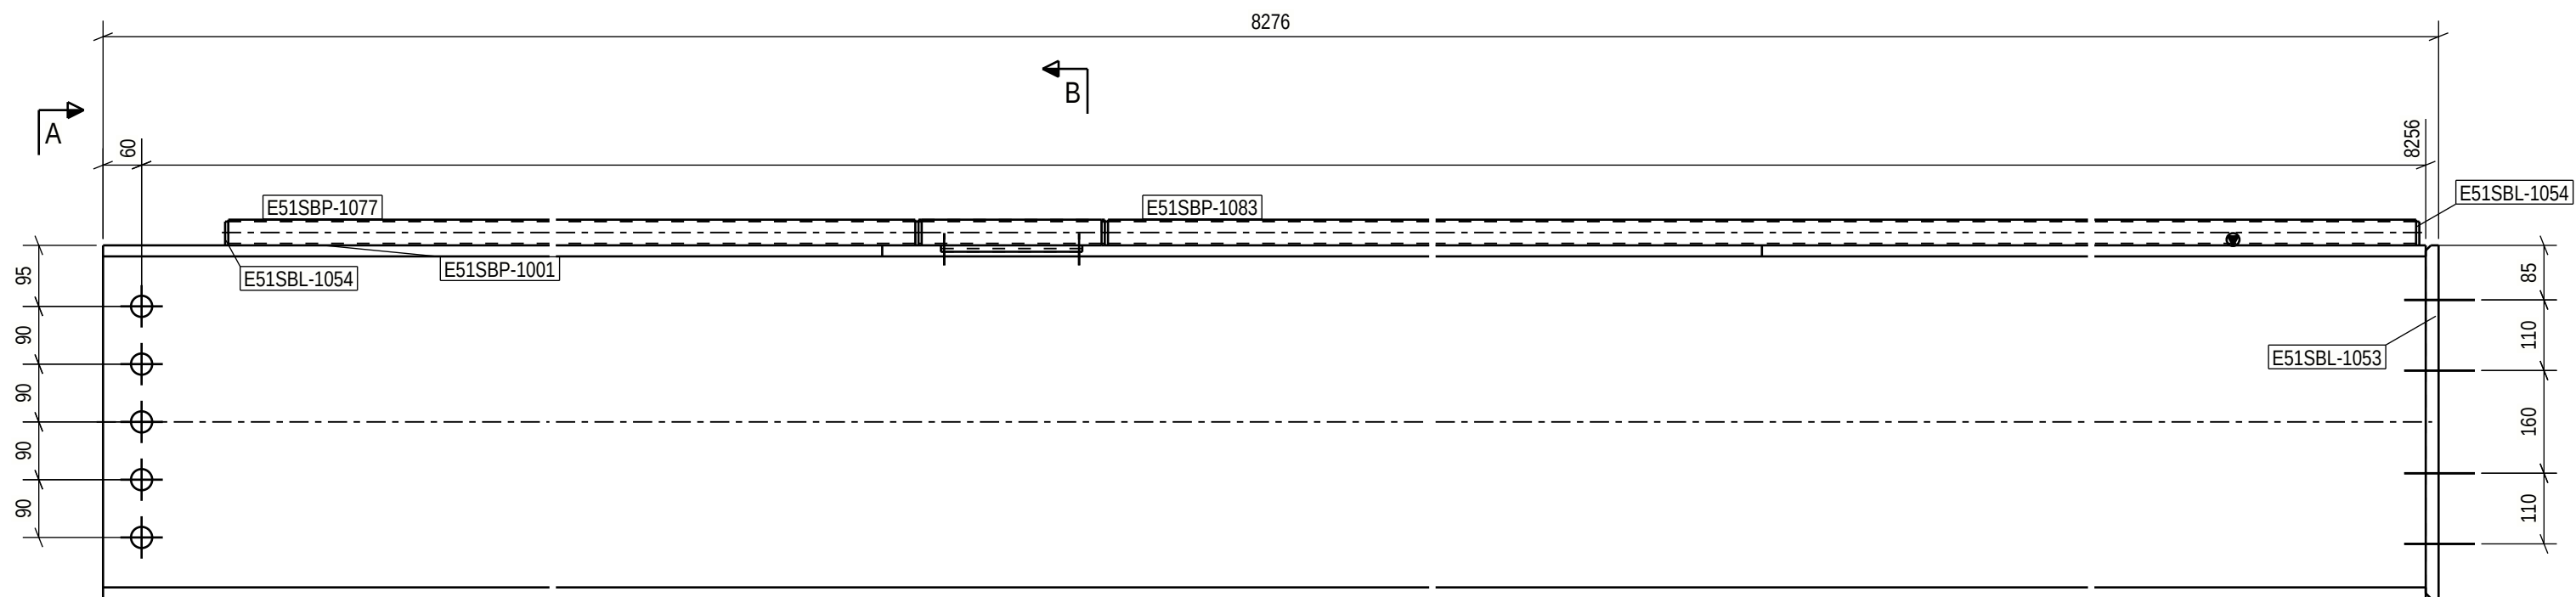


PART LIST FOR ASSEMBLY E51SB-1001, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51SBL-1026	PL10X65	S355J2+N	220	0.07	1.1	2
E51SBL-1053	PL20X210	S355J2+N	550	0.26	18.0	1
E51SBL-1054	PL5X37	S355J2+N	94	0.07	0.1	8
E51SBP-1001	IPE550	S355J2	8256	15.50	868.5	1
E51SBP-1077	CFRHS100X40X3	S355J2H	2515	0.68	15.4	1
E51SBP-1082	CFRHS100X40X3	S355J2H	280	0.15	1.7	2
E51SBP-1083	CFRHS100X40X3	S355J2H	5232	1.41	32.1	1
TOTAL:				18.13	940.7	

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005		
Surface preparation grade ISO8501-3, grade P2		
Surface treatment ISO12944-5		
Additional requirements on surface treatment C3.07, EPPUR 240/2		
Shade RAL 7024 (Graphite Gray)		
Welding of built up steel section Appendix 1 / Project spec.		
Welds, if not specified otherwise EN 9692-1, EN 9692-2		
Fabrication tolerances EN 1090-2, Appendix B		
Special fabrication tolerances Project specification/ shown on drwg.		
Weld inspection, requirements EN 1090-2, Table 24, U>0.5		
Extent of NDT, fillet welds MT-EN1290, 20% of welds		
Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds		
Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds		
Requirements on holing EN1090-2 Section 6.6.3		
Weld class C, EN ISO 5817		
Additional material inspection Shown on drwg.		

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51SB-1001



SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Kivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51SB-1001		



DRAWING CONTENT			
ASSEMBLY DRAWING			
Beam			
E51SB-1002			
DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER		DWG. NO.	REVISION
25019443		E51SB-1002	

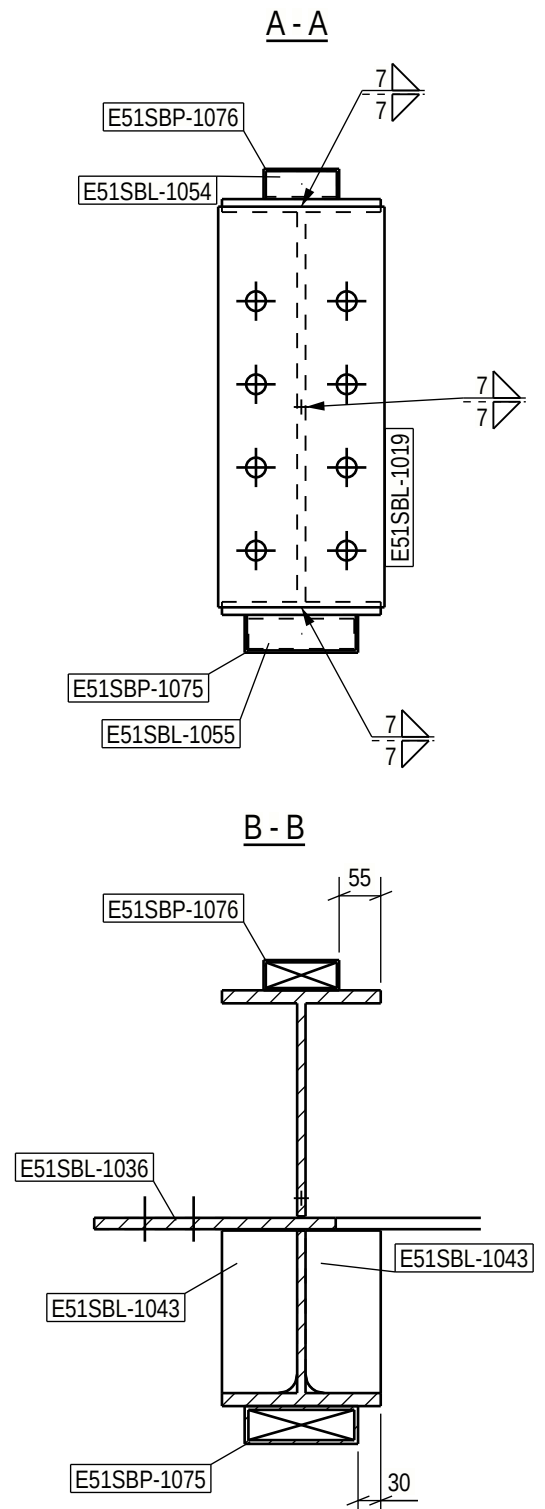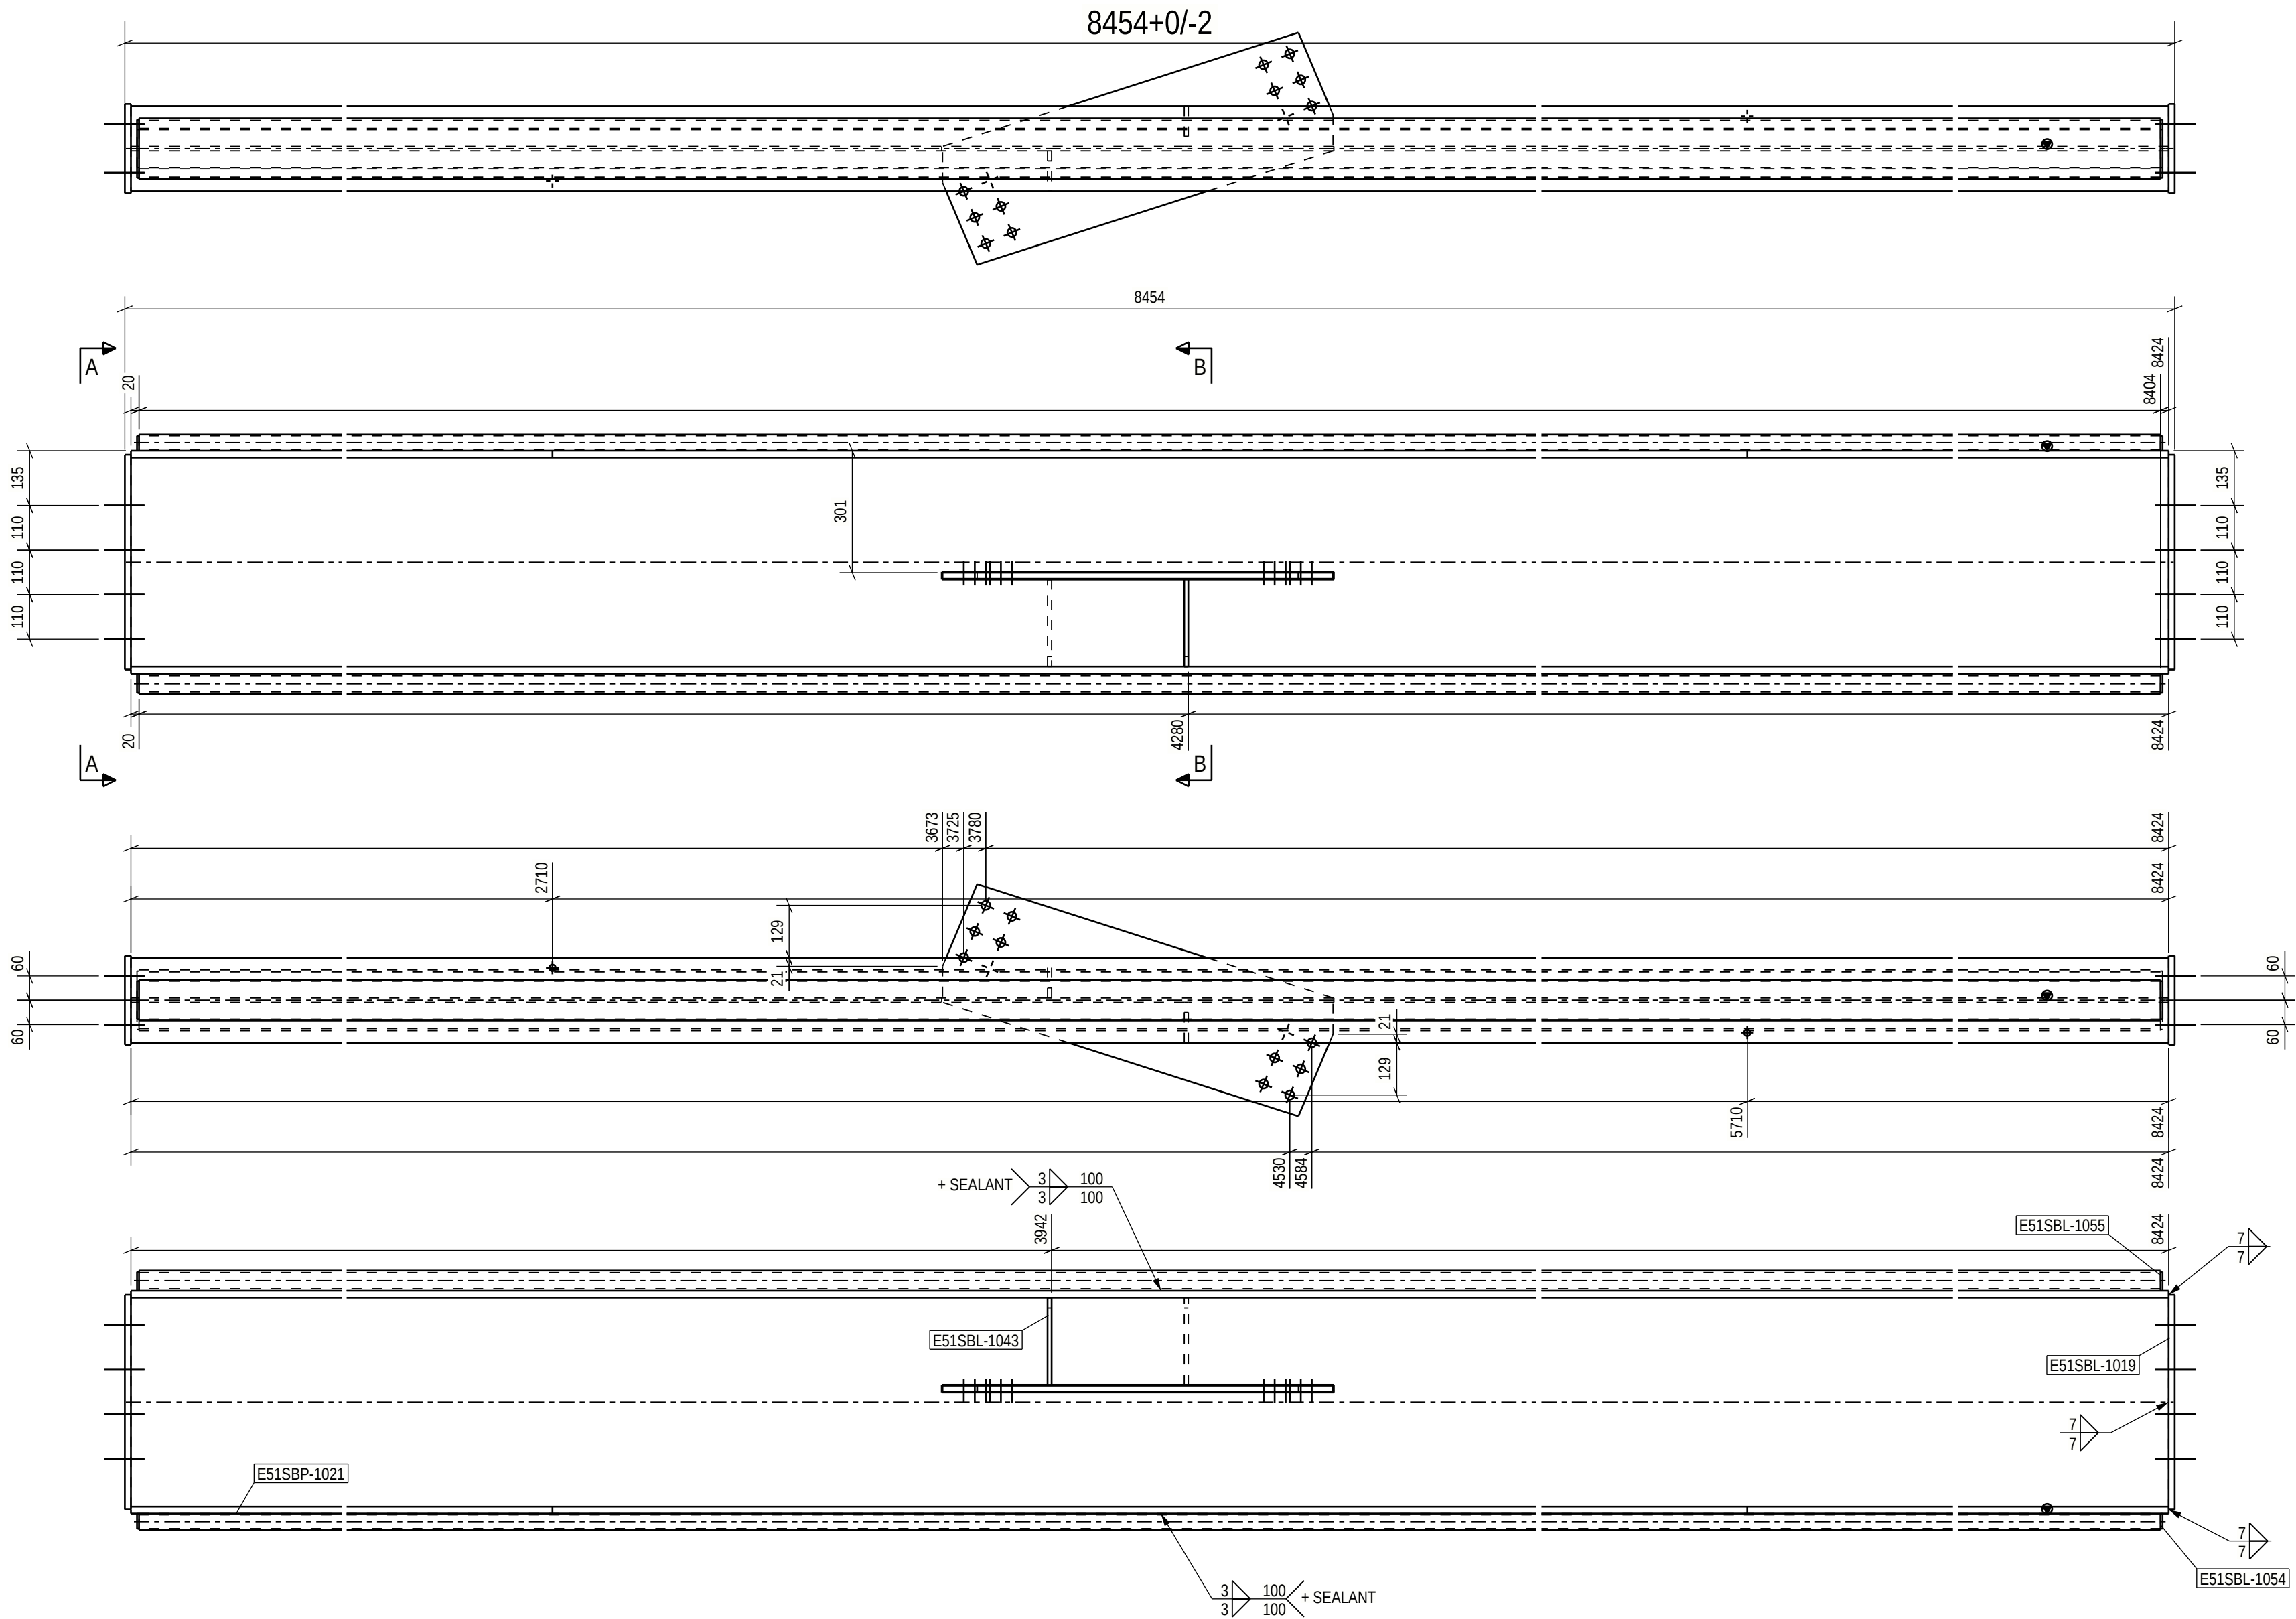

PART LIST FOR ASSEMBLY E51SB-1003, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51SBL-1019	PL15X220	S355J2+N	530	0.51	13.7	2
E51SBL-1036	PL15X304	S355J2+N	969	0.61	33.9	1
E51SBL-1043	PL10X99	S355J2+N	215	0.10	1.7	2
E51SBL-1054	PL5X37	S355J2+N	94	0.02	0.1	2
E51SBL-1055	PL5X47	S355J2+N	144	0.03	0.3	2
E51SBP-1021	IPE550	S355J2	8424	15.81	886.1	1
E51SBP-1075	CFRHS150X50X5	S355J2H	8384	3.21	120.4	1
E51SBP-1076	CFRHS100X40X3	S355J2H	8384	2.26	51.4	1
TOTAL:				22.56	1123.5	


Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2	Fabrication tolerances EN 1090-2, Appendix B	
Execution Specification document nr 25019443-ICC250-0600-0660-000005	Special fabrication tolerances Project specification/ shown on drwg.	
Surface preparation grade ISO8501-3, grade P2	Weld inspection, requirements EN 1090-2, Table 24, U>0.5	
Surface treatment ISO12944-5	Extent of NDT, fillet welds MT-EN1290, 20% of welds	
Additional requirements on surface treatment C3.07, EPPUR 240/2	Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Shade RAL 7024 (Graphite Gray)	Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds	
Welding of built up steel section Appendix 1 / Project spec.	Requirements on holing EN1090-2 Section 6.6.3	
Welds, if not specified otherwise EN 9692-1, EN 9692-2	Weld class C, EN ISO 5817	Additional material inspection Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1





SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi



DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51SB-1003


DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Koivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51SB-1003		

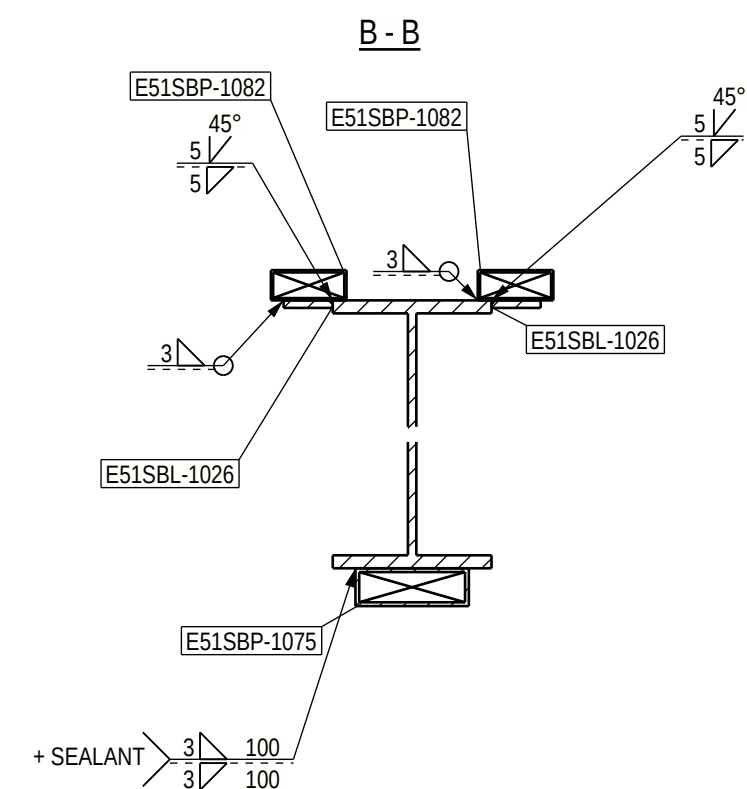25019443 Fair E500

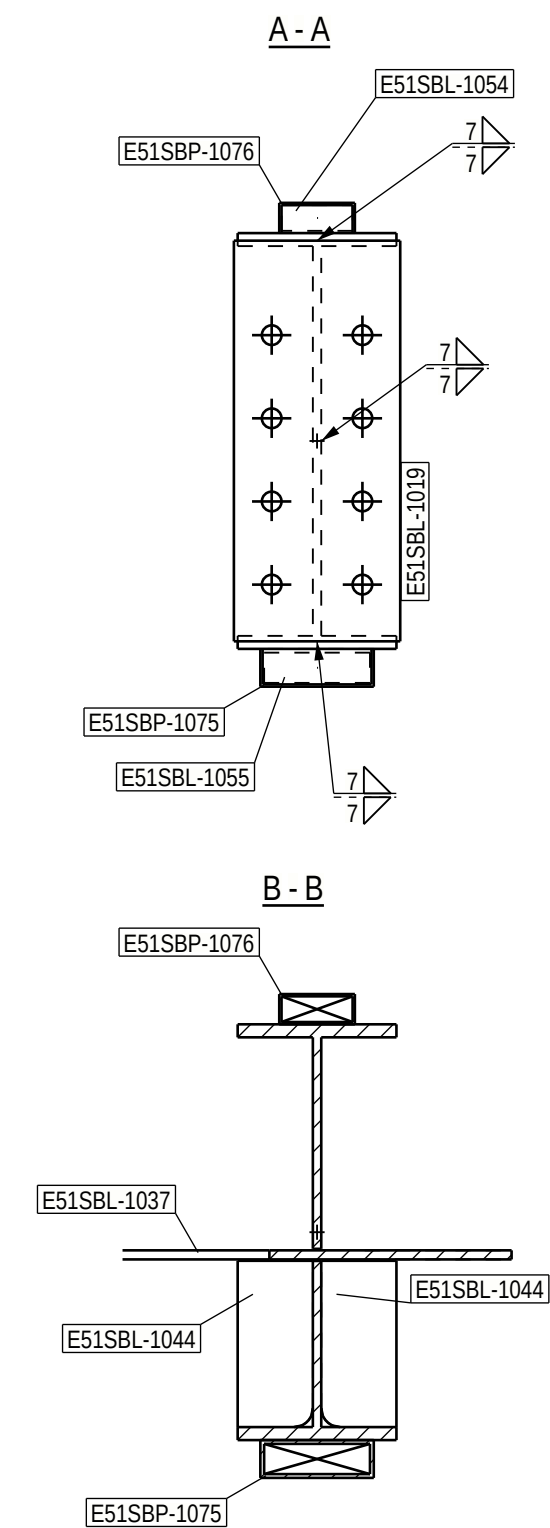


		Execution class
Technical fabrication requirements:		EXC2
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution Specification document nr 25019443-ICC250-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 / Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2	Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on healing EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817	
	Additional material inspection Shown on drwg.	

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




SWECO 
Sustainable engineering and design

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51SB-1005	REVISION	

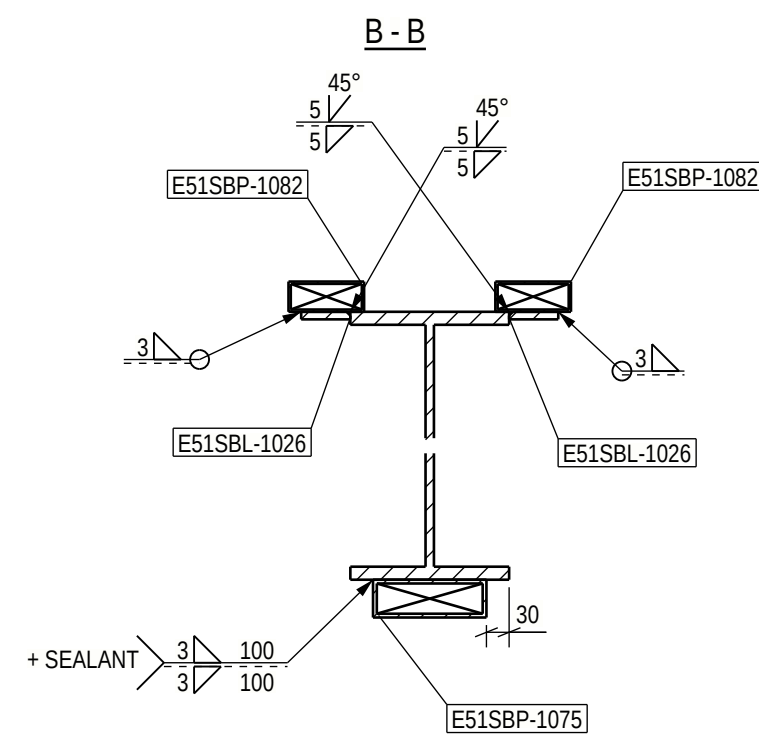


		Execution class	
Technical fabrication requirements:		EXC2	
Requirements for fabrication, standard		Fabrication tolerances	
EN1090-2, table A.3 : EXC2		EN 1090-2, Appendix B	
Execution Specification document nr		Special fabrication tolerances	
25019443-ICC250-0600-0660-000005		Project specification/ shown on drwg.	
Surface preparation grade		Weld inspection, requirements	
ISO8501-3, grade P2		EN 1090-2, Table 24, U>0.5	
Surface treatment		Extent of NDT, fillet welds	
ISO12944-5		MT-EN1290, 20% of welds	
Additional requirements on surface treatment		Extent of NDT, butt welds	
C3.07, EPPUR 240/2		UT, EN-ISO17640, 20% of welds	
Shade		Extent of NDT for splices not shown on drawing	
RAL 7024 (Graphite Gray)		UT, EN-ISO17640, 100% of welds	
Welding of built up steel section		Requirements on hinging	
Appendix 1 / Project spec.		EN1090-2 Section 6.6.3	
Welds, if not specified otherwise		Weld class	
EN 9692-1, EN 9692-2		C, EN ISO 5817	
		Additional material inspection Shown on drwg.	

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51SB-1006		REVISION

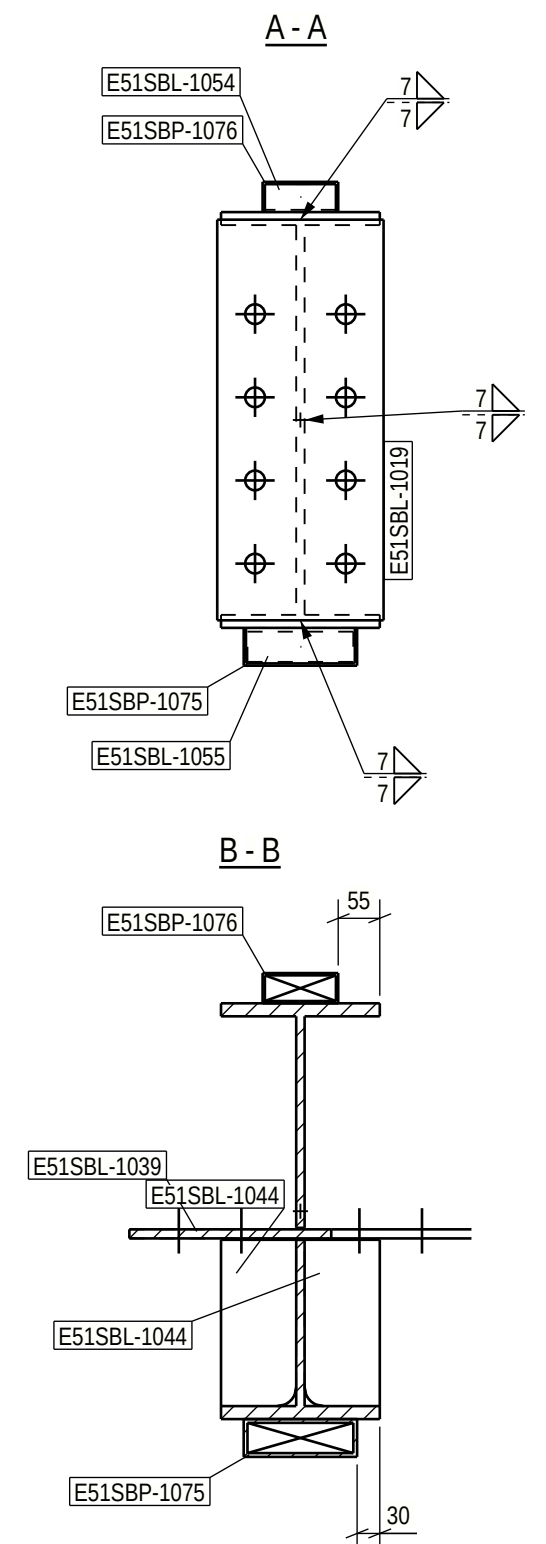


Technical fabrication requirements:		Execution class EXC2
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution Specification document nr 25019443-ICC2500-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 - Project spec. Weeds, if not specified otherwise EN 9692-1, EN 9692-2	Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on dwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100%of welds Requirements on holding EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817	Additional material inspection Shown on dwg.


PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



SWECO 
Sustainable engineering and design


DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51SB-1007	REVISION	

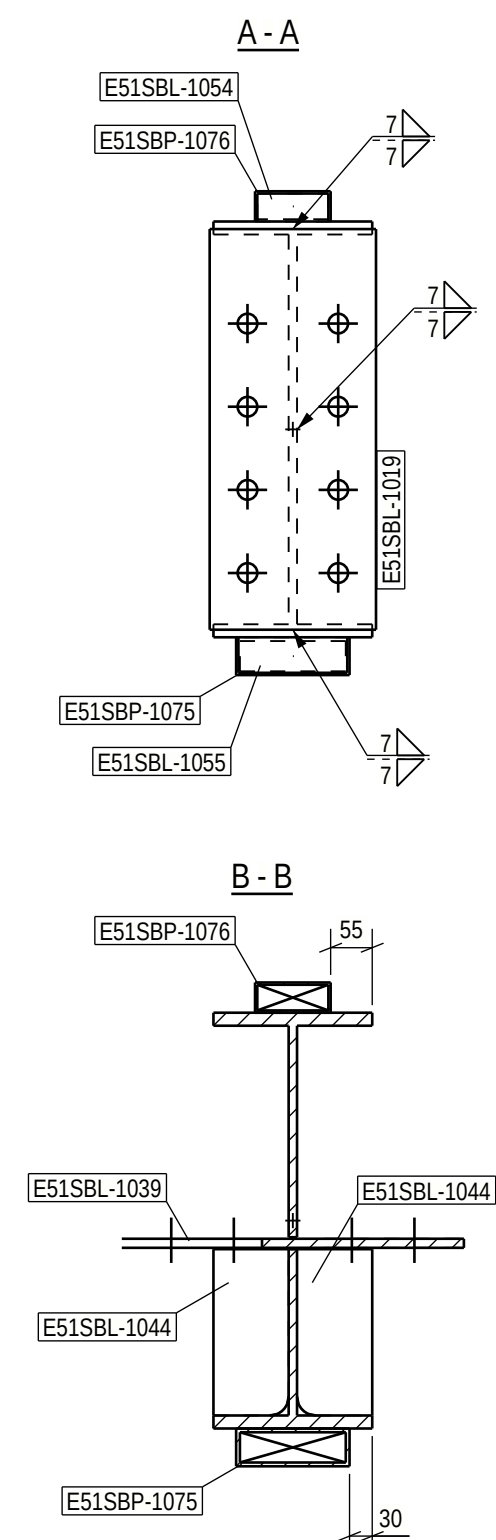25019443 Fair E500

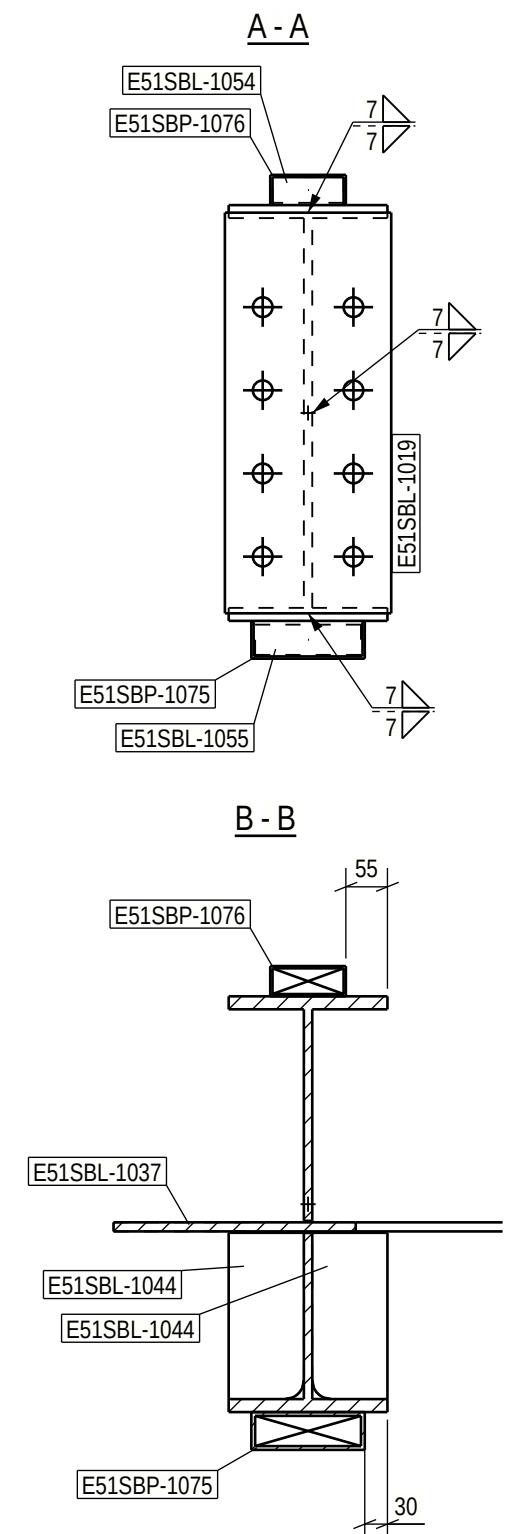


		Execution class
Technical fabrication requirements:		EXC2
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution specification document nr 25019443-ICC250-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 / Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2	Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on holing EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817	
	Additional material inspection Shown on drwg.	

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




SWECO 
Sustainable engineering and design

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51SB-1010	REVISION	

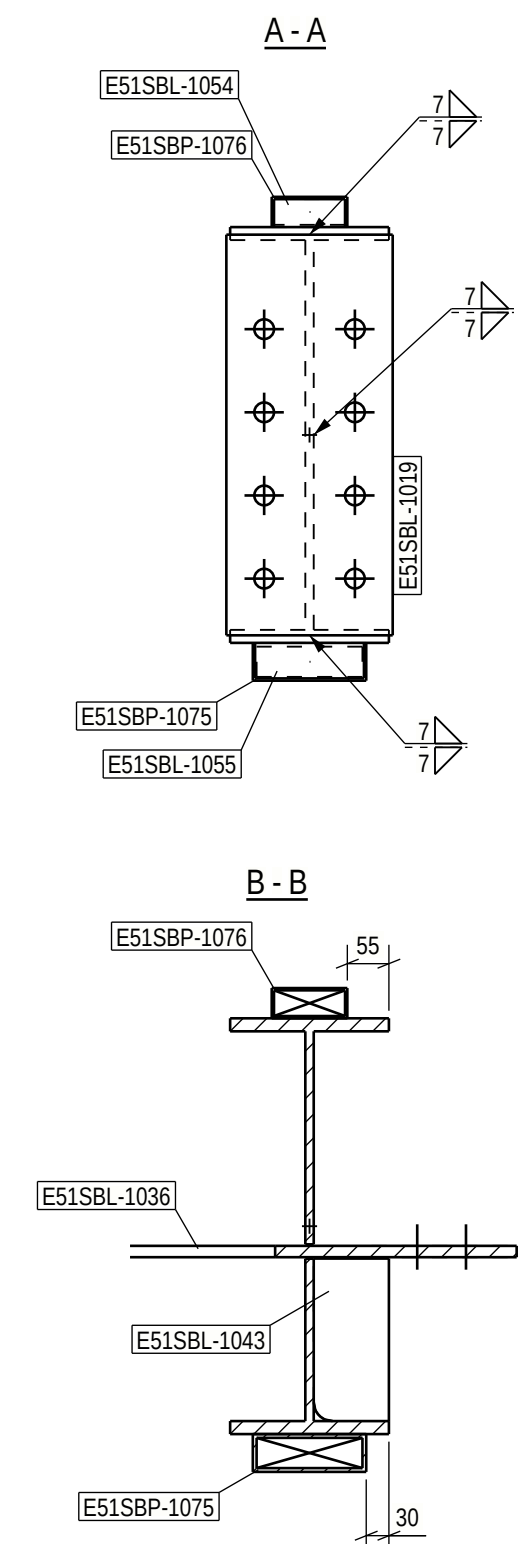


		Execution class
Technical fabrication requirements:		EXC2
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution specification document nr 25019443-ICC250-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 / Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2	Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on holing EN1090-2 Section 6.6.3 Weld class C, EN ISO 5817	
	Additional material inspection Shown on drwg.	


PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



SWECO 
Sustainable engineering and design


DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51SB-1011		
REVISION			

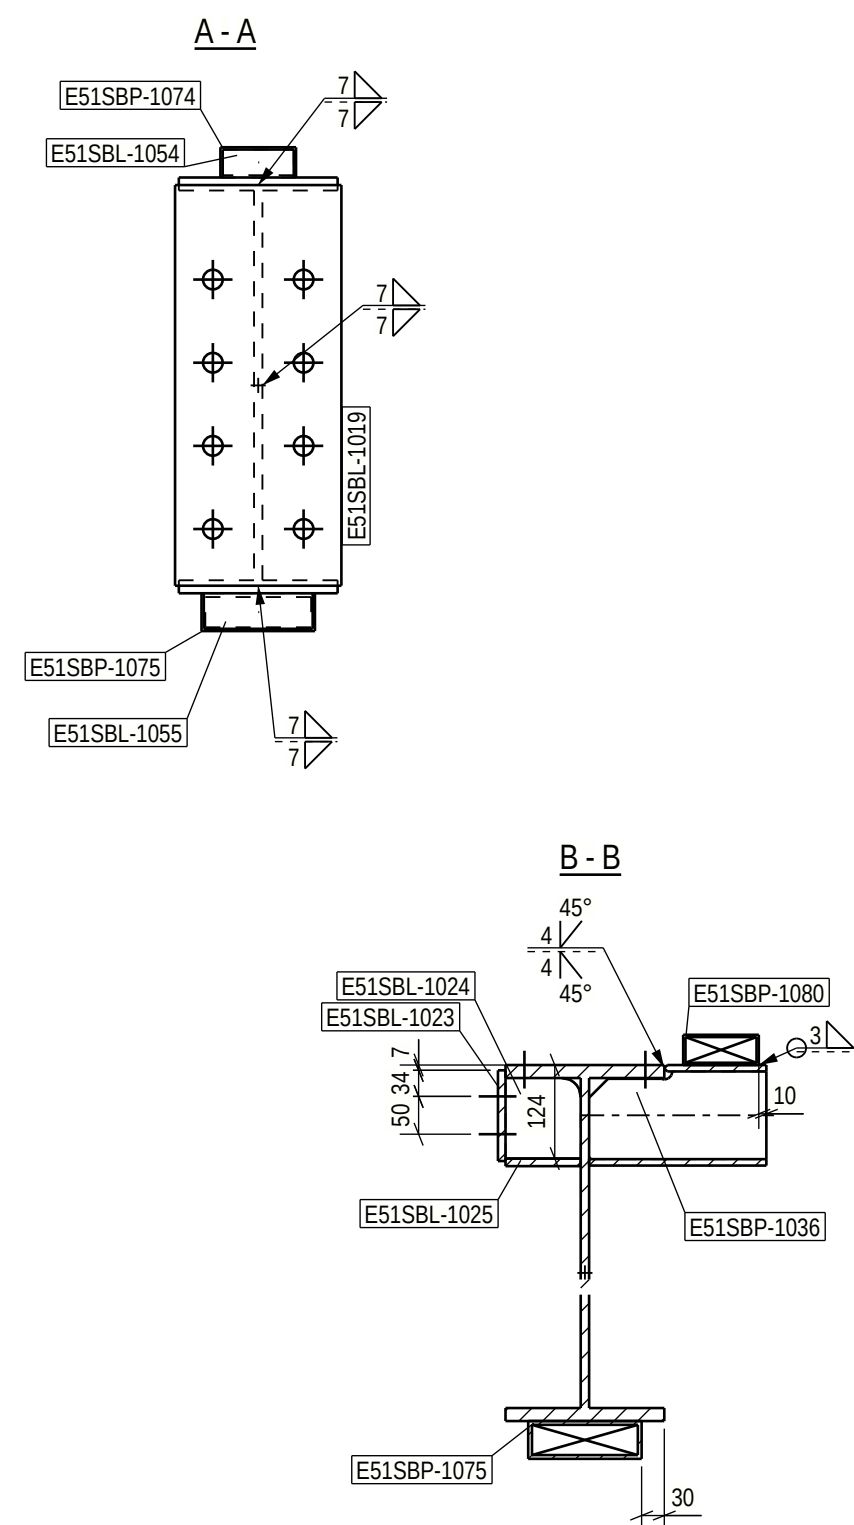

		Execution class	
Technical fabrication requirements:		EXC2	
Requirements for fabrication, standard		Fabrication tolerances	
EN1090-2, table A.3 : EXC2		EN 1090-2, Appendix B	
Execution Specification document nr		Special fabrication tolerances	
25019443-ICC250-0600-0660-000005		Project specification/ shown on drwg.	
Surface preparation grade		Weld inspection, requirements	
ISO8501-3, grade P2		EN 1090-2, Table 24, U>0.5	
Surface treatment		Extent of NDT, fillet welds	
ISO12944-5		MT-EN1290, 20% of welds	
Additional requirements on surface treatment		Extent of NDT, butt welds	
C3.07, EPPUR 240/2		UT, EN-ISO17640, 20% of welds	
Shade		Extent of NDT for splices not shown on drawing	
RAL 7024 (Graphite Gray)		UT, EN-ISO17640, 100% of welds	
Welding of built up steel section		Requirements on hinging	
Appendix 1 / Project spec.		EN1090-2 Section 6.6.3	
Welds, if not specified otherwise		Weld class	
EN 9692-1, EN 9692-2		C, EN ISO 5817	
		Additional material inspection	
		Shown on drwg.	

SWECO 
Sustainable engineering and design


DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51SB-1012		REVISION

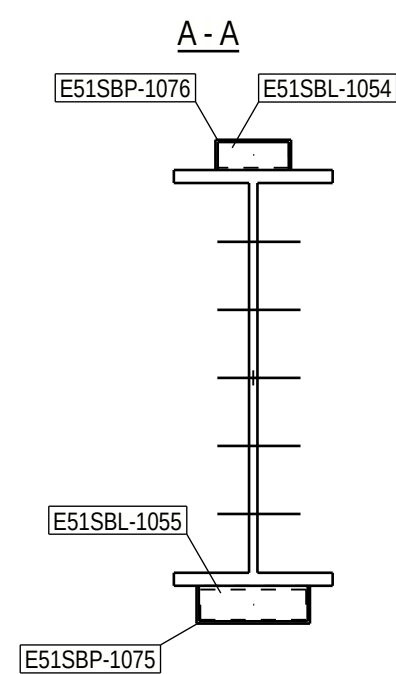

Technical drawing B-B showing a cross-section of a roof structure. The drawing includes labels for components: E51SBP-1076, E51SBP-1073, E51SBP-1075, E51SBL-1024, E51SBL-1023, and E51SBL-1025. Dimensions shown include a 45° angle, a 50mm height, a 34mm width, and a 7mm gap. A 30mm dimension is also indicated at the base.

Technical fabrication requirements:		Execution class EXC2
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution specification document nr Z5019443-ICC25-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1, Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2	Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on hinging EN1090-2 Section 6.6.3	Additional material inspection Weld class EN ISO 5817 Shown on drwg.

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



DRAWING CONTENT

ASSEMBLY DRAWING


Beam

E51SB-1015



SWECO RAKENNETEKNIikka Oy
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER	DWG. NO.		REVISION
25019443	E51SB-1015		

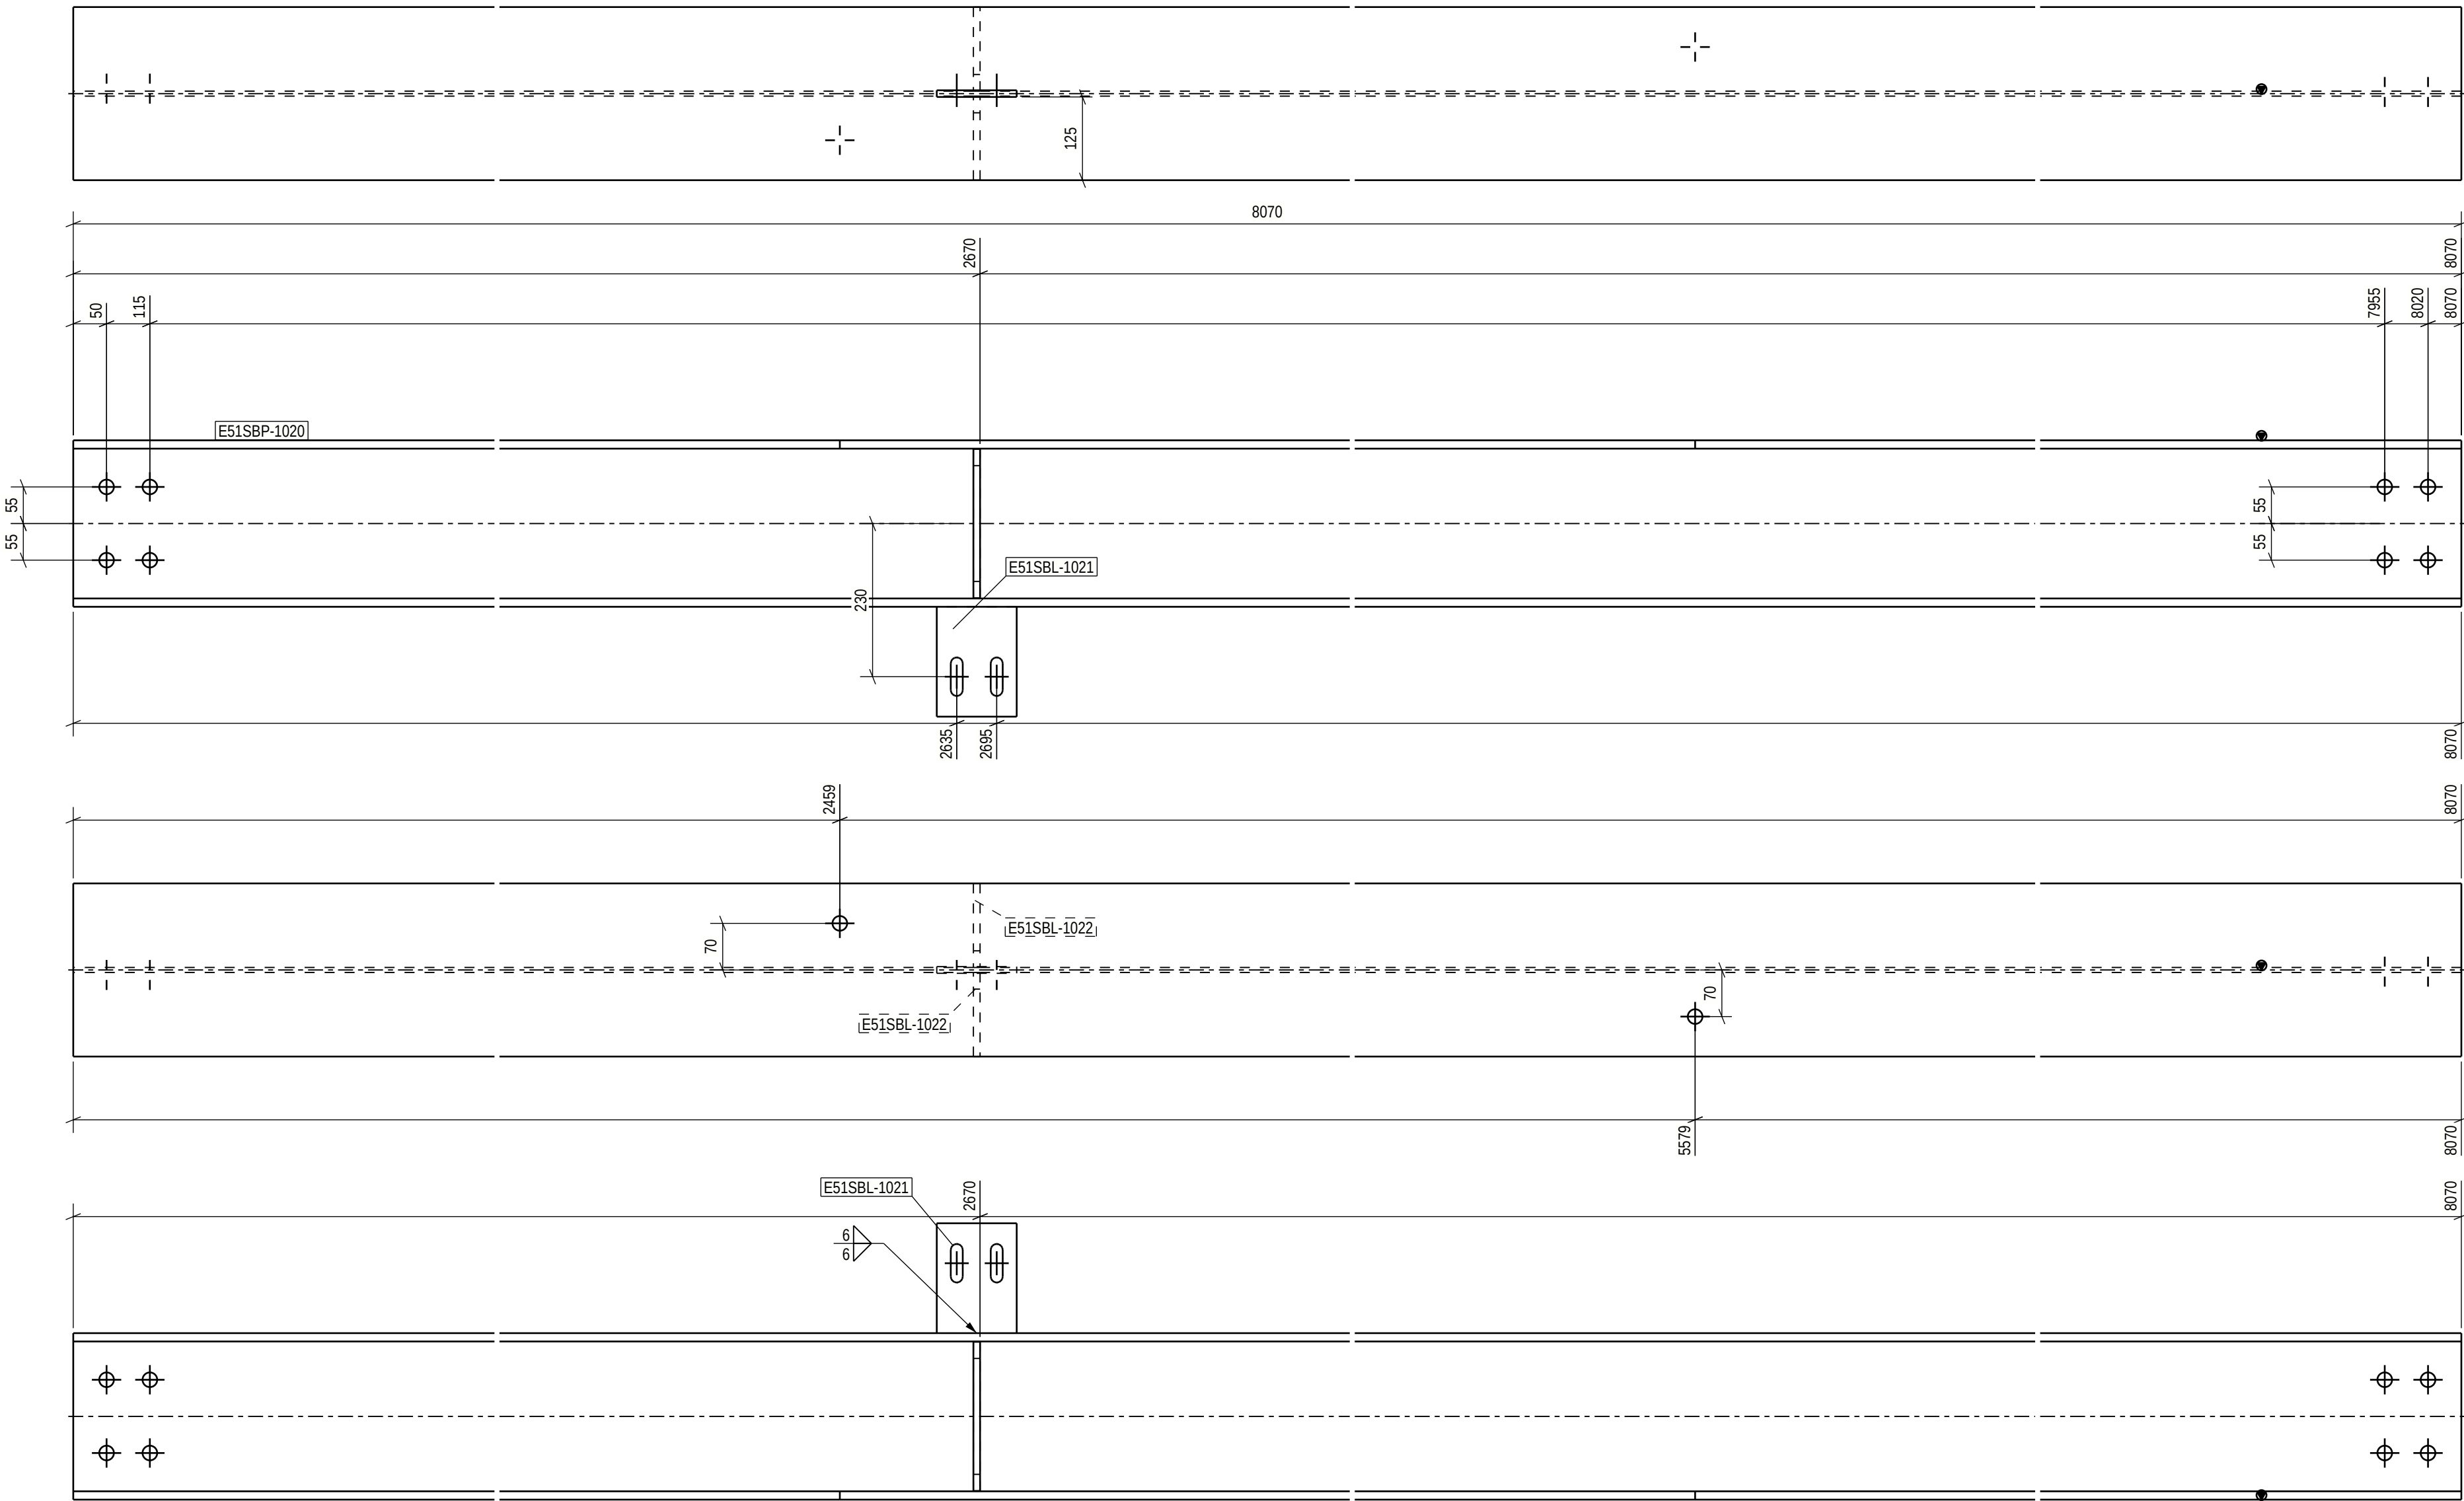

PART LIST FOR ASSEMBLY E51SB-1021, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51SBL-1021	PL10X120	S355J2+N	165	0.05	1.6	1
E51SBL-1022	PL10X126	S355J2+N	224	0.13	2.2	2
E51SBP-1020	HEA260	S355J2	8070	11.98	550.0	1
TOTAL:				12.15	555.9	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard
EN1090-2, table A.3 : EXC2
Execution Specification document nr
25019443-ICC250-0600-0660-000005

Fabrication tolerances
EN 1090-2, Appendix B
Special fabrication tolerances
Project specification/ shown on drwg.

Surface preparation grade
ISO8501-3, grade P2

Weld inspection, requirements
EN 1090-2, Table 24, U>0.5

Surface treatment
ISO12944-5

Extent of NDT, fillet welds
MT-EN1290, 20% of welds

Additional requirements on surface treatment
C3.07, EPPUR 240/2

Extent of NDT for splices not shown on drawing
UT, EN-ISO17640, 20% of welds

Shade
RAL 7024 (Graphite Gray)

UT, EN-ISO17640, 100% of welds

Welding of built up steel section
Appendix 1 / Project spec.

Requirements on holing
EN1090-2 Section 6.6.3

Welds, if not specified otherwise
EN 9692-1, EN 9692-2

Weld class
C, EN ISO 5817

Additional material inspection
Shown on drwg.

PROJECT NAME

Easpring New Materials Oy
FAIR Phase 1

 SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi


DRAWING CONTENT

ASSEMBLY DRAWING
Beam
E51SB-1021

DATE	16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP
DRAWN	Alexey Serous	DESIGNER	APPROVED	CHECKED
PROJECT NUMBER	25019443	Alexey Serous	Pertti Kivumaaanaho	Jere Kallosalmi
DWG. NO.	25019443	REVISION		

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

25019443_Fair_E500

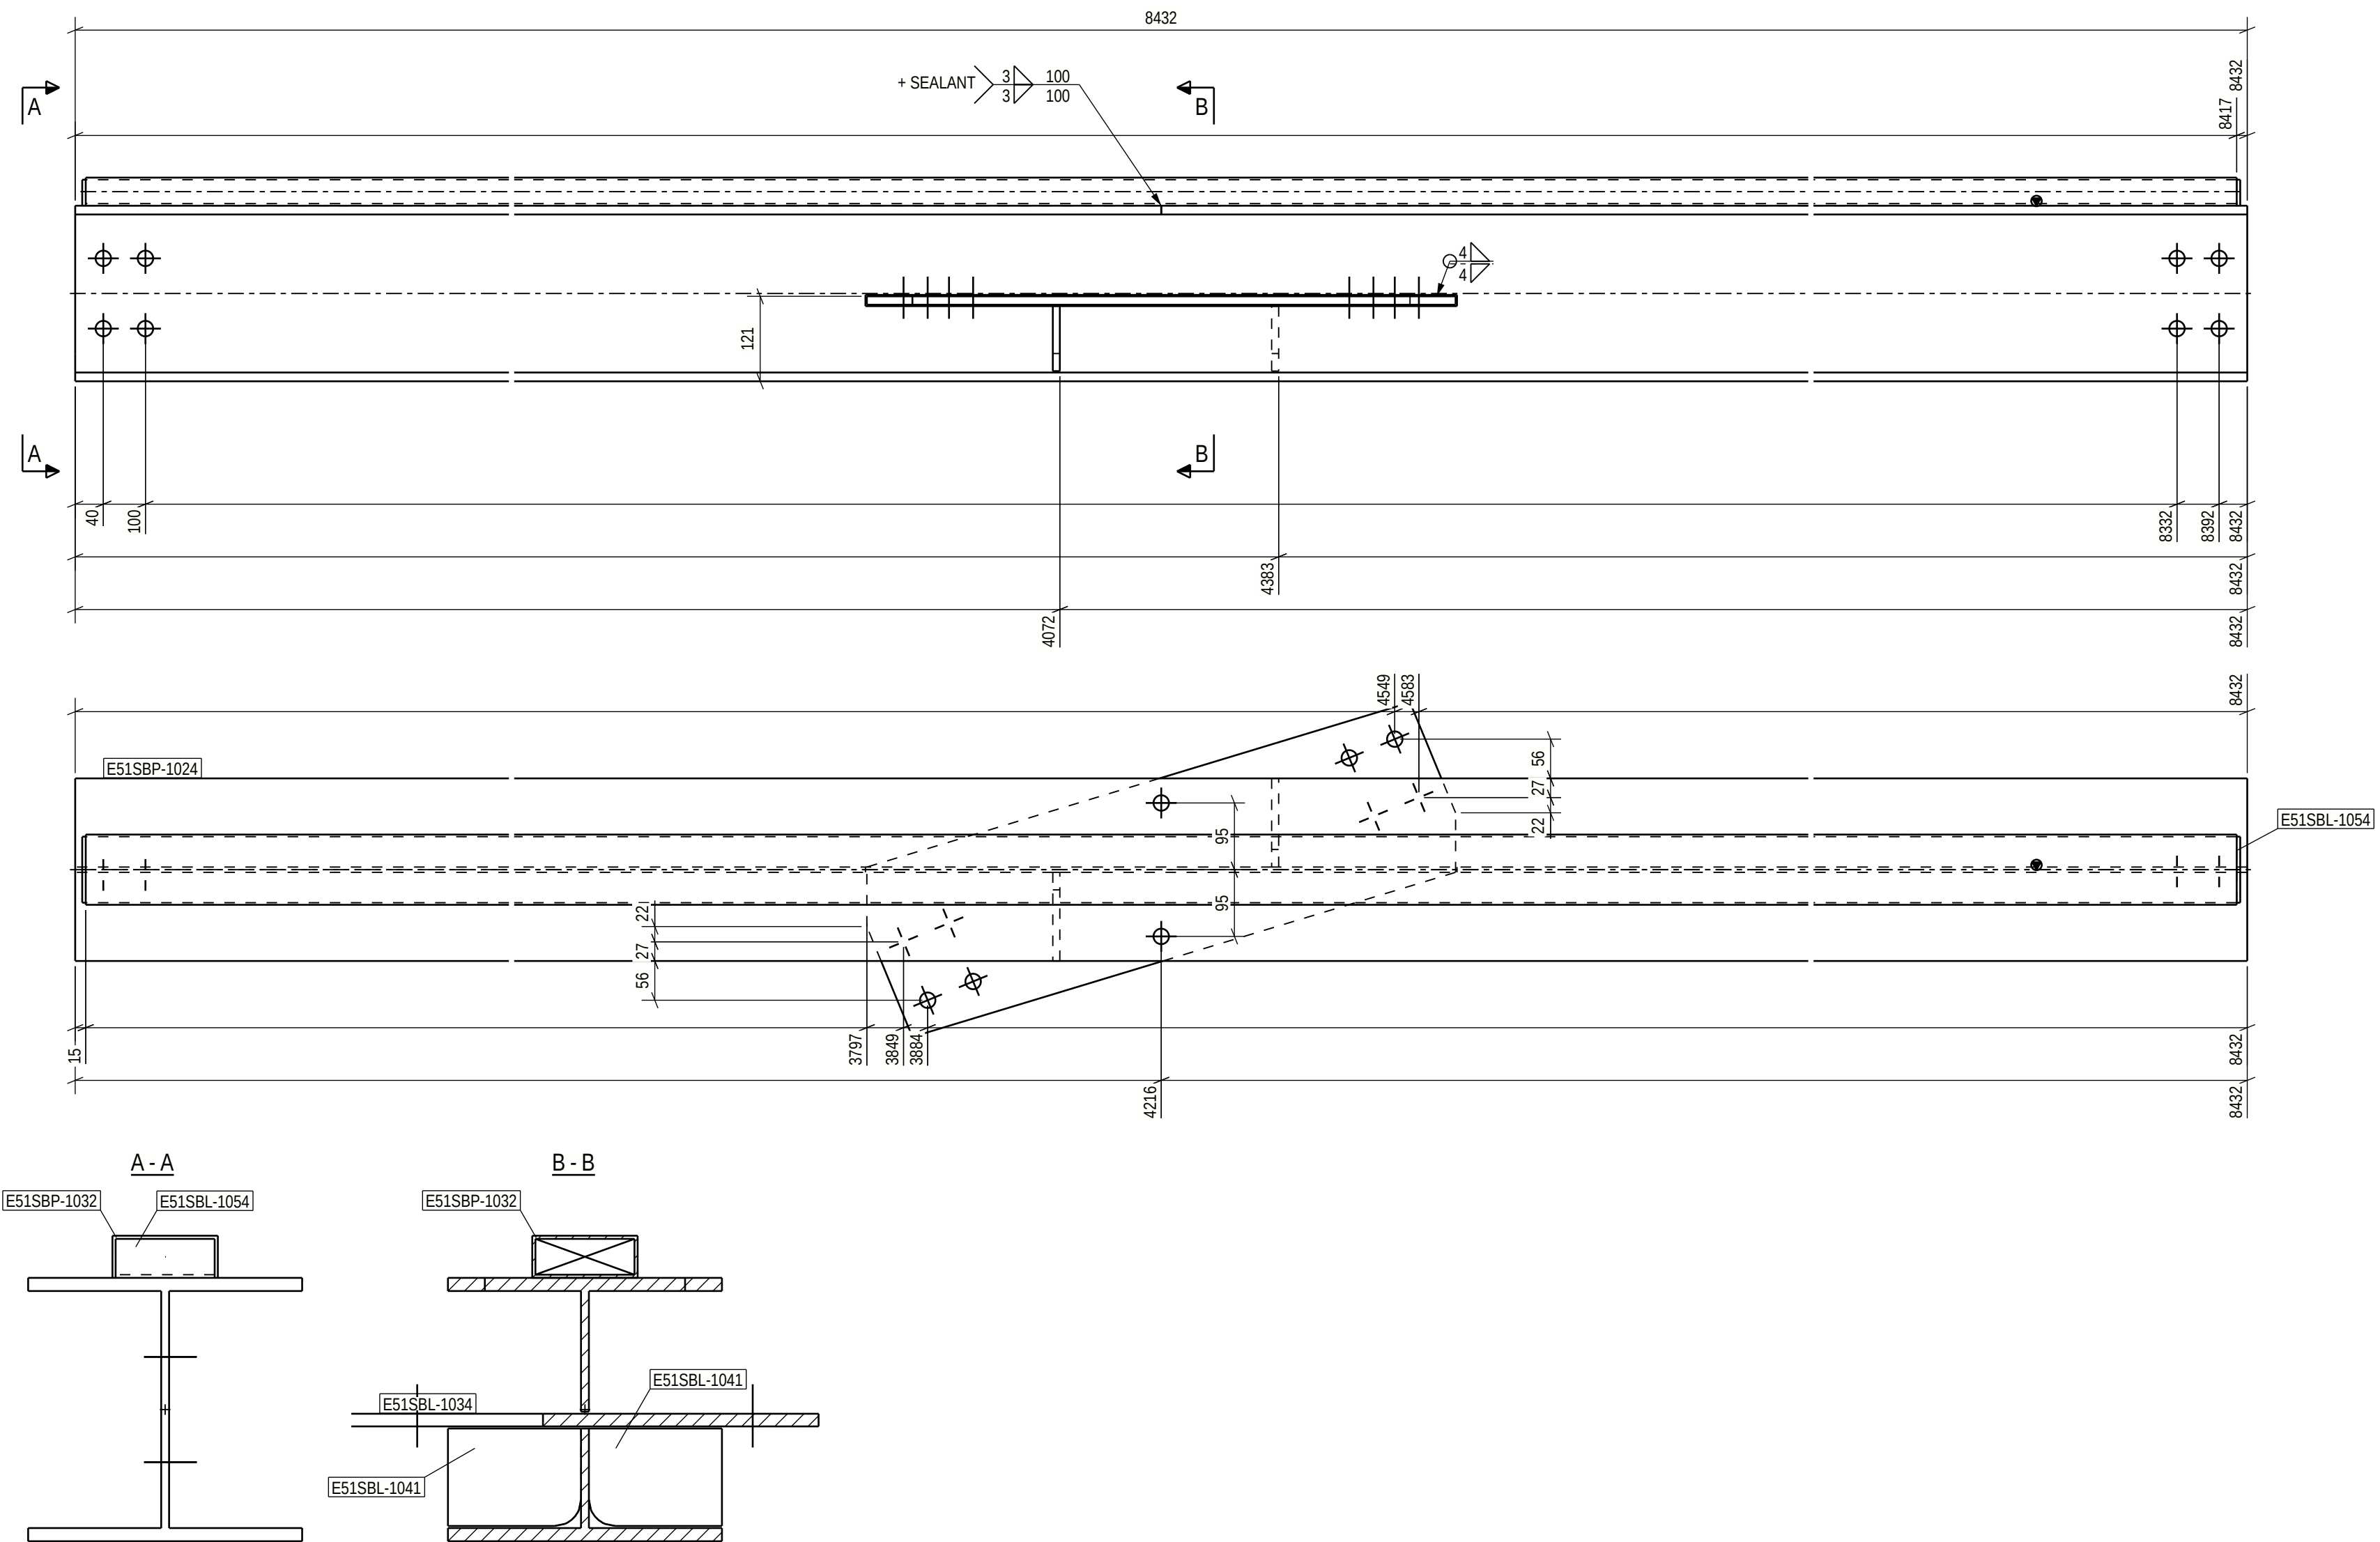


PART LIST FOR ASSEMBLY E51SB-1022, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51SBL-1034	PL12X250	S355J2+N	849	0.44	19.6	1
E51SBL-1041	PL10X126	S355J2+N	93	0.05	0.9	2
E51SBL-1054	PL5X37	S355J2+N	94	0.02	0.1	2
E51SBP-1024	HEA260	S355J2	8432	12.51	574.7	1
E51SBP-1032	CFRHS100X40X3	S355J2H	8402	2.27	51.5	1
TOTAL:			15.29	647.9		

Technical fabrication requirements:		Execution class
		EXC2
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2	Fabrication tolerances EN 1090-2, Appendix B	
Execution Specification document nr 25019443-ICC250-0600-0660-000005	Special fabrication tolerances Project specification/ shown on drwg.	
Surface preparation grade ISO8501-3, grade P2	Weld inspection, requirements EN 1090-2, Table 24, U>0.5	
Surface treatment ISO12944-5	Extent of NDT, fillet welds MT-EN1290, 20% of welds	
Additional requirements on surface treatment C3.07, EPPUR 240/2	Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Shade RAL 7024 (Graphite Gray)	Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds	
Welding of built up steel section Appendix 1 / Project spec.	Requirements on holing EN1090-2 Section 6.6.3	
Welds, if not specified otherwise EN 9692-1, EN 9692-2	Weld class C, EN ISO 5817	Additional material inspection Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51SB-1022




SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Koivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51SB-1022		

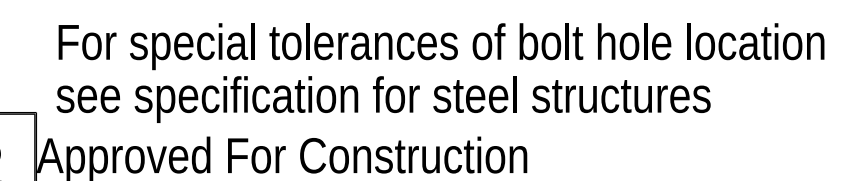

PROJECT NAME				DRAWING CONTENT			
Easpring New Materials Oy FAIR Phase 1				ASSEMBLY DRAWING Beam E51SB-1023			
 Sustainable engineering and design		SWECO RAKENNETEKNIIKKA OY ILMALANPORTTI 2 00240 HELSINKI		DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
		PUH. +358 207 393 000 www.sweco.fi		16.06.2026			STR
				DRAWN	DESIGNER	APPROVED	CHECKED
				Alexey Serous	Alexey Serous	Pertti Koivumaa/naaho	Jere Kalliosalmi
				PROJECT NUMBER	DWG. NO.		REVISION
				25019443	E51SB-1023		

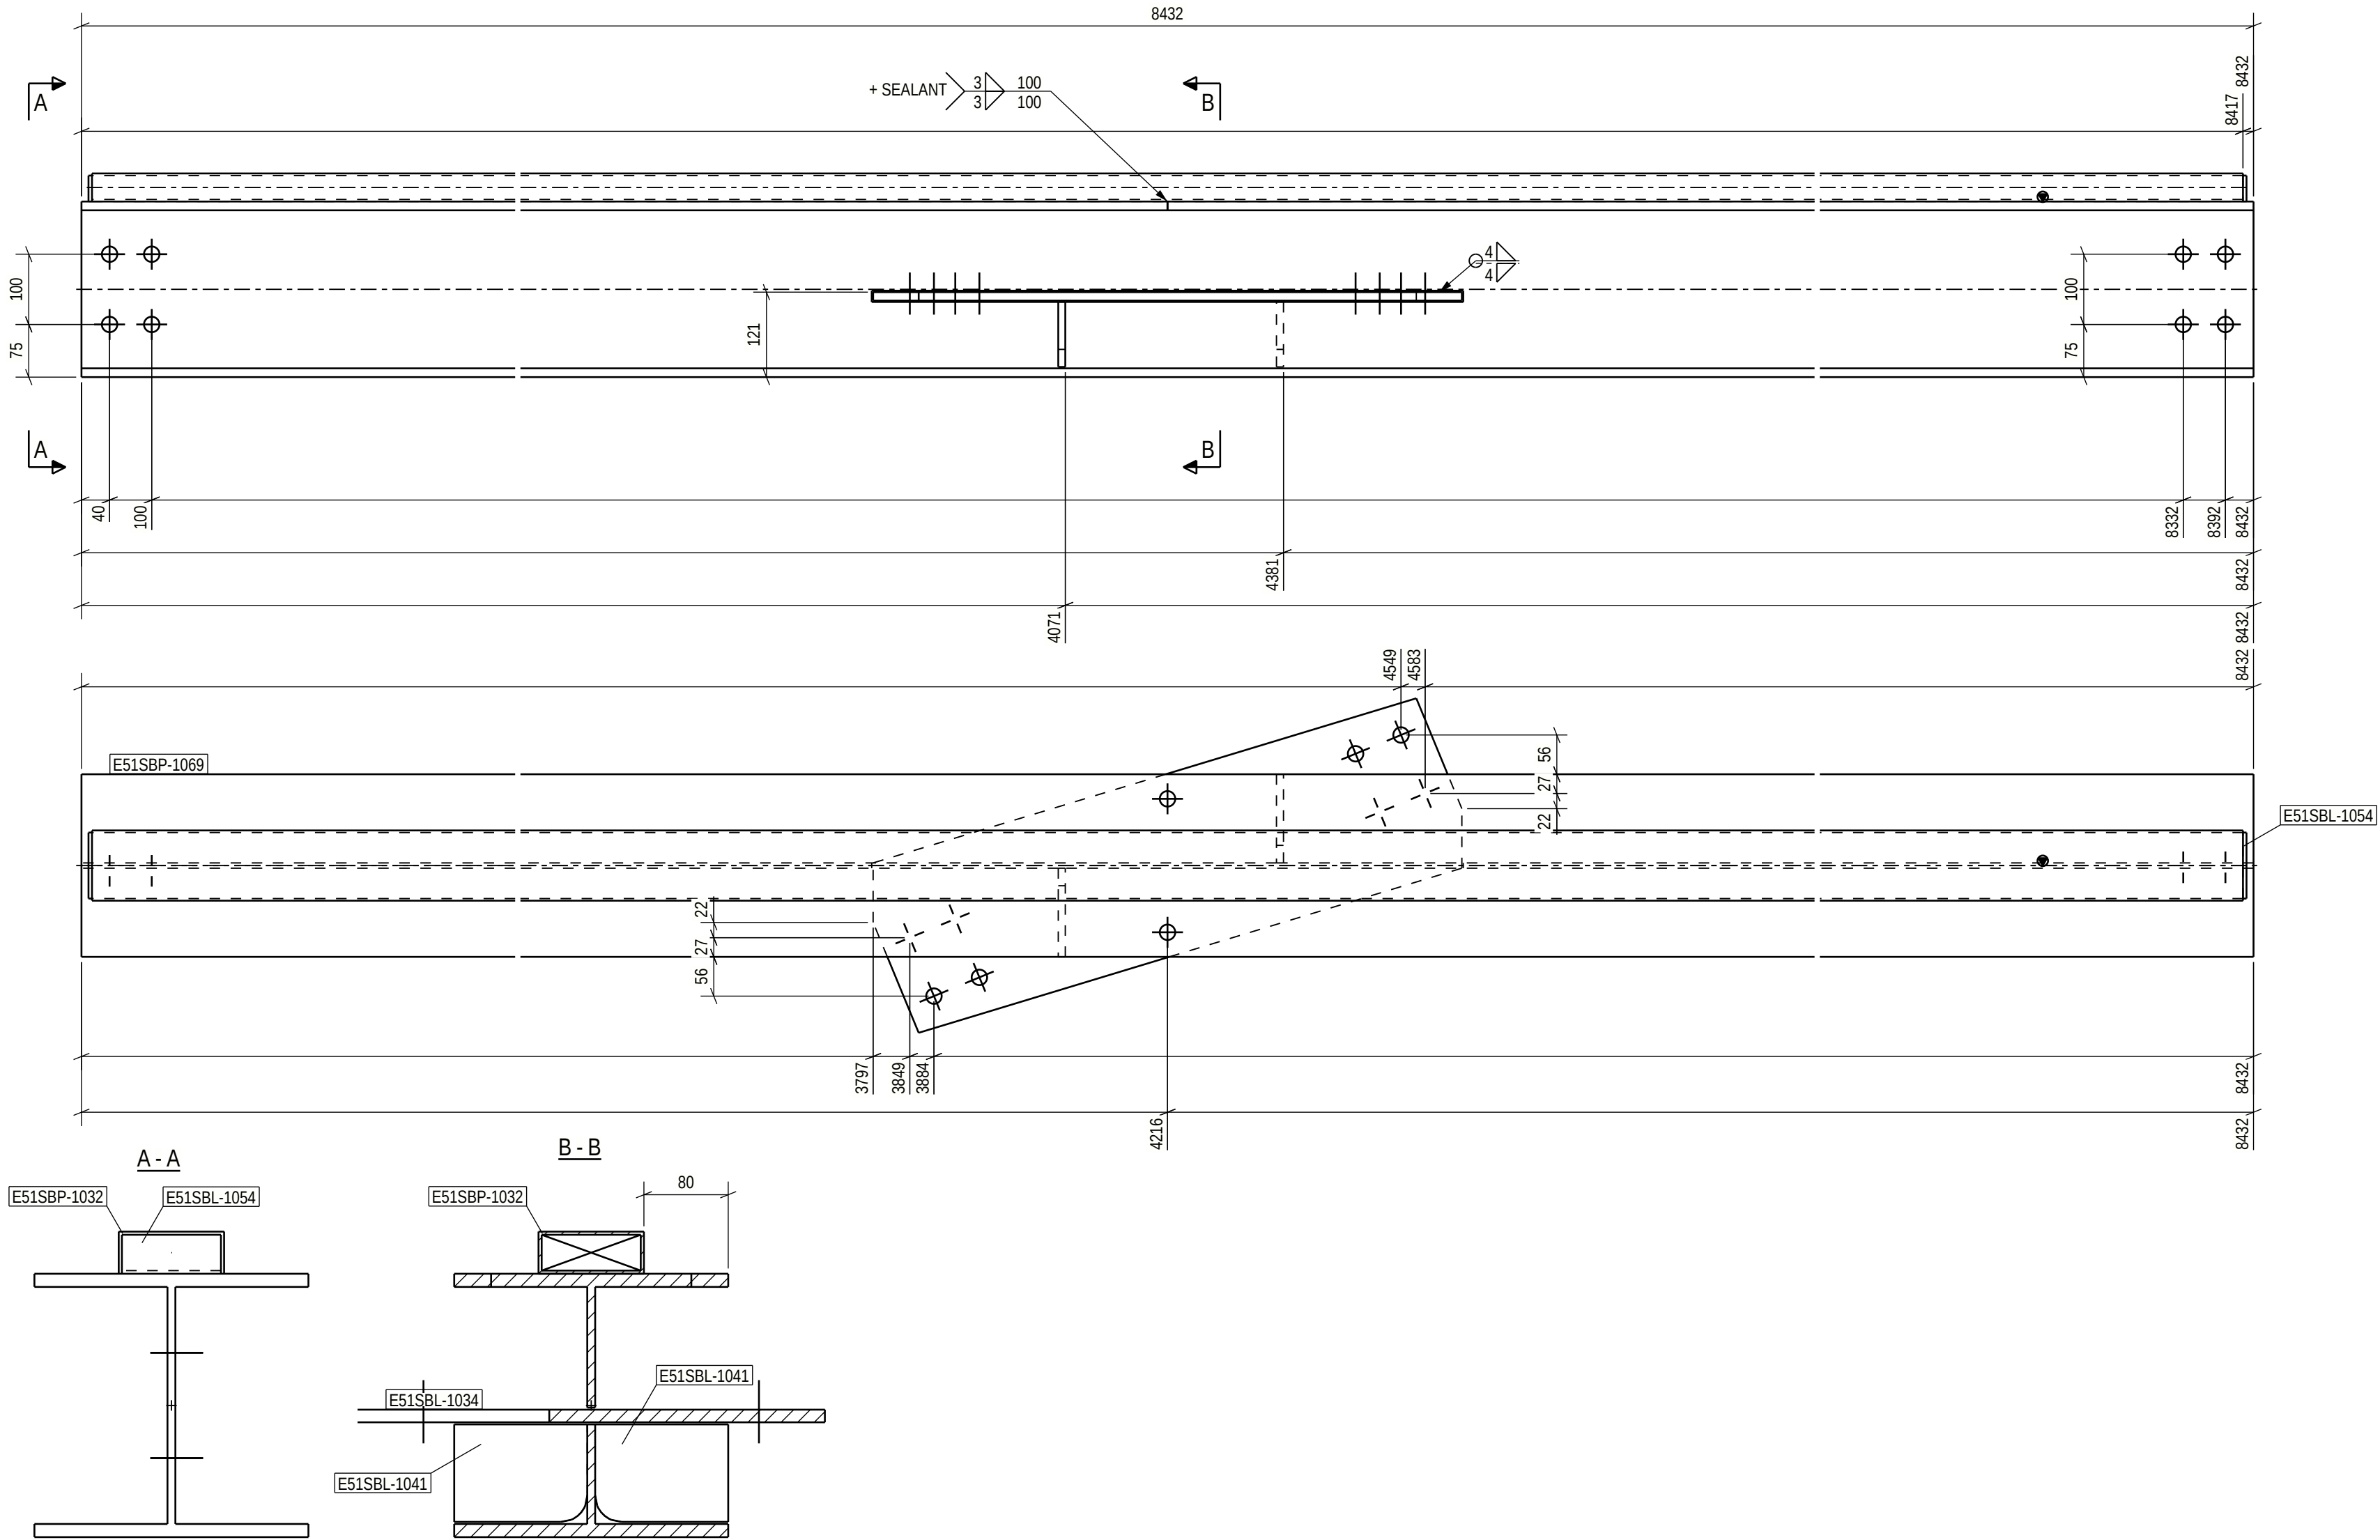


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PART LIST FOR ASSEMBLY E51SB-1024, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51SBL-1034	PL12X250	S355J2+N	849	0.44	19.6	1
E51SBL-1041	PL10X126	S355J2+N	93	0.05	0.9	2
E51SBL-1054	PL5X37	S355J2+N	94	0.02	0.1	2
E51SBP-1032	CFRHS100X40X3	S355J2H	8402	2.27	51.5	1
E51SBP-1069	HEA260	S355J2	8432	12.51	574.7	1
TOTAL:				15.29	647.9	

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005		
Surface preparation grade ISO8501-3, grade P2		
Surface treatment ISO12944-5		
Additional requirements on surface treatment C3.07, EPPUR 240/2		
Shade RAL 7024 (Graphite Gray)		
Welding of built up steel section Appendix 1 / Project spec.		
Welds, if not specified otherwise EN 9692-1, EN 9692-2		
Fabrication tolerances EN 1090-2, Appendix B		
Special fabrication tolerances Project specification/ shown on drwg.		
Weld inspection, requirements EN 1090-2, Table 24, U>0.5		
Extent of NDT, filled welds MT-EN1290, 20% of welds		
Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds		
Requirements on holing EN1090-2 Section 6.6.3		
Weld class C, EN ISO 5817		
Additional material inspection Shown on drwg.		

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51SB-1024

SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaa	CHECKED Jere Kallosalmi
PROJECT NUMBER 25019443	DWG. NO. E51SB-1024	REVISION	

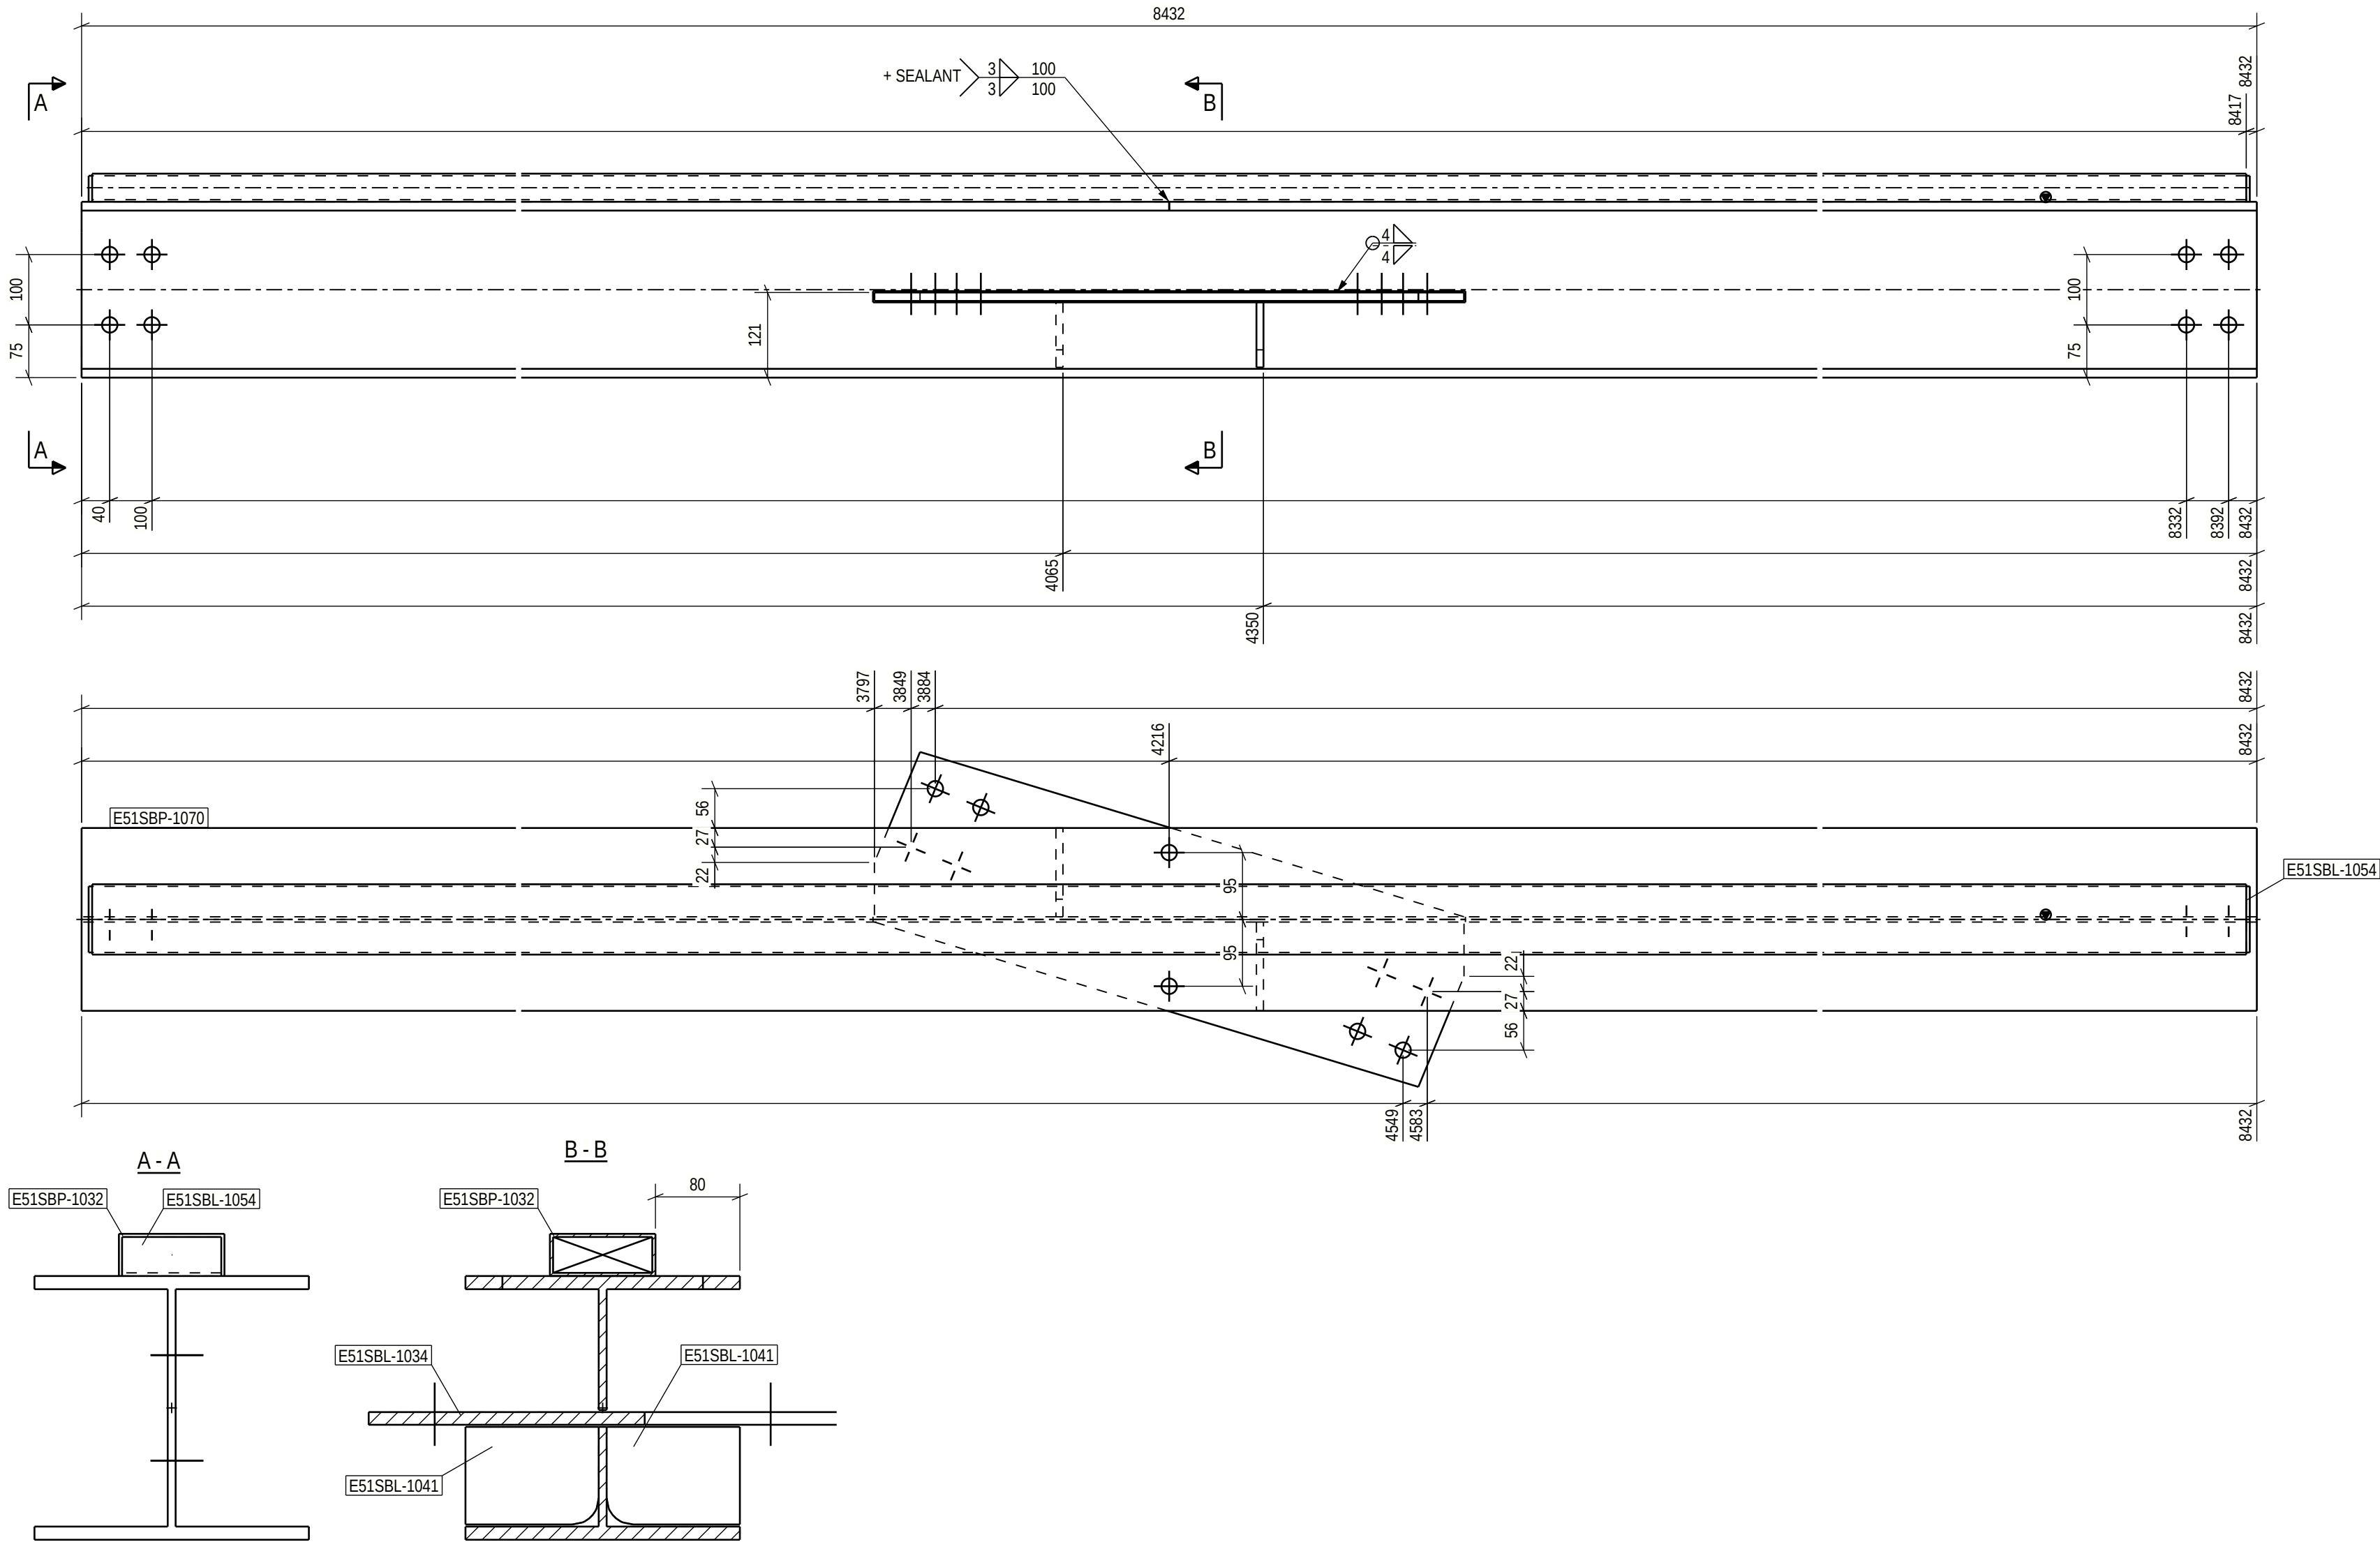

PART LIST FOR ASSEMBLY E51SB-1025, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51SBL-1034	PL12X250	S355J2+N	849	0.44	19.6	1
E51SBL-1041	PL10X126	S355J2+N	93	0.05	0.9	2
E51SBL-1054	PL5X37	S355J2+N	94	0.02	0.1	2
E51SBP-1032	CFRHS100X40X3	S355J2H	8402	2.27	51.5	1
E51SBP-1070	HEA260	S355J2	8432	12.51	574.7	1
TOTAL:				15.29	647.9	


Technical fabrication requirements:		Execution class
Requirements for fabrication, standard		EXC2
EN1090-2, table A.3 : EXC2	Fabrication tolerances	
Execution Specification document nr	Special fabrication tolerances	
25019443-ICC250-0600-0660-000005	Project specification/ shown on drwg.	
Surface preparation grade	Weld inspection, requirements	
ISO8501-3, grade P2	EN 1090-2,Table 24, U>0.5	
Surface treatment	Extent of NDT, fillet welds	
ISO12944-5	MT-EN1290,20% of welds	
Additional requirements on surface treatment	Extent of NDT, butt welds	
C3.07, EPPUR 240/2	UT, EN-ISO17640, 20% of welds	
Shade	Extent of NDT for splices not shown on drawing	
RAL 7024 (Graphite Gray)	UT, EN-ISO17640, 100% of welds	
Welding of built up steel section	Requirements on holing	
Appendix 1 / Project spec.	EN1090-2 Section 6.6.3	
Welds, if not specified otherwise	Weld class	Additional material inspection
EN 9692-1, EN 9692-2	C, EN ISO 5817	Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME		DRAWING CONTENT	
Easpring New Materials Oy		ASSEMBLY DRAWING	
FAIR Phase 1		Beam	
		E51SB-1025	
		DATE	ARCHIVING CODE
		16.06.2026	
		PAGE	DESIGN GROUP
			STR
		DRAWN	CHECKED
		Alexey Serous	Jere Kallosalmi
		DESIGNER	REVISION
		Alexey Serous	
		PROJECT NUMBER	
		25019443	
		DWG. NO.	
		E51SB-1025	



SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

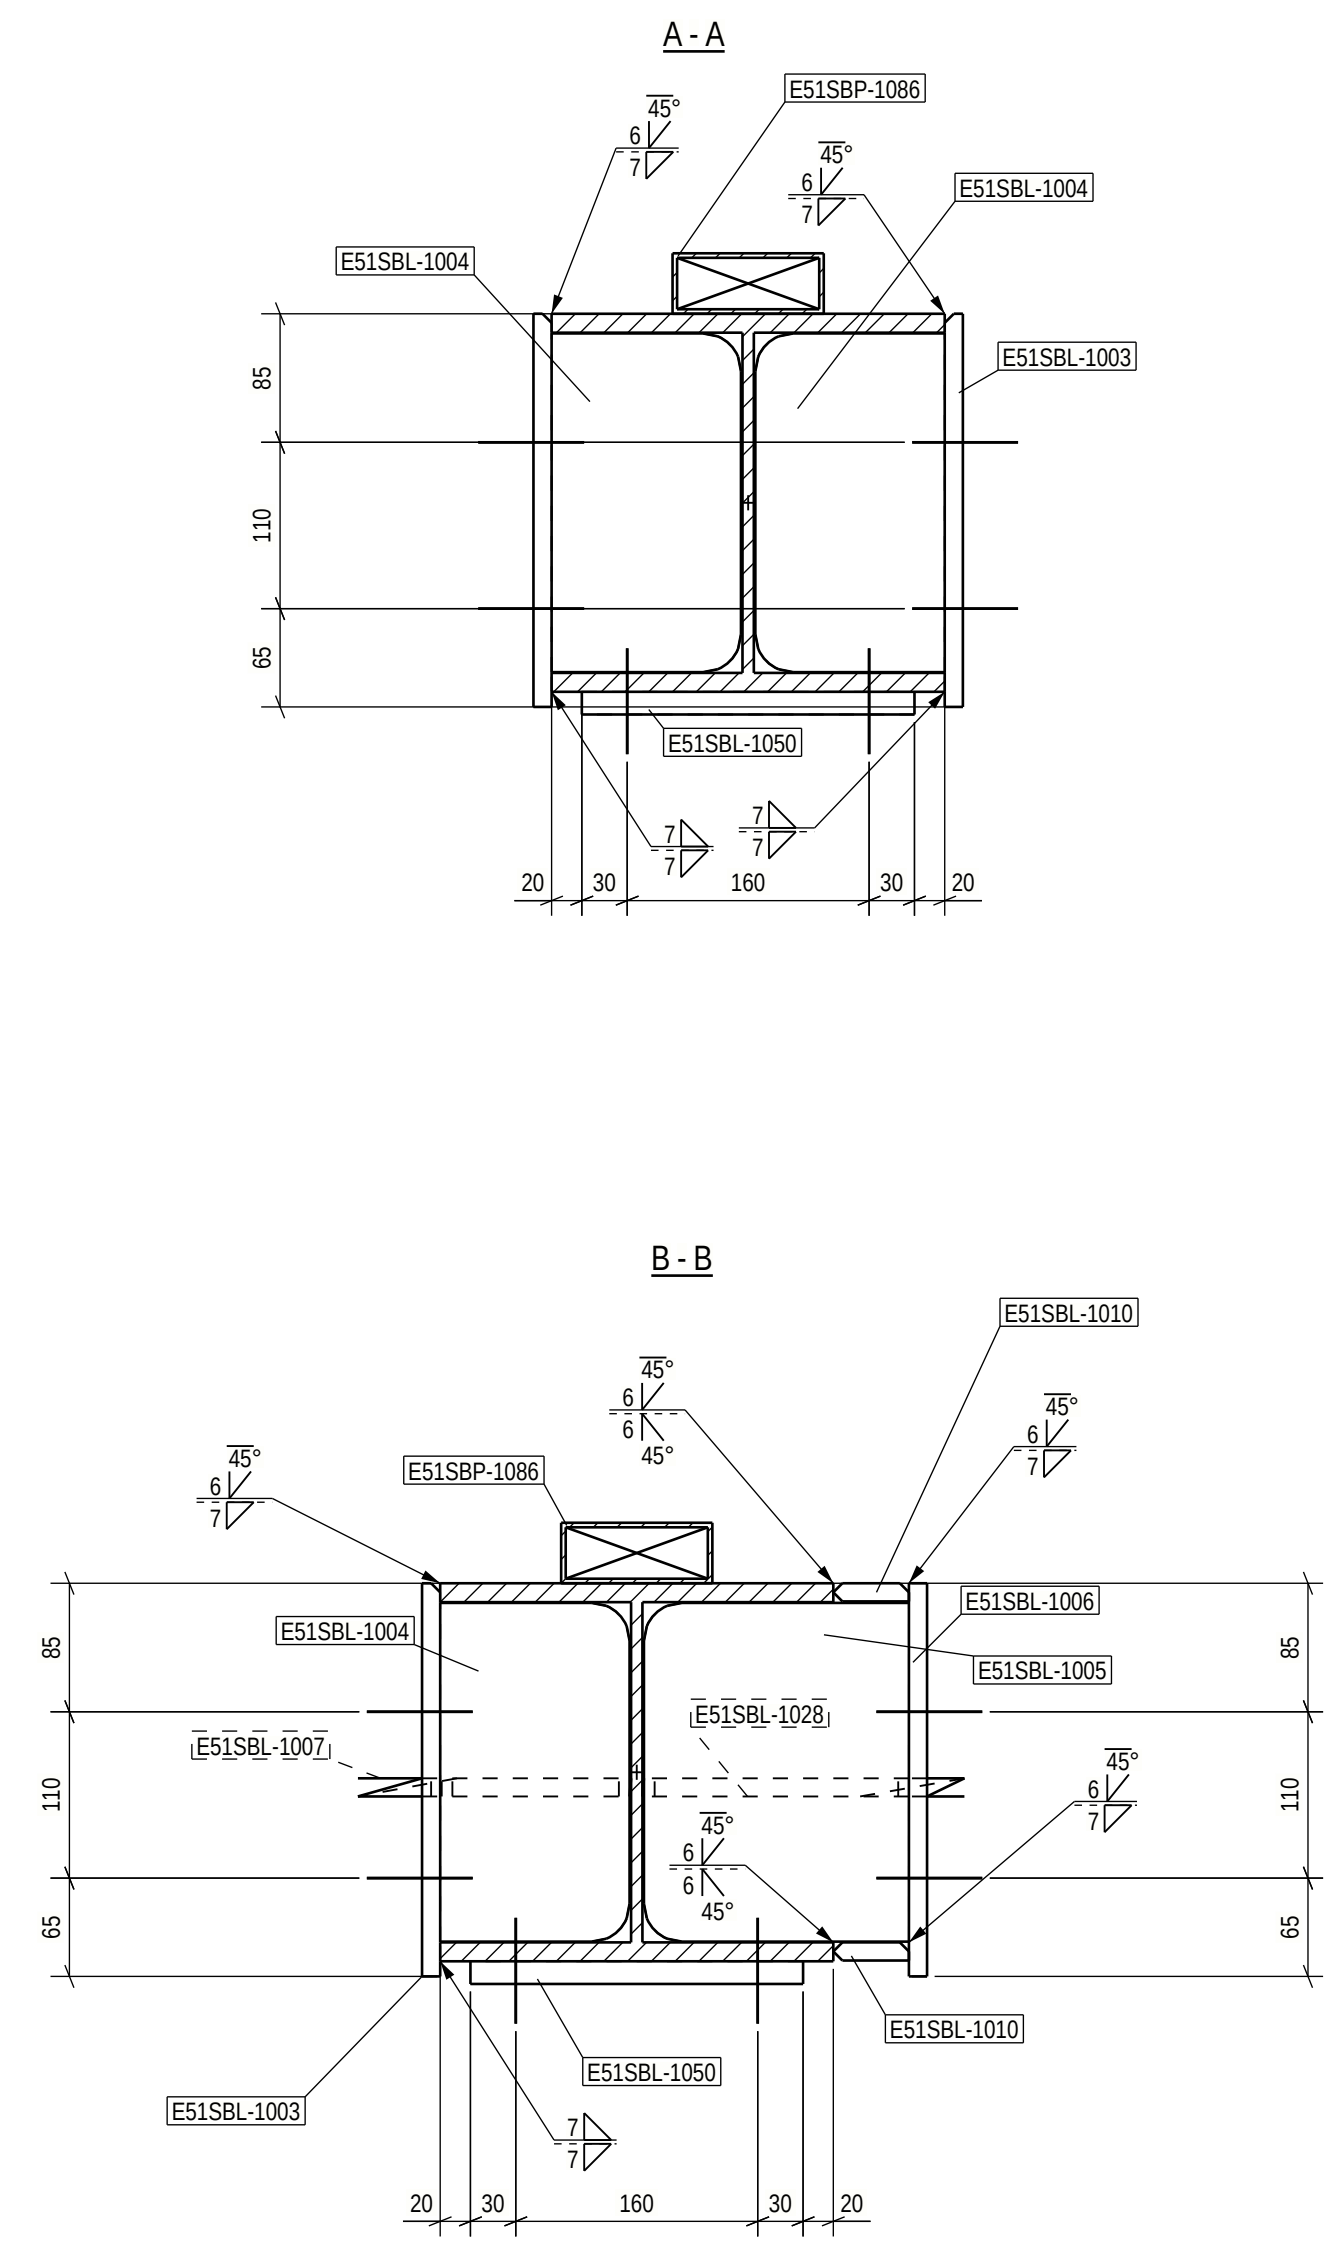


Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN 1090-2, table A3 : EXC2 Execution Specification document or 20193445-CC250-0600-0600-000005 ISO6901-3, grade PR2 ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 2042 Welding of Gal 24 (Granitine Gray) Appendix 1 / Project specific Welds, first specified inspection EN 9692-1, EN 9692-2	Fabrication instructions EN 1090-2, Appendix B Special fabrication instructions <u>Project specifications/ shown on dwg.</u> Welds, first specified inspection EN 1090-2, Table 24, U>0.5 Steel of EN 10025 MT-EN1090-2, 20% of welds Exent of HT, not welds EN 100517840, 20% of welds Exent of HT, not in section on dwg EN 10051840, 100% of welds Requirements on rolling EN 9692-2 Section 6.6.3 Weld class EN C EN ISO 5817	EXC2 Additional material inspection Shown on dwg


SWECO 
Sustainable engineering and design


SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi




25019443_Fair_E500

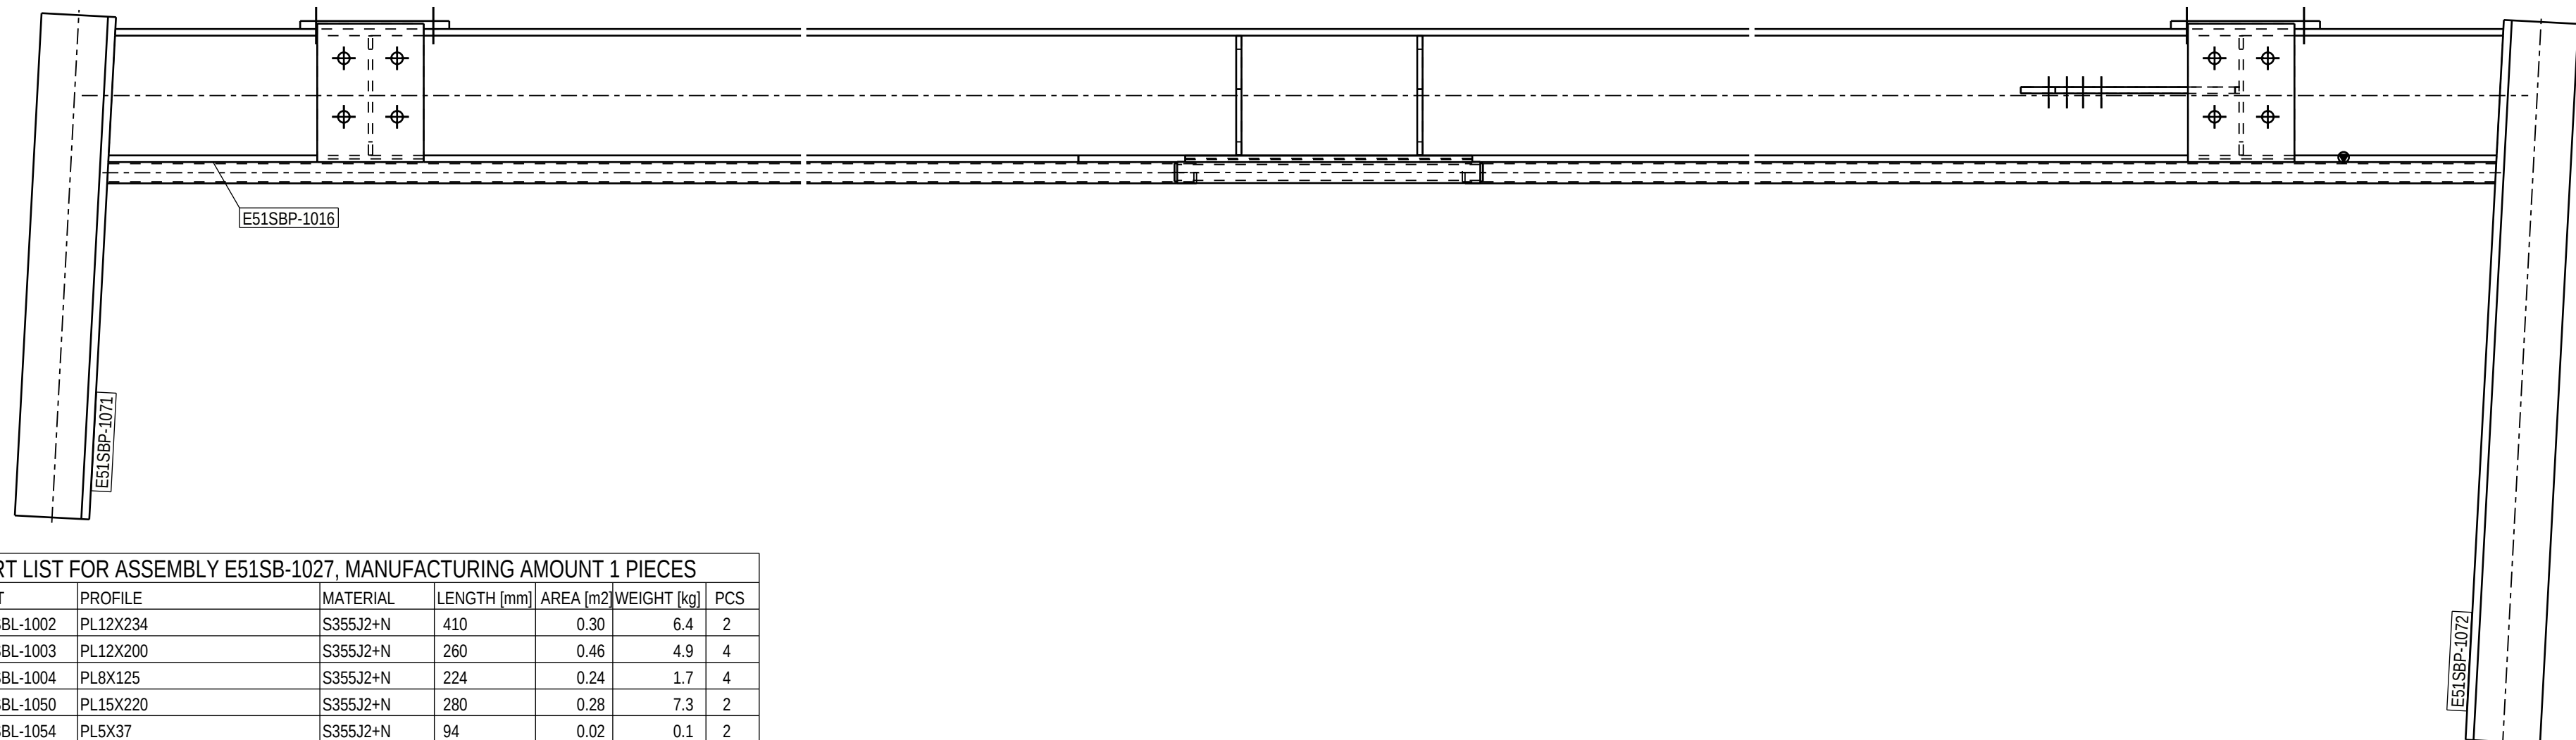

Technical fabrication requirements:		Execution class
Requirements for fabrication, including: EN1090-2, table A.3: EXC2 Execution Specification document: Z5019443-ICW250-0600-0660-000005 ISO8081-3, grade P2 Surface treatment ISO12944-5 Additional requirements or surface treatment C370, EPPUR 2402 EN17024 (Graphite Gray) Welding by butt or root arch Appendix 1 / Project spec. EN 9692-1, EN 9692-2		EXC2 Fabrication instructions EN 1090-2, Appendix B Special fabrication instructions Project specification/ shown on dwg. Weld inspection: in accordance EN 1090-2: Table 2.4, U+0.5 Extent of RT, if needed EN11220, 20% of welds Extent of VT, if needed EN1090-2: Table 2.4, U+0.5 Extent of RT, if needed EN17024, 20% of welds Extent of RT, if needed EN17024, 100% of welds Weld inspection: in holding EN1090-2: Section 6.6.3 Weld class EN ISO 5817 Additional material inspection Shown on dwg

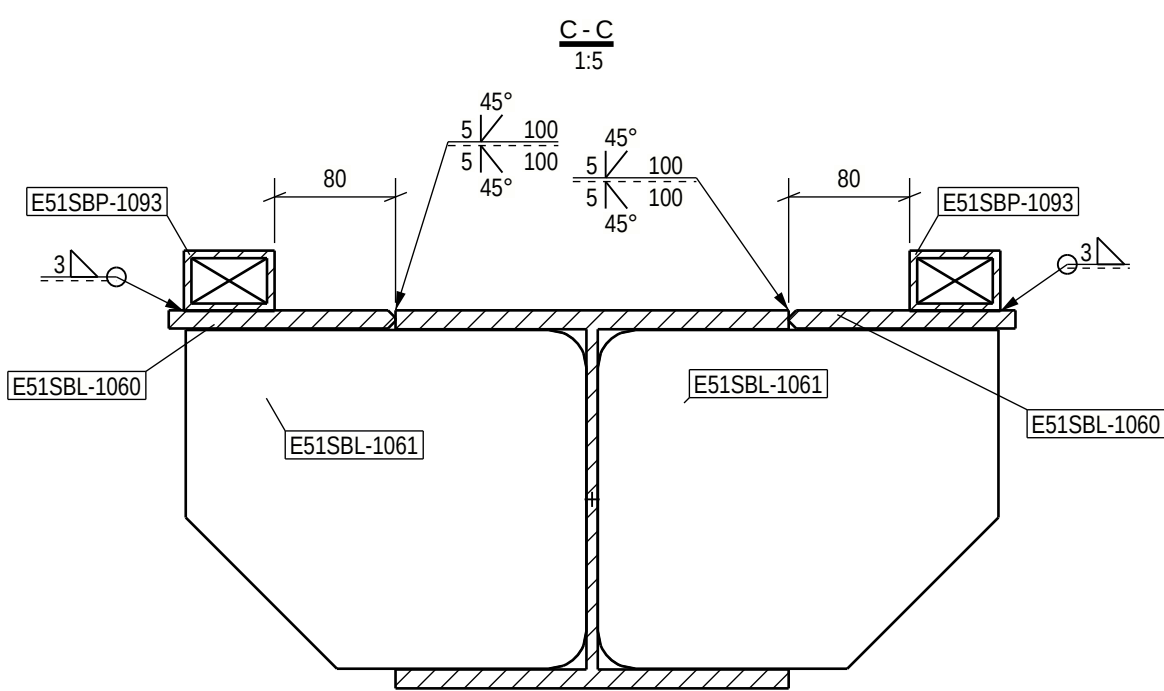

01		Roof bollard connection space added		FIALES		29.06.2026		FIKJER	
REV.		REVISION		CHANGED BY		DATE		CHECKED BY	
PROJECT NAME Easpring New Materials Oy FAIR Phase 1				 DRAWING CONTENT ASSEMBLY DRAWING Beam E51SB-1027					
 Sustainable engineering and design		SWECO RAKENNETEKNIikka OY ILMALAINPORTTI 2 00040 HELSINKI PUH. +358 20 393 000 www.sweco.fi		DATE 16.06.2026 DRAWN Alexy Serus PROJECT NUMBER E51S91443		ARCHIVING CODE PAGE DESIGNER Alexy Serus APPROVED Pertti Kalliojärvi DWO NO E51SB-1027		DESIGN GROUP STR CHECKED Jene Kalliojärvi REVISION 01	

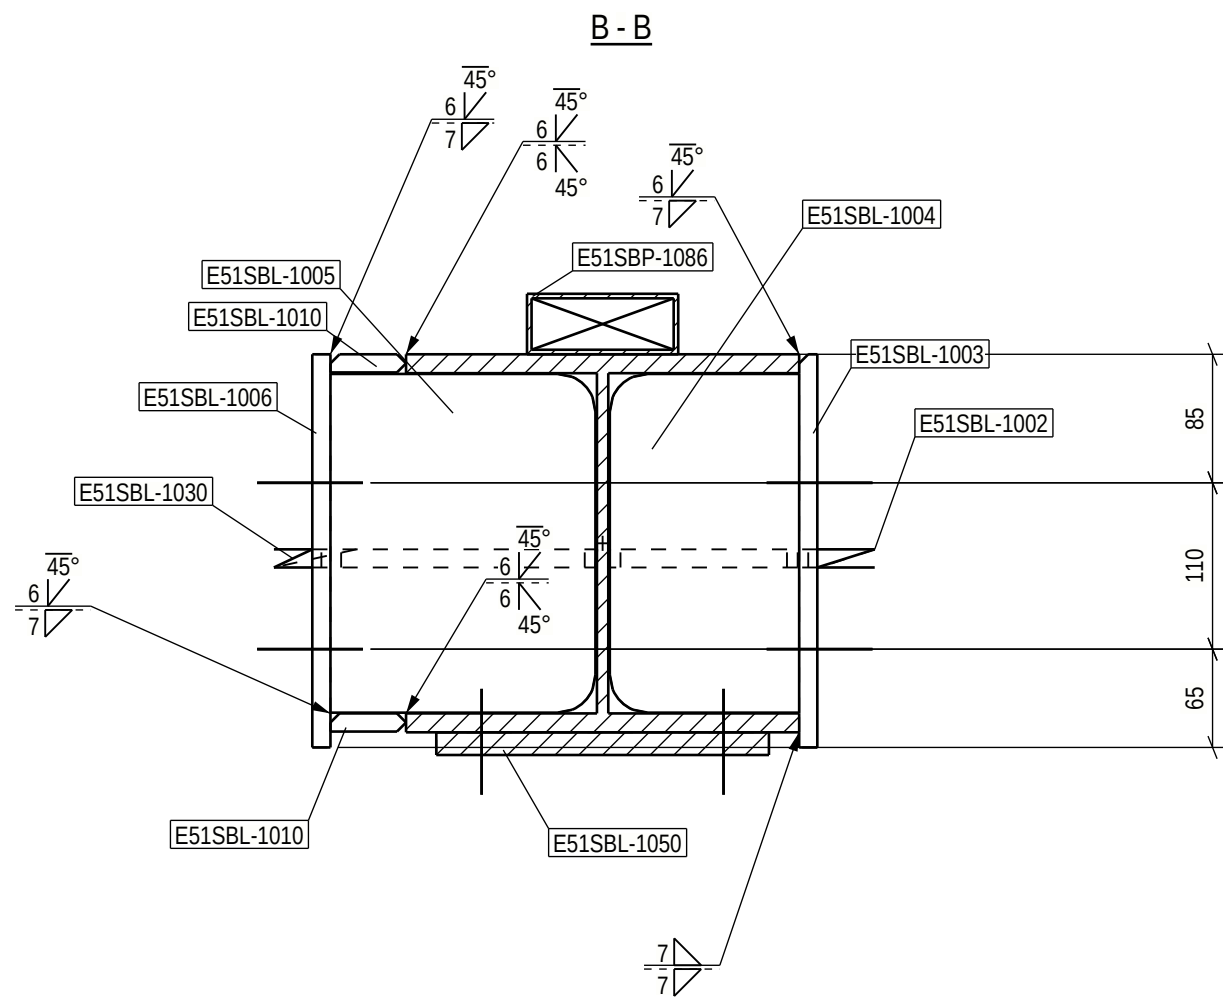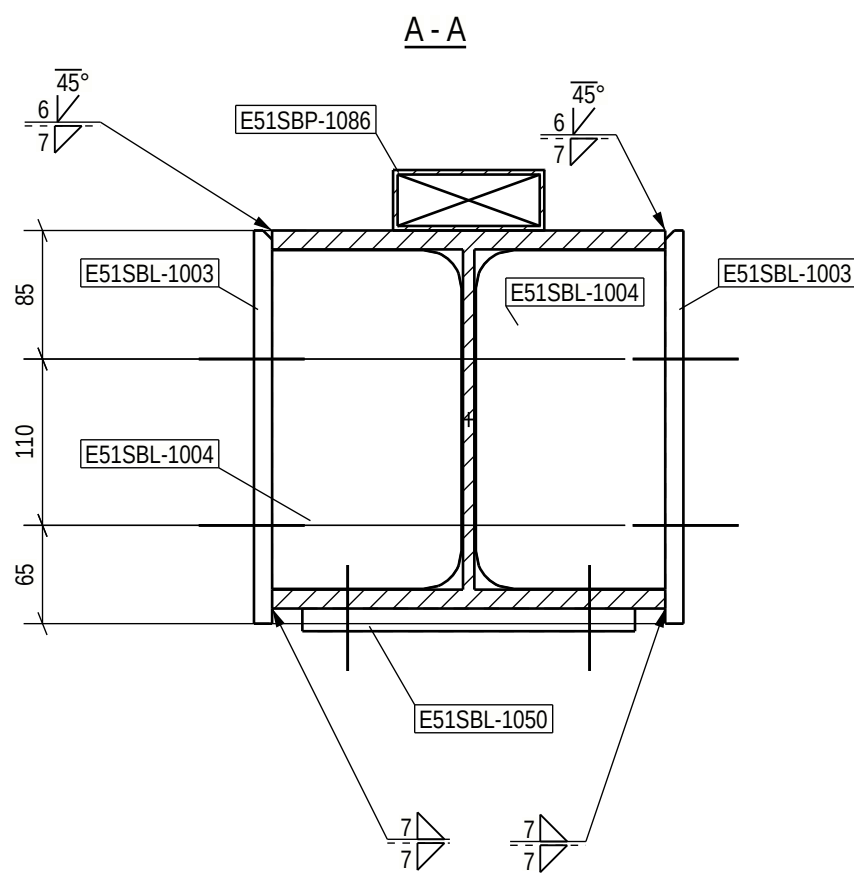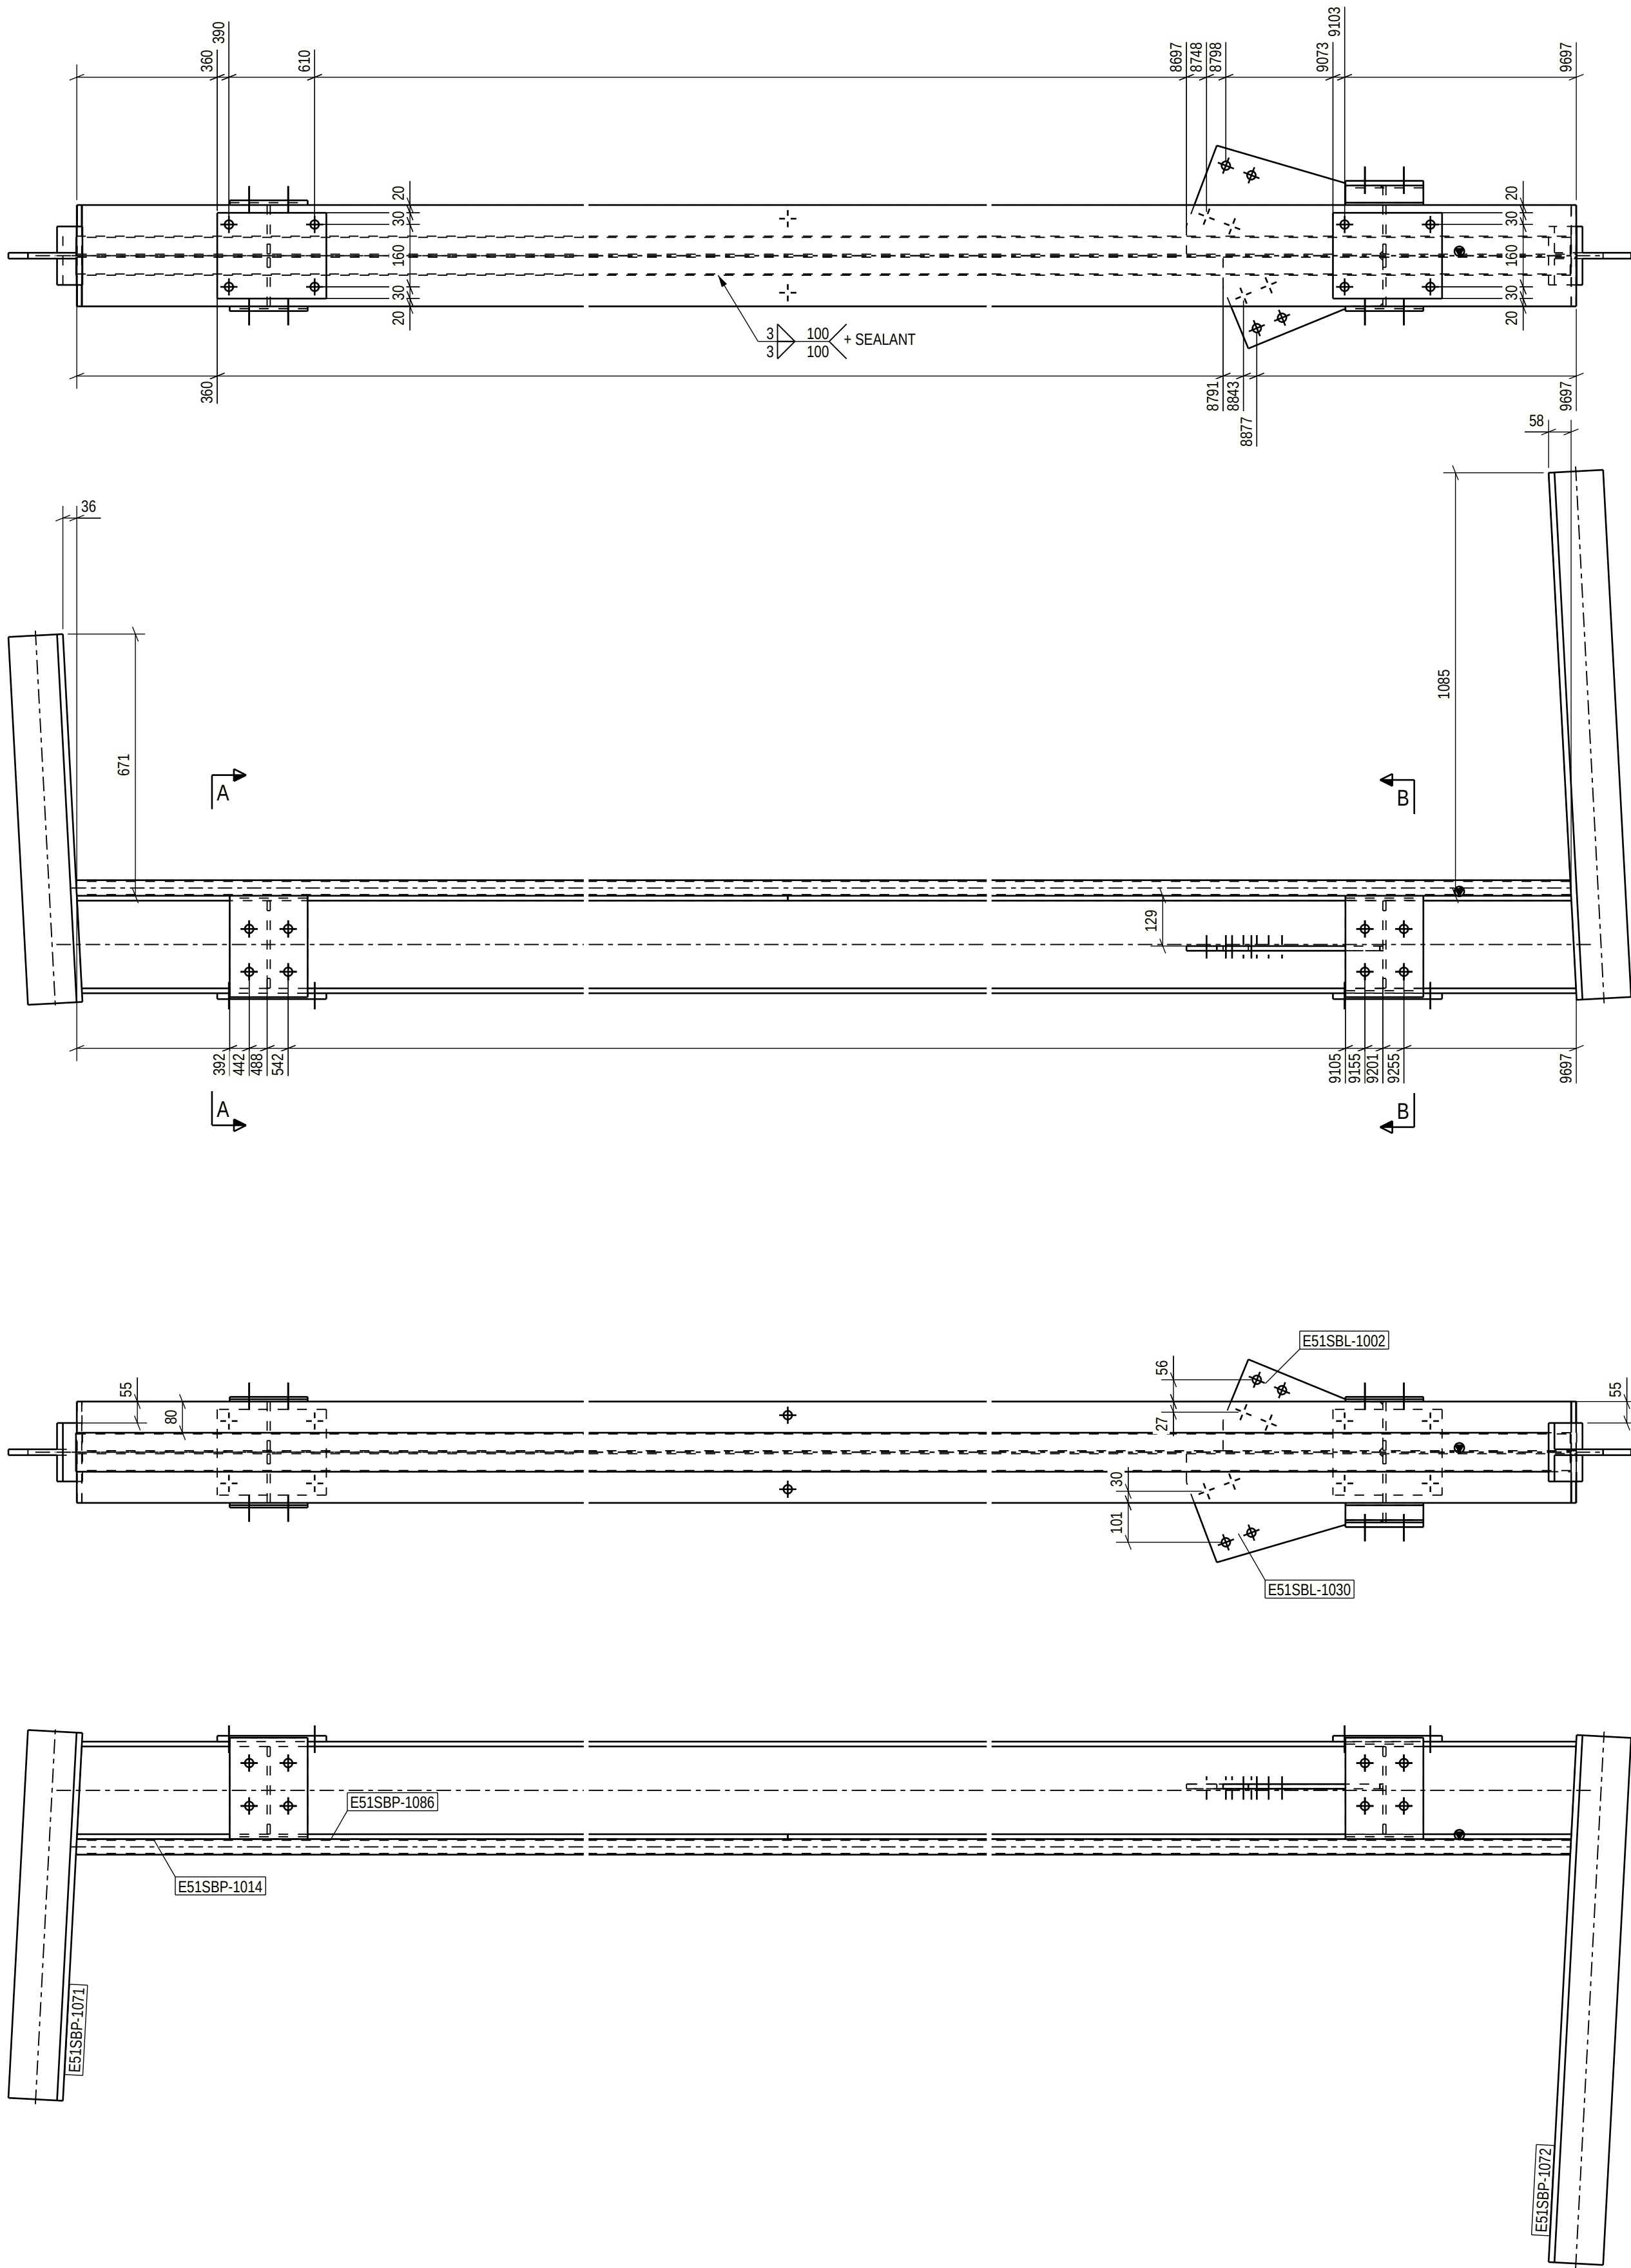

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

Technical fabrication requirements:		Execution class
Requirements for fabrication, standard		EXC2
EN1090-2, table A3: EXC2	Fabrication tolerances	EN 1090-2, Appendix B
Execution Specification document nr. 25019443-1CC250-0600-0660-000005	Special fabrication tolerances	Project specification/ shown on drwg.
ISO8501-3, grade P2	Weld inspection requirements	EN 1090-2, Table 24, U>0.5
Surface treatment	Extent of NDT, after welds	MT-EN1290, 20% of welds
ISO12944-5	Additional requirements on surface treatment	UT, EN-ISO17640, 20% of welds
C3.07, EPPUR 240/2	Extent of NDT, full welds	UT, EN-ISO17640, 100% of welds
RAL 7024 (Graphite Gray)	Requirements on testing	EN1090-2 Section 6.6.3
Appendix 1 / Project spec.	Weld class	C, EN ISO 5817
Welds, first specified otherwise	Additional material inspection	Shown on drwg
EN 9692-1, EN 9692-2		


PROJECT NAME		DRAWING CONTENT	
Easpring New Materials Oy		ASSEMBLY DRAWING	
FAIR Phase 1		Beam	
		E51SB-1028	
DATE		ARCHIVING CODE	PAGE
16.06.2026			
DESIGNER		APPROVED	CHECKED
Aleksy Serous		Pertti Kivimäenaho	Jere Kalliosalmi
PROJECT NUMBER		DESIGN NO.	REVISION
25019443			
E51SB-1028			




SWECO RAKENNETEKNIKKA OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
WWW.SWECO.FI


Sustainable engineering and design

25019443_Fair_E500

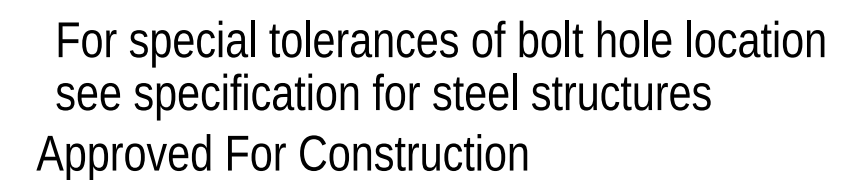


01		Roof bollard connection space added		FAILES	29.06.2026	FIKJER
REV.		REVISION		CHANGED BY		DATE
PROJECT NAME				DRAWING CONTENT		
Easpring New Materials Oy				ASSEMBLY DRAWING		
FAIR Phase 1				Beam		
				E51SB-1029		
 Sustainable engineering and design		SWECO RAKENNETEKNIikka OY		DATE		DESIGN GROUP
		ILMALANPORTTI 2		16.06.2026		
		00240 HELSINKI		ARCHIVING CODE		
		PUH. +358 207 393 000		DRAWN		PAGE
		www.sweco.fi		ALEXEY SEROUS		
				DESIGNER		
				PROJECT NUMBER		REVISION
				25019443		
				DWG. NO.		
				APPROVED		CHECKED
				PERTTI KOIVUMAAHANAHO		
				JERE KALLIOSALMI		
				E51SB-1029		01

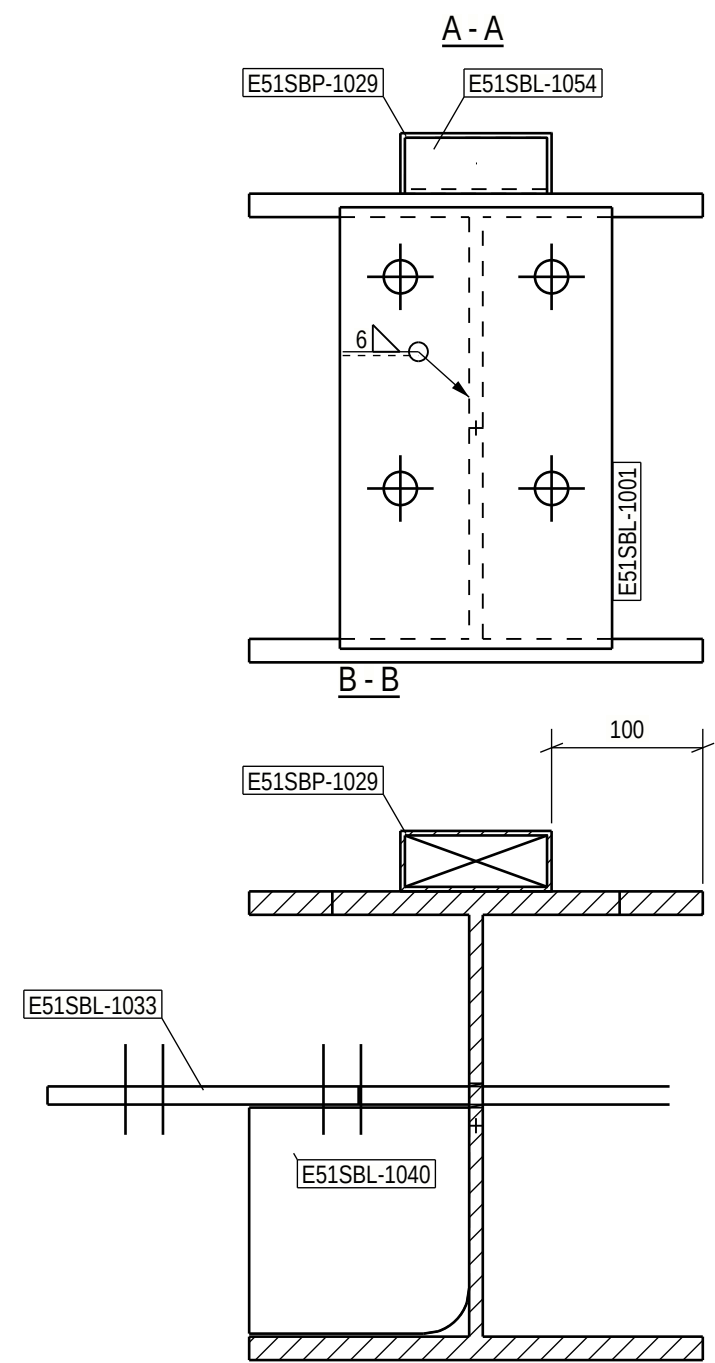

		Execution class	
Technical fabrication requirements:		EXC2	
Requirements for fabrication, standard		Fabrication tolerances	
EN1090-2, table A.3 : EXC2		EN 1090-2, Appendix B	
Execution Specification document nr		Special fabrication tolerances	
25019443-ICC250-0600-0660-000005		Project specification/ shown on drwg.	
Surface preparation grade		Weld inspection, requirements	
ISO8501-3, grade P2		EN 1090-2, Table 24, U>0.5	
Surface treatment		Extent of NDT, fillet welds	
ISO12944-5		MT-EN1290, 20% of welds	
Additional requirements on surface treatment		Extent of NDT, butt welds	
C3.07, EPPUR 240/2		UT, EN-ISO17640, 20% of welds	
Shade		Extent of NDT for splices not shown on drawing	
RAL 7024 (Graphite Gray)		UT, EN-ISO17640, 100% of welds	
Welding of built up steel section		Requirements on hinging	
Appendix 1 / Project spec.		EN1090-2 Section 6.6.3	
Welds, if not specified otherwise		Weld class	
EN 9692-1, EN 9692-2		C, EN ISO 5817	
		Additional material inspection	
		Shown on drwg.	

Approved For Construction

PROJECT NAME
Easpring New Materials O
FAIR Phase 1





DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51SB-1030		REVISION

SWECO 
Sustainable engineering and design

SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI

PUH. +358 207 393 000
www.sweco.fi

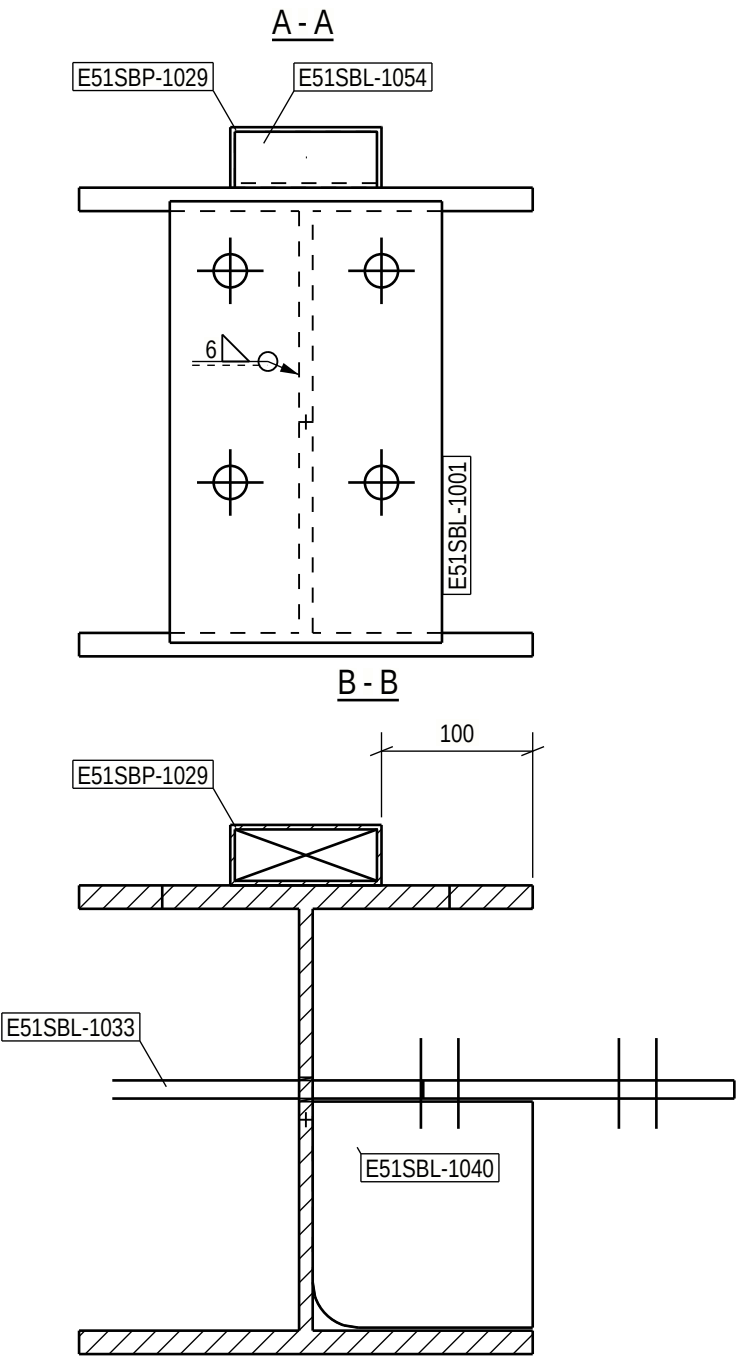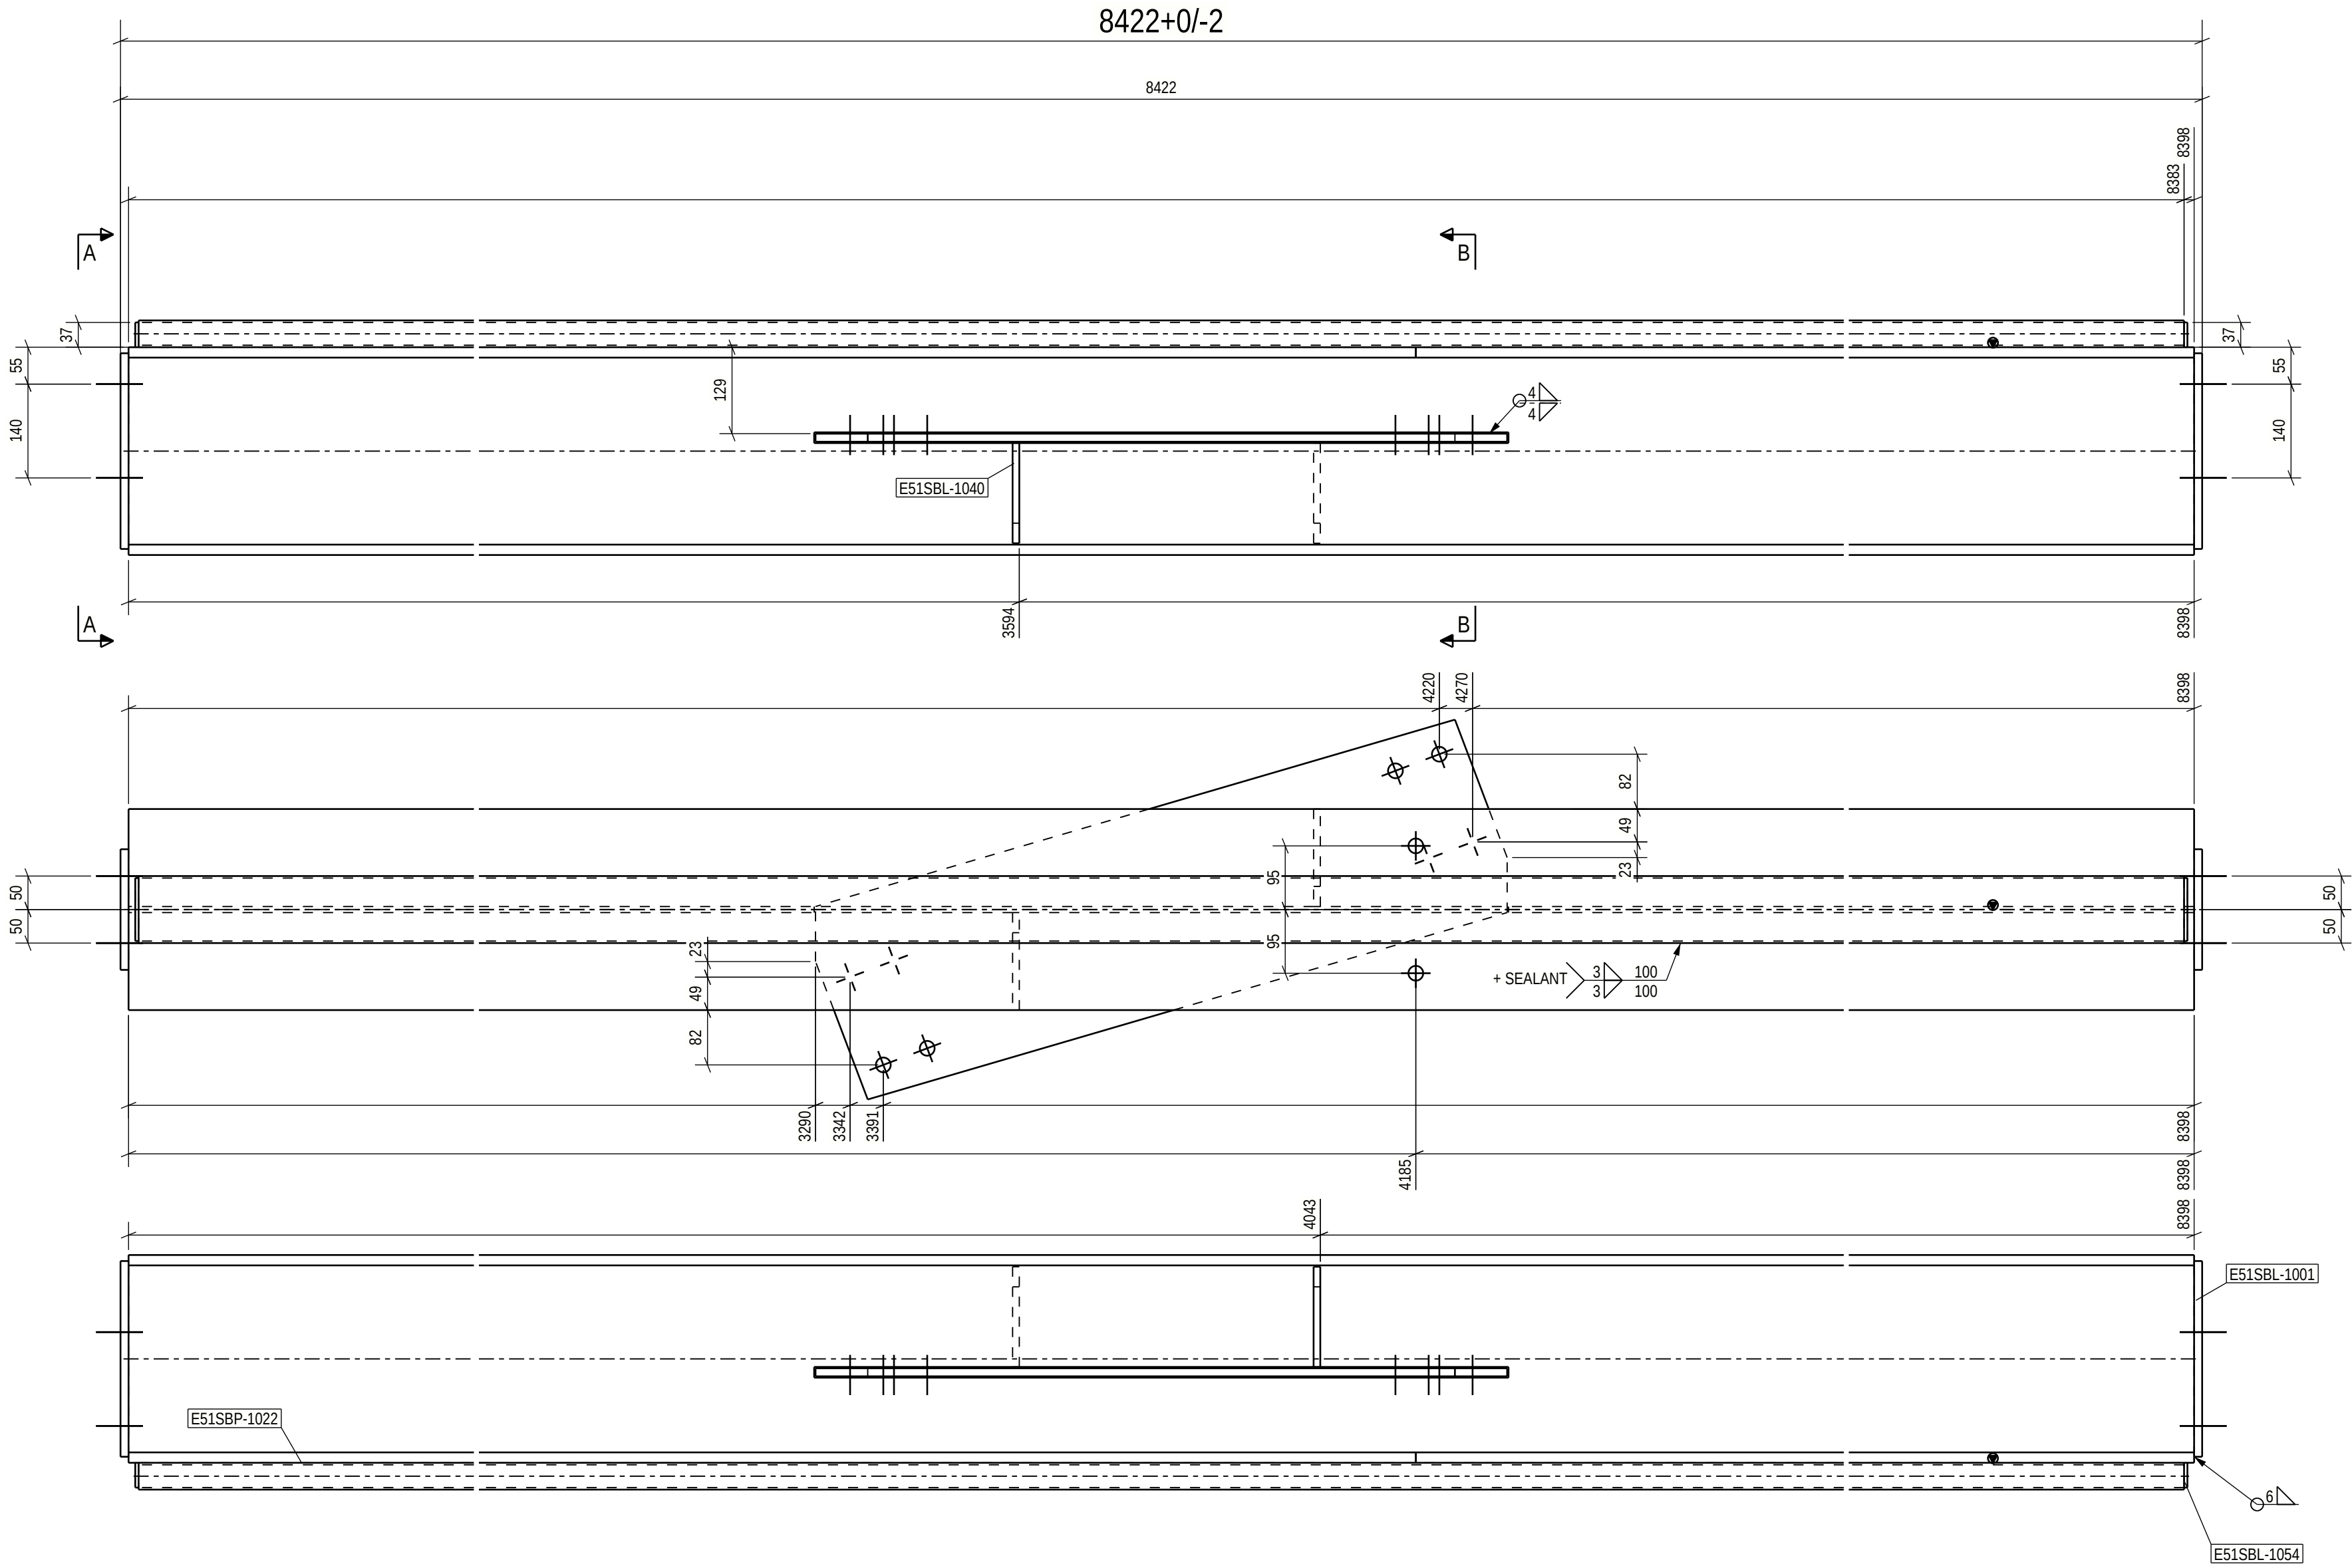

PART LIST FOR ASSEMBLY E51SB-1031, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51SBL-1001	PL12X180	S355J2+N	292	0.23	5.0	2
E51SBL-1033	PL12X298	S355J2+N	1034	0.64	28.5	1
E51SBL-1040	PL10X146	S355J2+N	150	0.10	1.7	2
E51SBL-1054	PL5X37	S355J2+N	94	0.02	0.1	2
E51SBP-1022	HEA320	S355J2	8398	14.75	820.1	1
E51SBP-1029	CFRHS100X40X3	S355J2H	8368	2.26	51.3	1
TOTAL:				17.99	913.5	


Technical fabrication requirements:		Execution class
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		EXC2
Execution Specification document nr 25019443-ICC250-0600-0660-000005		Fabrication tolerances EN 1090-2, Appendix B
Surface preparation grade ISO8501-3, grade P2		Special fabrication tolerances Project specification/ shown on drwg.
Surface treatment ISO12944-5		Weld inspection, requirements EN 1090-2, Table 24, U>0.5
Additional requirements on surface treatment C3.07, EPPUR 240/2		Extent of NDT, fillet welds MT-EN1290, 20% of welds
Shade RAL 7024 (Graphite Gray)		Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds
Welding of built up steel section Appendix 1 / Project spec.		Requirements on holing UT, EN-ISO17640, 100% of welds
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Requirements on holing EN1090-2 Section 6.6.3
		Weld class C, EN ISO 5817
		Additional material inspection Shown on drwg.

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi



DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51SB-1031

DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DRAWN	DESIGNER	APPROVED	CHECKED
Alexey Serous	Alexey Serous	Pertti Kivumaa	Jere Kallosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51SB-1031		




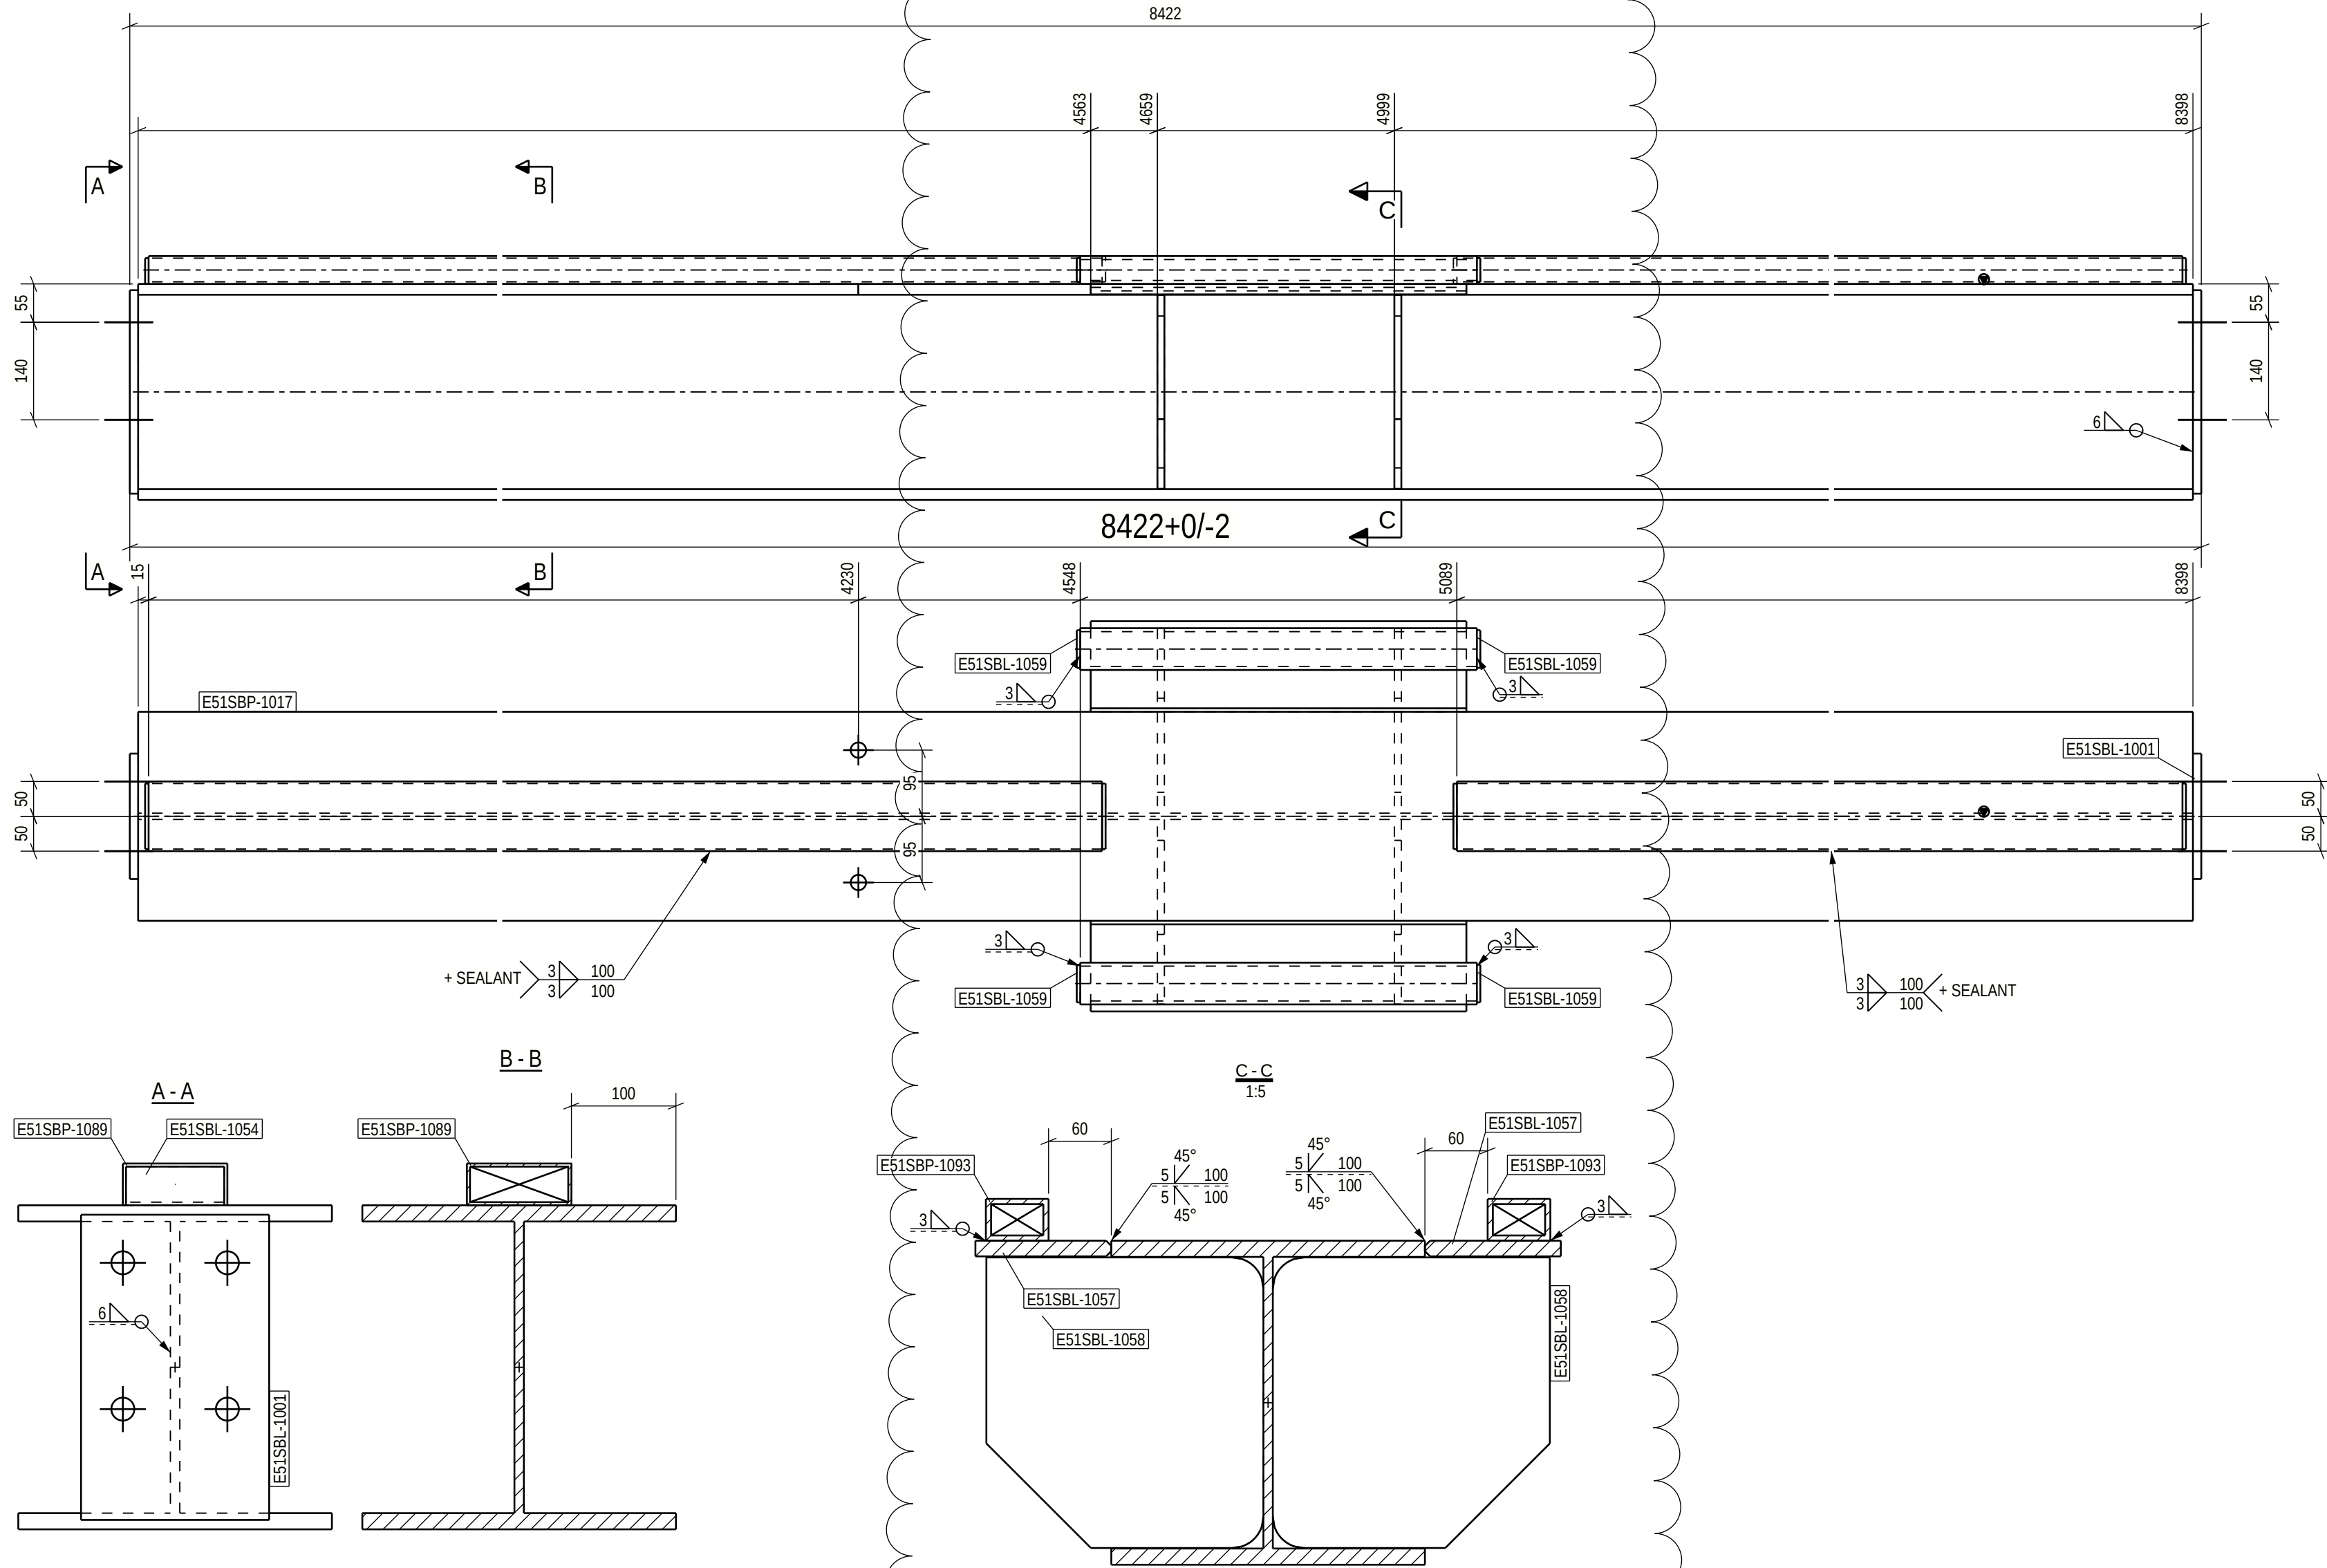


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PART LIST FOR ASSEMBLY E51SB-1032, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51SBL-1001	PL12X180	S355J2+N	292	0.23	5.0	2
E51SBL-1054	PL5X37	S355J2+N	94	0.03	0.1	4
E51SBL-1057	PL15X130	S355J2+N	539	0.31	8.1	2
E51SBL-1058	PL10X265	S355J2+N	278	0.59	5.4	4
E51SBL-1059	PL5X34	S355J2+N	54	0.02	0.1	4
E51SBP-1017	HEA320	S355J2	8398	14.75	820.1	1
E51SBP-1089	CFRHS100X40X3	S355J2H	4565	1.23	28.0	1
E51SBP-1091	CFRHS100X40X3	S355J2H	3294	0.89	20.2	1
E51SBP-1093	CFRHS60X40X5	S355J2H	569	0.21	3.1	2
TOTAL:				18.26	923.0	

Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2	Fabrication tolerances EN 1090-2, Appendix B	
Execution Specification document nr 25019443-ICC250-0600-0660-000005	Special fabrication tolerances Project specification/ shown on drwg.	
Surface preparation grade ISO8501-3, grade P2	Weld inspection, requirements EN 1090-2, Table 24, U>0.5	
Surface treatment ISO12944-5	Extent of NDT, fillet welds MT-EN1290, 20% of welds	
Additional requirements on surface treatment C3.07, EPPUR 240/2	UT, EN-ISO17640, 20% of welds	
Shade RAL 7024 (Graphite Gray)	Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds	
Welding of built up steel section Appendix 1 / Project spec.	Requirements on holing EN1090-2 Section 6.6.3	
Welds, if not specified otherwise EN 9692-1, EN 9692-2	Weld class C, EN ISO 5817	Additional material inspection Shown on drwg.

01	Roof bollard connection space added	FIALES	29.06.2026	FIKJER
REV.	REVISION	CHANGED BY	DATE	CHECKED BY
PROJECT NAME Easpring New Materials Oy FAIR Phase 1		DRAWING CONTENT ASSEMBLY DRAWING Beam E51SB-1032		
DATE 16.06.2026		ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous		DESIGNER Alexey Serous	APPROVED Pertti Koivumaa	CHECKED Jere Kallosalmi
PROJECT NUMBER 25019443		REVISION E51SB-1032 01		
SWECO Sustainable engineering and design		SWECO RAKENNTEKNIikka OY ILMALANPORTTI 2 00240 HELSINKI PUH. +358 207 393 000 www.sweco.fi		

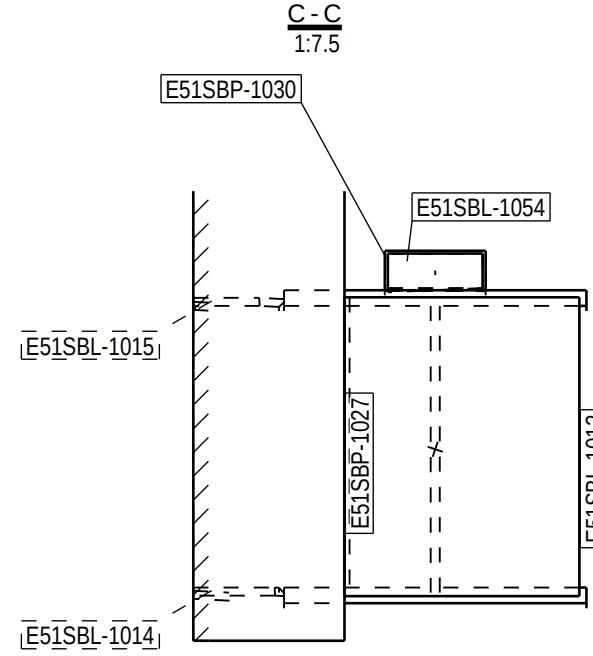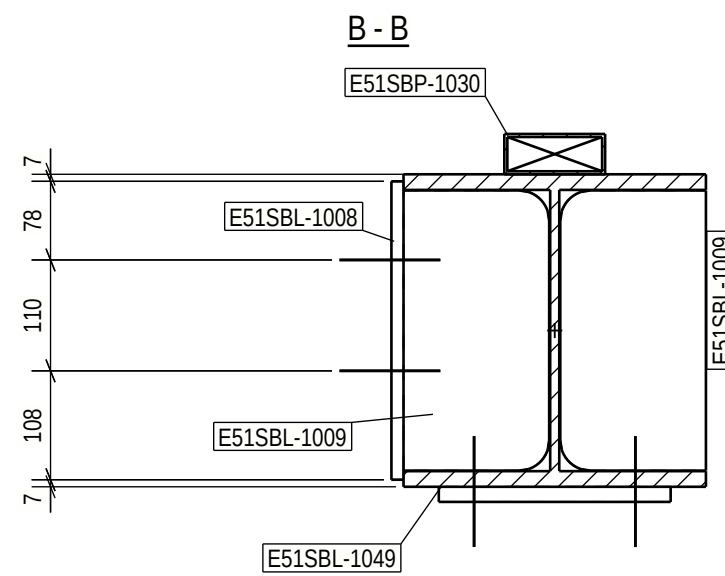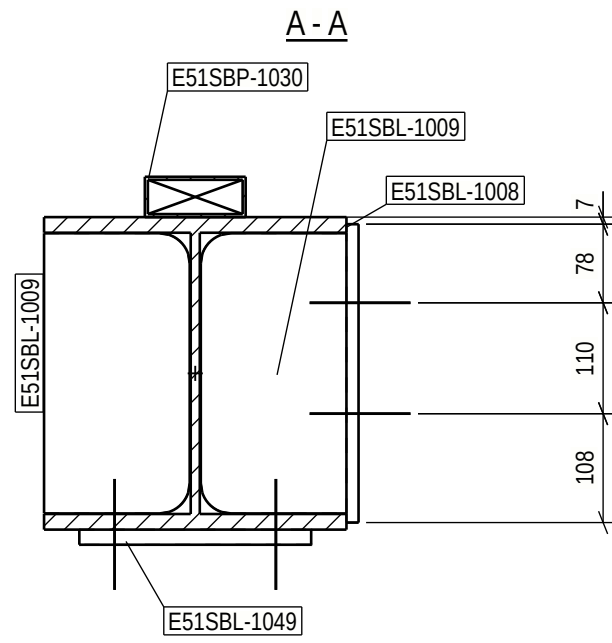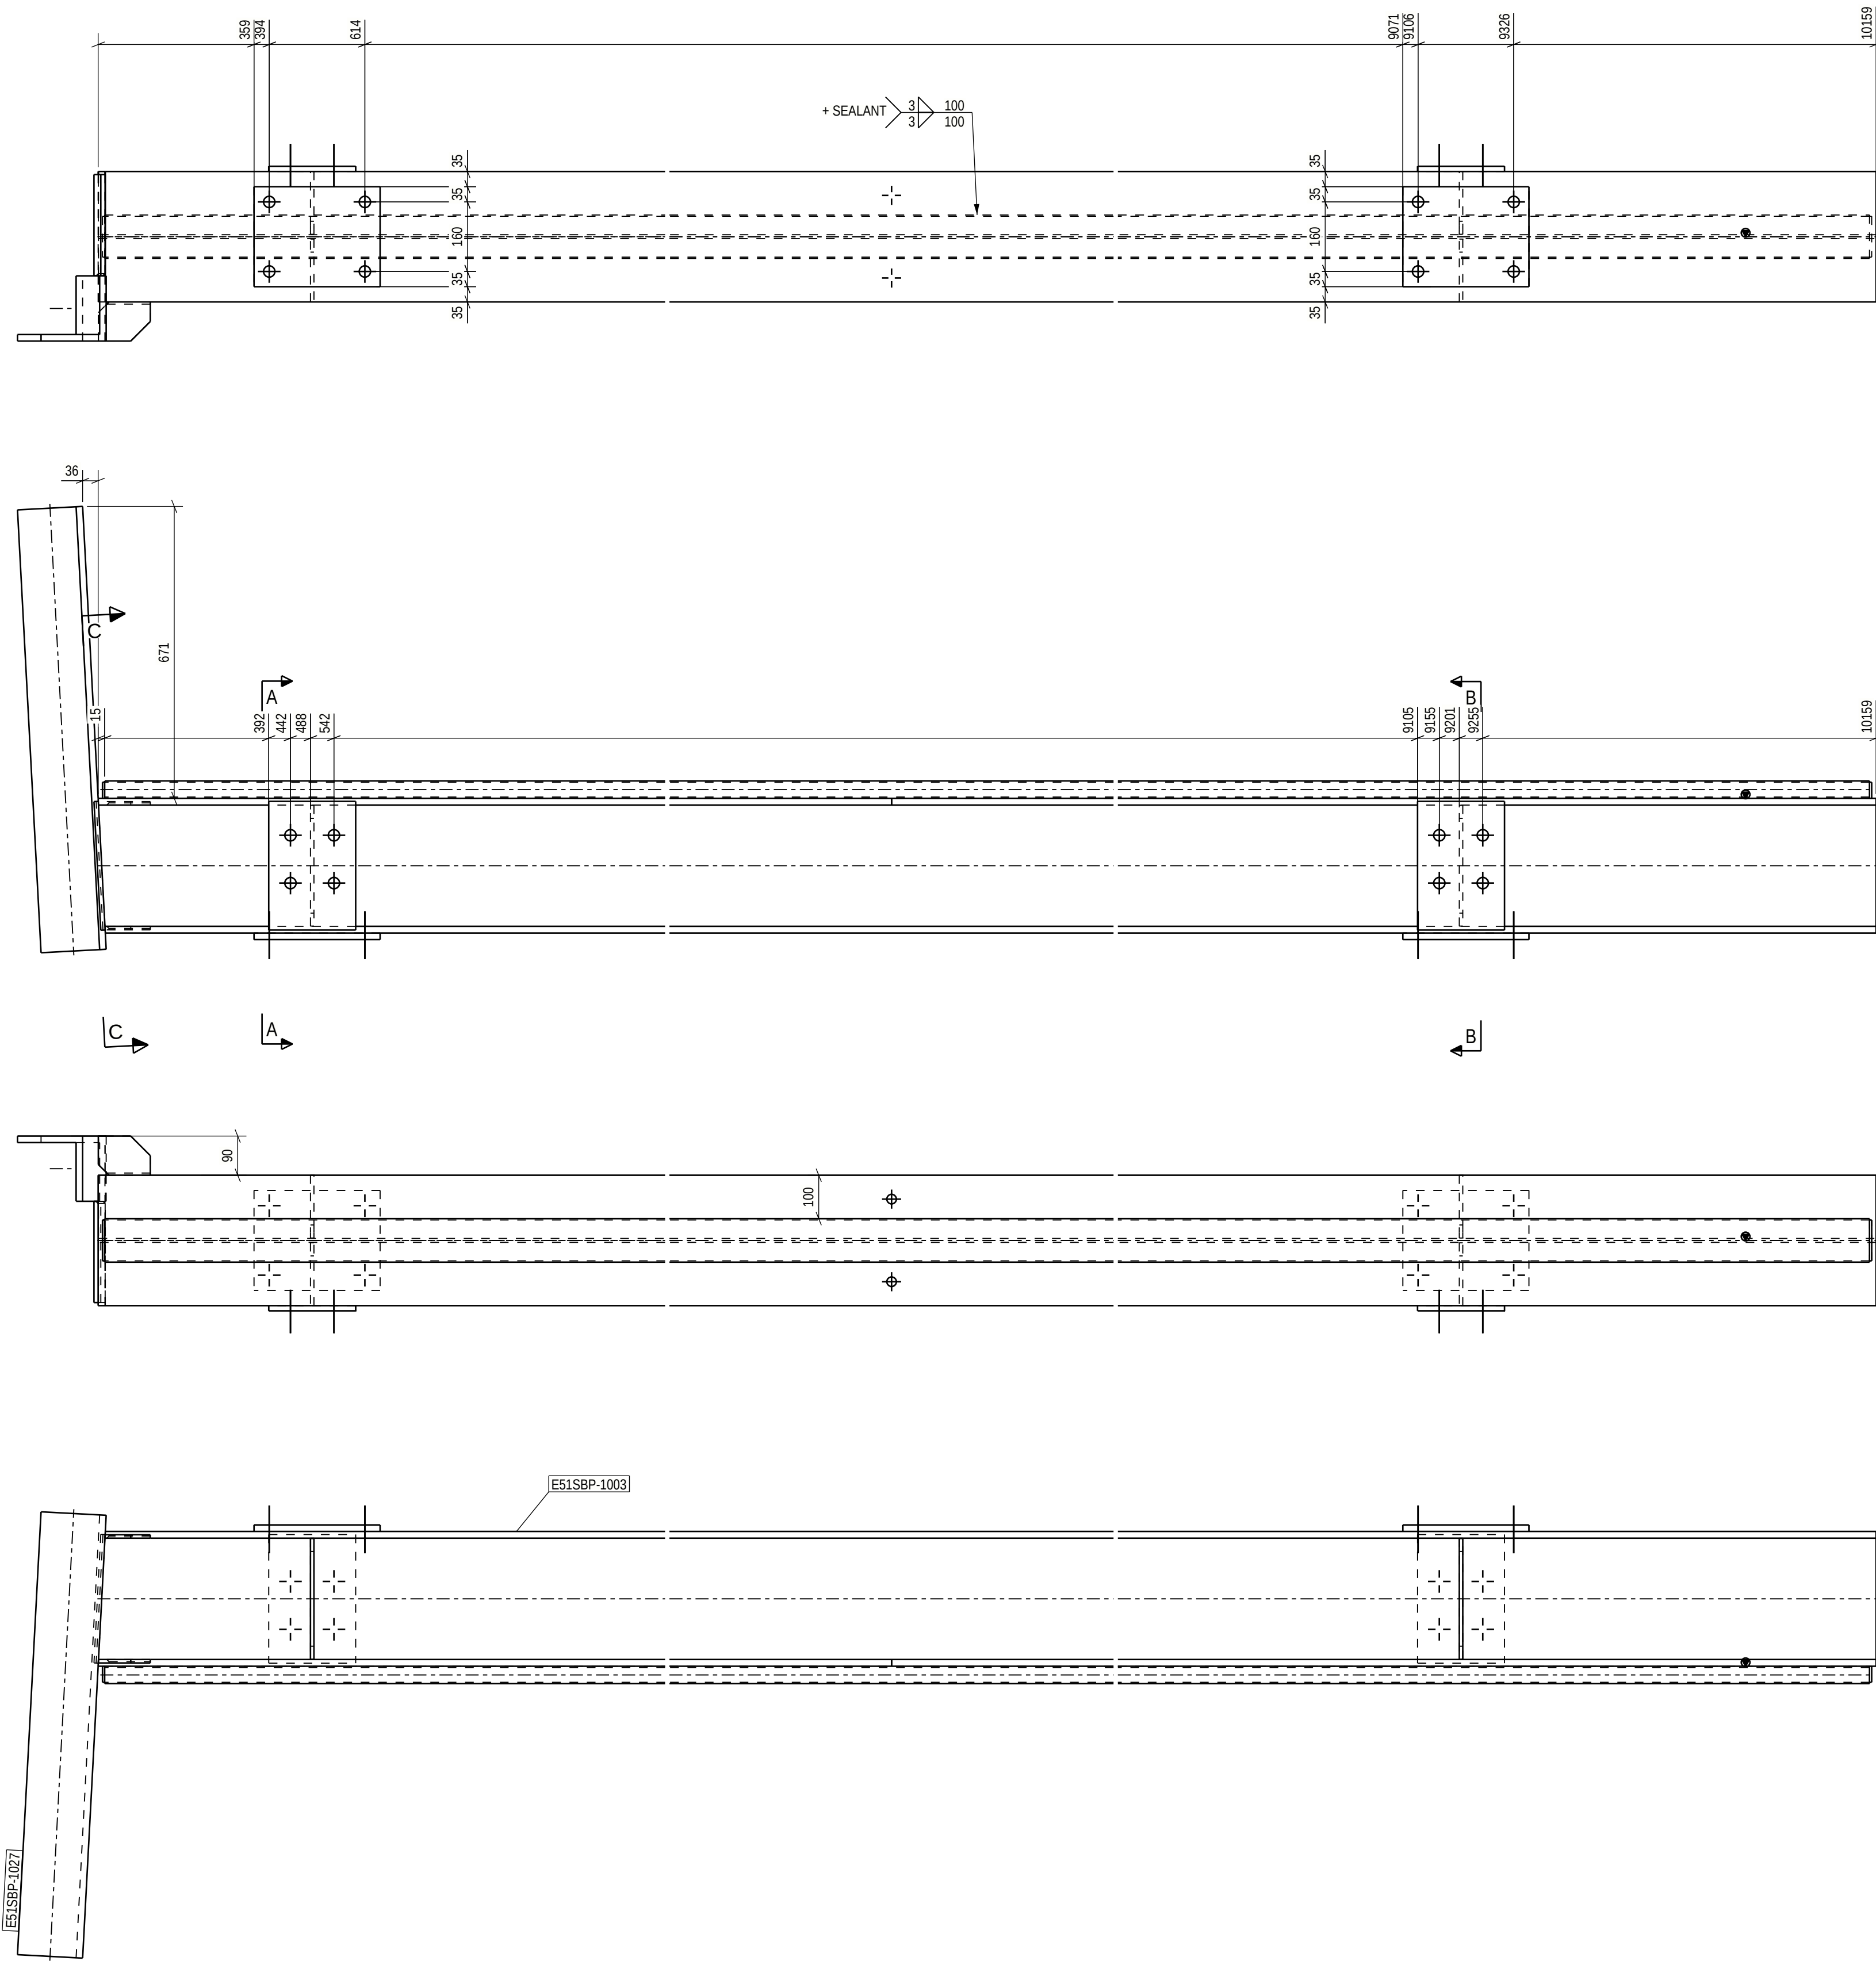

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1

DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51SB-1033



SWECO
Sustainable engineering and design

SWECO RAKENNETEKNIKKA OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
WWW.SWECO.FI

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DESIGNER Aleksy Serous	APPROVED Periti Kivimäenaho	CHECKED Jere Kallio	REVISION
PROJECT NUMBER 25019443	E51SB-1033		

PART LIST FOR ASSEMBLY E51SB-1033, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51SBL-1008	PL12X200	S355J2+N	296	0.26	5.6	2
E51SBL-1009	PL8X145	S355J2+N	278	0.34	2.5	4
E51SBL-1012	PL10X233	S355J2+N	296	0.15	5.4	1
E51SBL-1014	PL8X90	S355J2+N	104	0.02	0.5	1
E51SBL-1015	PL8X90	S355J2+N	120	0.02	0.6	1
E51SBL-1049	PL15X230	S355J2+N	290	0.30	7.9	2
E51SBL-1054	PL5X37	S355J2+N	94	0.02	0.1	2
E51SBP-1003	HEA320	S355J2	10159	17.84	992.1	1
E51SBP-1027	L150*15	S355J2	1020	0.60	34.4	1
E51SBP-1030	CFRHS100X40X3	S355J2H	10129	2.73	62.1	1
TOTAL:				22.28	1132.2	

Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard	EN 1090-2, Appendix B	
EN 1090-2, table A.3: EXC2	Special fabrication requirements	
Execution Specification document nr	25019443-ICC250-0600-0600-000005	
Project specification/ shown on drwg.	EN 1090-2, Table 24, U>0.5	
Surface preparation grade	ISO 8501-3, grade P2	
Weld inspection requirements	EN 1090-2, Table 24, U>0.5	
ISO 8501-3, grade P2	Extent of NDT, after welds	
Surface treatment	MT-EN12930, 20% of welds	
ISO12944-5	Extent of NDT, butt welds	
Additional requirements on surface treatment	UT, EN-ISO17640, 20% of welds	
C3.07, EPPUR 240/2	Extent of NDT for splices not shown on drawing	
RAL 7024 (Graphite Gray)	UT, EN-ISO17640, 100% of welds	
Welding of bulk up steel section	Requirements on testing	
Appendix 1 / Project spec.	EN1090-2 Section 6.6.3	
Welds, first specified elsewhere	Weld class	
EN 9692-1, EN 9692-2	C, EN ISO 5817	
Additional material inspection		Shown on drwg

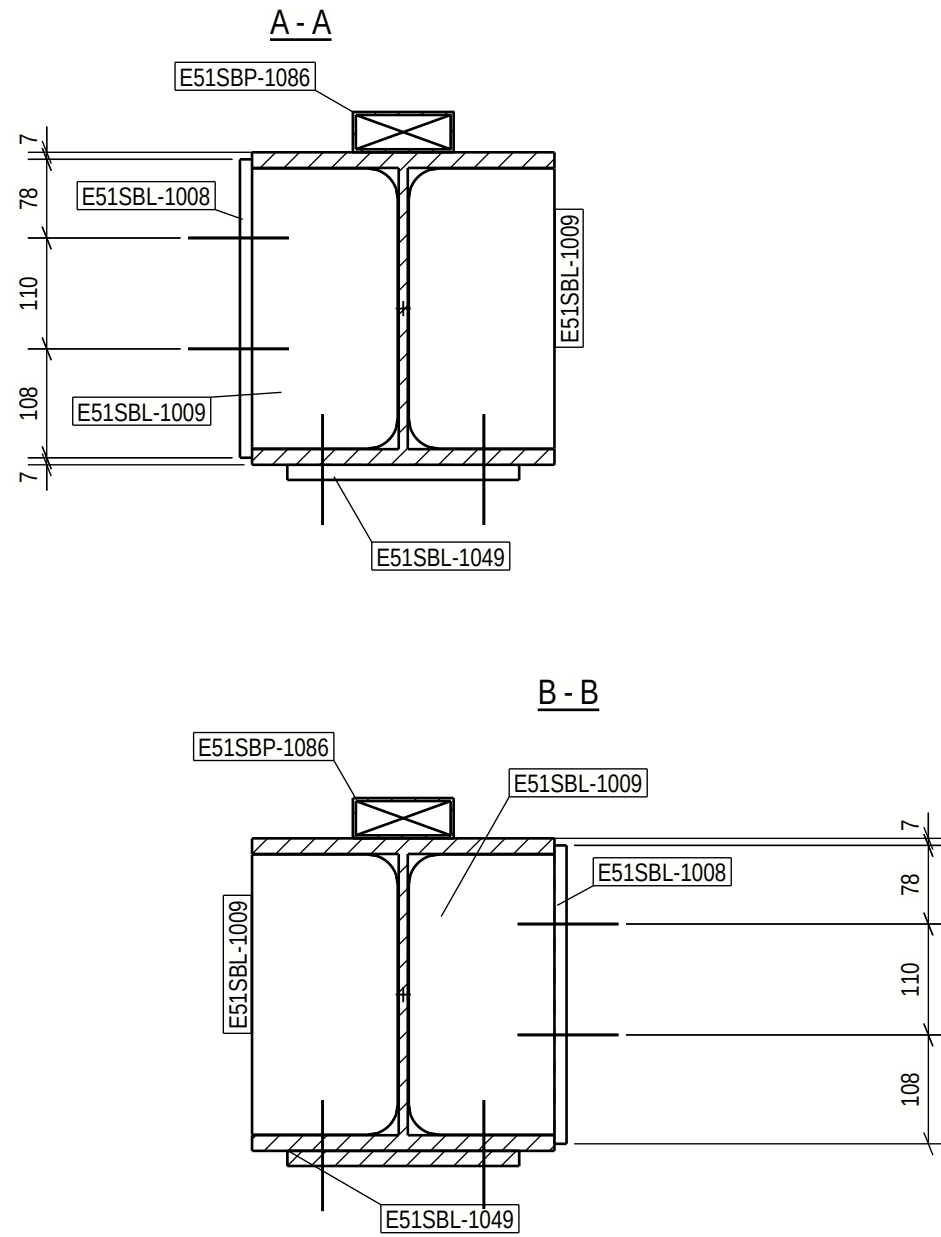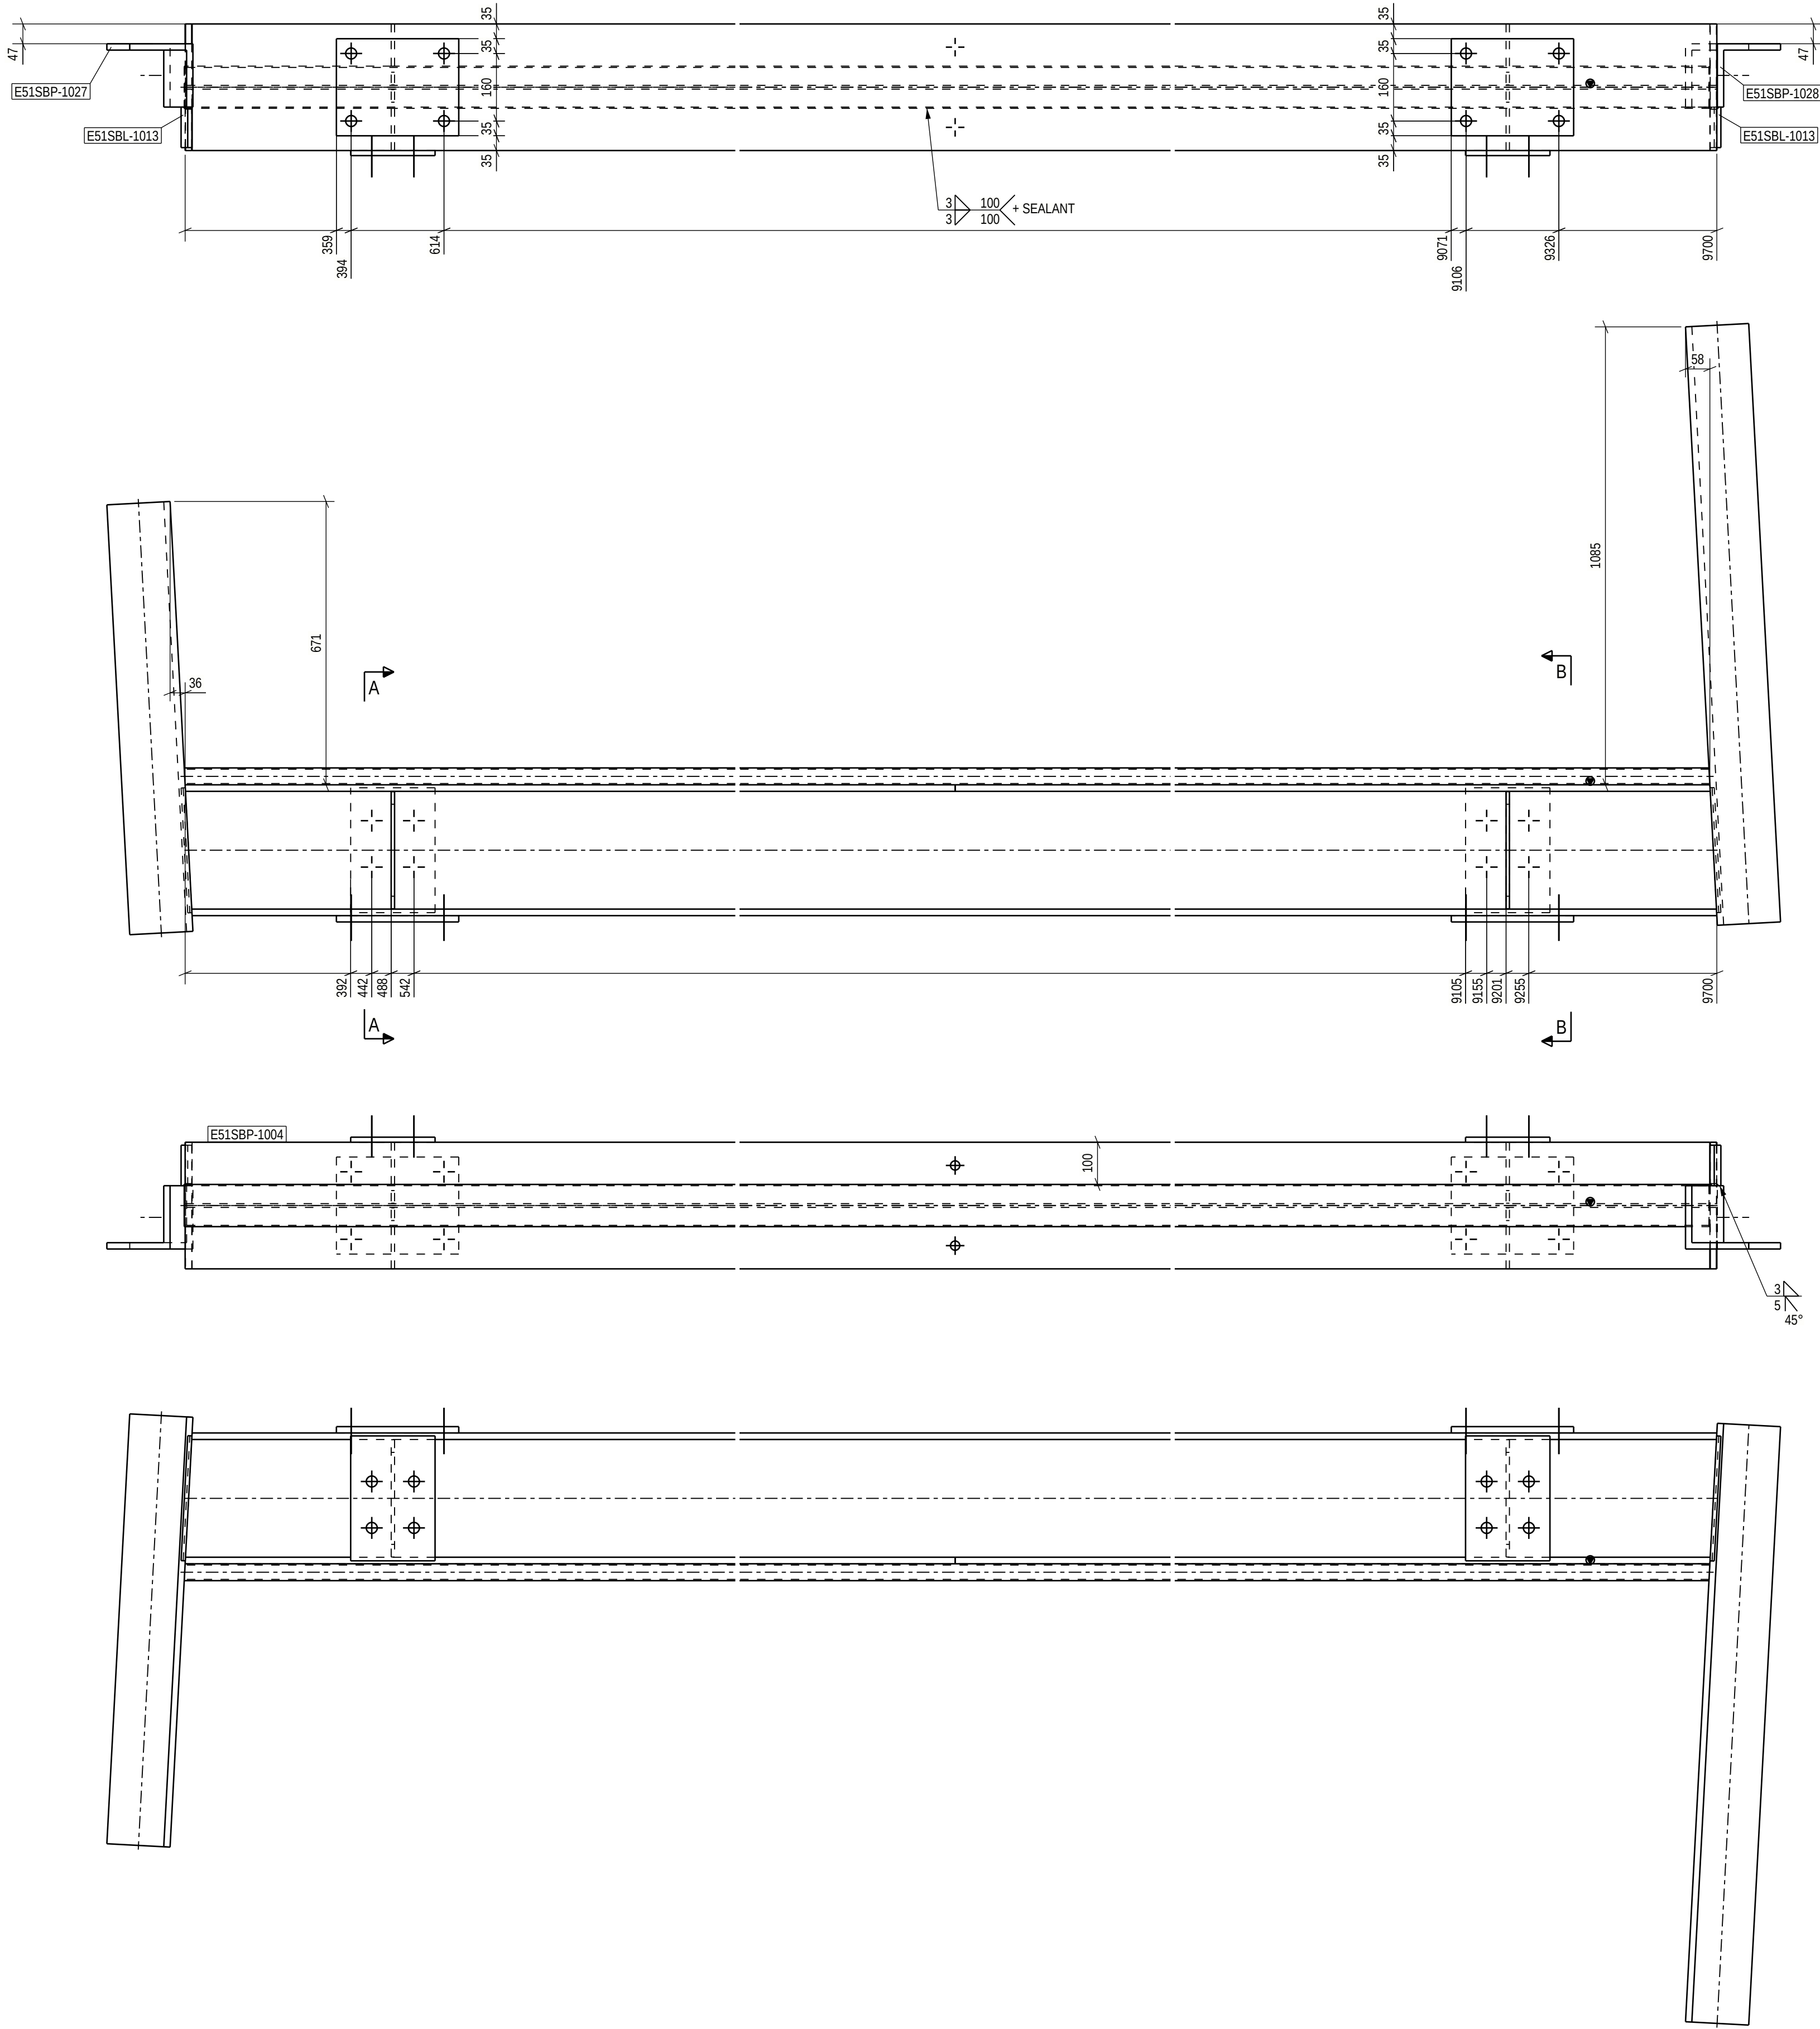

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction




PROJECT NAME Easpring New Materials Oy FAIR Phase 1				DRAWING CONTENT ASSEMBLY DRAWING Beam E51SB-1034			
 SWECO Sustainable engineering and design	SWECO RAKENNETEKNIKKI OY ILMALANPORTTI 2 00240 HELSINKI		DATE 16.06.2026		ARCHIVING CODE	PAGE	DESIGN GROUP STR
	TEKIJÄ Aleksy Serous		DESIGNER Aleksy Serous		APPROVED Periti Koluvaarahto		CHECKED Jere Kallioasamo
	PUH. +358 207 393 000 www.sweco.fi		PROJECT NUMBER 25019443		DWG. NO. E51SB-1034		REVISION



SWECO RAKENNETEKNIKKA OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
WWW.SWECO.FI

Technical fabrication requirements:		EXC2
Requirements for fabrication, standard EN1090-2, table A.3 - EXC2	Fabrication tolerances EN 1090-2, Appendix B	
Execution Specification document nr 25019443-ICC250-0600-0660-000005	Special fabrication tolerances Project specification/ shown on drwg.	
Surface preparation grade ISO8501-3, grade P2	Weld inspection requirements EN 1090-2, Table 24, U>0.5	
Surface treatment ISO12944-5	Extent of NDT, after welds MT-EN1290, 20% of welds	
Additional requirements on surface treatment RAL 7024 (Graphite Gray)	Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Welding of bulk up steel section Appendix 1 / Project spec.	UT, EN-ISO17640, 100% of welds	
Welds, first specified elsewhere EN 9692-1, EN 9692-2	Requirements on testing EN1090-2 Section 6.6.3	
	Weld class C, EN ISO 5817	Additional material inspection Shown on drwg.

PART LIST FOR ASSEMBLY E51SB-1034, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51SBL-1008	PL12X200	S355J2+N	296	0.26	5.6	2
E51SBL-1009	PL8X145	S355J2+N	278	0.34	2.5	4
E51SBL-1013	PL10X96	S355J2+N	296	0.13	2.2	2
E51SBL-1049	PL15X230	S355J2+N	290	0.30	7.9	2
E51SBP-1004	HEA320	S355J2	9700	17.03	947.3	1
E51SBP-1027	L150*15	S355J2	1020	0.60	34.4	1
E51SBP-1028	L150*15	S355J2	1420	0.83	47.9	1
E51SBP-1086	CFRHS100X40X3	S355J2H	9686	2.62	59.4	1
TOTAL:				22.11	1130.3	

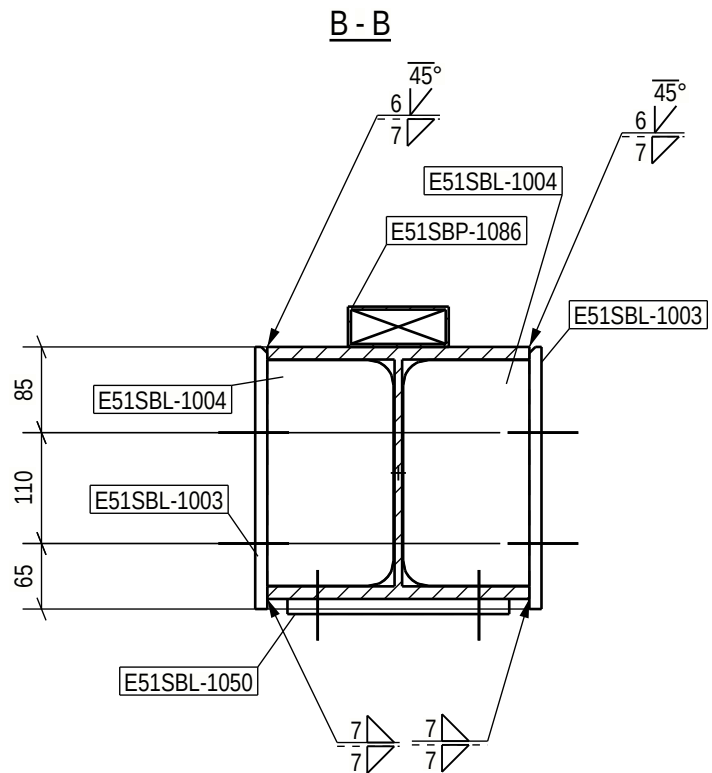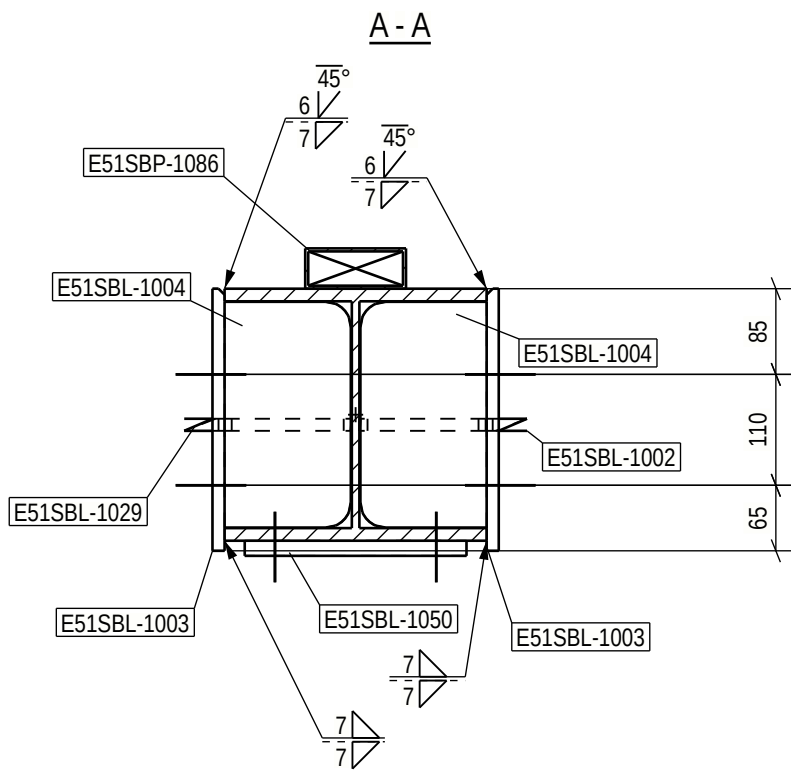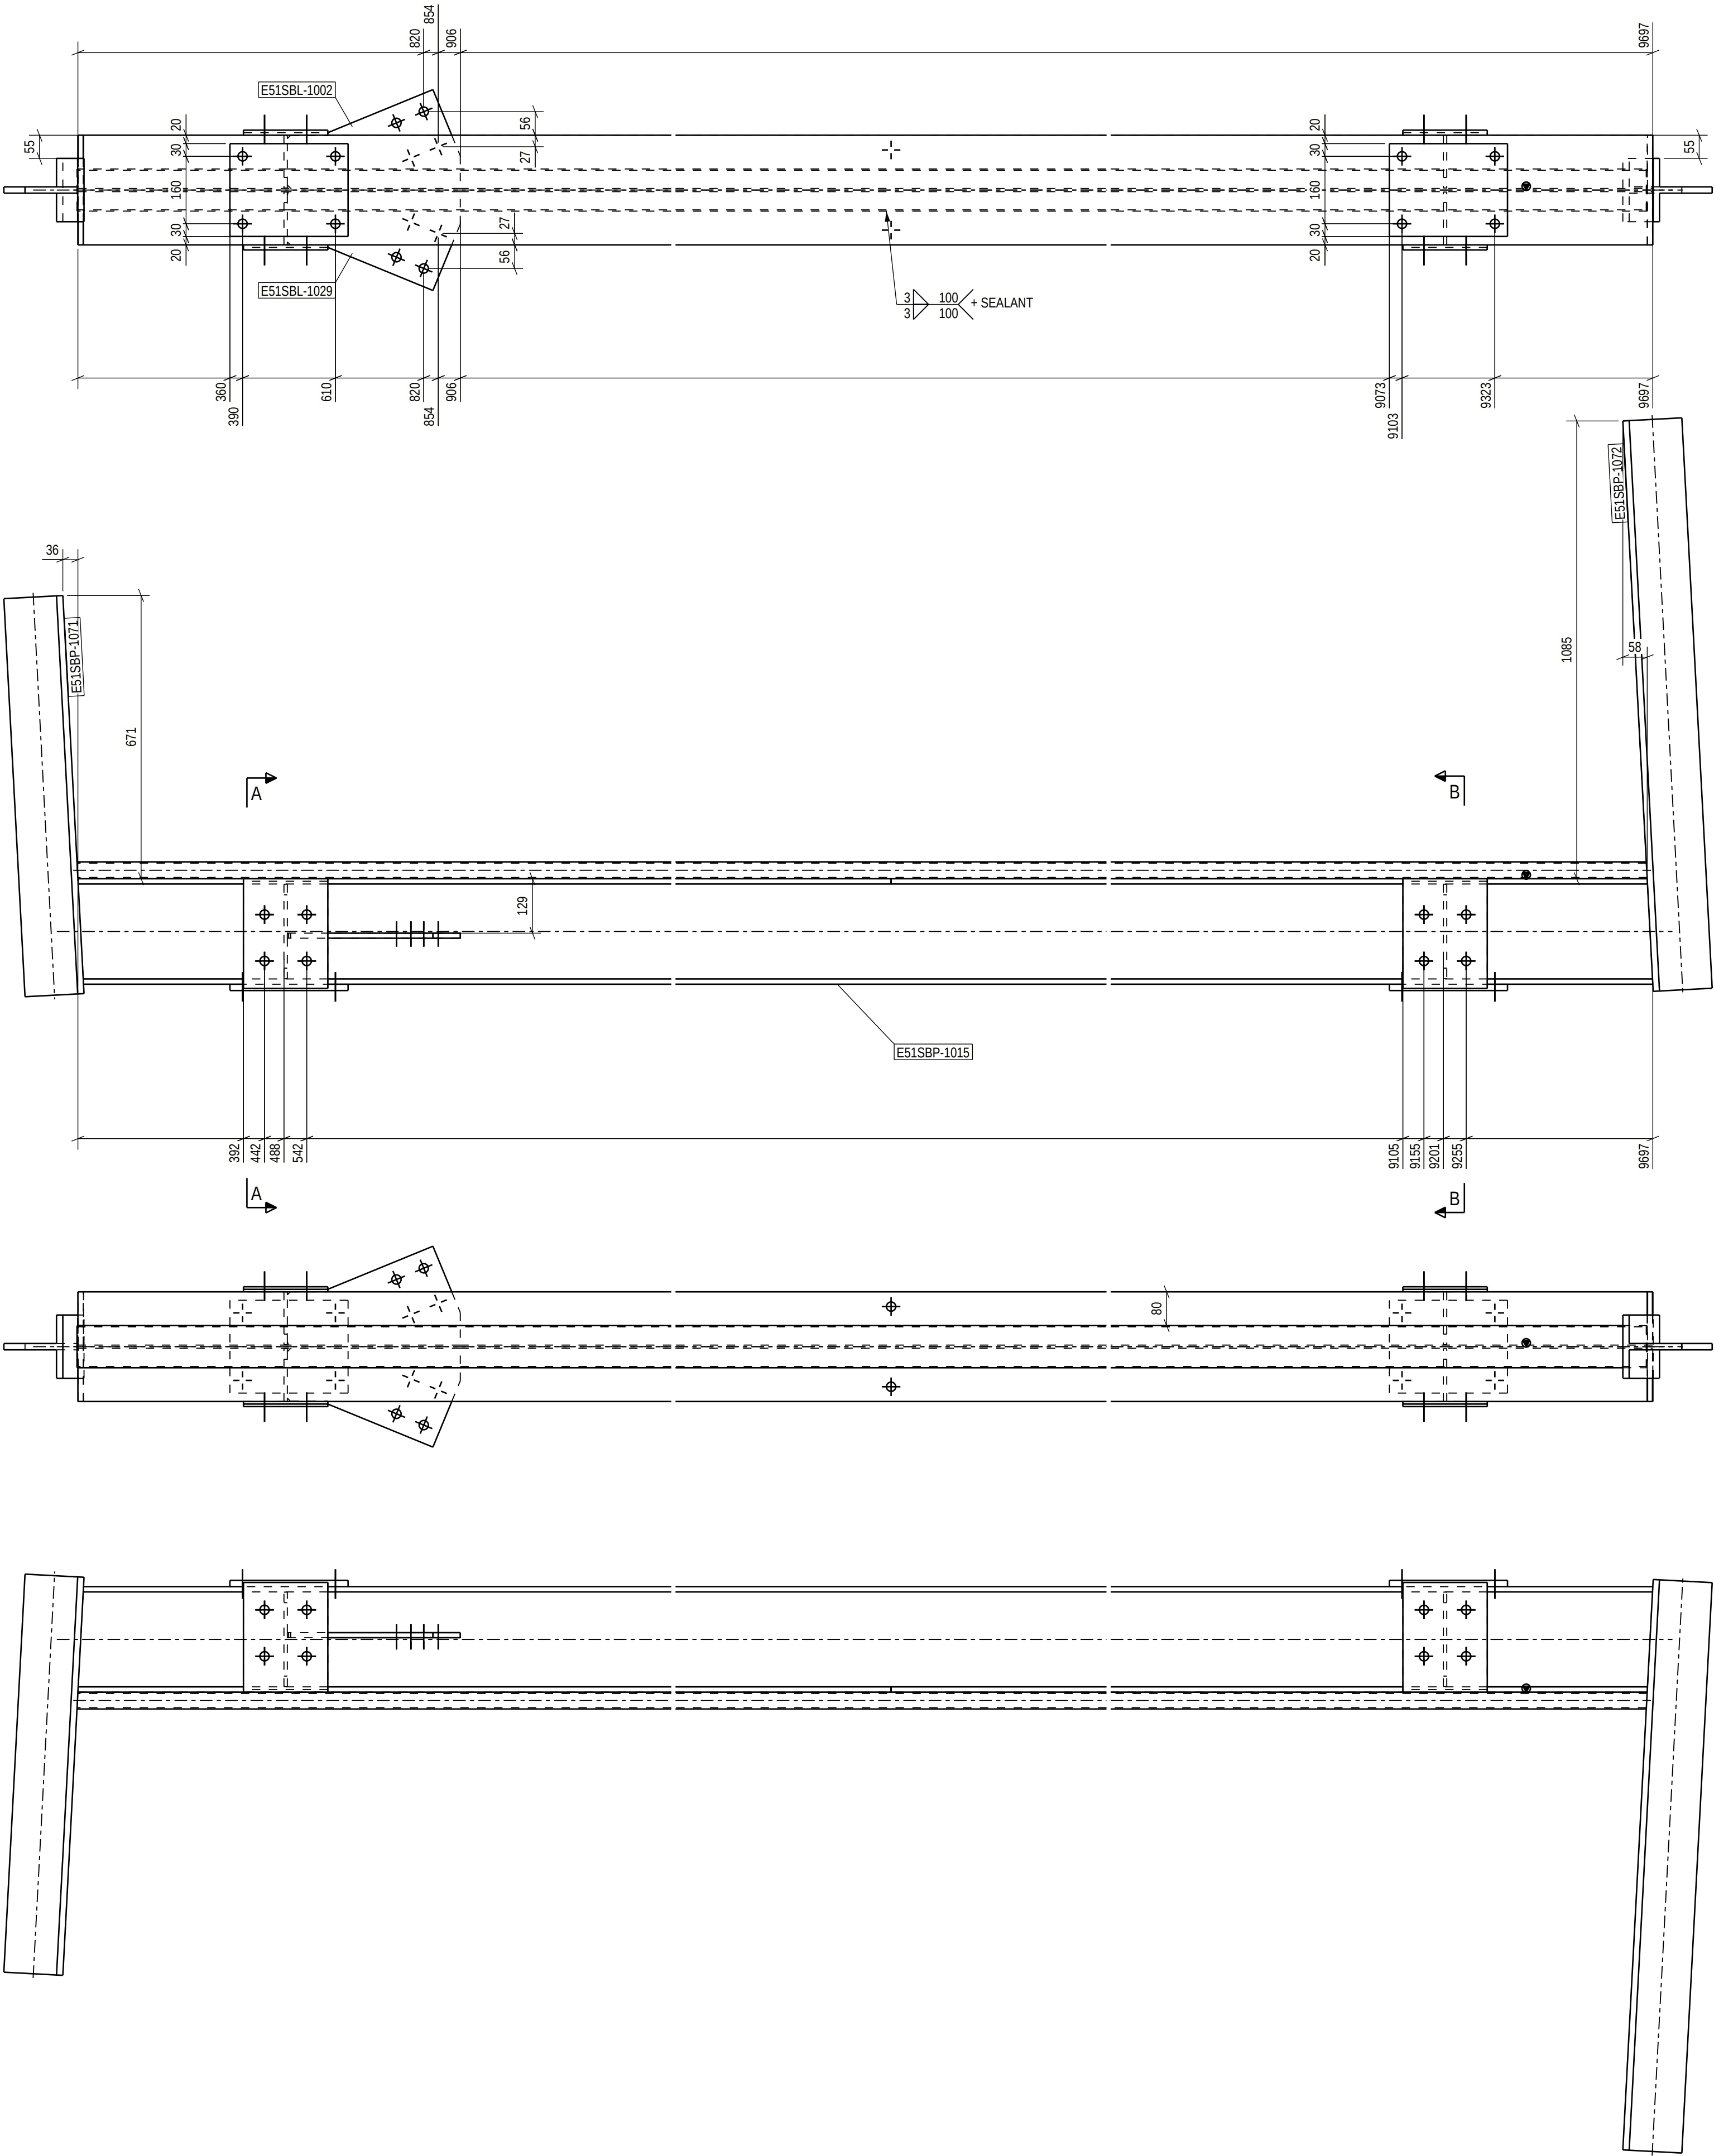

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

Technical fabrication requirements:		Execution class
EXC2		
Requirements for fabrication, standard	Fabrication tolerances	
EN1090-2, table A.3: EXC2	EN 1090-2, Appendix B	
Execution Specification document nr	Special fabrication tolerances	
25019443-ICC250-0600-0660-000005	Project specification/ shown on drwg.	
Surface preparation grade	Weld inspection requirements	
ISO8501-3, grade P2	EN 1090-2, Table 24, U>0.5	
Surface treatment	Extent of NDT, after welds	
ISO12944-5	MT-EN1290, 20% of welds	
Additional requirements on surface treatment	Extent of NDT, butt welds	
C3.07, EPPUR 240/2	UT, EN-ISO17640, 20% of welds	
Grades	UT, EN-ISO17640, 100% of welds	
RAL 7024 (Graphite Gray)	Requirements on testing	
Welding of bulk up steel section	EN1090-2 Section 6.6.3	
Appendix 1 / Project spec.	Weld class	
Welds, first specified otherwise	C, EN ISO 5817	
EN 9692-1, EN 9692-2	Additional material inspection	
	Shown on drwg	




PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1

DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51SB-1035



SWECO RAKENNETEKNIKKA OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
WWW.SWECO.FI

DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DESIGNER	APPROVED	CHECKED	REVISION
Alexey Serous	Alexey Serous	Pertti Kalliovaara	Jere Kallio
PROJECT NUMBER	25019443	E51SB-1035	

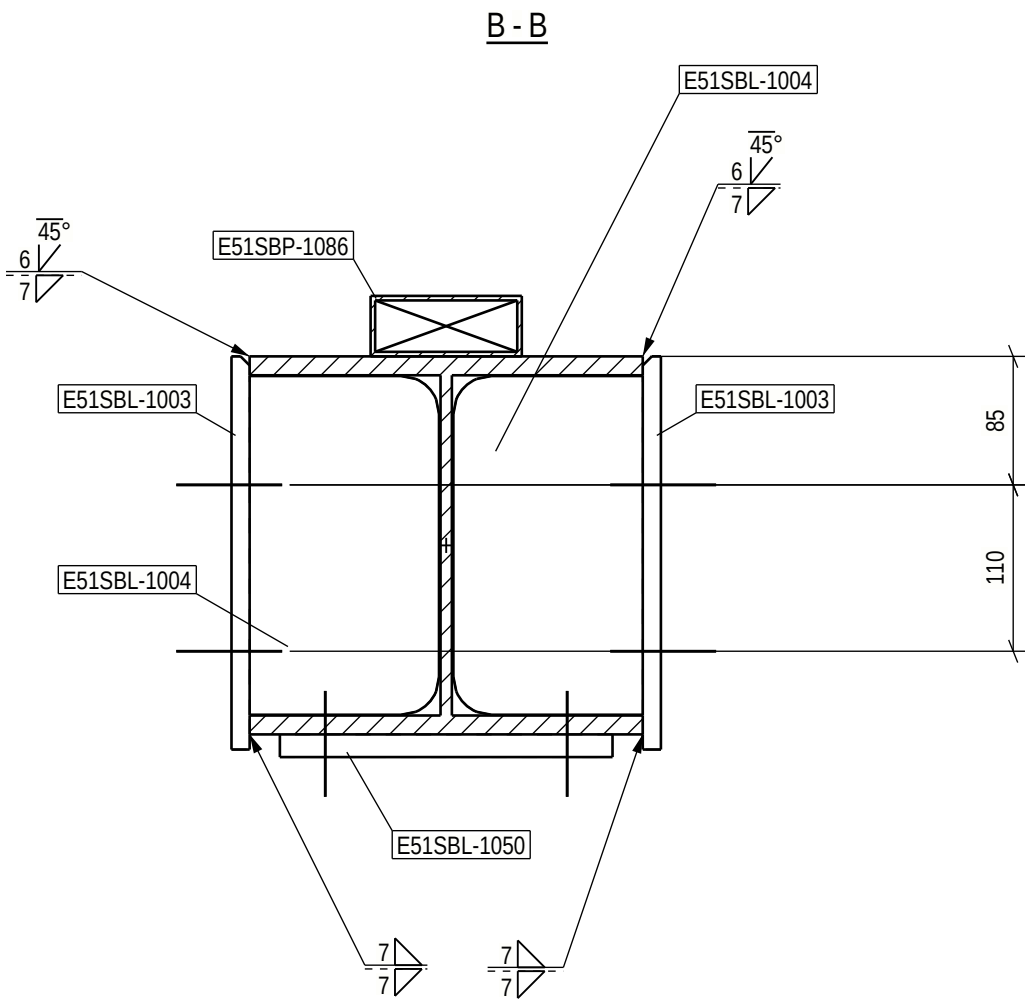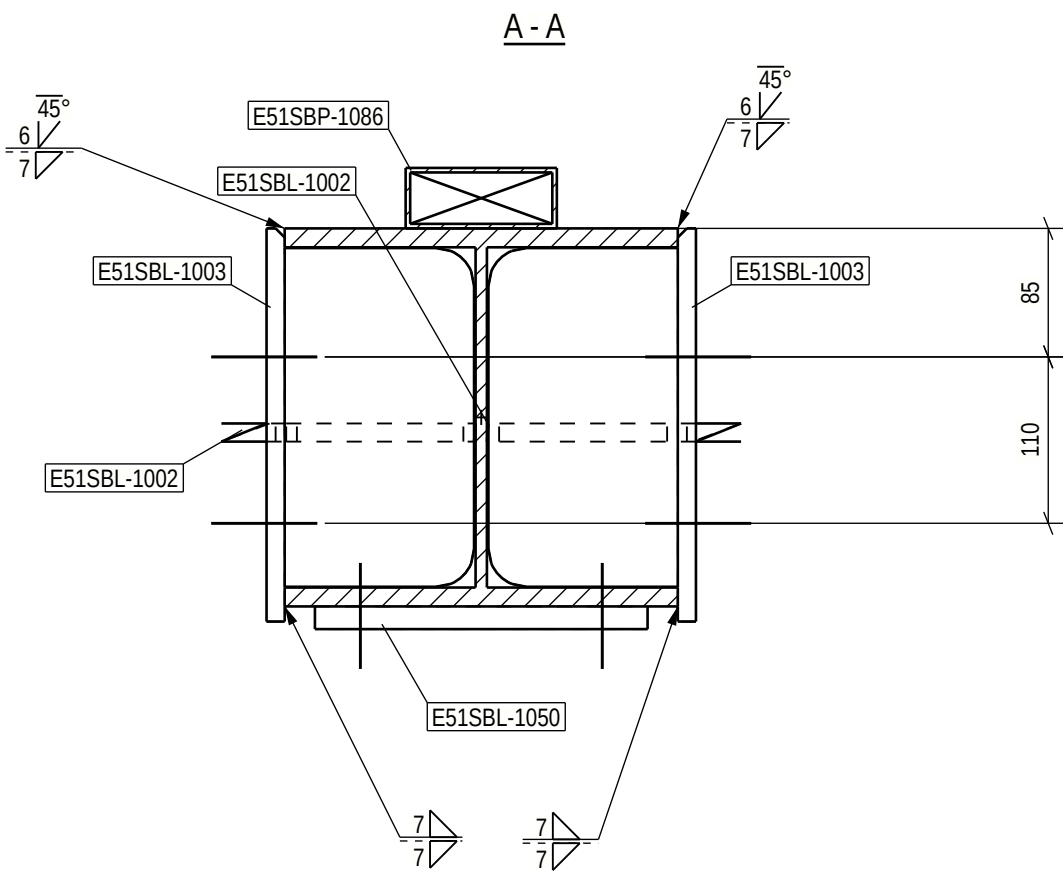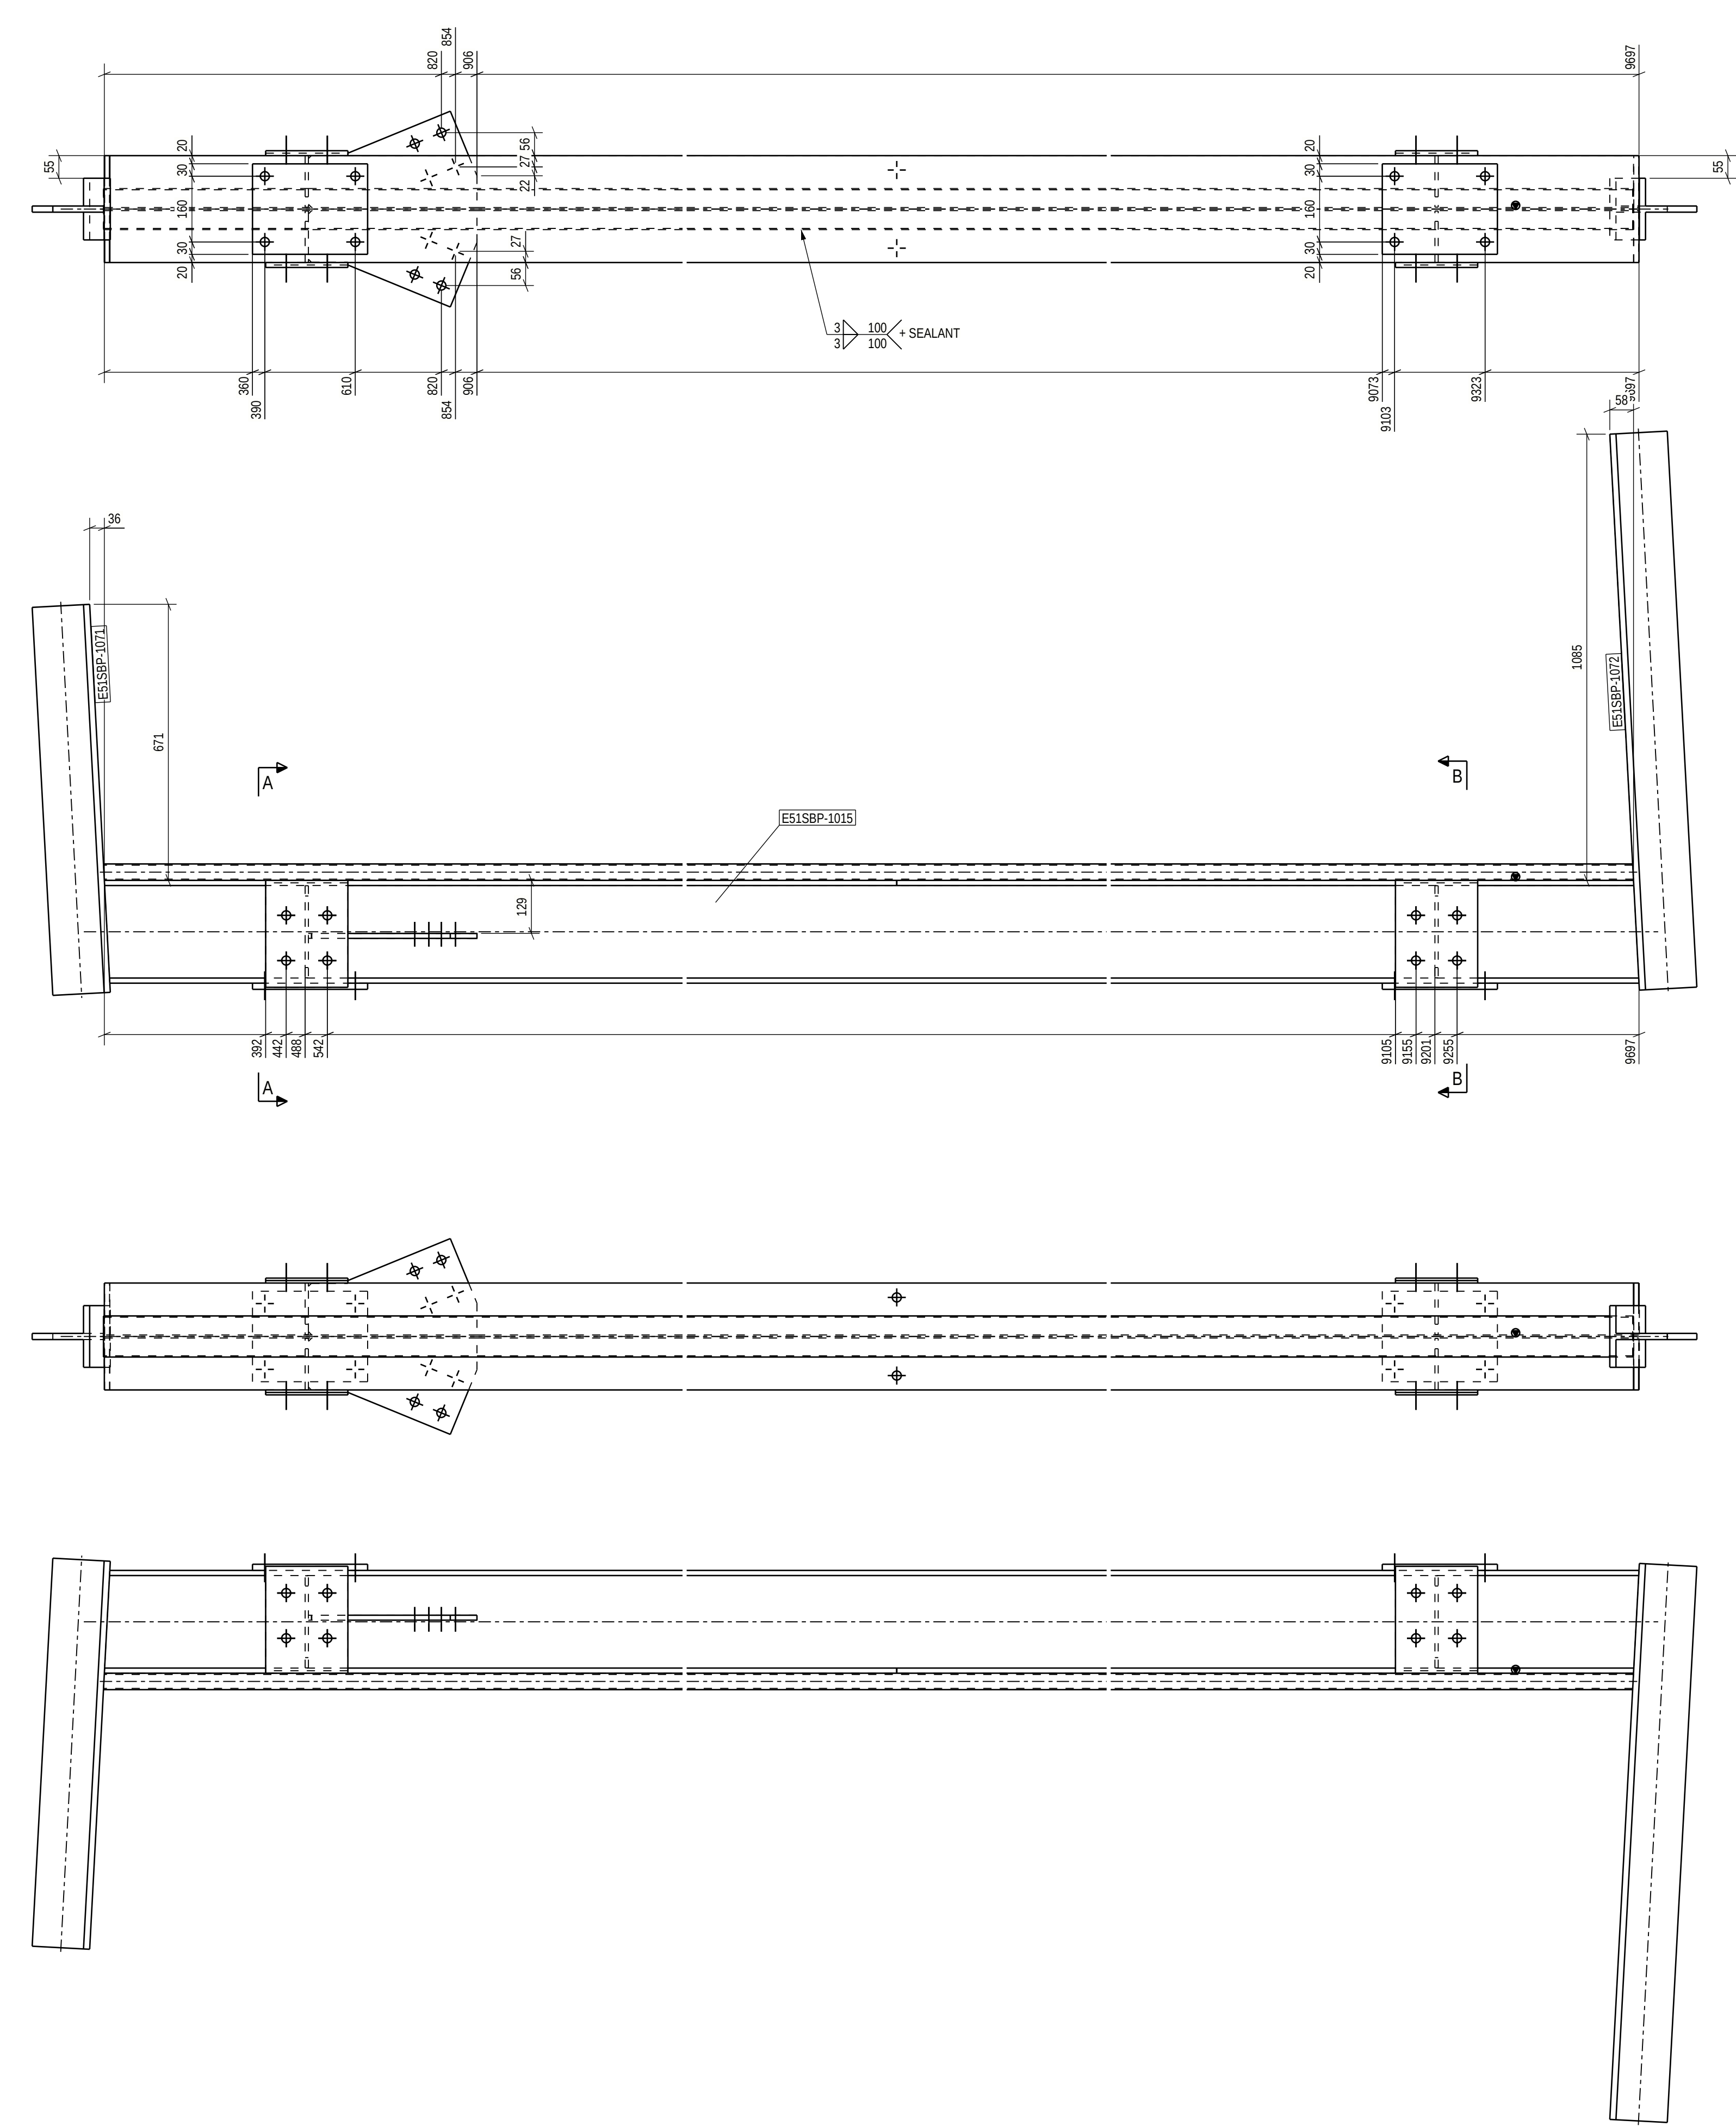

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PART LIST FOR ASSEMBLY E51SB-1036, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51SBL-1002	PL12X234	S355J2+N	410	0.30	6.4	2
E51SBL-1003	PL12X200	S355J2+N	260	0.46	4.9	4
E51SBL-1004	PL8X125	S355J2+N	224	0.24	1.7	4
E51SBL-1050	PL15X220	S355J2+N	280	0.28	7.3	2
E51SBP-1015	HEA260	S355J2	9697	14.39	660.9	1
E51SBP-1071	TI140-15-150	S355J2+N	945	0.56	31.0	1
E51SBP-1072	TI140-15-150	S355J2+N	1354	0.79	44.4	1
E51SBP-1086	CFRHS100X40X3	S355J2H	9686	2.62	59.4	1
TOTAL:				19.63	849.4	


Technical fabrication requirements:		EXC2
Requirements for fabrication, standard	Fabrication tolerances	
EN1090-2, table A3: EXC2	EN 1090-2, Appendix B	
Execution Specification document nr	Special fabrication tolerances	
25019443-ICC250-0600-0600-000005	Project specification/ shown on drwg.	
Surface preparation grade	Weld inspection requirements	
ISO8501-3, grade P2	EN 1090-2, Table 24, U>0.5	
Surface treatment	Extent of NDT, after welds	
ISO12944-5	MT-EN1290, 20% of welds	
Additional requirements on surface treatment	Extent of NDT, butt welds	
C3.07, EPPUR 240/2	UT, EN-ISO17640, 20% of welds	
RAL 7024 (Graphite Gray)	UT, EN-ISO17640, 100% of welds	
Welding of bulk up steel section	Requirements on testing	
Appendix 1 / Project spec.	EN1090-2 Section 6.6.3	
Weld class	EN 1090-2	Additional material inspection
EN 9692-1, EN 9692-2	EN 1090-2	Shown on drwg

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



SWECO RAKENNETEKNIKKA OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
WWW.SWECO.FI

DRAWING CONTENT			
DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
16.06.2026			STR
DESIGNER	APPROVED	CHECKED	STR
Alexey Serov	Alexey Serov	Pertti Kolumaanaho	Jere Kalliosalmi
PROJECT NUMBER	DWG. NO.	REVISION	
25019443	E51SB-1036		

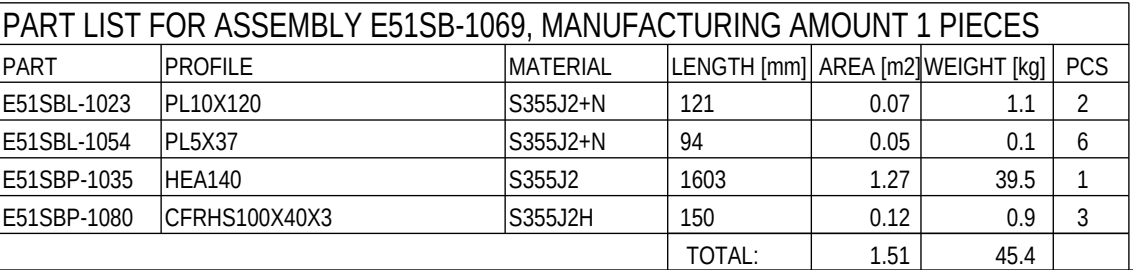

For special tolerances of bolt hole location
see specification for steel structures

Approved For Construction

SWECO 
Sustainable engineering and design


DRAWING CONTENT


ASSEMBLY DRAWING

Beam

E51SB-1069

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Koivumaaanaho	CHECKED Jere Kalliosalmi
PROJECT NUMBER 25019443	DWG. NO. E51SB-1069		REVISION

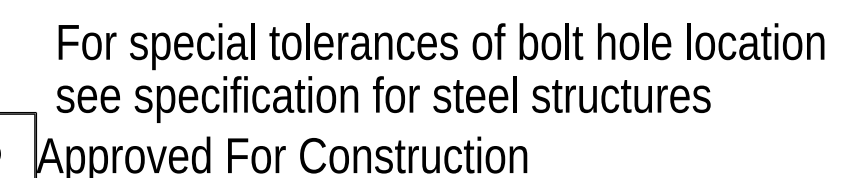25019443 Fair E500

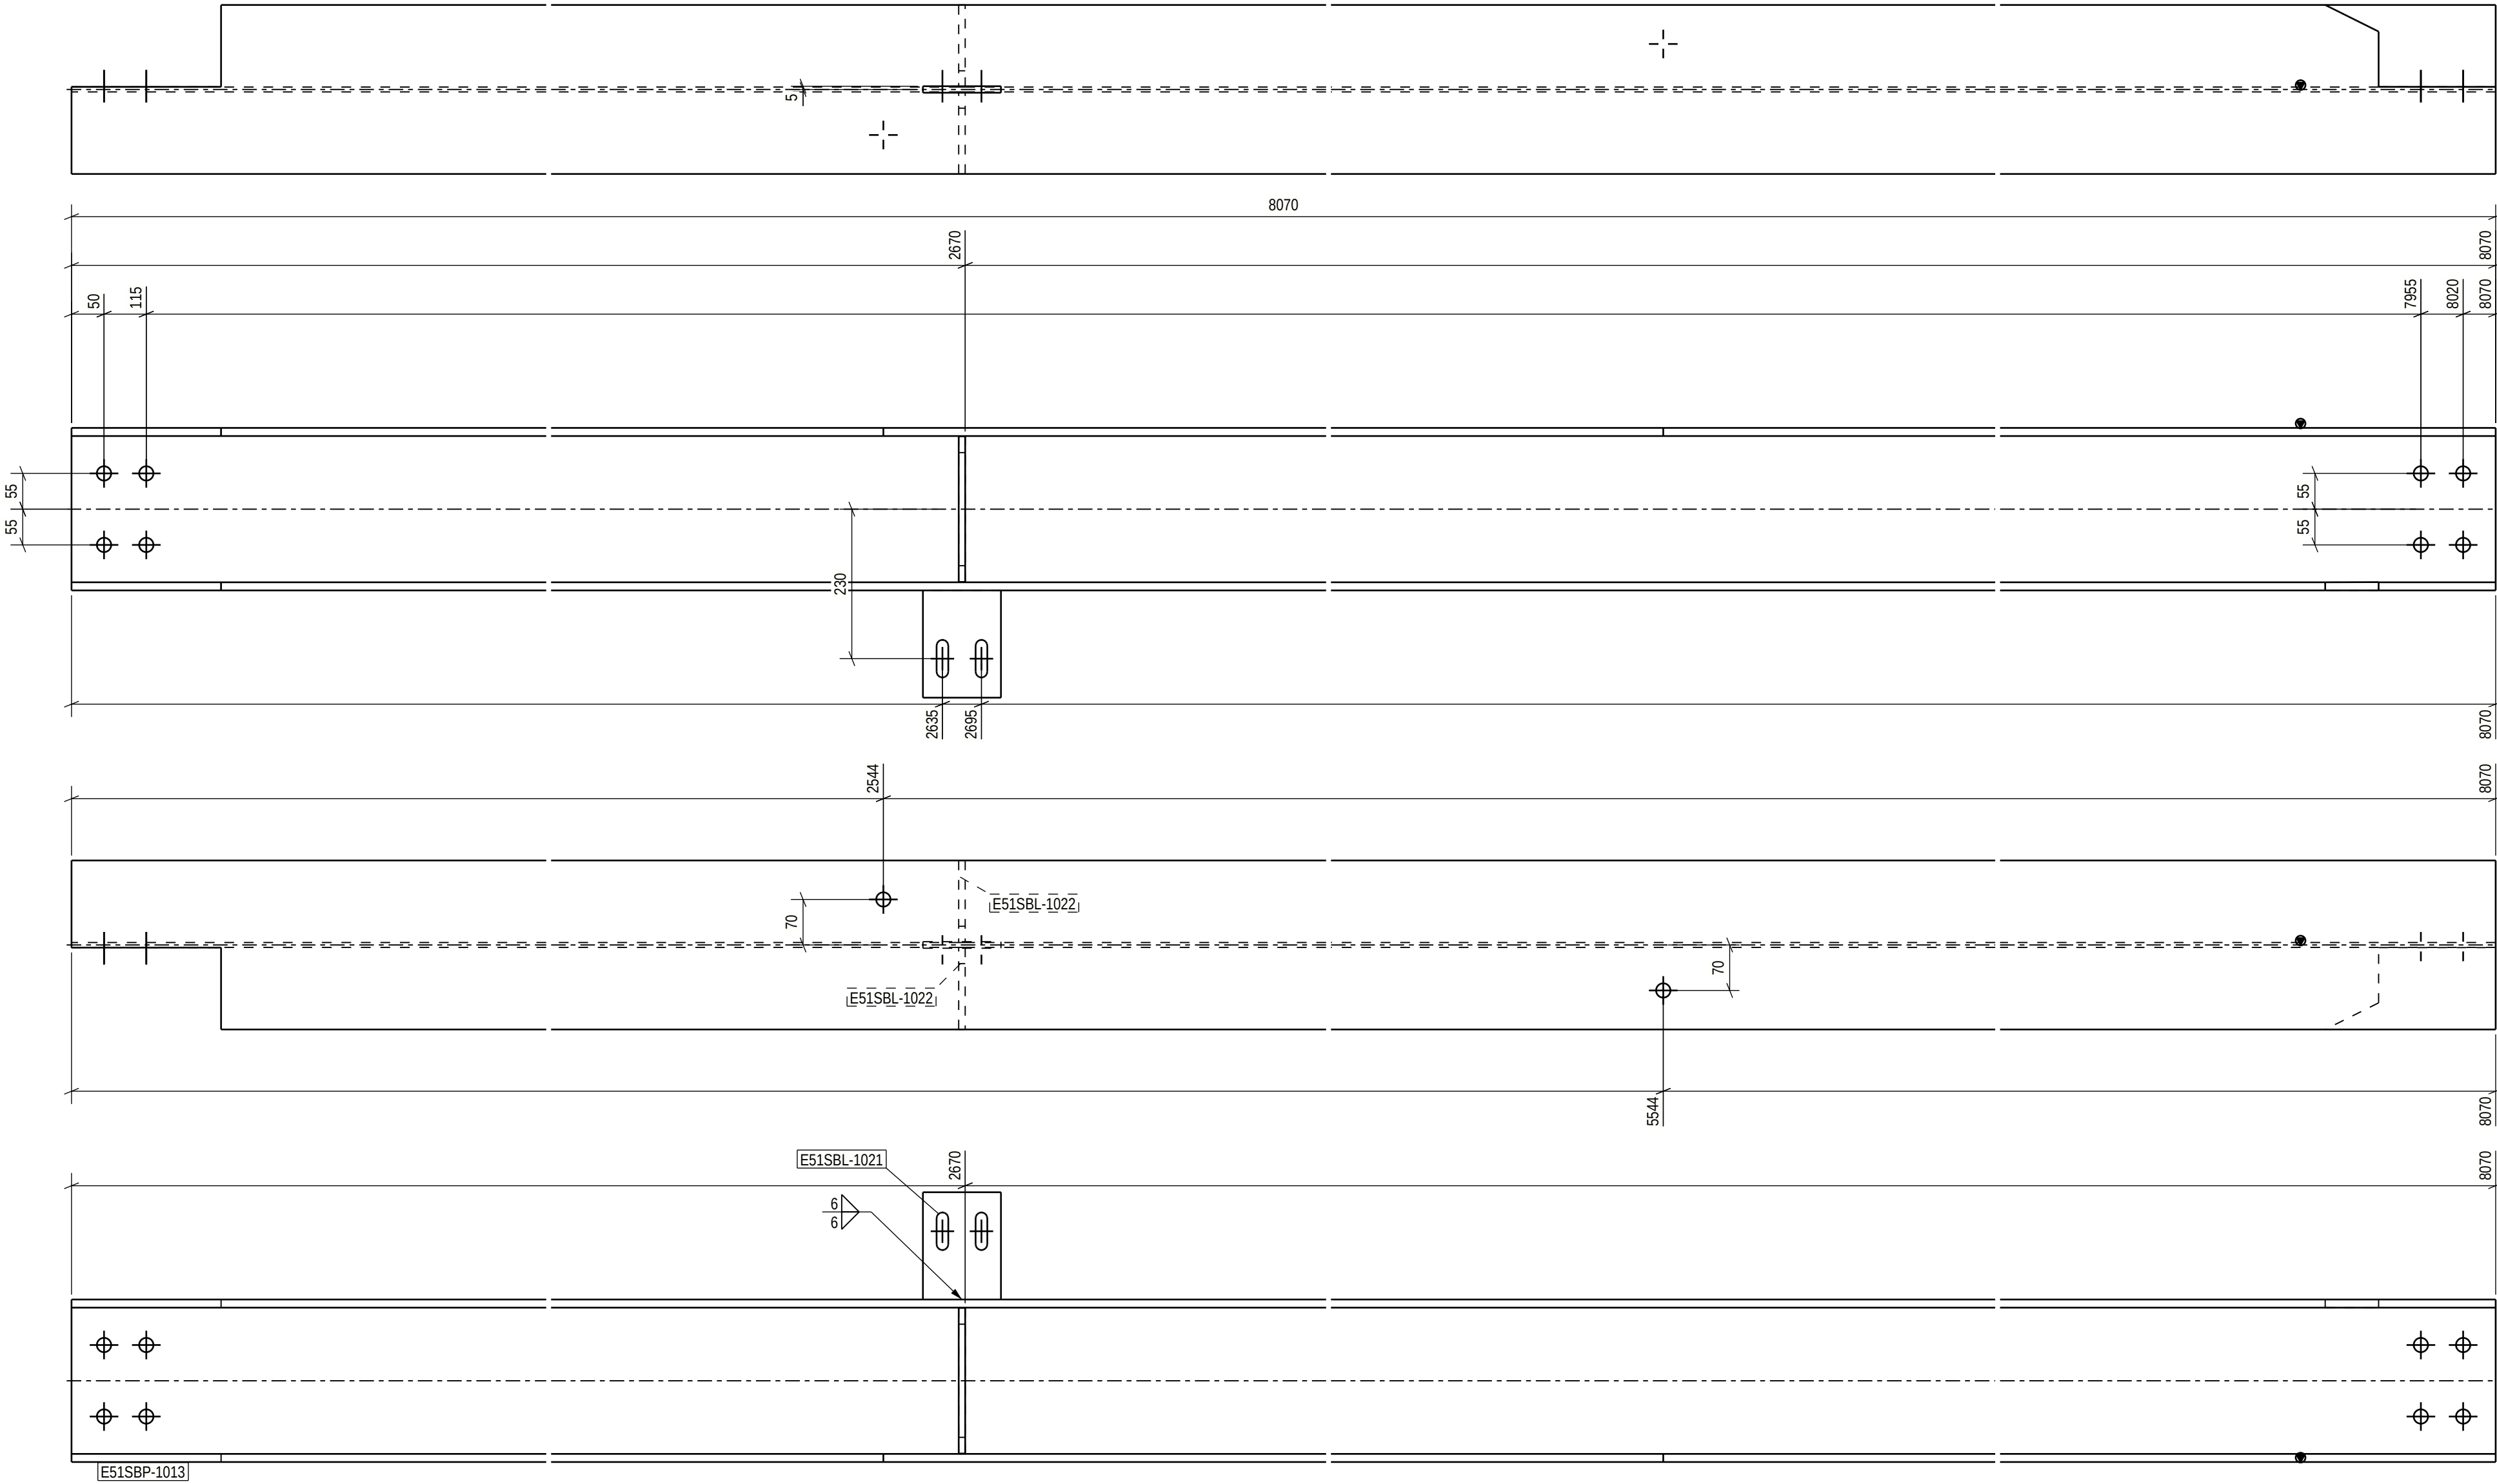

PART LIST FOR ASSEMBLY E51SB-1071, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51SBL-1021	PL10X120	S355J2+N	165	0.05	1.6	1
E51SBL-1022	PL10X126	S355J2+N	224	0.13	2.2	2
E51SBP-1013	HEA260	S355J2	8070	11.98	550.0	1
TOTAL:				12.15	555.9	

Technical fabrication requirements:

Execution class

EXC2

Requirements for fabrication, standard
EN1090-2, table A.3 : EXC2
Execution Specification document nr
25019443-ICC250-0600-0660-000005

Fabrication tolerances
EN 1090-2, Appendix B
Special fabrication tolerances
Project specification/ shown on drwg.

Surface preparation grade
ISO8501-3, grade P2

Weld inspection, requirements
EN 1090-2, Table 24, U>0.5

Surface treatment
ISO12944-5

Extent of NDT, fillet welds
MT-EN1290, 20% of welds

Additional requirements on surface treatment
C3.07, EPPUR 240/2

Extent of NDT for splices not shown on drawing
UT, EN-ISO17640, 20% of welds

Shade
RAL 7024 (Graphite Gray)

UT, EN-ISO17640, 100% of welds

Welding of built up steel section
Appendix 1 / Project spec.

Requirements on holing
EN1090-2 Section 6.6.3

Welds, if not specified otherwise
EN 9692-1, EN 9692-2

Weld class
C, EN ISO 5817

Additional material inspection
Shown on drwg.

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1




SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51SB-1071

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Kouvumaaaho	CHECKED Jere Kallosalmi
PROJECT NUMBER 25019443	REVISION E51SB-1071		

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

25019443_Fair_E500

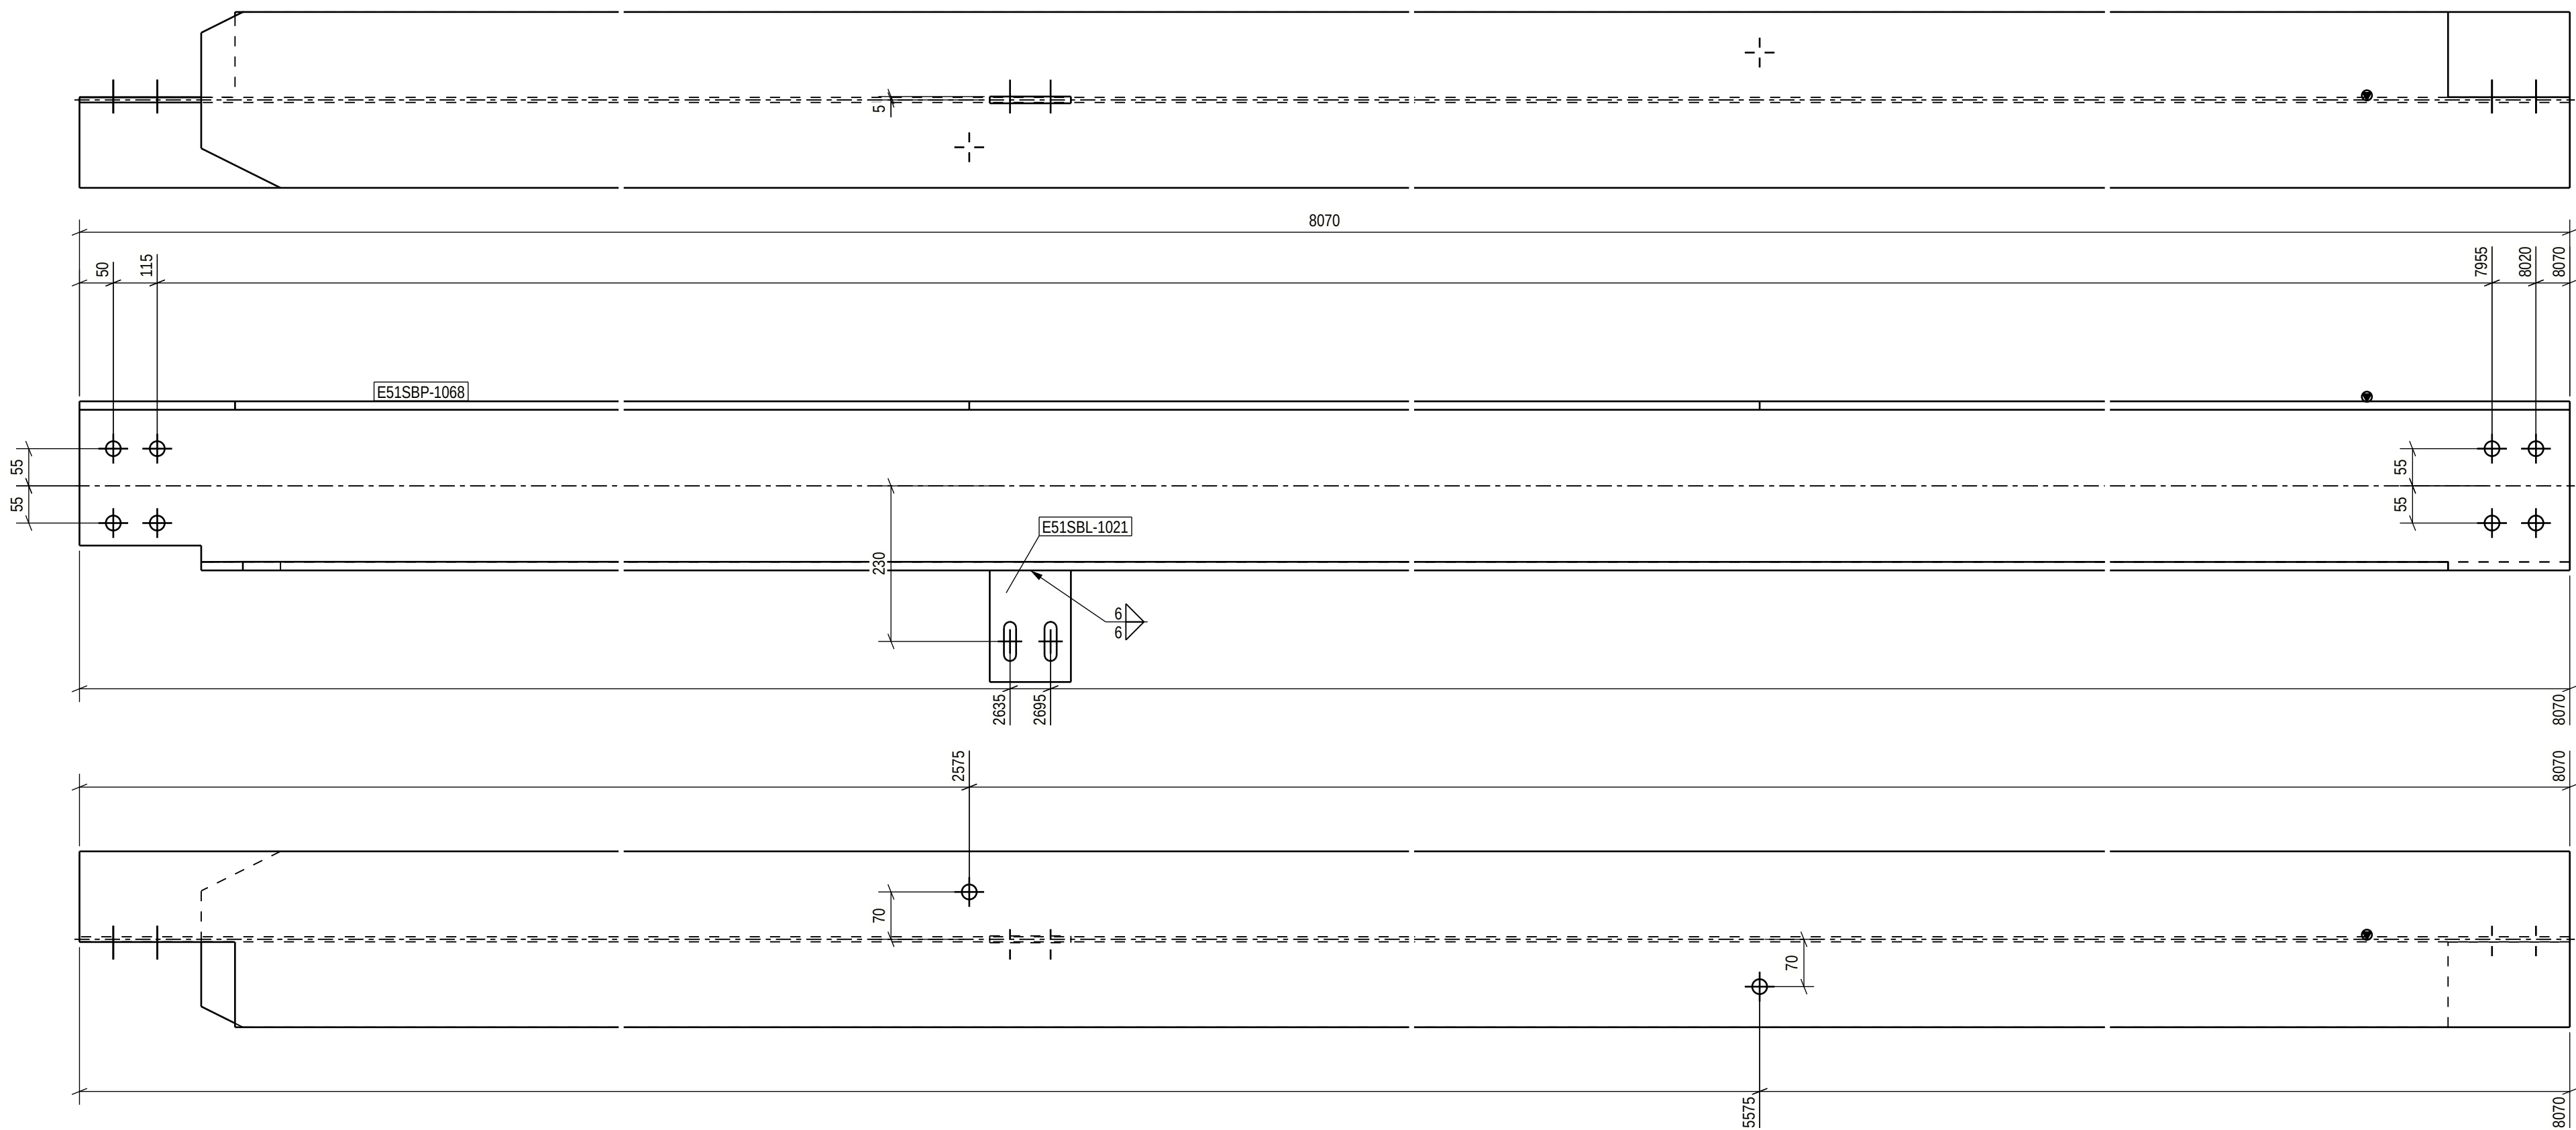


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PART LIST FOR ASSEMBLY E51SB-1072, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m ²]	WEIGHT [kg]	PCS
E51SBL-1021	PL10X120	S355J2+N	165	0.05	1.6	1
E51SBP-1068	HEA260	S355J2	8070	11.98	550.0	1
TOTAL:				12.02	551.6	

Technical fabrication requirements:		Execution class EXC2	
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2		Fabrication tolerances EN 1090-2, Appendix B	
Execution Specification document nr 25019443-ICC250-0600-0660-000005		Special fabrication tolerances Project specification/ shown on drwg.	
Surface preparation grade ISO8501-3, grade P2		Weld inspection, requirements EN 1090-2, Table 24, U>0.5	
Surface treatment ISO12944-5		Extent of NDT, fillet welds MT-EN1290, 20% of welds	
Additional requirements on surface treatment C3.07, EPPUR 240/2		Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds	
Shade RAL 7024 (Graphite Gray)		Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds	
Welding of built up steel section Appendix 1 / Project spec.		Requirements on holing EN1090-2 Section 6.6.3	
Welds, if not specified otherwise EN 9692-1, EN 9692-2		Weld class C, EN ISO 5817	
Additional material inspection Shown on drwg.			

PROJECT NAME Easpring New Materials Oy FAIR Phase 1				DRAWING CONTENT ASSEMBLY DRAWING Beam E51SB-1072	
		SWECO RAKENNETEKNIikka OY ILMALANPORTTI 2 00240 HELSINKI		DATE 16.06.2026	
DRAWN Alexey Serous		DESIGNER Alexey Serous		ARCHIVING CODE	
PROJECT NUMBER 25019443		PUH. +358 207 393 000 www.sweco.fi		PAGE	
				DESIGN GROUP STR	
				APPROVED Pertti Koivumaa	
				CHECKED Jere Kallosalmi	
				REVISION	

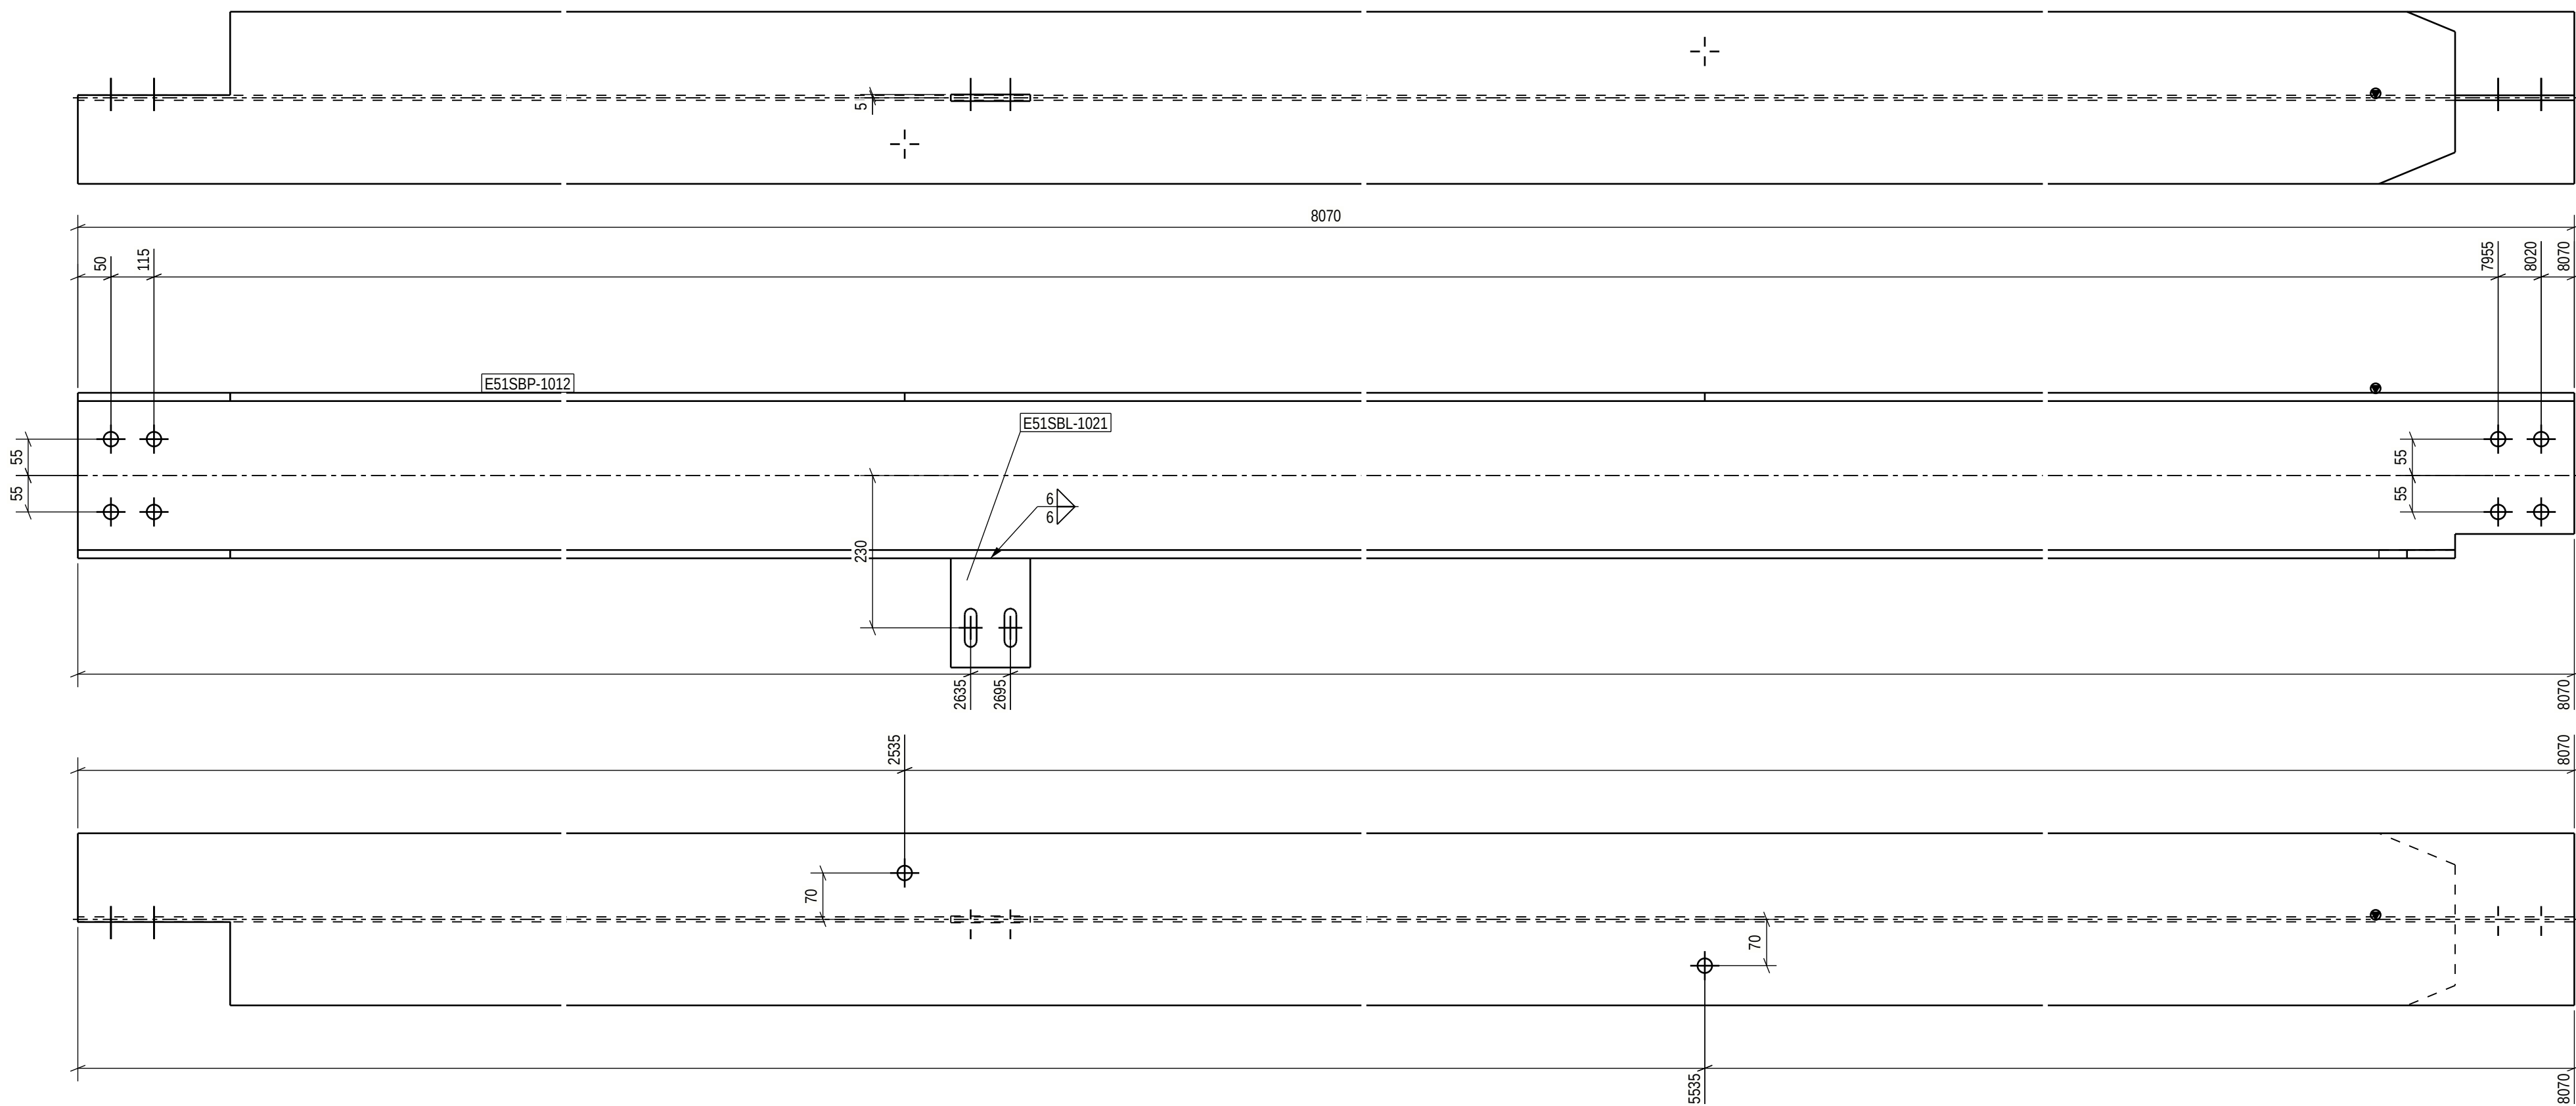


For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

PROJECT NAME		DRAWING CONTENT			
Easpring New Materials Oy		ASSEMBLY DRAWING			
FAIR Phase 1		Beam			
		E51SB-1073			
 Sustainable engineering and design	SWECO RAKENNETEKNIikka OY ILMALANPORTTI 2 00240 HELSINKI PUH. +358 207 393 000 www.sweco.fi	DATE	ARCHIVING CODE	PAGE	DESIGN GROUP
		16.06.2026			STR
		DRAWN	DESIGNER	APPROVED	CHECKED
		Alexey Serous	Alexey Serous	Pertti Koivumaa	Jere Kallosalmi
		PROJECT NUMBER		DWG. NO.	REVISION
		25019443		E51SB-1073	


Technical fabrication requirements:		Execution class	
EXC2			
Requirements for fabrication, standard		Fabrication tolerances	
EN1090-2, table A.3 : EXC2		EN 1090-2, Appendix B	
Execution Specification document nr		Special fabrication tolerances	
25019443-ICC250-0600-0660-000005		Project specification/ shown on drwg.	
Surface preparation grade		Weld inspection, requirements	
ISO8501-3, grade P2		EN 1090-2, Table 24, U>0.5	
Surface treatment		Extent of NDT, fillet welds	
ISO12944-5		MT-EN1290, 20% of welds	
Additional requirements on surface treatment		Extent of NDT, butt welds	
C3.07, EPPUR 240/2		UT, EN-ISO17640, 20% of welds	
Shade		Extent of NDT for splices not shown on drawing	
RAL 7024 (Graphite Gray)		UT, EN-ISO17640, 100% of welds	
Welding of built up steel section		Requirements on holing	
Appendix 1 / Project spec.		EN1090-2 Section 6.6.3	
Welds, if not specified otherwise		Weld class	
EN 9692-1, EN 9692-2		C, EN ISO 5817	
		Additional material inspection	
		Shown on drwg.	

PART LIST FOR ASSEMBLY E51SB-1073, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51SBL-1021	PL10X120	S355J2+N	165	0.05	1.6	1
E51SBP-1012	HEA260	S355J2	8070	11.98	550.0	1
TOTAL:				12.02	551.6	

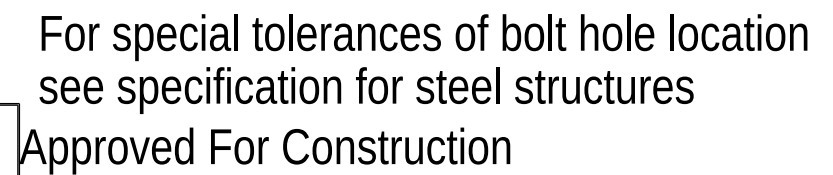

		Execution class
Technical fabrication requirements:		EXC2
Requirements for fabrication, standard EN1090-2, table A.3 : EXC2 Execution Specification document nr 25019443-ICC250-0600-0660-000005 Surface preparation grade ISO8501-3, grade P2 Surface treatment ISO12944-5 Additional requirements on surface treatment C3.07, EPPUR 240/2 Shade RAL 7024 (Graphite Gray) Welding of built up steel section Appendix 1 / Project spec. Welds, if not specified otherwise EN 9692-1, EN 9692-2	Fabrication tolerances EN 1090-2, Appendix B Special fabrication tolerances Project specification/ shown on drwg. Weld inspection, requirements EN 1090-2, Table 24, U>0.5 Extent of NDT, fillet welds MT-EN1290, 20% of welds Extent of NDT, butt welds UT, EN-ISO17640, 20% of welds Extent of NDT for splices not shown on drawing UT, EN-ISO17640, 100% of welds Requirements on healing EN1090-2 Section 6.6.3 Weld class EN ISO 5817	
	Additional material inspection Shown on drwg.	

25019443 Fair E500

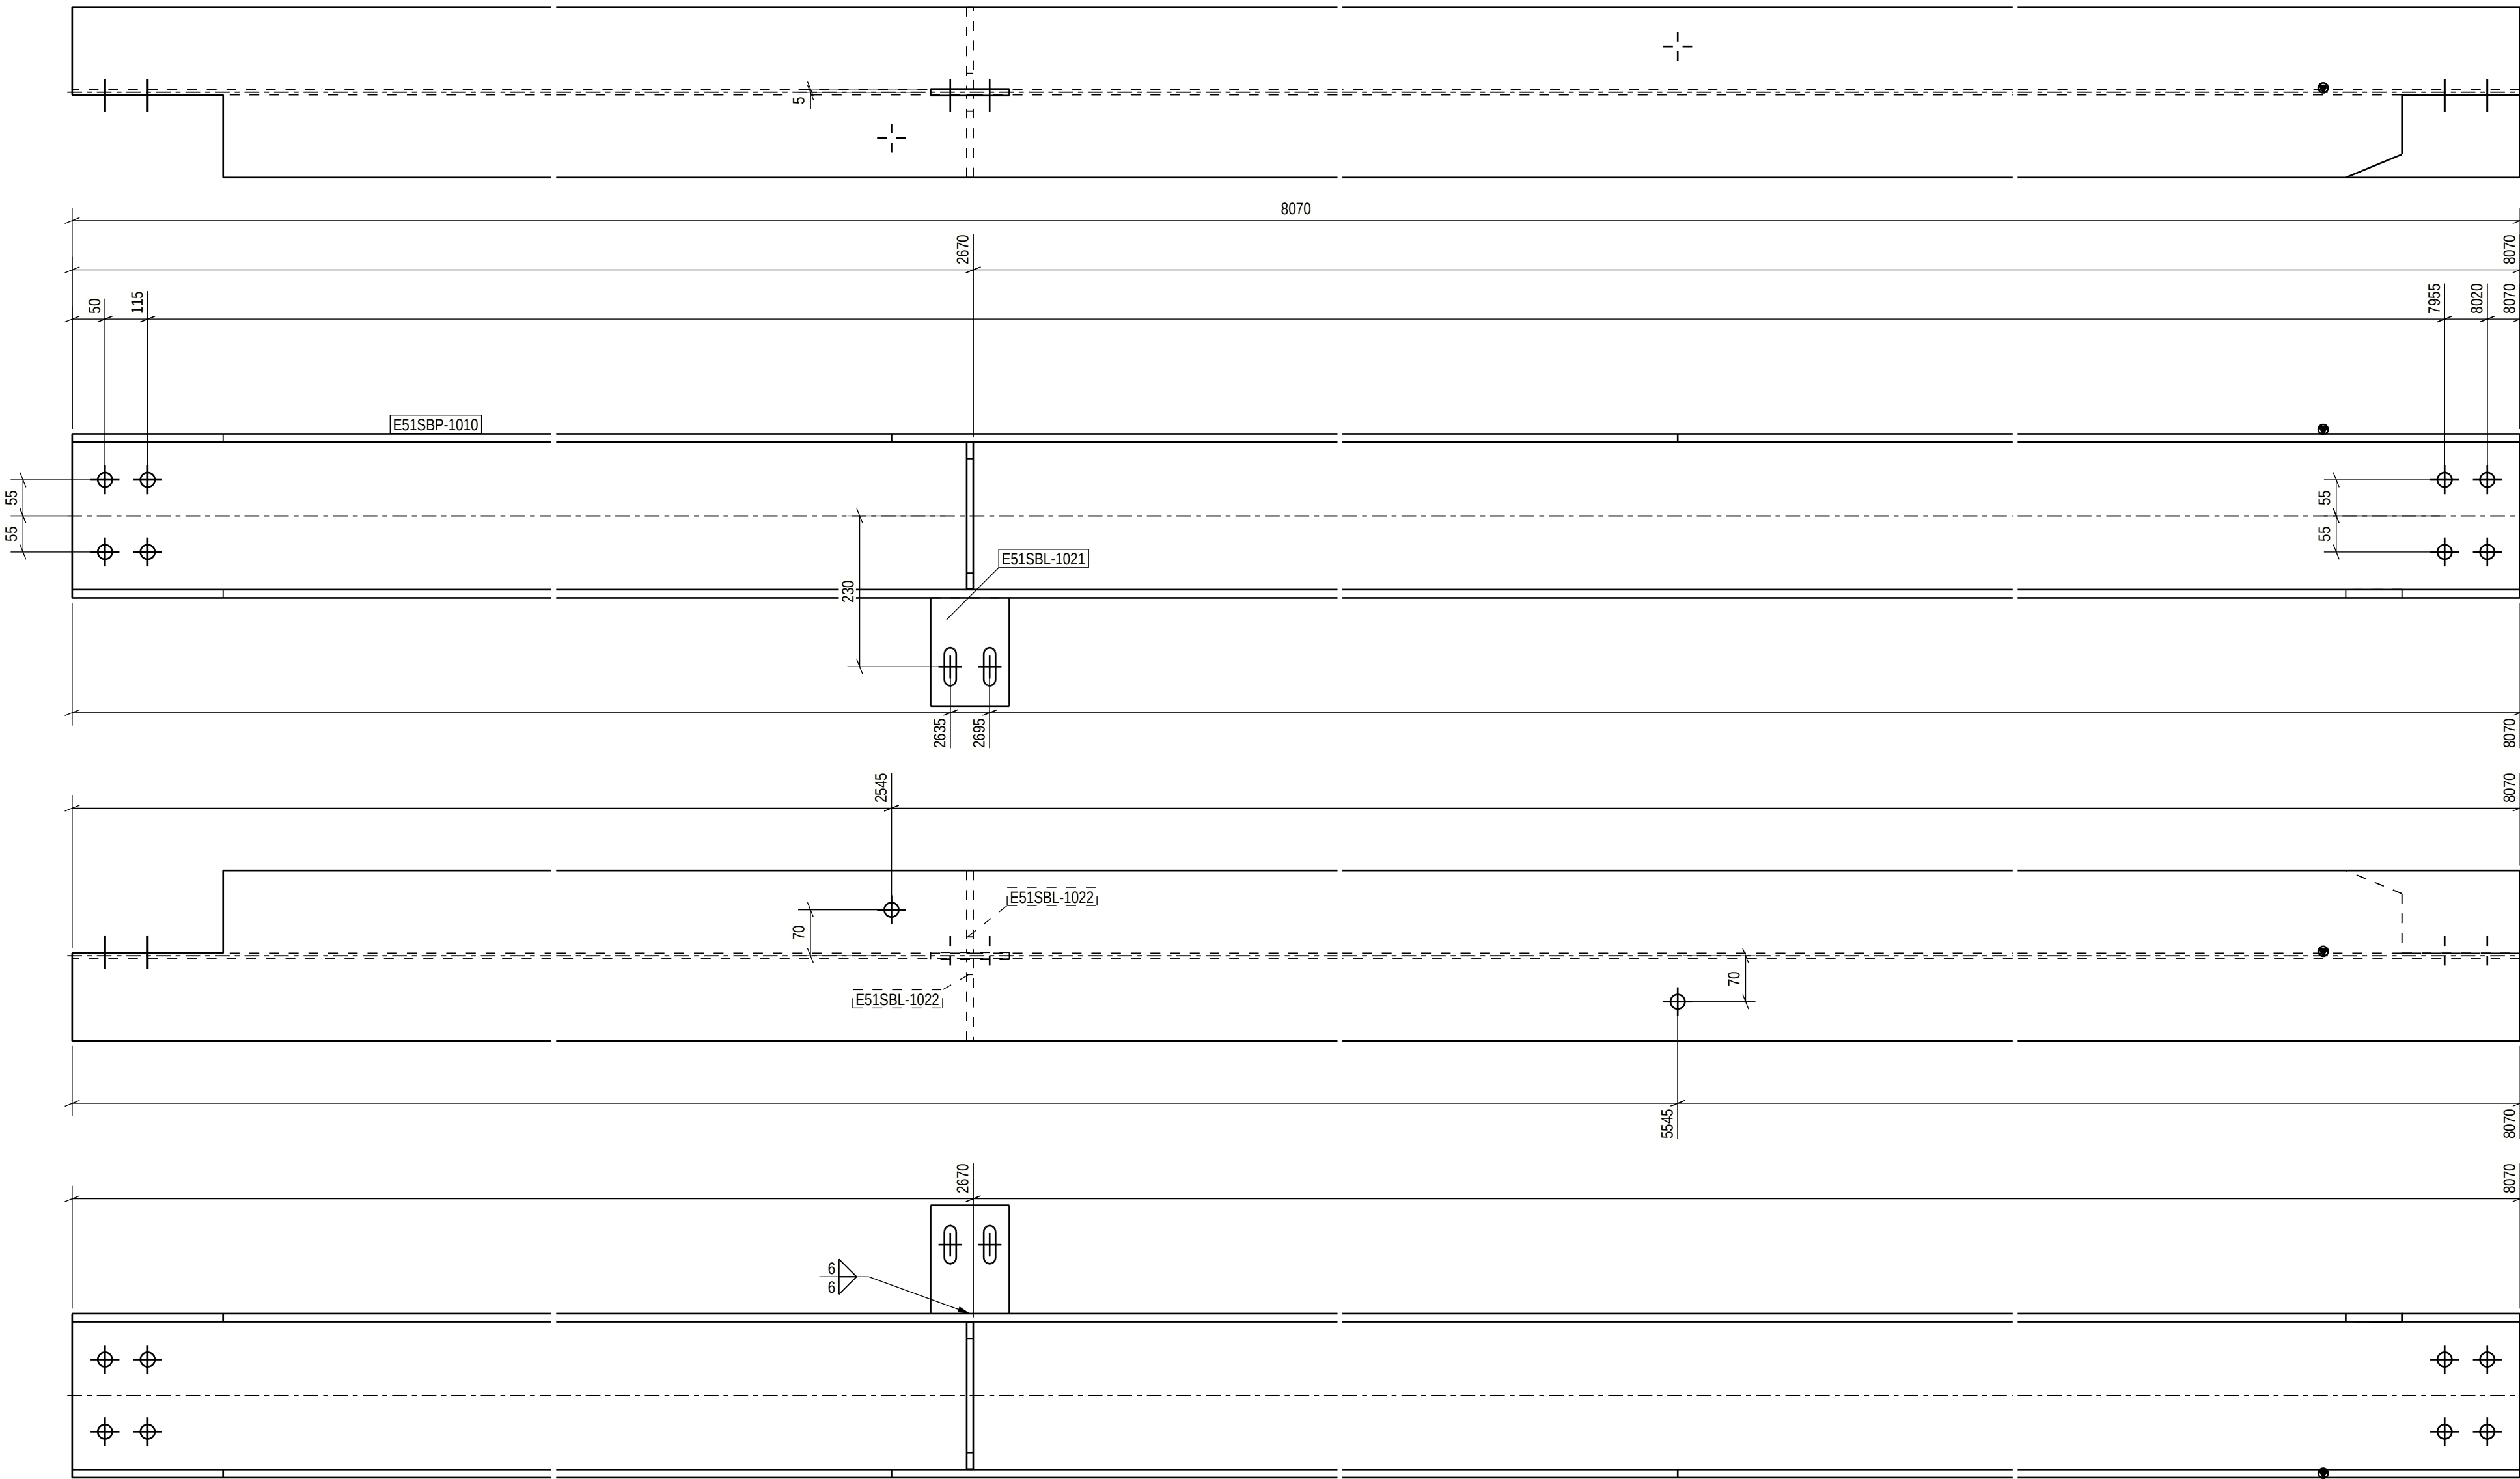

PART LIST FOR ASSEMBLY E51SB-1075, MANUFACTURING AMOUNT 1 PIECES						
PART	PROFILE	MATERIAL	LENGTH [mm]	AREA [m2]	WEIGHT [kg]	PCS
E51SBL-1021	PL10X120	S355J2+N	165	0.05	1.6	1
E51SBL-1022	PL10X126	S355J2+N	224	0.13	2.2	2
E51SBP-1010	HEA260	S355J2	8070	11.98	550.0	1
TOTAL:				12.15	555.9	

Technical fabrication requirements:

EXC2

Requirements for fabrication, standard
EN1090-2, table A.3 : EXC2
Execution Specification document nr
25019443-ICC250-0600-0660-000005

Fabrication tolerances
EN 1090-2, Appendix B
Special fabrication tolerances
Project specification/ shown on drwg.

Surface preparation grade
ISO8501-3, grade P2

Surface treatment
ISO12944-5

Additional requirements on surface treatment
C3.07, EPPUR 240/2

Shade
RAL 7024 (Graphite Gray)

Welding of built up steel section
Appendix 1 / Project spec.

Welds, if not specified otherwise
EN 9692-1, EN 9692-2

Extent of NDT, butt welds
UT, EN-ISO17640, 20% of welds

Extent of NDT, fillet welds
MT-EN1290, 20% of welds

Extent of NDT for splices not shown on drawing
UT, EN-ISO17640, 100% of welds

Requirements on holing
EN1090-2 Section 6.6.3

Weld class
C, EN ISO 5817

Additional material inspection
Shown on drwg.

PROJECT NAME
Easpring New Materials Oy
FAIR Phase 1



SWECO RAKENNETEKNIikka OY
ILMALANPORTTI 2
00240 HELSINKI
PUH. +358 207 393 000
www.sweco.fi

DRAWING CONTENT
ASSEMBLY DRAWING
Beam
E51SB-1075

DATE 16.06.2026	ARCHIVING CODE	PAGE	DESIGN GROUP STR
DRAWN Alexey Serous	DESIGNER Alexey Serous	APPROVED Pertti Kivumaaanaho	CHECKED Jere Kallosalmi
PROJECT NUMBER 25019443	REVISION E51SB-1075		

For special tolerances of bolt hole location
see specification for steel structures
Approved For Construction

25019443_Fair_E500