


Liquid buffer: 7 L min
Vapour buffer: 5 L min

Diamonds (TP / cat / next) mark the 'last-meter' hand-over between in-scope and out-of-scope assets.

Vacuum OK (QVE) -----
Cryo OK (2K/4.5K) -----
Utilities OK -----

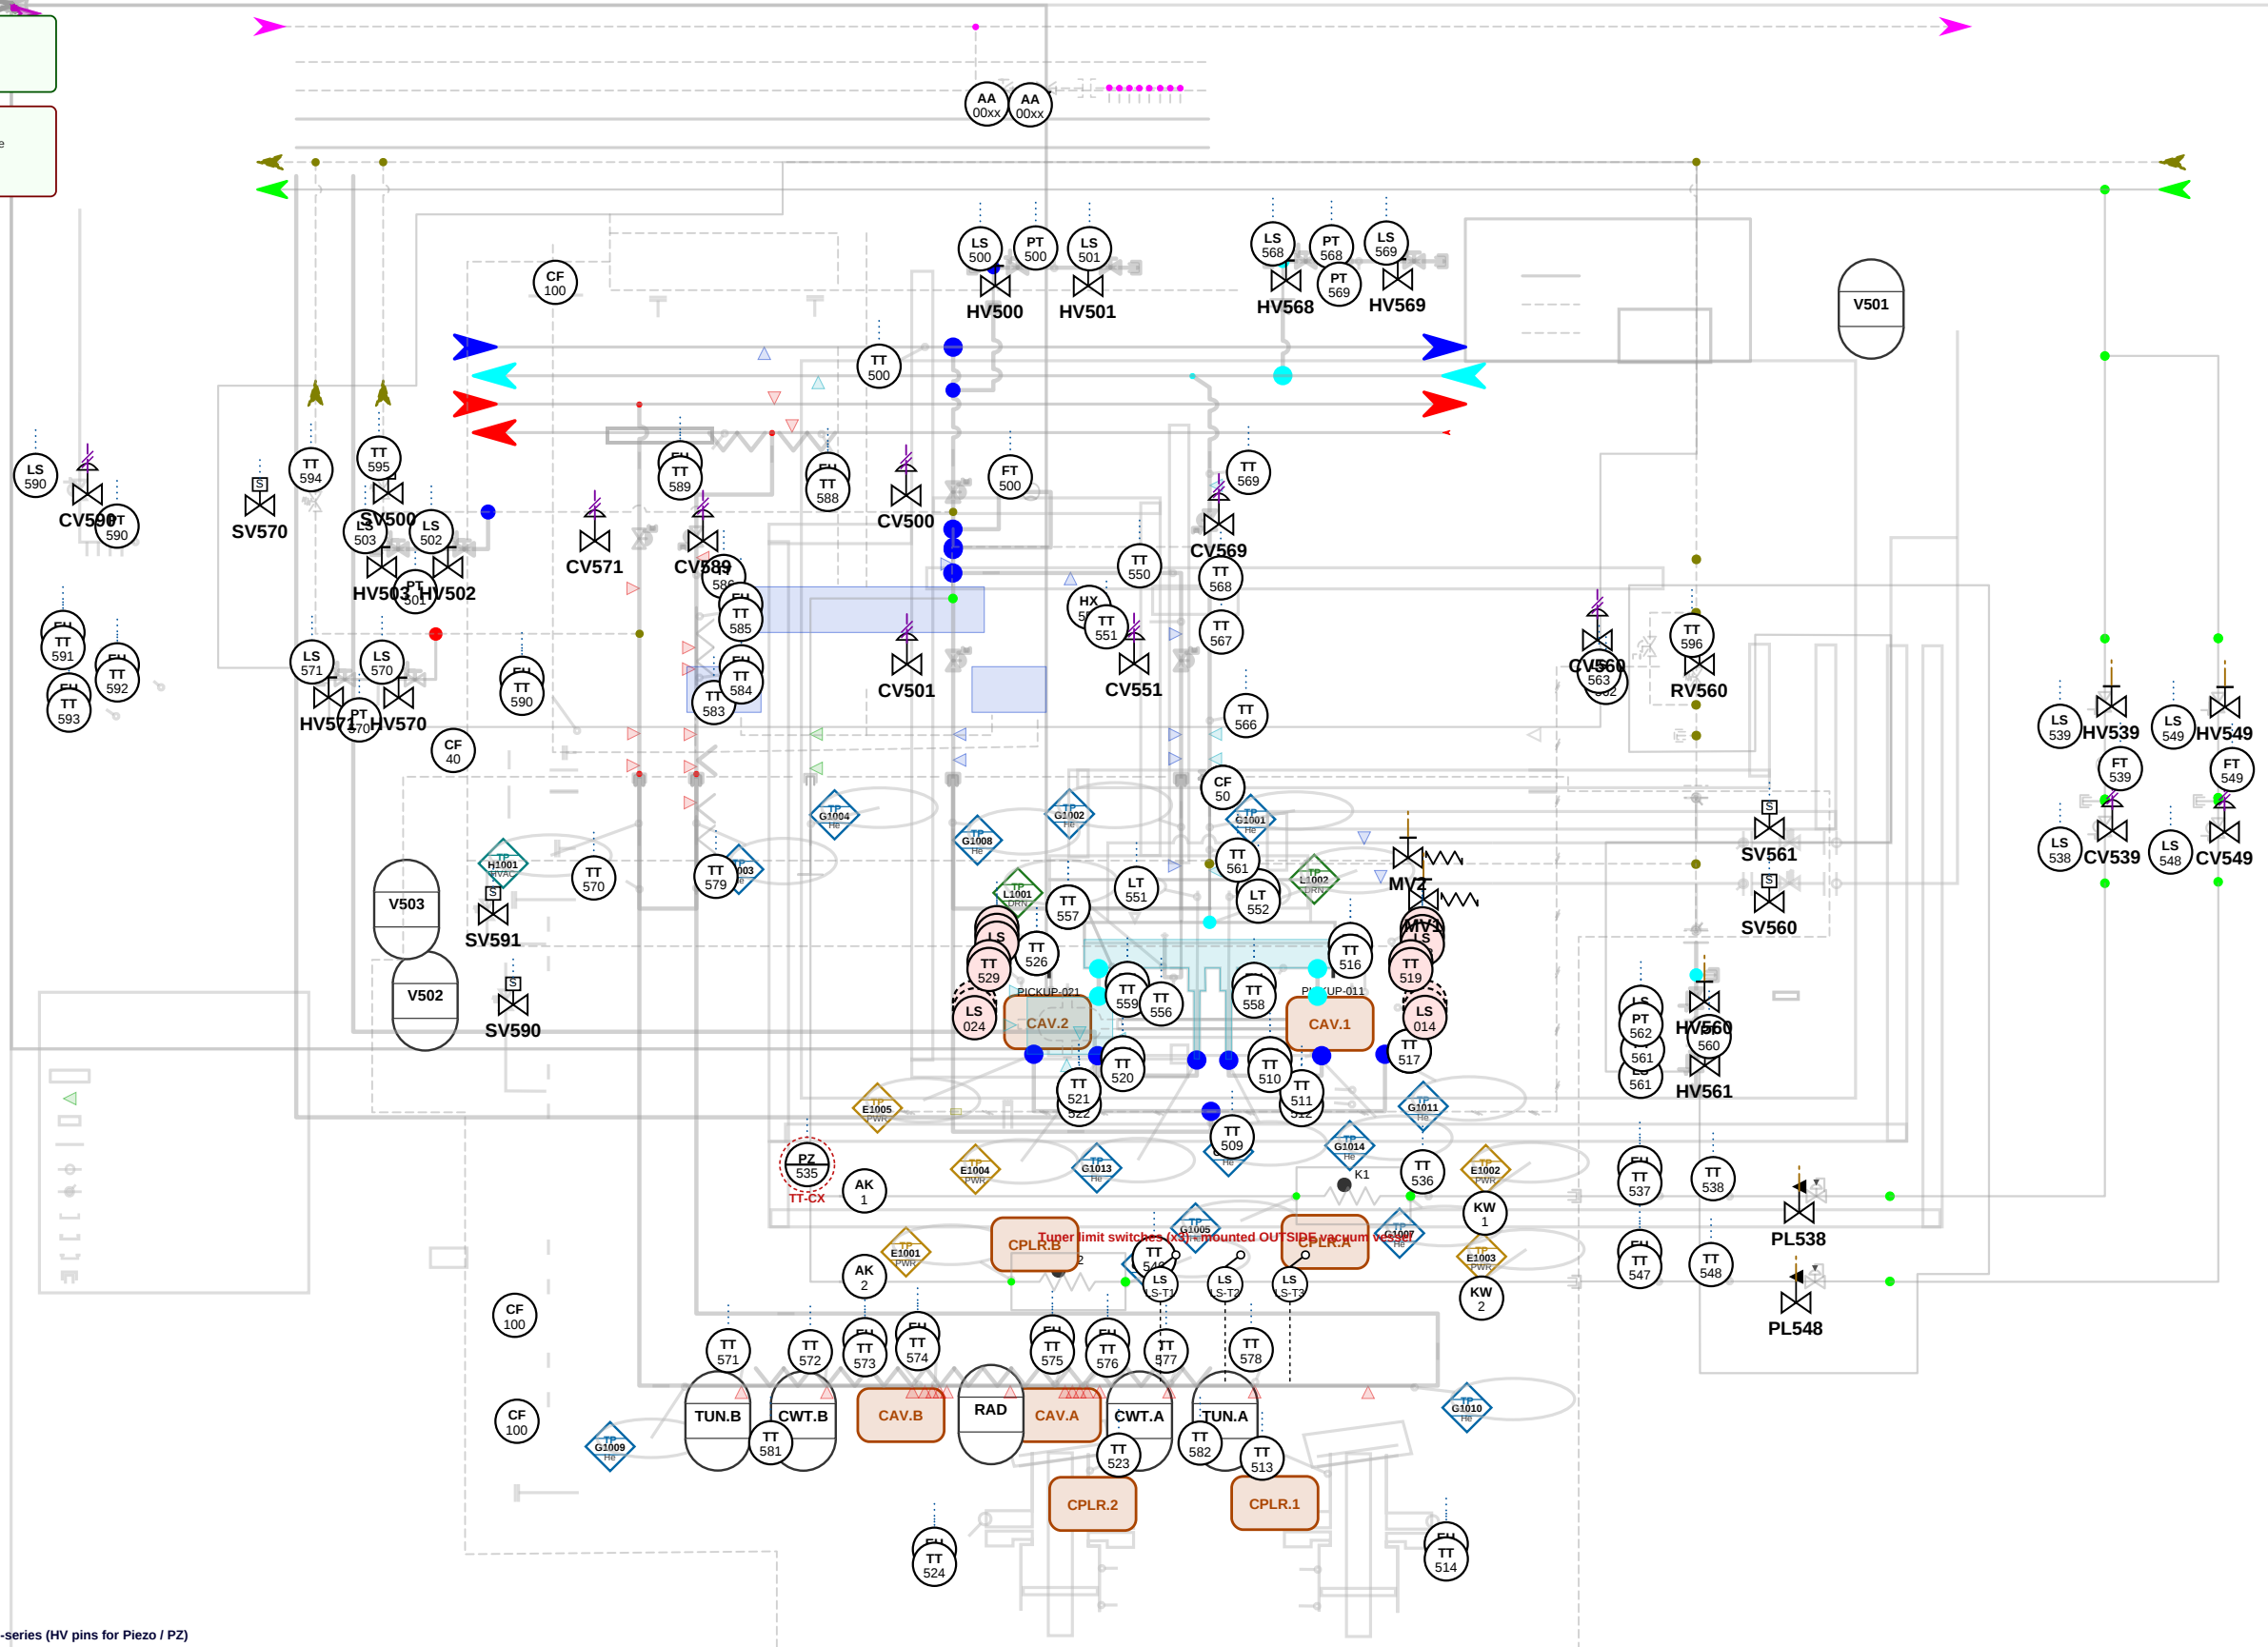

no B (HV/PZ)

CONSULTANT	CLIENT	REVISIONS	APPROVALS	MINERVA CryoCell - SCK CEN
Mott MacDonald	SCK CEN	Rev Date Description App'd	Designed QSYS	QCELL / LB - Instrumentation & Control
Bristol, UK	Boeretang 200, 2400 Mol, BE	C1 2026-06 v3 refinement - layers/legibil ACR	Drawn ACR	DWG No. =NA_PS01_PFB712
	MYRRHA / MINERVA Phase 1	B1 2026-05 v2 split sheets ACR	Checked ACR	MMD Proj. 411066
		A1 2026-04 First issue ACR	Approved PM	Scale NTS
				Suitability S2 - FOR ACCEPTANCE
				Security RESTRICTED
				Size / Std A3 / ISO10628 / ISA-5.1
				Sheet Sheet2 of 2 - Instrumentation
				Variant STANDARD