P&ID - RFCELL (seen by ACR) - Instrumentation & Control

STANDARD

COLD HEADER - Line A (4.5 K) / Line B (2 K)

THERMAL SHIELD - Line D (40 K in) / Line E (60 K out)

EQUIP. - cavities / vessels / heat exchangers

WARM PIPING SYSTEM (WPS) - Line W / S / U -> QRB handover

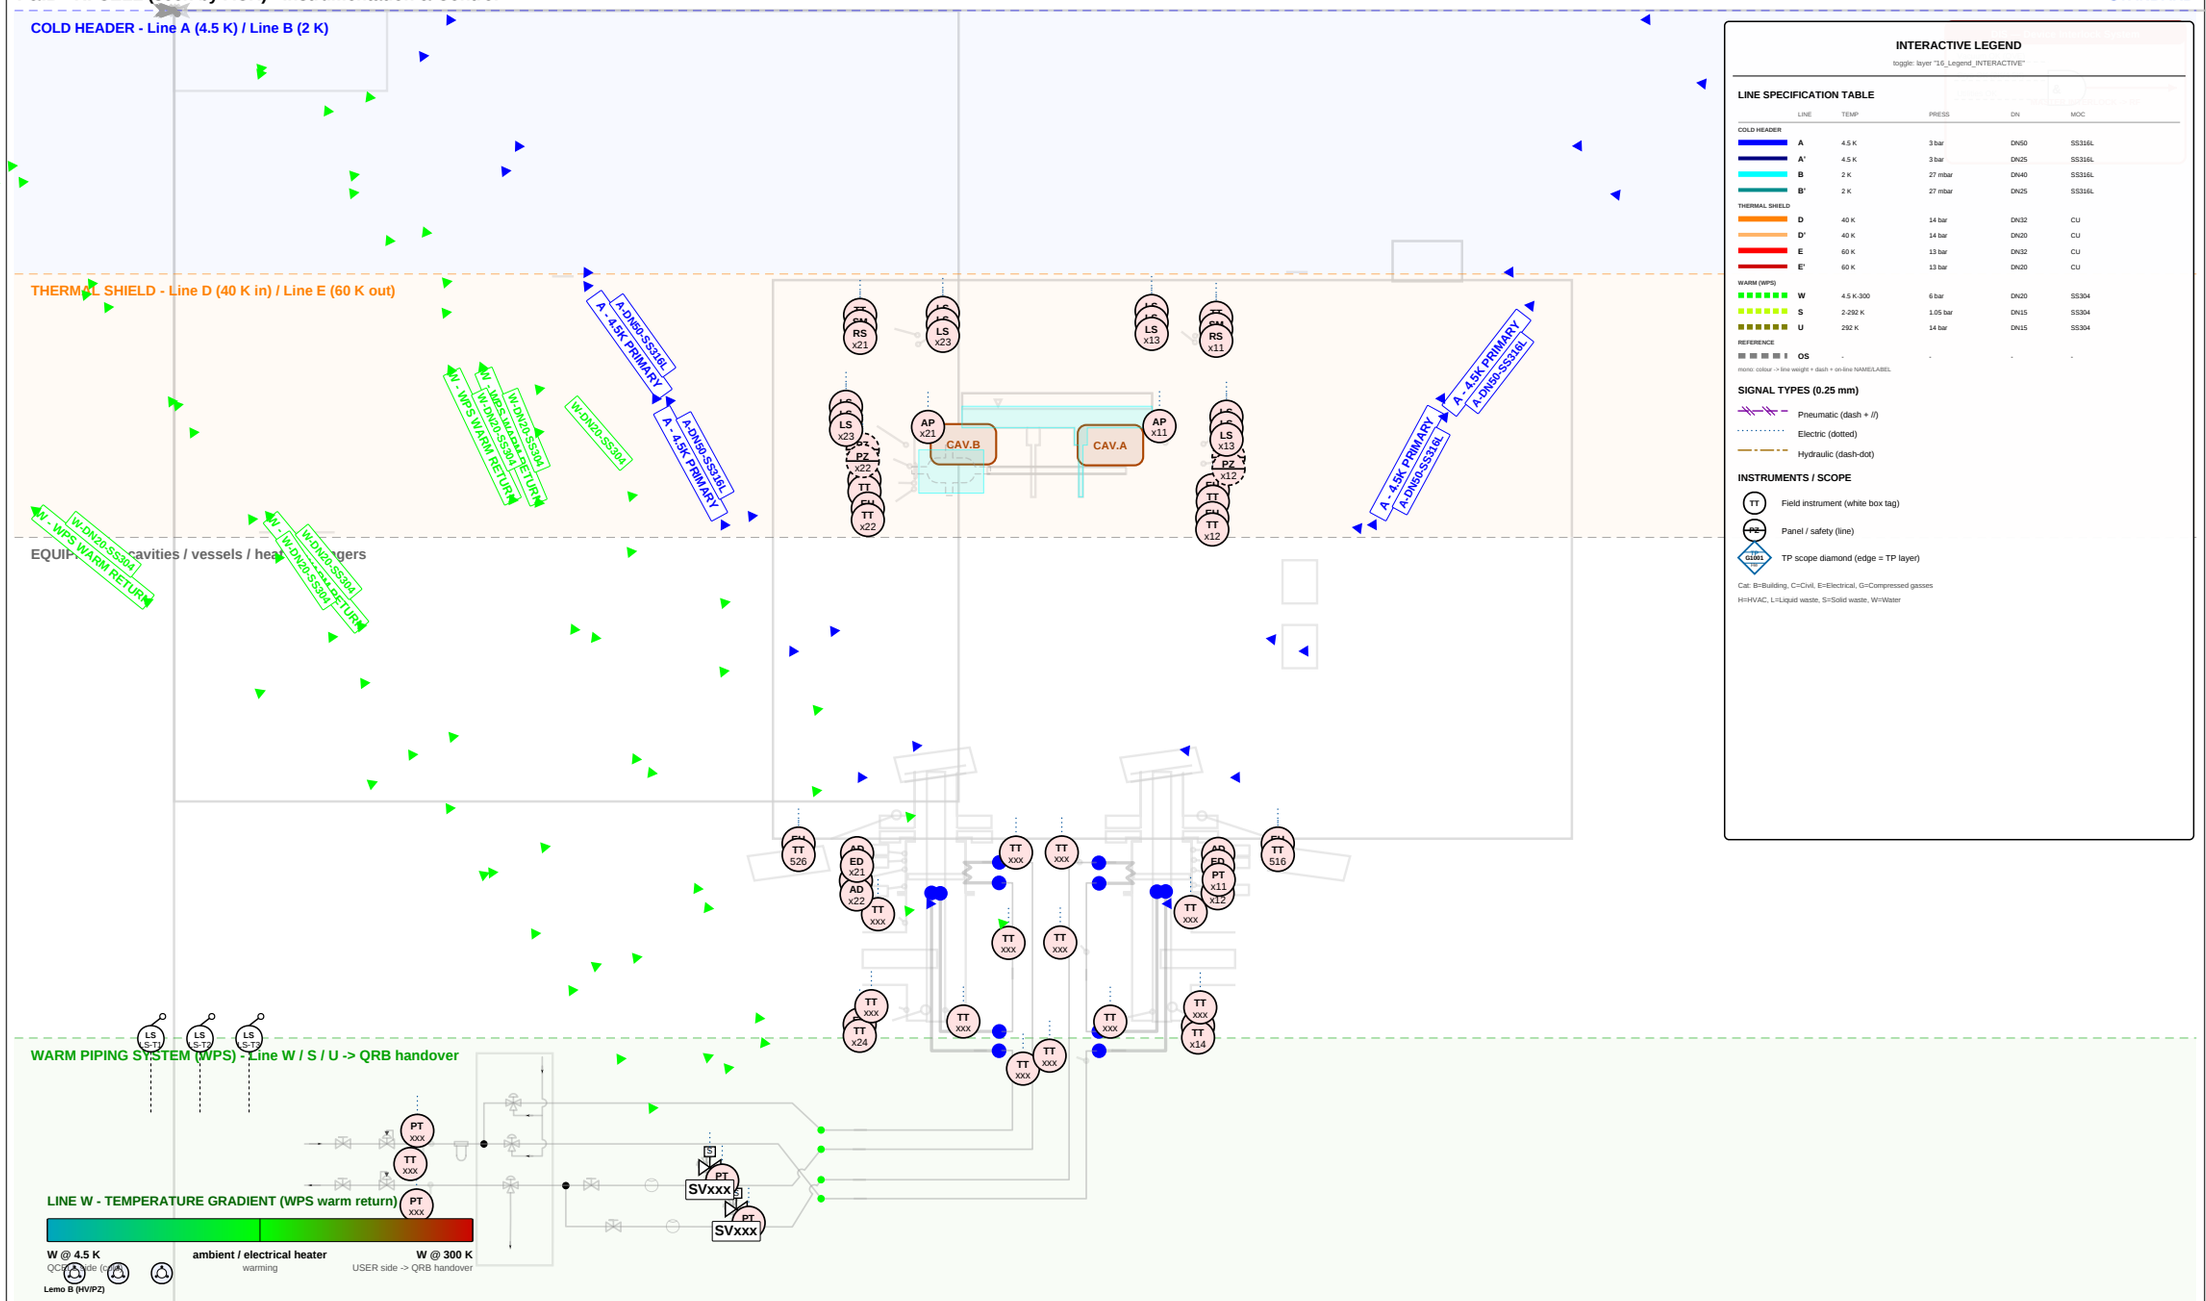

INTERACTIVE LEGEND

toggle: layer "16_Legend_INTERACTIVE"

LINE SPECIFICATION TABLE

	LINE	TEMP	PRESS	DN	MOC
COLD HEADER					
	A	4.5 K	3 bar	DN50	SS316L
	A'	4.5 K	3 bar	DN25	SS316L
	B	2 K	27 mbar	DN40	SS316L
	B'	2 K	27 mbar	DN25	SS316L
THERMAL SHIELD					
	D	40 K	14 bar	DN32	CU
	D'	40 K	14 bar	DN20	CU
	E	60 K	13 bar	DN32	CU
	E'	60 K	13 bar	DN20	CU
WARM (WPS)					
	W	4.5 K-300	6 bar	DN20	SS304
	S	2-292 K	1.05 bar	DN15	SS304
	U	292 K	14 bar	DN15	SS304
REFERENCE					
	OS	-	-	-	-

mono: colour -> line weight + dash + on-line NAME/LABEL

SIGNAL TYPES (0.25 mm)

- Pneumatic (dash + //)
- Electric (dotted)
- Hydraulic (dash-dot)

INSTRUMENTS / SCOPE

- TT — Field instrument (white box tag)
- PZ — Panel / safety (line)
- G1001 — TP scope diamond (edge = TP layer)

Cat: B=Building, C=Civil, E=Electrical, G=Compressed gasses
H=HVAC, L=Liquid waste, S=Solid waste, W=Water

CONSULTANT	CLIENT	REVISIONS	APPROVALS
Mott MacDonald	**SCK CEN**		Designed **QSYS**
Bristol, UK	Boeretang 200, 2400 Mol, BE		Drawn **ACR**
	MYRRHA / MINERVA Phase 1		Checked **ACR**
			Approved **PM**

Rev	Date	Description	App'd
C1	2026-06	v3 refinement - layers/legibil	ACR
B1	2026-05	v2 split sheets	ACR
A1	2026-04	First issue	ACR

MINERVA CryoCell - SCK CEN

RFCELL (seen by ACR) - Instrumentation & C

DWG No.	=NA.PS01_PFB713
MMD Proj.	411066
Scale	NTS
Suitability	S2 - FOR ACCEPTANCE
Security	RESTRICTED
Size / Std	A3 / ISO10628 / ISA-5.1
Sheet	Sheet2 of 2 - Instrumentation
Variant	STANDARD