

P&ID - RFCELL (seen by ACR) - Instrumentation & Control

CONTROL-CENTRIC / MONO

BUFFER VOLUMES
Liquid buffer: 7 L min
Vapour buffer: 5 L min

SCOPE HAND-OVER
Diamonds (TP / cat / next) mark the 'last-meter' hand-over between in-scope and out-of-scope assets.

DIS — Device Interlock System


Vacuum OK (QVE)

Cryo OK (2K/4.5K)

Utilities OK

&

MASTER INTERLOCK -> RF

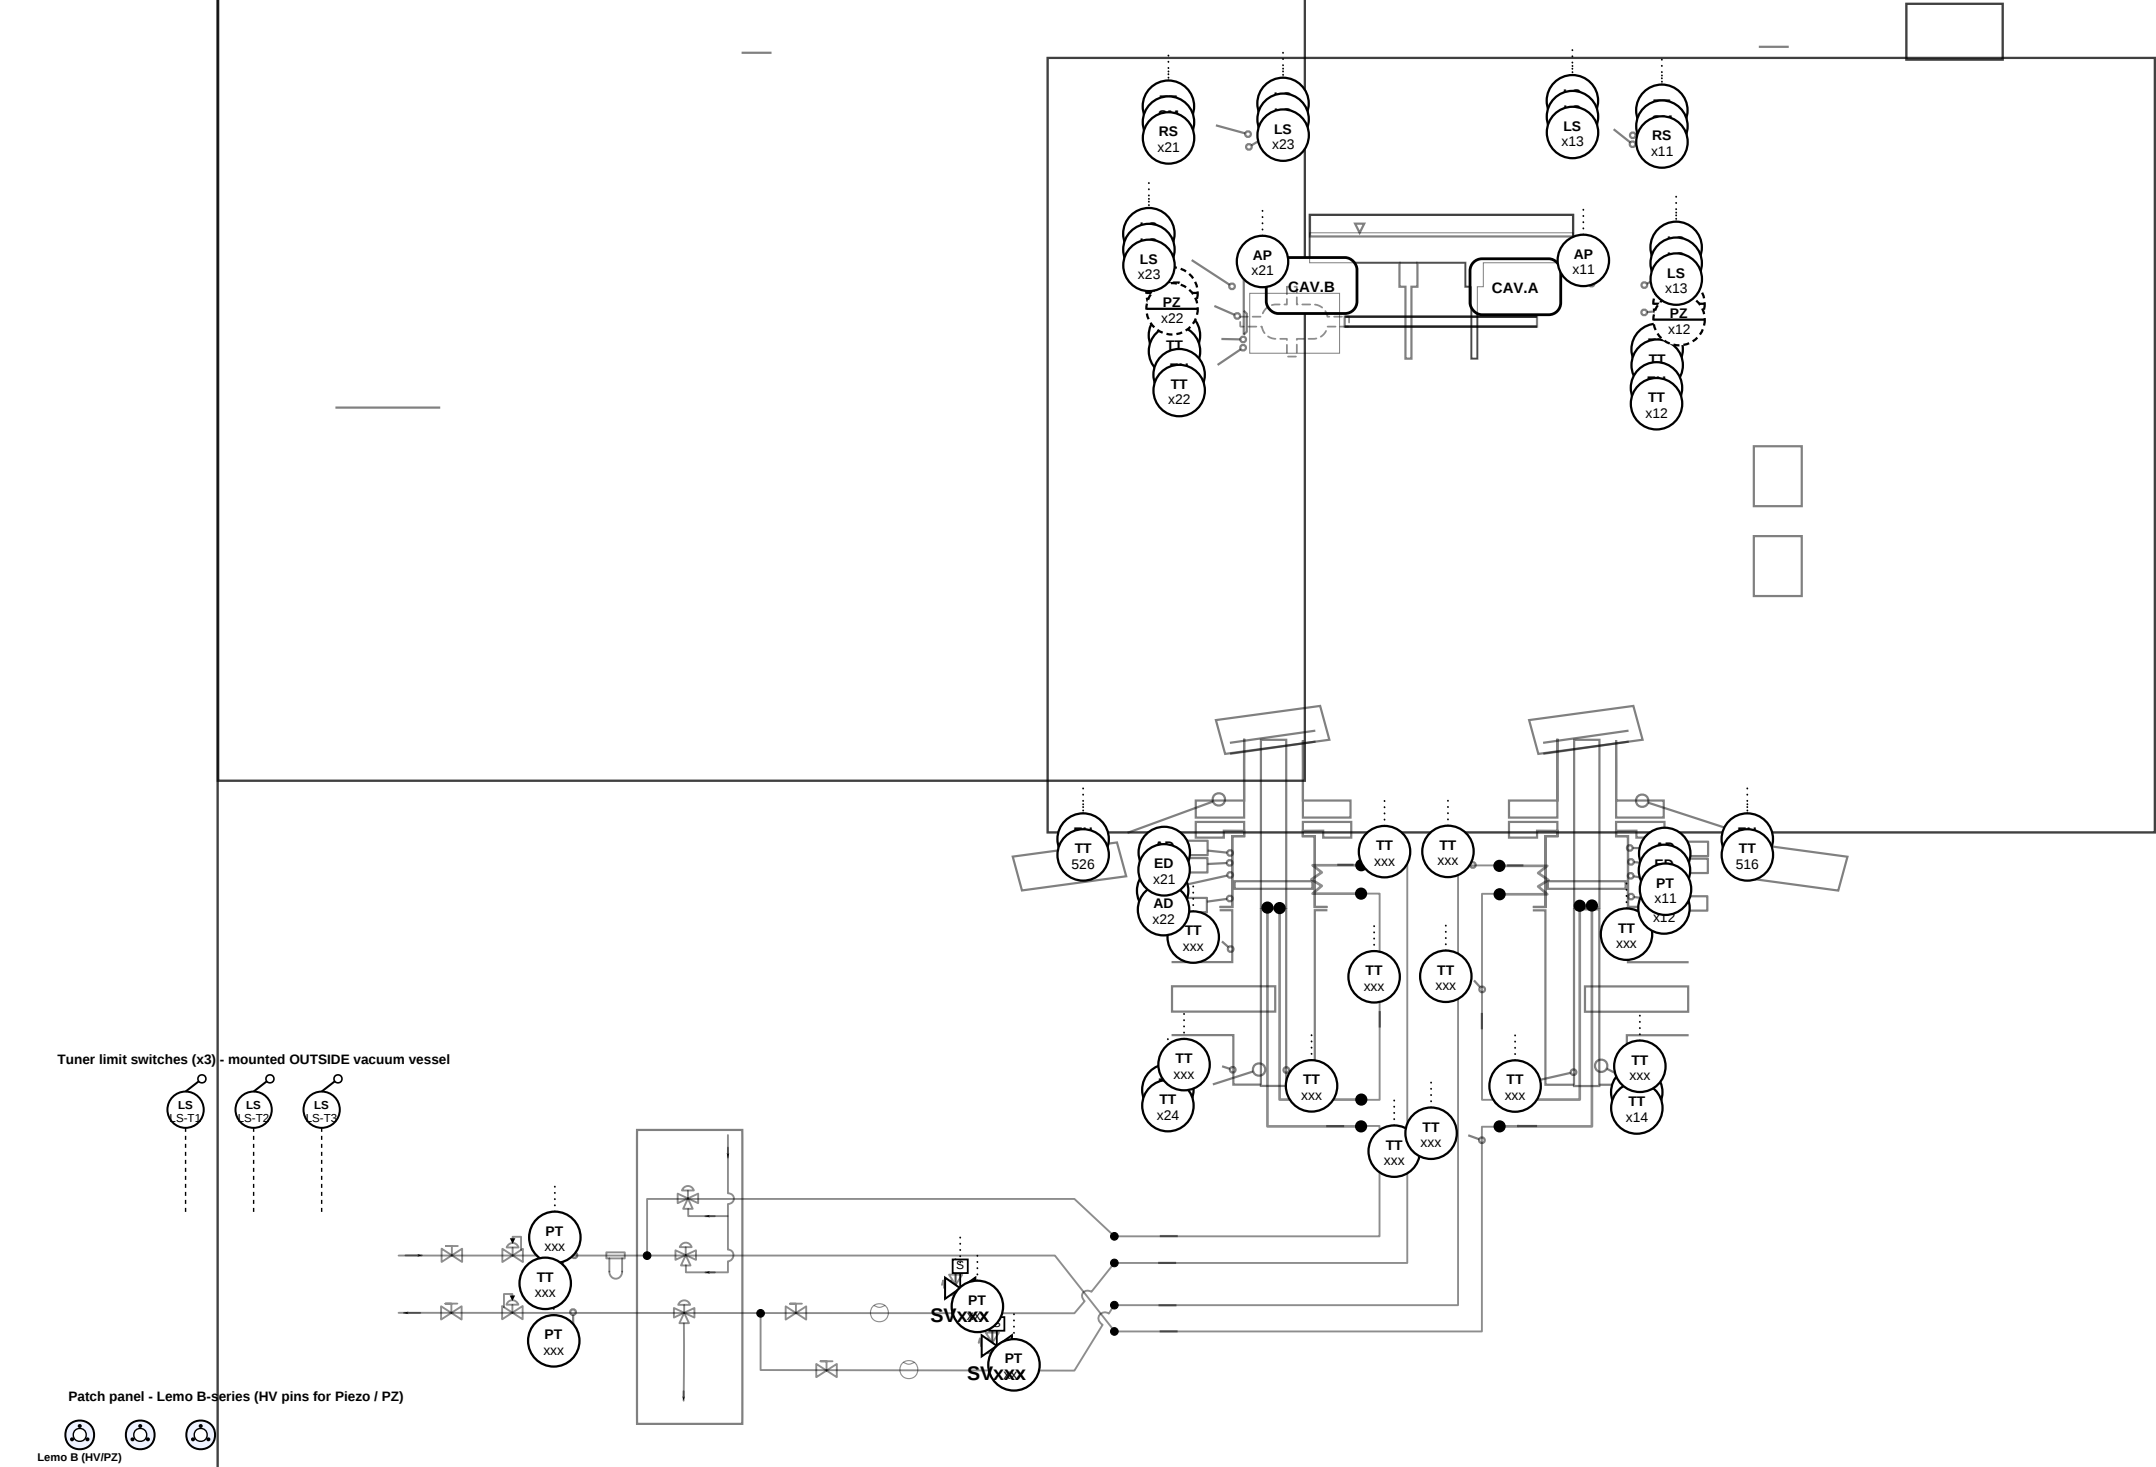

CONSULTANT Mott MacDonald Bristol, UK		CLIENT SCK CEN Boeretang 200, 2400 Mol, BE MYRRHA / MINERVA Phase 1	REVISIONS			App'd	APPROVALS		MINERVA CryoCell - SCK CEN RFCELL (seen by ACR) - Instrumentation & C DWG No. =NA.PS01_PFB713 MMD Proj. 411066 Scale NTS Suitability S2 - FOR ACCEPTANCE Security RESTRICTED Size / Std A3 / ISO10628 / ISA-5.1 Sheet Sheet2 of 2 - Instrumentation Variant CONTROL-CENTRIC_MONO
			Rev	Date	Description		Designed	QSYS	
			C1	2026-06	v3 refinement - layers/legibil		Drawn	ACR	
			B1	2026-05	v2 split sheets		Checked	ACR	
			A1	2026-04	First issue		Approved	PM	