




VISCON AUTOMATION

COMPANY / CUSTOMER	--	PI INDUSTRIES LTD.
PROJECT DESCRIPTION	--	6KL VCD SAP & LOP
TYPE OF MACHINE	--	VERTICAL CONE FILTER DRYER
JOB NUMBER	--	FND000699/2
DRAWING NUMBER -- VA-200		
QTY.	--	1 QTY
POWER SUPPLY	--	415V AC
CONTROL VOLTAGE	--	24V DC & 230V AC
NETFORM	--	102
REVISION	--	1
YEAR OF MANUFACTURING	--	2026
CREATED ON -- 19/02/2026		
EDIT DATE -- 31/03/2026		


MAVAG
Filtration & Drying

GMM
Pfaudler

SAP EXTERNAL GA

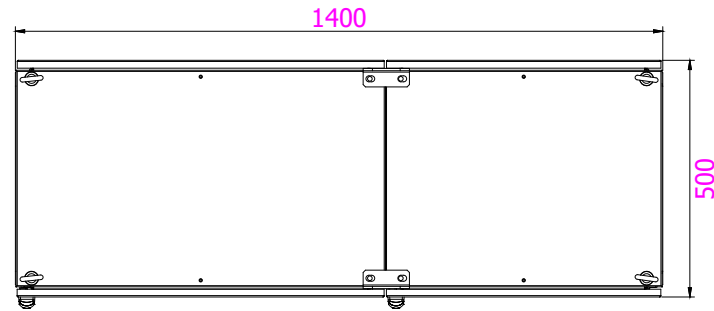


TOP VIEW

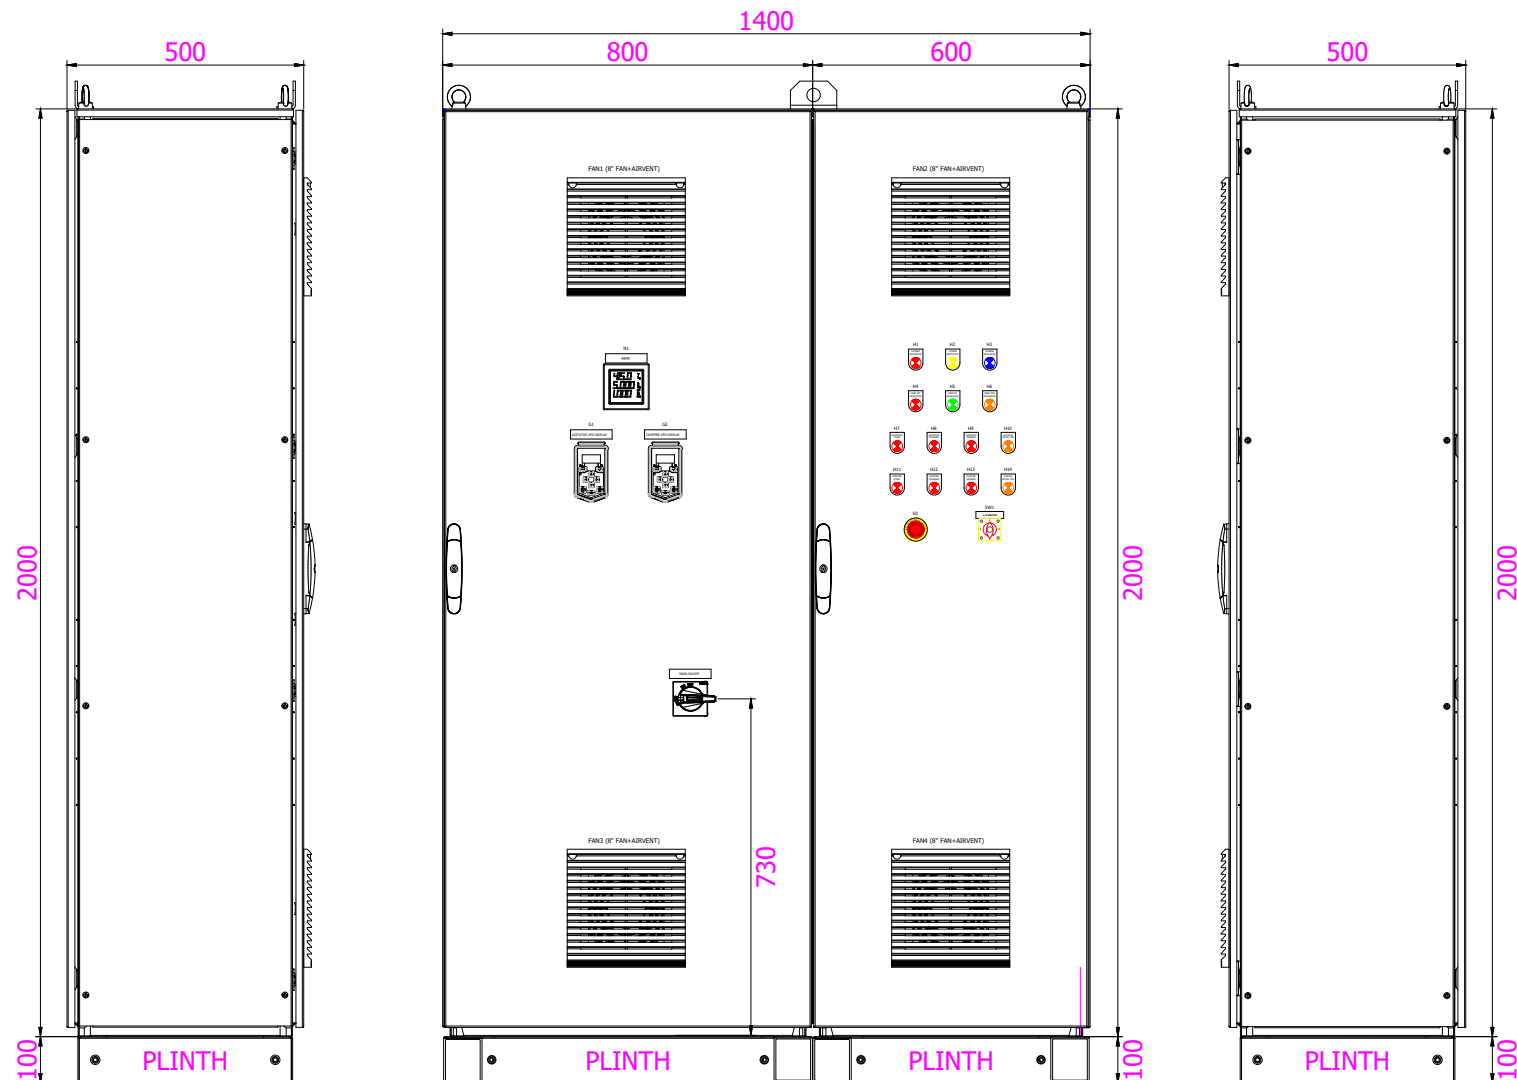

EXTERNAL
LHS VIEW

EXTERNAL FRONT VIEW

EXTERNAL
RHS VIEW

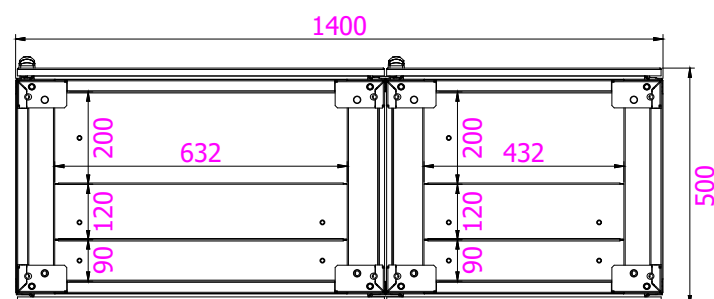


BOTTOM VIEW

	TECHNICAL SPECIFICATIONS ENCLOSURE	PANEL SIZE :- 2000x1400x500
1.	Enclosure -1:-	2000H X 800W X 500D (NCS20085R5)
2.	Enclosure -2:-	2000H X 600W X 500D (NCS20065R5)
3.	Height (H) :-	2000mm
4.	Width (W) :-	1400mm
5.	Depth (D) :-	500mm
6.	Mounting Plate Height :-	1894mm
7.	Mounting Plate Width :-	1294mm
8.	Max. Mounting Depth :-	459mm
9.	Color Code :-	RAL 7035
10.	Finish :-	Powder Coated
11.	Color :-	Light Gray

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : SAP EXTERNAL GA		= GEN
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 2
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	2 OF 102	

INTERNAL ARRANGEMENT GA

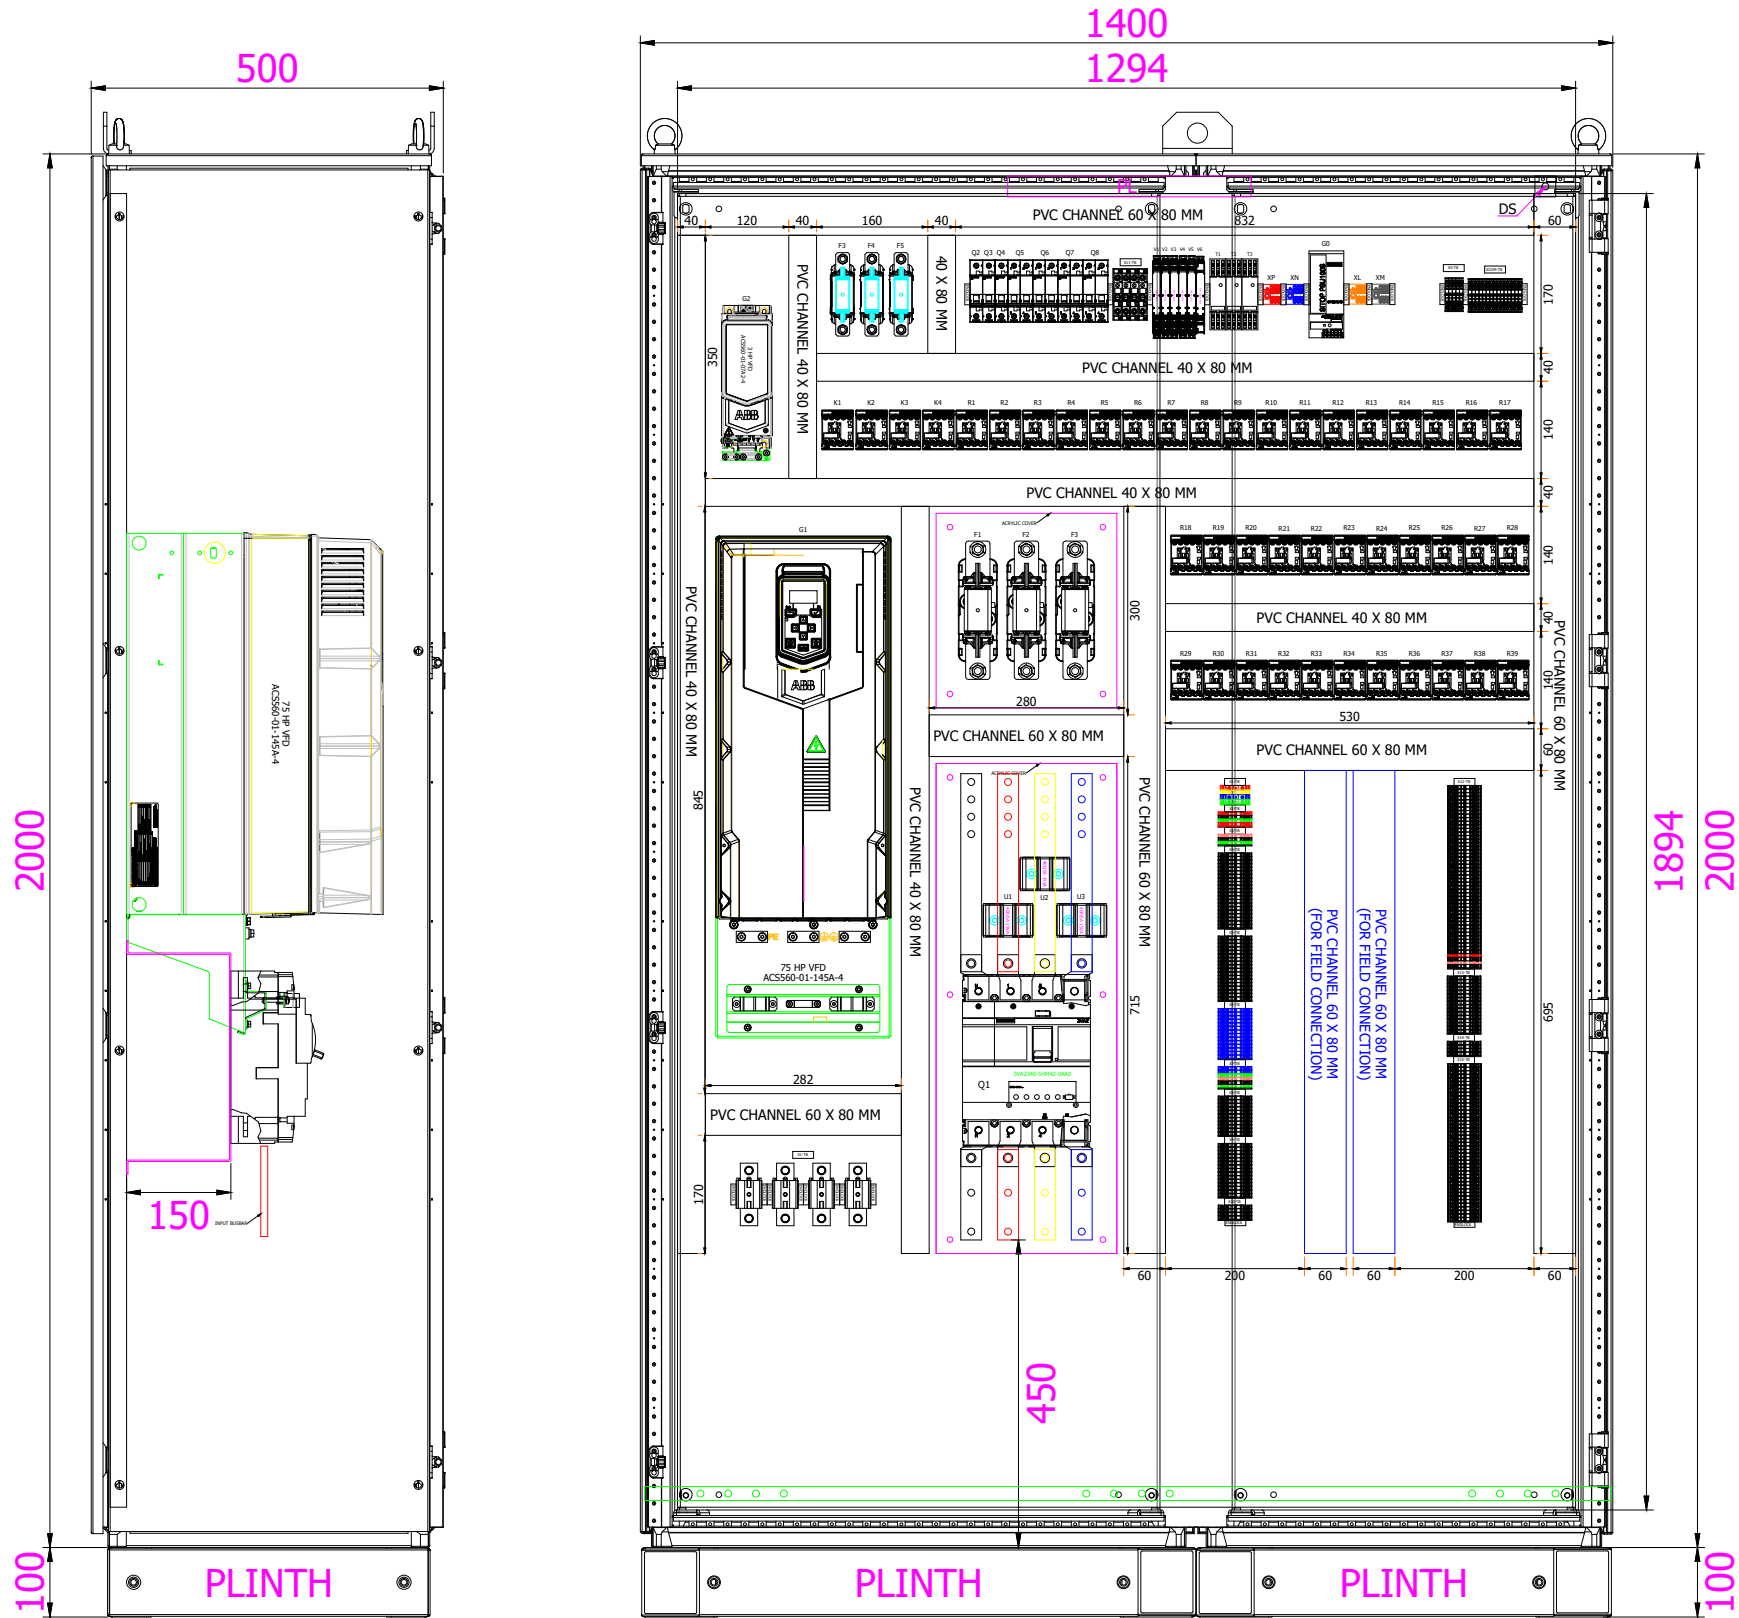


INTERNAL
LHS VIEW

INTERNAL FRONT VIEW

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : SAP INTERNAL GA	= GEN
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. : SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200 3 OF 102

LOP EXTERNAL GA

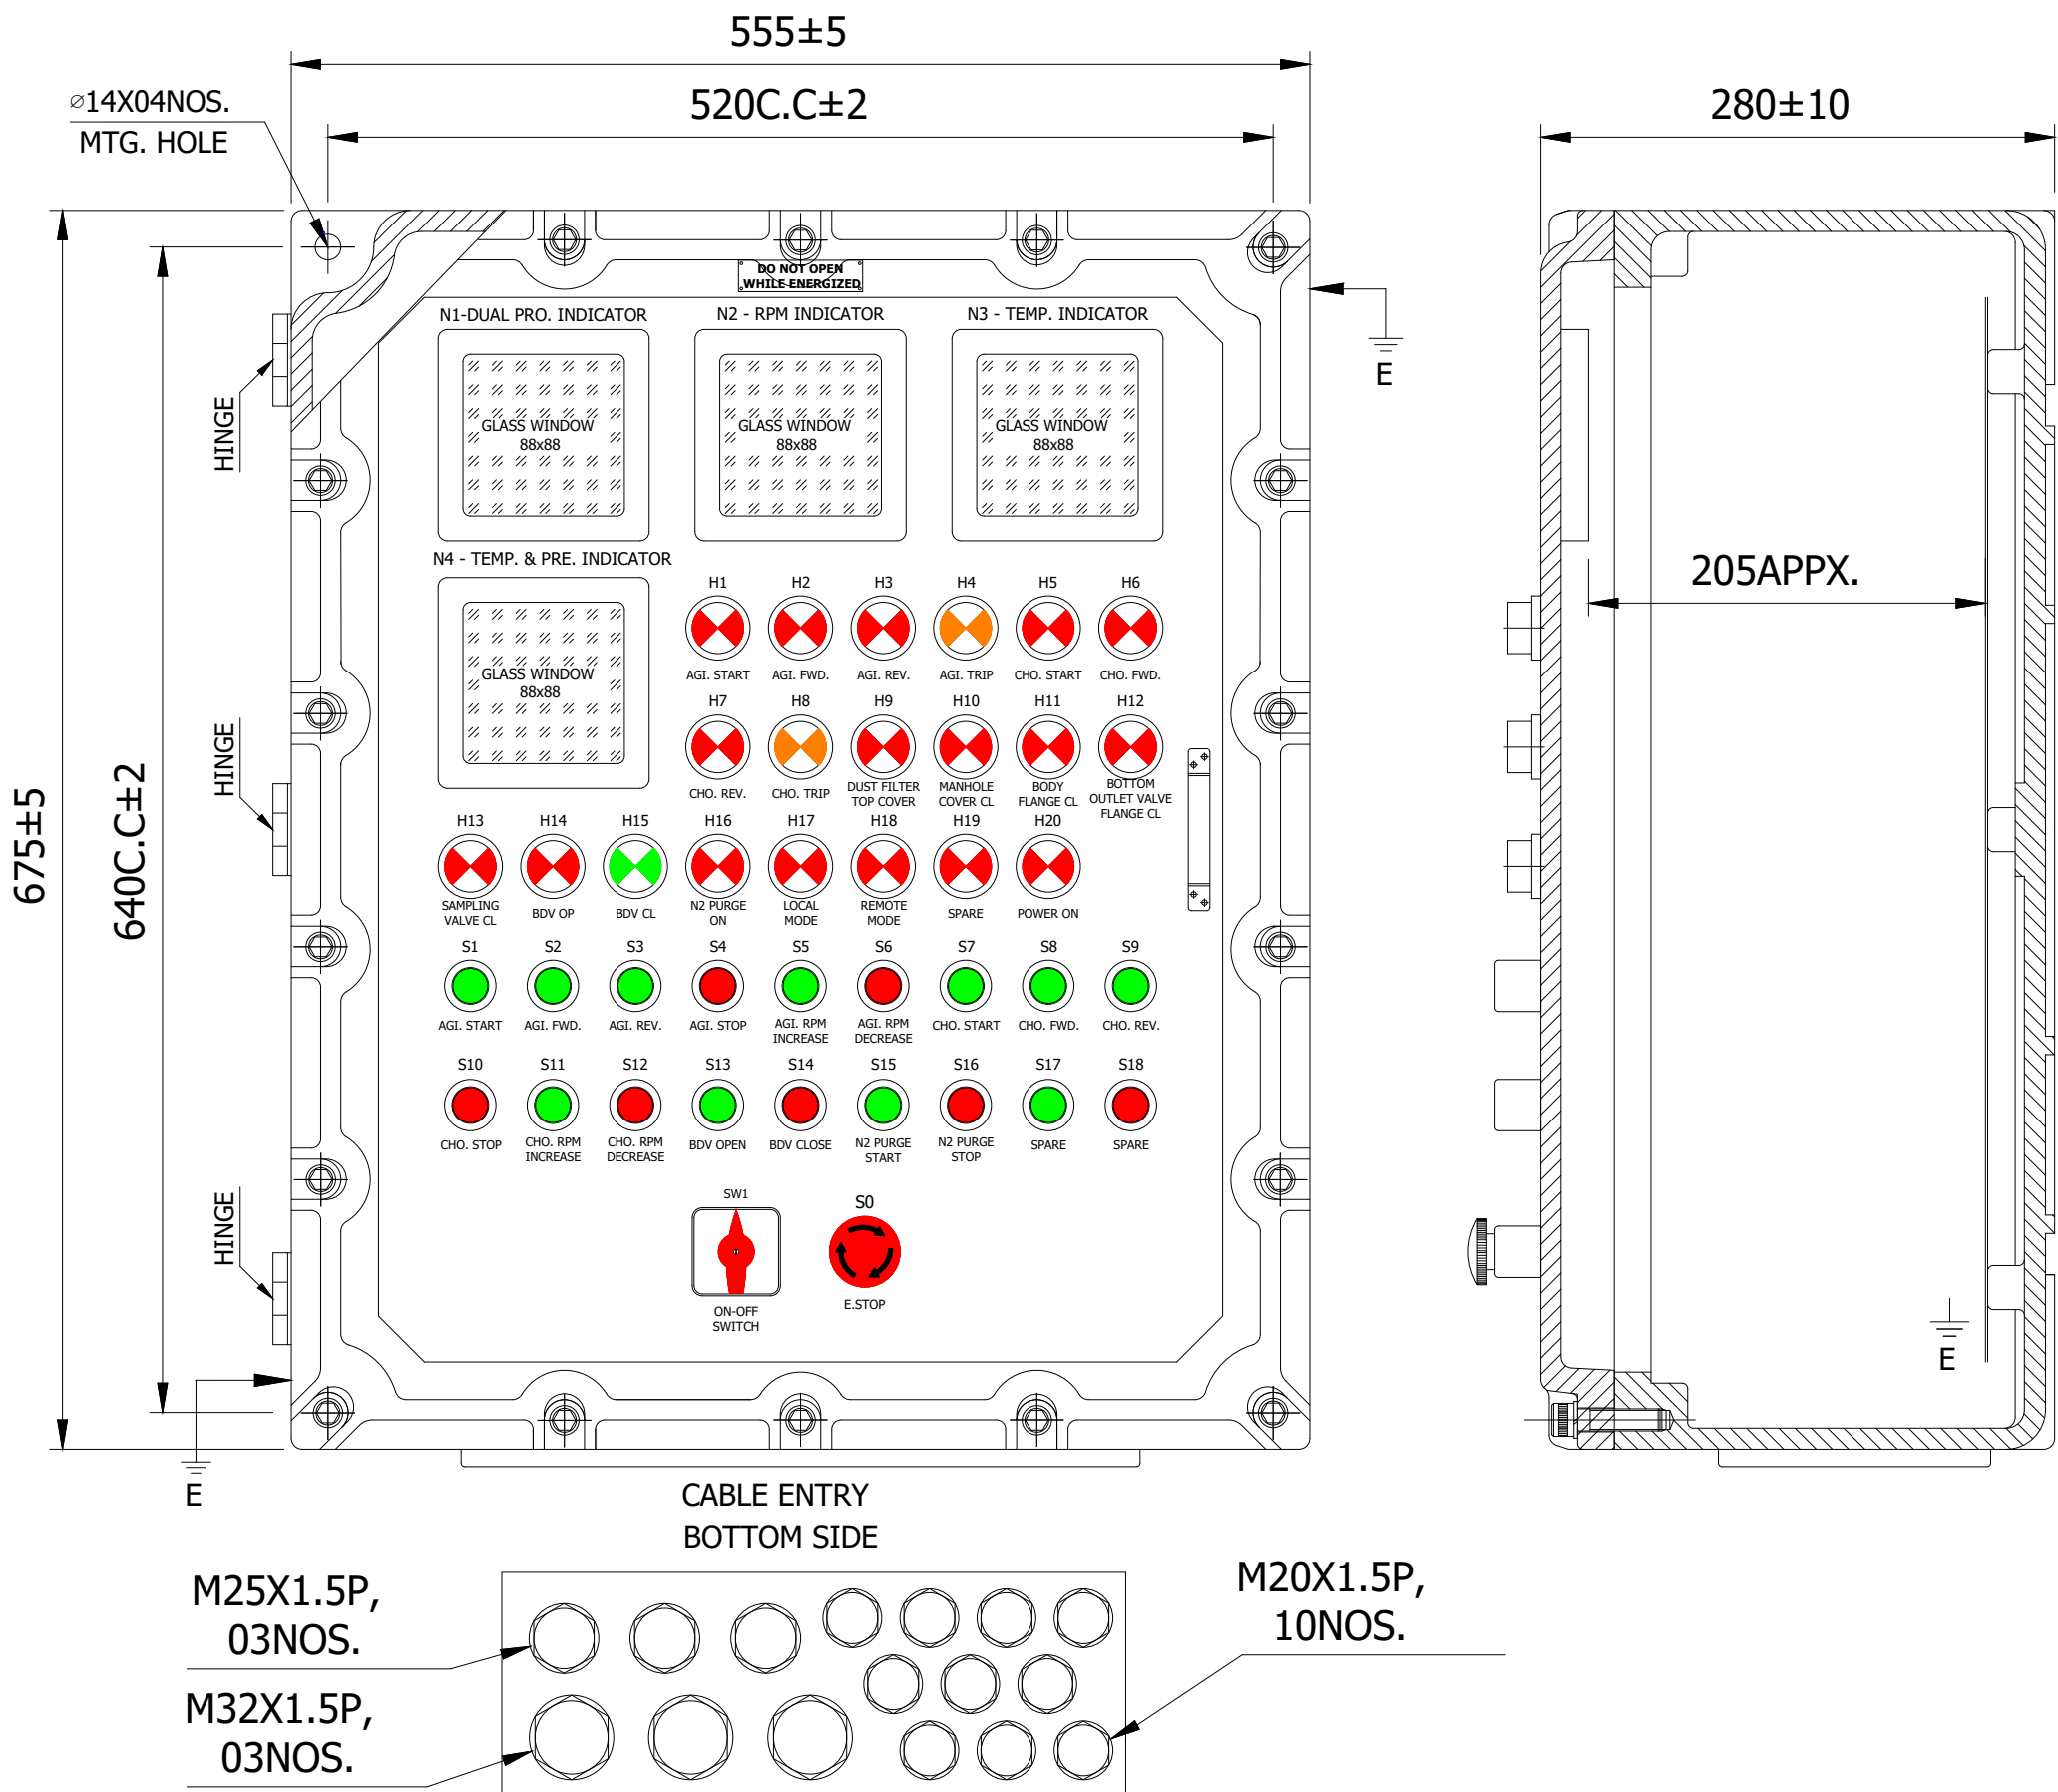

TECHNICAL DATA

ENCLOSURE TECHNICAL DATA

FLAMEPROOF PROTECTION :-
EX-d AS PER IS/IEC 60079-1:2014 SUITABLE FOR INSTALLATION
IN HAZARDOUS LOCATION OF GAS GROUP IIA & IIB, ZONE 1 & 2.

INGRESS PROTECTION :-
IP-65 AS PER IS/IEC 60529:2001 (REAFFIRMED 2014)

DUST IGNITION PROTECTION :-
(Ex 'db' IIB T6 Gb)(Ex tb/tc IIIC T85°C Db/Dc)
AS PER IS/IEC 60079-31:2013

TEMPERATURE CLASS :-
T6

ELECTRICAL RATING :-
UPTO 400Amp. at 1100V AC/DC

MATERIAL OF CONSTRUCTION :-
CAST AL ALLOY LM-6.

HARDWARE :-
STAINLESS STEEL/NICKEL PLATED STEEL

FINISH :-
DARK ADMIRALITY GREY SHADE 632 OF IS:5.

EARTHING :-
1 NO. INSIDE & 2 NOS. OUTSIDE


CABLE ENTRY :-
M32 X 1.5P - 03NOS.
M25 X 1.5P - 03NOS.
M20 X 1.5P - 10NOS.

FLP DC BRASS NI. PLATED CABLE GLAND :-
M32 X 1.5 - 02 NOS. (KCE - 5A)
M25 X 1.5 - 02 NOS. (KCE - 03)
M20 X 1.5 - 04 NOS. (KCE - 1S)
M20 X 1.5 - 03 NOS. (KCE - 01)
M20 X 1.5 - 02 NOS. (KCE - 02)

FLP BRASS NI. PLATED PLUG :-
M32 X 1.5 - 01 NOS.
M25 X 1.5 - 01 NOS.
M20 X 1.5 - 01 NOS.

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : LOP EXTERNAL GA	= GEN
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	Page : 4
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	4 OF 102

LOP INTERNAL GA

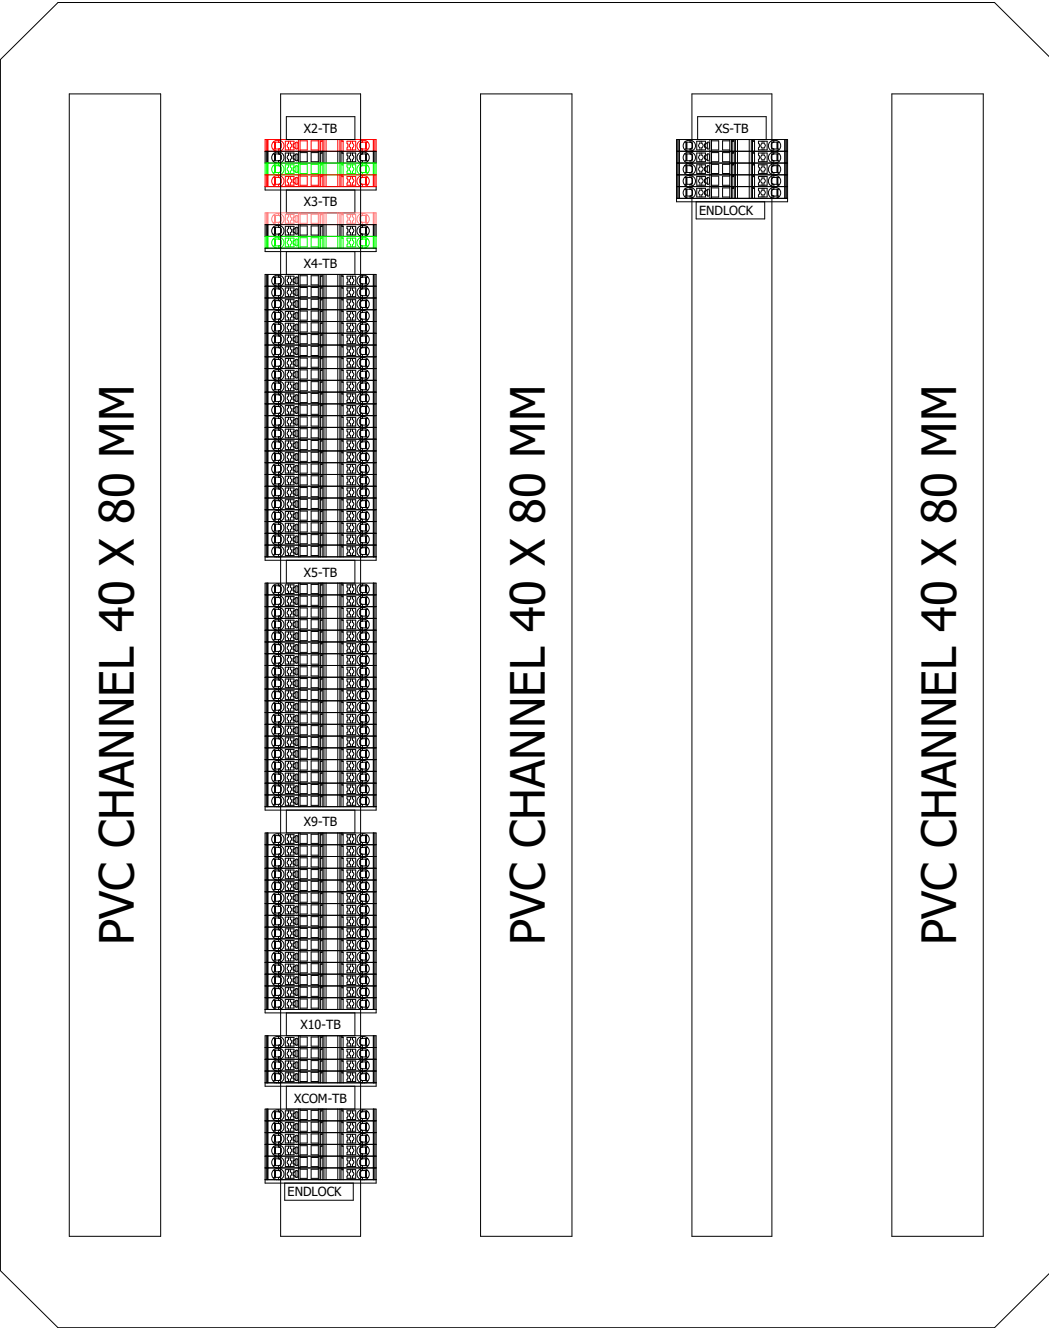

MATERIAL MOUNTING PLATE DETAILS

6										
01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : LOP INTERNAL GA		= GEN
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 5
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	5 OF 102

Structure identifier overview

Full designation	Labeling	Structure description
=GEN	Function designation	GENRAL INFORMATION
=VCD	Function designation	6KL VCD
=REPORT	Function designation	REPORTS
=SAP	Function designation	SAFE AREA CONTROL PANEL - 0325
+LOP	Location designation	FLAMEPROOF AREA LOCAL OPERATING PANEL - 0158
+CO	Location designation	CABLE OVERVIEW
+CD	Location designation	CABLE DIAGRAM
+TD	Location designation	TERMINAL DIAGRAM
+EXT	Location designation	EXTERNAL INSTALLATION
+JB	Location designation	JUNCTION BOX

Table of contents

Page	Page type	Page description	Date	Edited by
=GEN/1	Title page / cover sheet	Title page / cover sheet	30-03-2026	NAYAN PANCHAL
=GEN/2	Panel layout	SAP EXTERNAL GA	30-03-2026	NAYAN PANCHAL
=GEN/3	Panel layout	SAP INTERNAL GA	30-03-2026	NAYAN PANCHAL
=GEN/4	Panel layout	LOP EXTERNAL GA	31-03-2026	NAYAN PANCHAL
=GEN/5	Panel layout	LOP INTERNAL GA	30-03-2026	NAYAN PANCHAL
=GEN/6	Structure identifier overview	Structure identifier overview	02-03-2026	NAYAN PANCHAL
=GEN/7	Table of contents	Table of contents : =GEN/1 - =VCD/28	31-03-2026	NAYAN PANCHAL
=GEN/8	Table of contents	Table of contents : =VCD/29 - =REPORT+CD/56	31-03-2026	NAYAN PANCHAL
=GEN/9	Table of contents	Table of contents : =REPORT+CD/57 - =REPORT+TD/84	31-03-2026	NAYAN PANCHAL
=GEN/10	Table of contents	Table of contents : =REPORT+TD/85 - =REPORT+TD/102	31-03-2026	NAYAN PANCHAL
=GEN/11	Parts list	SAP & LOP - BILL OF MATERIALS	31-03-2026	NAYAN PANCHAL
=GEN/12	Parts list	SAP & LOP - BILL OF MATERIALS	31-03-2026	NAYAN PANCHAL
=GEN/13	Parts list	SAP & LOP - BILL OF MATERIALS	31-03-2026	NAYAN PANCHAL
=GEN/14	Parts list	SAP & LOP - BILL OF MATERIALS	31-03-2026	NAYAN PANCHAL
=GEN/15	Parts list	SAP & LOP - BILL OF MATERIALS	31-03-2026	NAYAN PANCHAL
=GEN/16	Parts list	SAP & LOP - BILL OF MATERIALS	31-03-2026	NAYAN PANCHAL
=GEN/17	Parts list	SAP & LOP - BILL OF MATERIALS	31-03-2026	NAYAN PANCHAL
=GEN/18	Parts list	SAP & LOP - BILL OF MATERIALS	31-03-2026	NAYAN PANCHAL
=GEN/19	Parts list	SAP & LOP - BILL OF MATERIALS	31-03-2026	NAYAN PANCHAL
=VCD/20	Schematic multi-line	MAIN SUPPLY	30-03-2026	NAYAN PANCHAL
=VCD/21	Schematic multi-line	PHASE INDICATION LAMP	30-03-2026	NAYAN PANCHAL
=VCD/22	Schematic multi-line	MFM METER AND DUAL PROCESS INDICATOR	30-03-2026	NAYAN PANCHAL
=VCD/23	Schematic multi-line	EMERGENCY	30-03-2026	NAYAN PANCHAL
=VCD/24	Schematic multi-line	PANEL LIGHT & FAN	30-03-2026	NAYAN PANCHAL
=VCD/25	Schematic multi-line	SMPS	30-03-2026	NAYAN PANCHAL
=VCD/26	Schematic multi-line	INDICATIONS	30-03-2026	NAYAN PANCHAL
=VCD/27	Schematic multi-line	VFD-1_AGITATOR MOTOR	31-03-2026	NAYAN PANCHAL
=VCD/28	Schematic multi-line	CONTROL WIRING	31-03-2026	NAYAN PANCHAL

Table of contents

Page	Page type	Page description	Date	Edited by
=VCD/29	Schematic multi-line	VFD-2_CHOPPER MOTOR	31-03-2026	NAYAN PANCHAL
=VCD/30	Schematic multi-line	CONTROL WIRING	30-03-2026	NAYAN PANCHAL
=VCD/31	Schematic multi-line	INDICATOR WIRING	30-03-2026	NAYAN PANCHAL
=VCD/32	Schematic multi-line	LOP CONTROL WIRING	30-03-2026	NAYAN PANCHAL
=VCD/33	Schematic multi-line	LOP CONTROL WIRING	31-03-2026	NAYAN PANCHAL
=VCD/34	Schematic multi-line	LOP CONTROL WIRING	30-03-2026	NAYAN PANCHAL
=VCD/35	Schematic multi-line	LOP CONTROL WIRING	30-03-2026	NAYAN PANCHAL
=VCD/36	Schematic multi-line	LOP CONTROL WIRING	30-03-2026	NAYAN PANCHAL
=VCD/37	Schematic multi-line	LOP CONTROL WIRING	30-03-2026	NAYAN PANCHAL
=VCD/38	Schematic multi-line	PROXY SWITCH	30-03-2026	NAYAN PANCHAL
=VCD/39	Schematic multi-line	PROXY SWITCH	30-03-2026	NAYAN PANCHAL
=VCD/40	Schematic multi-line	PROXY SWITCH	30-03-2026	NAYAN PANCHAL
=VCD/41	Schematic multi-line	PROXY SWITCH	30-03-2026	NAYAN PANCHAL
=VCD/42	Schematic multi-line	SOV	30-03-2026	NAYAN PANCHAL
=VCD/43	Schematic multi-line	RTD SENSOR & TRANSMITTER	30-03-2026	NAYAN PANCHAL
=VCD/44	Schematic multi-line	DCS DIGITAL INPUT	30-03-2026	NAYAN PANCHAL
=VCD/45	Schematic multi-line	DCS DIGITAL INPUT	30-03-2026	NAYAN PANCHAL
=VCD/46	Schematic multi-line	DCS DIGITAL OUTPUT	31-03-2026	NAYAN PANCHAL
=VCD/47	Schematic multi-line	DCS ANALOG OUTPUT	30-03-2026	NAYAN PANCHAL
=REPORT+CO/48	Cable overview	Cable overview : =VCD+-W0 - =VCD+JB-W13	30-03-2026	NAYAN PANCHAL
=REPORT+CD/49	Cable diagram	Cable diagram =VCD+-W0	30-03-2026	NAYAN PANCHAL
=REPORT+CD/50	Cable diagram	Cable diagram =VCD+-W1	30-03-2026	NAYAN PANCHAL
=REPORT+CD/51	Cable diagram	Cable diagram =VCD+-W2	30-03-2026	NAYAN PANCHAL
=REPORT+CD/52	Cable diagram	Cable diagram =VCD+-W4	30-03-2026	NAYAN PANCHAL
=REPORT+CD/53	Cable diagram	Cable diagram =VCD+-W5	30-03-2026	NAYAN PANCHAL
=REPORT+CD/54	Cable diagram	Cable diagram =VCD+-W6	30-03-2026	NAYAN PANCHAL
=REPORT+CD/55	Cable diagram	Cable diagram =VCD+-W6	30-03-2026	NAYAN PANCHAL
=REPORT+CD/56	Cable diagram	Cable diagram =VCD+-W7	30-03-2026	NAYAN PANCHAL

Table of contents

Page	Page type	Page description	Date	Edited by
=REPORT+CD/57	Cable diagram	Cable diagram =VCD+-W8	30-03-2026	NAYAN PANCHAL
=REPORT+CD/58	Cable diagram	Cable diagram =VCD+-W8	30-03-2026	NAYAN PANCHAL
=REPORT+CD/59	Cable diagram	Cable diagram =VCD+-W9	30-03-2026	NAYAN PANCHAL
=REPORT+CD/60	Cable diagram	Cable diagram =VCD+-W10	30-03-2026	NAYAN PANCHAL
=REPORT+CD/61	Cable diagram	Cable diagram =VCD+-W11	30-03-2026	NAYAN PANCHAL
=REPORT+CD/62	Cable diagram	Cable diagram =VCD+JB-W1	30-03-2026	NAYAN PANCHAL
=REPORT+CD/63	Cable diagram	Cable diagram =VCD+JB-W2	30-03-2026	NAYAN PANCHAL
=REPORT+CD/64	Cable diagram	Cable diagram =VCD+JB-W3	30-03-2026	NAYAN PANCHAL
=REPORT+CD/65	Cable diagram	Cable diagram =VCD+JB-W4	30-03-2026	NAYAN PANCHAL
=REPORT+CD/66	Cable diagram	Cable diagram =VCD+JB-W5	30-03-2026	NAYAN PANCHAL
=REPORT+CD/67	Cable diagram	Cable diagram =VCD+JB-W6	30-03-2026	NAYAN PANCHAL
=REPORT+CD/68	Cable diagram	Cable diagram =VCD+JB-W7	30-03-2026	NAYAN PANCHAL
=REPORT+CD/69	Cable diagram	Cable diagram =VCD+JB-W8	30-03-2026	NAYAN PANCHAL
=REPORT+CD/70	Cable diagram	Cable diagram =VCD+JB-W9	30-03-2026	NAYAN PANCHAL
=REPORT+CD/71	Cable diagram	Cable diagram =VCD+JB-W10	30-03-2026	NAYAN PANCHAL
=REPORT+CD/72	Cable diagram	Cable diagram =VCD+JB-W11	30-03-2026	NAYAN PANCHAL
=REPORT+CD/73	Cable diagram	Cable diagram =VCD+JB-W12	30-03-2026	NAYAN PANCHAL
=REPORT+CD/74	Cable diagram	Cable diagram =VCD+JB-W13	30-03-2026	NAYAN PANCHAL
=REPORT+TD/75	Terminal diagram	Terminal diagram =VCD+-X1	31-03-2026	NAYAN PANCHAL
=REPORT+TD/76	Terminal diagram	Terminal diagram =VCD+-X2	31-03-2026	NAYAN PANCHAL
=REPORT+TD/77	Terminal diagram	Terminal diagram =VCD+-X3	31-03-2026	NAYAN PANCHAL
=REPORT+TD/78	Terminal diagram	Terminal diagram =VCD+-X4	31-03-2026	NAYAN PANCHAL
=REPORT+TD/79	Terminal diagram	Terminal diagram =VCD+-X5	31-03-2026	NAYAN PANCHAL
=REPORT+TD/80	Terminal diagram	Terminal diagram =VCD+-X6	31-03-2026	NAYAN PANCHAL
=REPORT+TD/81	Terminal diagram	Terminal diagram =VCD+-X7	31-03-2026	NAYAN PANCHAL
=REPORT+TD/82	Terminal diagram	Terminal diagram =VCD+-X8	31-03-2026	NAYAN PANCHAL
=REPORT+TD/83	Terminal diagram	Terminal diagram =VCD+-X9	31-03-2026	NAYAN PANCHAL
=REPORT+TD/84	Terminal diagram	Terminal diagram =VCD+-X10	31-03-2026	NAYAN PANCHAL

Table of contents

Page	Page type	Page description	Date	Edited by
=REPORT+TD/85	Terminal diagram	Terminal diagram =VCD+-X12	31-03-2026	NAYAN PANCHAL
=REPORT+TD/86	Terminal diagram	Terminal diagram =VCD+-X12	31-03-2026	NAYAN PANCHAL
=REPORT+TD/87	Terminal diagram	Terminal diagram =VCD+-X13	31-03-2026	NAYAN PANCHAL
=REPORT+TD/88	Terminal diagram	Terminal diagram =VCD+-X14	31-03-2026	NAYAN PANCHAL
=REPORT+TD/89	Terminal diagram	Terminal diagram =VCD+-X15	31-03-2026	NAYAN PANCHAL
=REPORT+TD/90	Terminal diagram	Terminal diagram =VCD+-X15	31-03-2026	NAYAN PANCHAL
=REPORT+TD/91	Terminal diagram	Terminal diagram =VCD+-XCOM	31-03-2026	NAYAN PANCHAL
=REPORT+TD/92	Terminal diagram	Terminal diagram =VCD+-XS	31-03-2026	NAYAN PANCHAL
=REPORT+TD/93	Terminal diagram	Terminal diagram =VCD+LOP-X2	31-03-2026	NAYAN PANCHAL
=REPORT+TD/94	Terminal diagram	Terminal diagram =VCD+LOP-X3	31-03-2026	NAYAN PANCHAL
=REPORT+TD/95	Terminal diagram	Terminal diagram =VCD+LOP-X4	31-03-2026	NAYAN PANCHAL
=REPORT+TD/96	Terminal diagram	Terminal diagram =VCD+LOP-X5	31-03-2026	NAYAN PANCHAL
=REPORT+TD/97	Terminal diagram	Terminal diagram =VCD+LOP-X9	31-03-2026	NAYAN PANCHAL
=REPORT+TD/98	Terminal diagram	Terminal diagram =VCD+LOP-X10	31-03-2026	NAYAN PANCHAL
=REPORT+TD/99	Terminal diagram	Terminal diagram =VCD+LOP-XCOM	31-03-2026	NAYAN PANCHAL
=REPORT+TD/100	Terminal diagram	Terminal diagram =VCD+LOP-XS	31-03-2026	NAYAN PANCHAL
=REPORT+TD/101	Terminal diagram	Terminal diagram =VCD+JB-XJ	31-03-2026	NAYAN PANCHAL
=REPORT+TD/102	Terminal diagram	Terminal diagram =VCD+JB-XJ	31-03-2026	NAYAN PANCHAL

SAP & LOP - BILL OF MATERIAL

SR. NO.	DEVICE TAG	DESCRIPTION	MANUFACTURER	TYPE NUMBER	QUANTITY	PAGE REFERENCE
1	-EL1	Floor Standing, 2000X800X500, Combianble Enclosure, 1-Door, Mild Seel, IP55	nVent Hoffman	NCS20085R5	1	/2.1
2	-EL2	Floor Standing, 2000X600X500, Combianble Enclosure, 1-Door, Mild Seel, IP55	nVent Hoffman	NCS20065R5	1	/2.3
3	-LOP	Flameproof Operating Panel	Kaysons Techno	-	1	/4.1
4	-DS	Door Limit Switch 230V AC, 1 NO + 1 NC	Siemens	3SE30200AZ1	1	=VCD/24.1
5	-F1	250A, 690 Volt AC HRC Fuse with Fuse Base	Bussman	170M3816	1	=VCD/27.0
6	-F2	250A, 690 Volt AC HRC Fuse with Fuse Base	Bussman	170M3816	1	=VCD/27.1
7	-F3	250A, 690 Volt AC HRC Fuse with Fuse Base	Bussman	170M3816	1	=VCD/27.1
8	-F4	40A, 690 Volt AC HRC Fuse with Fuse Base	Bussman	170M2696	1	=VCD/29.0
9	-F5	40A, 690 Volt AC HRC Fuse with Fuse Base	Bussman	170M2696	1	=VCD/29.1
10	-F6	40A, 690 Volt AC HRC Fuse with Fuse Base	Bussman	170M2696	1	=VCD/29.1
11	-FAN 1	Panel Fan 8" Size with Metal Blade + Air Vent	Hicool	22A230HSAC	1	=VCD/24.1
12	-FAN 2	Panel Fan 8" Size with Metal Blade + Air Vent	Hicool	22A230HSAC	1	=VCD/24.2
13	-FAN 3	Panel Fan 8" Size with Metal Blade + Air Vent	Hicool	22A230HSAC	1	=VCD/24.3
14	-FAN 4	Panel Fan 8" Size with Metal Blade + Air Vent	Hicool	22A230HSAC	1	=VCD/24.4
15	-G0	SMPS 5 Amp, Single Phase 230 VAC Input, 24 V DC Output, Din Rail Mounted, SITOP PSU	Siemens	SIE.6EP1333-2BA20	1	=VCD/25.1
16	-G1	3-phase, 380–480 V, 55kW/105A Heavy Duty VFD	ABB	ACS560-01-145A-4	1	=VCD/27.0
17	-G1	Standard Assisant Panel Display	ABB	ACS-AP-S	1	=VCD/27.8
18	-G1	Door Mounting Kit	ABB	DPMP-EXT	1	=VCD/27.8
19	-G2	3-phase, 380–480 V, 2.2 kW/5.6A Heavy Duty VFD	ABB	ACS560-01-07A2-4	1	=VCD/29.0
20	-G2	Standard Assisant Panel Display	ABB	ACS-AP-S	1	=VCD/29.8
21	-G2	Door Mounting Kit	ABB	DPMP-EXT	1	=VCD/29.8
22	-H1	Red Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HC03	1	=VCD/21.4
23	-H2	Yellow Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HD03	1	=VCD/21.4
24	-H3	Blue Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HF03	1	=VCD/21.5
25	-H4	Red Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HC03	1	=VCD/20.2
26	-H5	Green Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HE03	1	=VCD/20.3
27	-H6	Amber Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HL03	1	=VCD/20.2
28	-H7	Red Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HC03	1	=VCD/26.2
29	-H8	Red Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HC03	1	=VCD/26.3

SAP & LOP - BILL OF MATERIAL

SR. NO.	DEVICE TAG	DESCRIPTION	MANUFACTURER	TYPE NUMBER	QUANTITY	PAGE REFERENCE
30	-H9	Red Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HC03	1	=VCD/26.4
31	-H10	Amber Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HL03	1	=VCD/26.5
32	-H11	Red Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HC03	1	=VCD/26.6
33	-H12	Red Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HC03	1	=VCD/26.7
34	-H13	Red Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HC03	1	=VCD/26.7
35	-H14	Amber Compact LED indicating lamp, Voltage: 220V/240V AC	Siemens	3SB5285-6HL03	1	=VCD/26.8
36	-K1	Auxiliary switch, on the front, 2 NO + 2 NC	Siemens	3RH2911-1NE22	1	=VCD/28.5
37	-K1	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/28.5
38	-K2	Auxiliary switch, on the front, 2 NO + 2 NC	Siemens	3RH2911-1NE22	1	=VCD/28.7
39	-K2	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/28.7
40	-K3	Auxiliary switch, on the front, 2 NO + 2 NC	Siemens	3RH2911-1NE22	1	=VCD/30.5
41	-K3	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/30.5
42	-K4	Auxiliary switch, on the front, 2 NO + 2 NC	Siemens	3RH2911-1NE22	1	=VCD/30.7
43	-K4	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/30.7
44	-N1	MFM Meter, Acc. CL: 0.5s, Aux. Supply: 80-300V AC/DC	Secure	Elite 444	1	=VCD/22.1
45	-PL	Led Tubelight, 1 Feet Lnog, Aux Supply : 230V AC, 5 WATT	Philips	ASTRALINE	1	=VCD/24.4
46	-Q1	Extended Door Mounted Rotary Operator (including 8UC handle) for 3VA13/14 400A/630A	Siemens	3VA9467-0FK51	1	=VCD/20.3
47	-Q1	Spreader Links - Broadened (with phase barriers) (one set = 4 links+ 3 phase barriers) for	Siemens	3VA9484-0QC50	2	=VCD/20.3
48	-Q1	Trip Alarm Switch (TAS) (1C/O)	Siemens	3VA9988-0AB12	2	=VCD/20.2
49	-Q1	Auxiliary Switch (AUX) (1C/O)	Siemens	3VA9988-0AA12	2	=VCD/20.3
50	-Q1	400A 4P 55kA MCCB, Release: Microprocessor Trip Unit, ETU330 LIG, Type: 3VA23	Siemens	3VA2340-5HM42-0AA0	1	=VCD/20.6
51	-Q2	2A 1P 10kA C-Curve MCB	Siemens	5SL41027RC	1	=VCD/21.4
52	-Q3	2A 1P 10kA C-Curve MCB	Siemens	5SL41027RC	1	=VCD/21.4
53	-Q4	2A 1P 10kA C-Curve MCB	Siemens	5SL41027RC	1	=VCD/21.5
54	-Q5	6A 2P 10kA C-Curve MCB	Siemens	5SL42067RC	1	=VCD/22.1
55	-Q6	6A 2P 10kA C-Curve MCB	Siemens	5SL42067RC	1	=VCD/23.1
56	-Q7	6A 2P 10kA C-Curve MCB	Siemens	5SL42067RC	1	=VCD/24.1
57	-Q8	6A 2P 10kA C-Curve MCB	Siemens	5SL42067RC	1	=VCD/25.1
58	-R1	Auxiliary switch, on the front, 4 NO	Siemens	3RH2911-1XA40-0MA0	1	=VCD/38.1

SAP & LOP - BILL OF MATERIAL

SR. NO.	DEVICE TAG	DESCRIPTION	MANUFACTURER	TYPE NUMBER	QUANTITY	PAGE REFERENCE
59	-R1	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/38.1
60	-R2	Auxiliary switch, on the front, 4 NO	Siemens	3RH2911-1XA40-0MA0	1	=VCD/38.2
61	-R2	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/38.2
62	-R3	Auxiliary switch, on the front, 4 NO	Siemens	3RH2911-1XA40-0MA0	1	=VCD/39.1
63	-R3	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/39.1
64	-R4	Auxiliary switch, on the front, 4 NO	Siemens	3RH2911-1XA40-0MA0	1	=VCD/39.2
65	-R4	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/39.2
66	-R5	Auxiliary switch, on the front, 4 NO	Siemens	3RH2911-1XA40-0MA0	1	=VCD/40.1
67	-R5	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/40.1
68	-R6	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/40.2
69	-R7	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/41.1
70	-R8	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/32.3
71	-R9	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/32.4
72	-R10	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/32.4
73	-R11	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/32.5
74	-R12	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/33.1
75	-R13	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 2NO + 2NC, Size: S00, Type: 3RH2	Siemens	3RH2122-1AP00	1	=VCD/33.2
76	-R14	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 2NO + 2NC, Size: S00, Type: 3RH2	Siemens	3RH2122-1AP00	1	=VCD/33.2
77	-R15	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/33.3
78	-R16	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/33.8
79	-R17	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/34.4
80	-R18	Auxiliary switch, on the front, 4 NO	Siemens	3RH2911-1XA40-0MA0	1	=VCD/28.3
81	-R18	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/28.3
82	-R19	Auxiliary switch, on the front, 4 NO	Siemens	3RH2911-1XA40-0MA0	1	=VCD/30.4
83	-R19	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/30.3
84	-R20	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/42.4
85	-R21	Auxiliary switch, on the front, 2 NO + 2 NC	Siemens	3RH2911-1NE22	1	=VCD/27.8
86	-R21	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/27.8
87	-R22	Auxiliary switch, on the front, 2 NC	Siemens	3RH2911-1MA02	1	=VCD/29.8

SAP & LOP - BILL OF MATERIAL

SR. NO.	DEVICE TAG	DESCRIPTION	MANUFACTURER	TYPE NUMBER	QUANTITY	PAGE REFERENCE
88	-R22	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/29.8
89	-R23	Auxiliary switch, on the front, 4 NC	Siemens	3RH2911-1XA04-0MA0	1	=VCD/42.6
90	-R23	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/42.6
91	-R24	Auxiliary switch, on the front, 4 NC	Siemens	3RH2911-1XA04-0MA0	1	=VCD/42.7
92	-R24	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/42.7
93	-R25	Auxiliary switch, on the front, 4 NC	Siemens	3RH2911-1XA04-0MA0	1	=VCD/42.8
94	-R25	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/42.8
95	-R26	Auxiliary switch, on the front, 4 NC	Siemens	3RH2911-1XA04-0MA0	1	=VCD/42.8
96	-R26	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/42.8
97	-R27	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/46.1
98	-R28	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/46.2
99	-R29	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/46.3
100	-R30	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/46.4
101	-R31	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/46.5
102	-R32	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/46.6
103	-R33	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/46.8
104	-R34	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/46.9
105	-R35	10A Auxiliary Contactor, Coil: 24V DC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1BB408K	1	=VCD/42.9
106	-R36	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/32.8
107	-R37	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/32.8
108	-R38	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/33.6
109	-R39	10A Auxiliary Contactor, Coil: 230V AC, Aux Contact: 4NO, Size: S00, Type: 3RH2	Siemens	3RH2140-1AP008K	1	=VCD/33.6
110	-S0	Red Mushroom push to trip, turn to release actuator(40 mm ø) for Emergency Stop	Siemens	3SB5000-0UC01	1	=VCD/23.1
111	-SW1	Contact block, 1 NC, screw terminal, front plate mounting	Siemens	3SB5400-0C	1	=VCD/42.6
112	-SW1	Key switch, 22 mm, round, plastic, 2 positions O-I, maintained	Siemens	3SB5000-4AB01	1	=VCD/42.6
113	-T1	Timing relay, electronic OFF delay 1 change-over contact	Siemens	3RP1533-1AP308K	1	=VCD/32.6
114	-T2	Timing relay, electronic OFF delay 1 change-over contact	Siemens	3RP1533-1AP308K	1	=VCD/33.4
115	-T3	Timing relay, Multifunction 1 change-over contact, 8 functions 15 time ranges	Siemens	3RP1505-1AW308K	1	=VCD/34.2
116	-U1	400/5A 15VA Acc. Cl: 0.5 Tape Wound Ring Type Current Transformer	TRIO	NA	1	=VCD/21.1

SAP & LOP - BILL OF MATERIAL

SR. NO.	DEVICE TAG	DESCRIPTION	MANUFACTURER	TYPE NUMBER	QUANTITY	PAGE REFERENCE
117	-U2	400/5A 15VA Acc. Cl: 0.5 Tape Wound Ring Type Current Transformer	TRIO	NA	1	=VCD/21.2
118	-U3	400/5A 15VA Acc. Cl: 0.5 Tape Wound Ring Type Current Transformer	TRIO	NA	1	=VCD/21.3
119	-V1	2-channel isolated barrier	Pepperl+Fuchs	KCD2-SR-EX2	1	=VCD/38.3
120	-V2	2-channel isolated barrier	Pepperl+Fuchs	KCD2-SR-EX2	1	=VCD/39.3
121	-V3	2-channel isolated barrier	Pepperl+Fuchs	KCD2-SR-EX2	1	=VCD/40.3
122	-V4	2-channel isolated barrier	Pepperl+Fuchs	KCD2-SR-EX2	1	=VCD/41.3
123	-V5	2-channel isolated barrier	Pepperl+Fuchs	KCD2-SR-EX2	1	=VCD/41.6
124	-V6	Solenoid Driver	Pepperl+Fuchs	KCD0-SD-EX1.1245	1	=VCD/42.1
125	-X1	Power - Bus-Bar Terminal	Elmex	DPBB70_RD	1	=VCD/27.0
126	-X1	Power - Bus-Bar Terminal	Elmex	DPBB70_YE	1	=VCD/27.1
127	-X1	Power - Bus-Bar Terminal	Elmex	DPBB70_BU	1	=VCD/27.1
128	-X1	Power - Bus-Bar Terminal	Elmex	DPBB70_GNYE	1	=VCD/27.1
129	-X1	4 Sq.mm Feed Through Terminal	Elmex	KUT 4_RD	1	=VCD/29.0
130	-X1	4 Sq.mm Feed Through Terminal	Elmex	KUT 4_YE	1	=VCD/29.1
131	-X1	4 Sq.mm Feed Through Terminal	Elmex	KUT 4_BU	1	=VCD/29.1
132	-X1	4 Sq.mm Feed Through Terminal	Elmex	KUT 4_GNYE	1	=VCD/29.1
133	-X2	Feed-through terminal block - PT 2,5 RD	Phoenix Contact	3209512	2	=VCD/23.4
134	-X2	Feed-through terminal block - PT 2,5 BK	Phoenix Contact	3212330	1	=VCD/23.5
135	-X2	Ground modular terminal block - PT 2,5-PE	Phoenix Contact	3209536	1	=VCD/23.5
136	-X3	Feed-through terminal block - PT 2,5 BN	Phoenix Contact	1176299	1	=VCD/23.7
137	-X3	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	1	=VCD/23.8
138	-X3	Ground modular terminal block - PT 2,5-PE	Phoenix Contact	3209536	1	=VCD/23.8
139	-X4	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	22	=VCD/32.1...=VCD/32.5
140	-X5	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	18	=VCD/35.1...=VCD/35.7
141	-X6	Feed-through terminal block - PT 2,5 BU	Phoenix Contact	3209523	14	=VCD/38.3
142	-X7	Feed-through terminal block - PT 2,5 BU	Phoenix Contact	3209523	2	=VCD/42.1
143	-X7	Ground modular terminal block - PT 2,5-PE	Phoenix Contact	3209536	2	=VCD/42.2
144	-X7	Feed-through terminal block - PT 2,5 BN	Phoenix Contact	1176299	1	=VCD/42.3
145	-X7	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	1	=VCD/42.5

SAP & LOP - BILL OF MATERIAL

SR. NO.	DEVICE TAG	DESCRIPTION	MANUFACTURER	TYPE NUMBER	QUANTITY	PAGE REFERENCE
146	-X8	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	11	=VCD/43.1...=VCD/43.6
147	-X9	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	15	=VCD/31.1
148	-X10	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	4	=VCD/22.5
149	-X11	Drop link type terminals for CT Shorting-RD	Elmex	KUTSD6NV_RD	1	=VCD/21.1
150	-X11	Drop link type terminals for CT Shorting-YE	Elmex	KUTSD6NV_YE	1	=VCD/21.2
151	-X11	Drop link type terminals for CT Shorting-BU	Elmex	KUTSD6NV_BU	1	=VCD/21.3
152	-X11	Drop link type terminals for CT Shorting-PE	Elmex	KUTSD6NV_GNYE	1	=VCD/21.1
153	-X12	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	47	=VCD/28.5
154	-X12	Feed-through terminal block - PT 2,5 BN	Phoenix Contact	1176299	1	=VCD/45.3
155	-X12	Feed-through terminal block - PT 2,5 RD	Phoenix Contact	3209512	1	=VCD/45.4
156	-X12	Feed-through terminal block - PT 2,5 BK	Phoenix Contact	3212330	1	=VCD/45.4
157	-X13	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	16	=VCD/46.0...=VCD/46.9
158	-X14	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	4	=VCD/47.0...=VCD/47.2
159	-X15	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	44	=VCD/27.2
160	-XCOM	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	15	=VCD/22.3
161	-XL	Distribution block nom. voltage: 450 V, nominal current: 24 A BN	Phoenix	PTFIX 6/6X2,5 BN	1	=VCD/25.3
162	-XM	Distribution block nom. voltage: 450 V, nominal current: 24 A GY	Phoenix	PTFIX 6/6X2,5 GY	1	=VCD/25.5
163	-XN	Distribution block nom. voltage: 450 V, nominal current: 24 A BK	Phoenix	PTFIX 6/6X2,5 BK	1	=VCD/23.2
164	-XP	Distribution block nom. voltage: 450 V, nominal current: 24 A RD	Phoenix	PTFIX 6/6X2,5 RD	1	=VCD/23.1
165	-XS	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	5	=VCD/47.3
166	-H1	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/35.1
167	-H2	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/35.1
168	-H3	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/35.2
169	-H4	22.5mm LED Indicator Lamp Amber Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/35.3
170	-H5	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/35.4
171	-H6	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/35.5
172	-H7	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/35.6
173	-H8	22.5mm LED Indicator Lamp Amber Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/35.7
174	-H9	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/36.1

SAP & LOP - BILL OF MATERIAL

SR. NO.	DEVICE TAG	DESCRIPTION	MANUFACTURER	TYPE NUMBER	QUANTITY	PAGE REFERENCE
175	-H10	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/36.1
176	-H11	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/36.2
177	-H12	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/36.3
178	-H13	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/36.4
179	-H14	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/36.5
180	-H15	22.5mm LED Indicator Lamp Green Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/36.6
181	-H16	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/36.7
182	-H17	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/36.8
183	-H18	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/36.8
184	-H19	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/37.1
185	-H20	22.5 mm LED Indicator Lamp Red Color 240V AC	Vaishno-Hotline	2XVLDIL-BN (240V AC)	1	=VCD/37.1
186	-N1	Dual Process Indicator, 96 X 96 Size, 230V AC Aux. Supply, Model : DPI 122	Multispan	DPI 122	1	=VCD/22.5
187	-N2	Dual Channel Indicator	Masibus	LC5296-DC-CCU211	1	=VCD/31.0
188	-N3	Dual Channel Indicator	Masibus	LC5296-DC-99U211	1	=VCD/31.3
189	-N4	Dual Channel Indicator	Masibus	LC5296-DC-9CU211	1	=VCD/31.7
190	-S0	Single contact block, NC type	Vaishno-Hotline	ES-3	2	=VCD/32.1
191	-S0	Emergency Stop,Switching OFF Head Trigger and Latching Turn Release	Vaishno-Hotline	2XVAPR	1	=VCD/32.1
192	-S1	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/32.3
193	-S1	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/32.3
194	-S2	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/32.4
195	-S2	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/32.4
196	-S3	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/32.4
197	-S3	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/32.4
198	-S4	Single contact block, NC type	Vaishno-Hotline	ES-3	1	=VCD/32.5
199	-S4	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/32.7
200	-S4	Red Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/32.5
201	-S5	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/32.8
202	-S5	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/32.8
203	-S6	Single contact block, NC type	Vaishno-Hotline	ES-3	1	=VCD/32.8

SAP & LOP - BILL OF MATERIAL

SR. NO.	DEVICE TAG	DESCRIPTION	MANUFACTURER	TYPE NUMBER	QUANTITY	PAGE REFERENCE
204	-S6	Red Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/32.8
205	-S7	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/33.1
206	-S7	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/33.1
207	-S8	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/33.2
208	-S8	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/33.2
209	-S9	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/33.2
210	-S9	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/33.2
211	-S10	Single contact block, NC type	Vaishno-Hotline	ES-3	1	=VCD/33.3
212	-S10	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/33.5
213	-S10	Red Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/33.3
214	-S11	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/33.6
215	-S11	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/33.6
216	-S12	Single contact block, NC type	Vaishno-Hotline	ES-3	1	=VCD/33.6
217	-S12	Red Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/33.6
218	-S13	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/33.8
219	-S13	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/33.8
220	-S14	Single contact block, NC type	Vaishno-Hotline	ES-3	1	=VCD/33.9
221	-S14	Red Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/33.9
222	-S15	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/34.2
223	-S15	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/34.2
224	-S16	Single contact block, NC type	Vaishno-Hotline	ES-3	1	=VCD/34.4
225	-S16	Red Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/34.4
226	-S17	Single contact block, NO type	Vaishno-Hotline	ES-2	1	=VCD/34.5
227	-S17	Green Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/34.5
228	-S18	Single contact block, NC type	Vaishno-Hotline	ES-3	1	=VCD/34.6
229	-S18	Red Pushbutton-Flameproof Spring Type	Vaishno-Hotline	-	1	=VCD/34.6
230	-SW1	Power ON-OFF selector switch, 6 A 4 pole on-off	Salzer	-	1	=VCD/23.4
231	-X2	Feed-through terminal block - PT 2,5 RD	Phoenix Contact	3209512	2	=VCD/23.4
232	-X2	Feed-through terminal block - PT 2,5 BK	Phoenix Contact	3212330	1	=VCD/23.5

SAP & LOP - BILL OF MATERIAL


SR. NO.	DEVICE TAG	DESCRIPTION	MANUFACTURER	TYPE NUMBER	QUANTITY	PAGE REFERENCE
233	-X2	Ground modular terminal block - PT 2,5-PE	Phoenix Contact	3209536	1	=VCD/23.5
234	-X3	Feed-through terminal block - PT 2,5 BN	Phoenix Contact	1176299	1	=VCD/23.7
235	-X3	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	1	=VCD/23.8
236	-X3	Ground modular terminal block - PT 2,5-PE	Phoenix Contact	3209536	1	=VCD/23.8
237	-X4	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	24	=VCD/32.1...=VCD/32.5
238	-X5	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	19	=VCD/35.1...=VCD/35.7
239	-X9	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	15	=VCD/31.1
240	-X10	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	4	=VCD/22.5
241	-XCOM	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	6	=VCD/31.2
242	-XS	Feed-through terminal block - PT 2,5	Phoenix Contact	3209510	5	=VCD/47.3
243	-P1	Inductive sensor	Pepperl+Fuchs	P+F.NCB4-12GM40-N0-V1	1	=VCD/38.3
244	-P2	Inductive sensor	Pepperl+Fuchs	P+F.NCB4-12GM40-N0-V1	1	=VCD/38.4
245	-P3	Inductive sensor	Pepperl+Fuchs	P+F.NCB4-12GM40-N0-V1	1	=VCD/39.3
246	-P4	Inductive sensor	Pepperl+Fuchs	P+F.NCB4-12GM40-N0-V1	1	=VCD/39.4
247	-P5	Inductive sensor	Pepperl+Fuchs	P+F.NCB4-12GM40-N0-V1	1	=VCD/40.3
248	-P6	Inductive sensor	Pepperl+Fuchs	P+F.NCB4-12GM40-N0-V1	1	=VCD/40.4
249	-P7	Inductive sensor	Pepperl+Fuchs	P+F.NCB4-12GM40-N0-V1	1	=VCD/41.3

21


01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : MAIN SUPPLY		= VCD
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION	 VIS-CON AUTOMATION	VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 20
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	20 OF 102	

22

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : MFM METER AND DUAL PROCESS INDICATOR	= VCD
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : Page : 22
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. : SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200 22 OF 102	

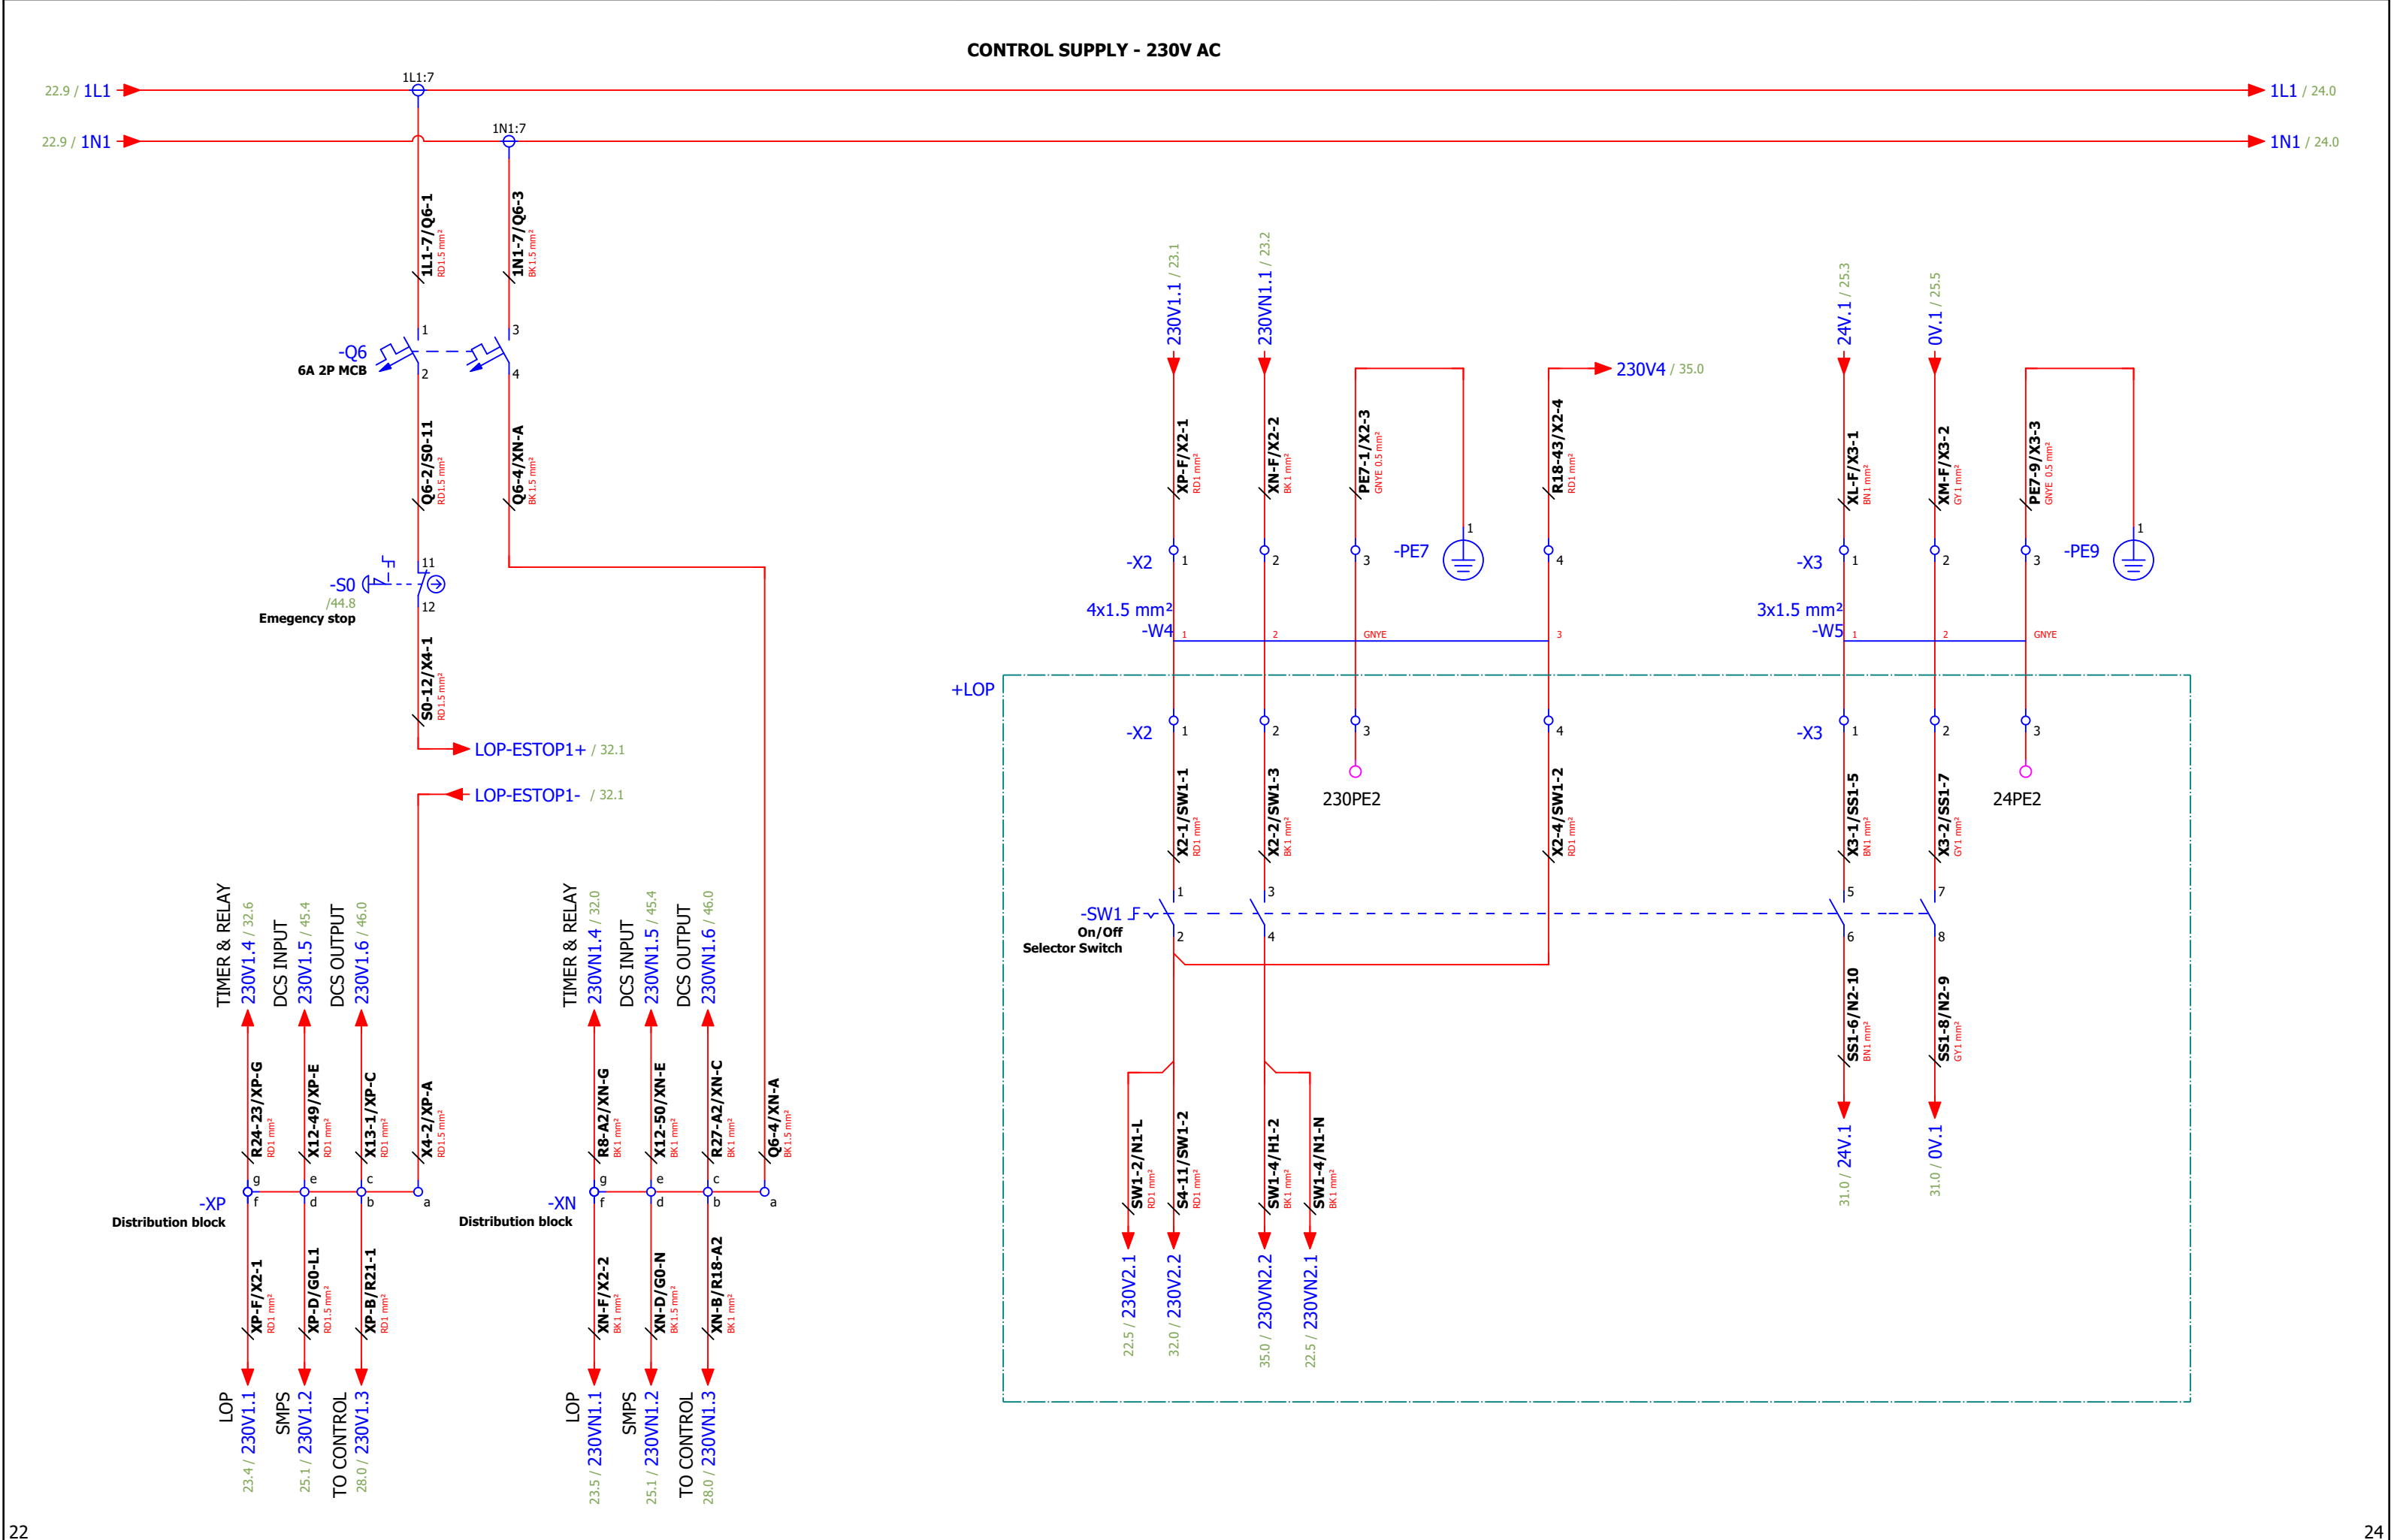


01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : EMERGENCY		= VCD
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION	 VIS-CON AUTOMATION	VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 23
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	23 OF 102	

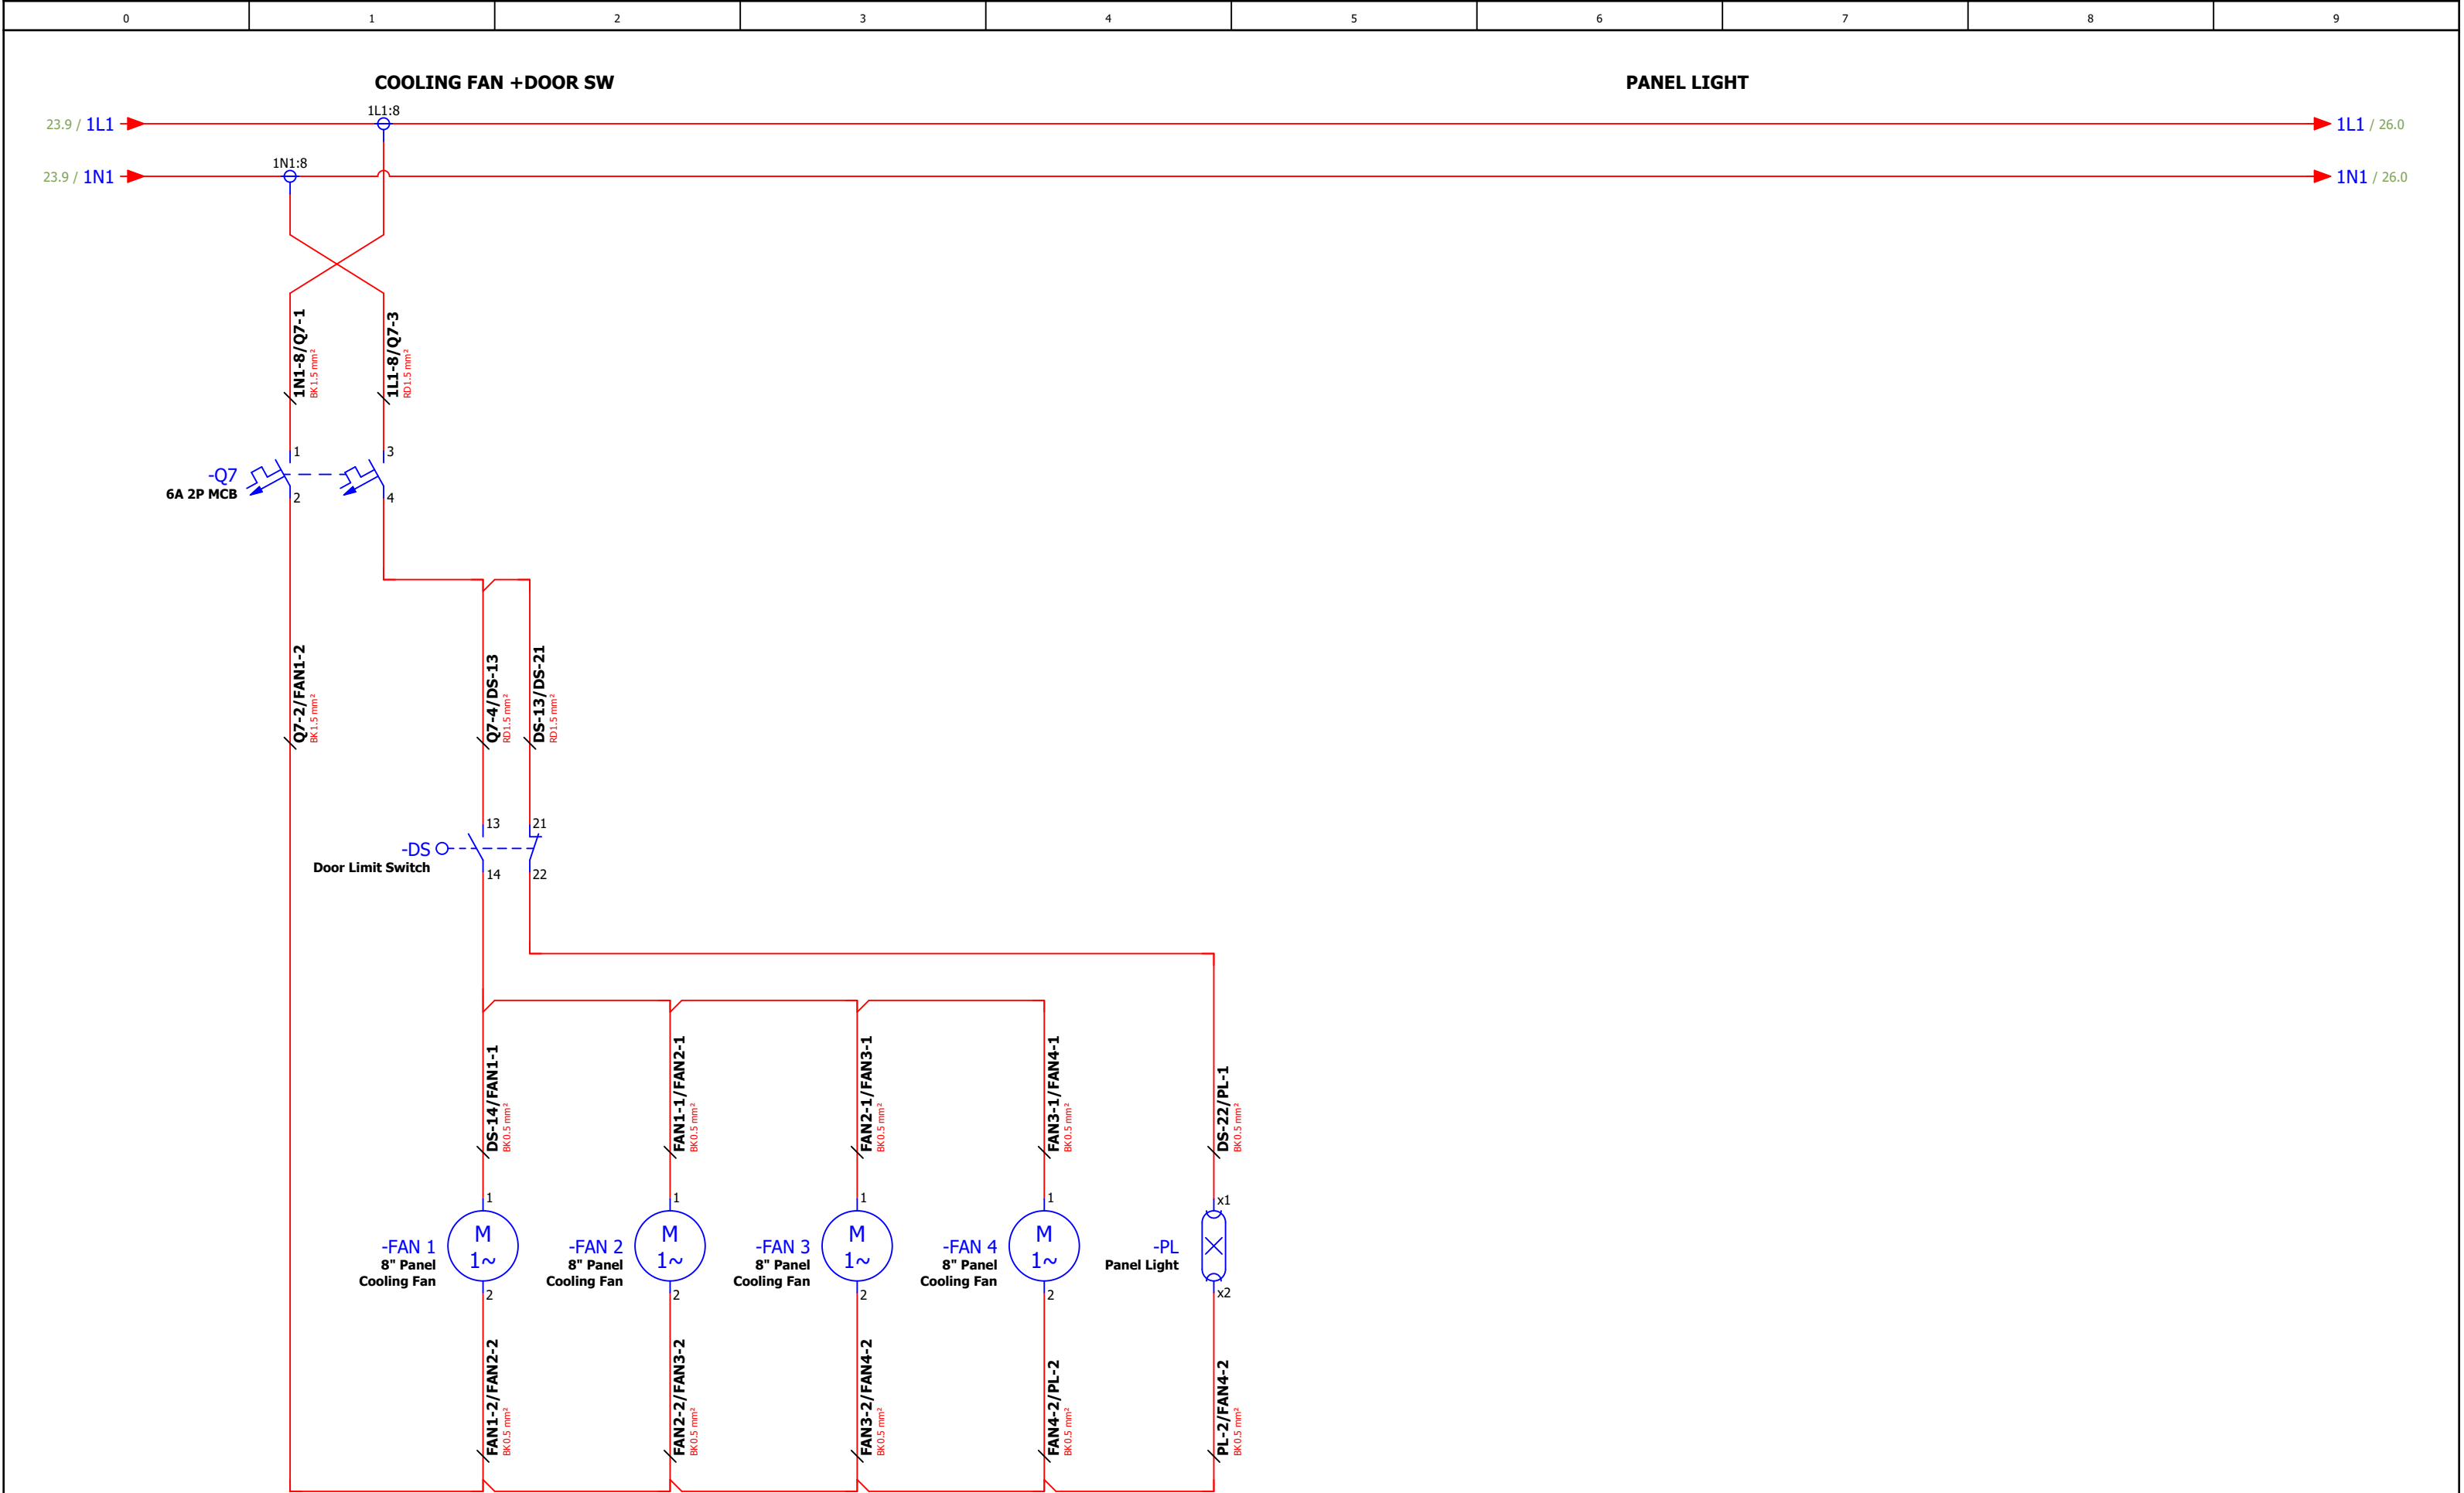


01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : PANEL LIGHT & FAN	= VCD
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : DRAWING No. : VA-200
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			Page : 24 SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			24 OF 102


CONTROL VOLTAGE SUPPLY -24V DC

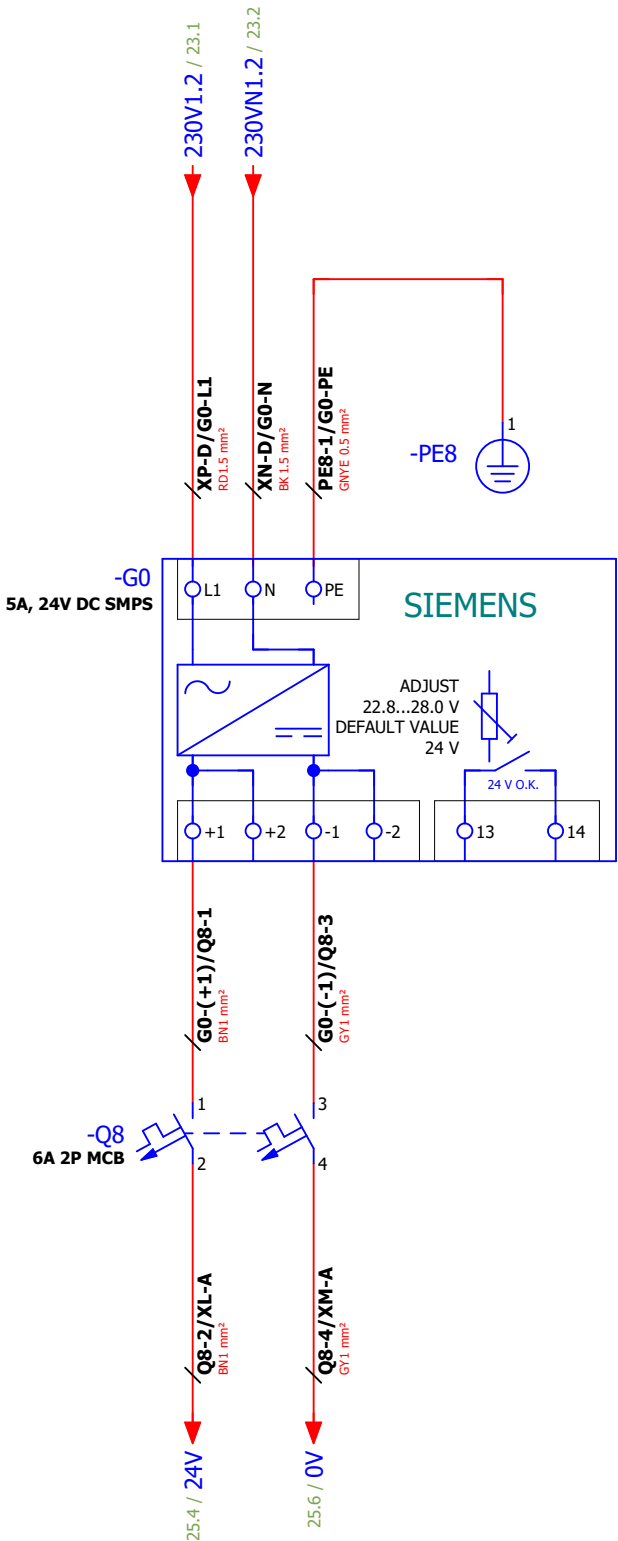



24V DC SUPPLY JUNCTION

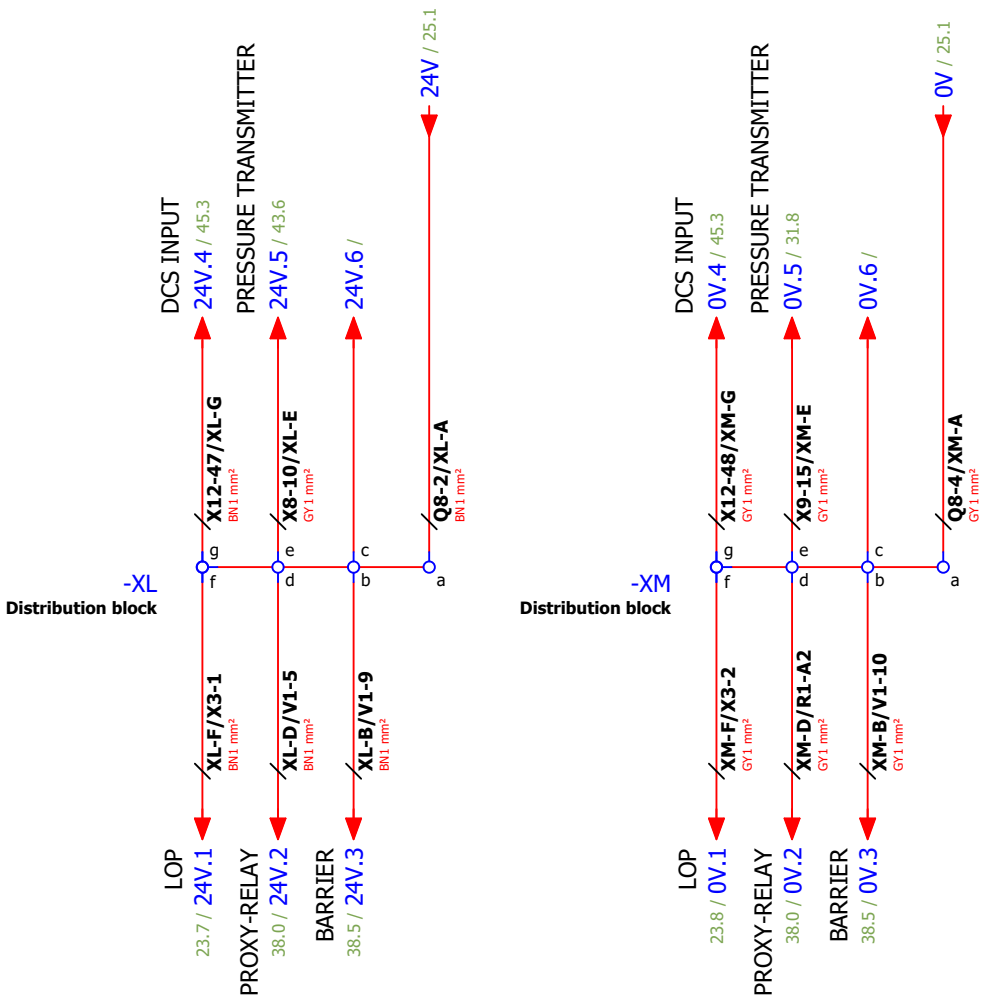



01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : SMPS	= VCD	
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION	 VIS-CON AUTOMATION	VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 25
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	25 OF 102	

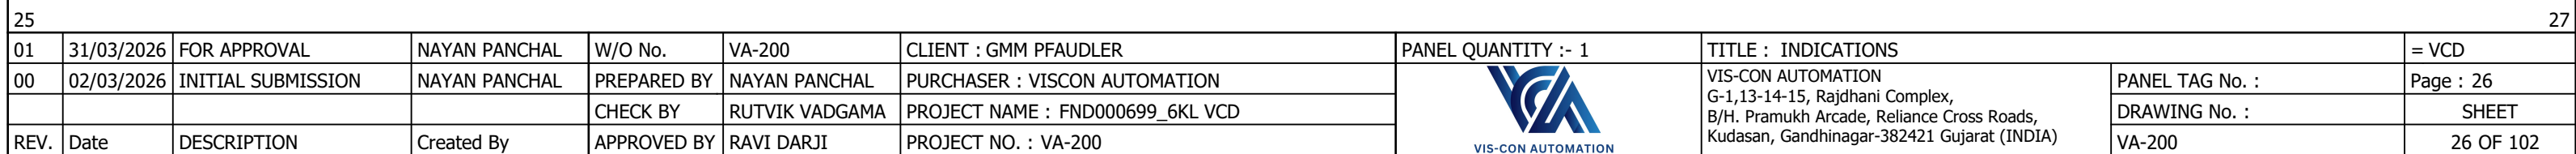


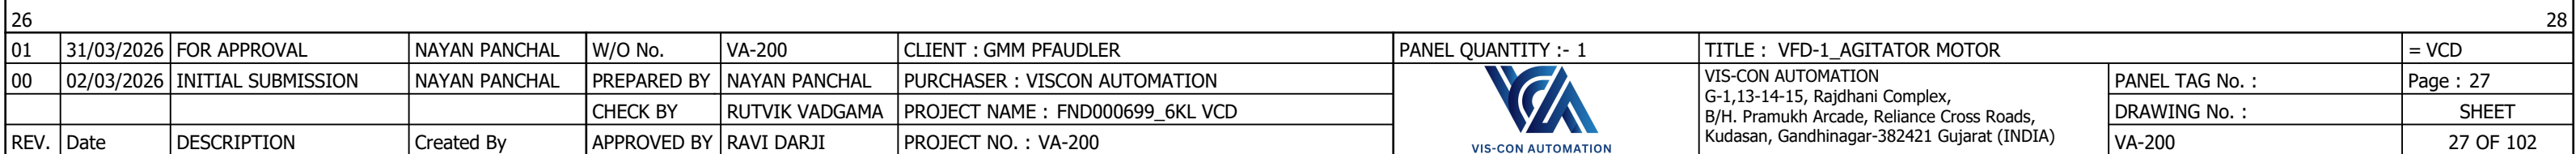

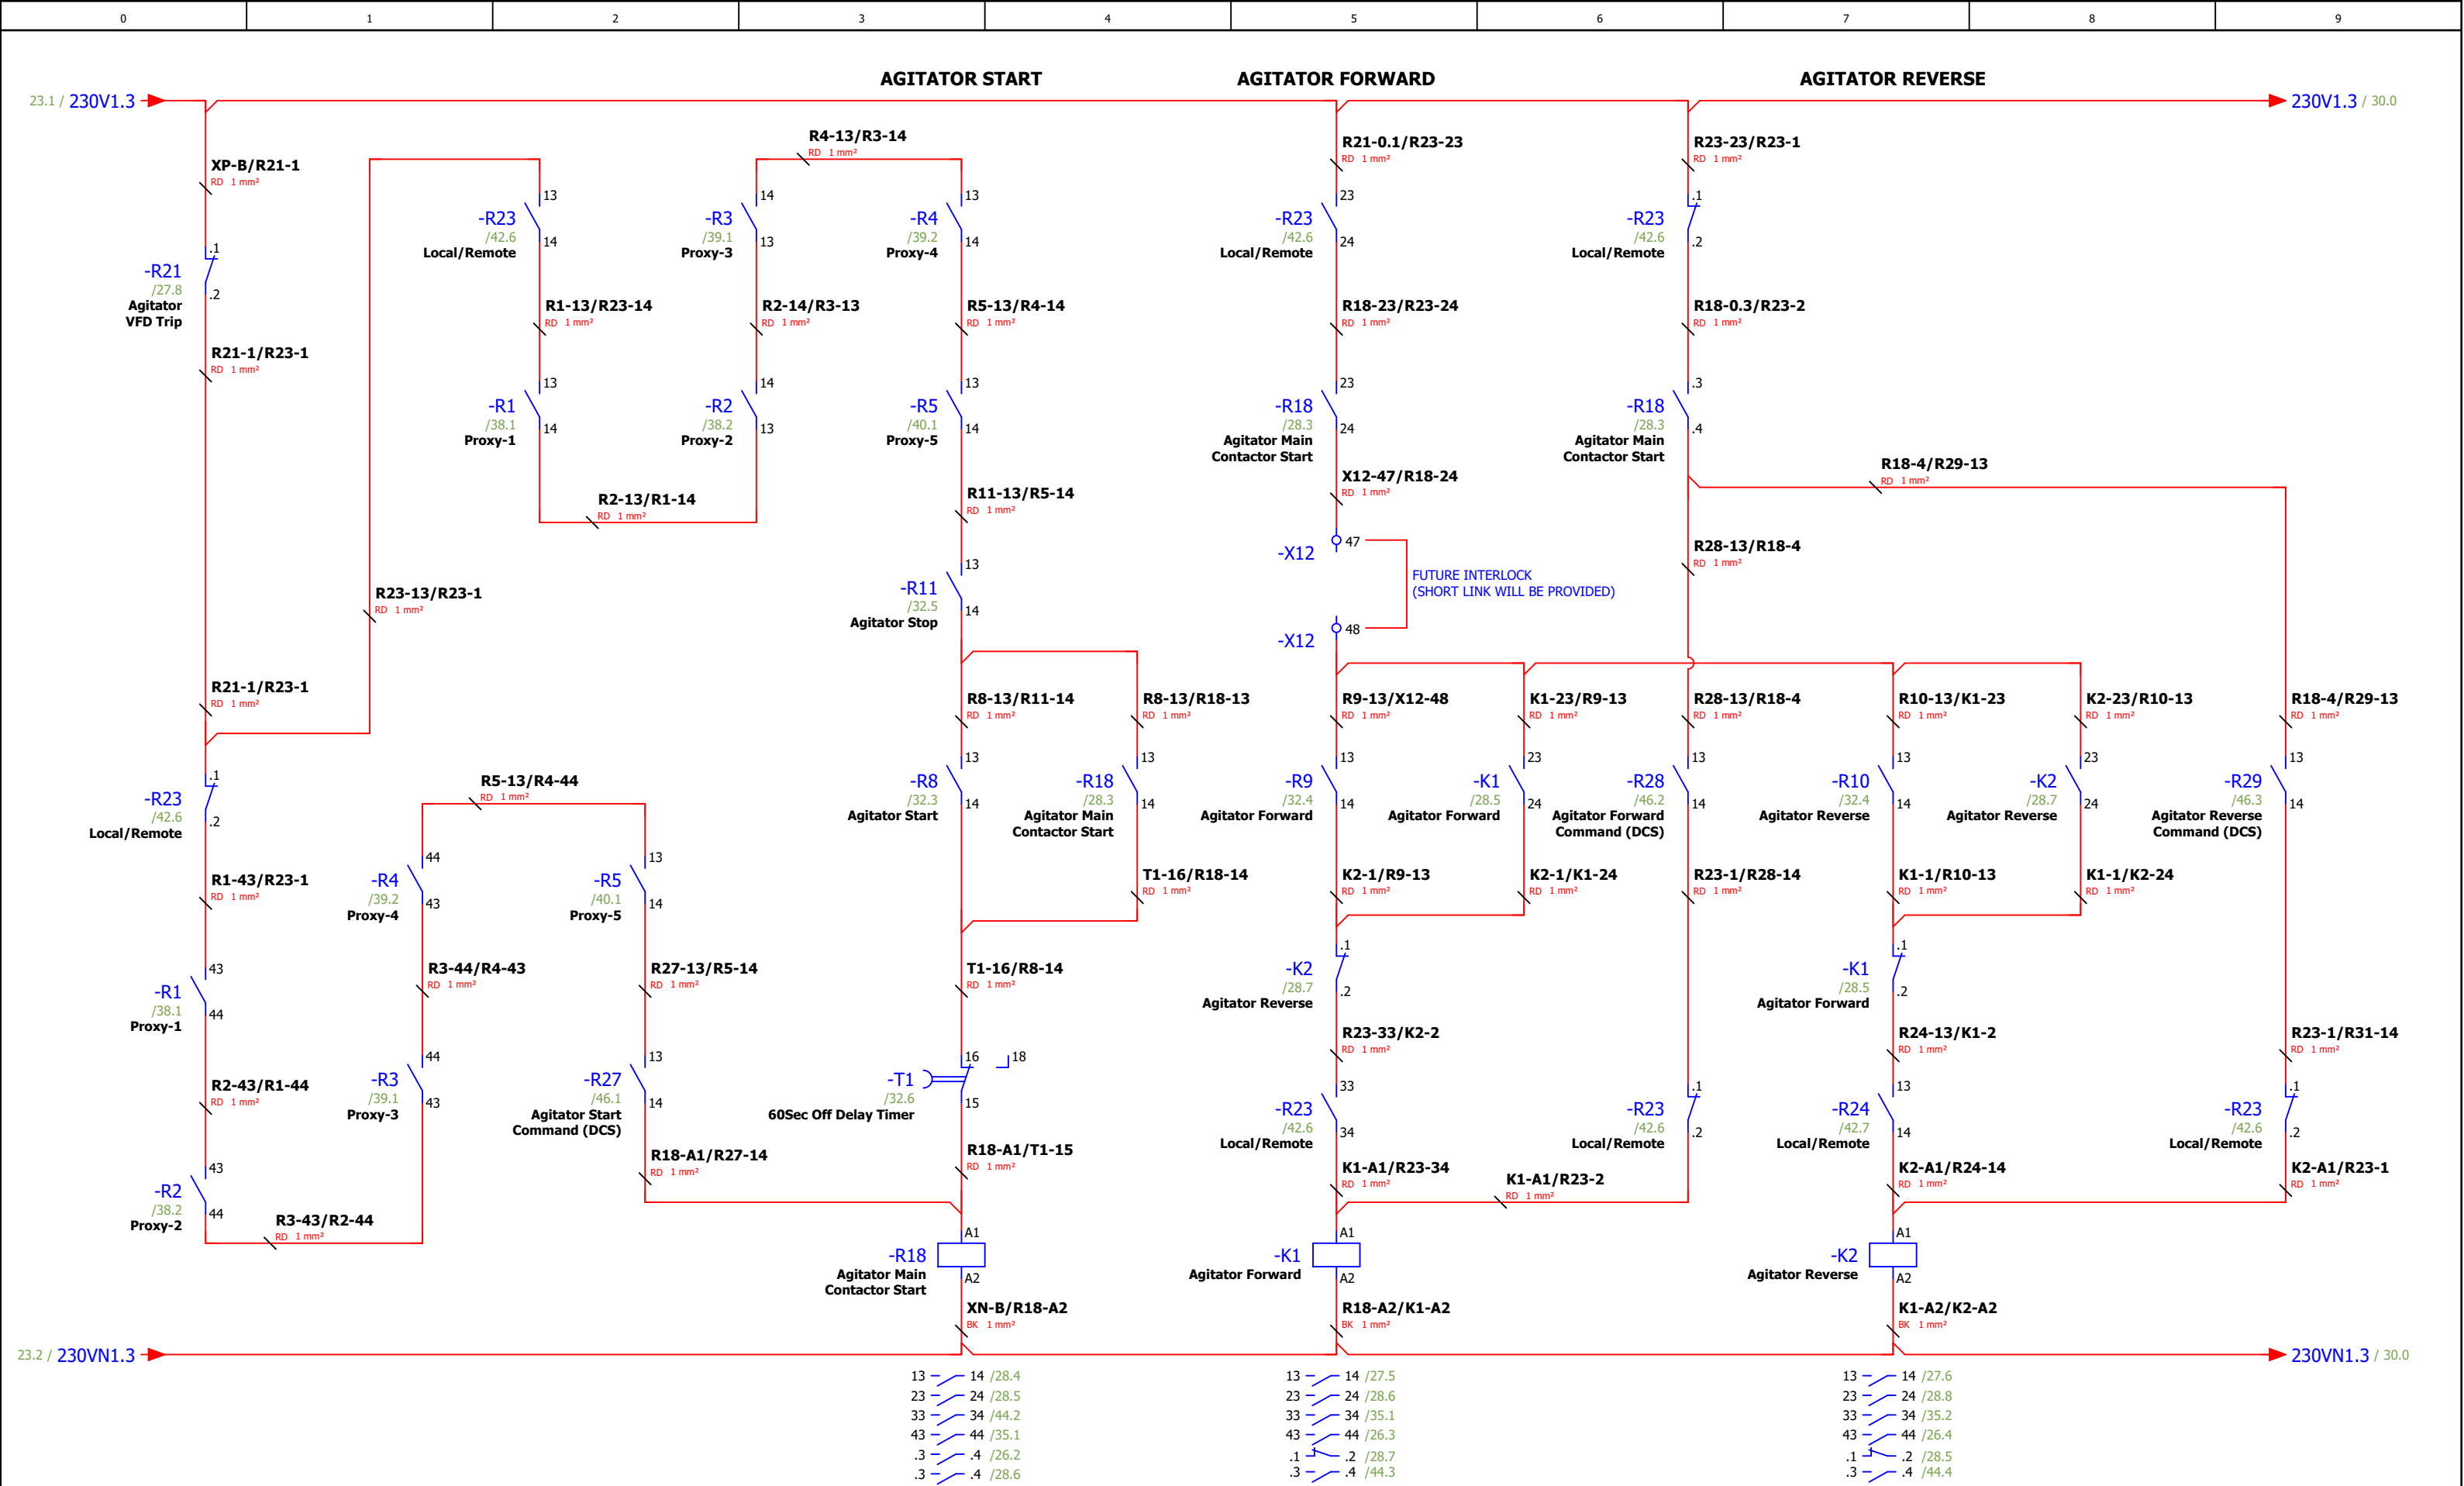


01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : CONTROL WIRING	= VCD	
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 28
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	28 OF 102

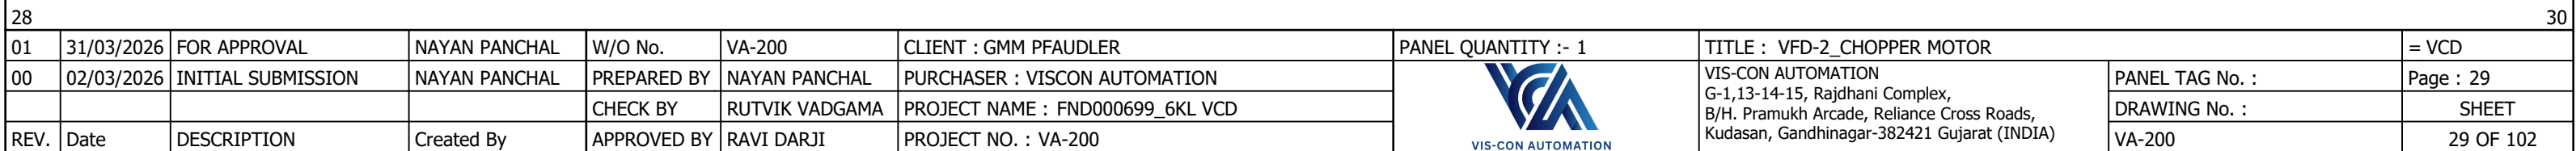


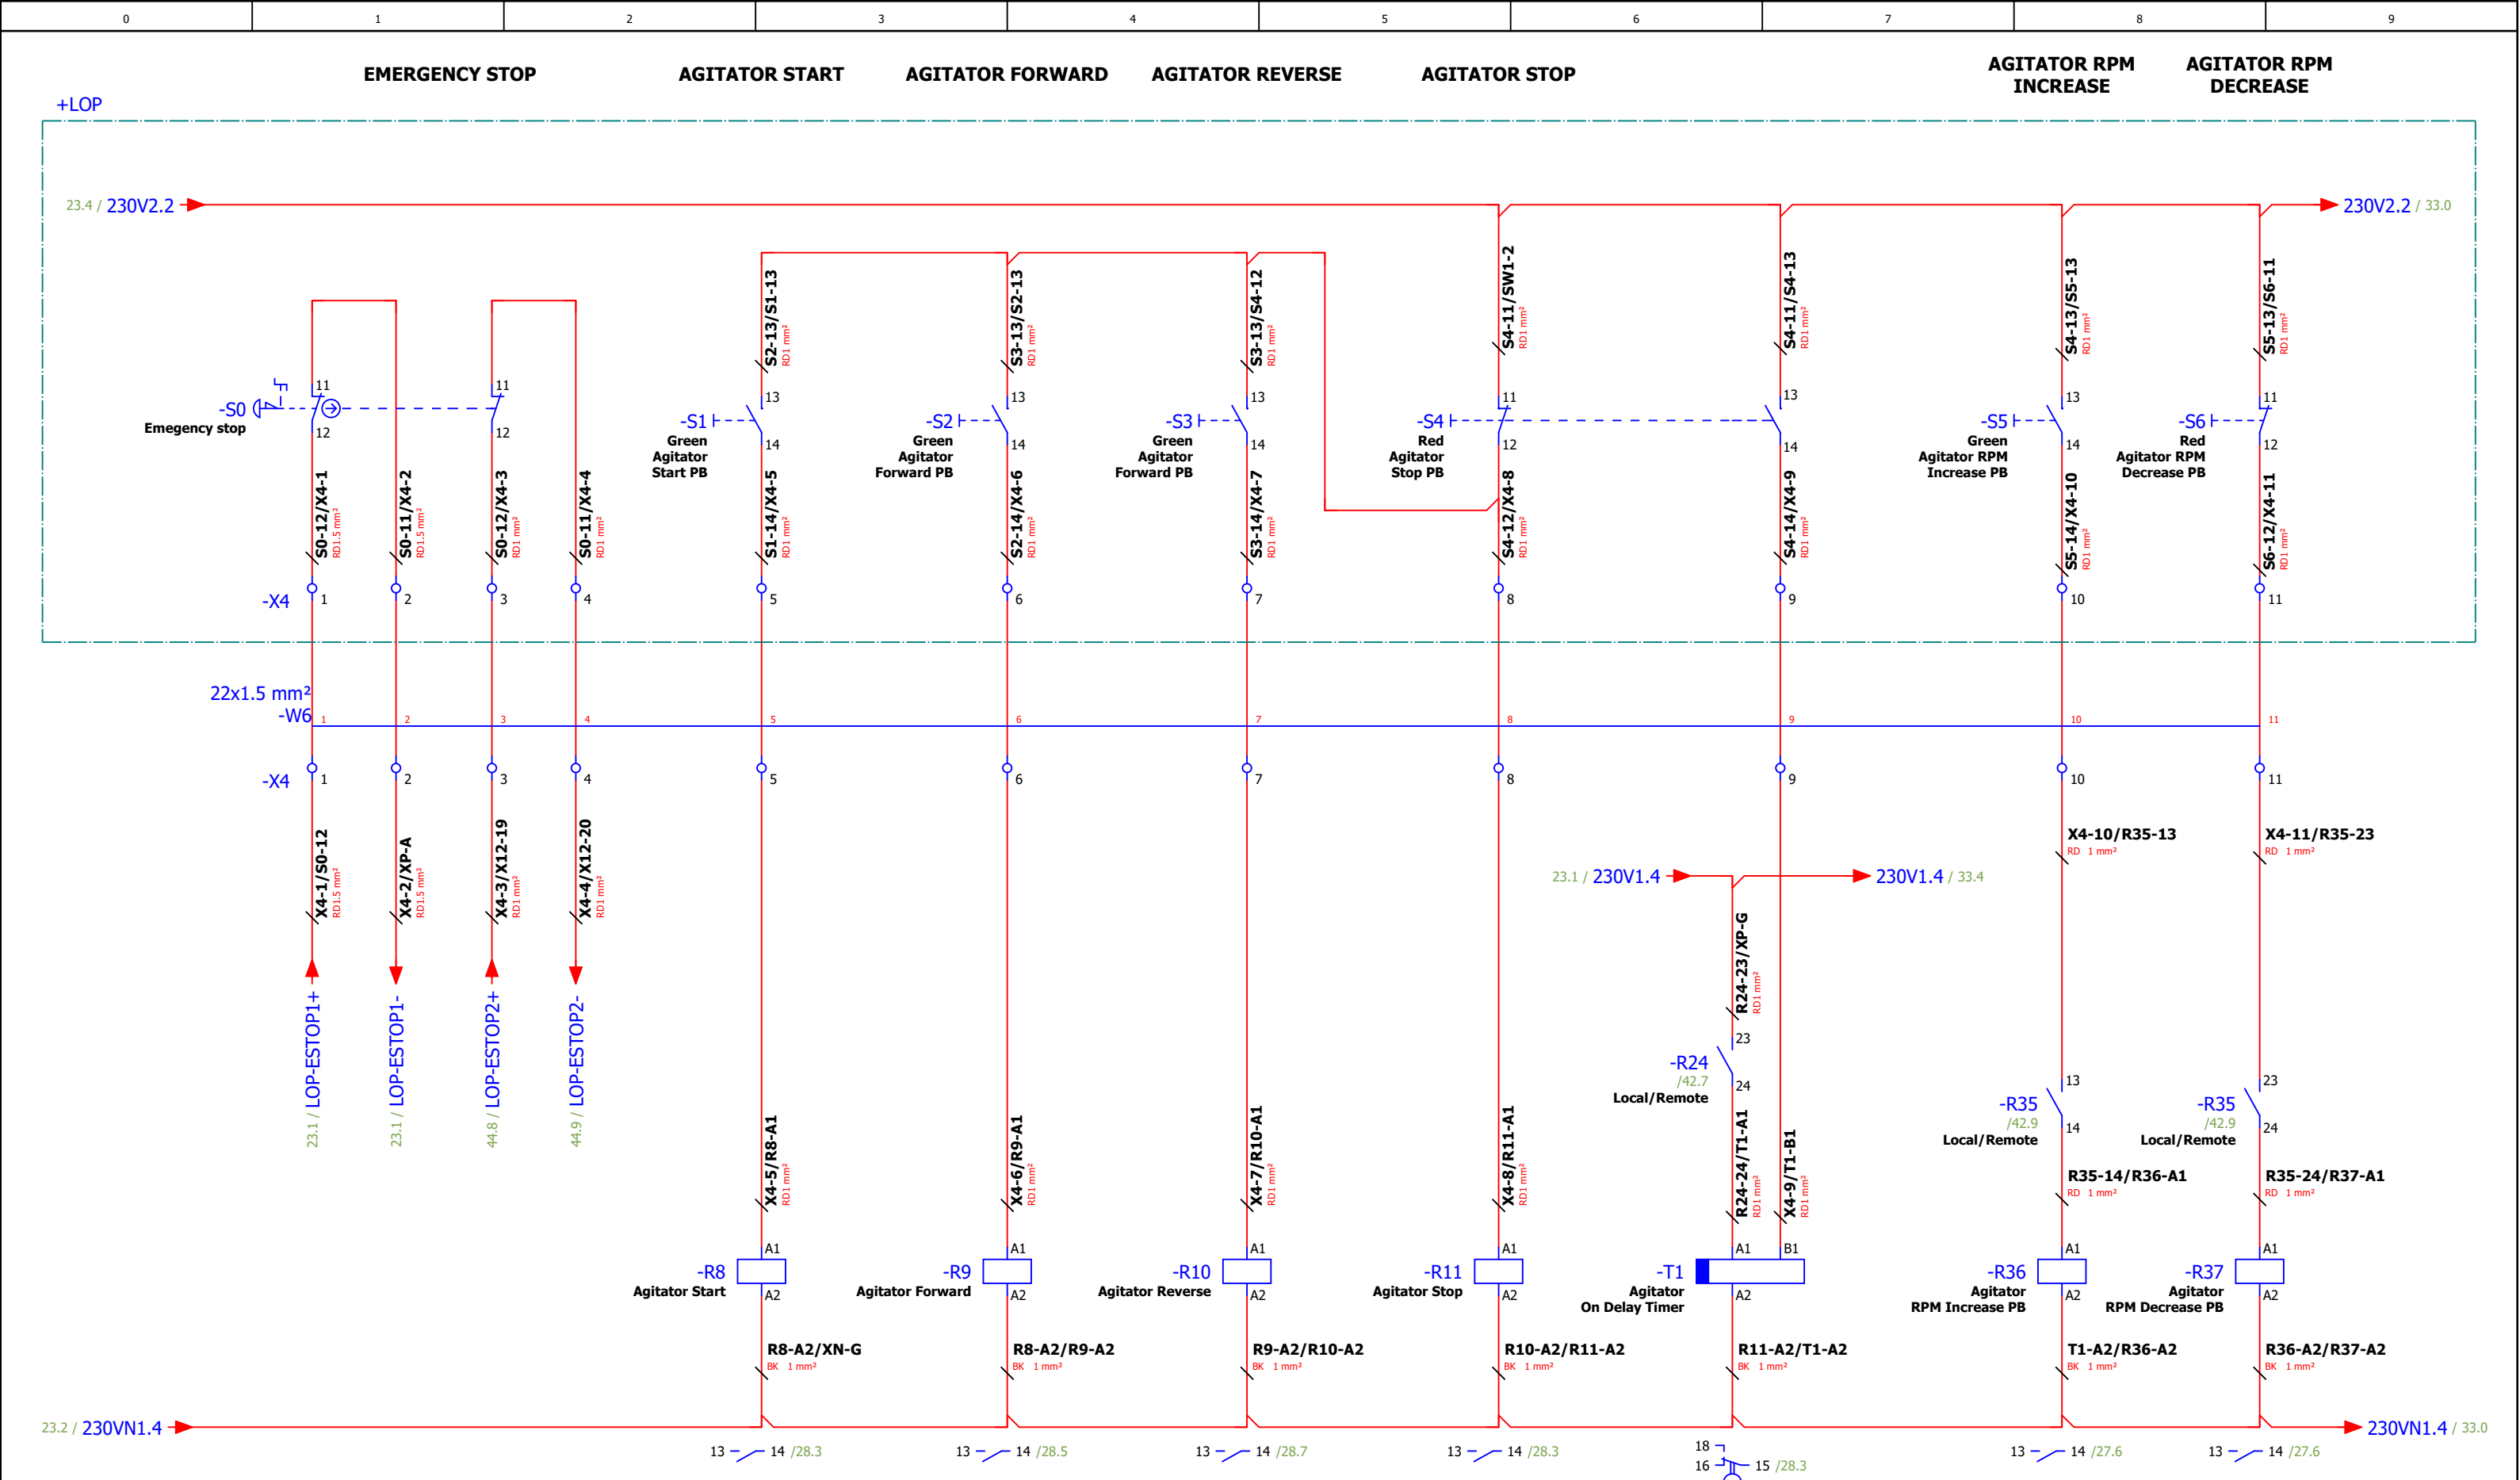

31										33									
01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : LOP CONTROL WIRING		= VCD									
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 32									
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET									
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	32 OF 102									

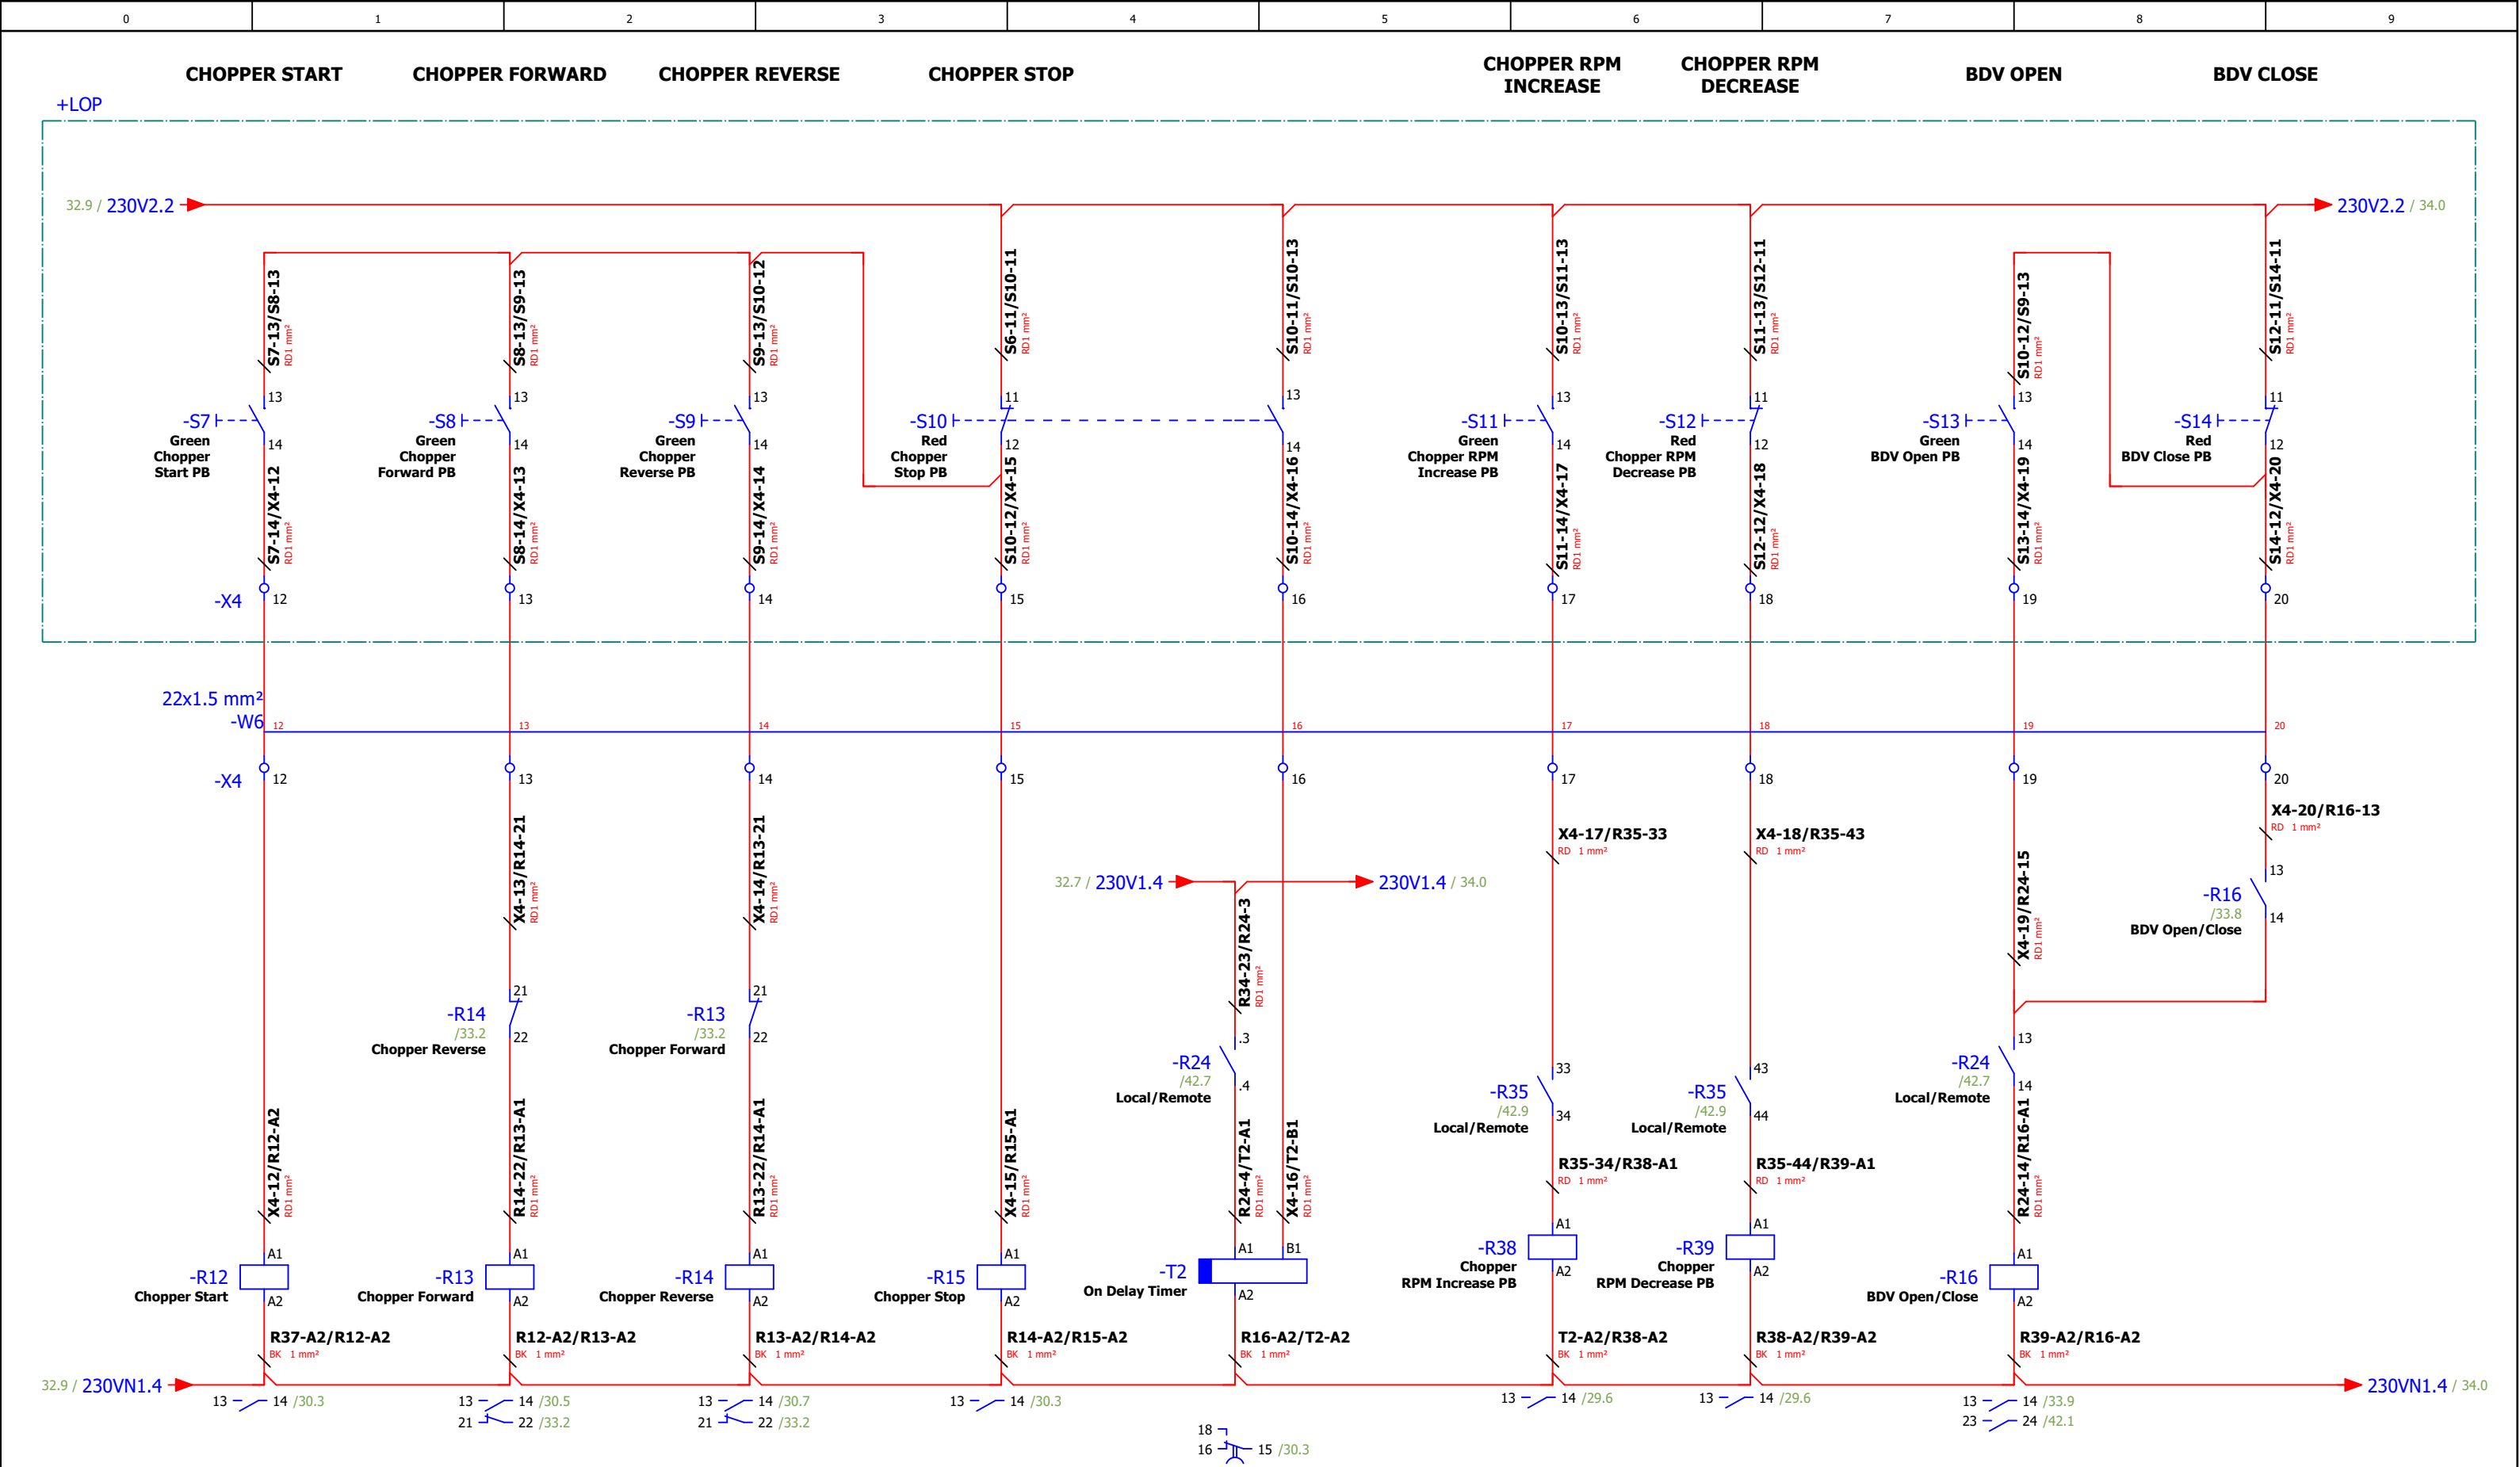


01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : LOP CONTROL WIRING	= VCD
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :
			CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	33 OF 102

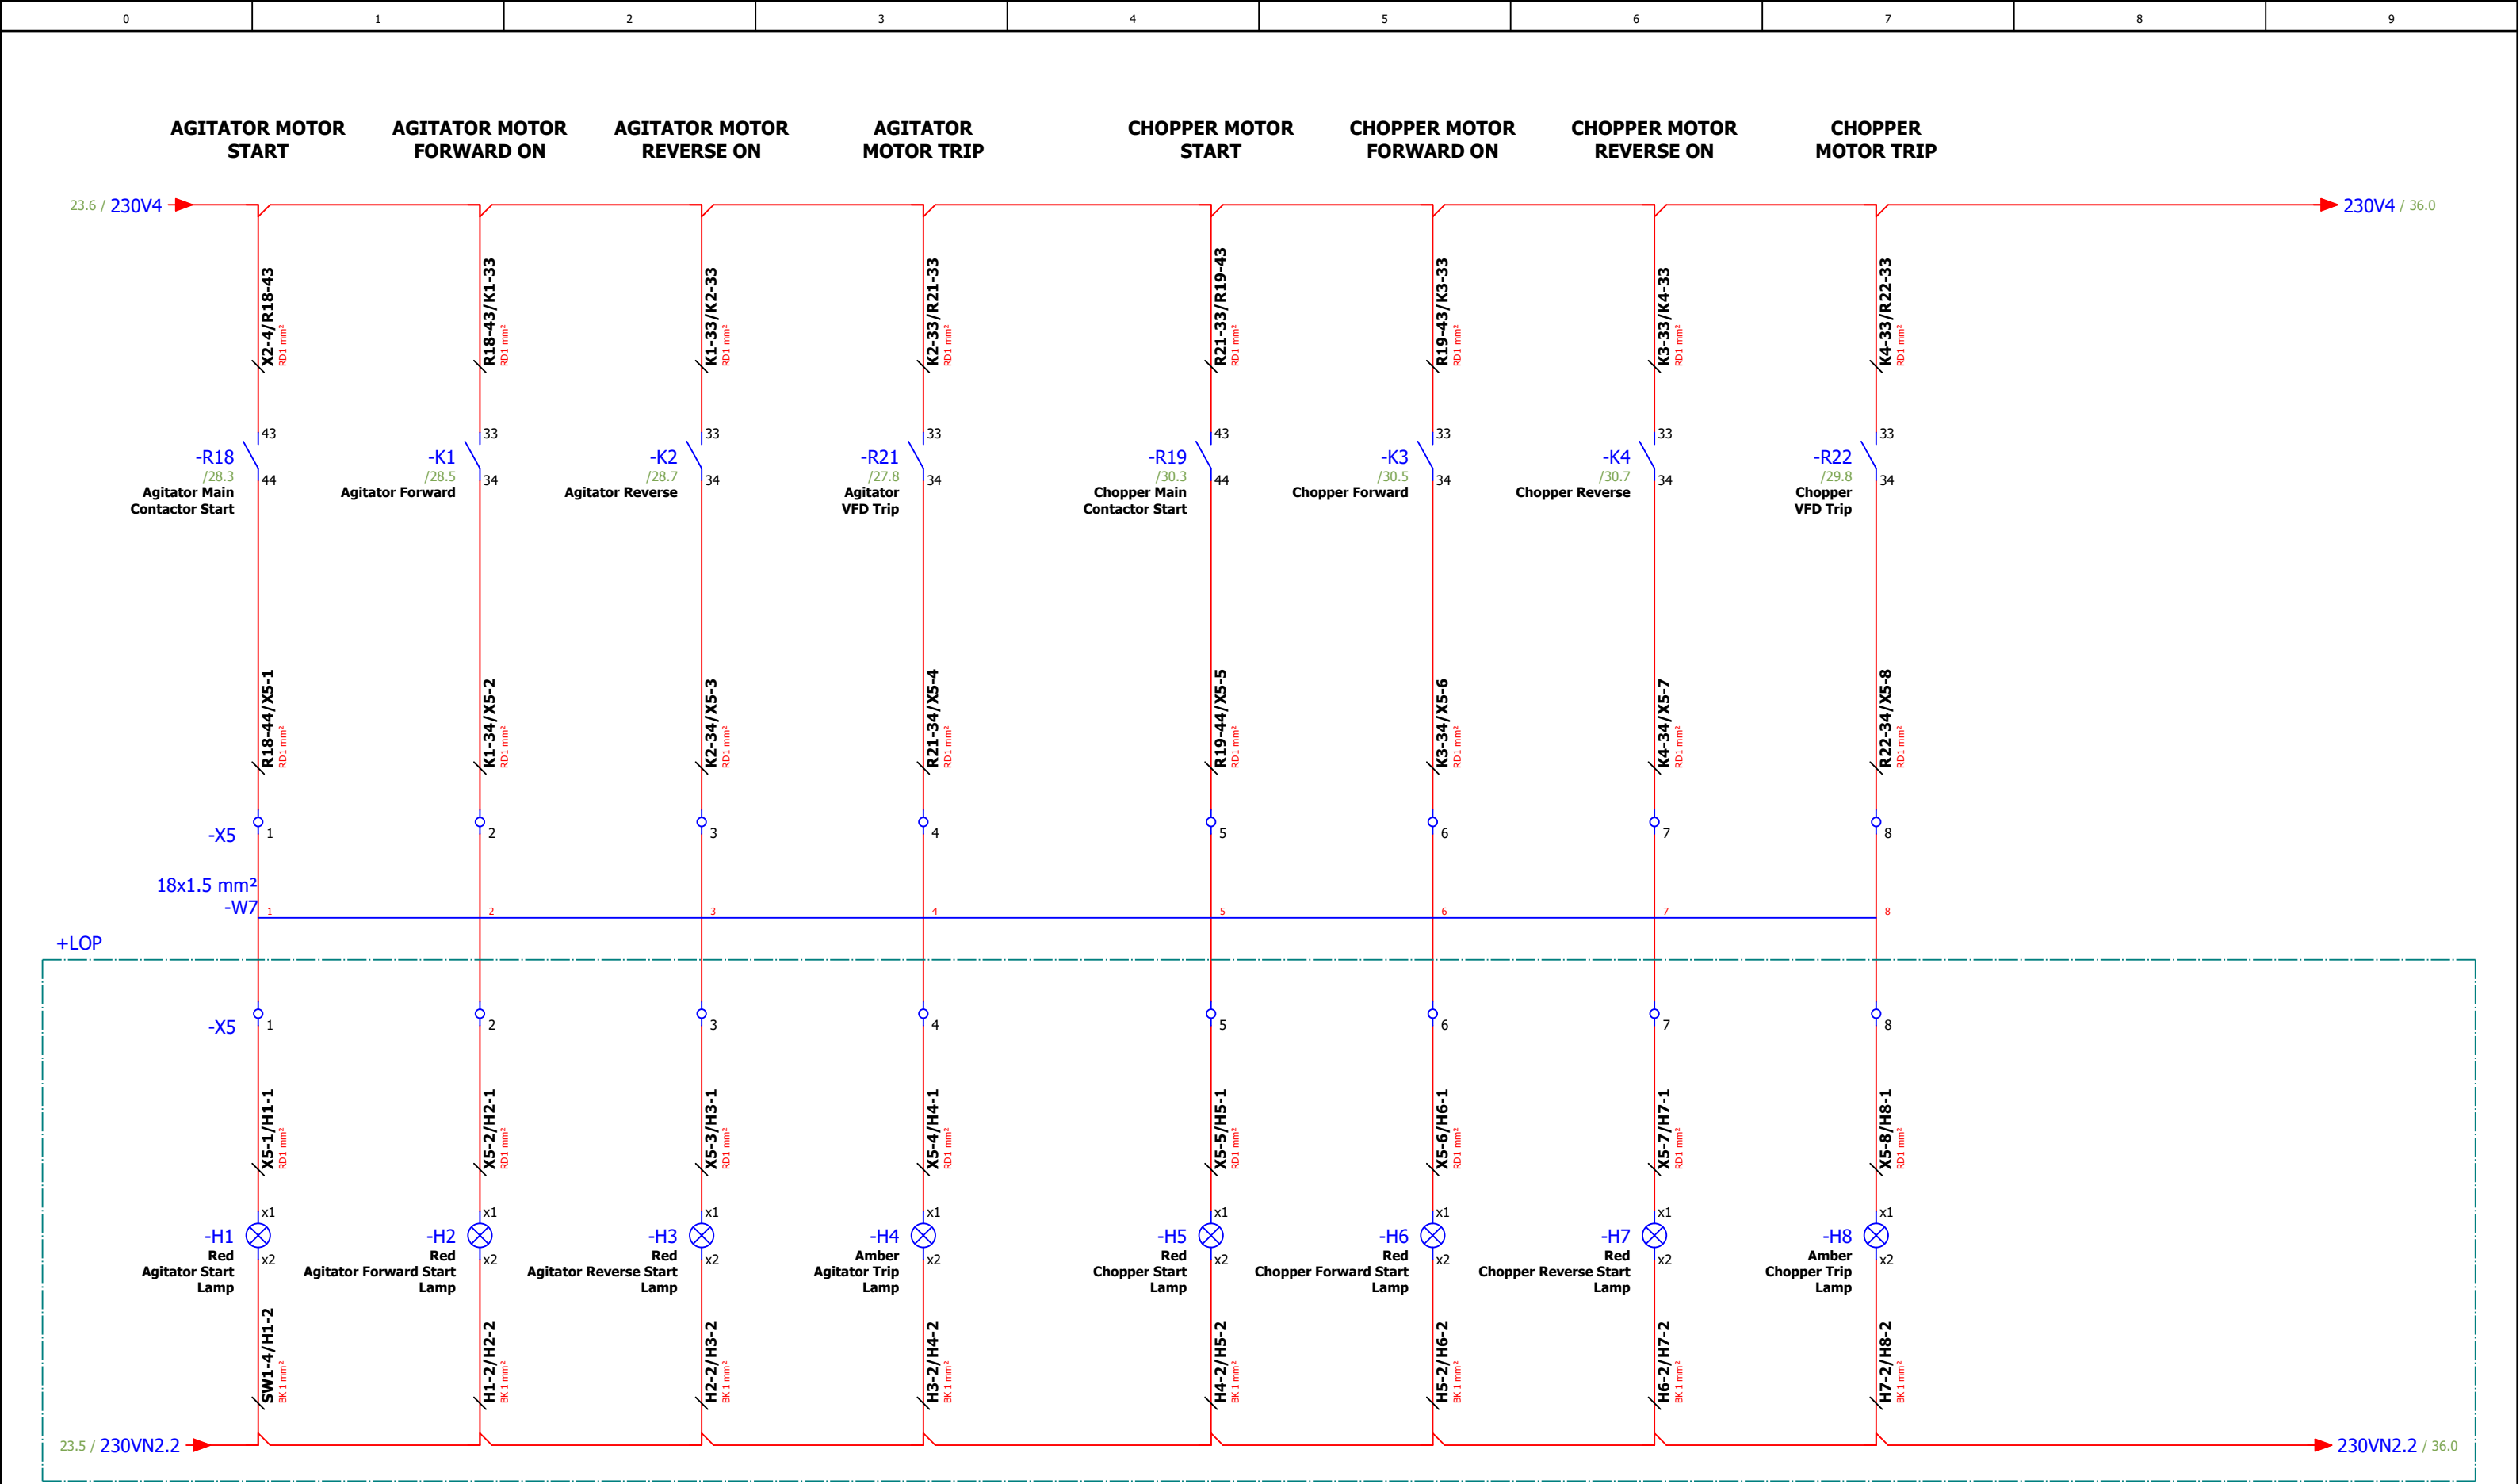



34										36	
01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : LOP CONTROL WIRING		= VCD	
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 35	
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	35 OF 102	


SPARE

POWER SUPPLY ON

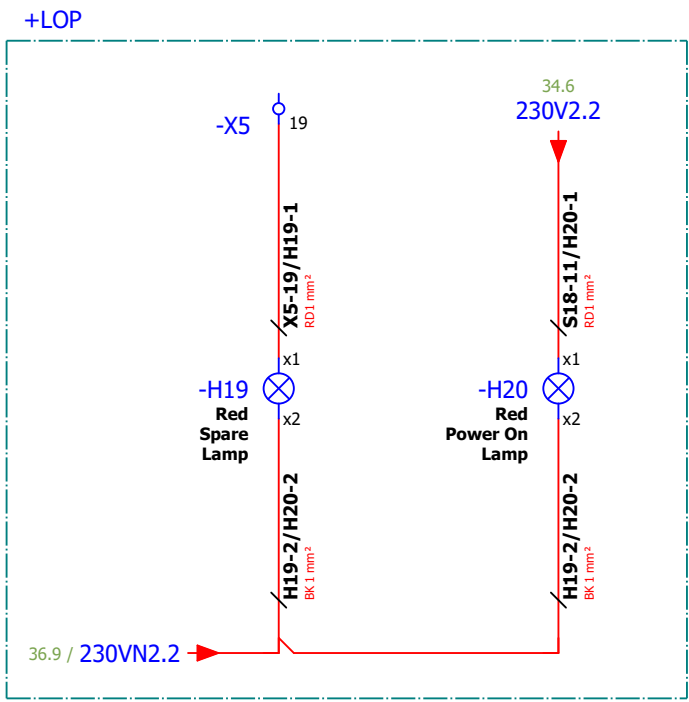


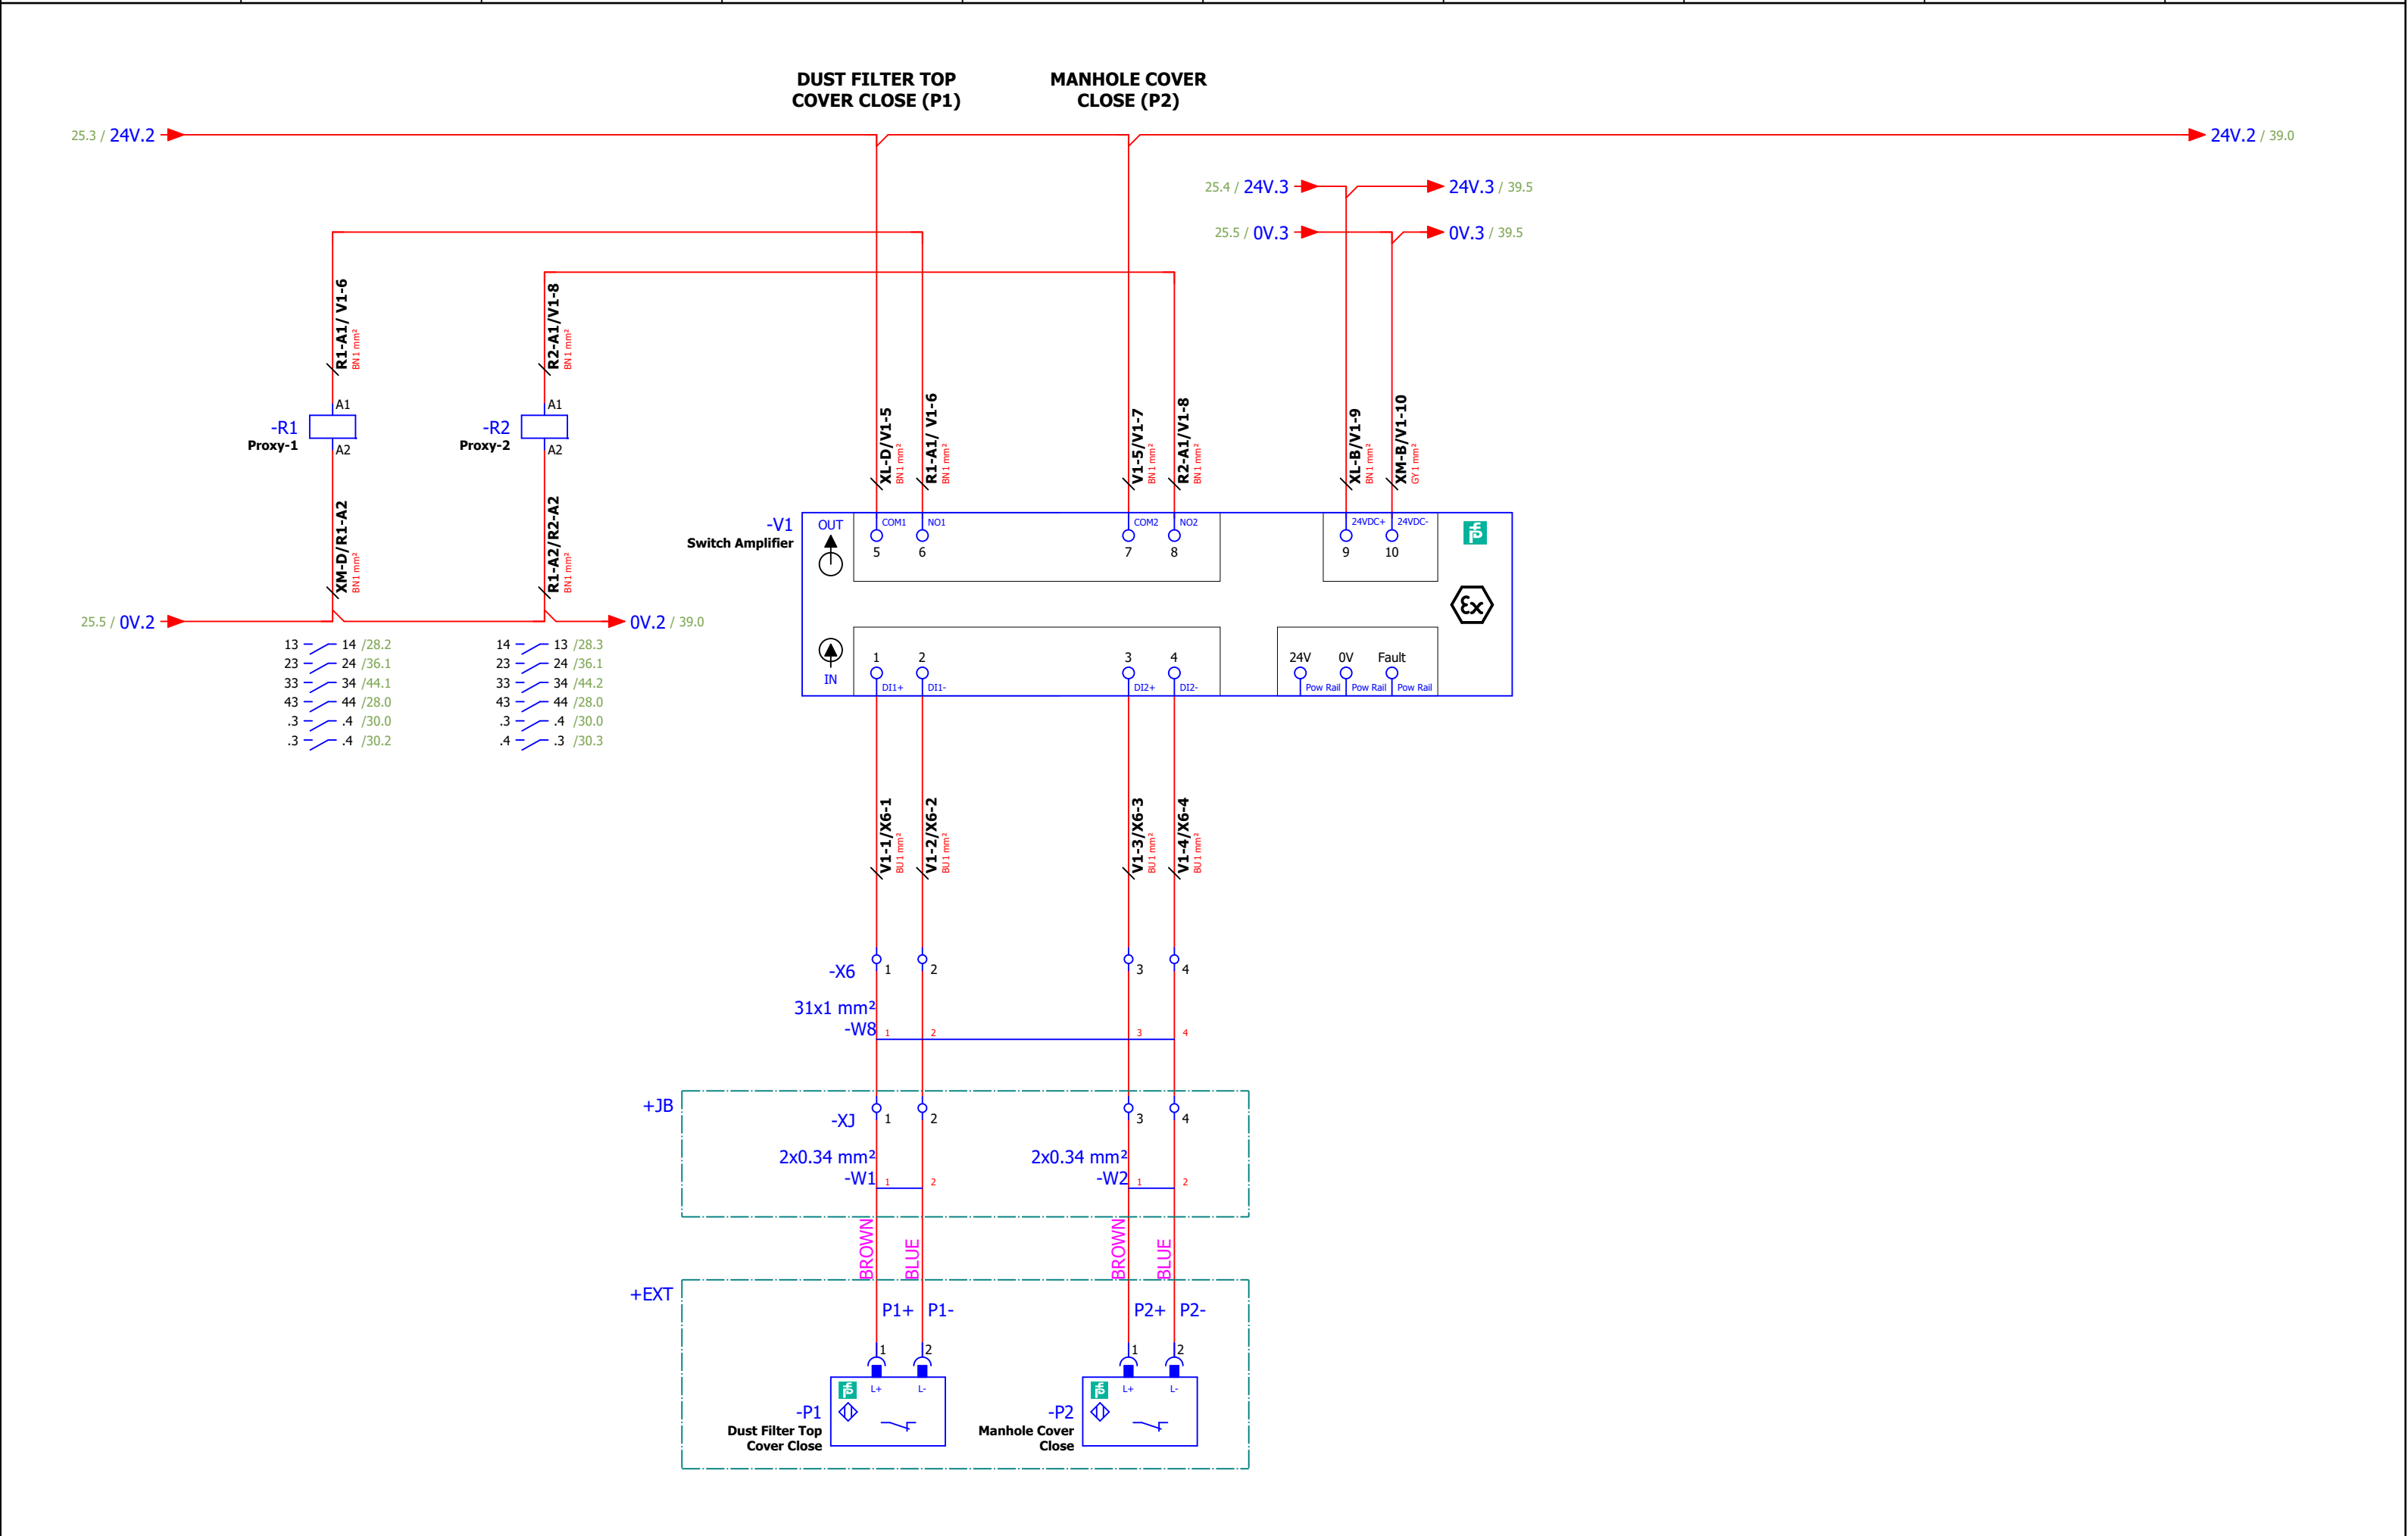

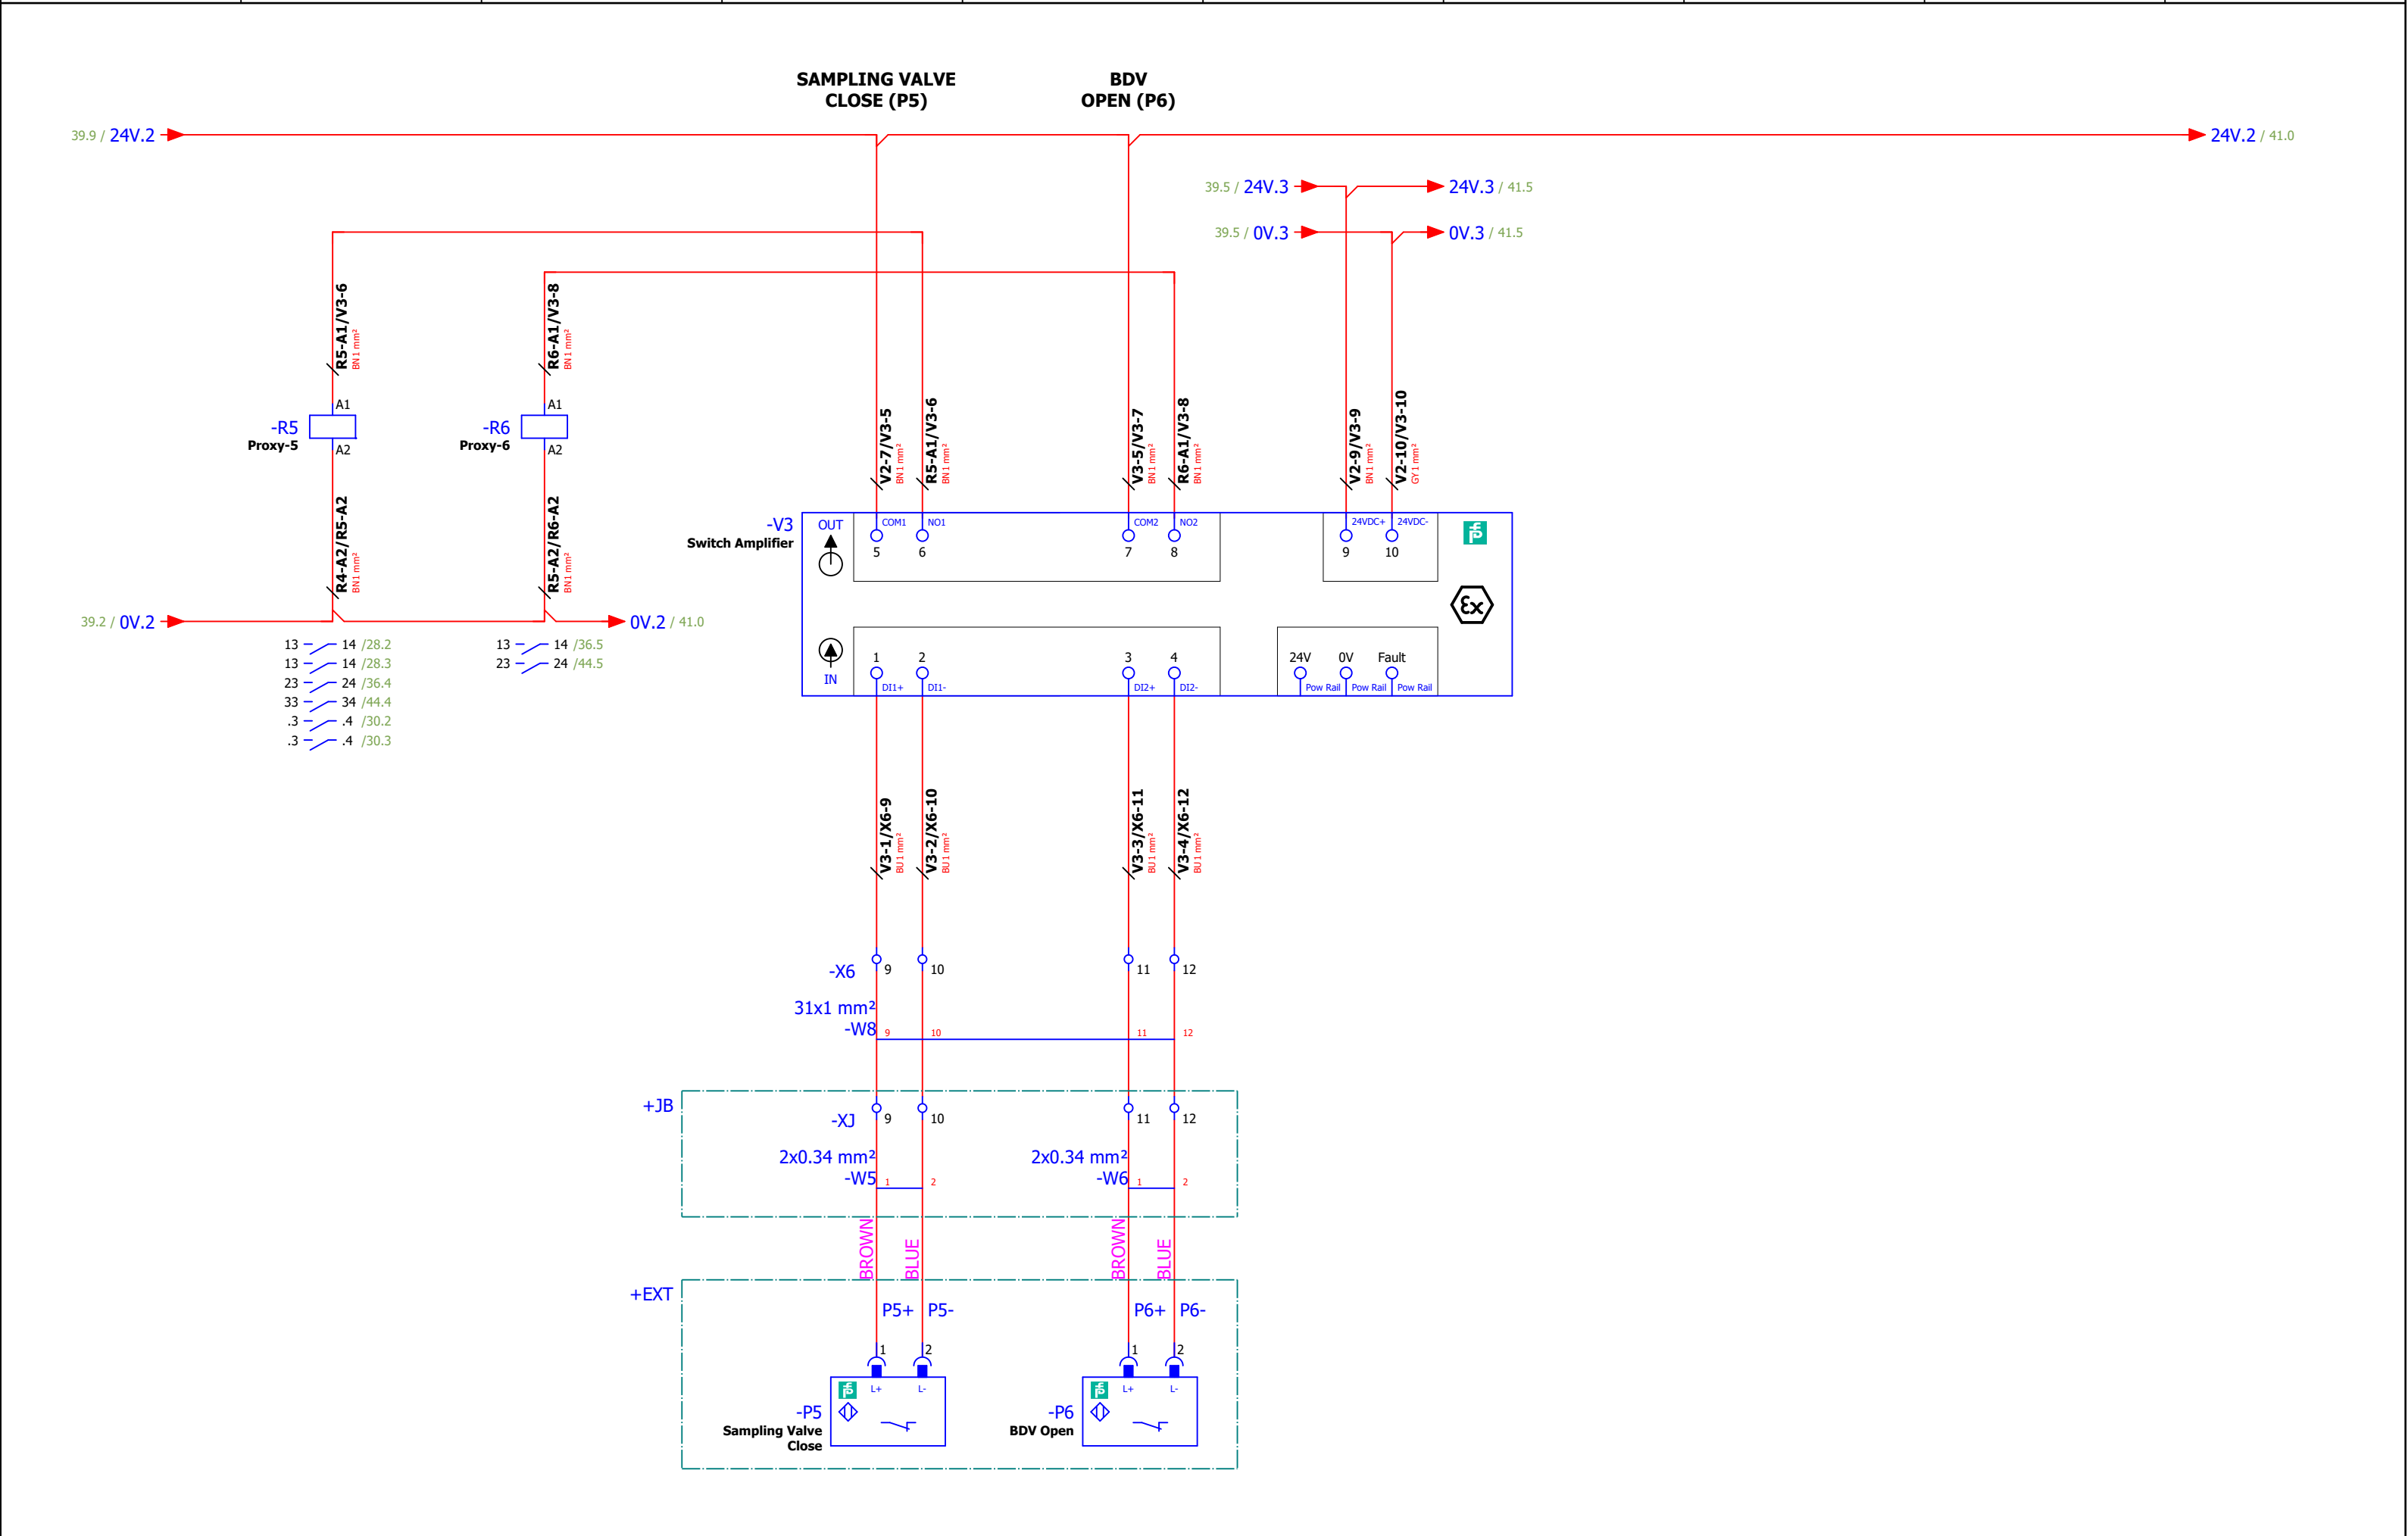


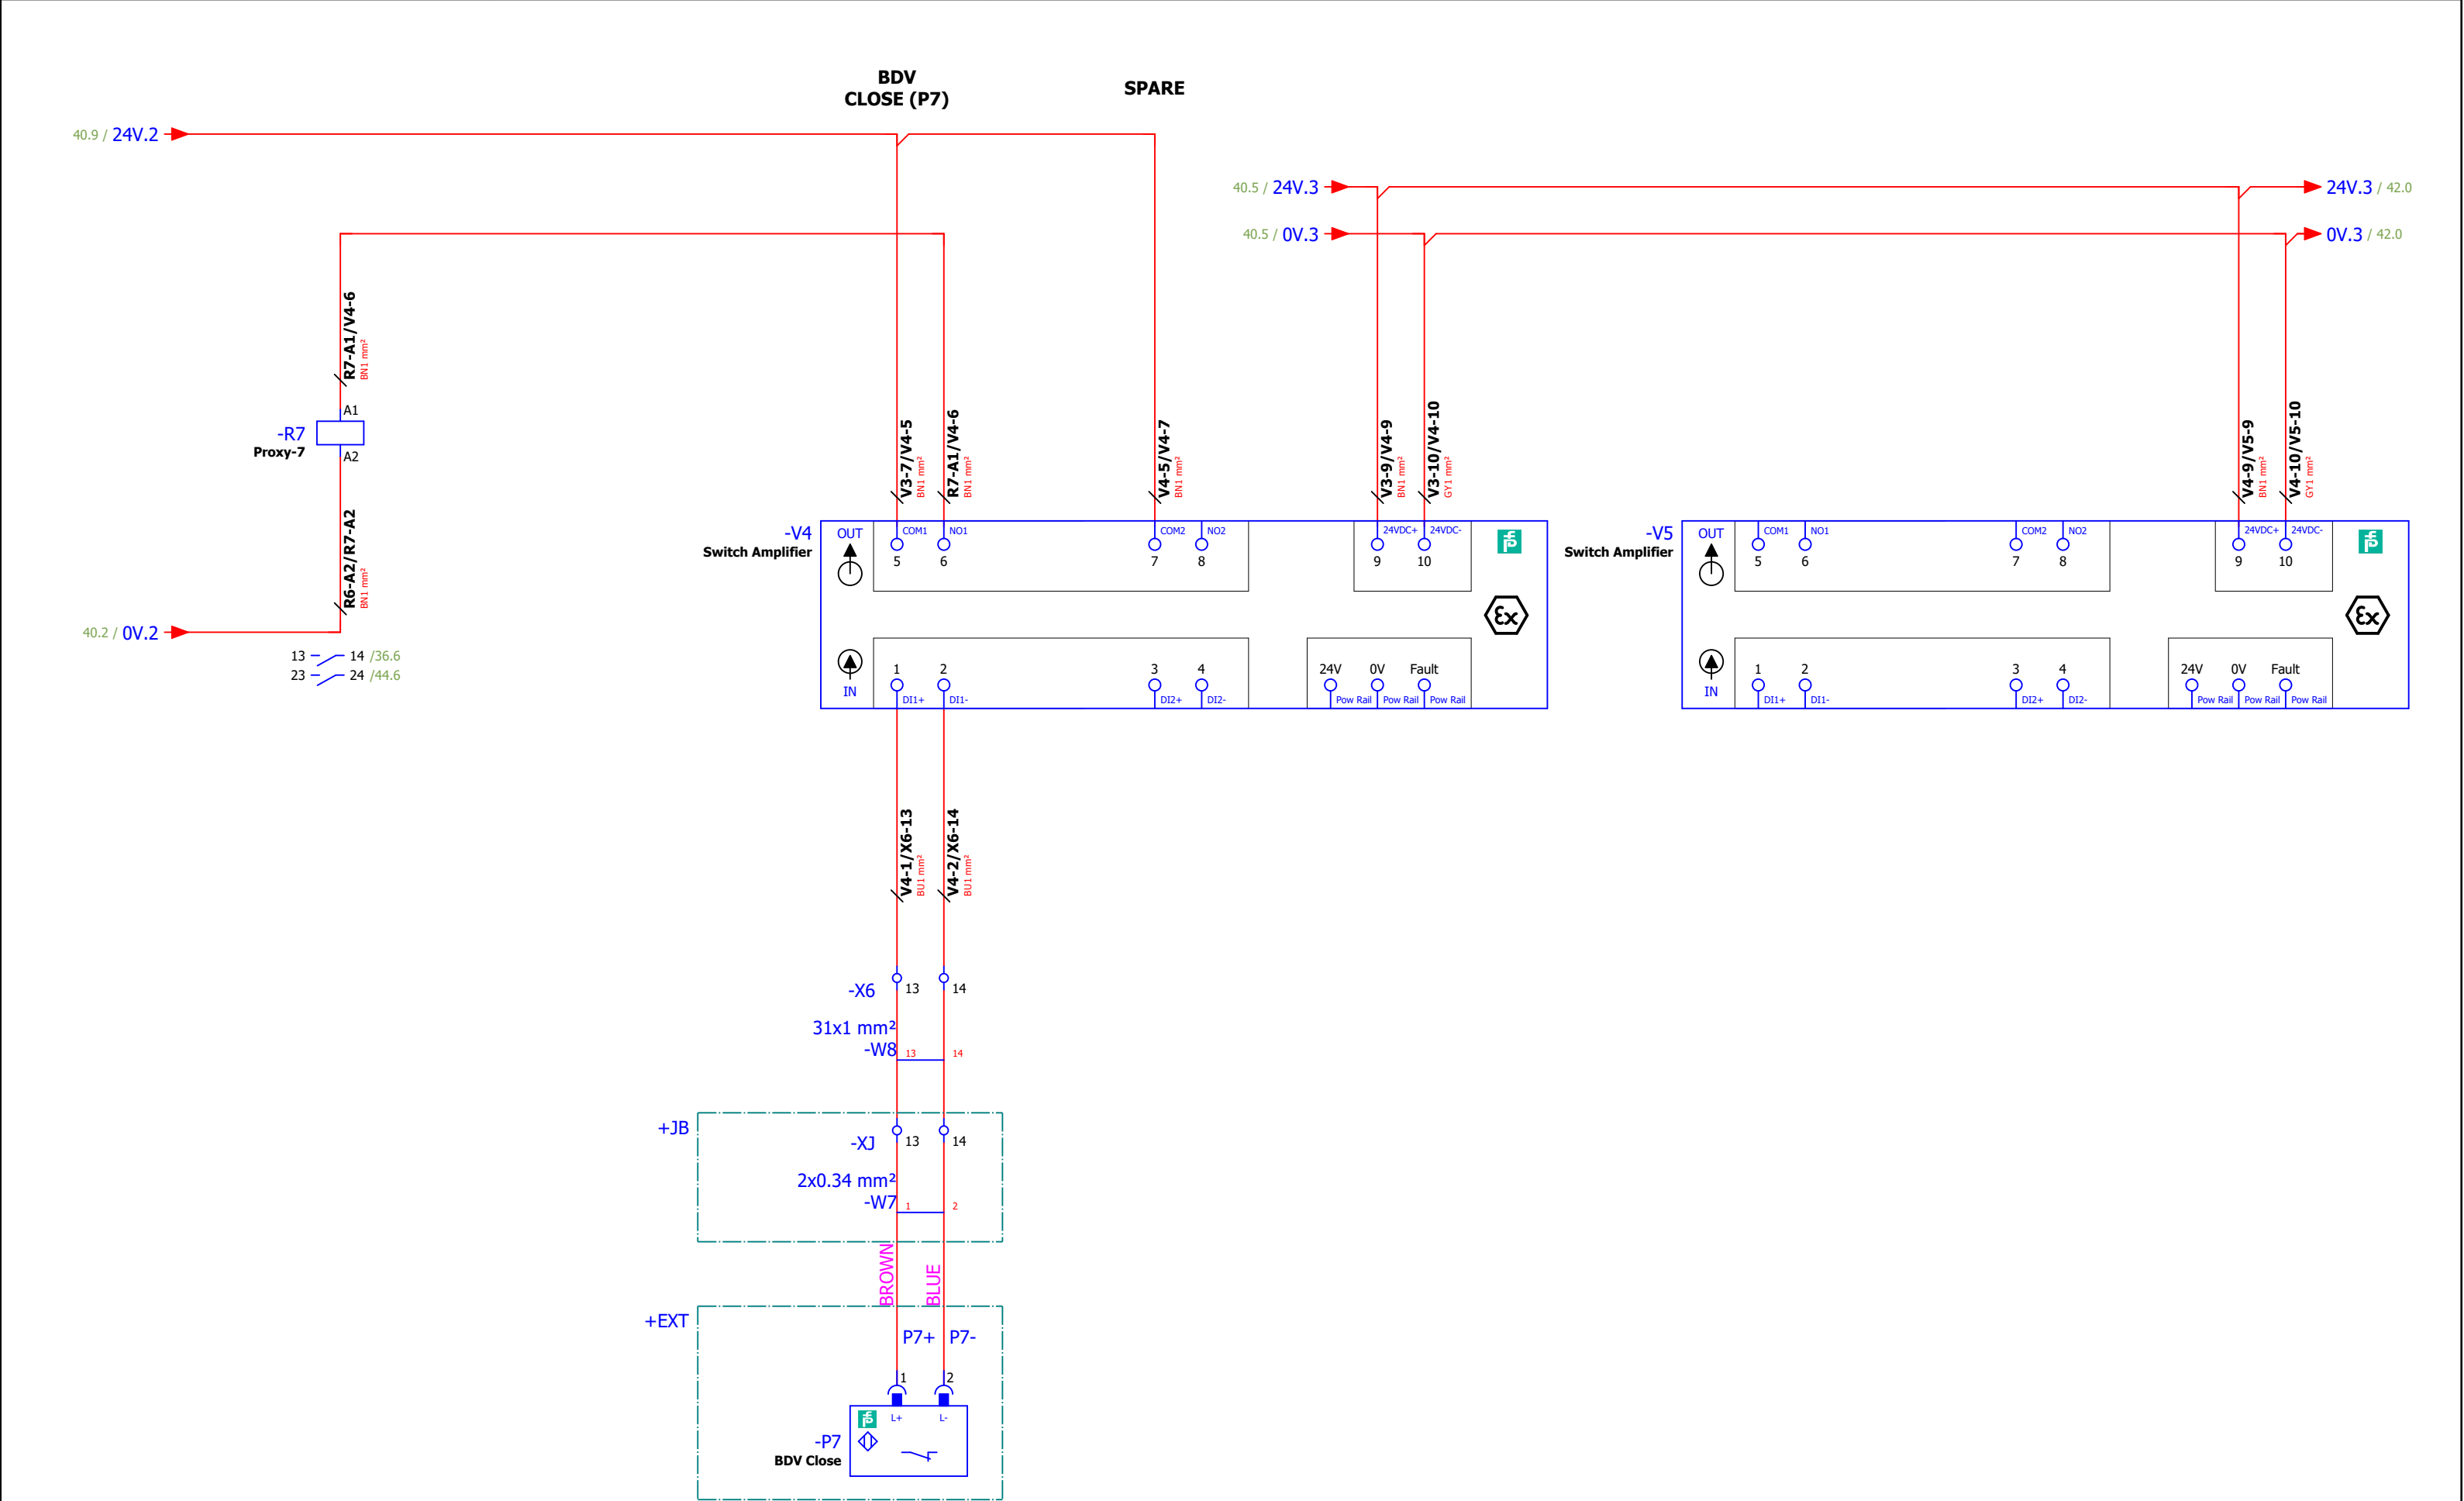


40										42	
01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : PROXY SWITCH		= VCD	
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 41	
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	41 OF 102	

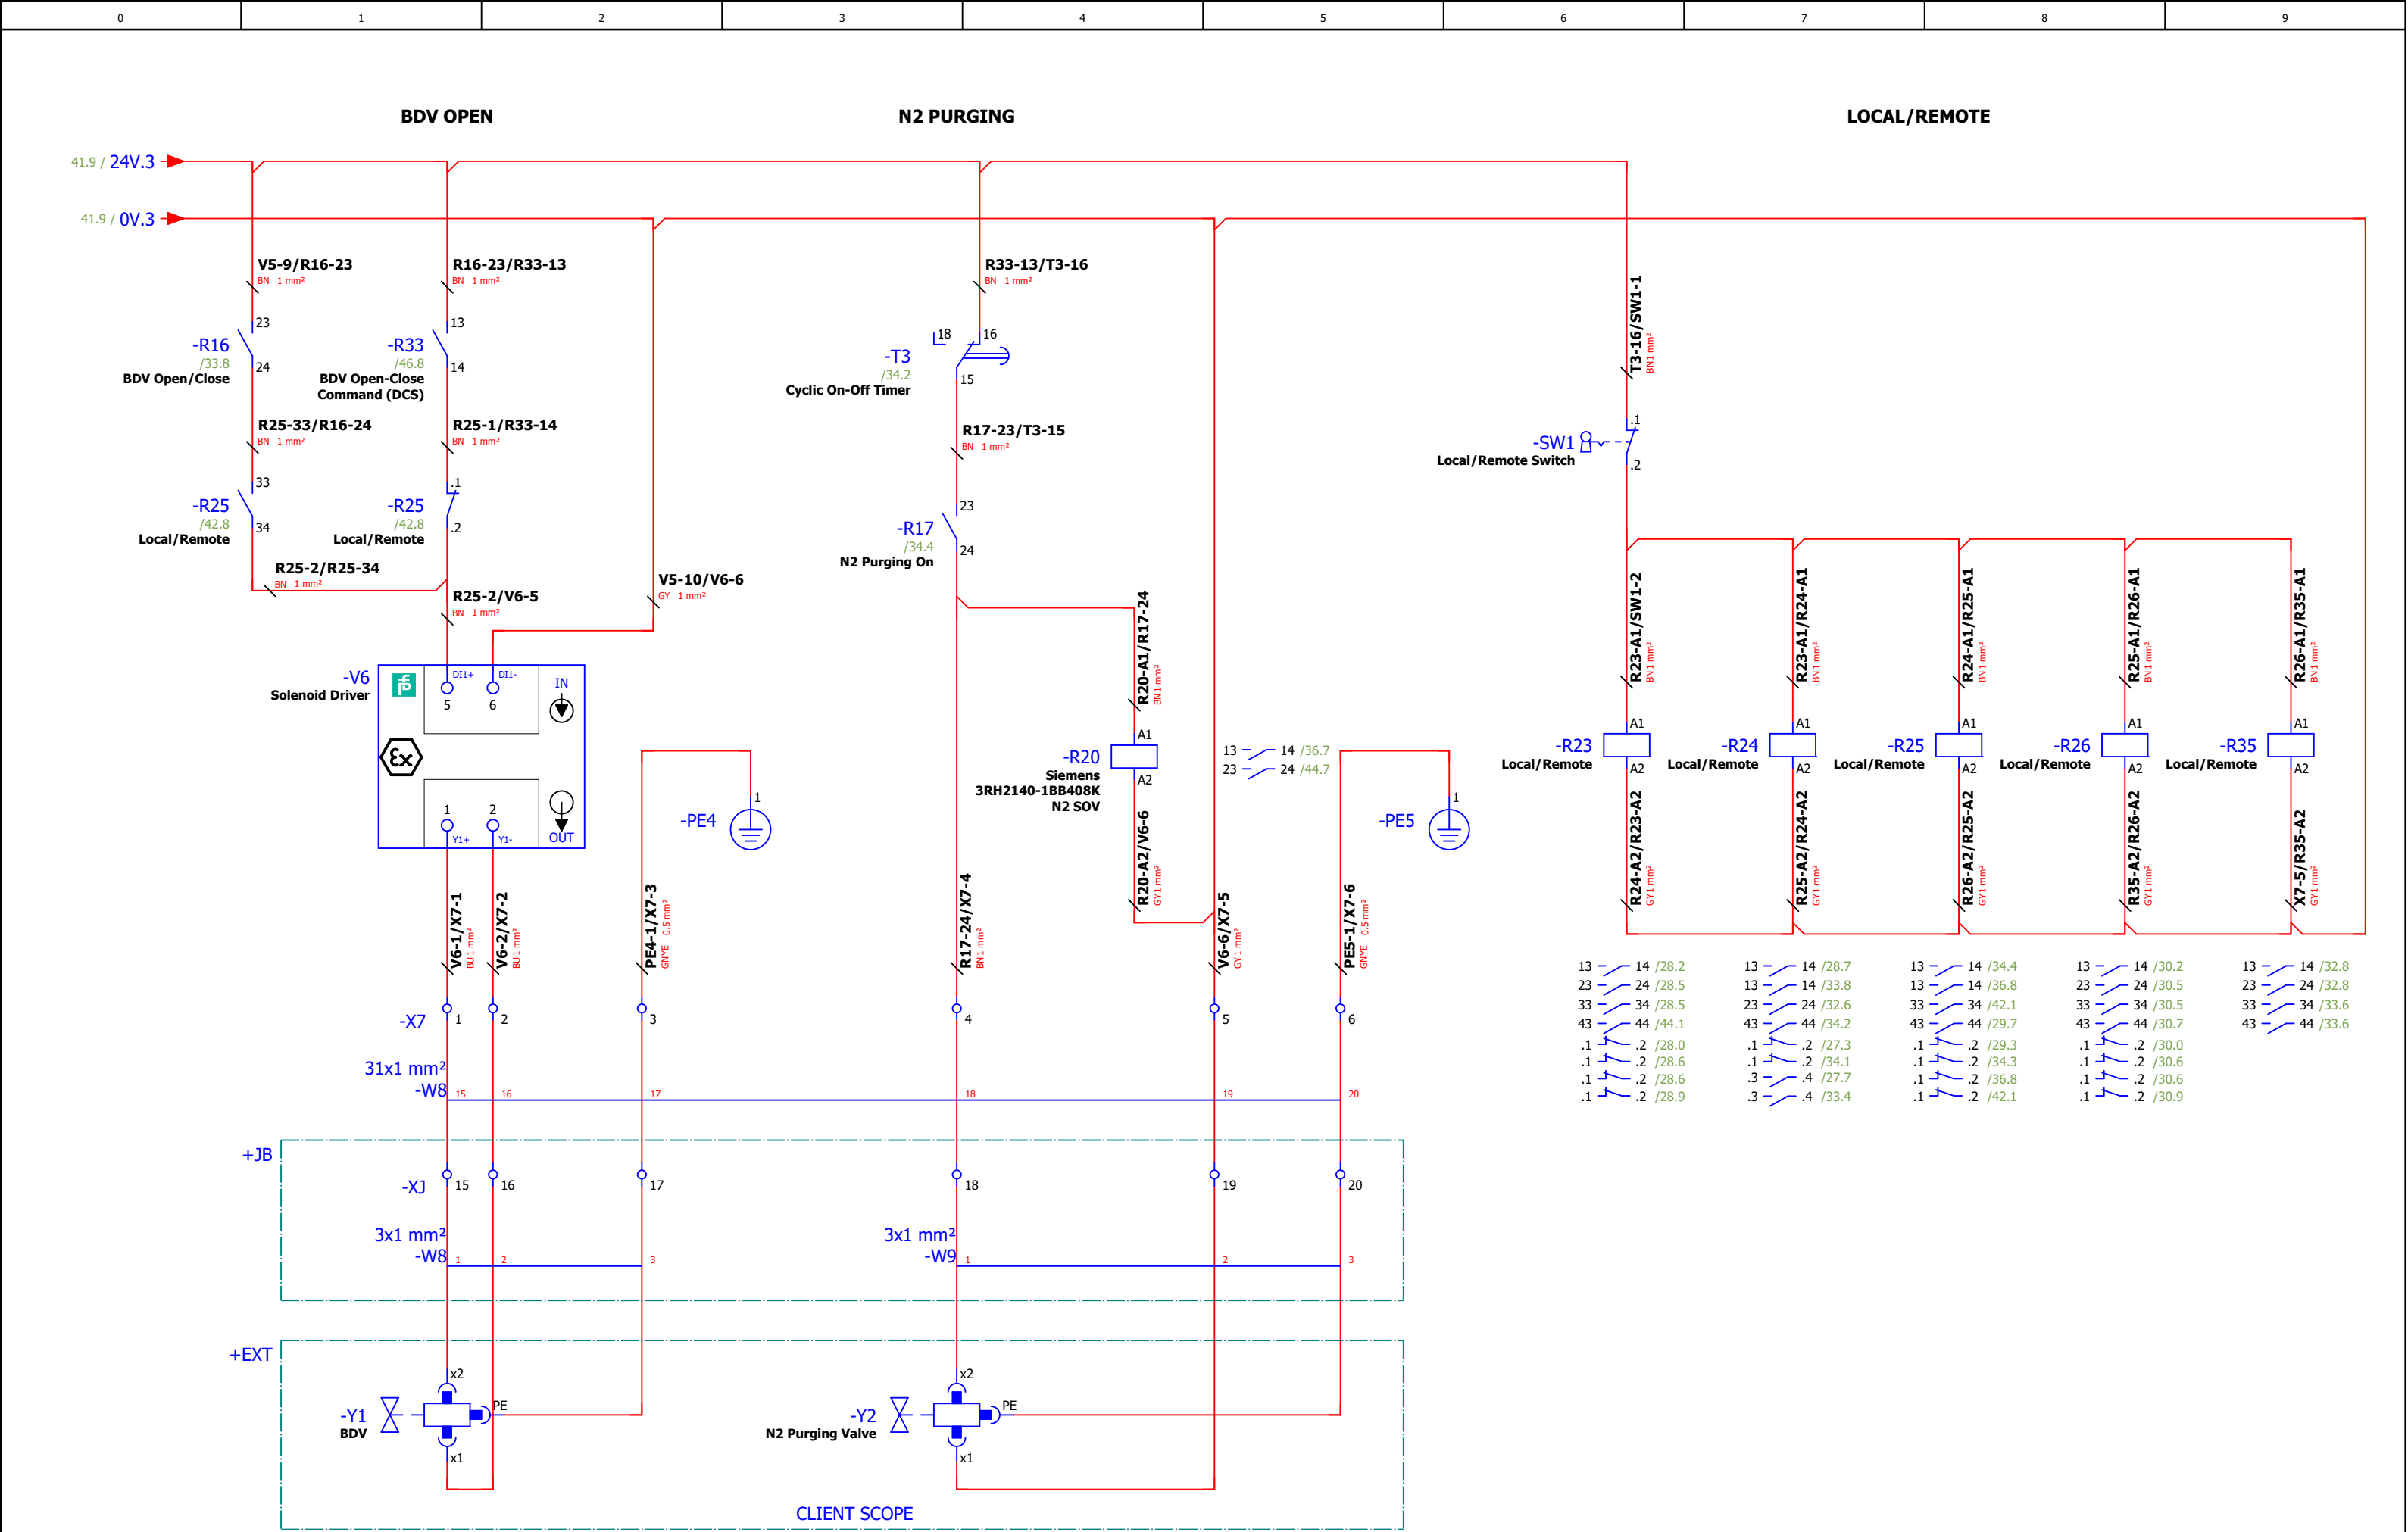


41										43									
01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : SOV		= VCD									
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)		PANEL TAG No. :	Page : 42								
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD				DRAWING No. :	SHEET								
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VIS-CON AUTOMATION		VA-200		42 OF 102							

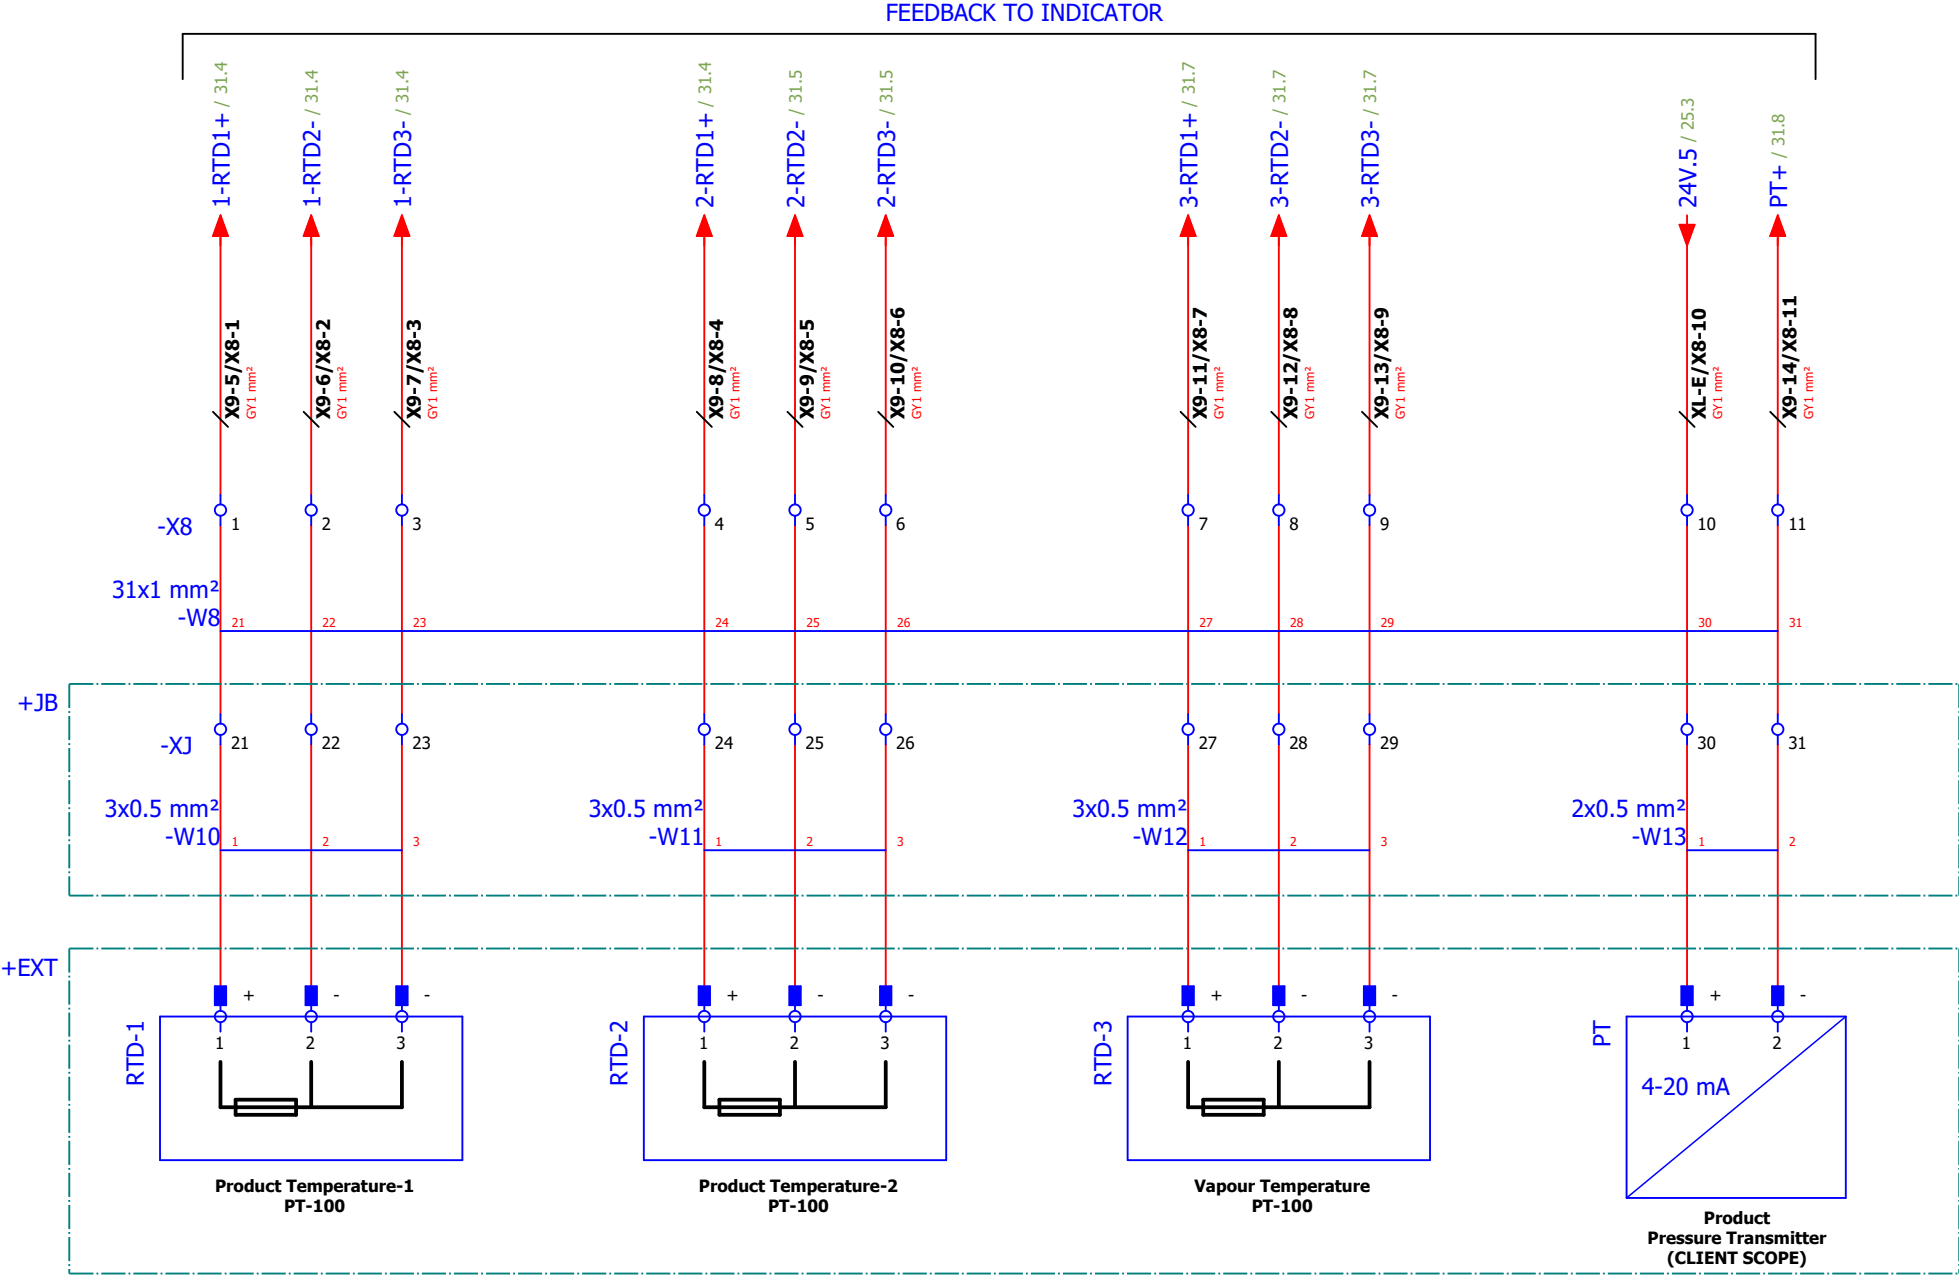

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : RTD SENSOR & TRANSMITTER		= VCD
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION	 VIS-CON AUTOMATION	VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 43
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	43 OF 102

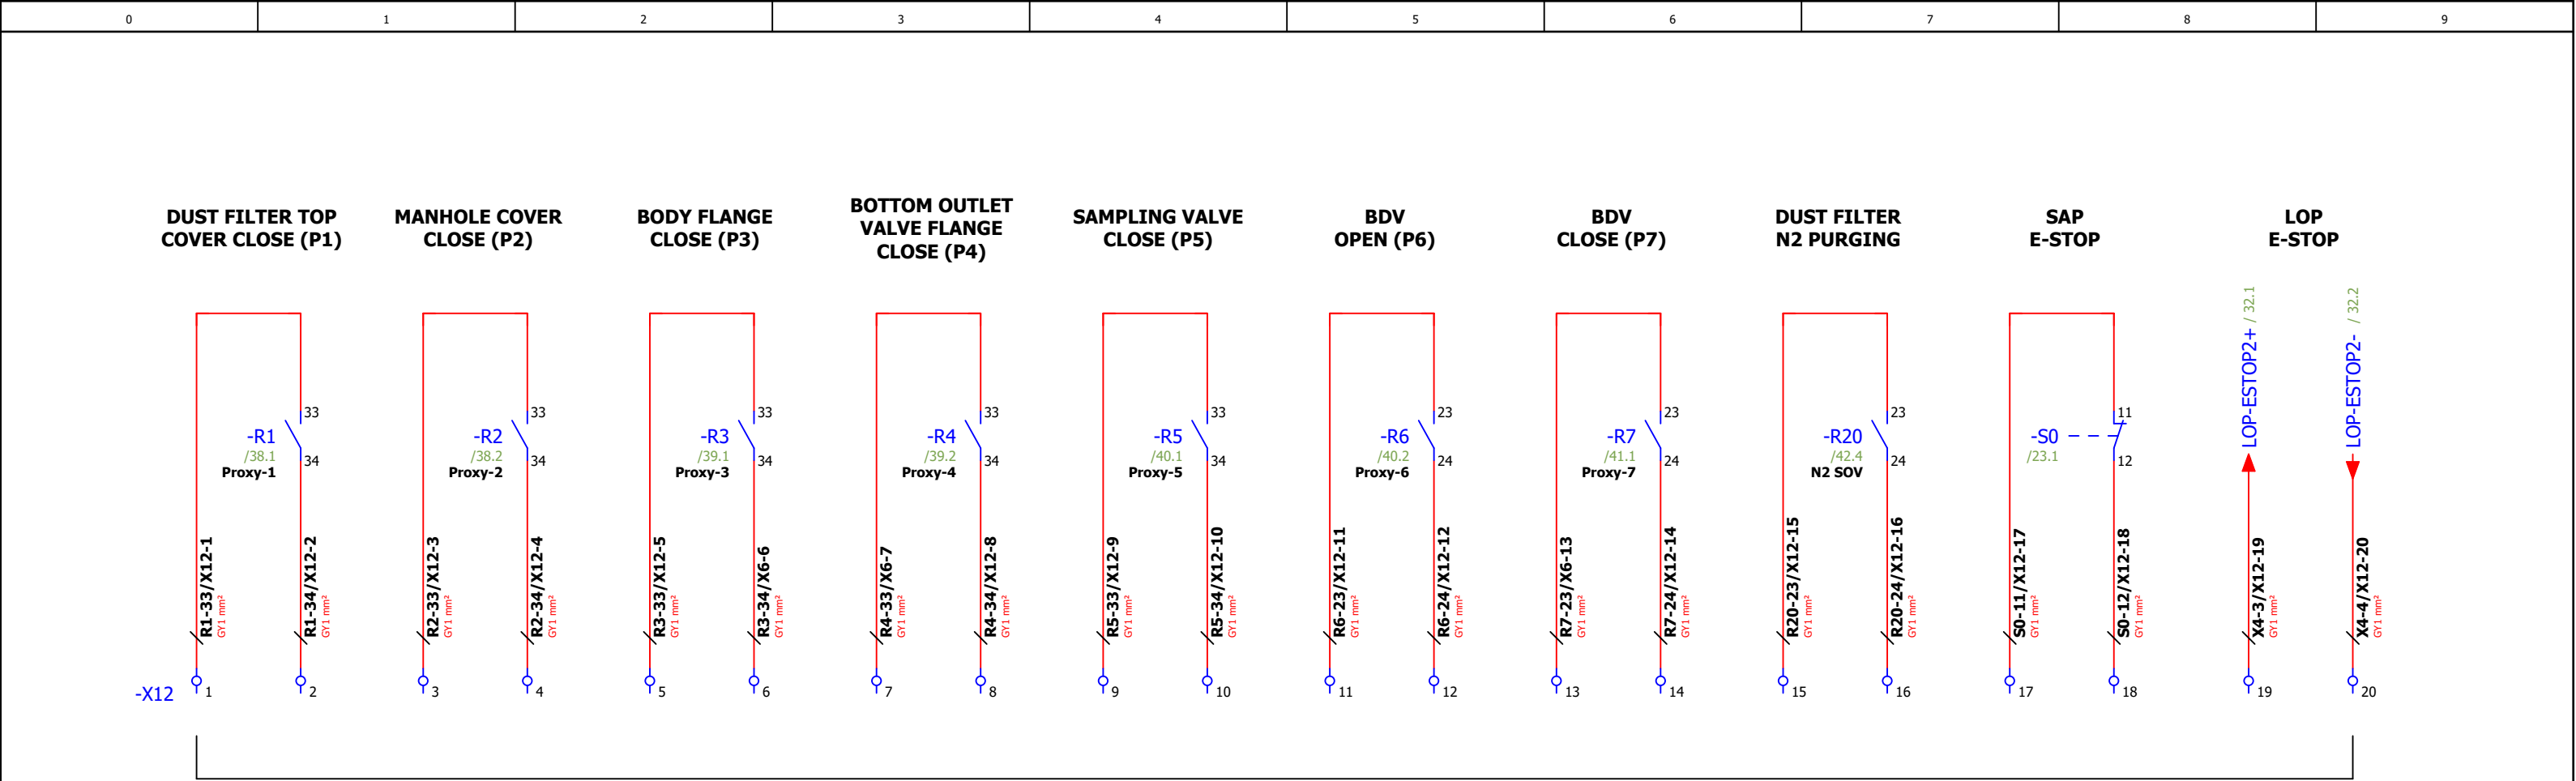


TO CLIENT'S DCS DIGITAL INPUT

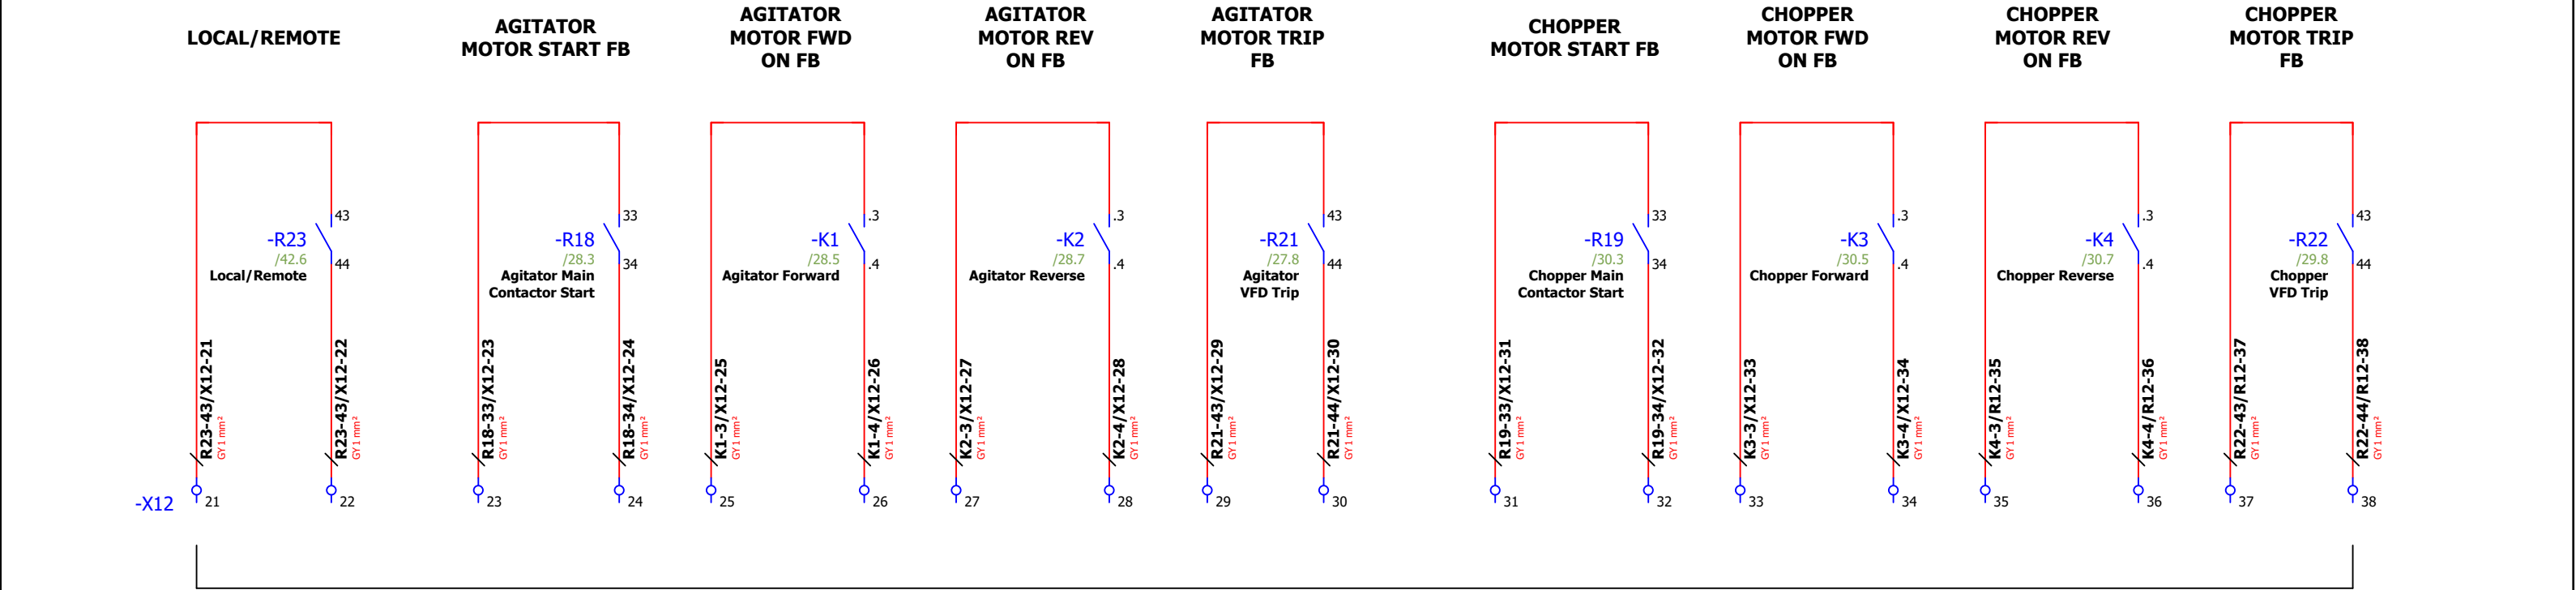

TO CLIENT'S DCS DIGITAL INPUT

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : DCS DIGITAL INPUT	= VCD
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	Page : 44
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	44 OF 102

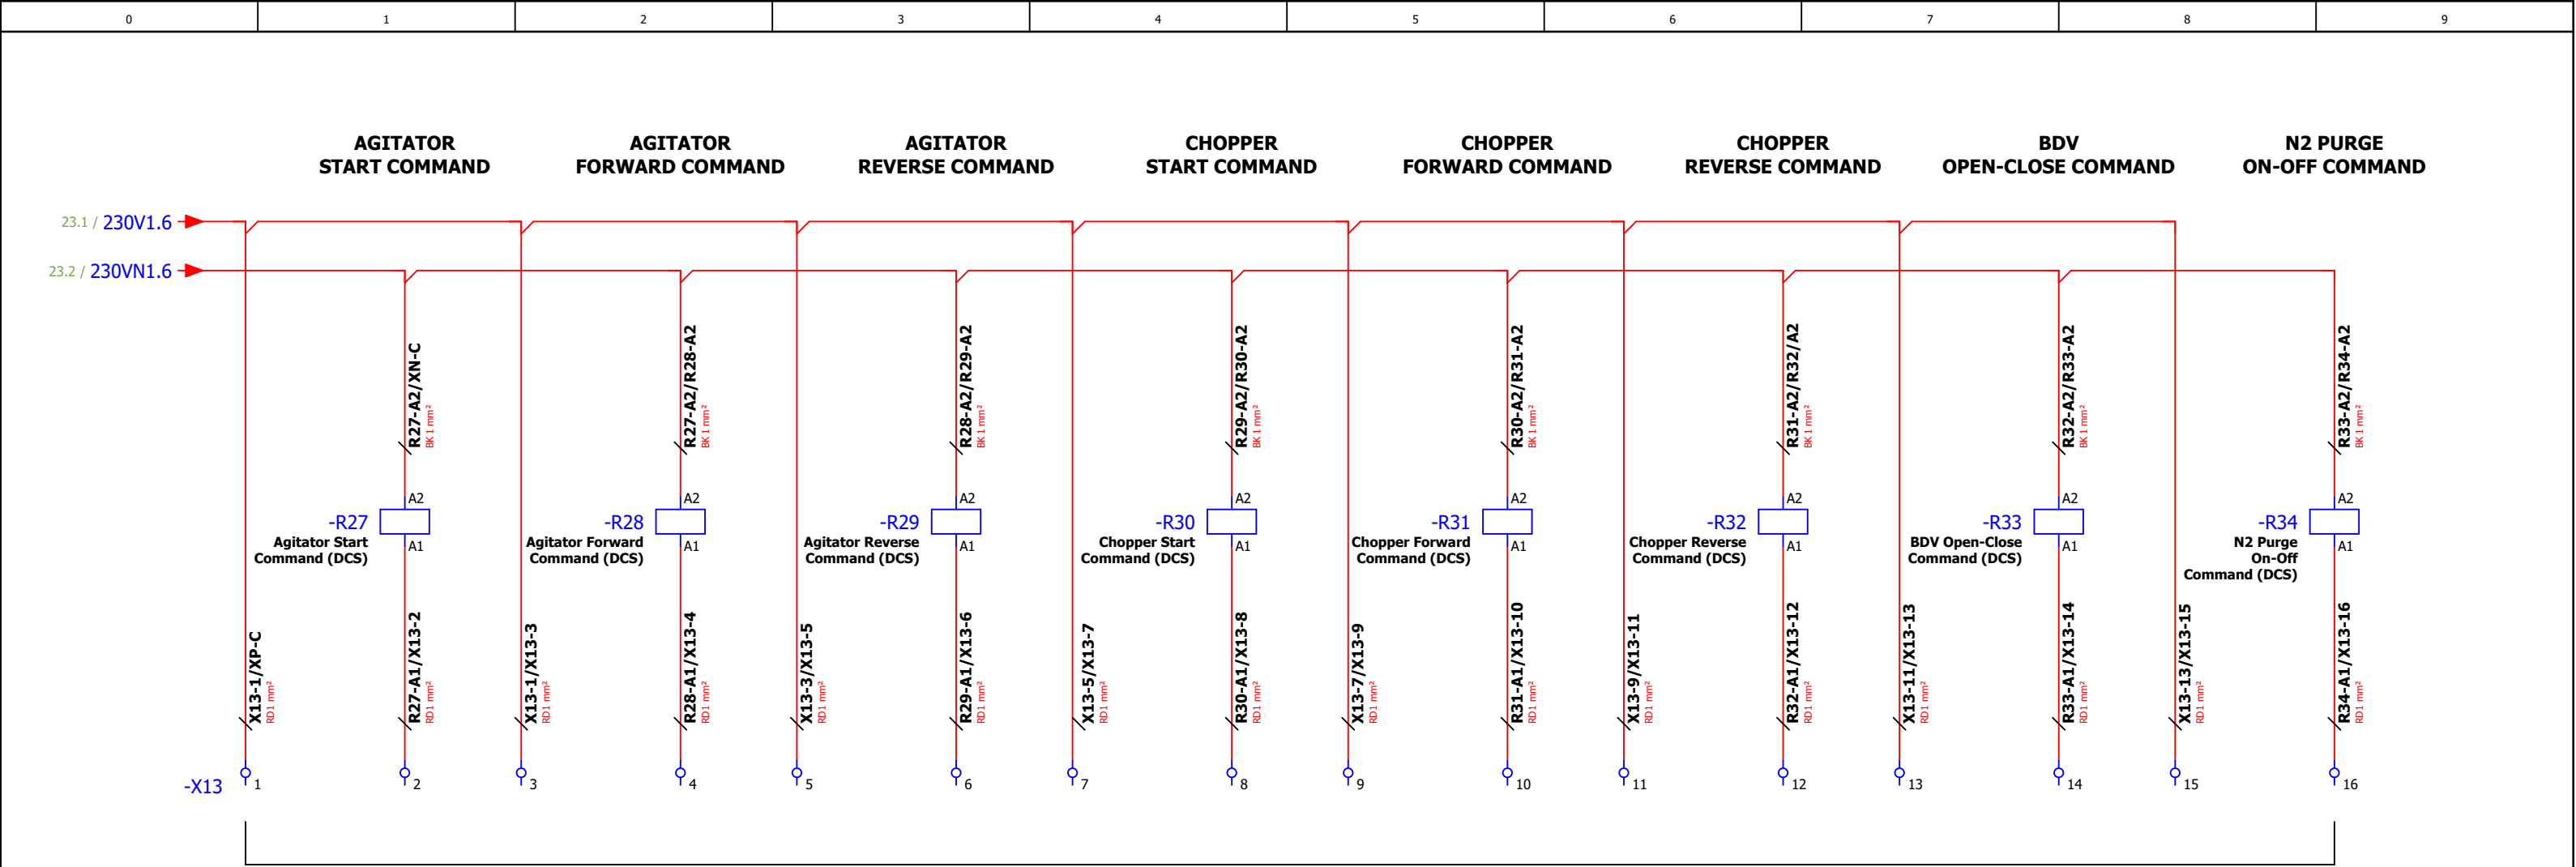


TO CLIENT'S DCS DIGITAL OUTPUT

13 - 14 /28.2 13 - 14 /28.6 13 - 14 /28.9 13 - 14 /30.2 13 - 14 /30.6 13 - 14 /30.9 13 - 14 /42.1 13 - 14 /34.1

45

47


01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : DCS DIGITAL OUTPUT		= VCD
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION	 VIS-CON AUTOMATION	VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 46
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	46 OF 102

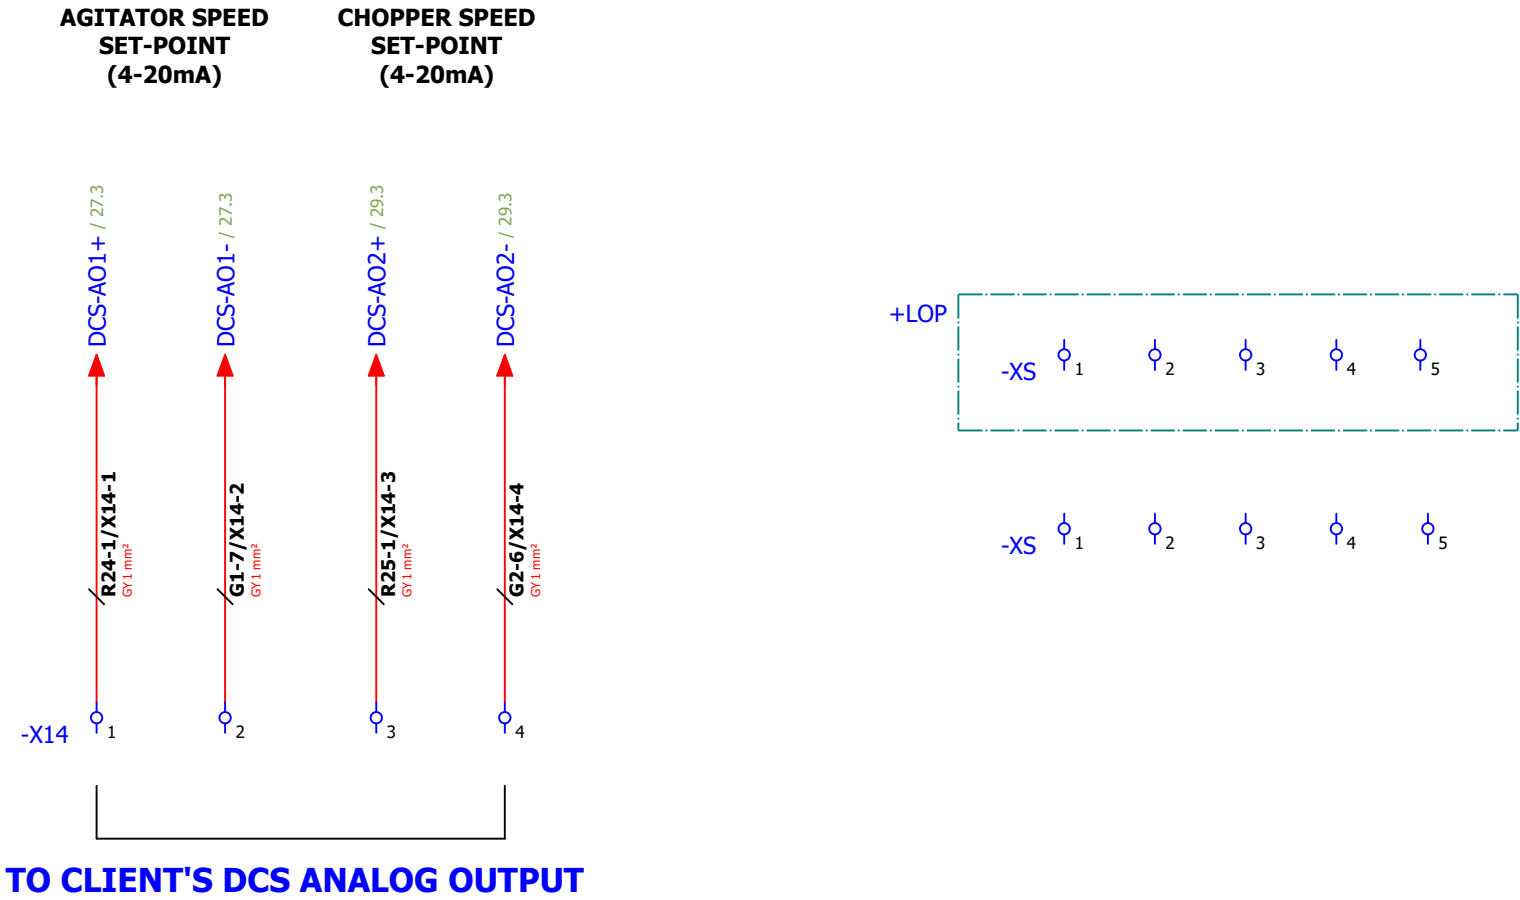

Cable overview

Cable name	Source (from)	Target (to)	all conductors	Conductors used	Cross-section [mm]	Function text	Graphical page of cable diagram
=VCD-W0	=VCD-Q1	=VCD-PE0	5	5	240	MAIN SUPPLY 415V AC	=REPORT+CD/49
=VCD-W1	=VCD-X1	=VCD+EXT-M1	4	4	50	AGITATOR MOTOR 75HP	=REPORT+CD/50
=VCD-W2	=VCD-X1	=VCD+EXT-M2	4	4	2.5	CHOPPER MOTOR 3HP	=REPORT+CD/51
=VCD-W4	=VCD-X2	=VCD+LOP-X2	4	4	1.5	CONTROL SUPPLY 230V AC	=REPORT+CD/52
=VCD-W5	=VCD-X3	=VCD+LOP-X3	3	3	1.5	CONTROL SUPPLY 24V DC	=REPORT+CD/53
=VCD-W6	=VCD-X4	=VCD+LOP-X4	22	22	1.5	PUSHBUTTON CONNECTION	=REPORT+CD/54
=VCD-W7	=VCD-X5	=VCD+LOP-X5	18	18	1.5	INDICATION CONNECTION	=REPORT+CD/56
=VCD-W8	=VCD-X6;=VCD-X7	=VCD+JB-XJ	31	31	1	SENSOR & SOV CONNECTION	=REPORT+CD/57
=VCD-W9	=VCD-X9	=VCD+LOP-X9	15	15	1.5	INDICATOR	=REPORT+CD/59
=VCD-W10	=VCD-X10	=VCD+LOP-X10	4	4	1.5	DUAL PROCESS INDICATOR	=REPORT+CD/60
=VCD-W11	=VCD-XCOM	=VCD+LOP-XCOM	6	6	0.5	RS485 COMMUNICATION	=REPORT+CD/61
=VCD+JB-W1	=VCD+JB-XJ	=VCD+EXT-P1	2	2	0.34	PROXY-1 (DUST FILTER TOP COVER CLOSE)	=REPORT+CD/62
=VCD+JB-W2	=VCD+JB-XJ	=VCD+EXT-P2	2	2	0.34	PROXY-2 (MANOLE COVER CLOSE)	=REPORT+CD/63
=VCD+JB-W3	=VCD+JB-XJ	=VCD+EXT-P3	2	2	0.34	PROXY-3 (BODY FLANGE CLOSE)	=REPORT+CD/64
=VCD+JB-W4	=VCD+JB-XJ	=VCD+EXT-P4	2	2	0.34	PROXY -4 (BOTTOM OUTLET VALVE FLANGE CLOSE)	=REPORT+CD/65
=VCD+JB-W5	=VCD+JB-XJ	=VCD+EXT-P5	2	2	0.34	PROXY-5 (SAMPLING VALVE CLOSE)	=REPORT+CD/66
=VCD+JB-W6	=VCD+JB-XJ	=VCD+EXT-P6	2	2	0.34	PROXY-6 (BDV OPEN)	=REPORT+CD/67
=VCD+JB-W7	=VCD+JB-XJ	=VCD+EXT-P7	2	2	0.34	PROXY-7 (BDV CLOSE)	=REPORT+CD/68
=VCD+JB-W8	=VCD+JB-XJ	=VCD+EXT-Y1	3	3	1	SOV-1 (BDV)	=REPORT+CD/69
=VCD+JB-W9	=VCD+JB-XJ	=VCD+EXT-Y2	3	3	1	SOV-2 (N2 PURGING VALVE)	=REPORT+CD/70
=VCD+JB-W10	=VCD+EXT-RTD-1	=VCD+JB-XJ	3	3	0.5	RTD SENSOR-1 (PRODUCT TEMPERATURE-1)	=REPORT+CD/71
=VCD+JB-W11	=VCD+EXT-RTD-2	=VCD+JB-XJ	3	3	0.5	RTD SENSOR-2 (PRODUCT TEMPERATURE-2)	=REPORT+CD/72
=VCD+JB-W12	=VCD+EXT-RTD-3	=VCD+JB-XJ	3	3	0.5	RTD SENSOR-3 (VAPOUR TEMPERATURE)	=REPORT+CD/73
=VCD+JB-W13	=VCD+EXT-PT	=VCD+JB-XJ	2	2	0.5	PRODUCT PRESSURE TRANSMITTER	=REPORT+CD/74

Cable diagram

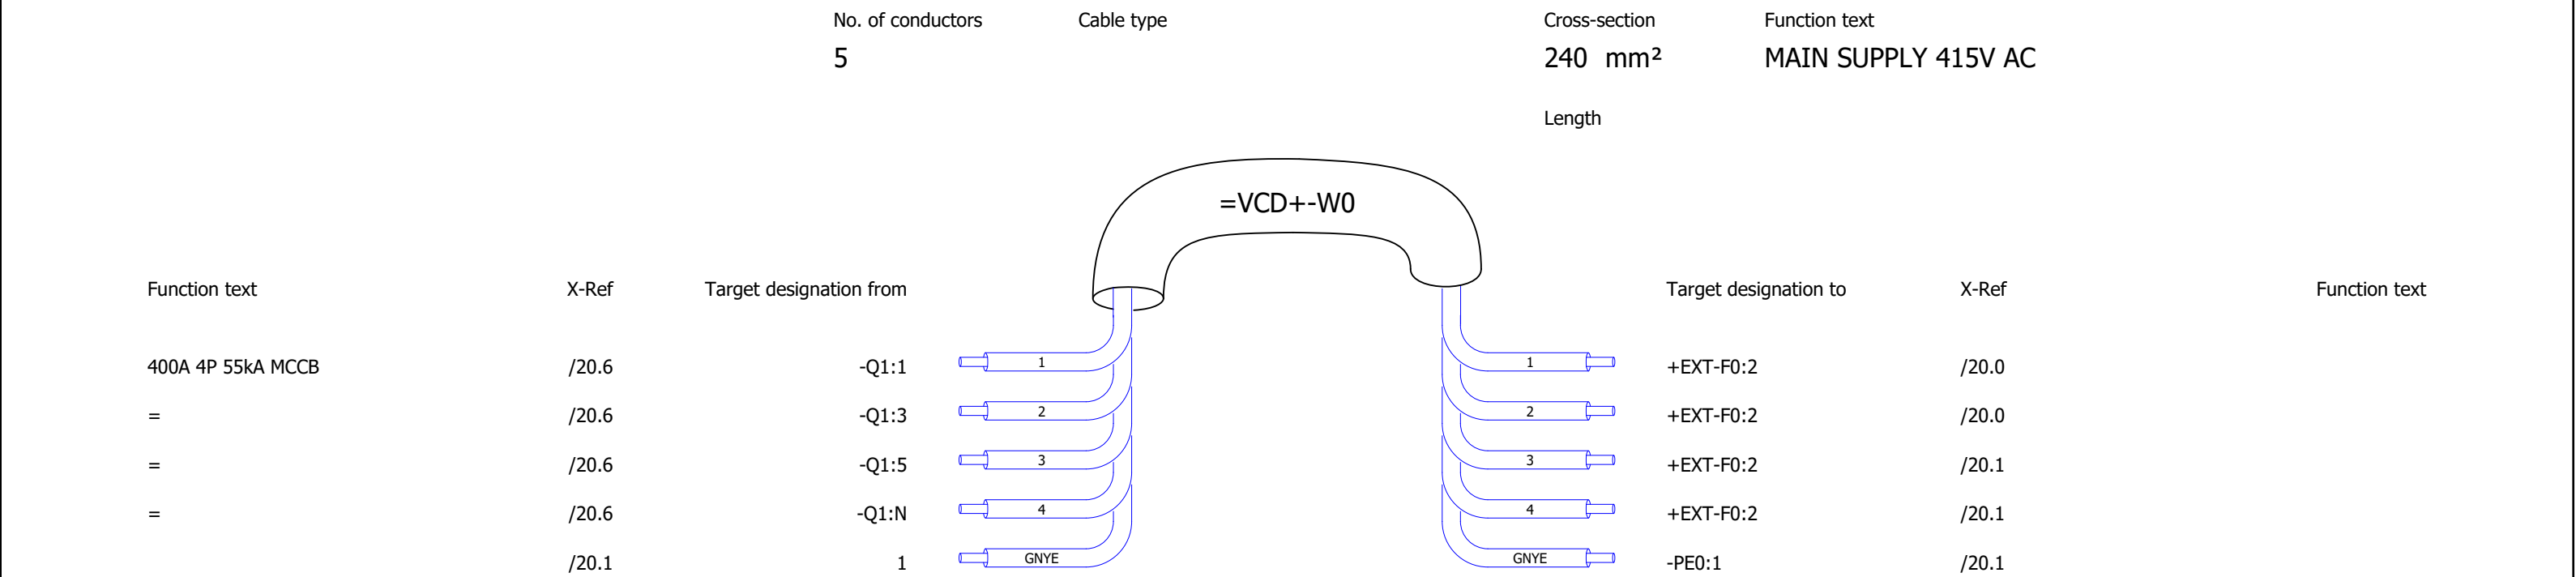

Cable diagram

No. of conductors

4

Cable type

Cross-section

50 mm²

Function text

AGITATOR MOTOR 75HP

Length

Function text

AGITATOR MOTOR U1

X-Ref

/27.0

Target designation from

-X1:1

1

Target designation to

+EXT-M1:U1

X-Ref

/27.0

Function text

AGITATOR MOTOR

Function text

AGITATOR MOTOR V1

X-Ref

/27.1

Target designation from

-X1:2

2

Target designation to

+EXT-M1:V1

X-Ref

/27.0

Function text

=

Function text

AGITATOR MOTOR W1

X-Ref

/27.1

Target designation from

-X1:3

3

Target designation to

+EXT-M1:W1

X-Ref

/27.0

Function text

=

Function text

AGITATOR MOTOR PE

X-Ref

/27.1

Target designation from

-X1:4

GNYE

Target designation to

+EXT-M1:PE

X-Ref

/27.0

Function text

=

=VCD+-W1

1

2

3

GNYE


1

2


3

GNYE


Cable diagram

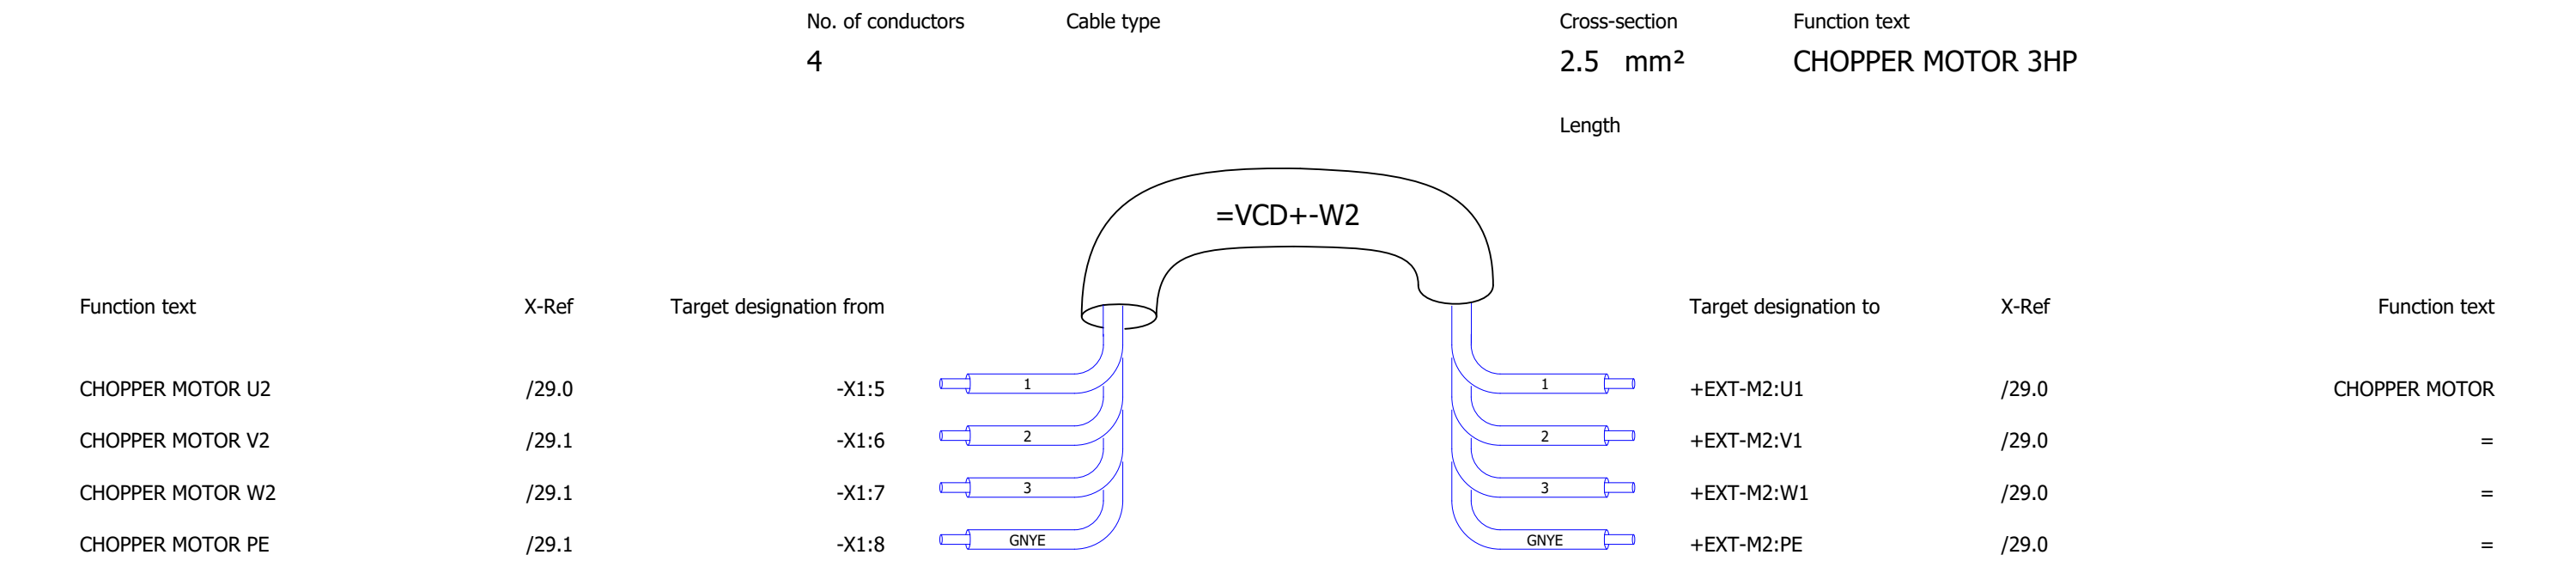

Cable diagram

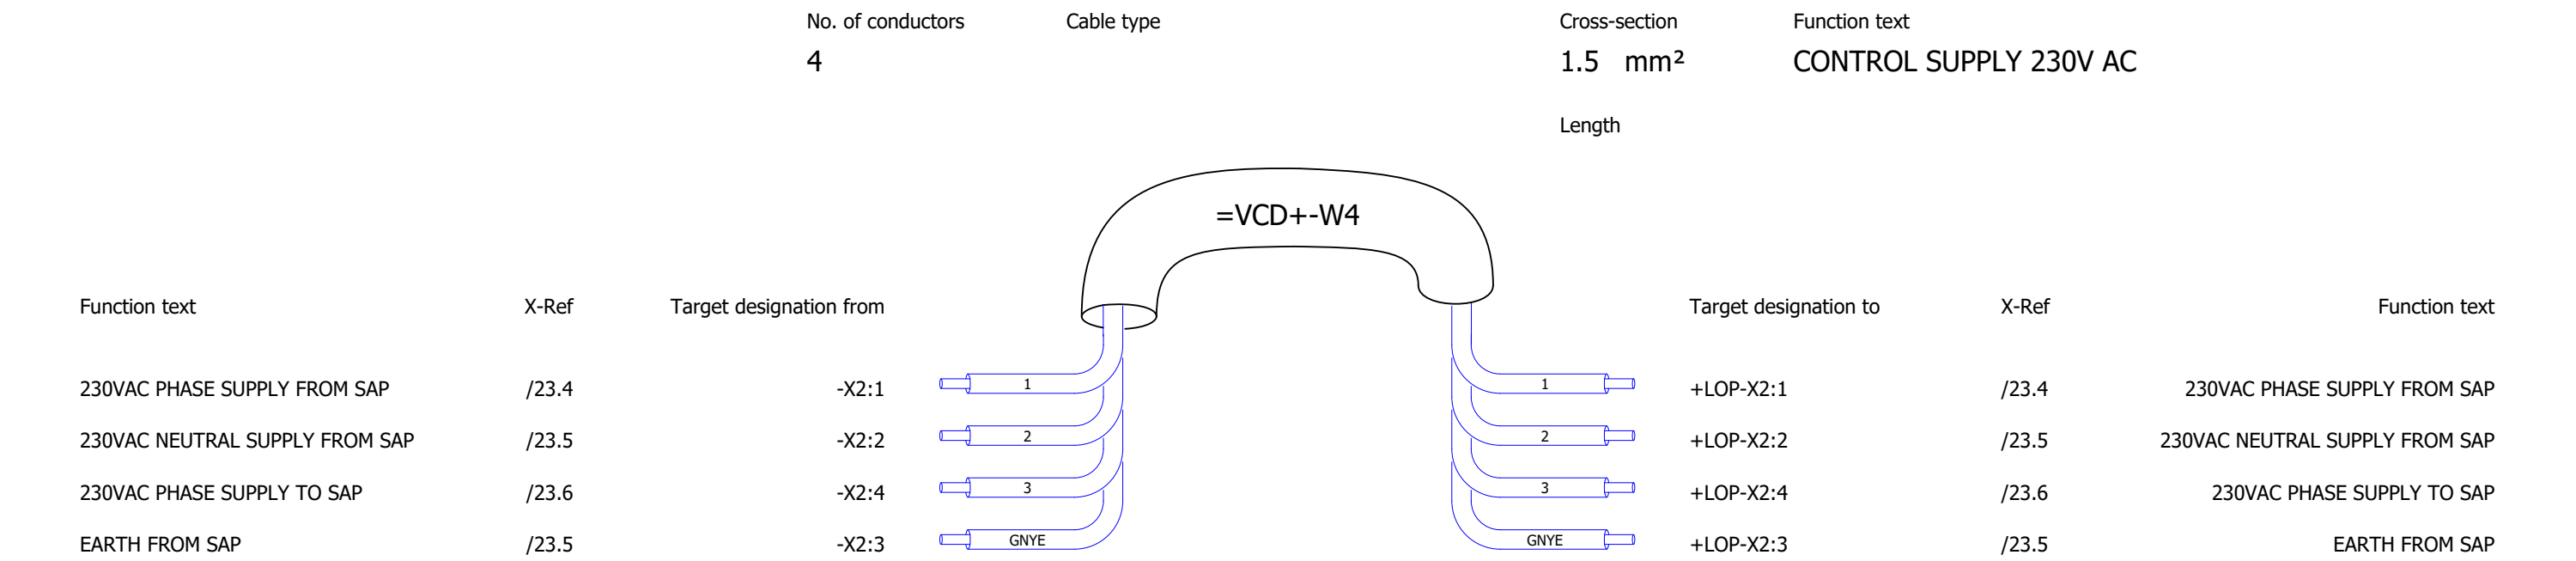

Cable diagram

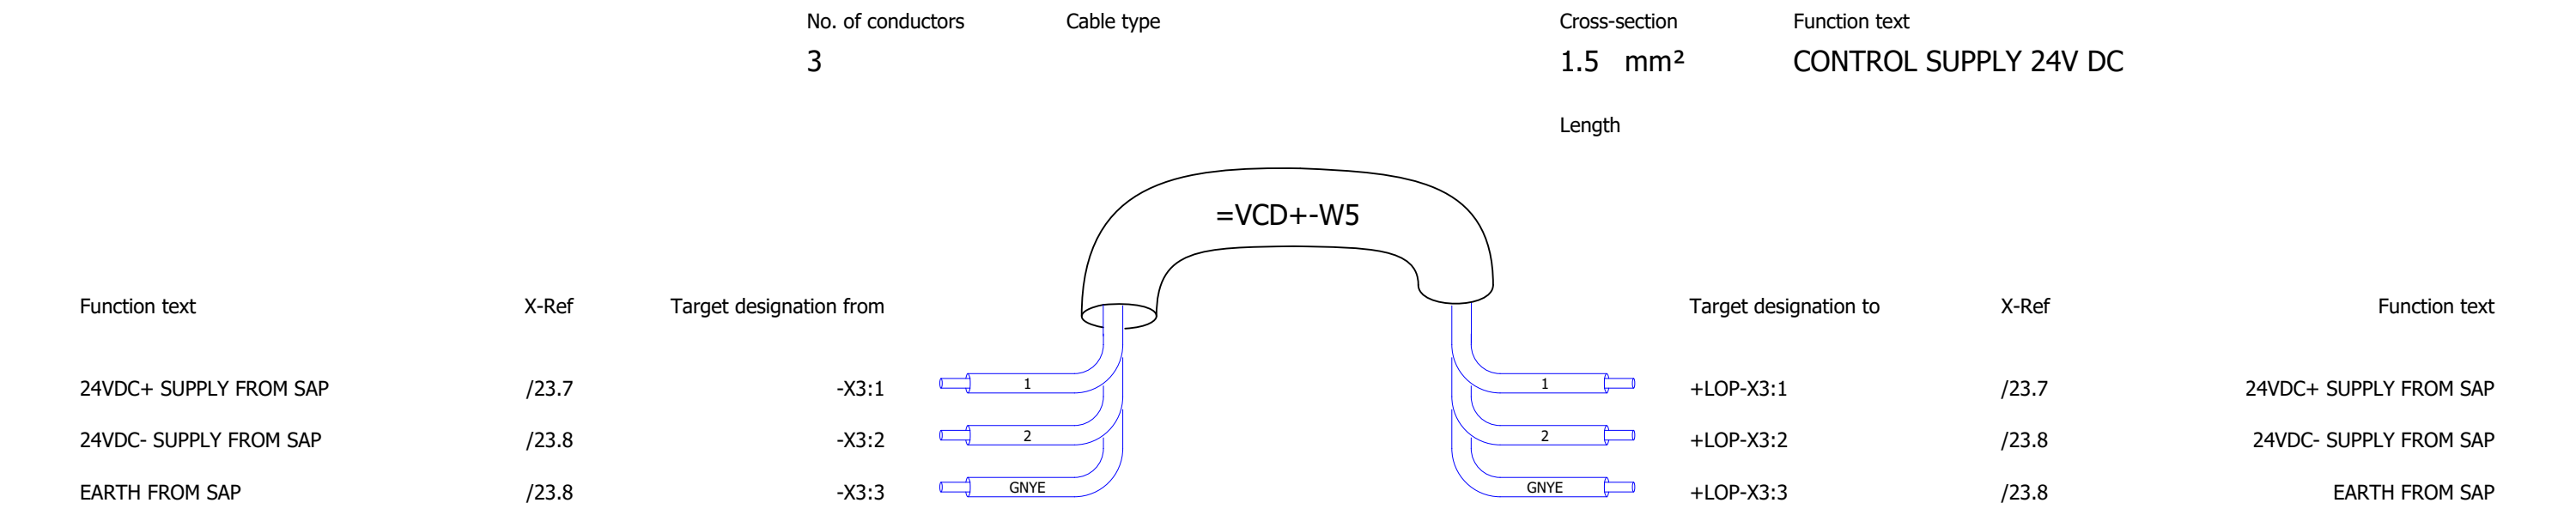

Cable diagram

		No. of conductors	Cable type		Cross-section	Function text		
		22			1.5 mm²	PUSHBUTTON CONNECTION		
				Length				
		=VCD+-W6						
Function text	X-Ref	Target designation from				Target designation to	X-Ref	Function text
EMGERGENCY COMMON (SAP)	/32.1	-X4:1	1		1	+LOP-X4:1	/32.1	EMGERGENCY COMMON (SAP)
EMGERGENCY NC (SAP)	/32.1	-X4:2	2		2	+LOP-X4:2	/32.1	EMGERGENCY NC (SAP)
EMGERGENCY COMMON (DCS)	/32.1	-X4:3	3		3	+LOP-X4:3	/32.1	EMGERGENCY COMMON (DCS)
EMGERGENCY NC (DCS)	/32.2	-X4:4	4		4	+LOP-X4:4	/32.2	EMGERGENCY NC (DCS)
AGITATOR START PB S1	/32.3	-X4:5	5		5	+LOP-X4:5	/32.3	AGITATOR START PB S1
AGITATOR FORWARD PB S2	/32.4	-X4:6	6		6	+LOP-X4:6	/32.4	AGITATOR FORWARD PB S2
AGITATOR REVERSE PB S3	/32.4	-X4:7	7		7	+LOP-X4:7	/32.4	AGITATOR REVERSE PB S3
AGITATOR STOP PB S4	/32.5	-X4:8	8		8	+LOP-X4:8	/32.5	AGITATOR STOP PB S4
AGITATOR STOP PB S4 FOR TIMER	/32.7	-X4:9	9		9	+LOP-X4:9	/32.7	AGITATOR STOP PB S4 FOR TIMER
AGITATOR RPM INCREASRE PB S5	/32.8	-X4:10	10		10	+LOP-X4:10	/32.8	AGITATOR RPM INCREASRE PB S5
AGITATOR RPM DECREASRE PB S6	/32.8	-X4:11	11		11	+LOP-X4:11	/32.8	AGITATOR RPM DECREASRE PB S6
CHOPPER START PB S7	/33.1	-X4:12	12		12	+LOP-X4:12	/33.1	CHOPPER START PB S7
CHOPPER FORWARD PB S8	/33.2	-X4:13	13		13	+LOP-X4:13	/33.2	CHOPPER FORWARD PB S8
CHOPPER REVERSE PB S9	/33.2	-X4:14	14		14	+LOP-X4:14	/33.2	CHOPPER REVERSE PB S9
CHOPPER STOP PB S10	/33.3	-X4:15	15		15	+LOP-X4:15	/33.3	CHOPPER STOP PB S10
CHOPPER STOP PB S10 FOR TIMER	/33.5	-X4:16	16		16	+LOP-X4:16	/33.5	CHOPPER STOP PB S10 FOR TIMER
CHOPPER RPM INCREASRE PB S11	/33.6	-X4:17	17		17	+LOP-X4:17	/33.6	CHOPPER RPM INCREASRE PB S11
CHOPPER RPM DECREASRE PB S12	/33.6	-X4:18	18		18	+LOP-X4:18	/33.6	CHOPPER RPM DECREASRE PB S12
BDV OPEN PB S13	/33.8	-X4:19	19		19	+LOP-X4:19	/33.8	BDV OPEN PB S13
BDV CLOSE PB S14	/33.9	-X4:20	20		20	+LOP-X4:20	/33.9	BDV CLOSE PB S14

Cable diagram

No. of conductors

22

Cable type

Cross-section

1.5 mm²

Function text

PUSHBUTTON CONNECTION

Length

Function text

N2 PURGE START PB S15

X-Ref

/34.2

Target designation from

-X4:21

Target designation to

+LOP-X4:21

X-Ref

/34.2

Function text

N2 PURGE START PB S15

Function text

N2 PURGE STOP PB S16

X-Ref

/34.4

Target designation from

-X4:22

Target designation to

+LOP-X4:22

X-Ref

/34.4

Function text

N2 PURGE STOP PB S16

21

22

=VCD+-W6

21


22

Cable diagram

		No. of conductors	Cable type	Cross-section	Function text		
		31		1 mm²	SENSOR & SOV CONNECTION		
		Length					
Function text	X-Ref	Target designation from	=VCD+-W8		Target designation to	X-Ref	Function text
PROXY P1+	/38.3	-X6:1	1	1	+JB-XJ:1	/38.3	PROXY P1+ (JB)
PROXY P1-	/38.3	-X6:2	2	2	+JB-XJ:2	/38.3	PROXY P1- (JB)
PROXY P2+	/38.4	-X6:3	3	3	+JB-XJ:3	/38.4	PROXY P2+ (JB)
PROXY P2-	/38.4	-X6:4	4	4	+JB-XJ:4	/38.4	PROXY P2- (JB)
PROXY P3+	/39.3	-X6:5	5	5	+JB-XJ:5	/39.3	PROXY P3+ (JB)
PROXY P3-	/39.3	-X6:6	6	6	+JB-XJ:6	/39.3	PROXY P3- (JB)
PROXY P4+	/39.4	-X6:7	7	7	+JB-XJ:7	/39.4	PROXY P4+ (JB)
PROXY P4-	/39.4	-X6:8	8	8	+JB-XJ:8	/39.4	PROXY P4- (JB)
PROXY P5+	/40.3	-X6:9	9	9	+JB-XJ:9	/40.3	PROXY P5+ (JB)
PROXY P5-	/40.3	-X6:10	10	10	+JB-XJ:10	/40.3	PROXY P5- (JB)
PROXY P6+	/40.4	-X6:11	11	11	+JB-XJ:11	/40.4	PROXY P6+ (JB)
PROXY P6-	/40.4	-X6:12	12	12	+JB-XJ:12	/40.4	PROXY P6- (JB)
PROXY P7+	/41.3	-X6:13	13	13	+JB-XJ:13	/41.3	PROXY P7+ (JB)
PROXY P7-	/41.3	-X6:14	14	14	+JB-XJ:14	/41.3	PROXY P7- (JB)
SOV Y1+	/42.1	-X7:1	15	15	+JB-XJ:15	/42.1	SOV Y1+ (JB)
SOV Y1-	/42.2	-X7:2	16	16	+JB-XJ:16	/42.2	SOV Y1- (JB)
SOV Y1 EARTH	/42.2	-X7:3	17	17	+JB-XJ:17	/42.2	SOV Y1 EARTH (JB)
SOV Y2 24V	/42.3	-X7:4	18	18	+JB-XJ:18	/42.3	SOV Y2 24V (JB)
SOV Y2 0V	/42.5	-X7:5	19	19	+JB-XJ:19	/42.5	SOV Y2 0V (JB)
SOV Y2 EARTH	/42.5	-X7:6	20	20	+JB-XJ:20	/42.5	SOV Y2 EARTH (JB)

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Cable diagram =VCD+-W8	= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : Page : 57
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. : SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200 57 OF 102	


Cable diagram

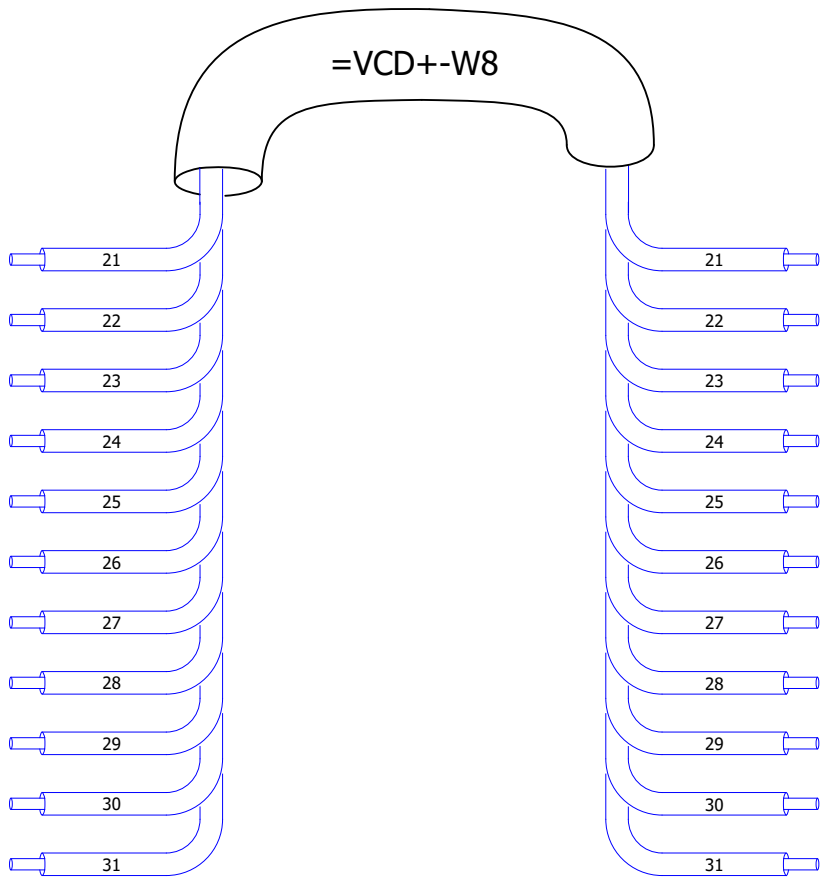		No. of conductors	Cable type		Cross-section	Function text		
		31			1 mm ²	SENSOR & SOV CONNECTION		
				Length				
Function text	X-Ref	Target designation from			Target designation to	X-Ref	Function text	
1-RTD1+	/43.1	-X8:1	21		+JB-XJ:21	/43.1	1-RTD1+ (JB)	
1-RTD2-	/43.1	-X8:2	22		+JB-XJ:22	/43.1	1-RTD2- (JB)	
1-RTD3-	/43.2	-X8:3	23		+JB-XJ:23	/43.2	1-RTD3- (JB)	
2-RTD1+	/43.3	-X8:4	24		+JB-XJ:24	/43.3	2-RTD1+ (JB)	
2-RTD2-	/43.3	-X8:5	25		+JB-XJ:25	/43.3	2-RTD2- (JB)	
2-RTD3-	/43.3	-X8:6	26		+JB-XJ:26	/43.3	2-RTD3- (JB)	
3-RTD1+	/43.4	-X8:7	27		+JB-XJ:27	/43.4	3-RTD1+ (JB)	
3-RTD2-	/43.4	-X8:8	28		+JB-XJ:28	/43.4	3-RTD2- (JB)	
3-RTD3-	/43.5	-X8:9	29		+JB-XJ:29	/43.5	3-RTD3- (JB)	
PT+	/43.6	-X8:10	30		+JB-XJ:30	/43.6	PT+ (JB)	
PT-	/43.6	-X8:11	31		+JB-XJ:31	/43.6	PT- (JB)	


Cable diagram

		No. of conductors	Cable type	Cross-section	Function text		
		15		1.5 mm²	INDICATOR		
		Length					
		=VCD+-W9					
Function text	X-Ref	Target designation from			Target designation to	X-Ref	Function text
SPEED SET POINT FROM RPM INDICATOR	/31.1	-X9:1	1		+LOP-X9:1	/31.1	SPEED SET POINT FROM RPM INDICATOR
SPEED SET POINT FROM RPM INDICATOR	/31.1	-X9:2	2		+LOP-X9:2	/31.1	SPEED SET POINT FROM RPM INDICATOR
SPEED SET POINT FROM RPM INDICATOR	/31.1	-X9:3	3		+LOP-X9:3	/31.1	SPEED SET POINT FROM RPM INDICATOR
SPEED SET POINT FROM RPM INDICATOR	/31.2	-X9:4	4		+LOP-X9:4	/31.2	SPEED SET POINT FROM RPM INDICATOR
RTD SENSOR-1 (1+)	/31.4	-X9:5	5		+LOP-X9:5	/31.4	RTD SENSOR-1 (1+)
RTD SENSOR-1 (2-)	/31.4	-X9:6	6		+LOP-X9:6	/31.4	RTD SENSOR-1 (2-)
RTD SENSOR-1 (3-)	/31.4	-X9:7	7		+LOP-X9:7	/31.4	RTD SENSOR-1 (3-)
RTD SENSOR-2 (1+)	/31.4	-X9:8	8		+LOP-X9:8	/31.4	RTD SENSOR-2 (1+)
RTD SENSOR-2 (2-)	/31.5	-X9:9	9		+LOP-X9:9	/31.5	RTD SENSOR-2 (2-)
RTD SENSOR-2 (3-)	/31.5	-X9:10	10		+LOP-X9:10	/31.5	RTD SENSOR-2 (3-)
RTD SENSOR-3 (1+)	/31.7	-X9:11	11		+LOP-X9:11	/31.7	RTD SENSOR-3 (1+)
RTD SENSOR-3 (2-)	/31.7	-X9:12	12		+LOP-X9:12	/31.7	RTD SENSOR-3 (2-)
RTD SENSOR-3 (3-)	/31.7	-X9:13	13		+LOP-X9:13	/31.7	RTD SENSOR-3 (3-)
PRESSURE TRANSMITER (PT+)	/31.8	-X9:14	14		+LOP-X9:14	/31.8	PRESSURE TRANSMITER (PT+)
PRESSURE TRANSMITER (PT-)	/31.8	-X9:15	15		+LOP-X9:15	/31.8	PRESSURE TRANSMITER (PT-)

Cable diagram

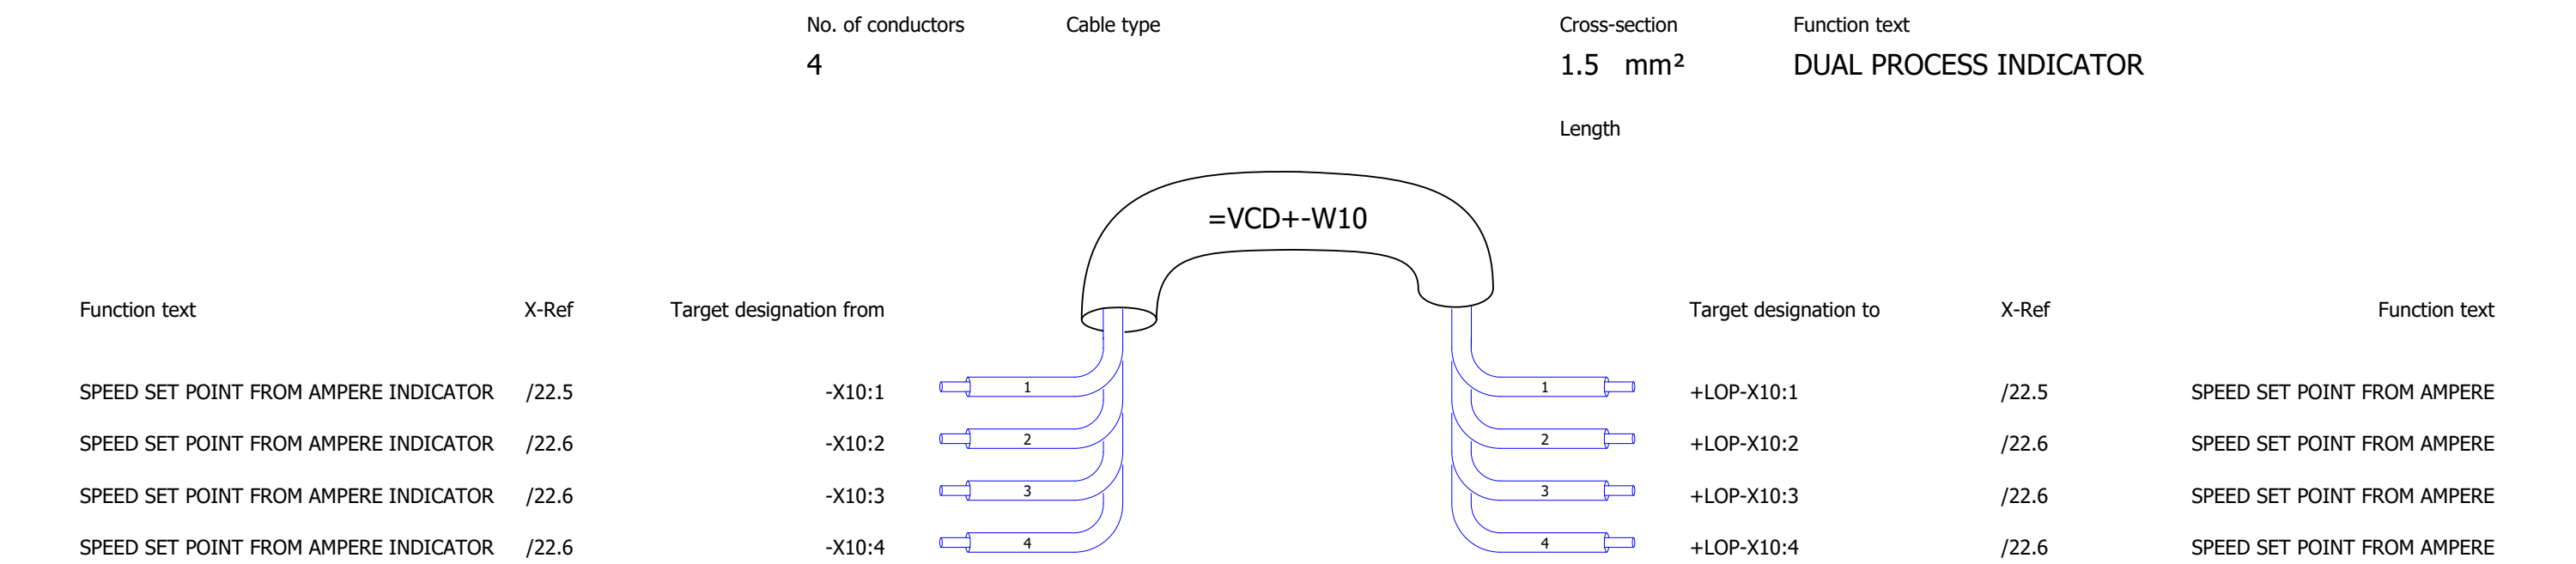

Cable diagram

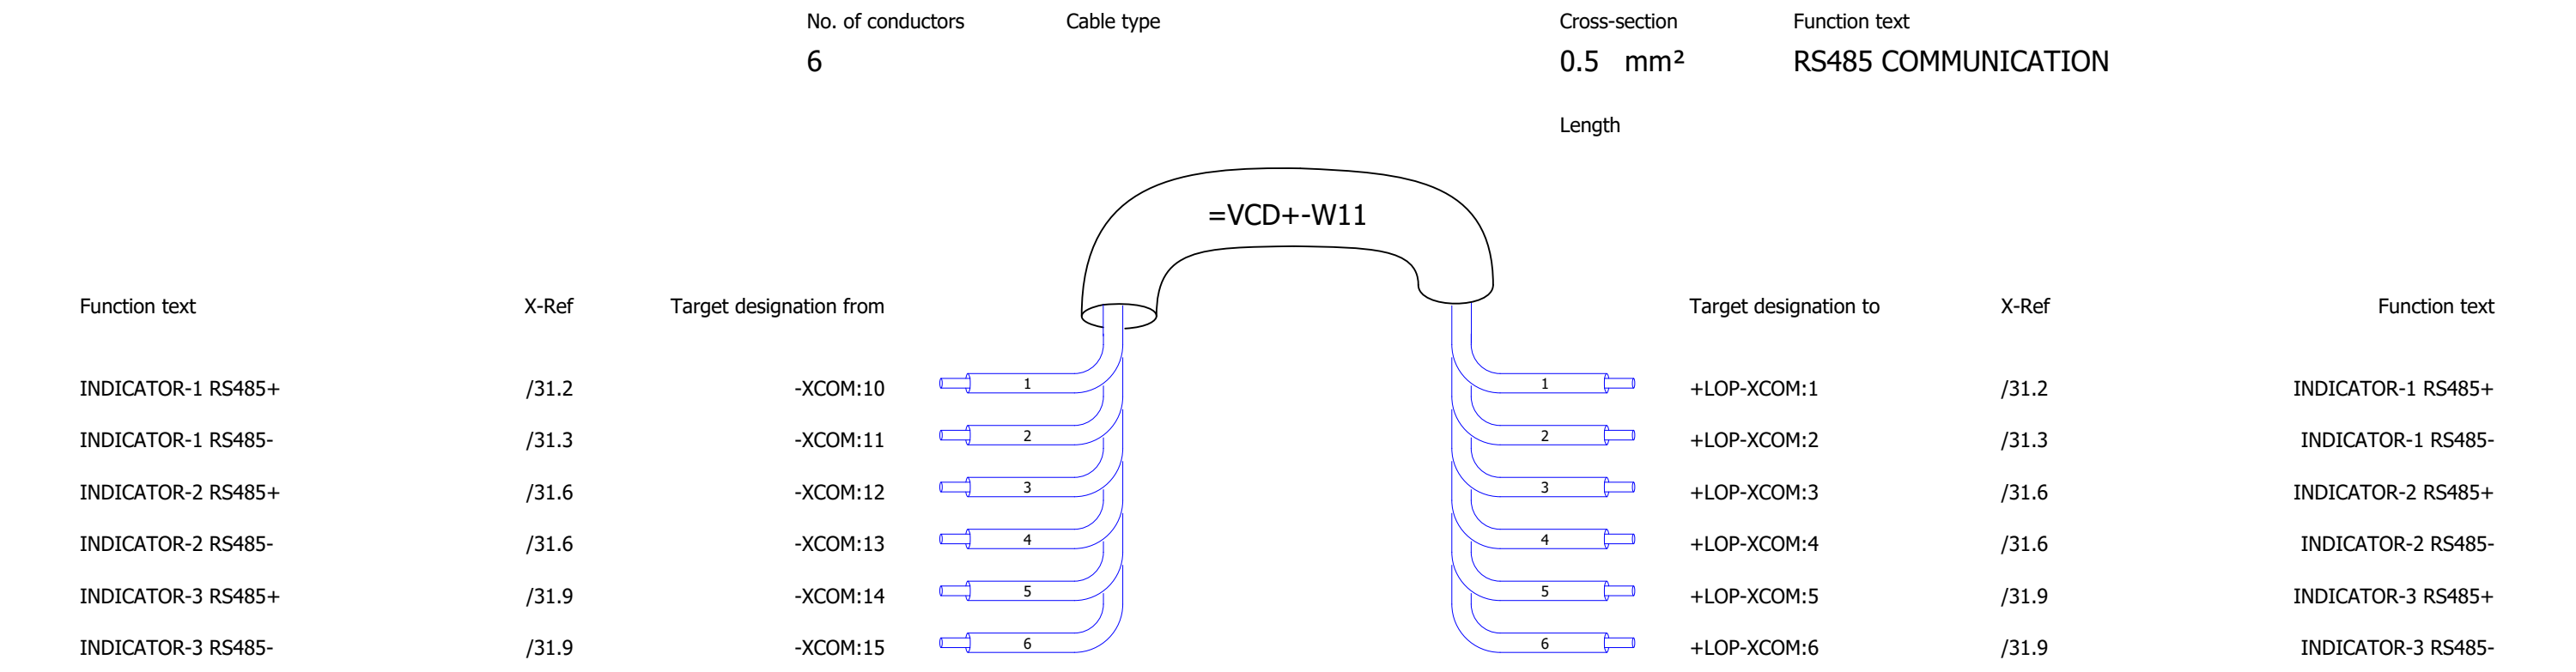

=VCD+-W11

INDICATOR-1 RS485+

/31.2

-XCOM:10

+LOP-XCOM:1

/31.2

INDICATOR-1 RS485+

INDICATOR-1 RS485-

/31.3

-XCOM:11

+LOP-XCOM:2

/31.3

INDICATOR-1 RS485-

INDICATOR-2 RS485+

/31.6

-XCOM:12

+LOP-XCOM:3

/31.6

INDICATOR-2 RS485+

INDICATOR-2 RS485-

/31.6

-XCOM:13

+LOP-XCOM:4

/31.6

INDICATOR-2 RS485-

INDICATOR-3 RS485+

/31.9

-XCOM:14

+LOP-XCOM:5

/31.9

INDICATOR-3 RS485+

INDICATOR-3 RS485-

/31.9


-XCOM:15

+LOP-XCOM:6


/31.9

INDICATOR-3 RS485-

Cable diagram

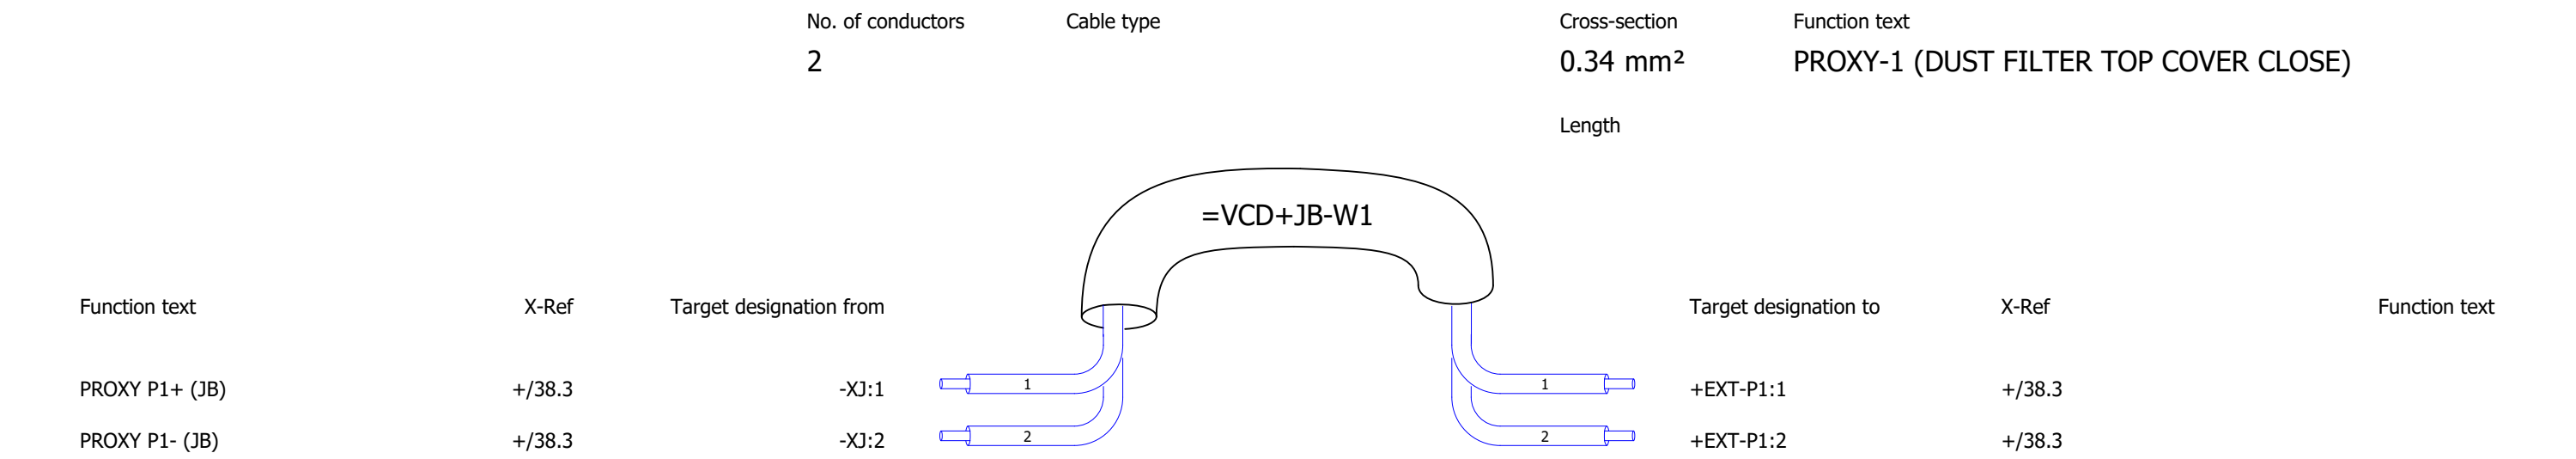

Cable diagram

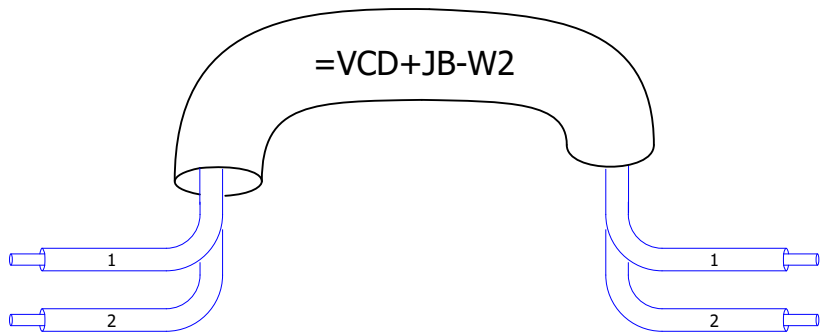		No. of conductors	Cable type	Cross-section	Function text		
		2		0.34 mm²	PROXY-2 (MANOLE COVER CLOSE)		
		Length					
							
Function text	X-Ref	Target designation from			Target designation to	X-Ref	Function text
PROXY P2+ (JB)	+/38.4	-XJ:3			+EXT-P2:1	+/38.4	
PROXY P2- (JB)	+/38.4	-XJ:4			+EXT-P2:2	+/38.4	


Cable diagram

		No. of conductors	Cable type		Cross-section	Function text	
		2			0.34 mm²	PROXY-3 (BODY FLANGE CLOSE)	
				Length			
		=VCD+JB-W3					
Function text	X-Ref	Target designation from		Target designation to		X-Ref	Function text
PROXY P3+ (JB)	+/39.3	-XJ:5		+EXT-P3:1		+/39.3	
PROXY P3- (JB)	+/39.3	-XJ:6		+EXT-P3:2		+/39.3	


Cable diagram

		No. of conductors	Cable type	Cross-section	Function text		
		2		0.34 mm ²	PROXY -4 (BOTTOM OUTLET VALVE FLANGE CLOSE)		
				Length			
		=VCD+JB-W4					
Function text	X-Ref	Target designation from			Target designation to	X-Ref	Function text
PROXY P4+ (JB)	+/39.4	-XJ:7	1		+EXT-P4:1	+/39.4	
PROXY P4- (JB)	+/39.4	-XJ:8	2		+EXT-P4:2	+/39.4	


Cable diagram

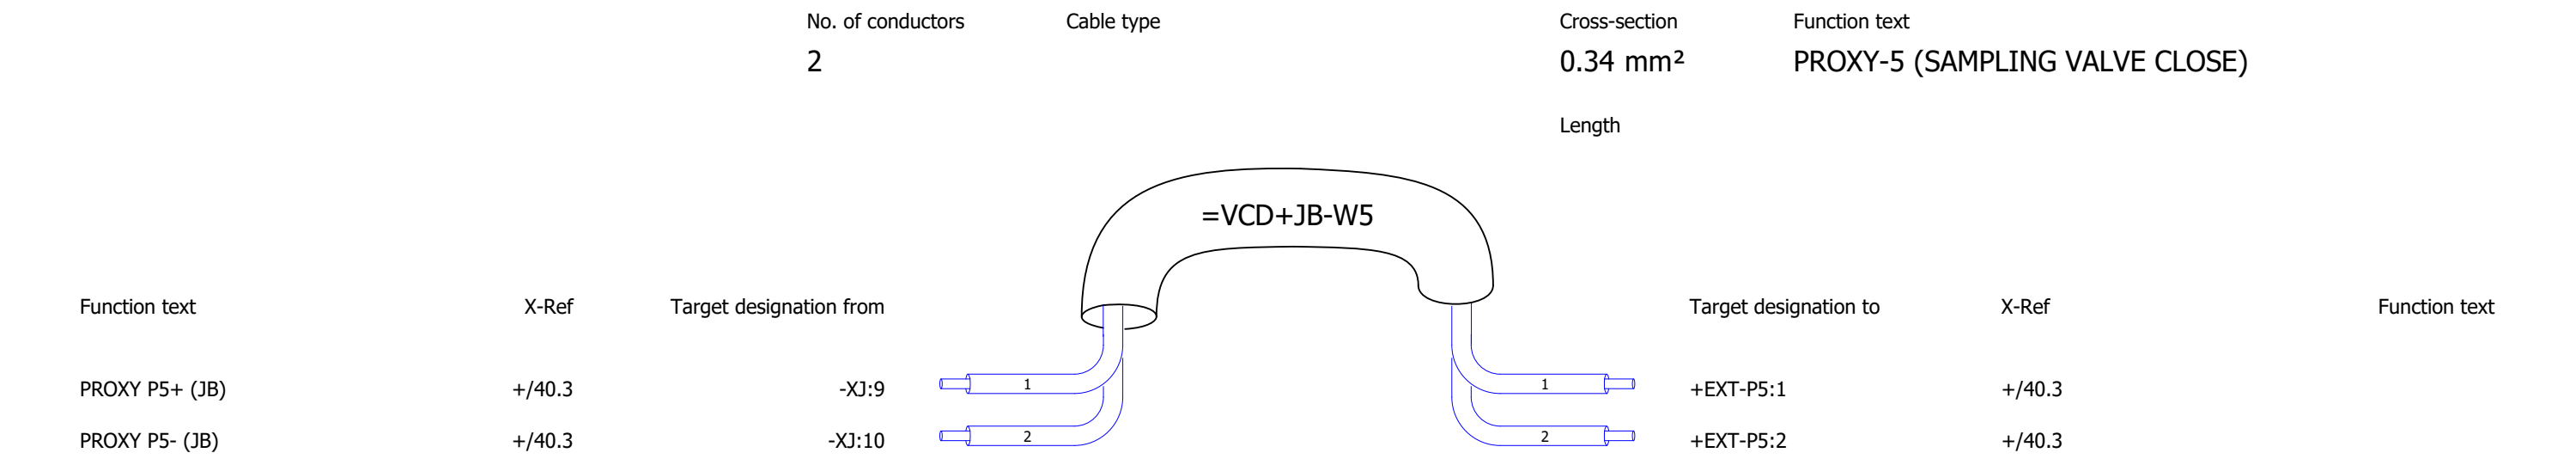


Cable diagram

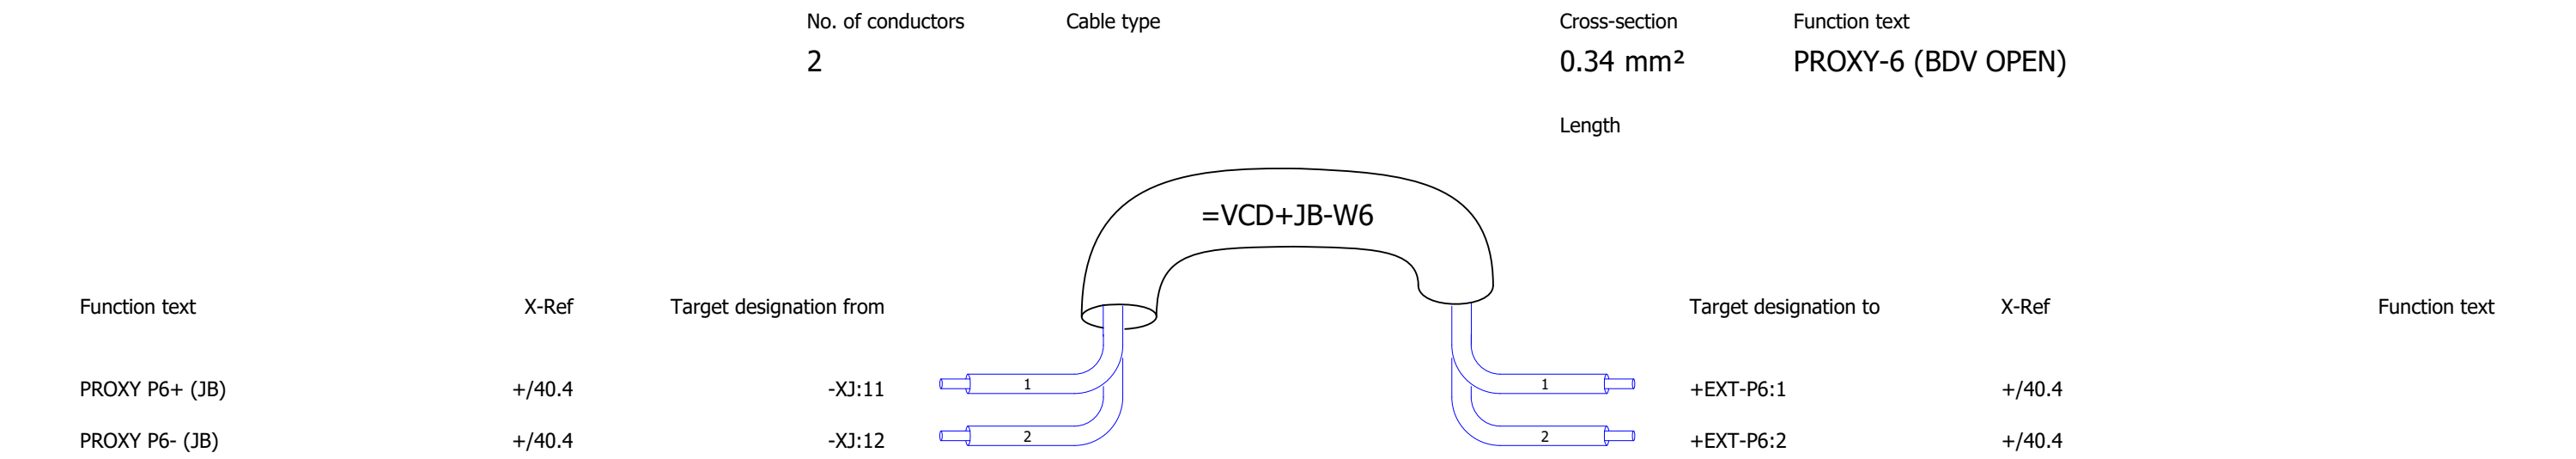


Cable diagram

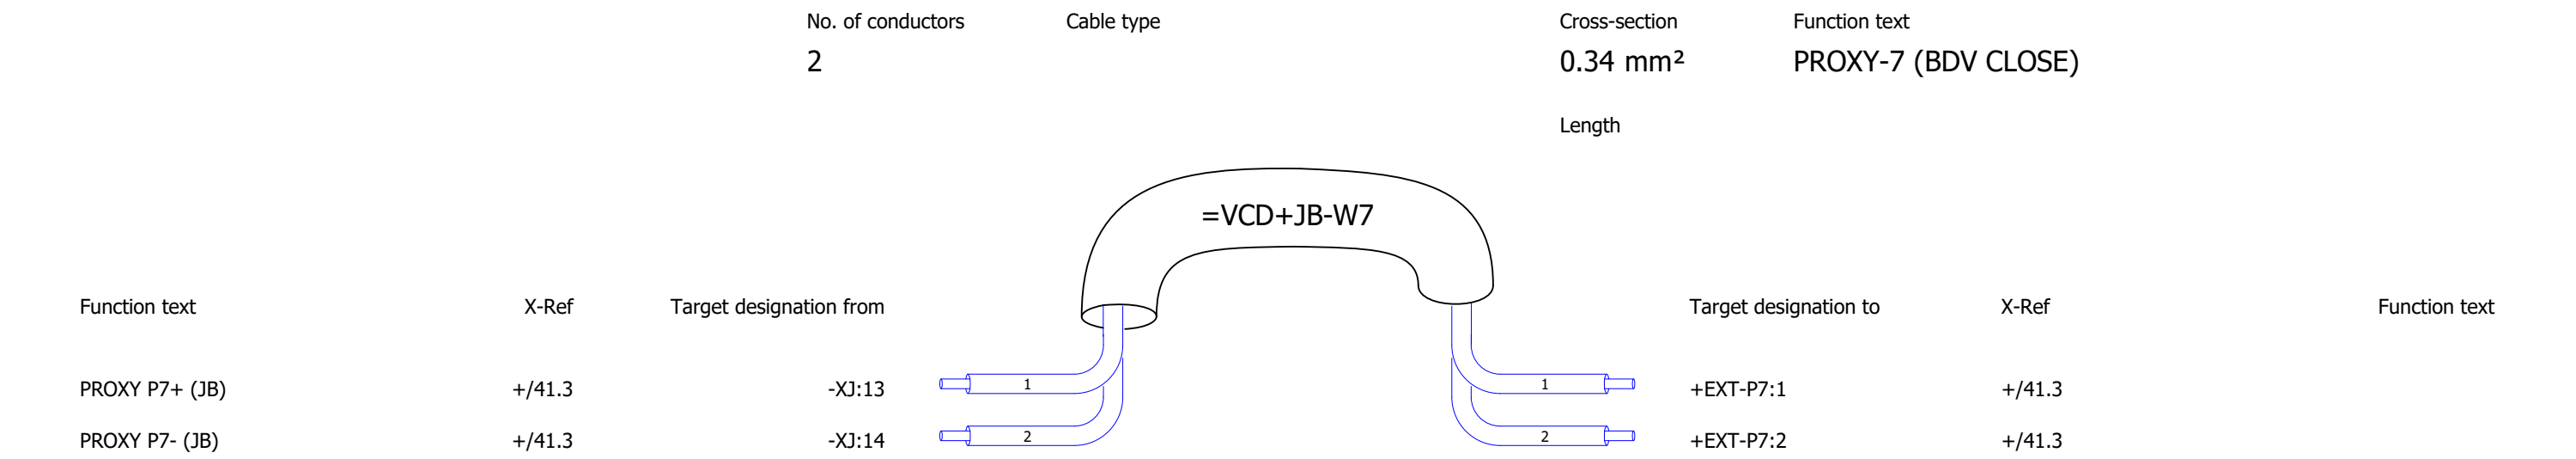

Cable diagram

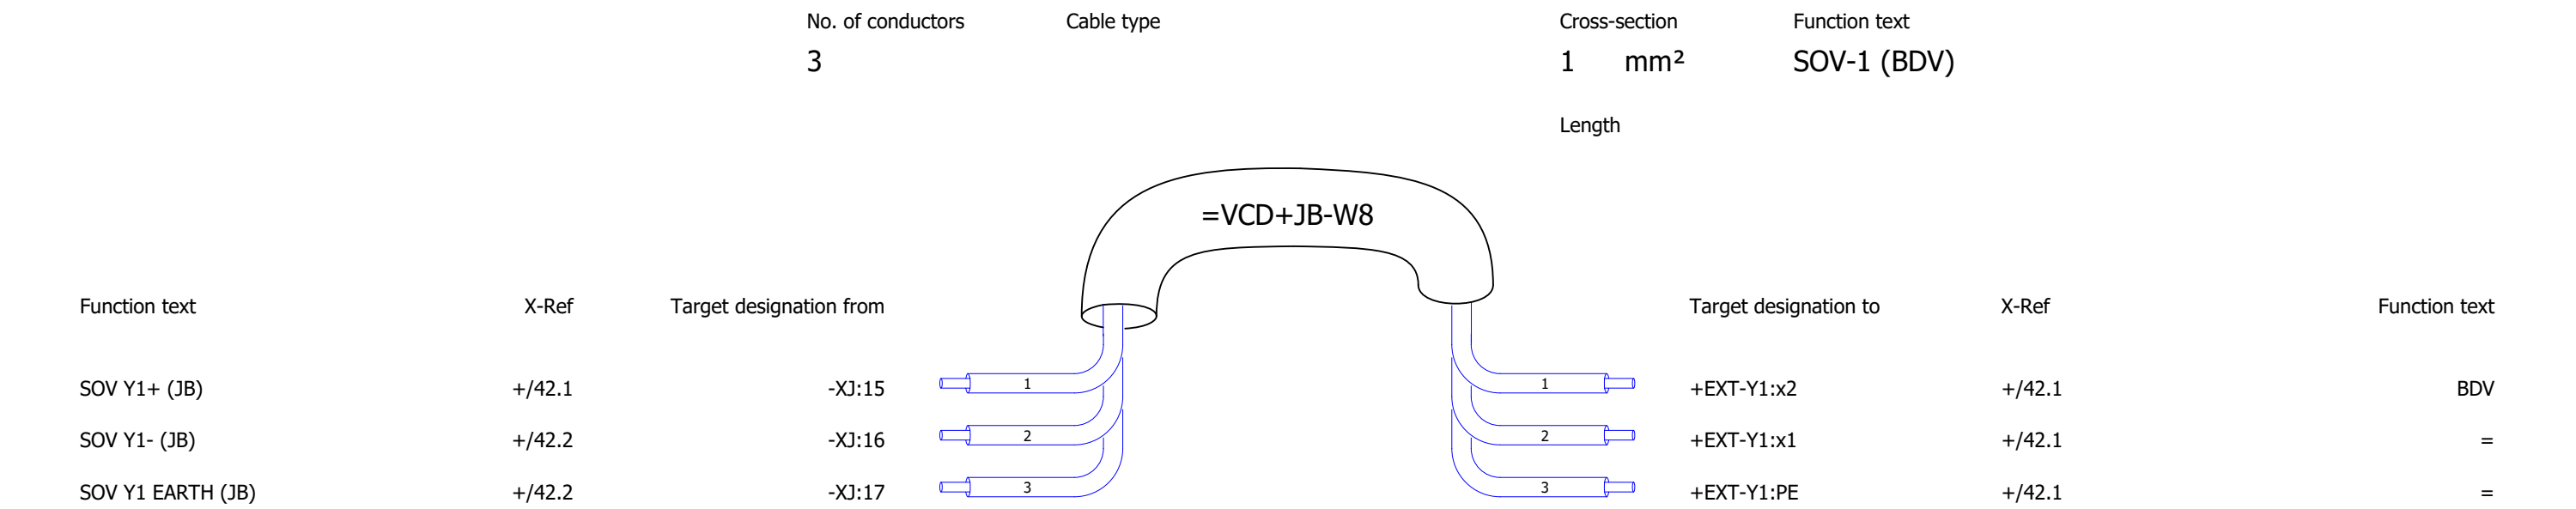

Cable diagram

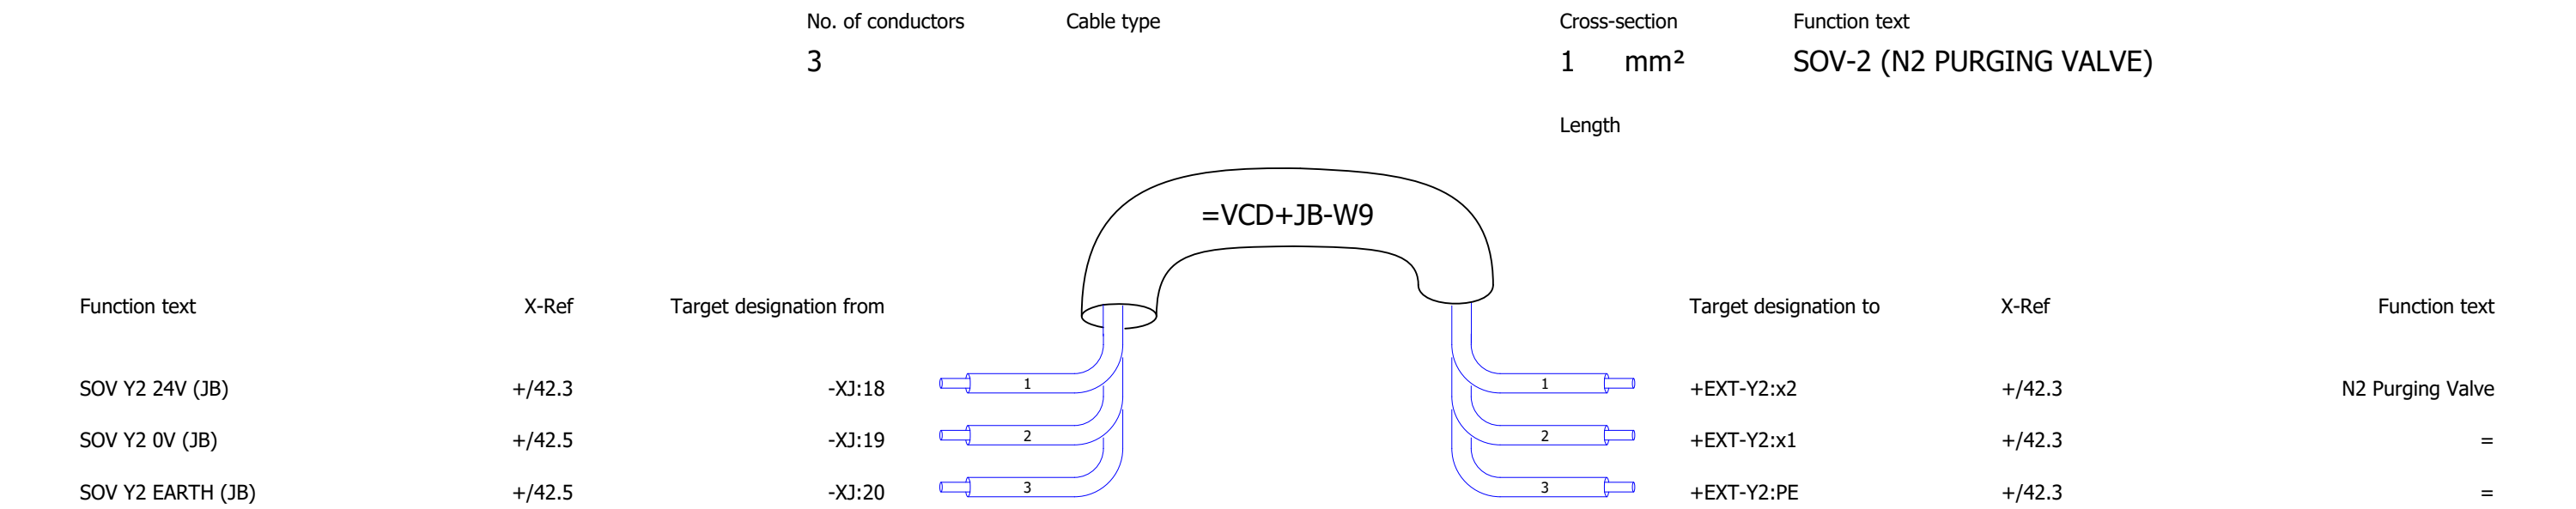

SOV Y2 24V (JB)

+ / 42.3

-XJ:18

+EXT-Y2:x2

+ / 42.3

N2 Purging Valve

SOV Y2 0V (JB)

+ / 42.5

-XJ:19

+EXT-Y2:x1

+ / 42.3

=

SOV Y2 EARTH (JB)

+ / 42.5


-XJ:20

+EXT-Y2:PE

+ / 42.3

=


Cable diagram

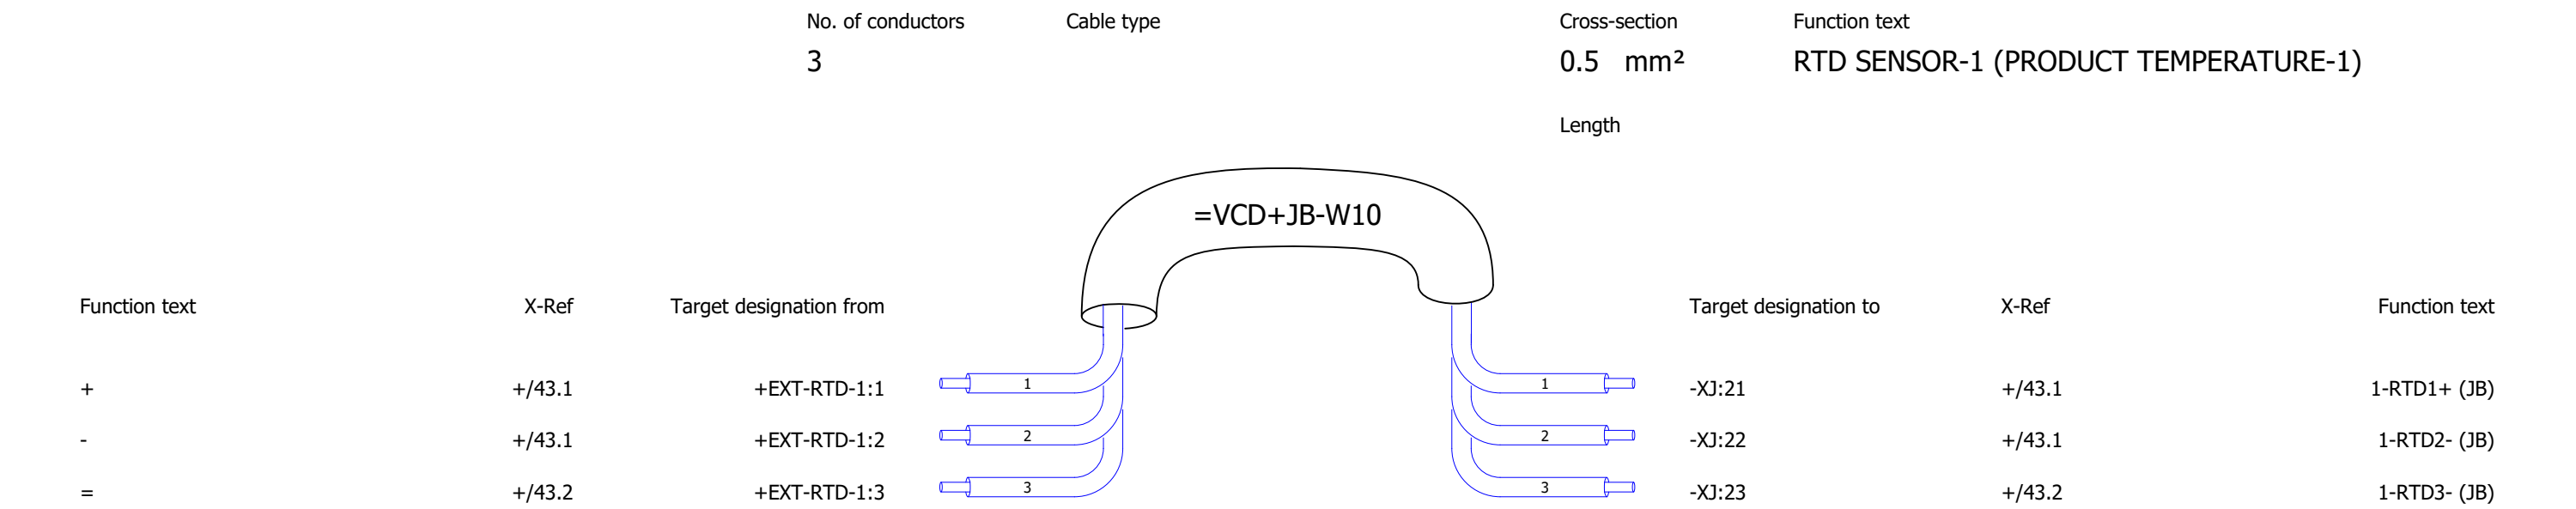


Cable diagram

			No. of conductors	Cable type	Cross-section	Function text		
			3		0.5 mm ²	RTD SENSOR-2 (PRODUCT TEMPERATURE-2)		
						Length		
			=VCD+JB-W11					
Function text	X-Ref	Target designation from				Target designation to	X-Ref	Function text
+	+/43.3	+EXT-RTD-2:1	1			-XJ:24	+/43.3	2-RTD1+ (JB)
-	+/43.3	+EXT-RTD-2:2	2			-XJ:25	+/43.3	2-RTD2- (JB)
=	+/43.3	+EXT-RTD-2:3	3			-XJ:26	+/43.3	2-RTD3- (JB)

Cable diagram

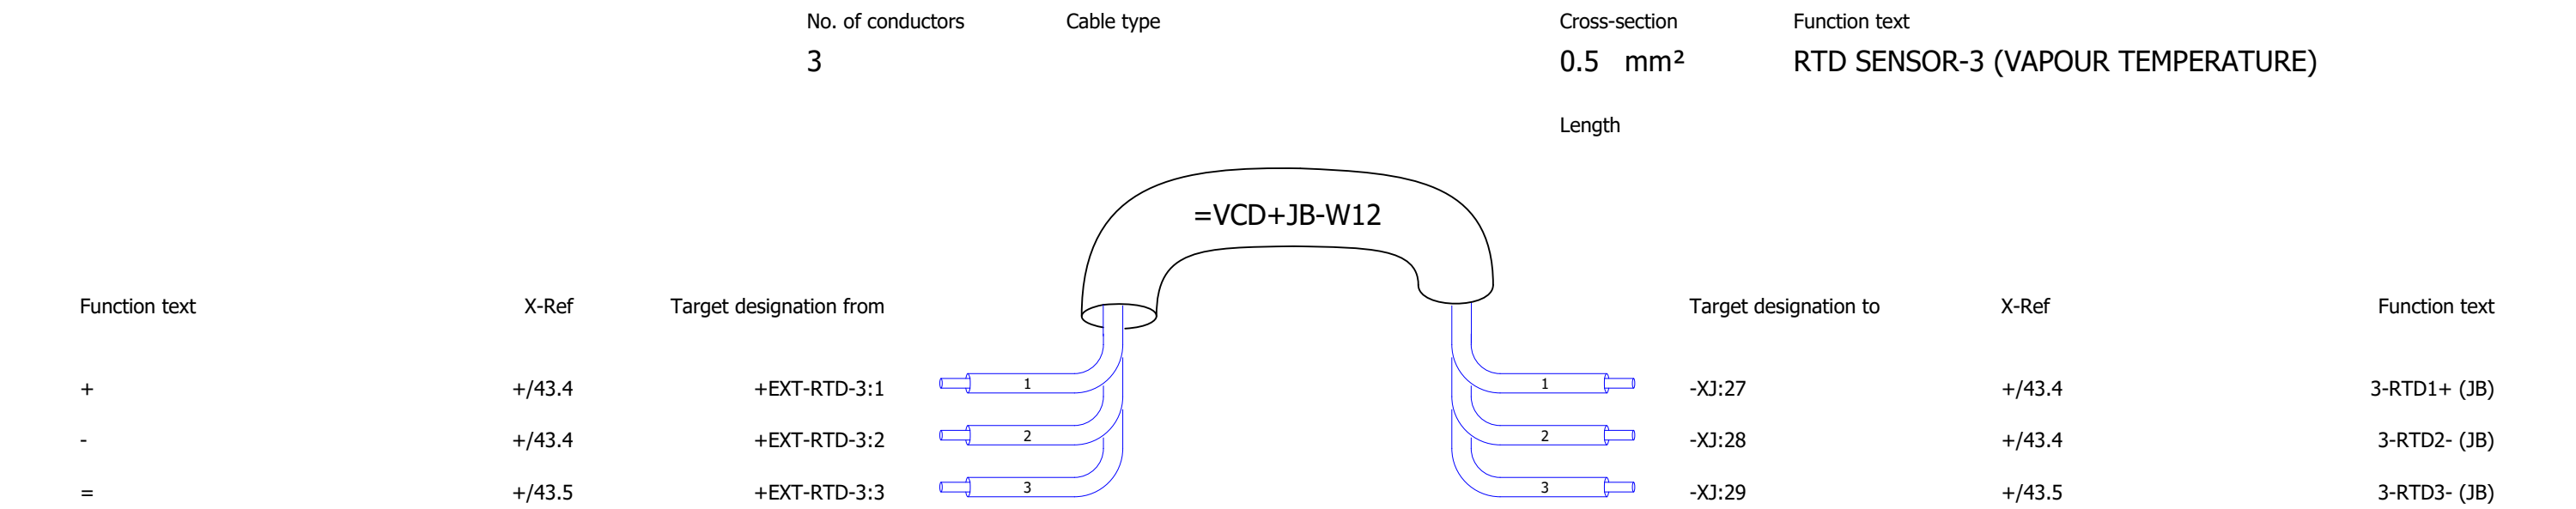

Cable diagram

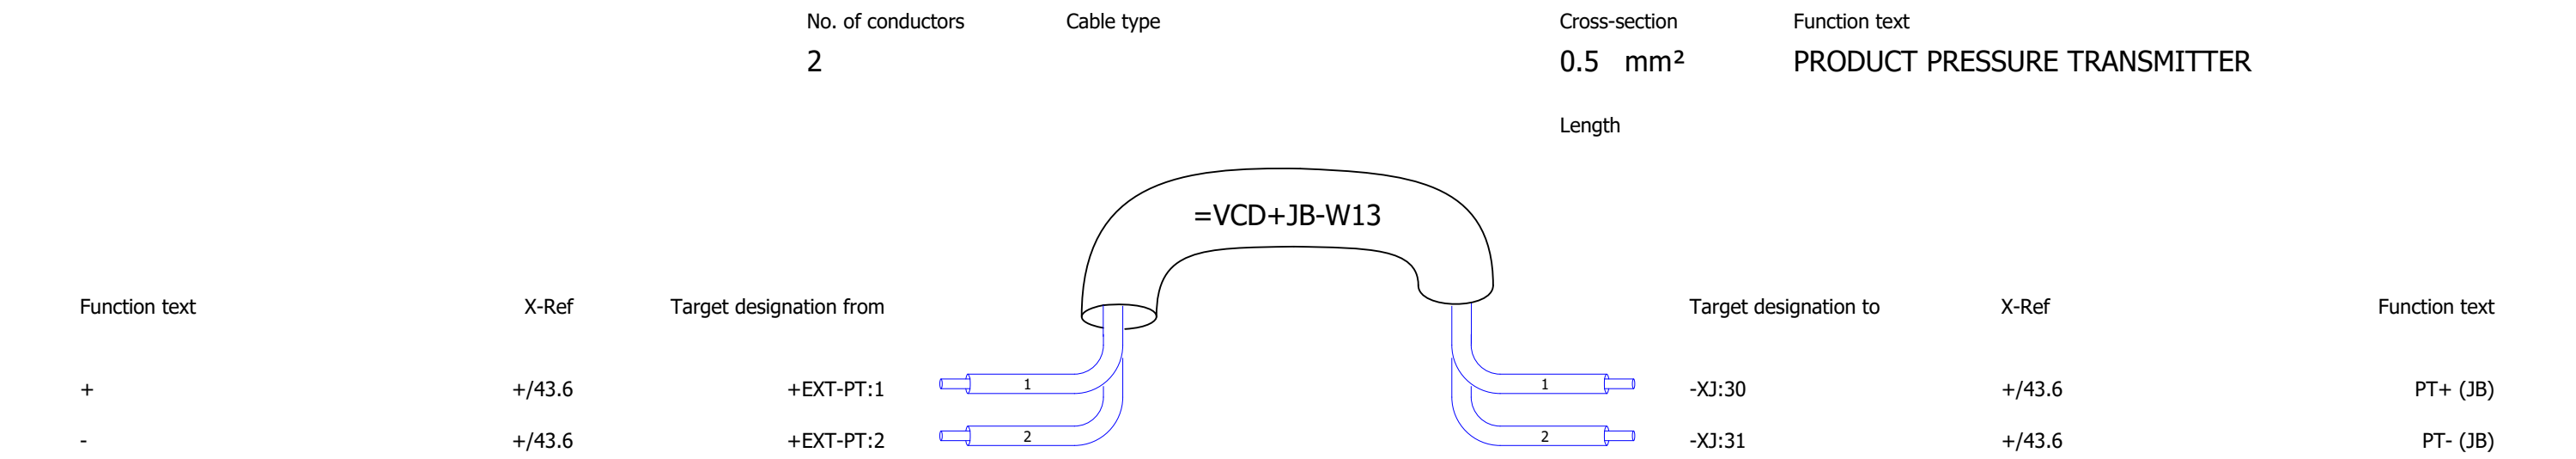

+

-

+ /43.6

+ /43.6

+EXT-PT:1

+EXT-PT:2

-XJ:30

-XJ:31

+ /43.6

+ /43.6

PT+ (JB)

PT- (JB)

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-X4	= REPORT	
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : DRAWING No. : VA-200	Page : 78 SHEET 78 OF 102
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD				
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200				

Terminal diagram

[illegible]

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-X7	= REPORT	
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : DRAWING No. : VA-200	Page : 81 SHEET 81 OF 102
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD				
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200				

Terminal diagram

1	-W8	31x1 mm²											Strip =VCD+-X8 SENSORS	Target designation							Connection point		Target designation							Connection point		1																																	
2														Target designation							Connection point		Target designation							Connection point		2																																	
3														Target designation							Connection point		Target designation							Connection point		3																																	
4														Target designation							Connection point		Target designation							Connection point		4																																	
5														Target designation							Connection point		Target designation							Connection point		5																																	
6														Target designation							Connection point		Target designation							Connection point		6																																	
7														Target designation							Connection point		Target designation							Connection point		7																																	
8														Target designation							Connection point		Target designation							Connection point		8																																	
9														Target designation							Connection point		Target designation							Connection point		9																																	
10														Target designation							Connection point		Target designation							Connection point		10																																	
11														Target designation							Connection point		Target designation							Connection point		11																																	
Function text													1	2	3	4	5	6	7	8	9	10	11	Target designation							Connection point		Target designation							Connection point		11	10	9	8	7	6	5	4	3	2	1	Page / column												
1-RTD1+													21															+JB-XJ							21		1																	/43.1											
1-RTD2-													22															+JB-XJ							22		2																	/43.1											
1-RTD3-													23															+JB-XJ							23		3																	/43.2											
2-RTD1+													24															+JB-XJ							24		4																	/43.3											
2-RTD2-													25															+JB-XJ							25		5																	/43.3											
2-RTD3-													26															+JB-XJ							26		6																	/43.3											
3-RTD1+													27															+JB-XJ							27		7																	/43.4											
3-RTD2-													28															+JB-XJ							28		8																	/43.4											
3-RTD3-													29															+JB-XJ							29		9																	/43.5											
PT+													30															+JB-XJ							30		10																	/43.6											
PT-													31															+JB-XJ							31		11																	/43.6											

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-X8	= REPORT	
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : DRAWING No. : VA-200	Page : 82 SHEET 82 OF 102
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD				
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200				

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-X9		= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 83
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	83 OF 102

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-X10		= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 84
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	84 OF 102

Terminal diagram

1			Strip =VCD+-X12 DCS DIGITAL INPUT						1																
2									2																
3									3																
4									4																
5									5																
6									6																
7									7																
8									8																
9									9																
10									10																
11									11																
Function text		1	2	3	4	5	6	7	8	9	10	11	11	10	9	8	7	6	5	4	3	2	1	Page / column	
PROXY-1 FB (DCS)																									/44.0
=																									/44.1
PROXY-2 FB (DCS)																									/44.1
=																									/44.2
PROXY-3 FB (DCS)																									/44.2
=																									/44.2
PROXY-4 FB (DCS)																									/44.3
=																									/44.3
PROXY-5 FB (DCS)																									/44.4
=																									/44.4
PROXY-6 FB (DCS)																									/44.5
=																									/44.5
PROXY-7 FB (DCS)																									/44.6
=																									/44.6
N2 PURGE OPEN FB (DCS)																									/44.6
=																									/44.7
SAP E-STOP FB (DCS)																									/44.7
=																									/44.8
LOP E-STOP FB (DCS)																									/44.8
=																									/44.9
LOCAL/REMOTE FB (DCS)																									/44.0
=																									/44.1
AGI. START FB (DCS)																									/44.1
=																									/44.2
AGI. FWD. FB (DCS)																									/44.2
=																									/44.3
AGI. REV. FB (DCS)																									/44.3
=																									/44.4
AGI. TRIP FB (DCS)																									/44.4
=																									/44.5


Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-X12	= REPORT	
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : DRAWING No. : VA-200	Page : 86 SHEET 86 OF 102
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD				
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200				

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-X14		= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION	 VIS-CON AUTOMATION	VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 88
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	88 OF 102	

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-X15	= REPORT	
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : DRAWING No. : VA-200	Page : 89 SHEET 89 OF 102
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD				
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200				


Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-X15	= REPORT	
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : DRAWING No. : VA-200	Page : 90 SHEET 90 OF 102
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD				
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200				

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-XCOM	= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : Page : 91
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. : SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200 91 OF 102	

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+-XS	= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : Page : 92
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. : SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200 92 OF 102	

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+LOP-X2	= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : Page : 93
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. : SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200 93 OF 102	

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+LOP-X3		= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 94
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	94 OF 102	

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+LOP-X4	= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : Page : 95
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. : SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200 95 OF 102	

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+LOP-X5		= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 96
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	96 OF 102	


Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+LOP-X9		= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 97
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	97 OF 102	


Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+LOP-X10		= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 98
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	98 OF 102

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+LOP-XCOM		= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 99
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. :	SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200	99 OF 102	

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O NO.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+LOP-XS	= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasan, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. : Page : 100
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD		DRAWING No. : SHEET	
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200		VA-200 100 OF 102	

Terminal diagram

[illegible]

01	31/03/2026	FOR APPROVAL	NAYAN PANCHAL	W/O No.	VA-200	CLIENT : GMM PFAUDLER	PANEL QUANTITY :- 1	TITLE : Terminal diagram =VCD+JB-XJ		= REPORT
00	02/03/2026	INITIAL SUBMISSION	NAYAN PANCHAL	PREPARED BY	NAYAN PANCHAL	PURCHASER : VISCON AUTOMATION		VIS-CON AUTOMATION G-1,13-14-15, Rajdhani Complex, B/H. Pramukh Arcade, Reliance Cross Roads, Kudasán, Gandhinagar-382421 Gujarat (INDIA)	PANEL TAG No. :	Page : 102
				CHECK BY	RUTVIK VADGAMA	PROJECT NAME : FND000699_6KL VCD			DRAWING No. :	SHEET
REV.	Date	DESCRIPTION	Created By	APPROVED BY	RAVI DARJI	PROJECT NO. : VA-200			VA-200	102 OF 102