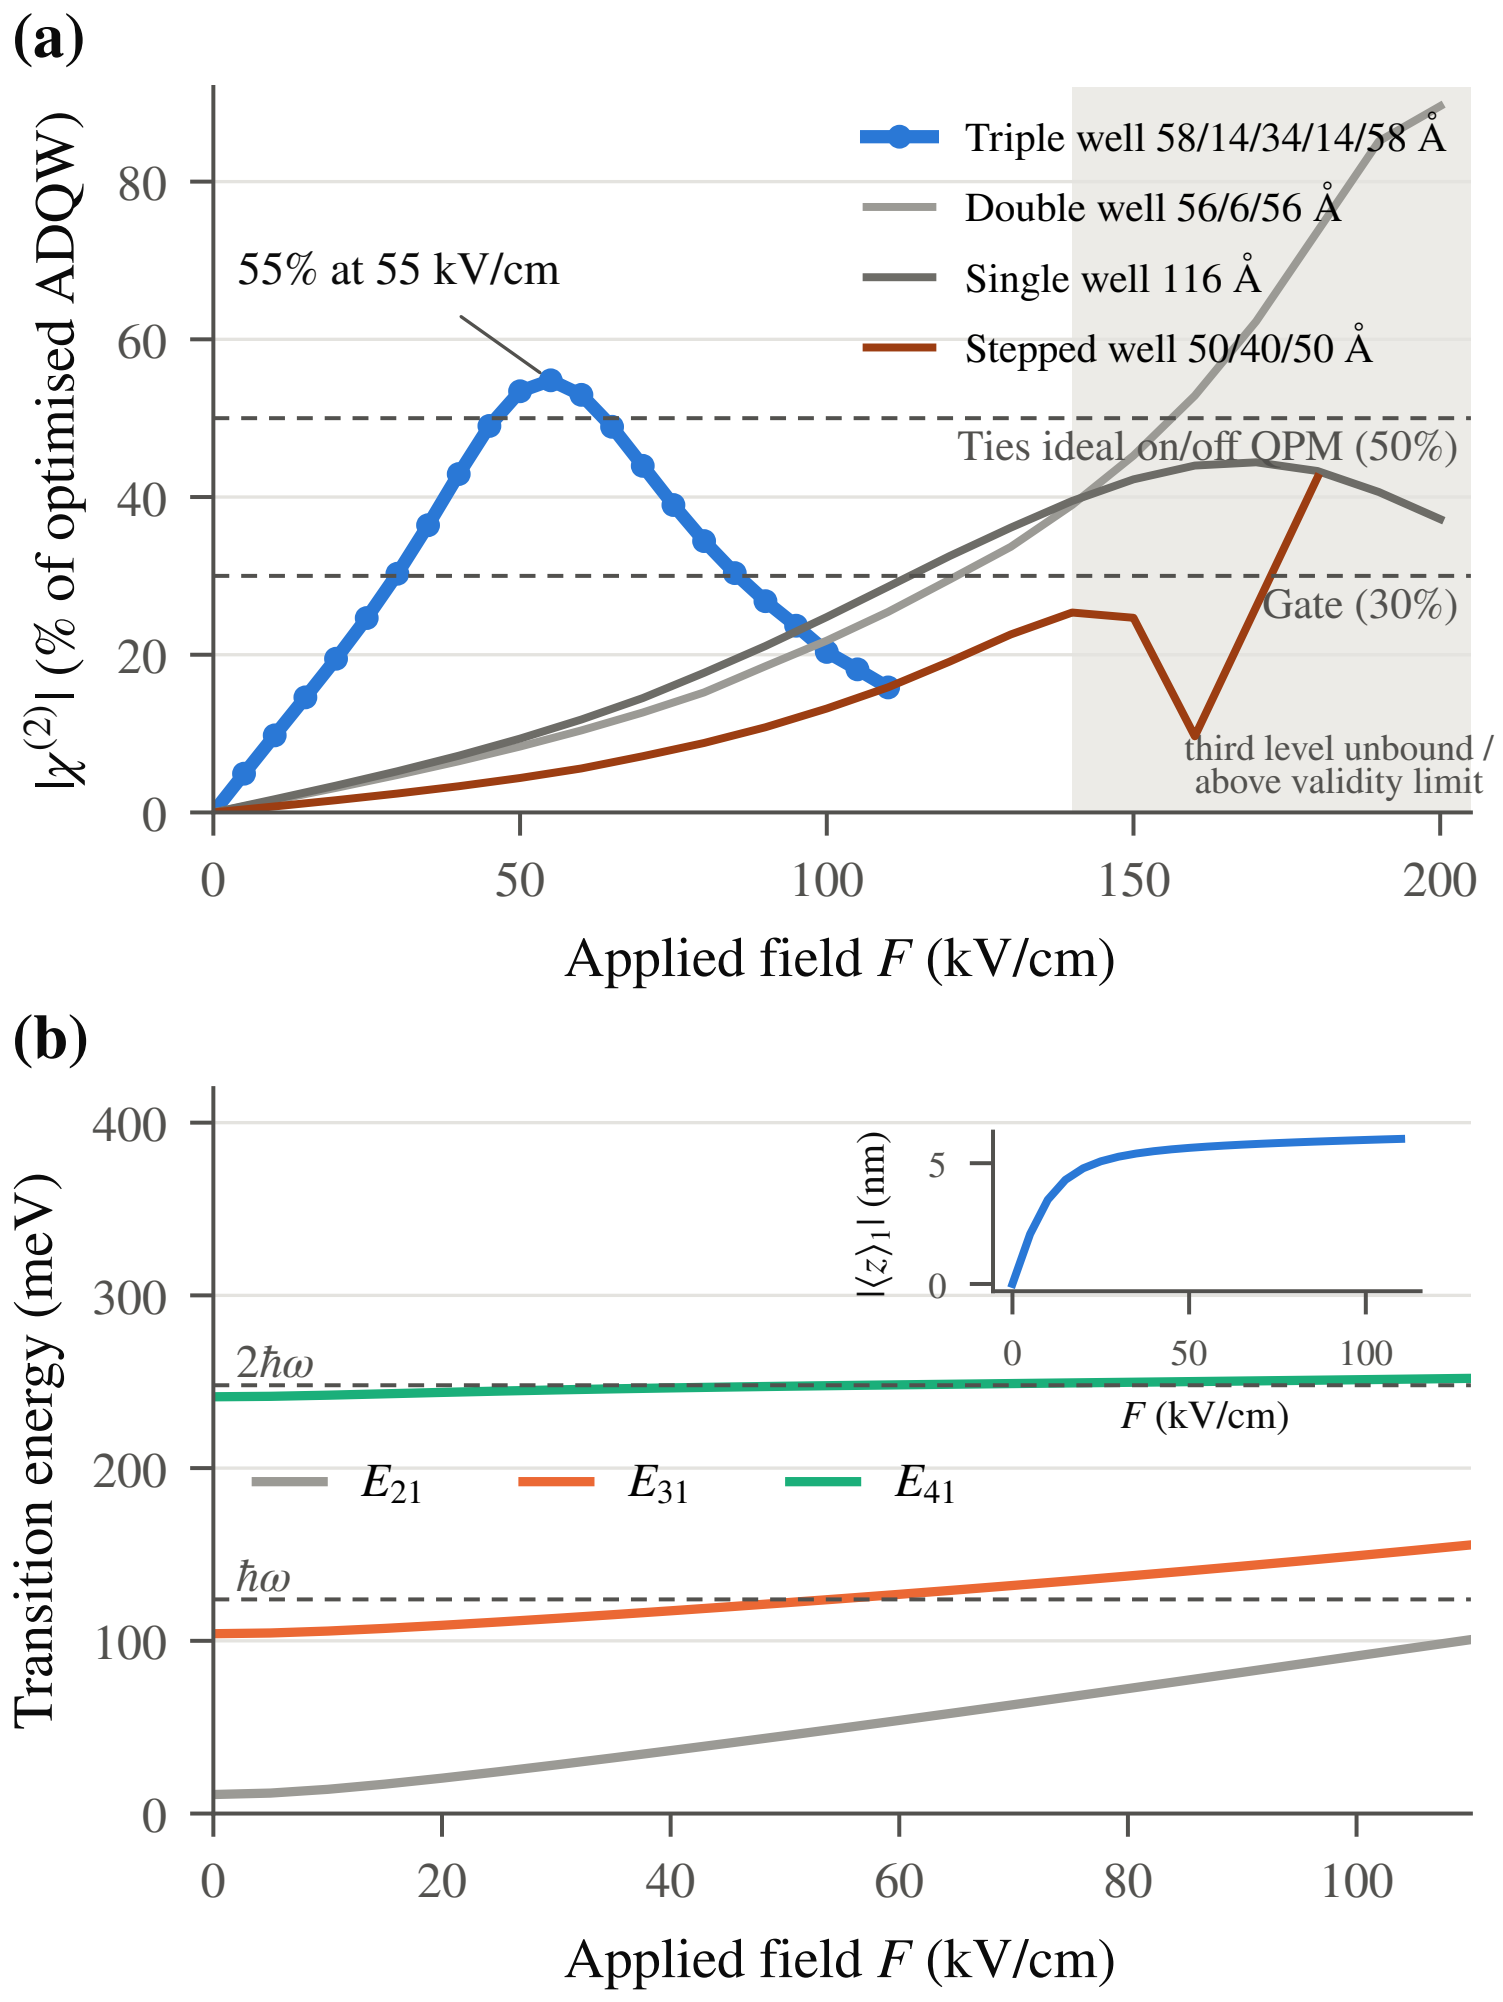
(a)
Triple well 58/14/34/14/58 Å
Double well 56/6/56 Å
Single well 116 Å
Stepped well 50/40/50 Å
55% at 55 kV/cm
Ties ideal on/off QPM (50%)
Gate (30%)
third level unbound / above validity limit
$|\chi^{(2)}|$ (% of optimised ADQW)
Applied field F (kV/cm)
(b)
$|\langle z \rangle_1|$ (nm)
F (kV/cm)
$2\hbar\omega$
$\hbar\omega$
E_{21}
E_{31}
E_{41}
Transition energy (meV)
Applied field F (kV/cm)