


ThermoPINN Calibration: In-Distribution vs Out-of-Distribution

Overconfidence collapse under domain shift — motivation for conformal recalibration

(a) ID calibration (ECE=0.1833)
synthetic test set

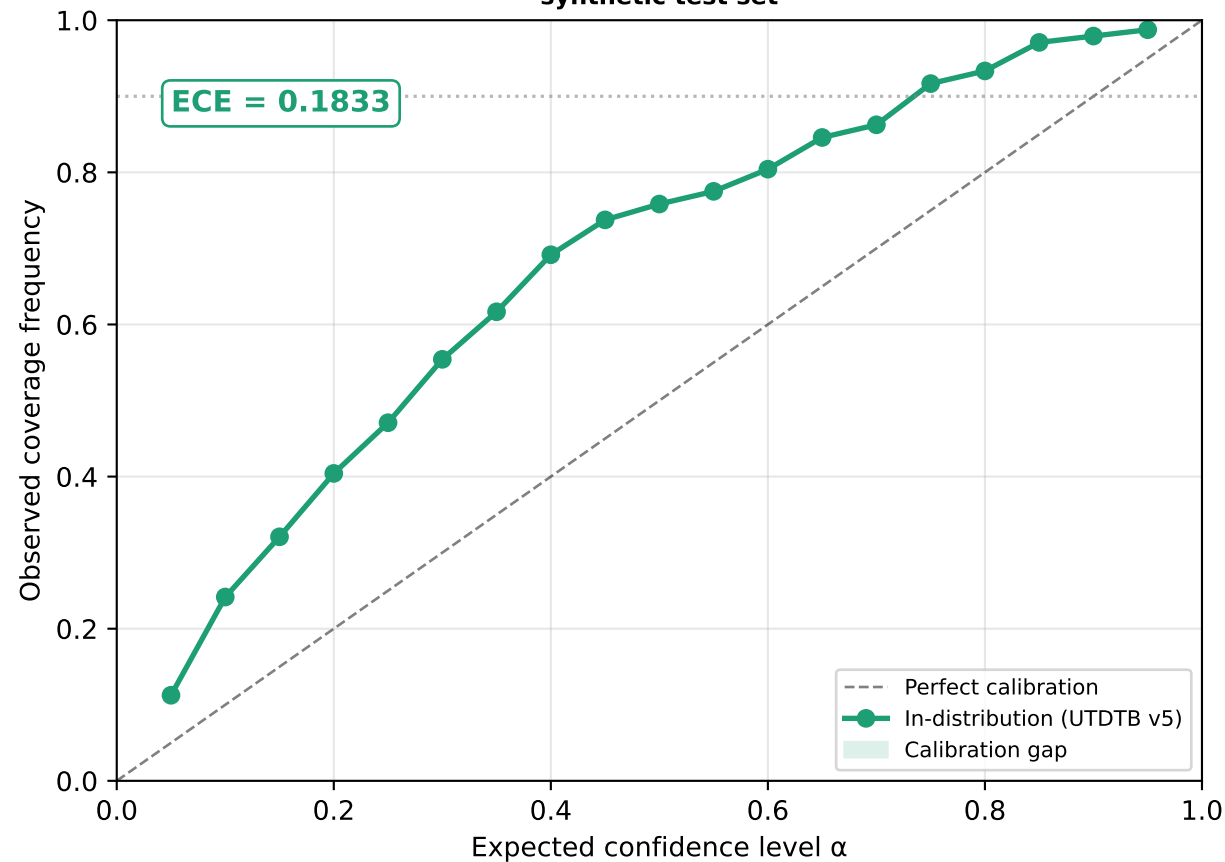

(b) OOD calibration (ECE=0.1747)
real N-CMAPSS engines

