

Water Automation Visual Handoff v2

Close-up renders. Every part labelled. No guess-work.

WHAT'S INSIDE

02

Sintex tank + sensor riser

How the cap is modified, where the sensor sits, where the float hangs

03

Sintex JB on parapet wall

Where the box mounts on terrace, where the conduit drops to

04

Sump cross-section

What's inside the pit: probe, float, water levels

05

Sump JB on porch W wall

Why the box sits beside the manhole, not above it

06

Inside the JB

ESP32, PoE splitter, terminal block, 4 cable glands

USE WITH


WATER_AUTOMATION_SCHEMATIC.pdf - the wiring schematics (floor plan + circuit)

WATER_AUTOMATION.pdf - the long-form spec with full BOM and sign-off checklist

v2.0 - 2026-05-29 - AI renders annotated with Python overlay

Sintex tank + sensor riser

Where to drill the cap, what to mount on top

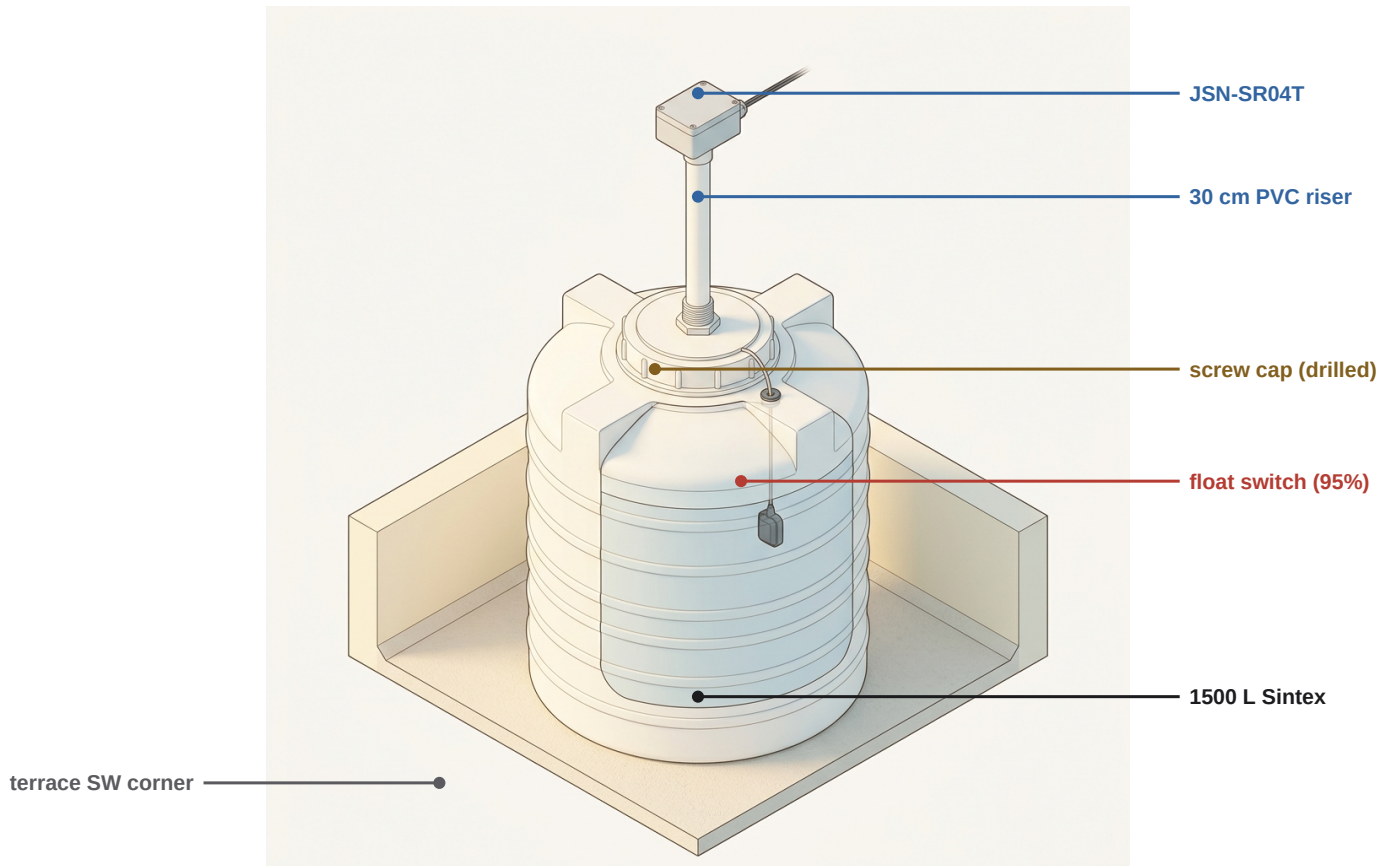


WHAT THIS SHOWS

Sintex tank cap modified: drill a 32 mm hole at the centre, install a 1" threaded PVC fitting with rubber gasket, screw in a 30 cm vertical PVC pipe. JSN-SR04T sensor sits inside a small weatherproof cap at the top of the riser, cable exits sideways. The high-level float hangs inside the tank from a separate small hole in the screw cap.

Sintex JB on parapet wall

Terrace SW corner, shaded side of the parapet

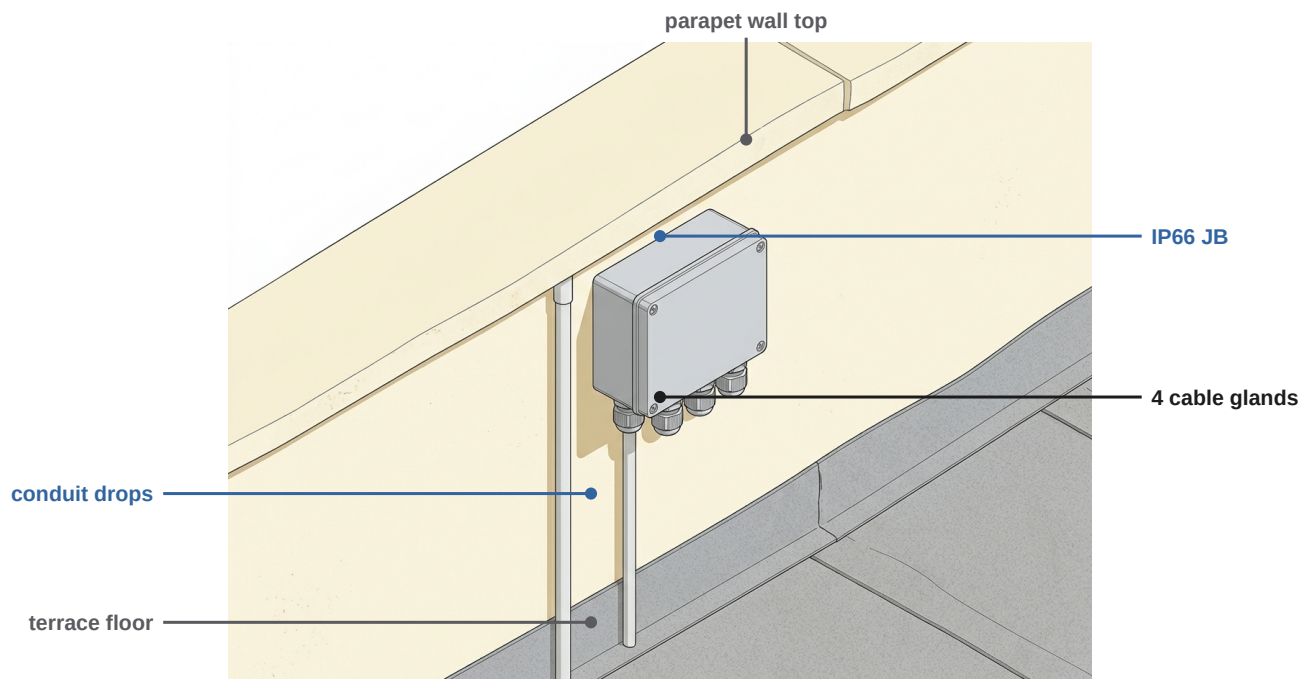


WHAT THIS SHOWS

Junction box mounted on the inner face of the terrace parapet, shaded side. Conduit drops down the wall surface to the embedded C-Sintex-1 (Cat6) and C-Sintex-2 (float wire) conduits that run under the terrace screed back into the staircase shaft.

Sump cross-section

What's inside the pit

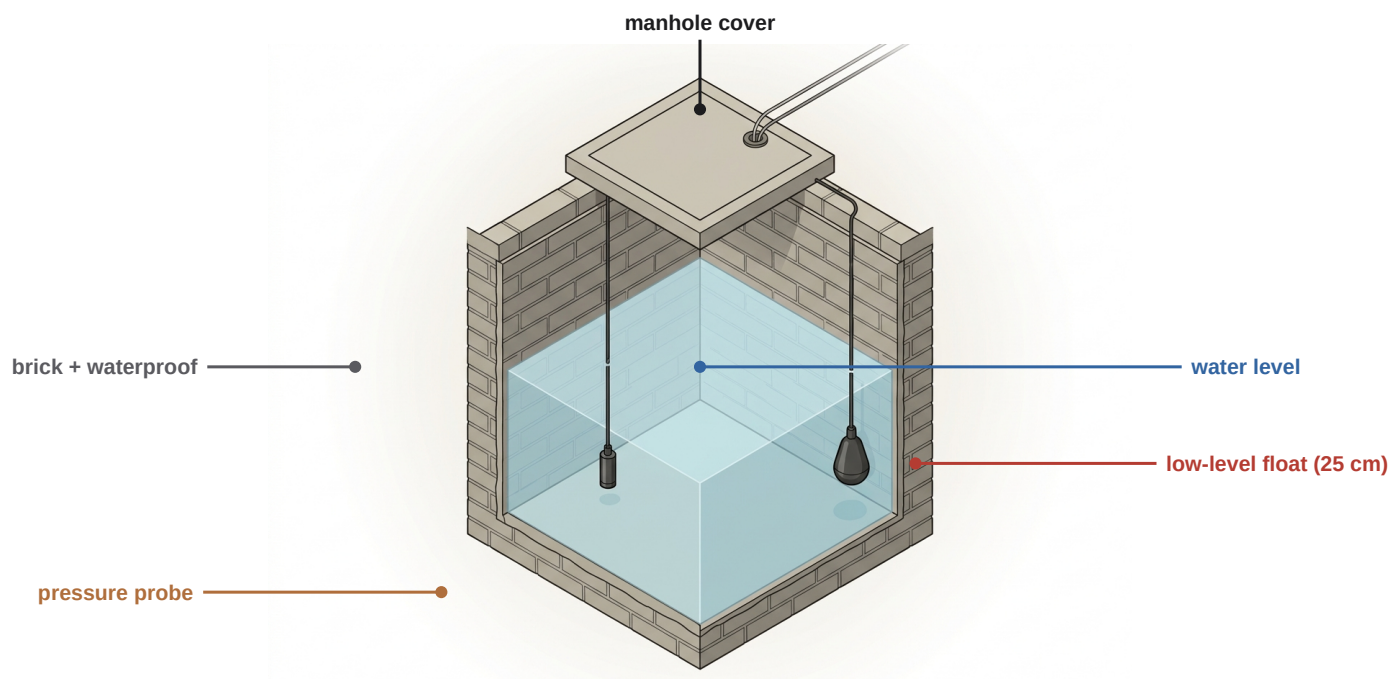


WHAT THIS SHOWS

Inside the underground sump: pressure transducer probe hangs ~10 cm above the floor for level reading. Low-level pendulum float hangs at ~25 cm - when water drops below this, the float opens and kills the booster pump (dry-run protection, mechanical, no server needed).

05

Sump JB on porch wall

Porch W wall, 300 mm above floor, BESIDE the manhole

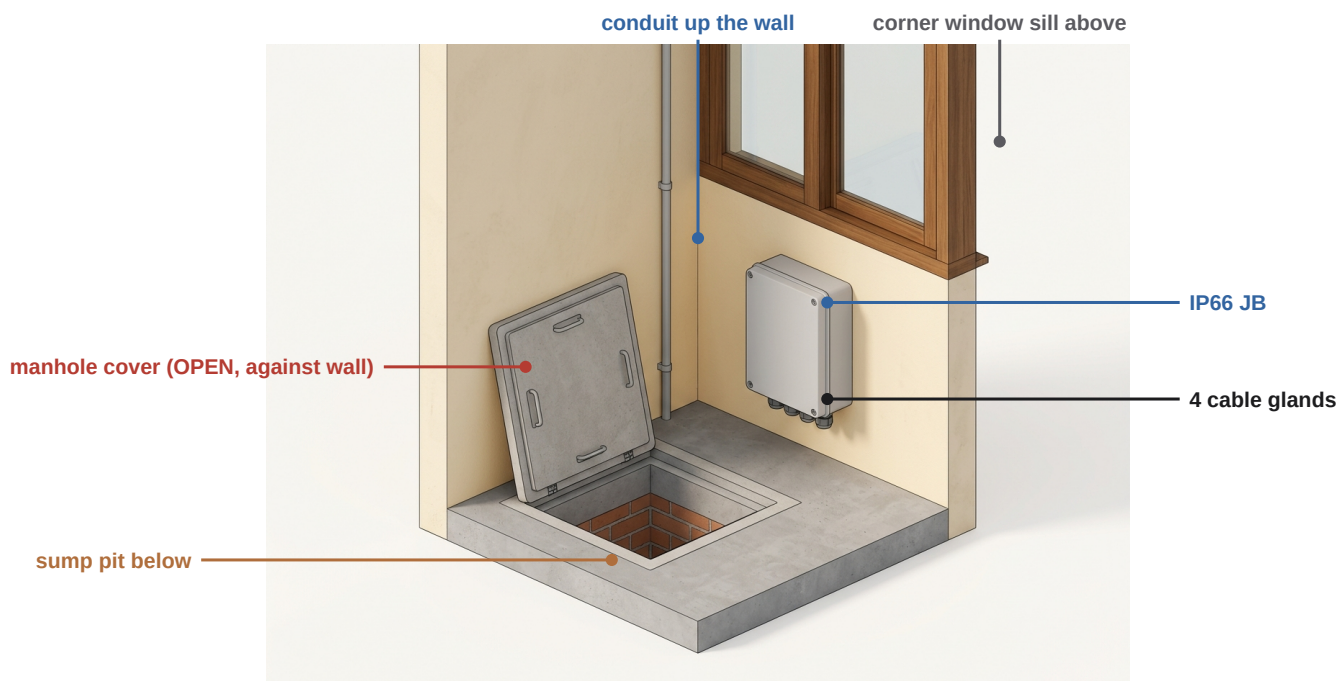


WHAT THIS SHOWS

JB mounted at knee-height on porch W wall, BESIDE the manhole - not directly above. The manhole cover hinges on the W side and lies flat against this wall when open, so the JB has to sit to one side. Below the window sill (3 ft AGL) and above the floor splash zone.

Inside the JB

ESP32 + PoE splitter + terminal block + 4 glands

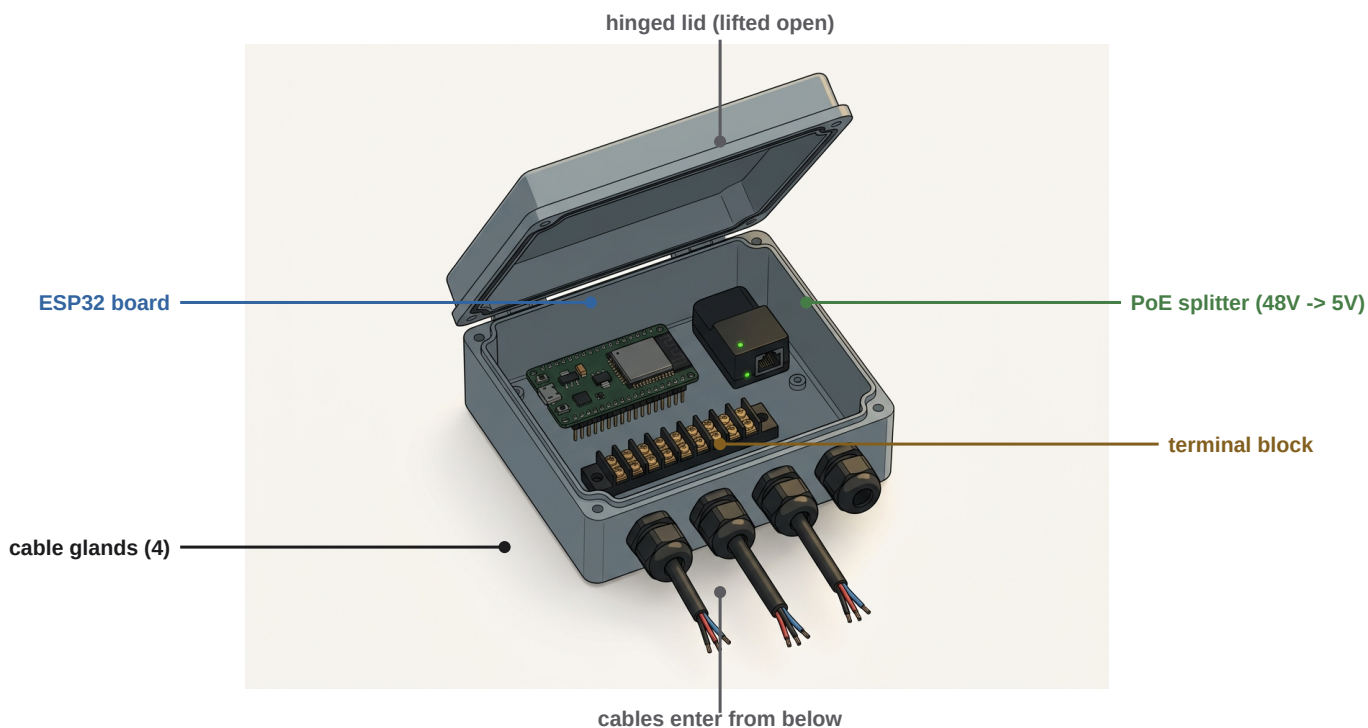

WHAT THIS SHOWS

Box lid lifted. PoE Cat6 enters via one of the bottom glands, lands at the splitter which drops 48 V to 5 V for the ESP32. Sensor wires from inside the tank/sump also enter via the bottom glands and land on the terminal block. All four glands face DOWN - water sheds away.