


TASK 1

Using the diagrams given in the presentation calculate how much (%) is the effect of applying different modifications (changing the gas, adding an extra pane, using a low emissivity coating) on the U value with respect to a benchmark case of double layer with air and no coating? (Keep the gap thickness to be 13 mm)

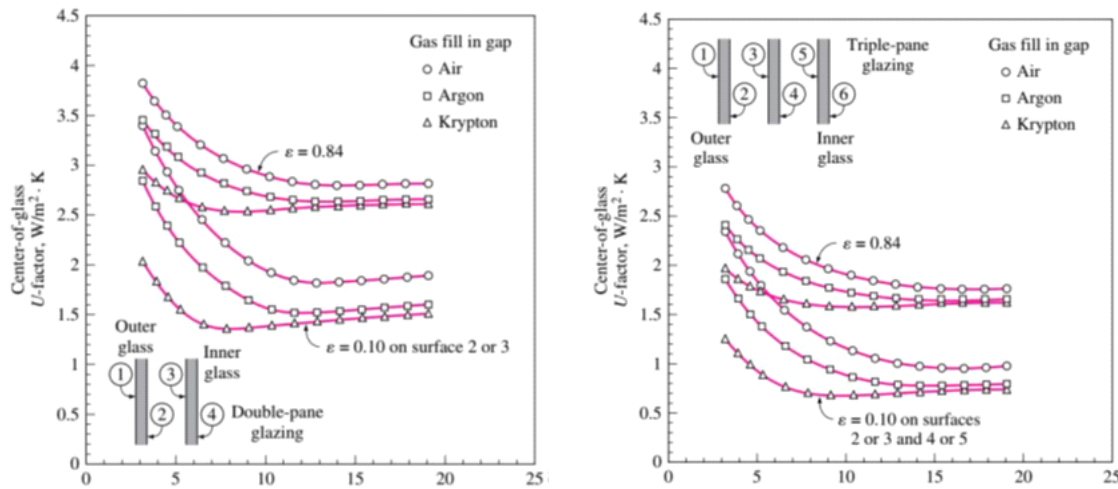

	U	Difference	Percentage
2 Parallel plans with air	2,8 W/m2		
2 Parallel plans with gas	2,6 W/m2	0,2 W/m2	7,14%
2 Parallel plans with air and coating	1,8 W/m2	1,0 W/m2	35,71%
2 Parallel plans with gas and coating	1,5 W/m2	1,3 W/m2	46,42%
3 Parallel plans with air	1,8 W/m2	1,0 W/m2	35,71%
3 Parallel plans with gas	1,6 W/m2	1,2 W/m2	42,85%
3 Parallel plans with air and coating	1,0 W/m2	1,8 W/m2	64,28%
3 Parallel plans with gas and coating	0,75 W/m2	2,05 W/m2	73,21%

TASK 2.

Consider the house that we analyzed in the last two examples, calculate the heating and cooling load of the other windows which are fixed 14.4 m2 on the west, fixed 3.6 m2 on the south and an operable

3.6 m2 on the south (the same window and frame type). How much does the total value change if I change the frame of the window from wooden one to aluminum ?

The u factor for various frames are listed in the table as function pf spacer materials and the glazing unit thickness. The U-factor of metal framing and thus the rate of heat transfer through a metal window frame is more than three times that of a wood of vinyl window frame

PIACENZA, Italy

WMO#: 160840

Lat: 44.92N

Long: 9.73E

Elev: 138

StdP: 99.68

Time Zone: 1.00 (EUW)

Period: 89-10

WBAN: 99999

Annual Heating and Humidification Design Conditions

Coldest Month	Heating DB		Humidification DP/MCDB and HR						Coldest month WS/MCDB				MCWS/PCWD to 99.6% DB	
			99.6%			99%			0.4%		1%			
	99.6%	99%	DP	HR	MCDB	DP	HR	MCDB	WS	MCDB	WS	MCDB	MCWS	PCWD
(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)	(l)	(m)	(n)	(o)
1	-6.2	-4.8	-11.6	1.4	3.1	-8.8	1.8	1.8	8.8	5.6	7.7	6.2	2.1	250

(1)

Annual Cooling, Dehumidification, and Enthalpy Design Conditions

Hottest Month	Hottest Month DB Range	Cooling DB/MCWB						Evaporation WB/MCDB						MCWS/PCWD to 0.4% DB	
		0.4%		1%		2%		0.4%		1%		2%			
		DB	MCWB	DB	MCWB	DB	MCWB	WB	MCDB	WB	MCDB	WB	MCDB	MCWS	PCWD
(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)	(l)	(m)	(n)	(o)	(p)
8	11.9	33.1	22.7	31.9	22.4	30.3	21.8	24.6	30.2	23.7	29.2	22.9	28.3	2.4	90

(2)

$$\Delta T_{cooling} = 31.9 - 24 = 7.9^{\circ}\text{C}$$

$$\Delta T_{heating} = 20 - (-4.8) = 24.8^{\circ}\text{C}$$

$$DR = 11.9^{\circ}\text{C}$$

The RLF method uses the following to estimate cooling load:

$$q_{opq} = A \times CF_{opq}$$

$$CF_{opq} = U(OF_t \Delta t + OF_b + OF_r DR)$$

where

q_{opq} = opaque surface cooling load, W

A = net surface area, m²

CF = surface cooling factor, W/m²

U = construction U-factor, W/(m²·K)

Δt = cooling design temperature difference, K

OF_t, OF_b, OF_r = opaque-surface cooling factors (see [Table 7](#))

DR = cooling daily range, K

Surface Type	OF_t	OF_b , K	OF_r
Ceiling or wall adjacent to vented attic	0.62	$14.3\alpha_{roof} - 4.5$	-0.19
Ceiling/roof assembly	1	$38.3\alpha_{roof} - 7.0$	-0.36
Wall (wood frame) or door with solar exposure	1	8.2	-0.36
Wall (wood frame) or door (shaded)	1	0	-0.36
Floor over ambient	1	0	-0.06
Floor over crawlspace	0.33	0	-0.28
Slab floor (see Slab Floor section)			

α_{roof} = roof solar absorptance (see [Table 8](#)).

$$Q_{load} = 105.8 \times 82.040 = 8679.834 \frac{\text{W}}{\text{m}^2}$$

$$CF_{opq} = U(OF_t \Delta t + OF_b + OF_r DR) = 0.438(1 \times 7.9 + 8.2 - 0.36 \times 11.9) = 82.040 \frac{\text{W}}{\text{m}^2}$$

$$Q_{load} = 105.8 \times 81.478 = 8620.38 \frac{\text{W}}{\text{m}^2}$$

$$CF_{opq} = U(OF_t \Delta t + OF_b + OF_r DR) = 0.435(1 \times 7.9 + 8.2 - 0.36 \times 11.9) = 81.478 \frac{\text{W}}{\text{m}^2}$$

$$Q_{load-south} = 3.6 \times 82.040 = 295.344 \frac{\text{W}}{\text{m}^2}$$

$$CF_{opq} = U(OF_t \Delta t + OF_b + OF_r DR) = 0.438(1 \times 7.9 + 8.2 - 0.36 \times 11.9) = 82.040 \frac{\text{W}}{\text{m}^2}$$

$$Q_{load-west} = 14.4 \times 81.478 = 1173.283 \frac{\text{W}}{\text{m}^2}$$

$$CF_{opq} = U(OF_t \Delta t + OF_b + OF_r DR) = 0.435(1 \times 7.9 + 8.2 - 0.36 \times 11.9) = 81.478 \frac{\text{W}}{\text{m}^2}$$

Frame material	<i>U</i> -factor, W/m ² · °C*
Aluminum:	
Single glazing (3 mm)	10.1
Double glazing (18 mm)	10.1
Triple glazing (33 mm)	10.1
Wood or vinyl:	
Single glazing (3 mm)	2.9
Double glazing (18 mm)	2.8
Triple glazing (33 mm)	2.7

$$Q_{load-south} = 3.6 * 524.456 = 1888.044 \frac{W}{m^2}$$

$$CF_{opq-wood} = U(OF_t \Delta t + OF_b + OF_r DR) = 2.8(1 * 7.9 + 8.2 - 0.36 * 11.9) = 524.456 \frac{W}{m^2}$$

$$Q_{load-west} = 14.4 * 1891.79 = 27241.784 \frac{W}{m^2}$$

$$CF_{opq-aluminium} = U(OF_t \Delta t + OF_b + OF_r DR) = 10.1(1 * 7.9 + 8.2 - 0.36 * 11.9) = 1891.79 \frac{W}{m^2}$$