


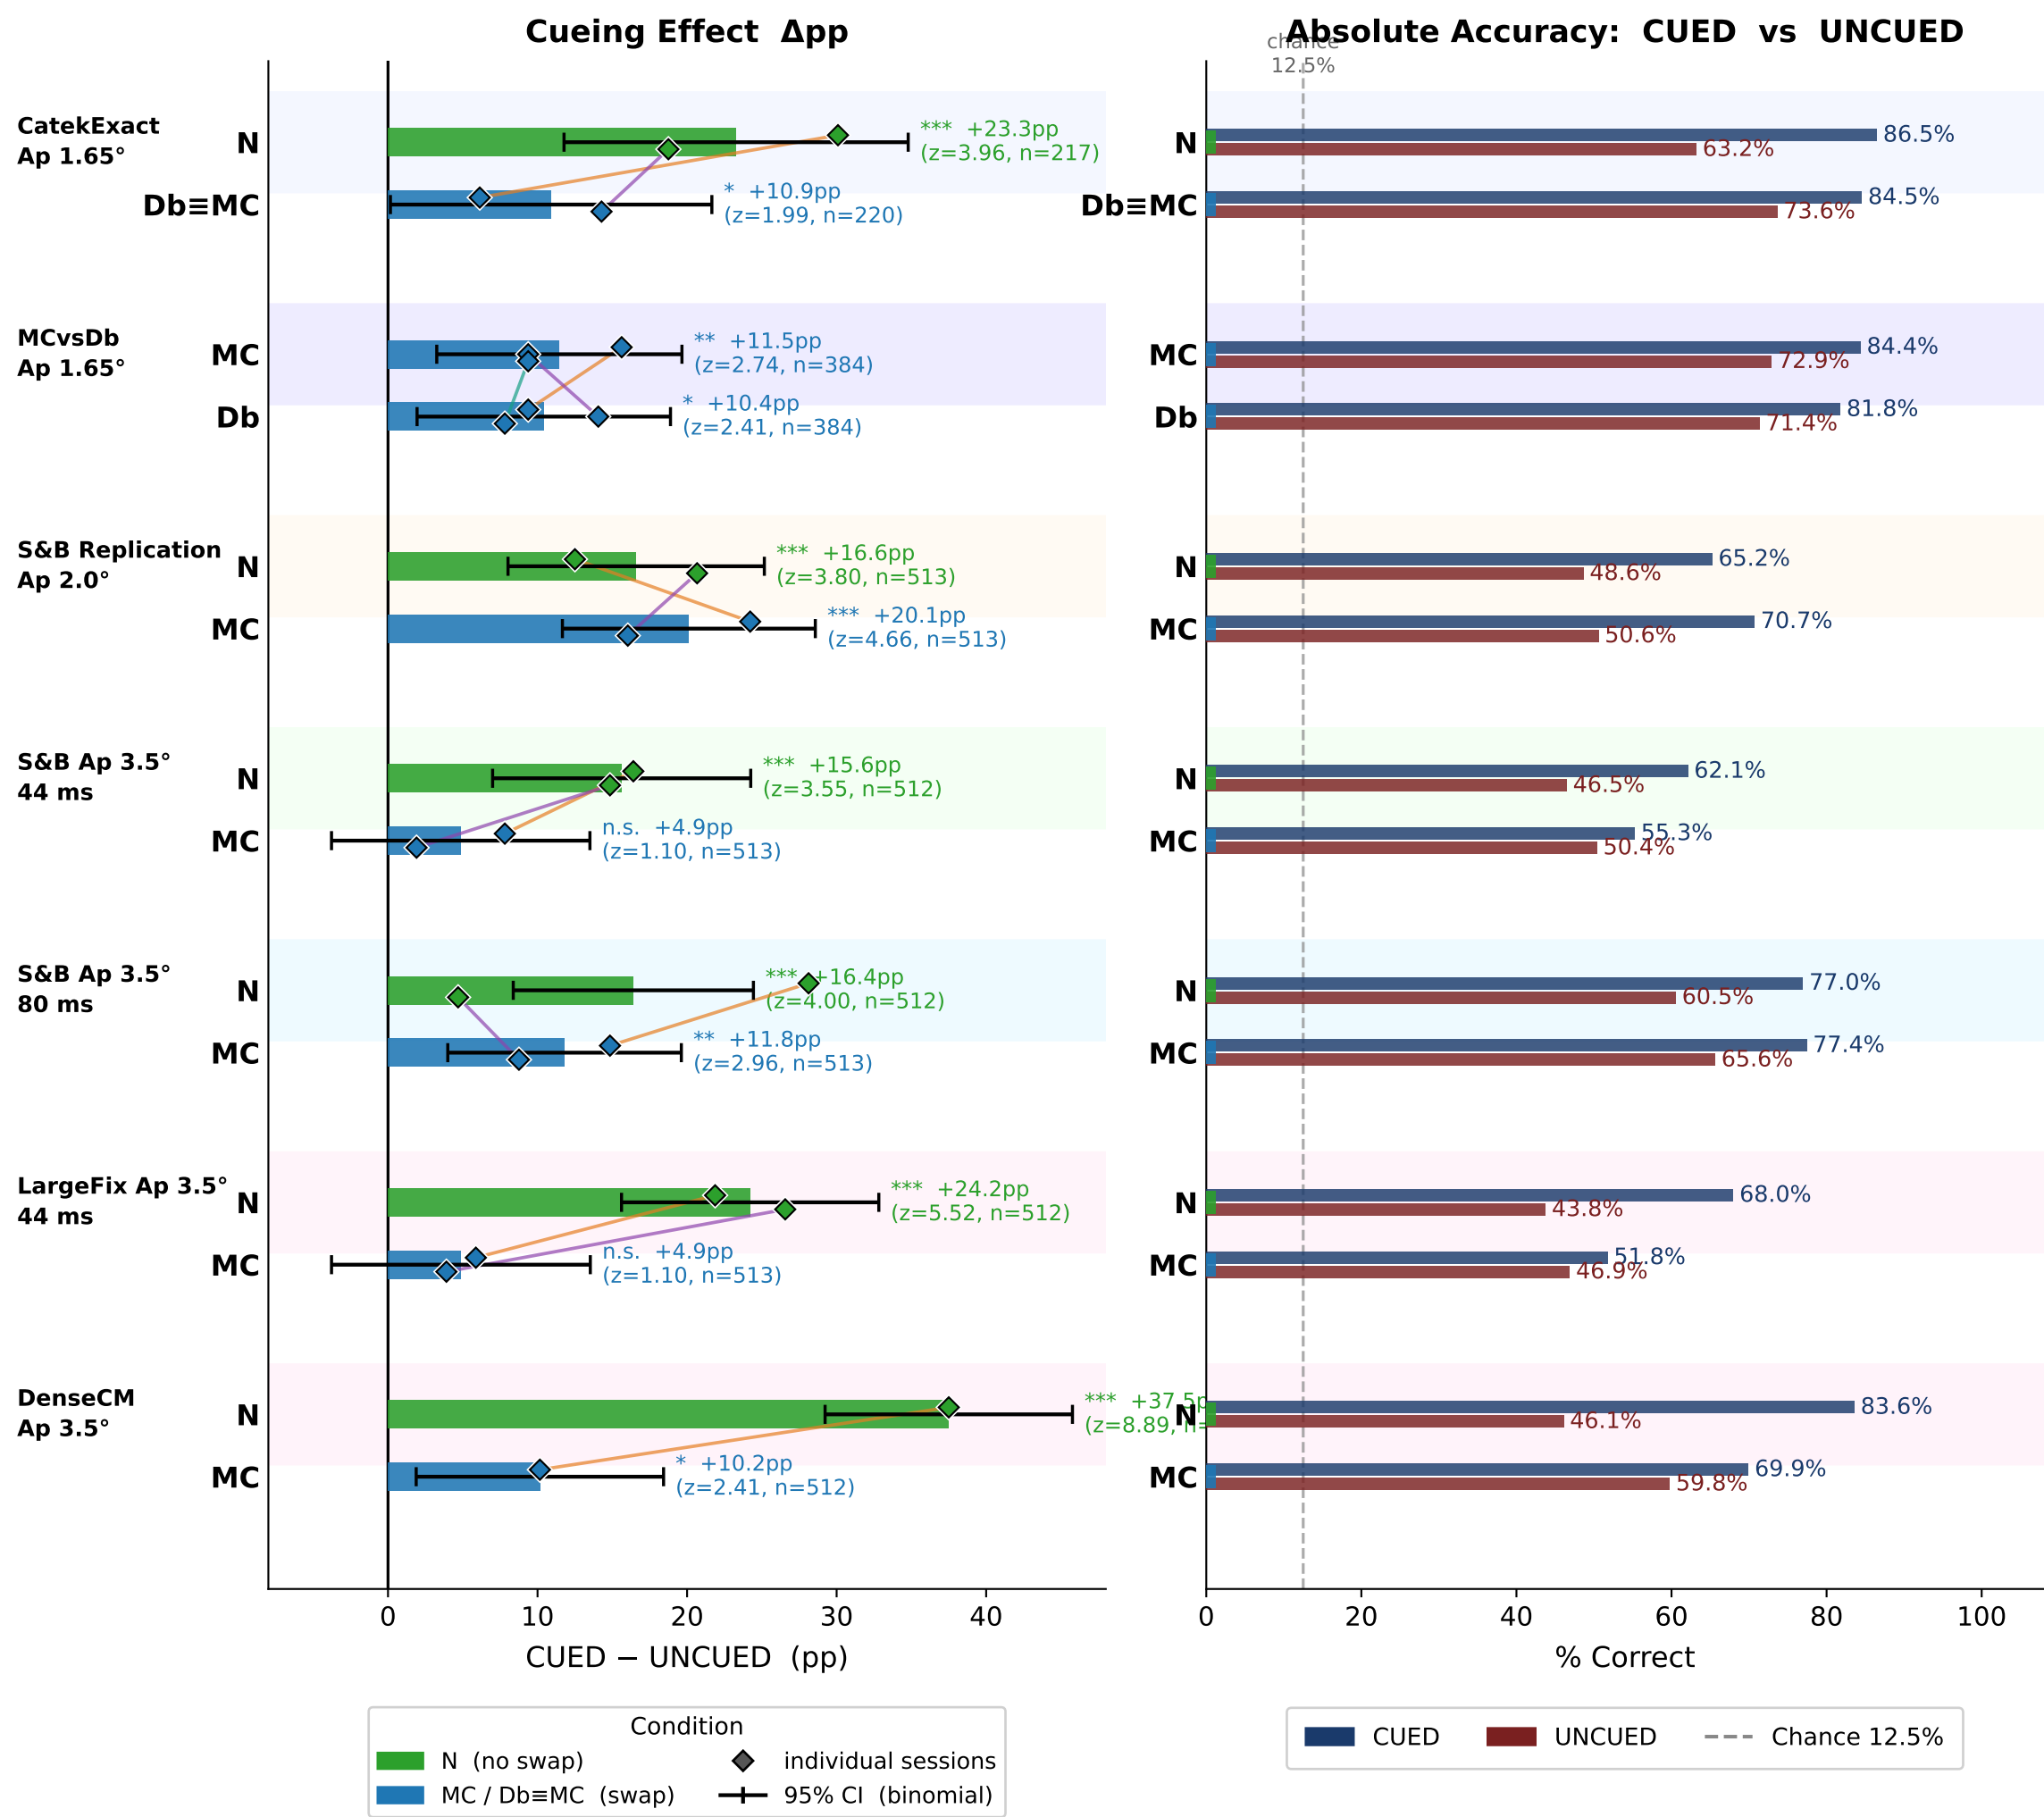

Experiment Parameters — corrected aperture area and radius, dots/field, aperture radius, density, trans. dur., Db CUED/swap label, Fix disc. to onset, Excl. conversion, Excl./Ap ratio, Sessions (n trials) on/exclusion zone

Experiment	Ap diam.	Ap area (deg²)	Dots/field	Density (dots/deg²)	Trans. dur.	Swap cond.	Fix disc diam.	Excl. radius	Excl./Ap ratio	Sessions (n trials)
CatekExact	1.65°	2.14	43	20.1	80 ms	N+Db $\equiv$ MC	0.85°	0.50°	0.61	2 (N=437)
MCvsDb Ap 1.6	1.65°	2.14	43	20.1	80 ms	MC+Db	0.85°	0.50°	0.61	2 (N=768) no N baseline
S&B Replication	2.0°	3.14	63	20.1	44 ms	N+MC	0.40°	0.396°	0.40	2 (N=1026)
S&B Ap 3.5° 44	3.5°	9.62	192	20.0	44 ms	N+MC	0.40°	0.396°	0.23	2 (N=1025)
S&B Ap 3.5° 80	3.5°	9.62	192	20.0	80 ms	N+MC	0.40°	0.396°	0.23	2 (N=1025)
LargeFix Ap 3.5	3.5°	9.62	192	20.0	44 ms	N+MC	1.80°	1.10°	0.63	2 (N=1025)
DenseCM	3.5°	9.62	500	52.0	80 ms	N+MC	1.80°	1.10°	0.61	2 (N=1024) no N baseline