




1. Matching-relay is located on top of the power source box.

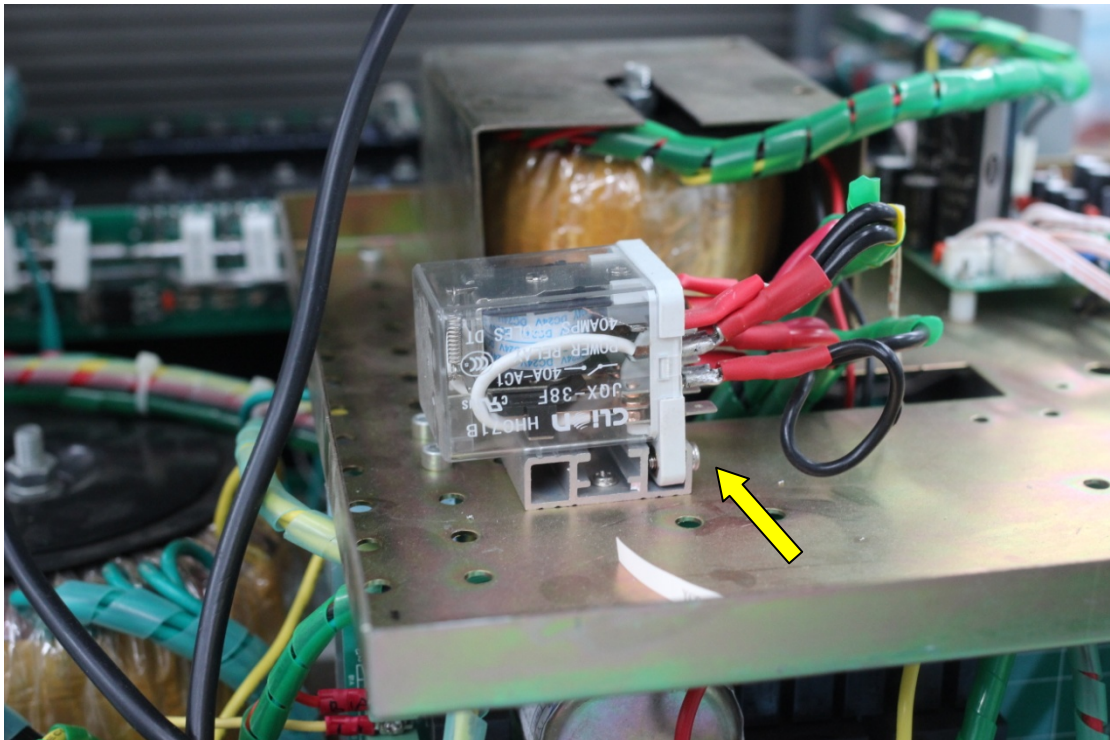

2. Relay at off position

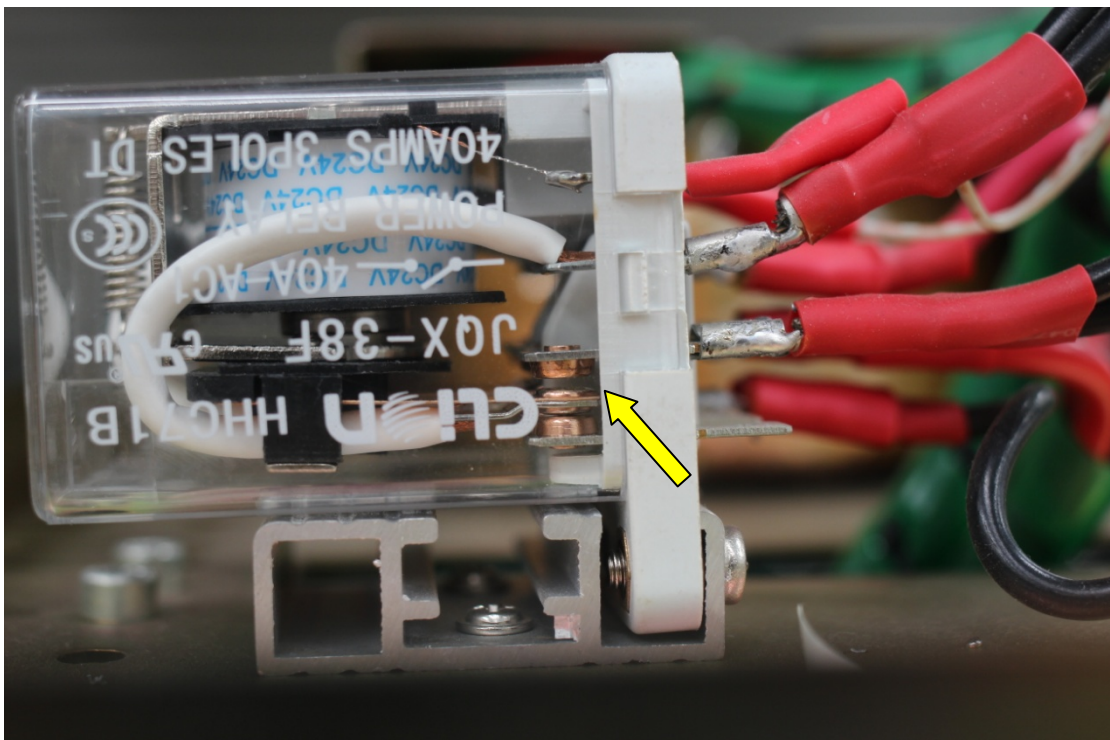

3. Relay at on position.

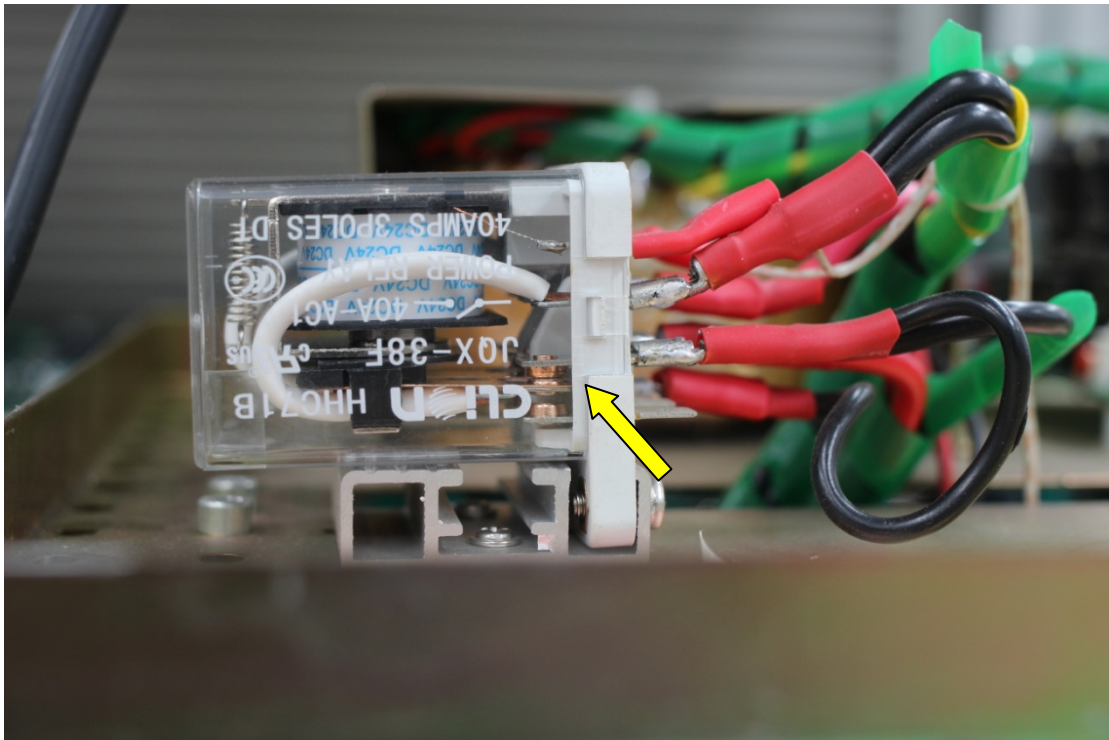

Remarks : The relay on and off positions are depended on the loaded condition. The load conditions include currents amplitude and impedance of tested meters. In the field test, a 12 meters position test bench with meters installed and relay start to move to on position at the 79A current output level and move back to off position again when drop the current back to 76A level. Between 76A and 79A is the critical point of relay positions.