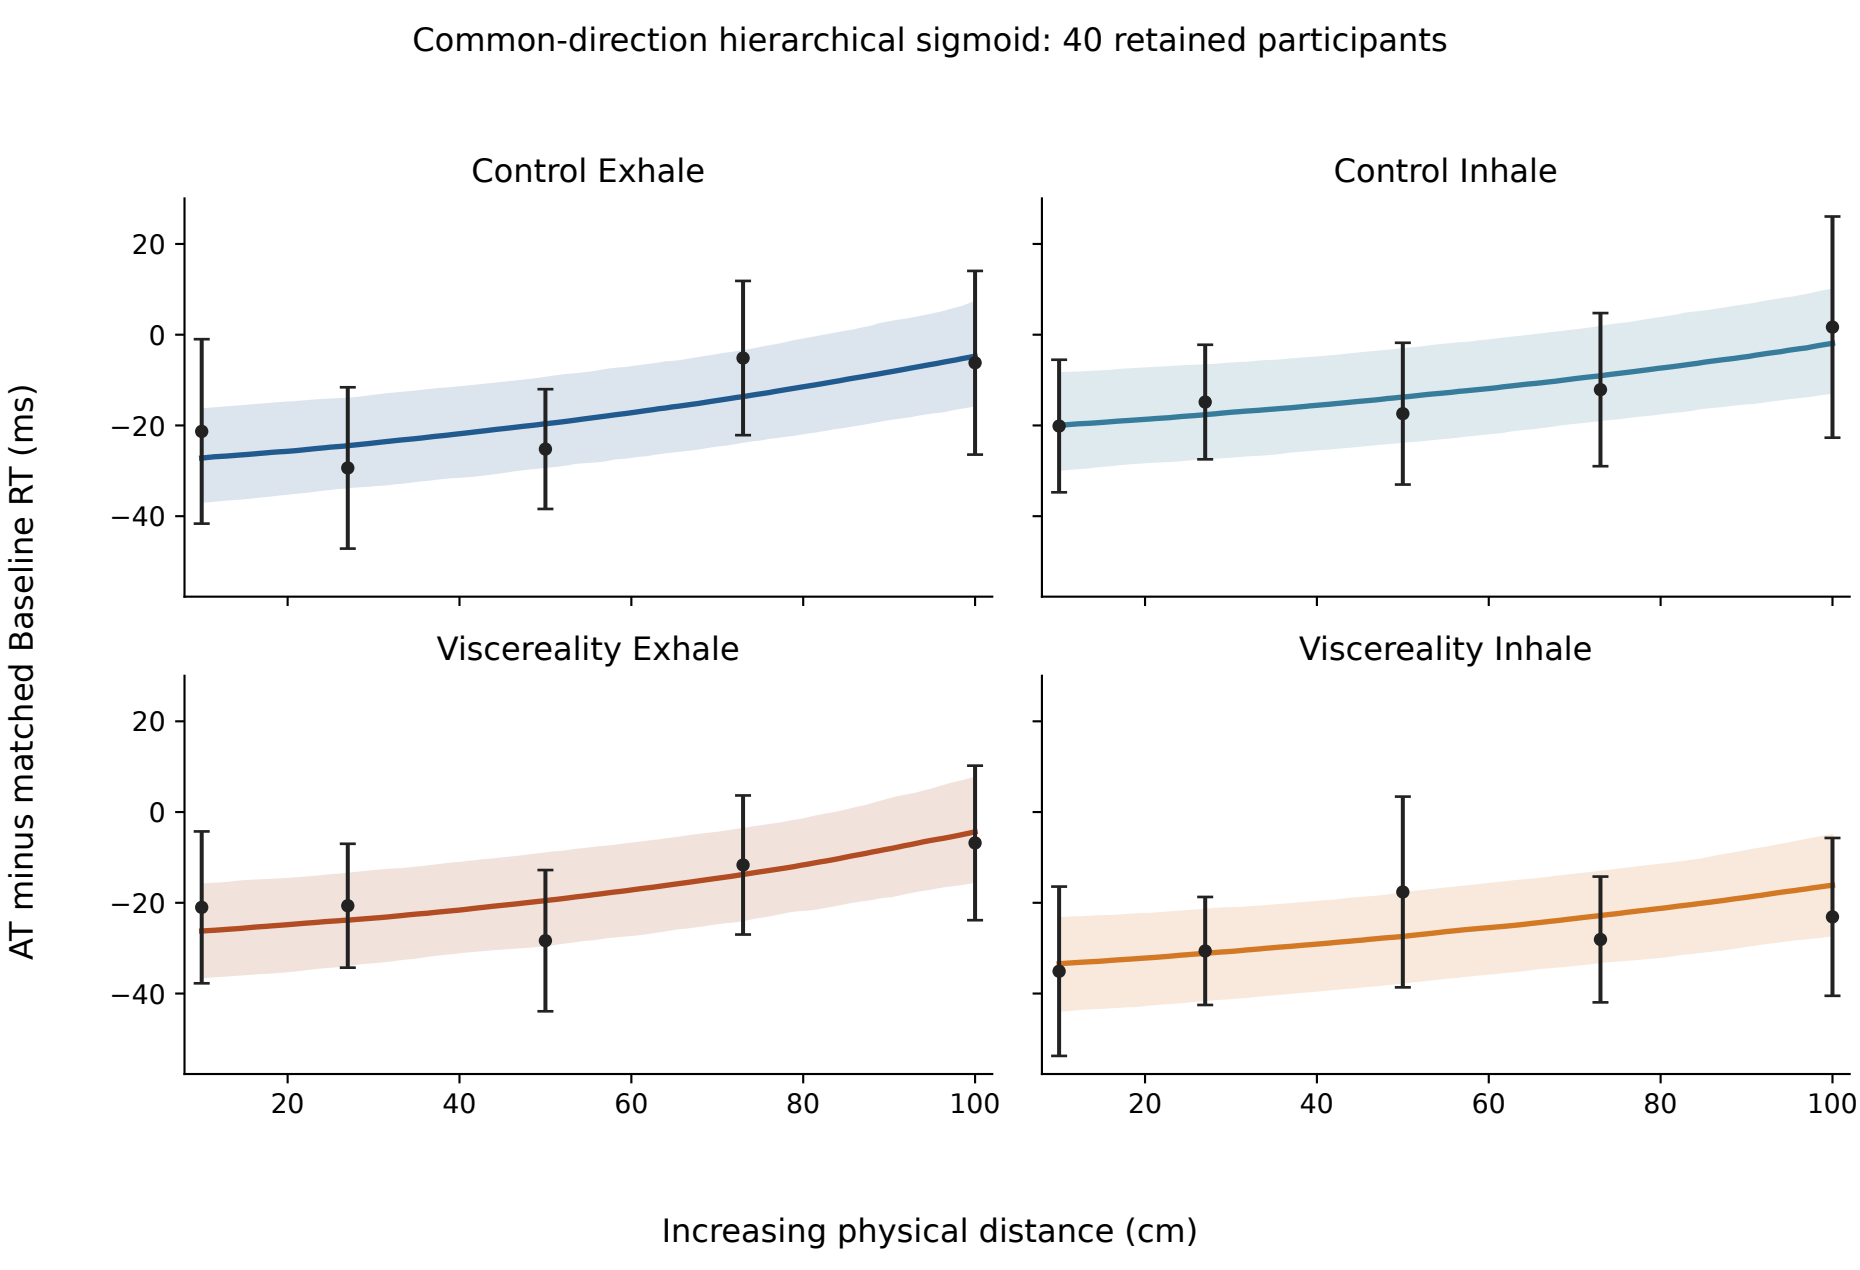
Common-direction hierarchical sigmoid: 40 retained participants
Control Exhale
Control Inhale
Viscereality Exhale
Viscereality Inhale
AT minus matched Baseline RT (ms)
20
0
−20
−40
20
40
60
80
100
Increasing physical distance (cm)
Dots: equal-participant means ± 95% CI; bands: 95% expected-response intervals.
All fitted directions are constrained to increasing RT. Raw observations retain their original direction.