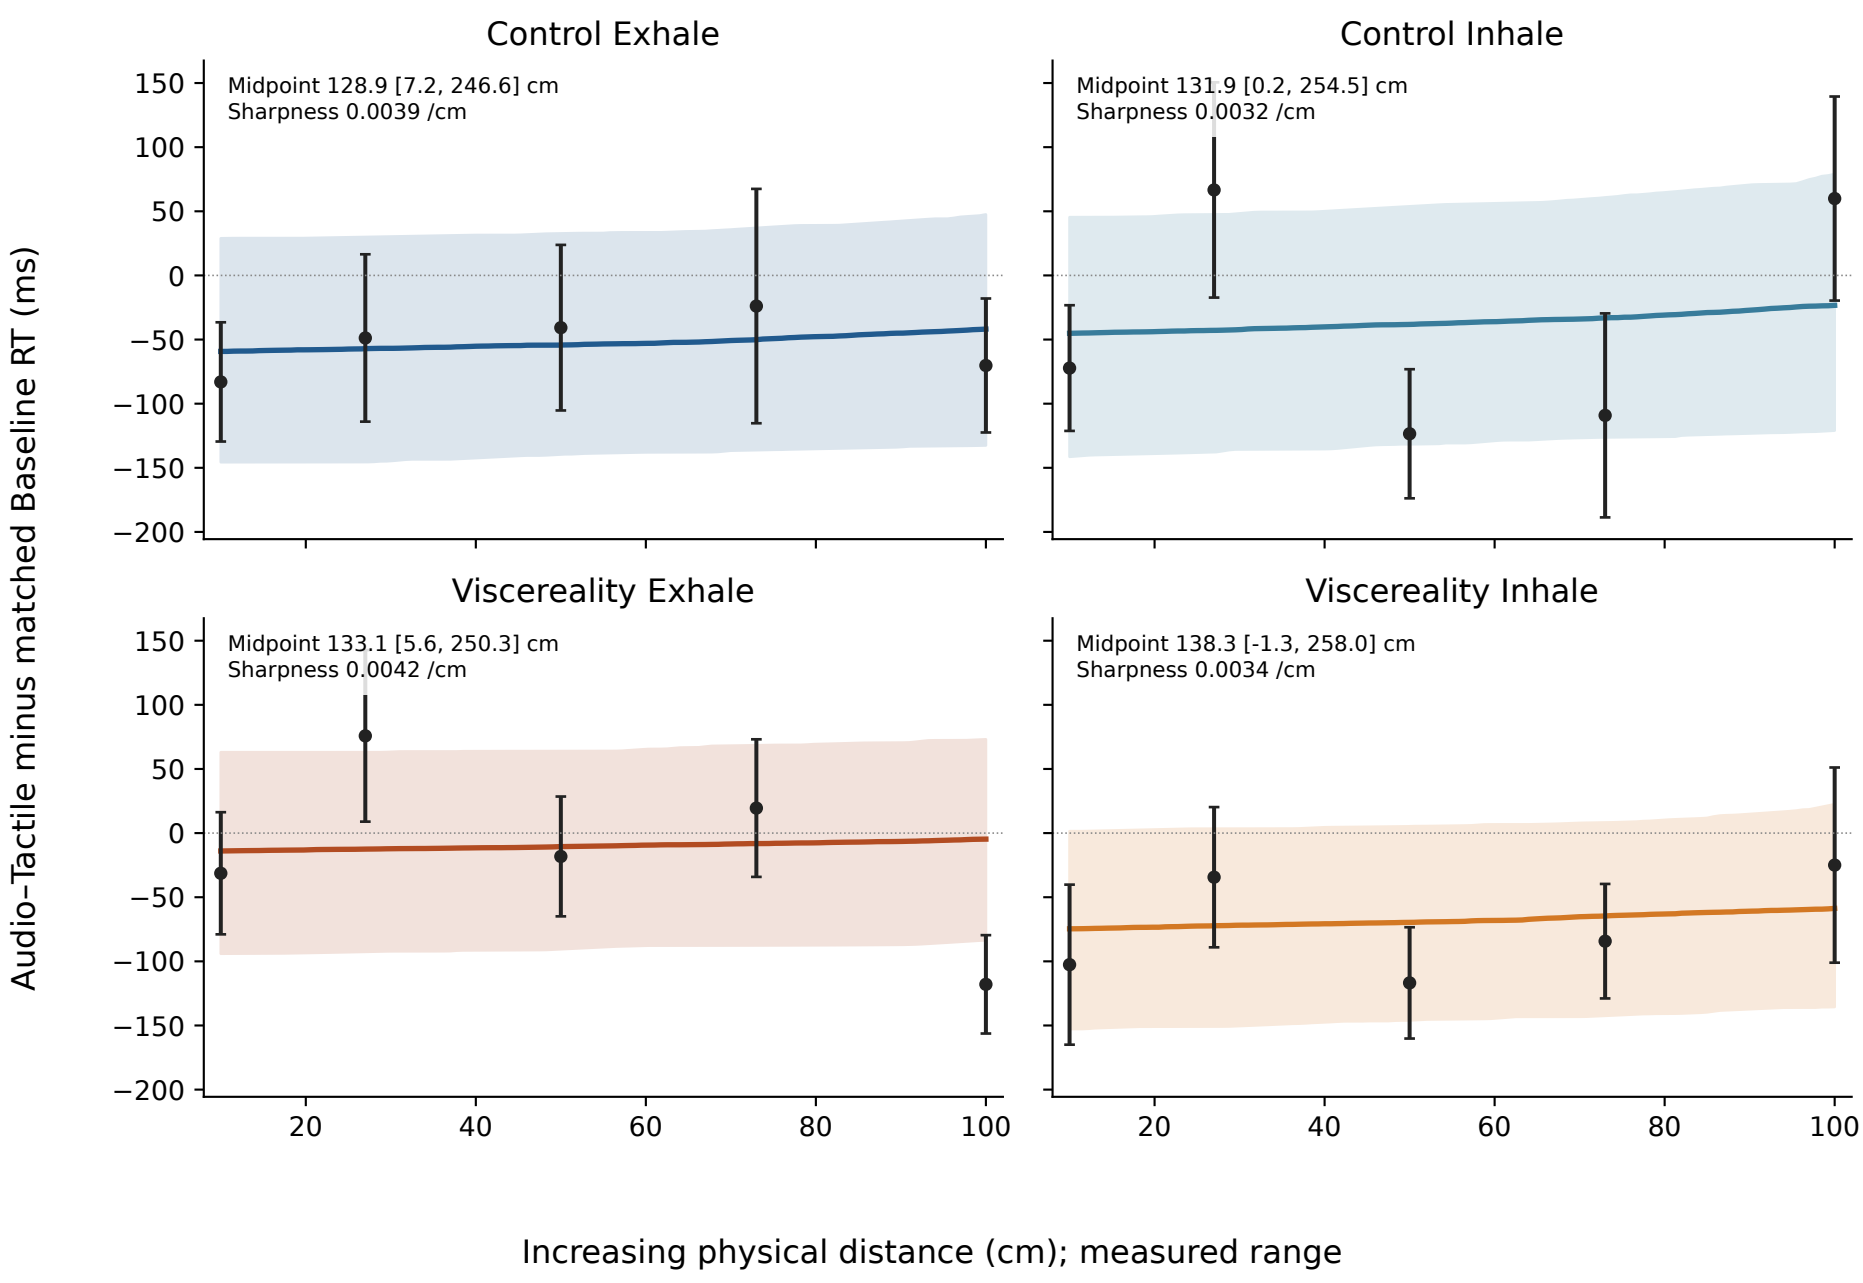
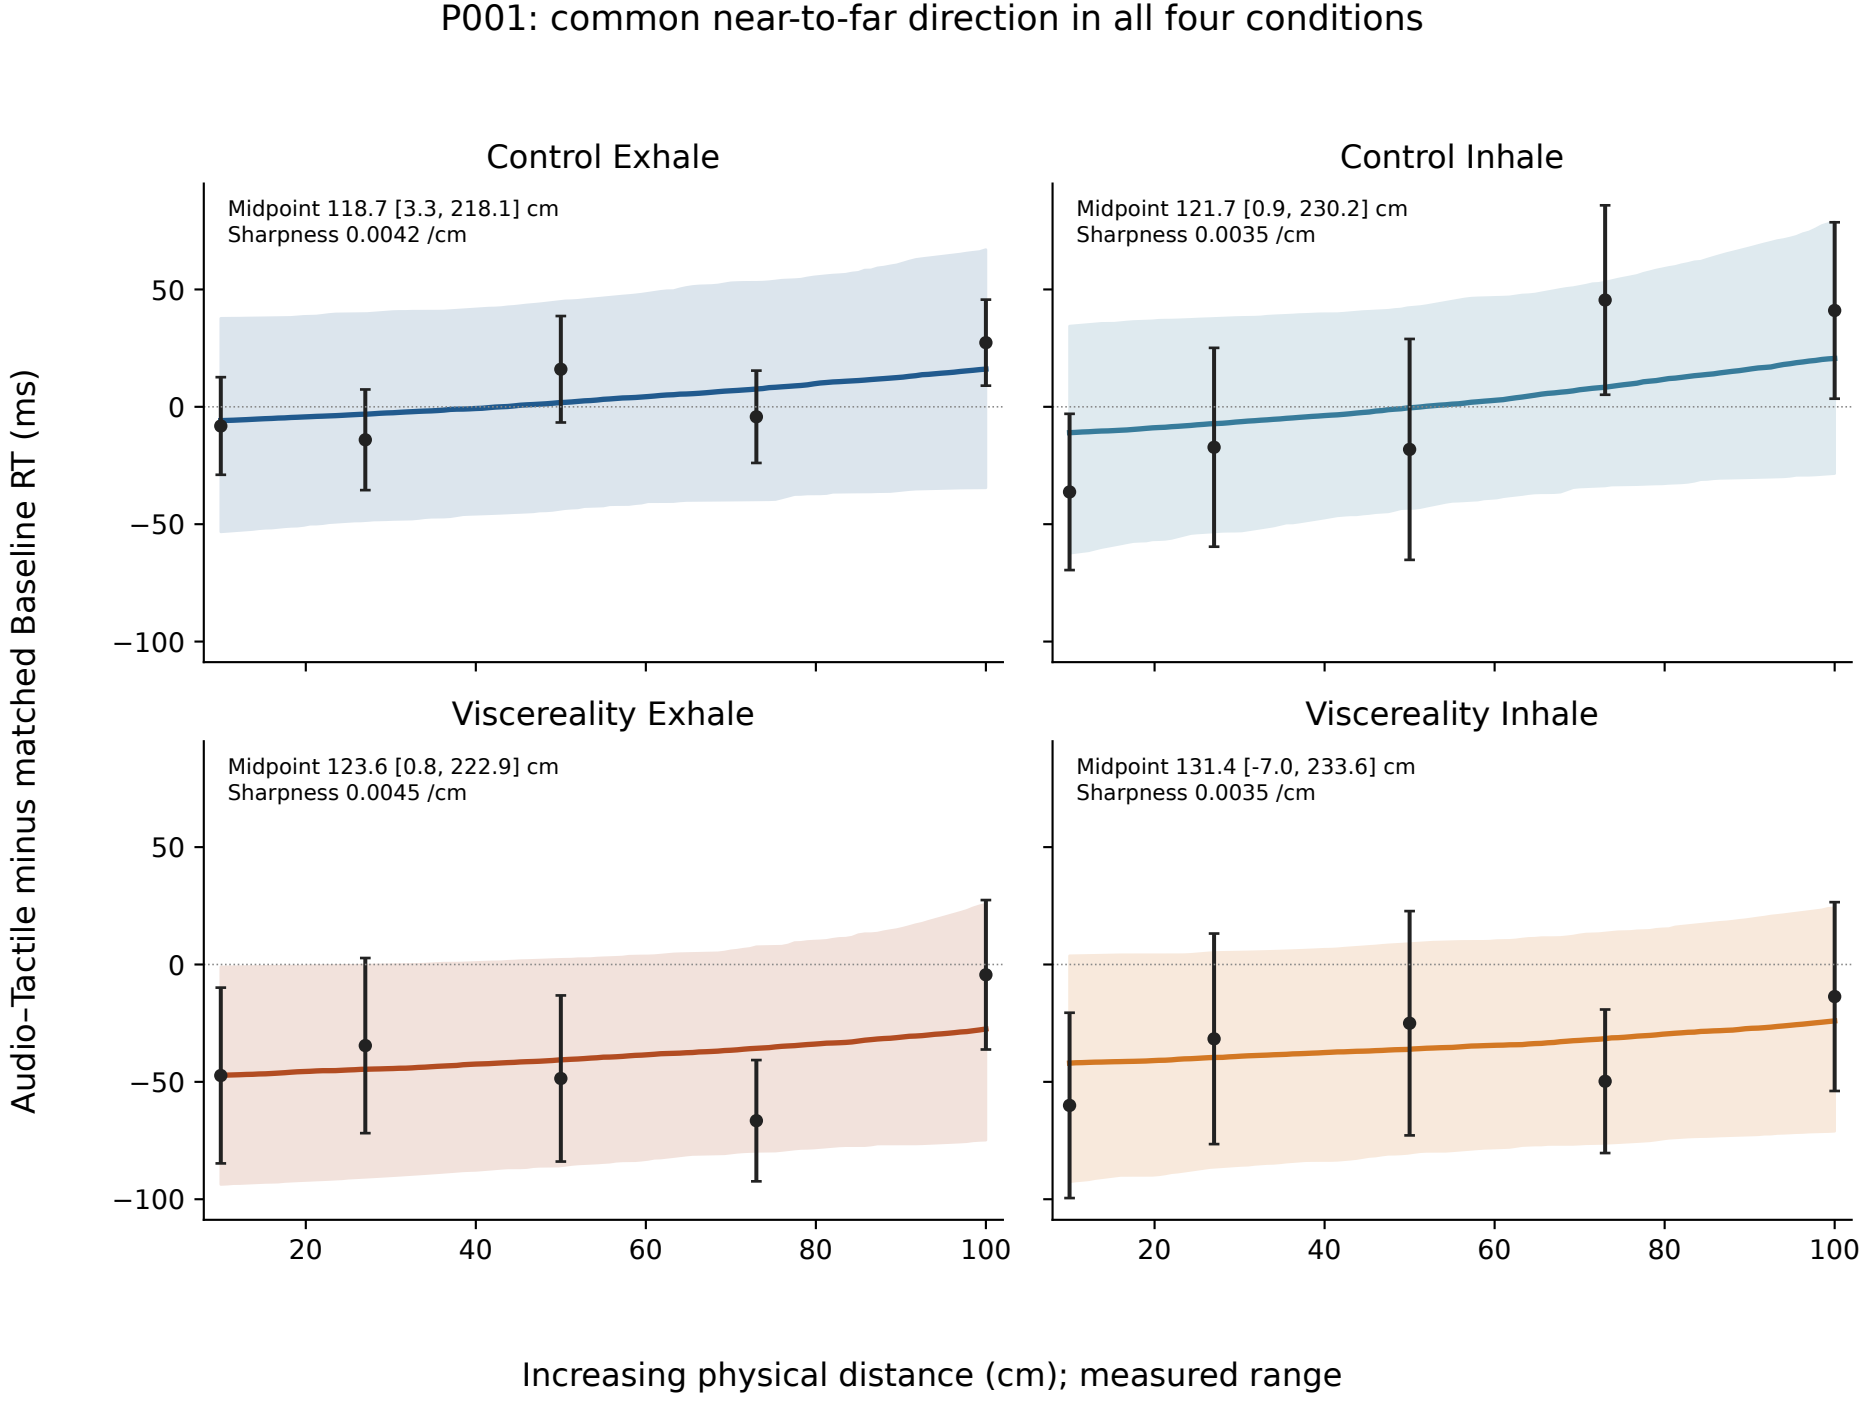
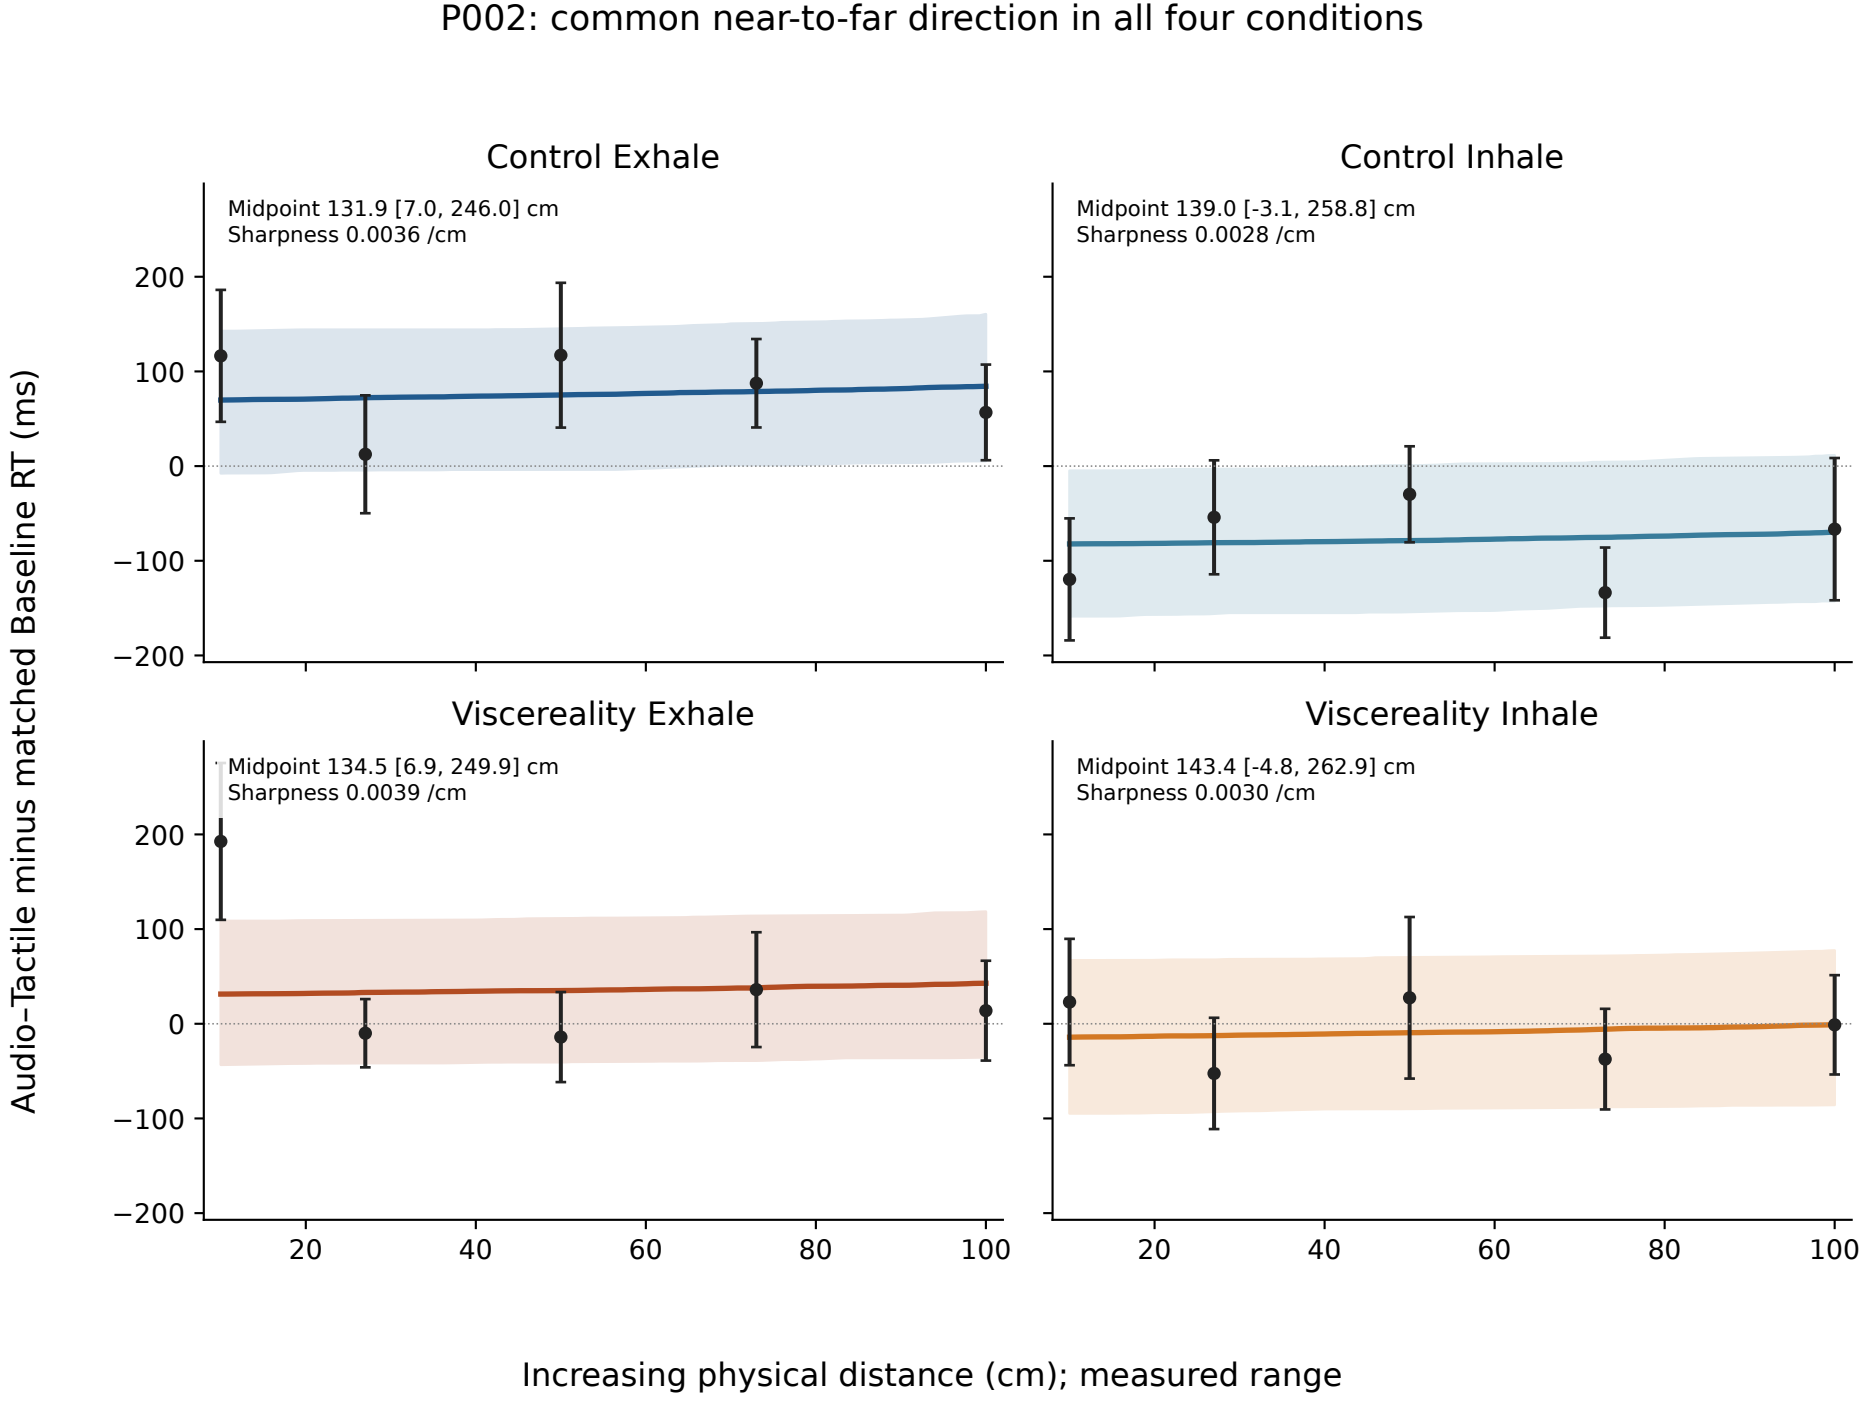
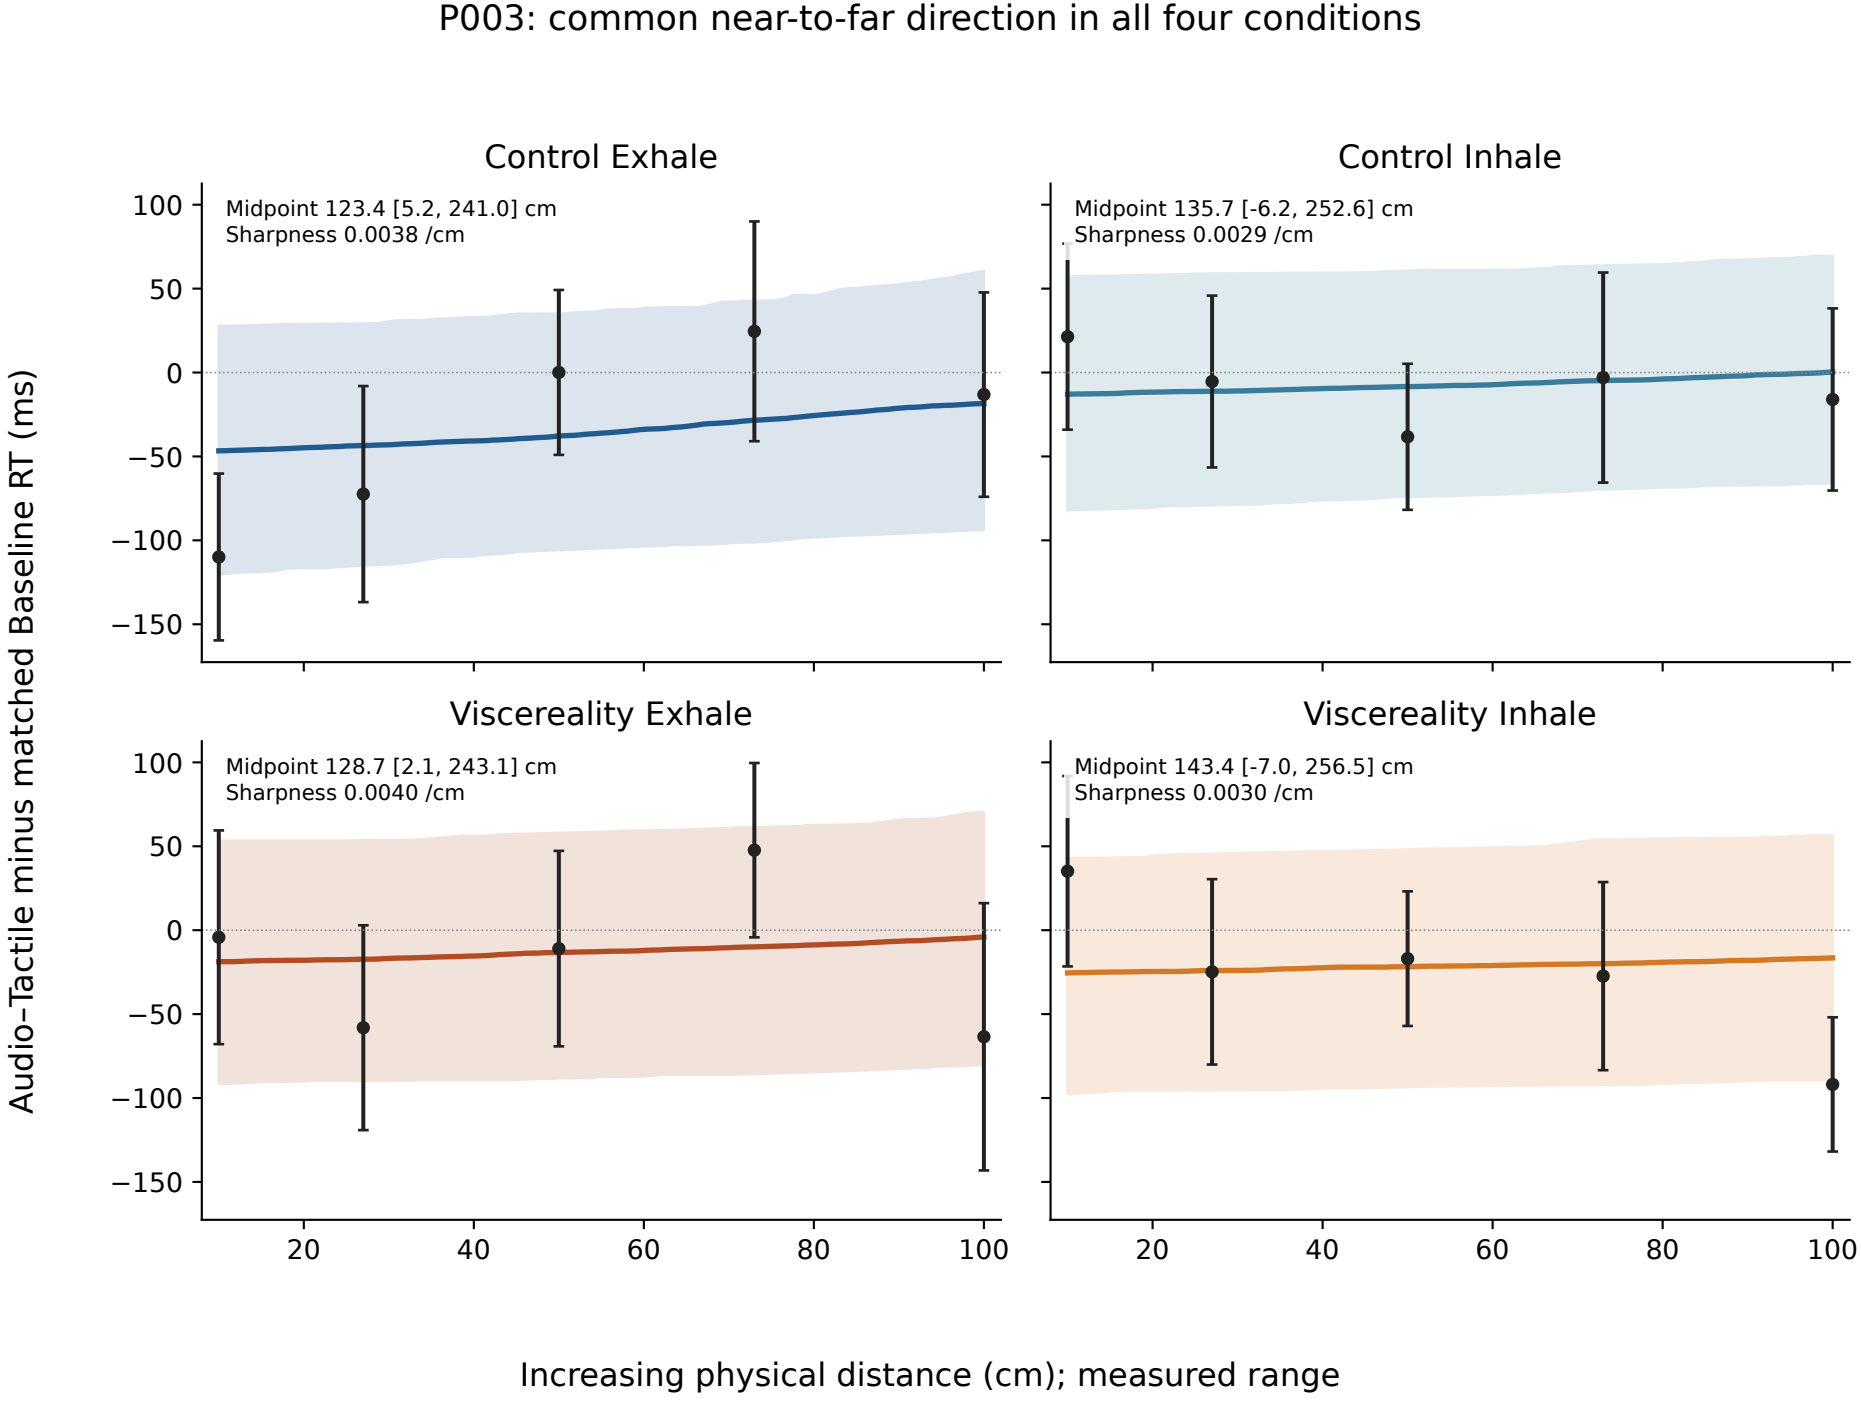
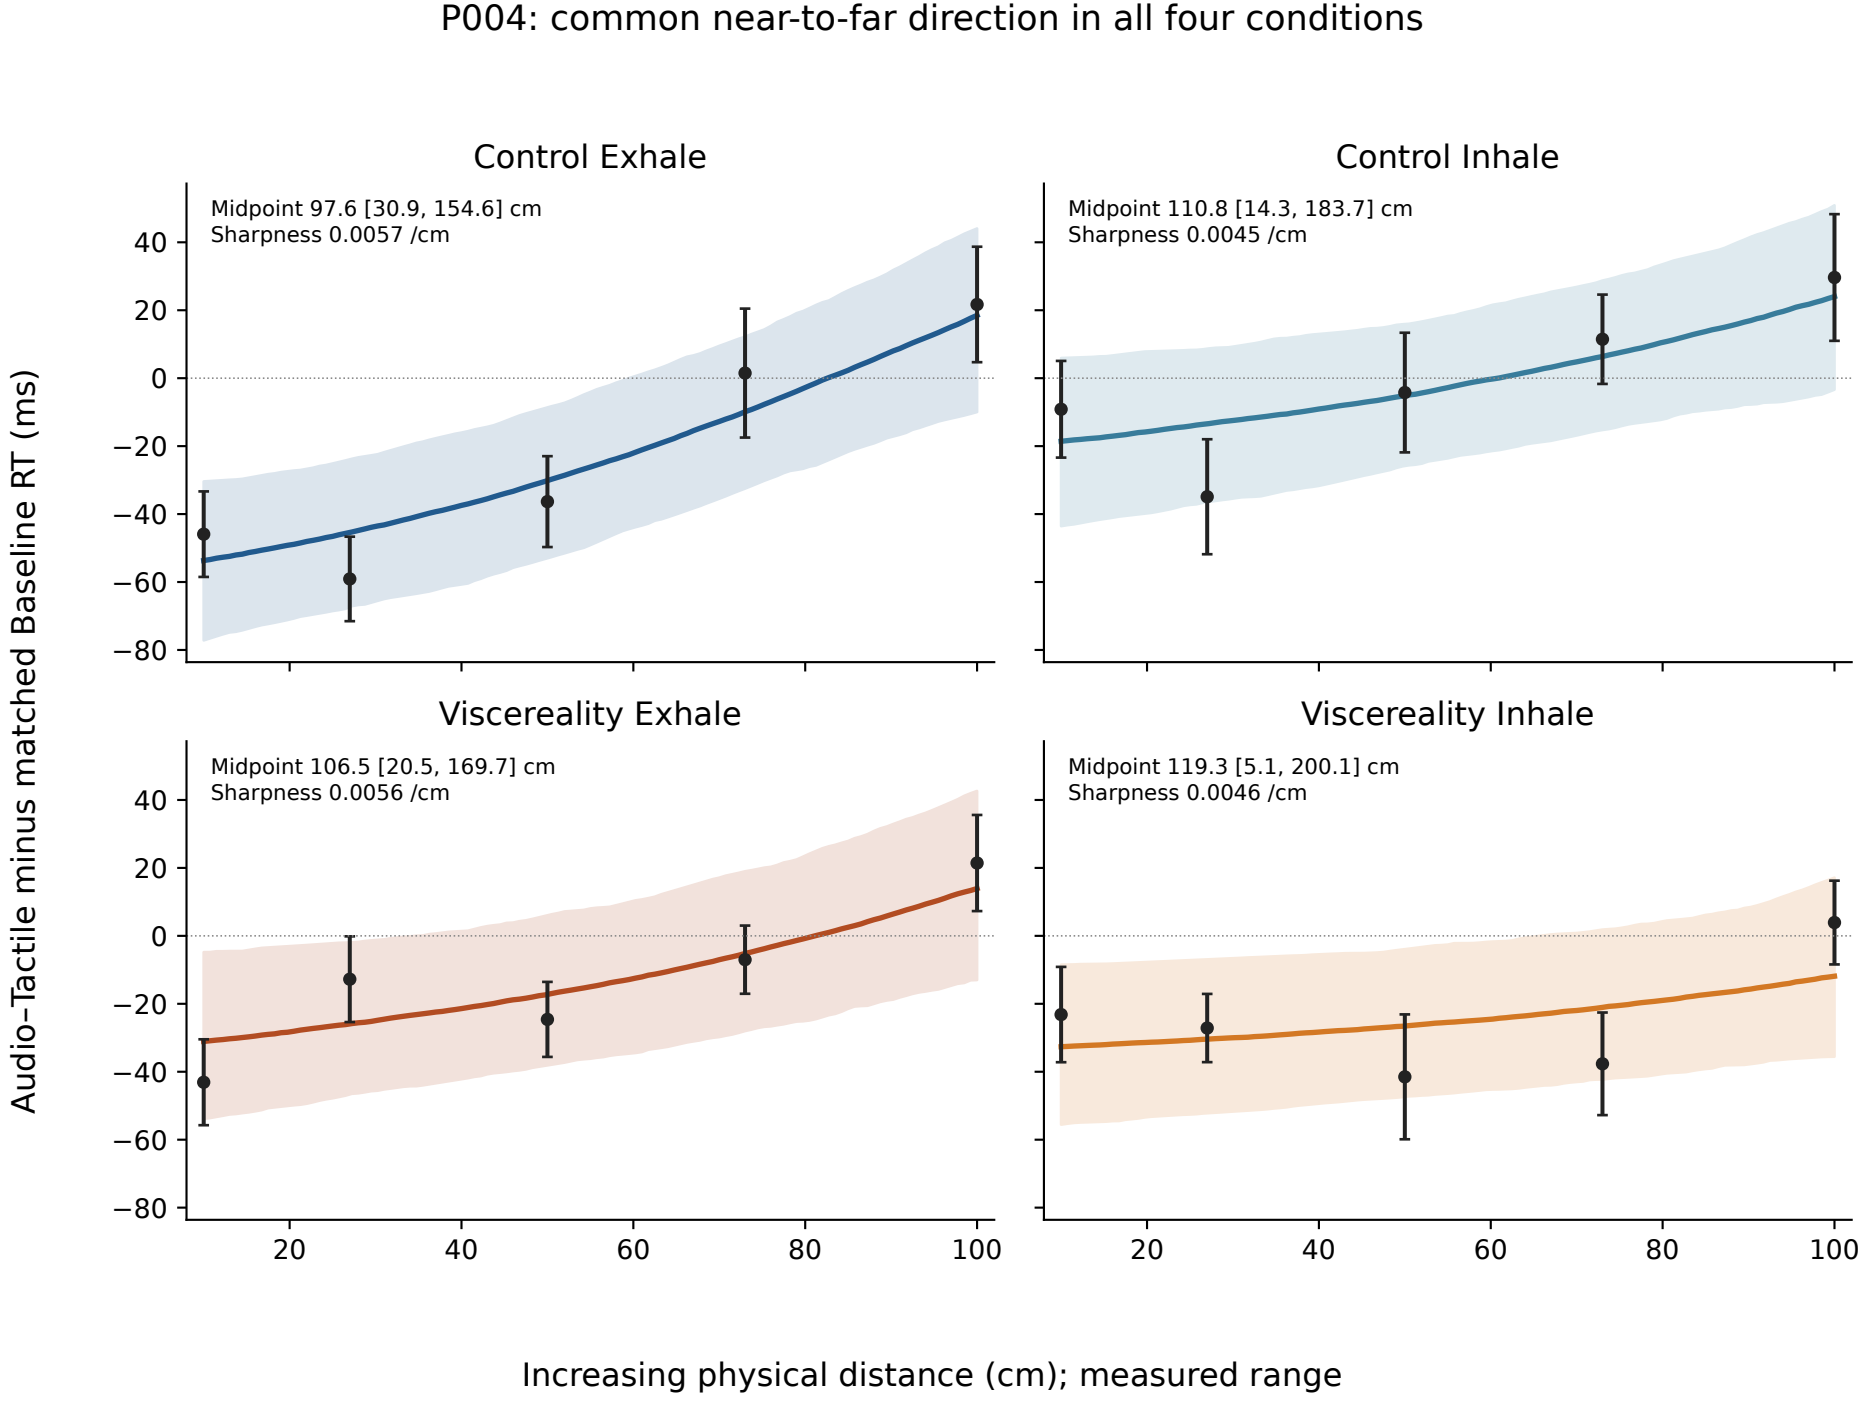
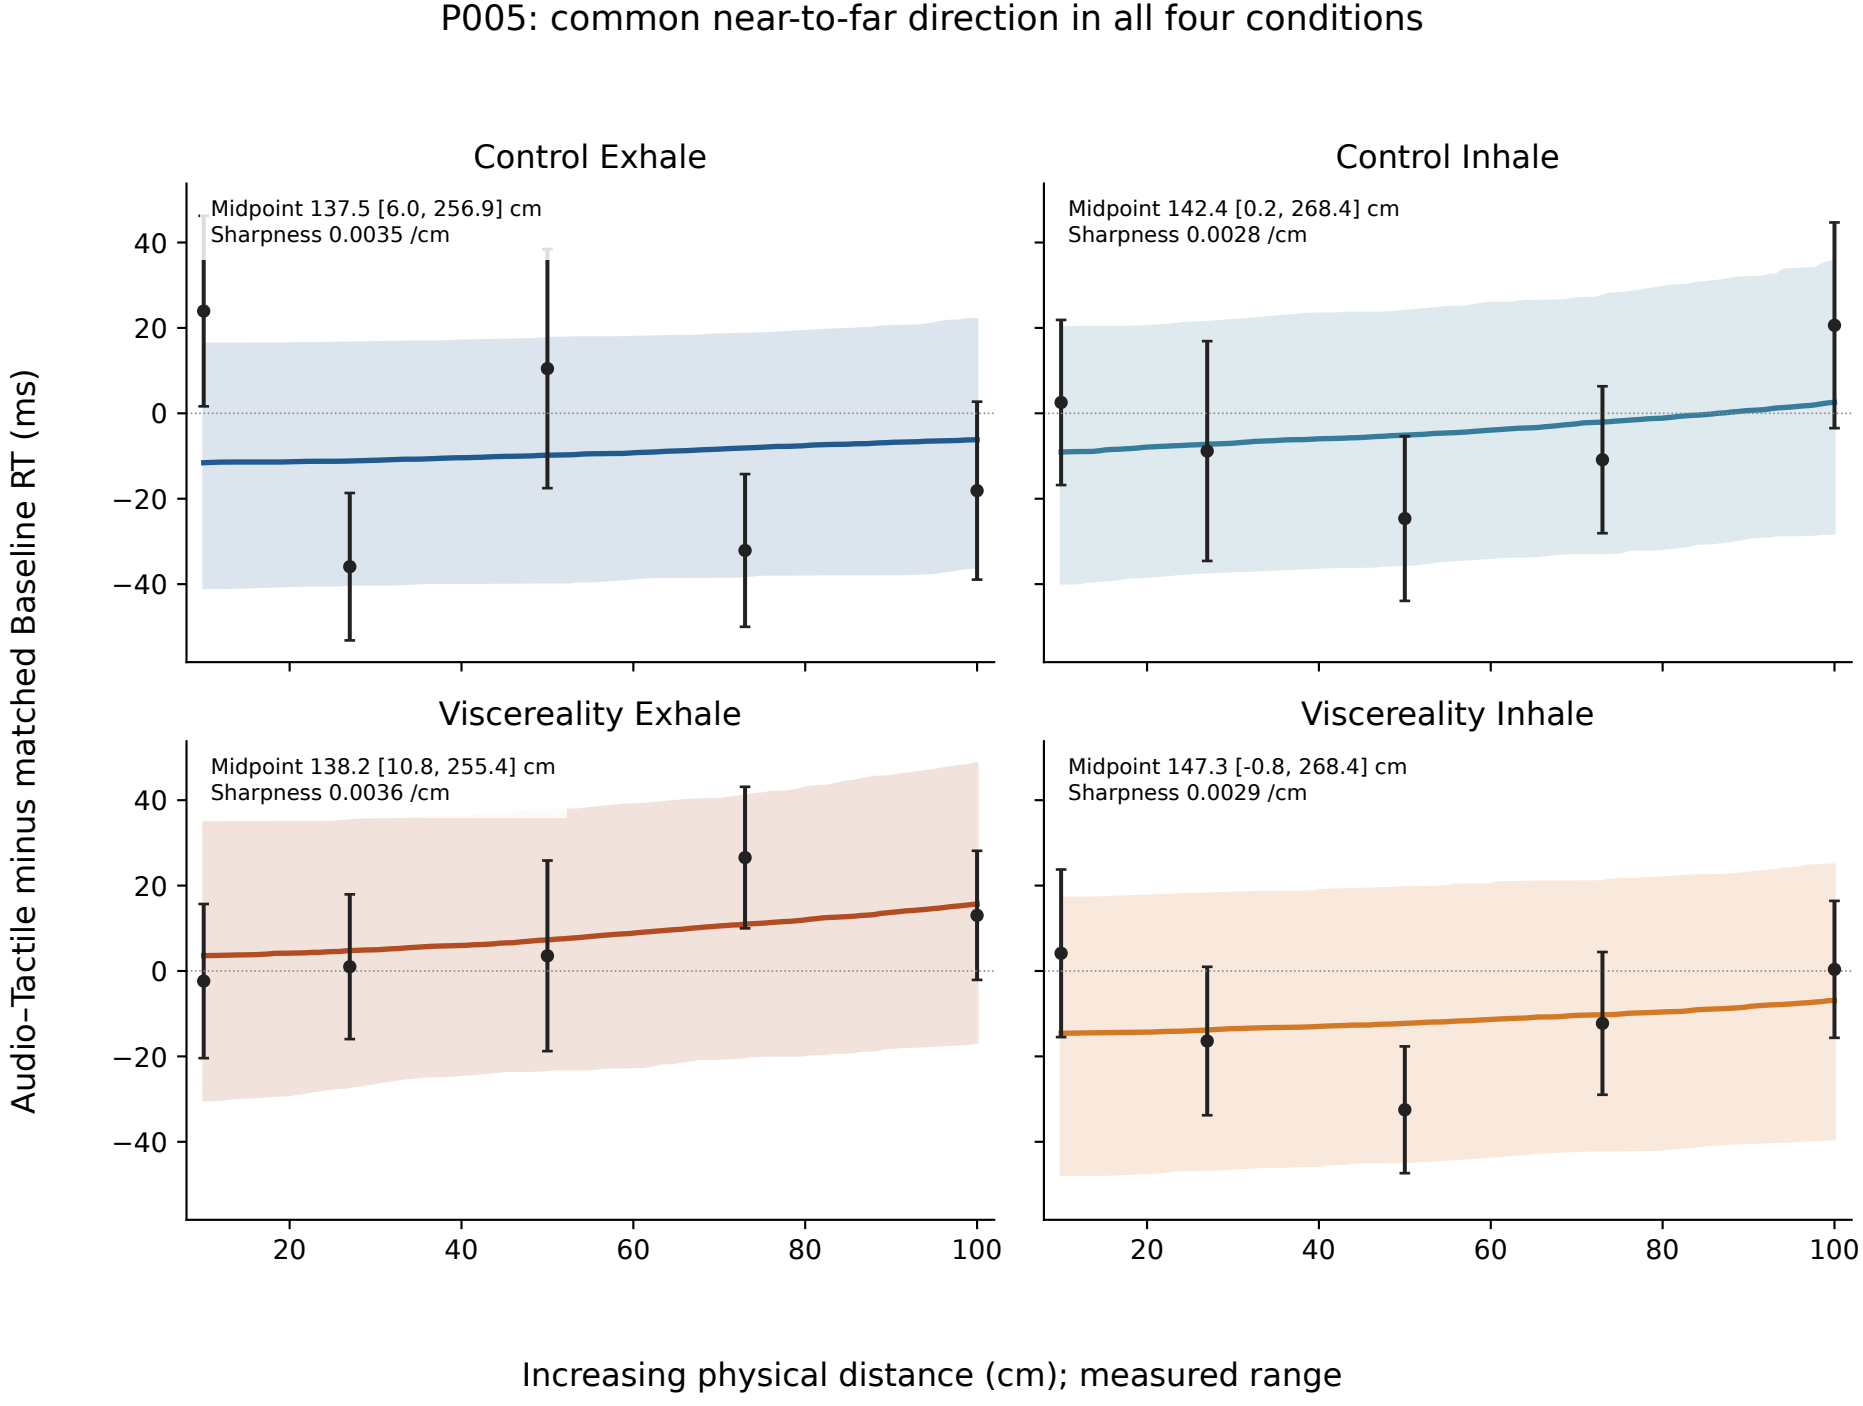

P000: common near-to-far direction in all four conditions
Control Exhale
Midpoint 128.9 [7.2, 246.6] cm
Sharpness 0.0039 /cm
Control Inhale
Midpoint 131.9 [0.2, 254.5] cm
Sharpness 0.0032 /cm
Viscereality Exhale
Midpoint 133.1 [5.6, 250.3] cm
Sharpness 0.0042 /cm
Viscereality Inhale
Midpoint 138.3 [-1.3, 258.0] cm
Sharpness 0.0034 /cm
Audio–Tactile minus matched Baseline RT (ms)
150
100
50
0
−50
−100
−150
−200
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

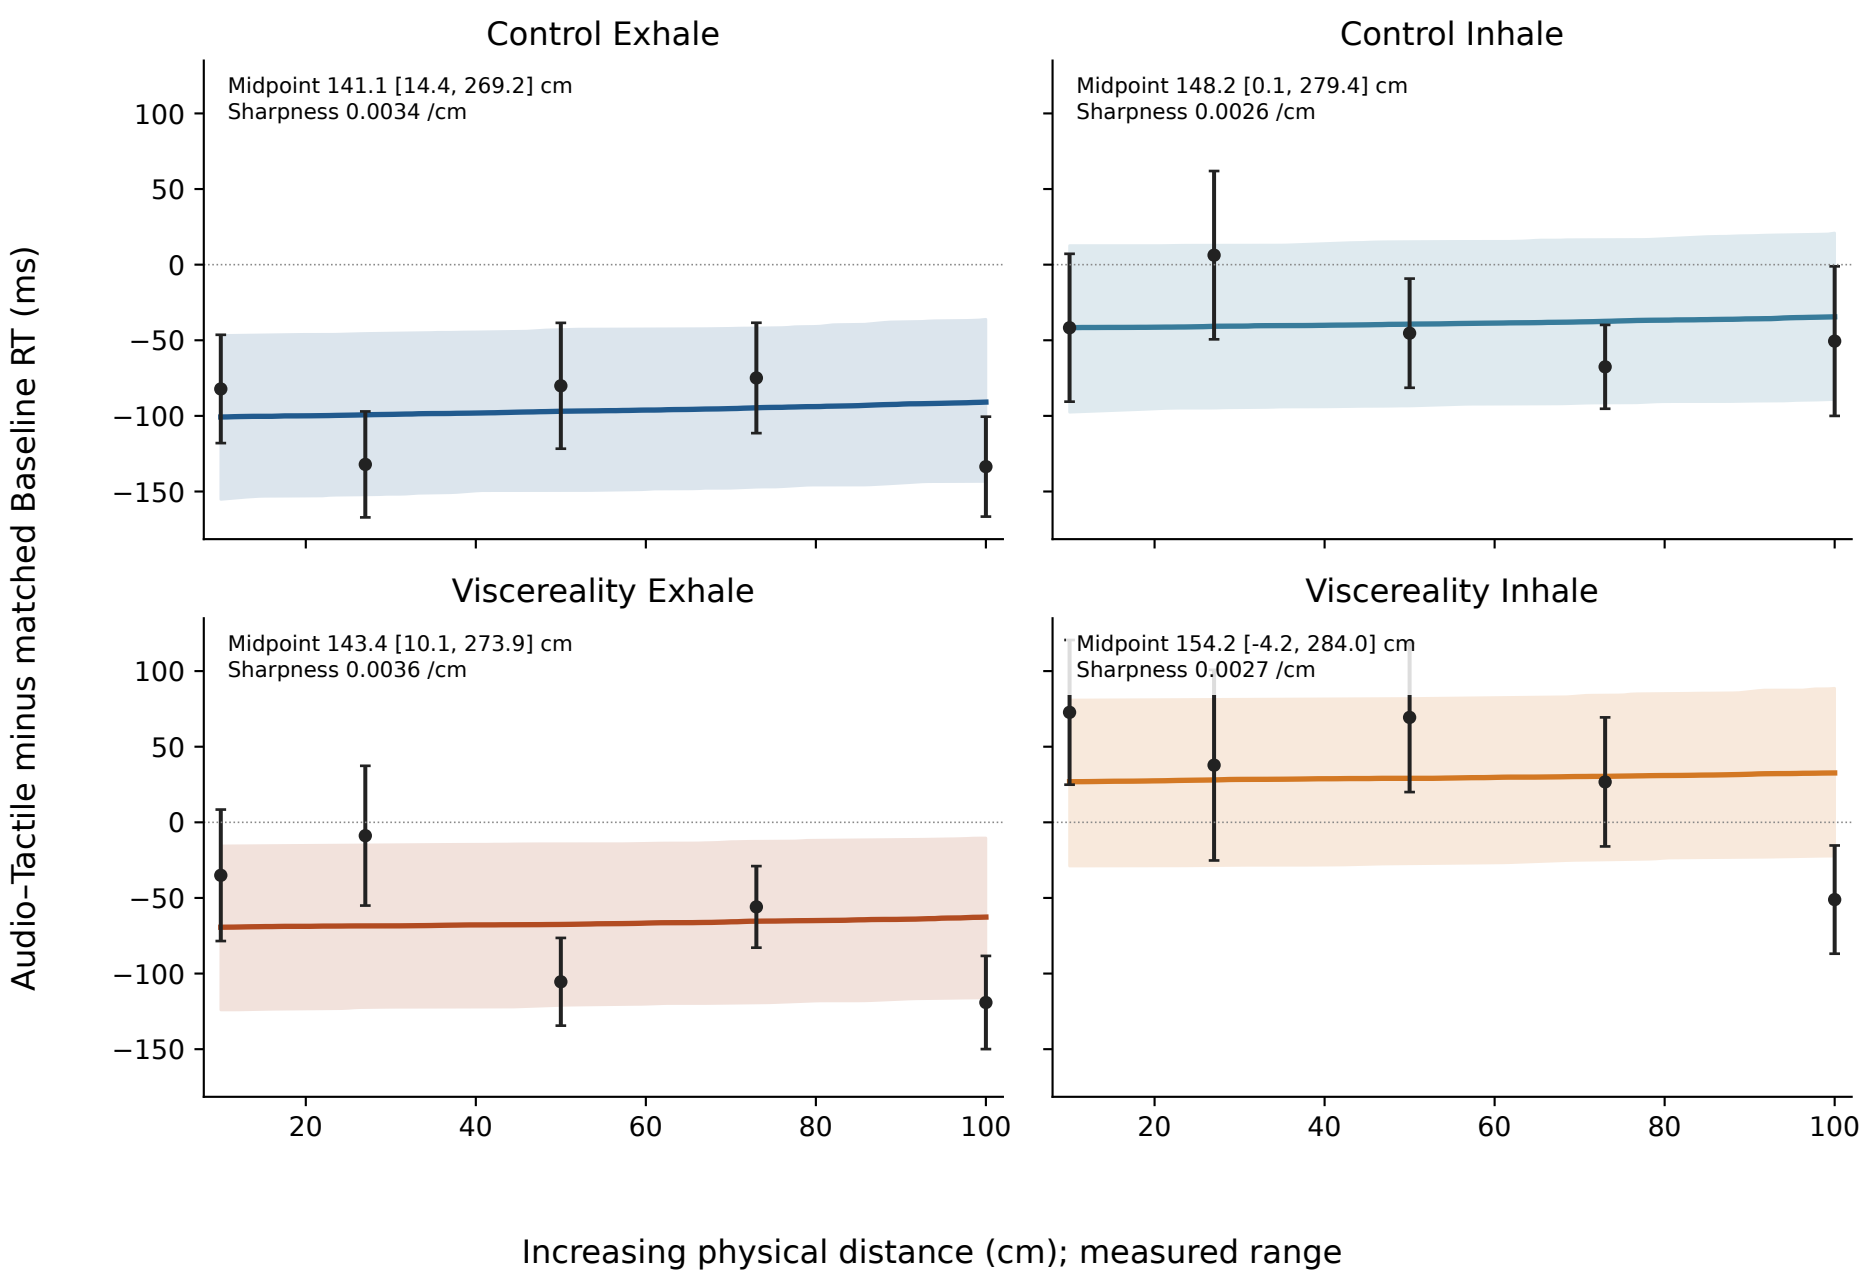

P001: common near-to-far direction in all four conditions
Control Exhale
Midpoint 118.7 [3.3, 218.1] cm
Sharpness 0.0042 /cm
Control Inhale
Midpoint 121.7 [0.9, 230.2] cm
Sharpness 0.0035 /cm
Viscereality Exhale
Midpoint 123.6 [0.8, 222.9] cm
Sharpness 0.0045 /cm
Viscereality Inhale
Midpoint 131.4 [-7.0, 233.6] cm
Sharpness 0.0035 /cm
Audio–Tactile minus matched Baseline RT (ms)
50
0
−50
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

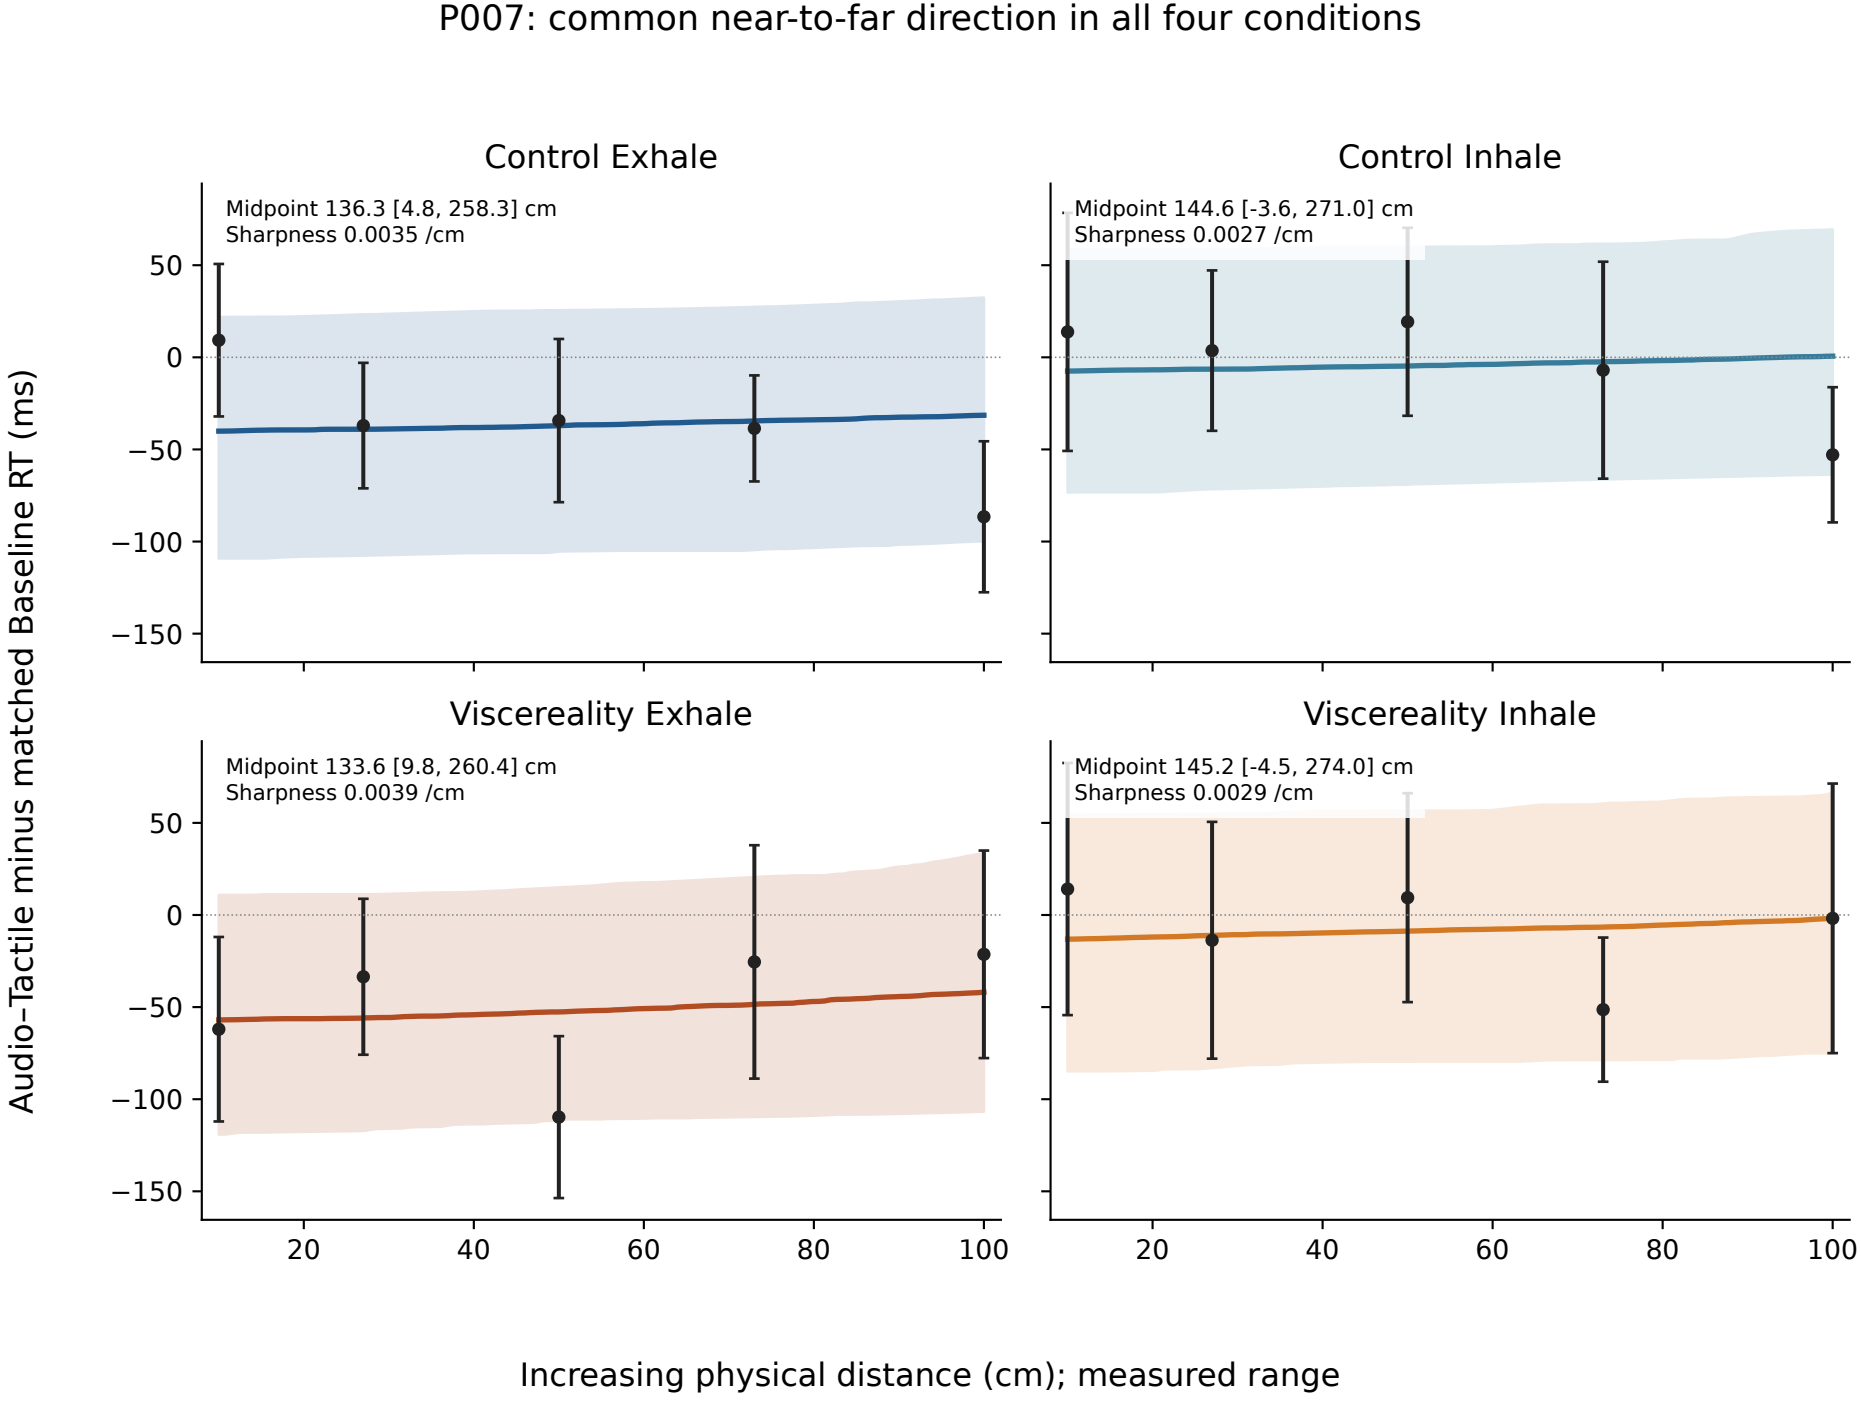

P002: common near-to-far direction in all four conditions
Control Exhale
Midpoint 131.9 [7.0, 246.0] cm
Sharpness 0.0036 /cm
Control Inhale
Midpoint 139.0 [-3.1, 258.8] cm
Sharpness 0.0028 /cm
Viscereality Exhale
Midpoint 134.5 [6.9, 249.9] cm
Sharpness 0.0039 /cm
Viscereality Inhale
Midpoint 143.4 [-4.8, 262.9] cm
Sharpness 0.0030 /cm
Audio–Tactile minus matched Baseline RT (ms)
200
100
0
−100
−200
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

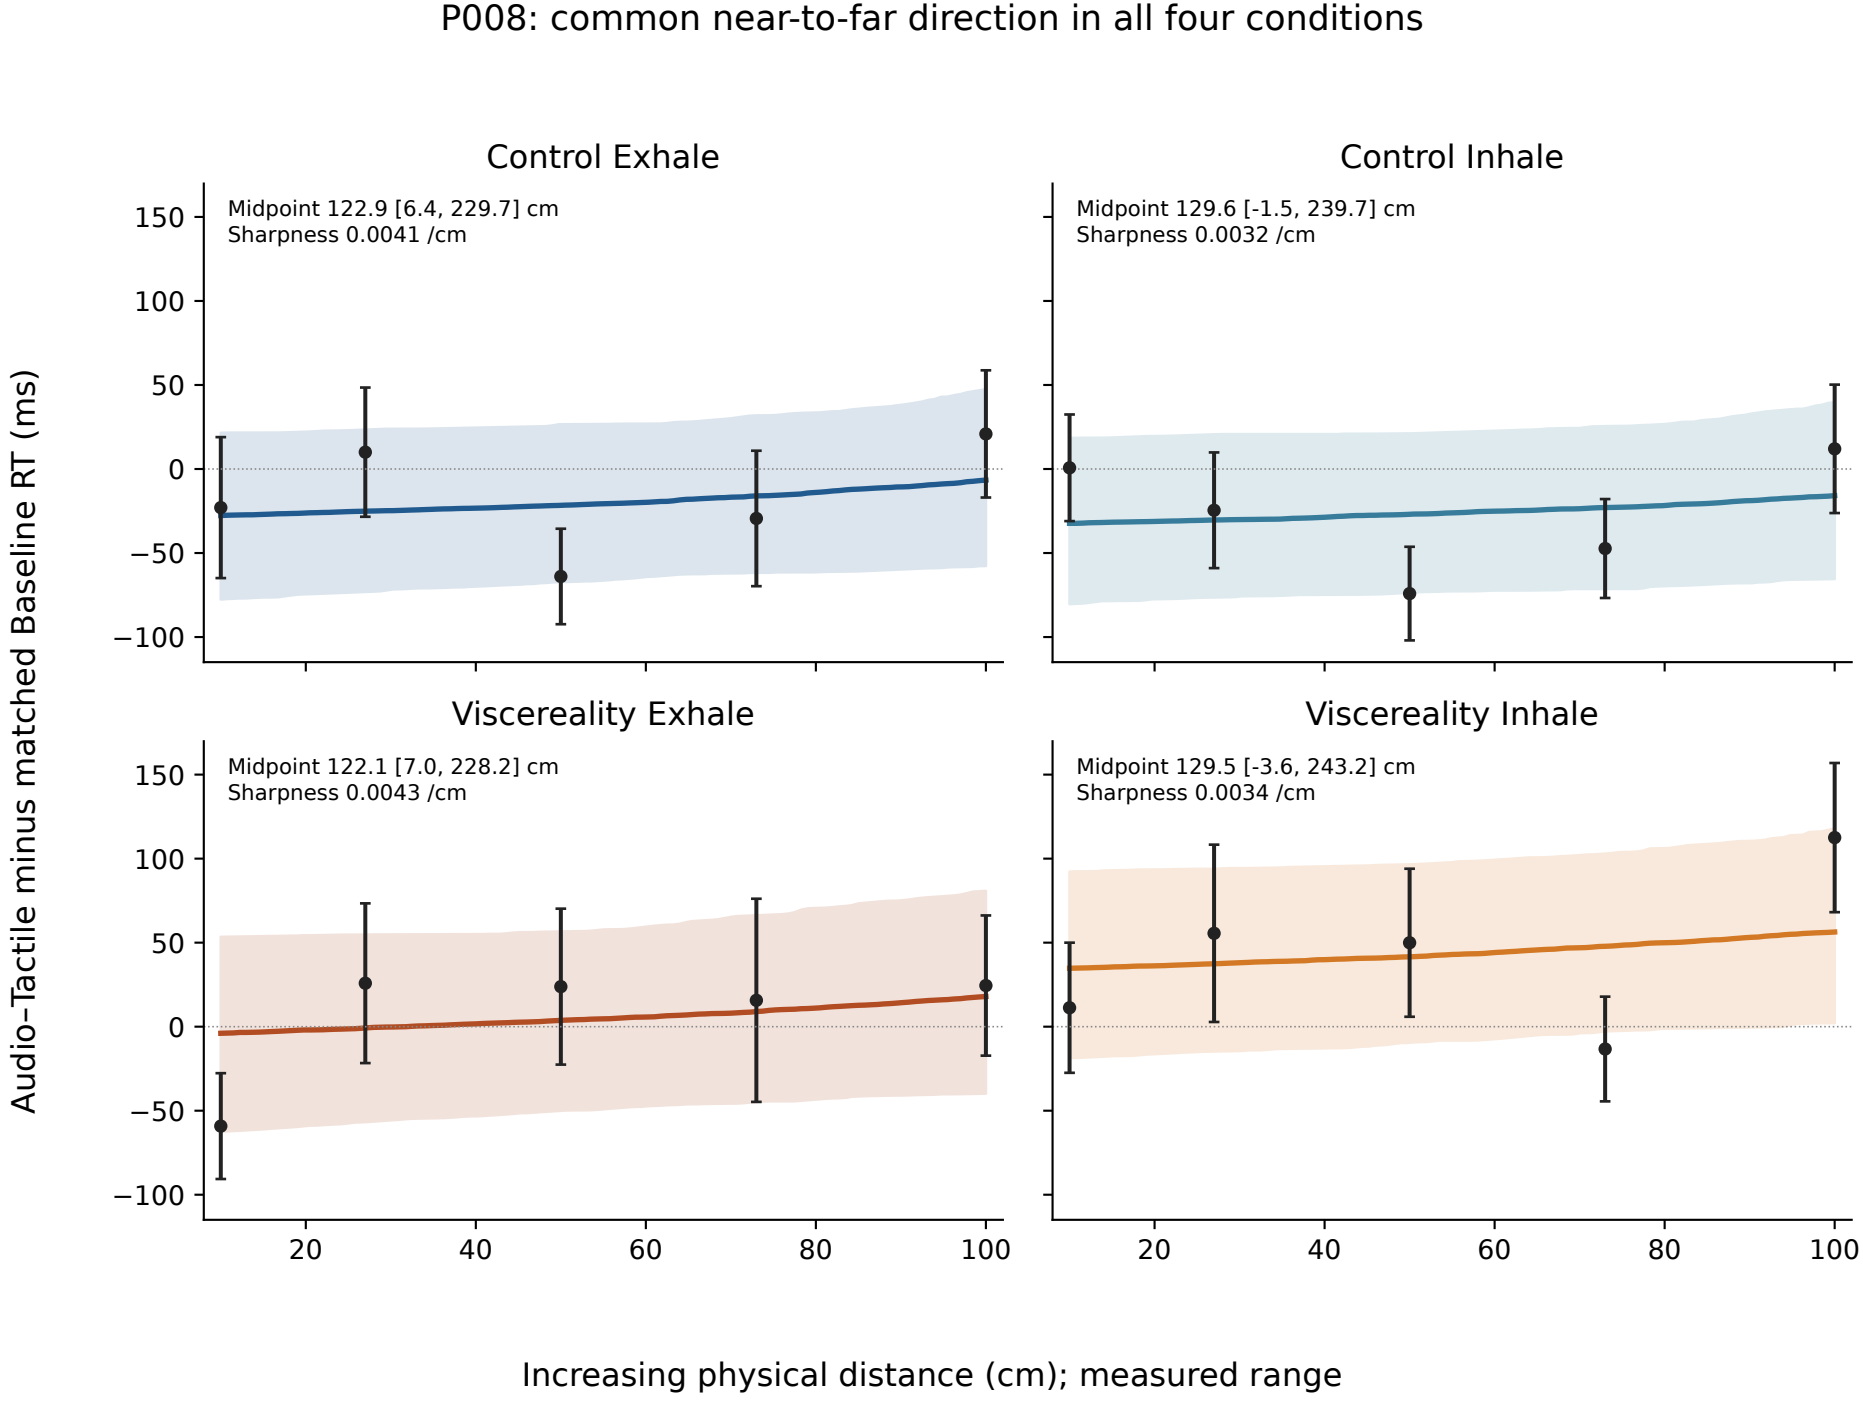

P003: common near-to-far direction in all four conditions
Control Exhale
Midpoint 123.4 [5.2, 241.0] cm
Sharpness 0.0038 /cm
Control Inhale
Midpoint 135.7 [-6.2, 252.6] cm
Sharpness 0.0029 /cm
Viscereality Exhale
Midpoint 128.7 [2.1, 243.1] cm
Sharpness 0.0040 /cm
Viscereality Inhale
Midpoint 143.4 [-7.0, 256.5] cm
Sharpness 0.0030 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
−100
−150
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

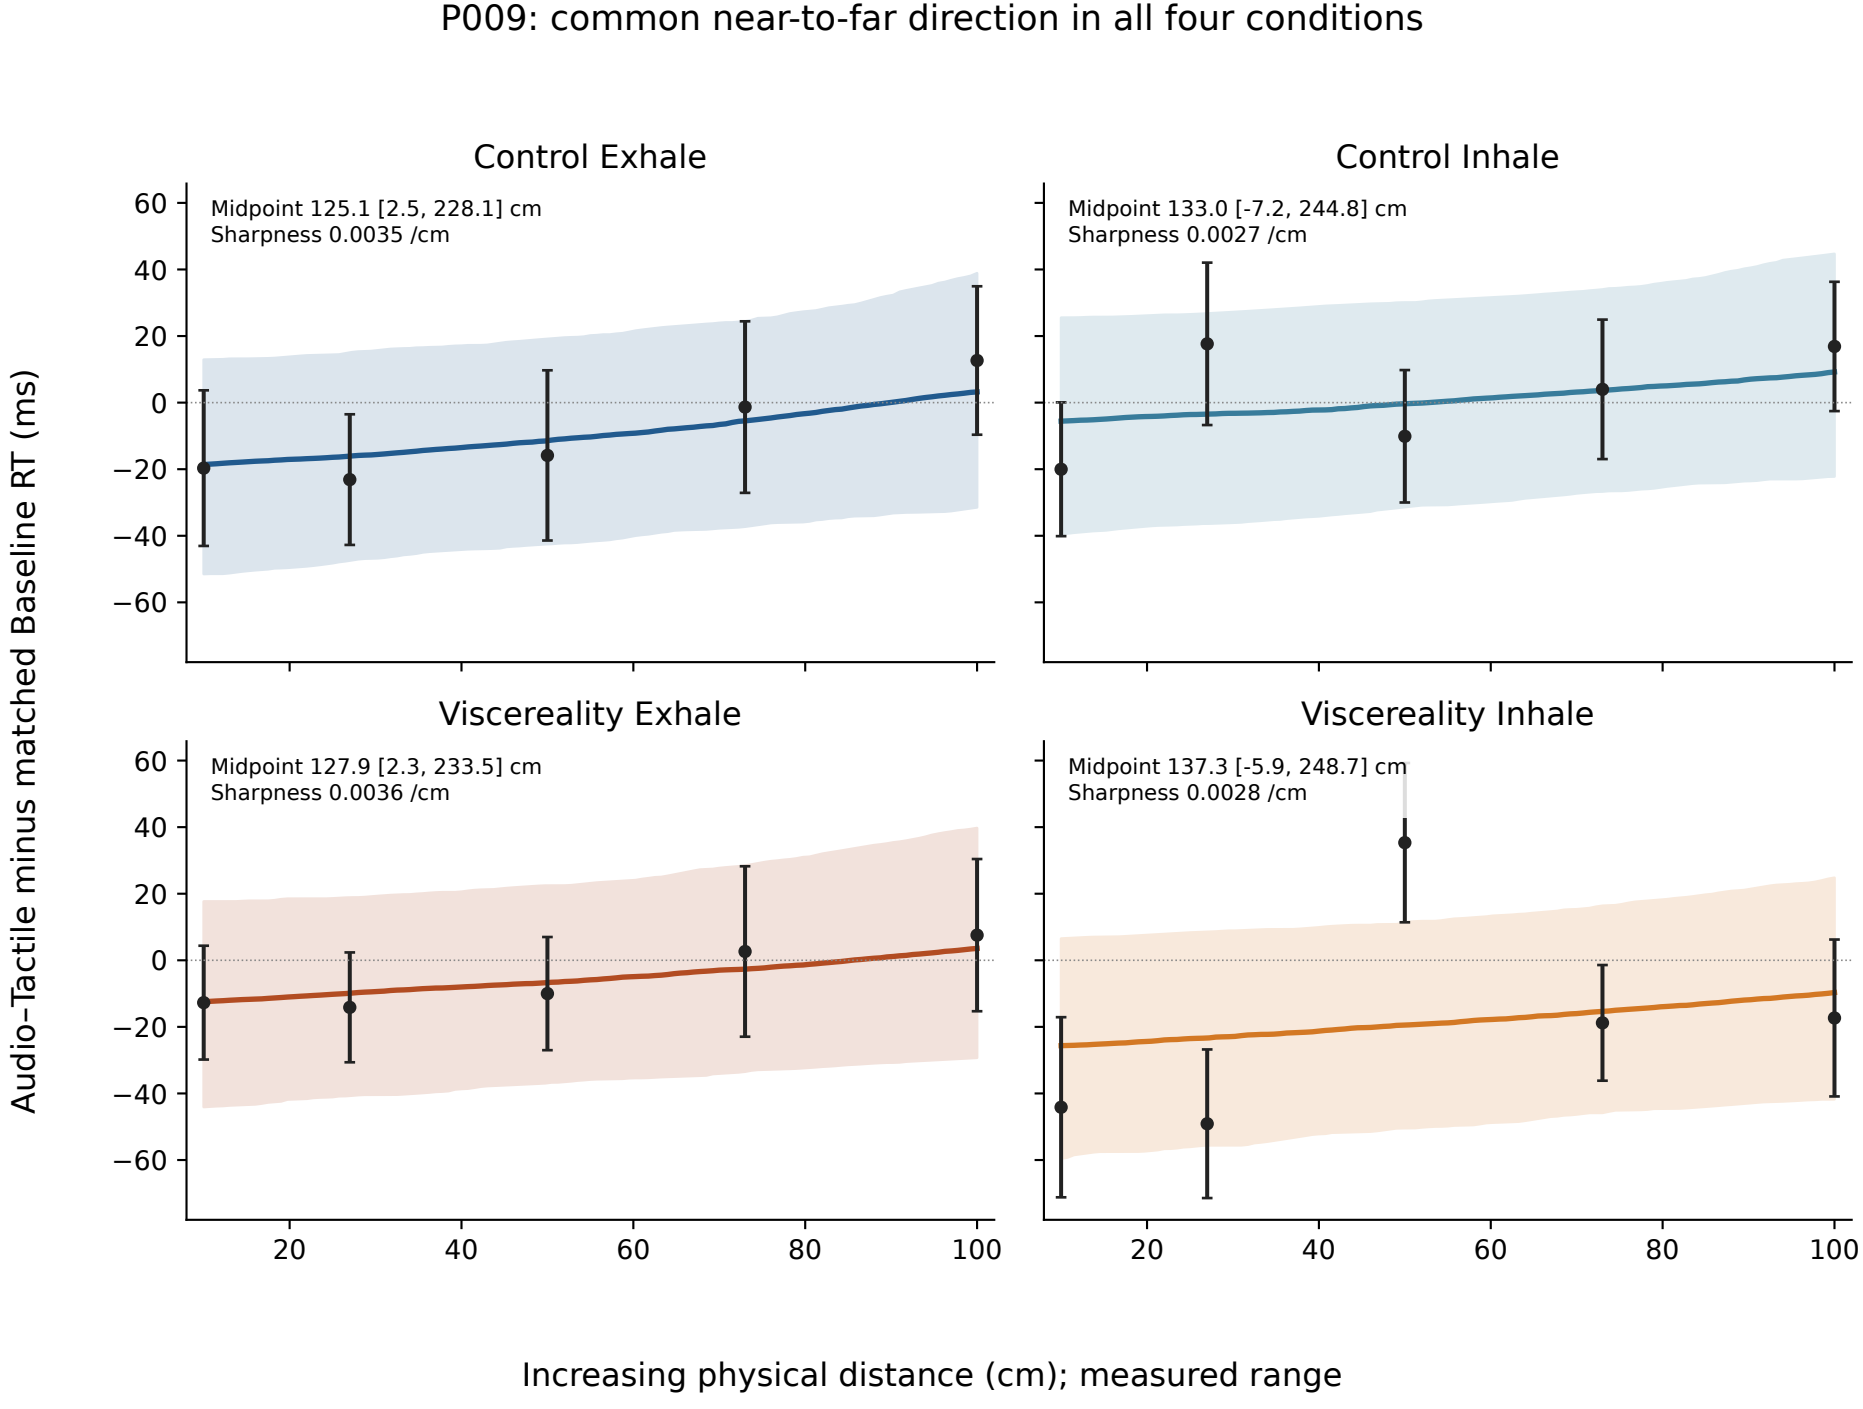

P004: common near-to-far direction in all four conditions
Control Exhale
Midpoint 97.6 [30.9, 154.6] cm
Sharpness 0.0057 /cm
Control Inhale
Midpoint 110.8 [14.3, 183.7] cm
Sharpness 0.0045 /cm
Viscereality Exhale
Midpoint 106.5 [20.5, 169.7] cm
Sharpness 0.0056 /cm
Viscereality Inhale
Midpoint 119.3 [5.1, 200.1] cm
Sharpness 0.0046 /cm
Audio–Tactile minus matched Baseline RT (ms)
40
20
0
−20
−40
−60
−80
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

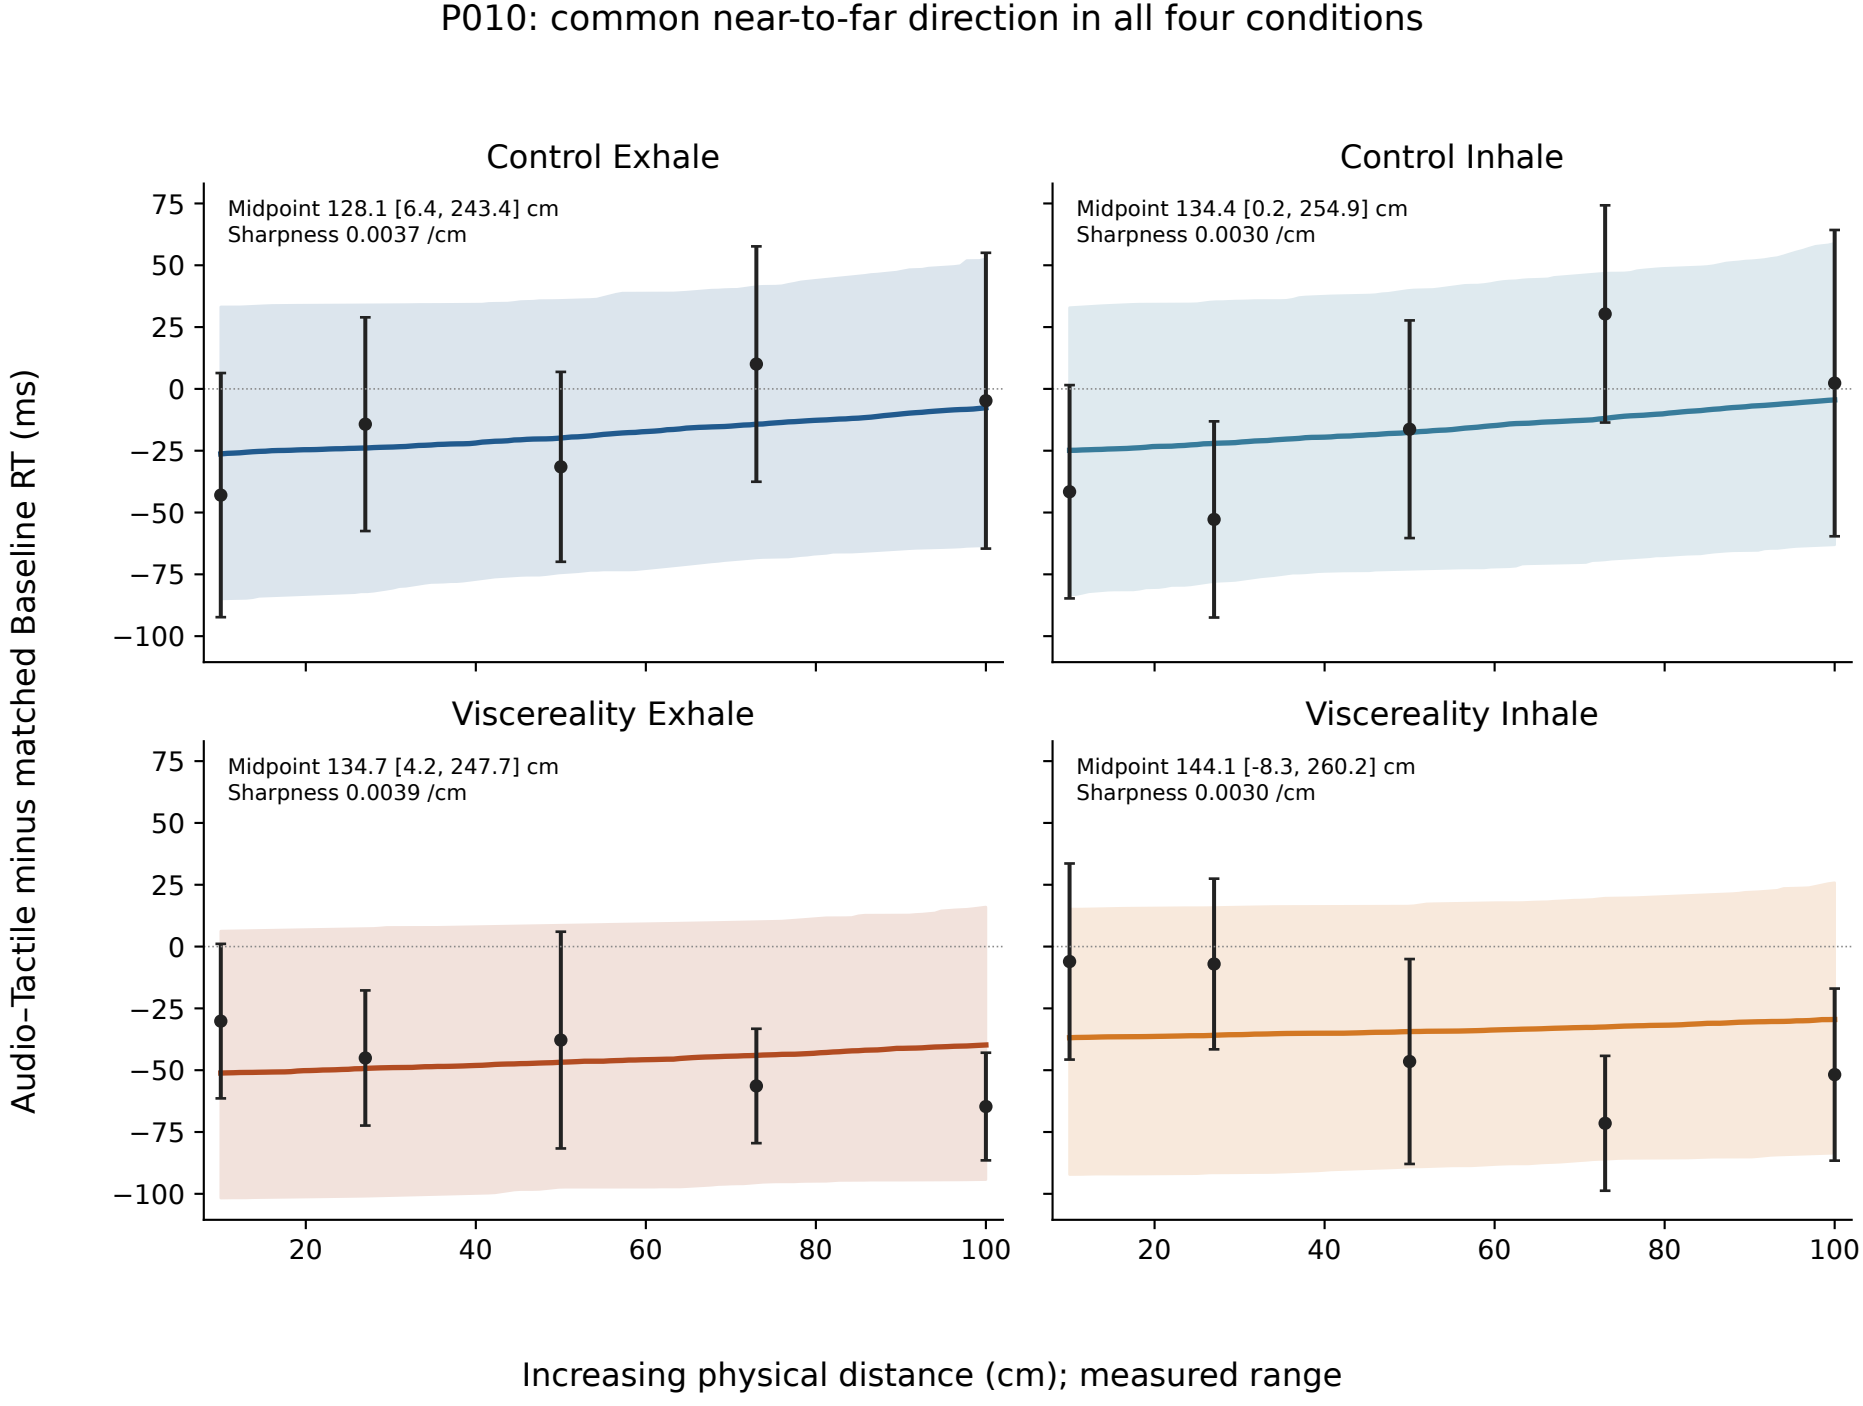

P005: common near-to-far direction in all four conditions
Control Exhale
Midpoint 137.5 [6.0, 256.9] cm
Sharpness 0.0035 /cm
Control Inhale
Midpoint 142.4 [0.2, 268.4] cm
Sharpness 0.0028 /cm
Viscereality Exhale
Midpoint 138.2 [10.8, 255.4] cm
Sharpness 0.0036 /cm
Viscereality Inhale
Midpoint 147.3 [-0.8, 268.4] cm
Sharpness 0.0029 /cm
Audio–Tactile minus matched Baseline RT (ms)
40
20
0
−20
−40
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

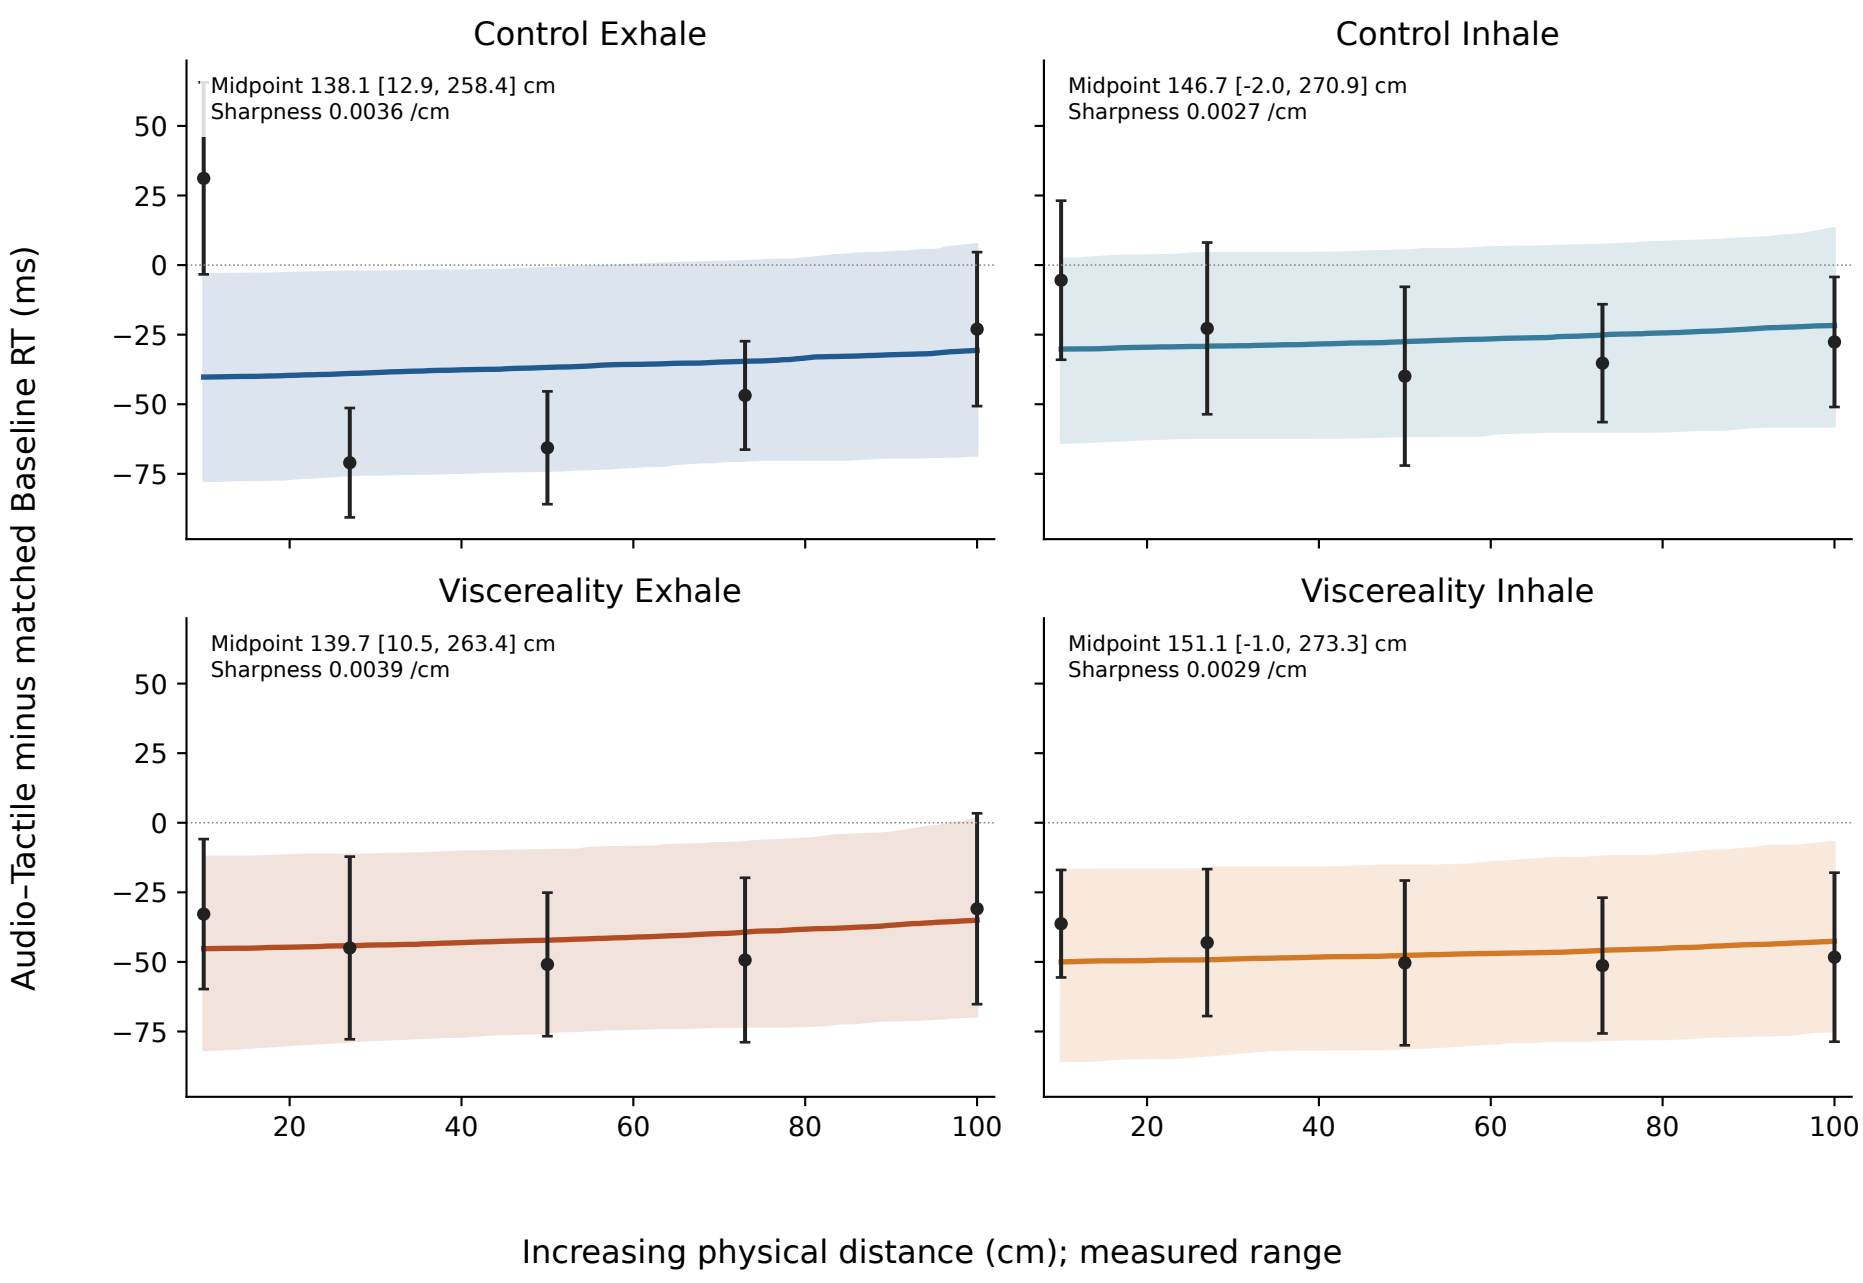

P006: common near-to-far direction in all four conditions
Control Exhale
Midpoint 141.1 [14.4, 269.2] cm
Sharpness 0.0034 /cm
Control Inhale
Midpoint 148.2 [0.1, 279.4] cm
Sharpness 0.0026 /cm
Viscereality Exhale
Midpoint 143.4 [10.1, 273.9] cm
Sharpness 0.0036 /cm
Viscereality Inhale
Midpoint 154.2 [-4.2, 284.0] cm
Sharpness 0.0027 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
−100
−150
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

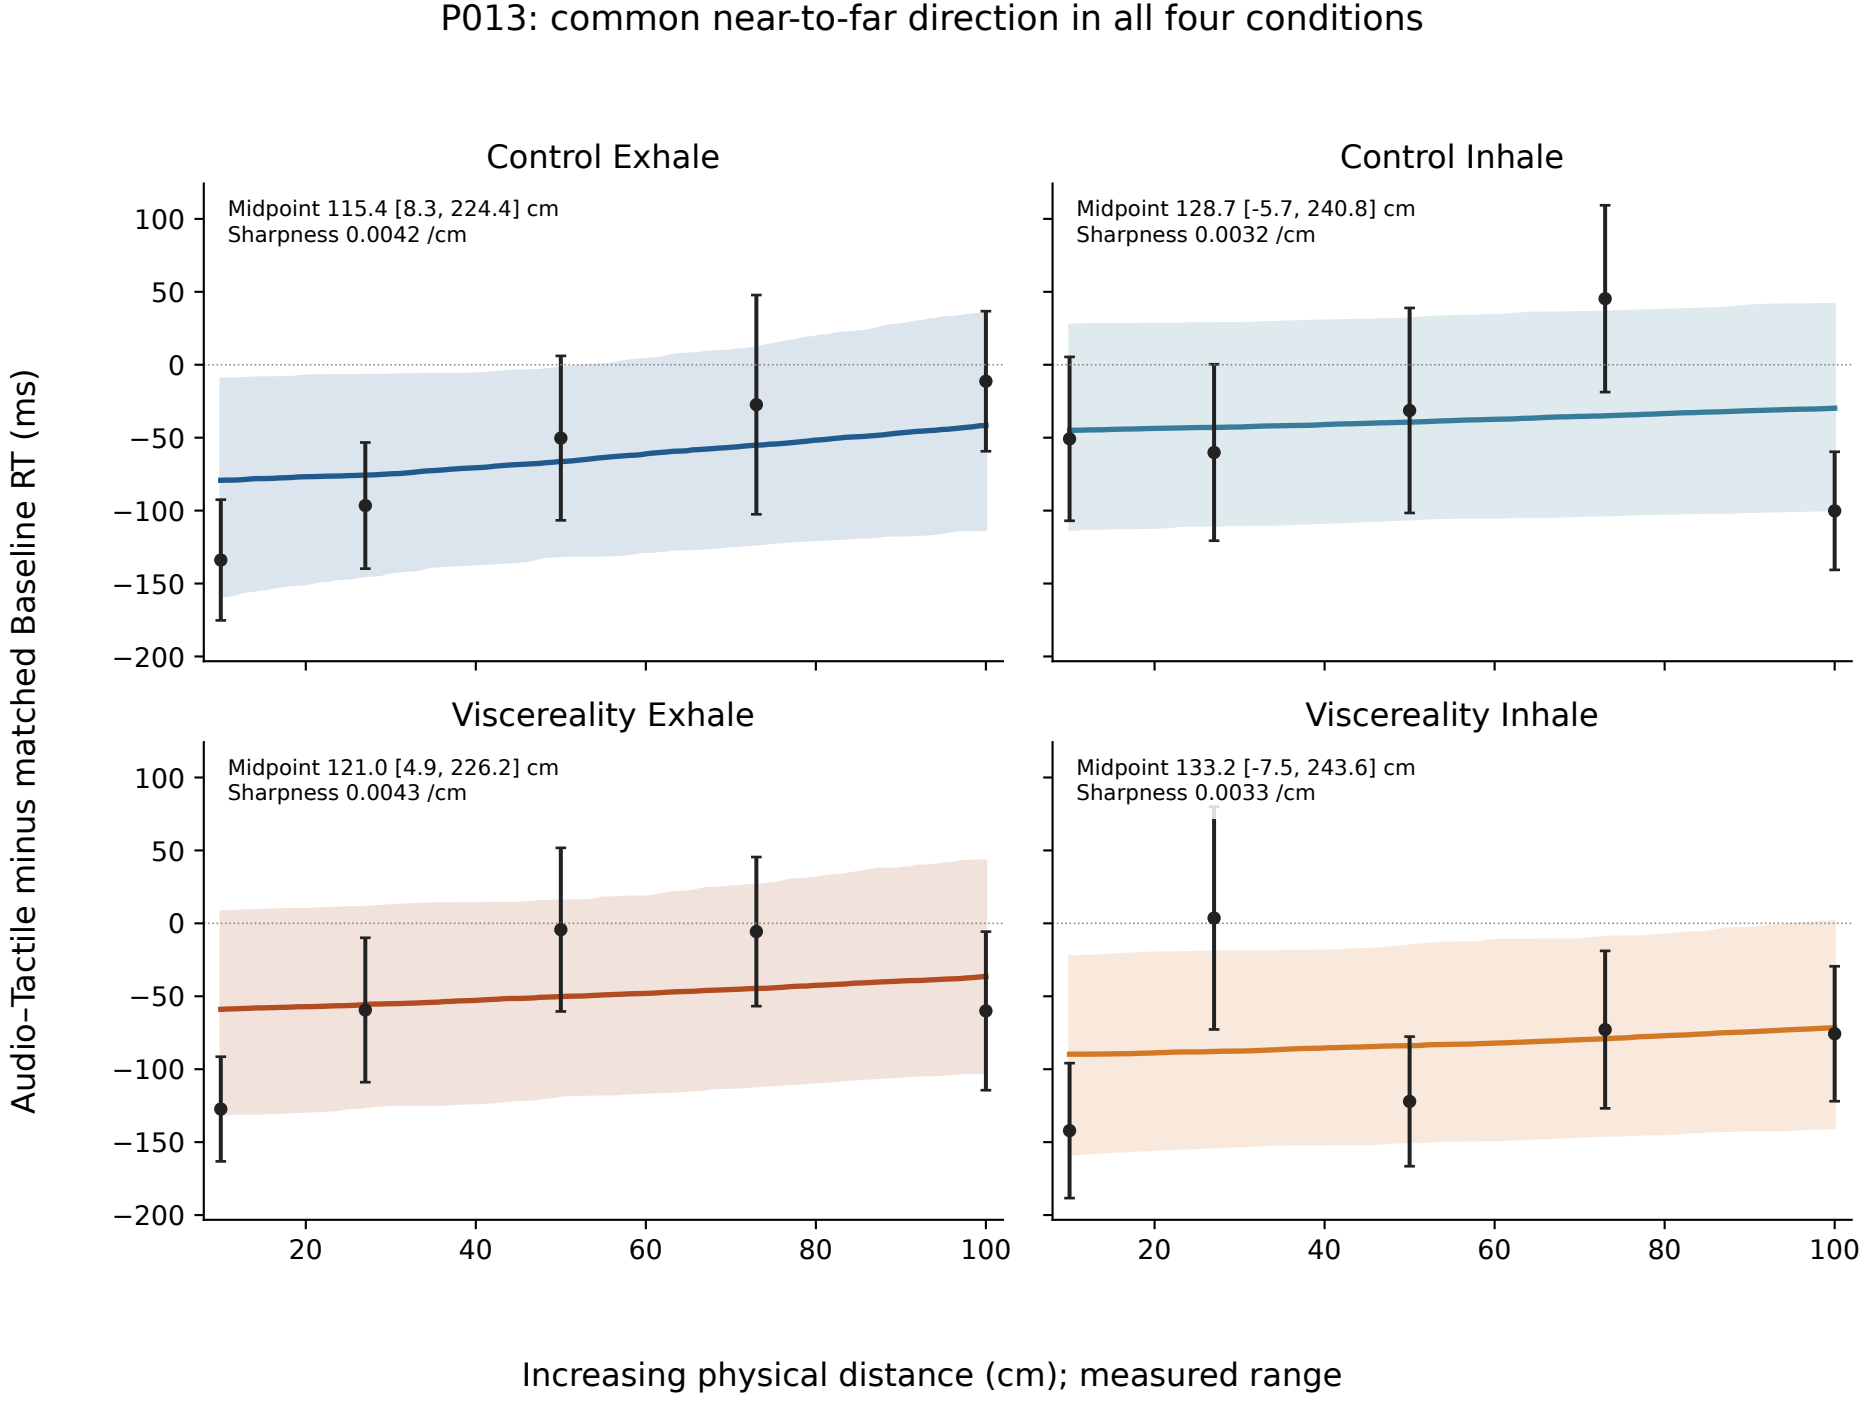

P007: common near-to-far direction in all four conditions
Control Exhale
Midpoint 136.3 [4.8, 258.3] cm
Sharpness 0.0035 /cm
Control Inhale
Midpoint 144.6 [-3.6, 271.0] cm
Sharpness 0.0027 /cm
Viscereality Exhale
Midpoint 133.6 [9.8, 260.4] cm
Sharpness 0.0039 /cm
Viscereality Inhale
Midpoint 145.2 [-4.5, 274.0] cm
Sharpness 0.0029 /cm
Audio–Tactile minus matched Baseline RT (ms)
50
0
−50
−100
−150
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

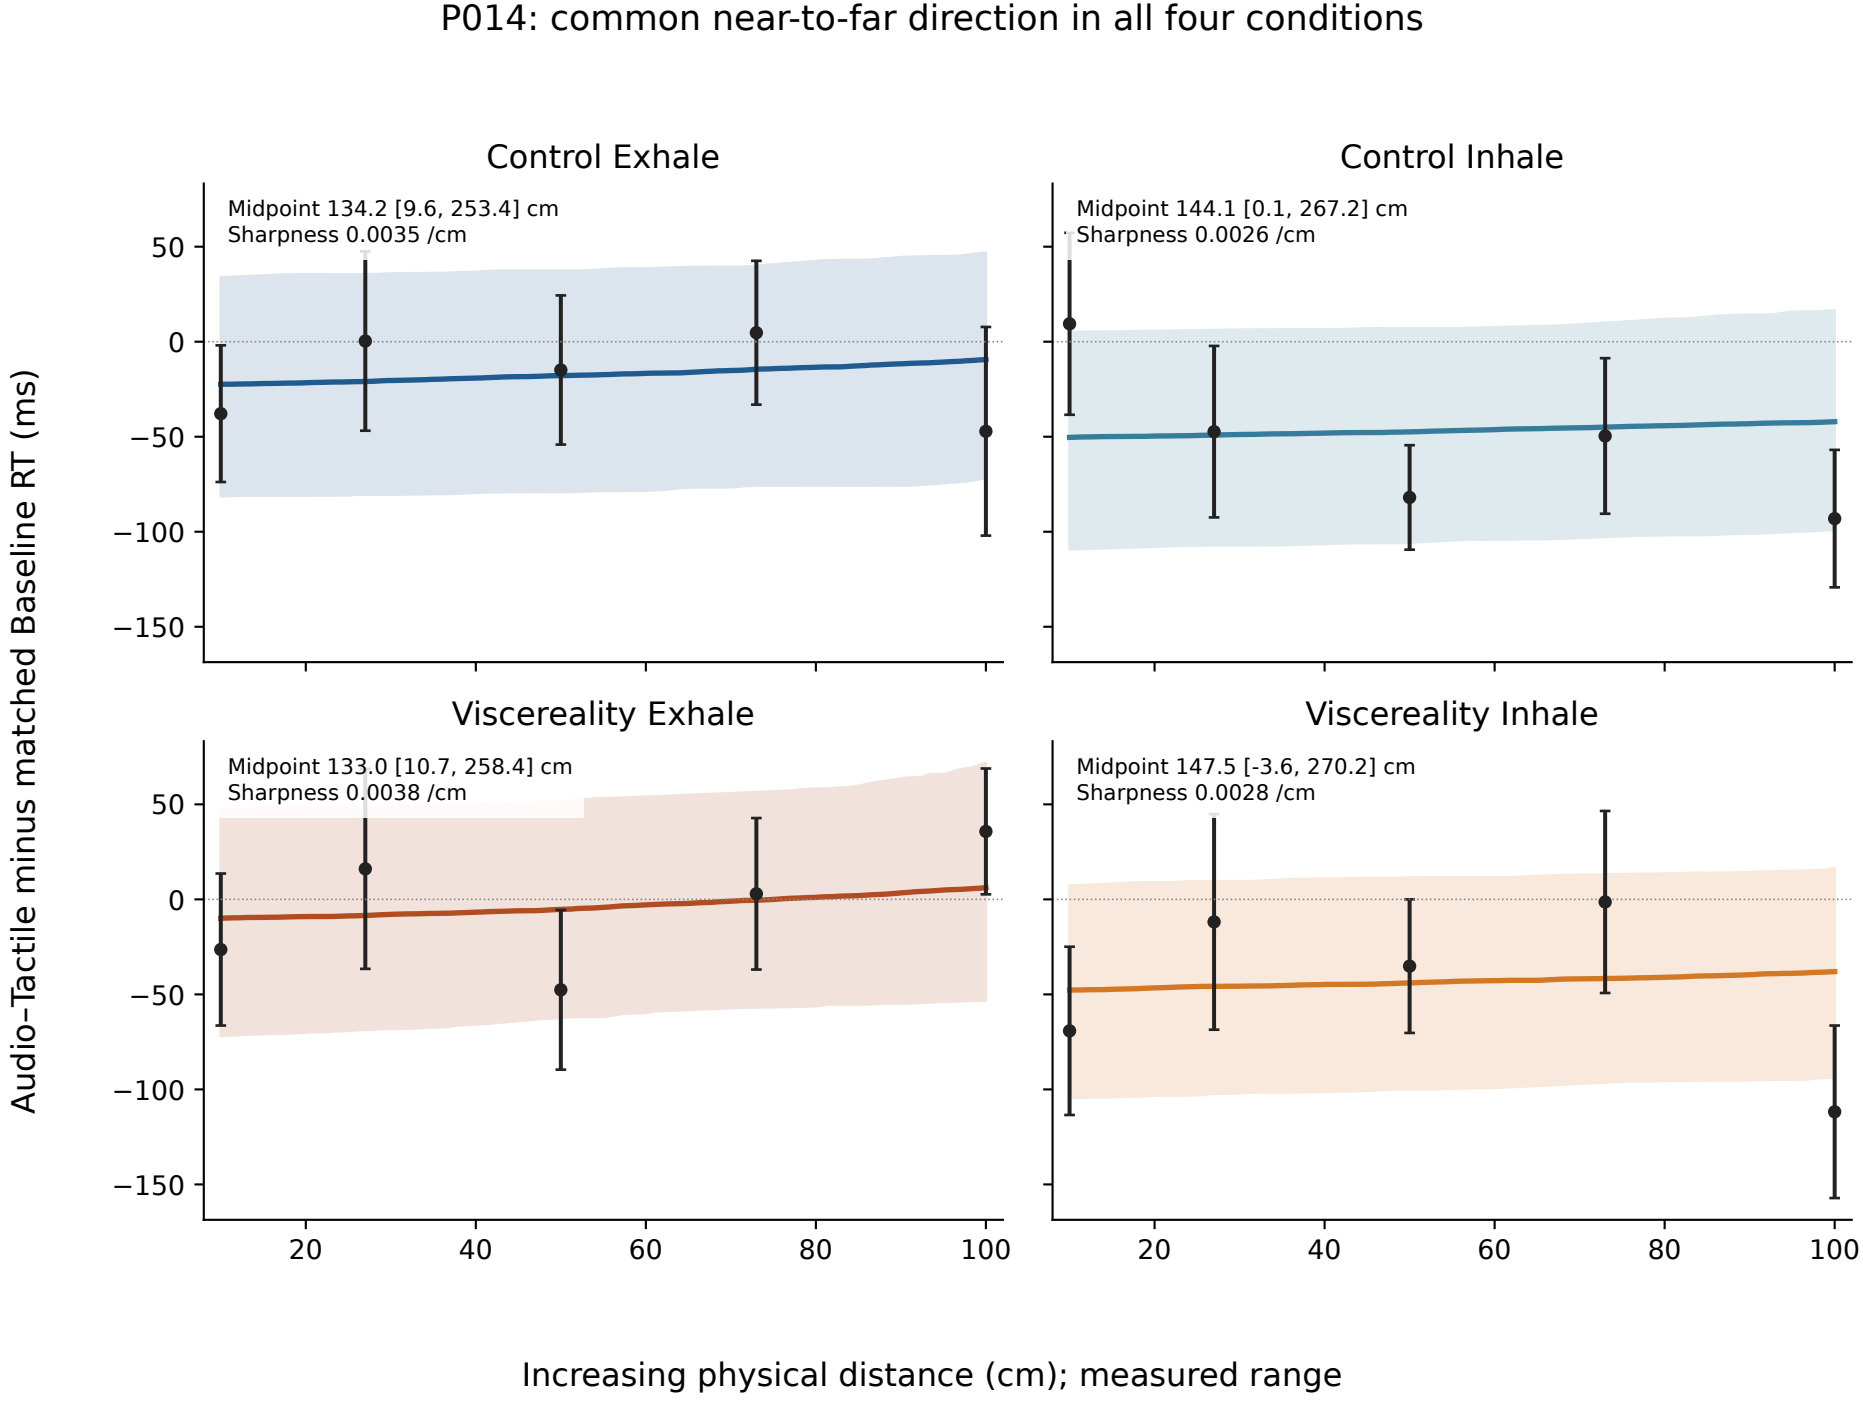

P008: common near-to-far direction in all four conditions
Control Exhale
Midpoint 122.9 [6.4, 229.7] cm
Sharpness 0.0041 /cm
Control Inhale
Midpoint 129.6 [-1.5, 239.7] cm
Sharpness 0.0032 /cm
Viscereality Exhale
Midpoint 122.1 [7.0, 228.2] cm
Sharpness 0.0043 /cm
Viscereality Inhale
Midpoint 129.5 [-3.6, 243.2] cm
Sharpness 0.0034 /cm
Audio–Tactile minus matched Baseline RT (ms)
150
100
50
0
−50
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

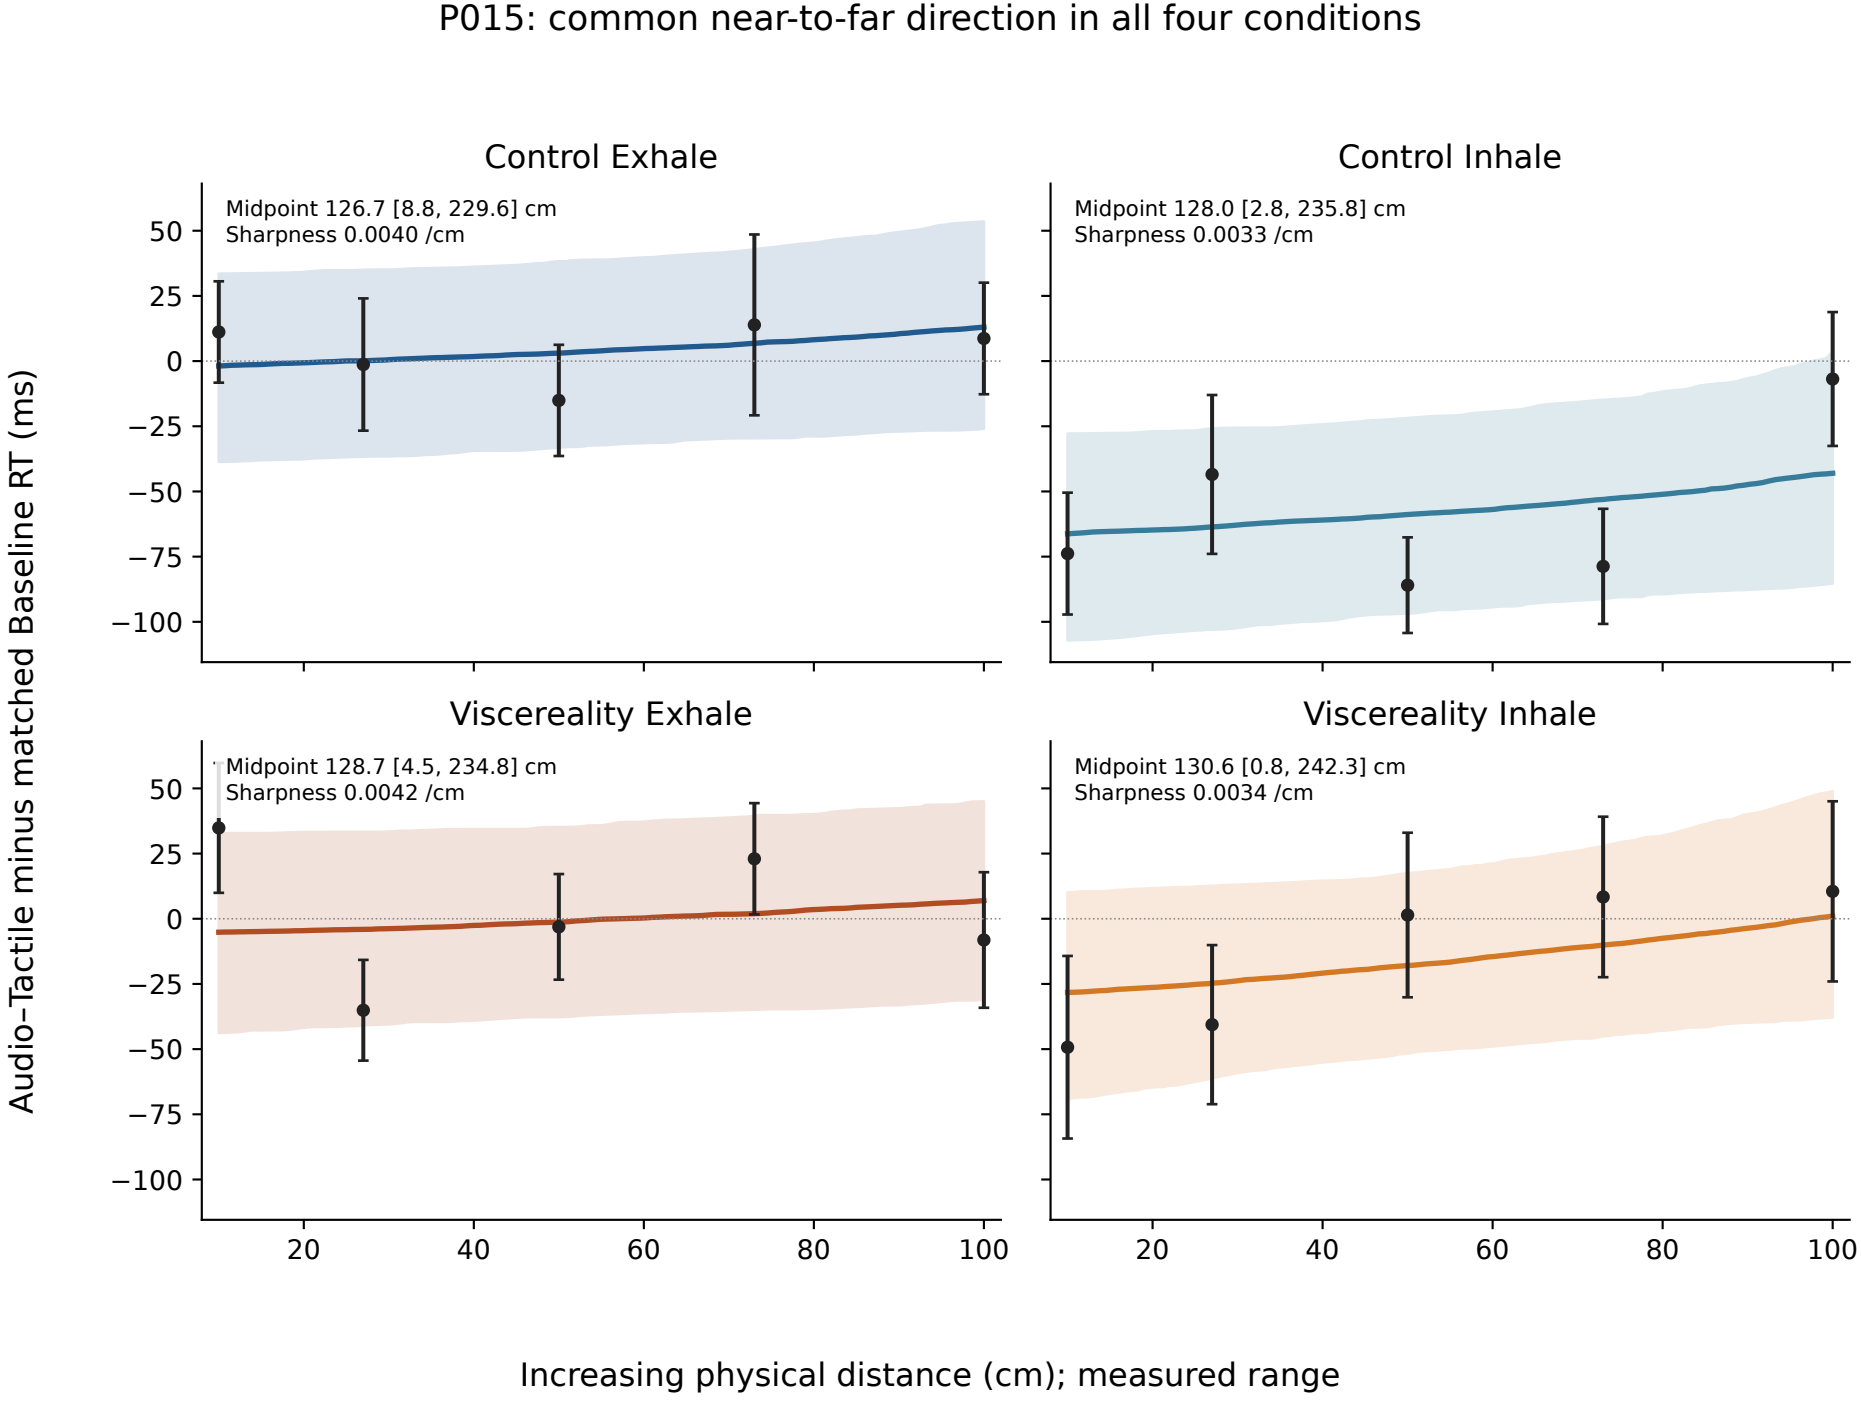

P009: common near-to-far direction in all four conditions
Control Exhale
Midpoint 125.1 [2.5, 228.1] cm
Sharpness 0.0035 /cm
Control Inhale
Midpoint 133.0 [-7.2, 244.8] cm
Sharpness 0.0027 /cm
Viscereality Exhale
Midpoint 127.9 [2.3, 233.5] cm
Sharpness 0.0036 /cm
Viscereality Inhale
Midpoint 137.3 [-5.9, 248.7] cm
Sharpness 0.0028 /cm
Audio–Tactile minus matched Baseline RT (ms)
60
40
20
0
−20
−40
−60
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

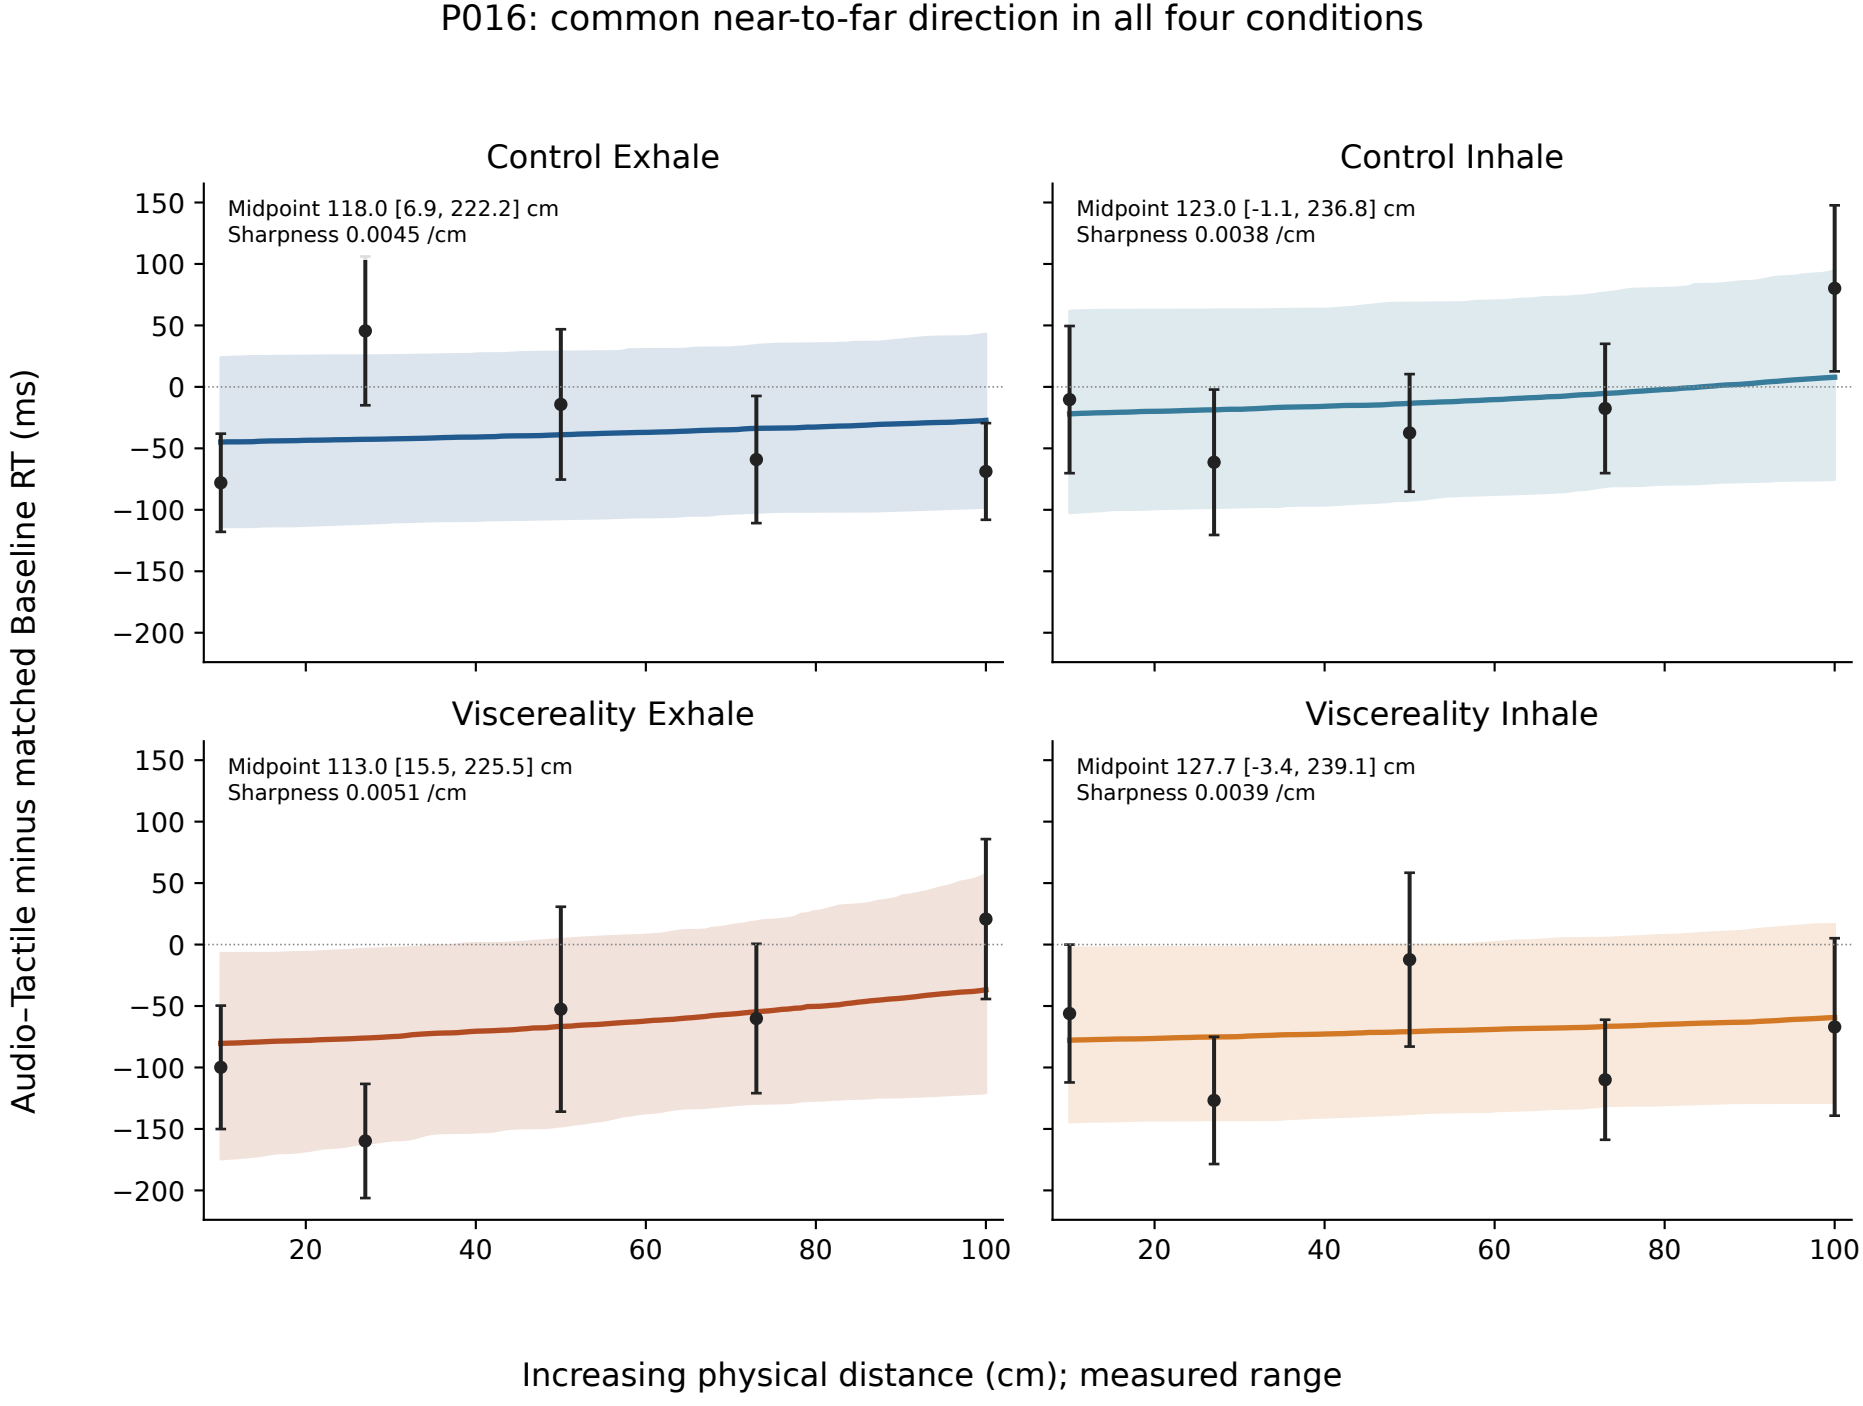

P010: common near-to-far direction in all four conditions
Control Exhale
Midpoint 128.1 [6.4, 243.4] cm
Sharpness 0.0037 /cm
Control Inhale
Midpoint 134.4 [0.2, 254.9] cm
Sharpness 0.0030 /cm
Viscereality Exhale
Midpoint 134.7 [4.2, 247.7] cm
Sharpness 0.0039 /cm
Viscereality Inhale
Midpoint 144.1 [-8.3, 260.2] cm
Sharpness 0.0030 /cm
Audio–Tactile minus matched Baseline RT (ms)
75
50
25
0
−25
−50
−75
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

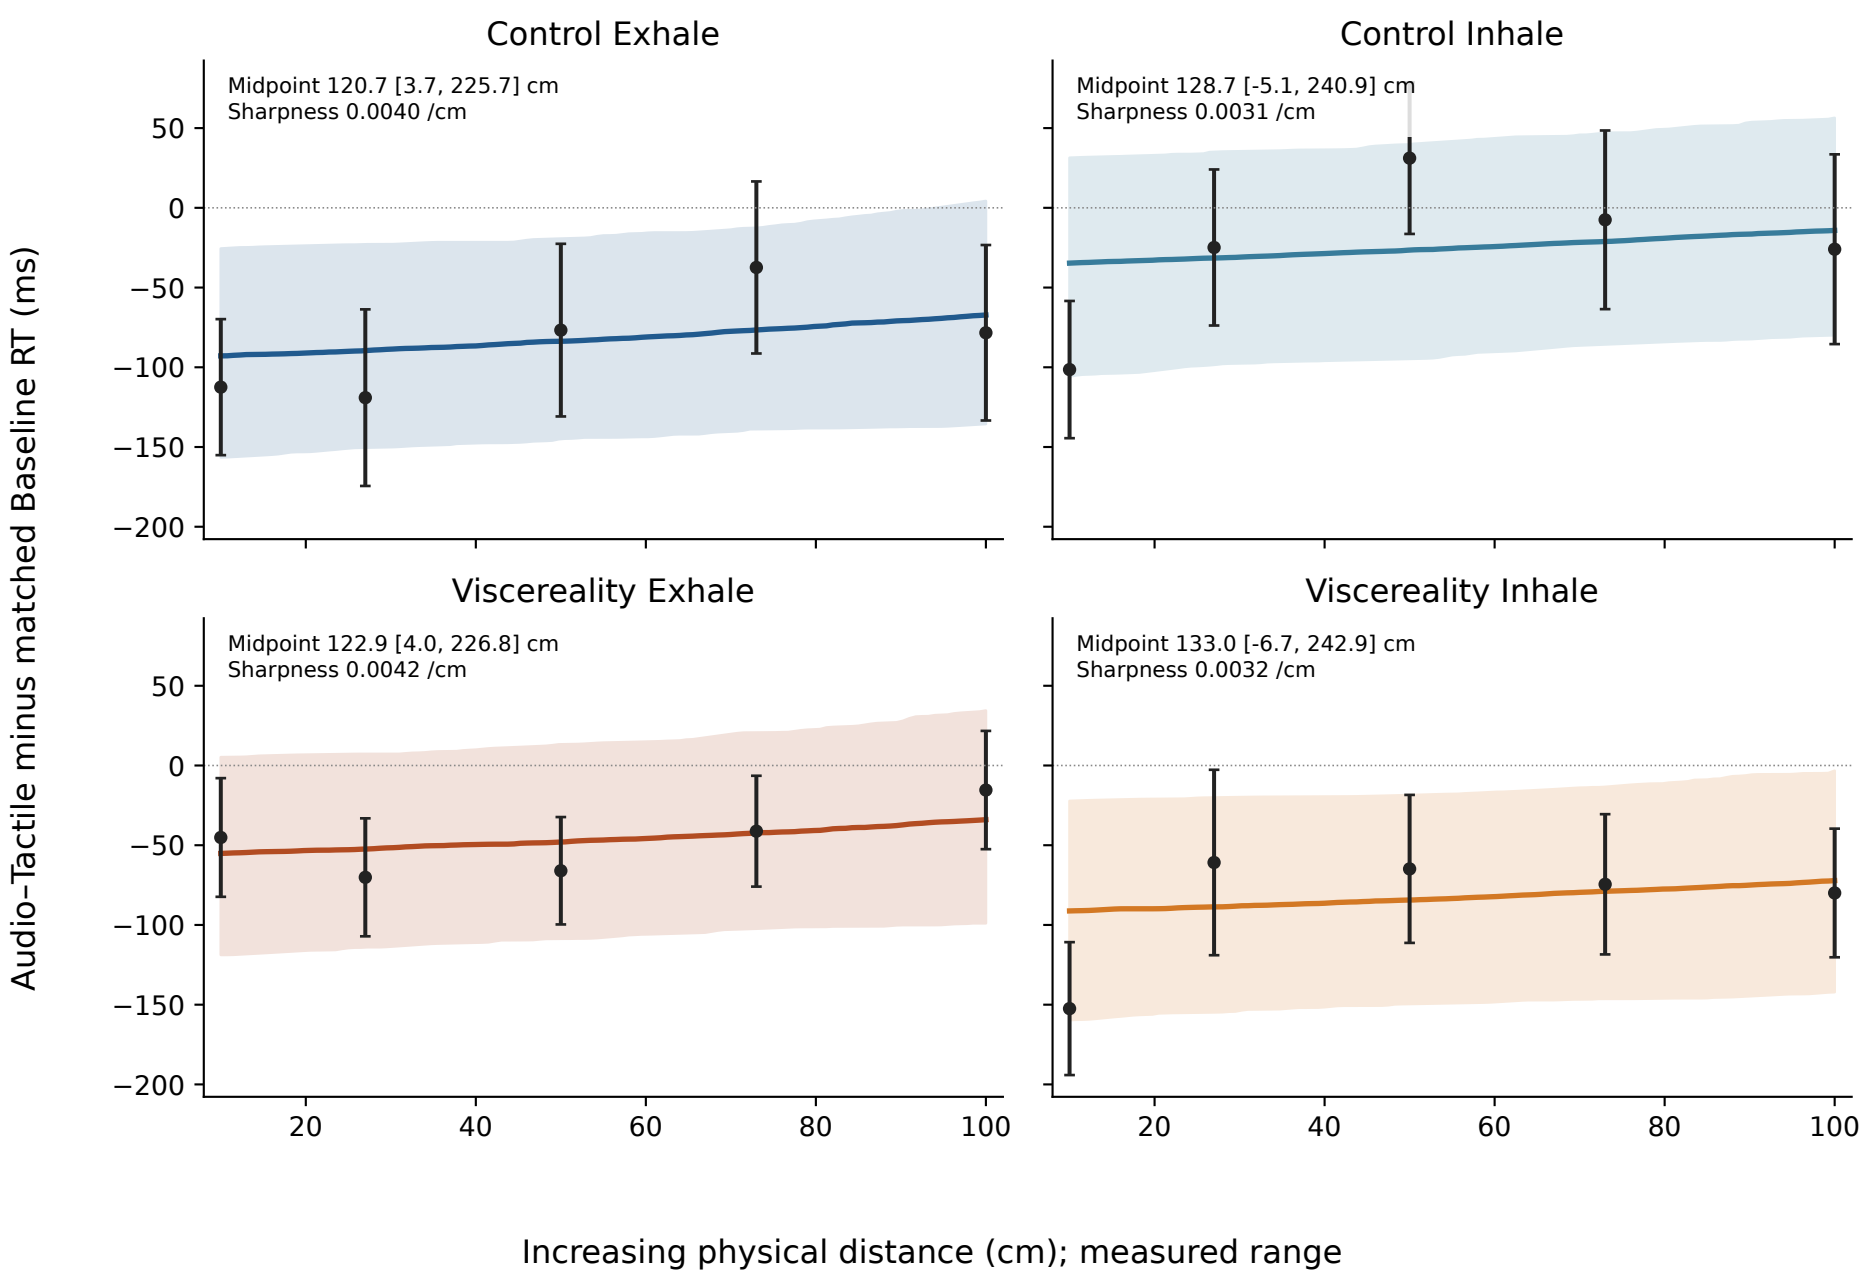

P012: common near-to-far direction in all four conditions
Control Exhale
Midpoint 138.1 [12.9, 258.4] cm
Sharpness 0.0036 /cm
Control Inhale
Midpoint 146.7 [-2.0, 270.9] cm
Sharpness 0.0027 /cm
Viscereality Exhale
Midpoint 139.7 [10.5, 263.4] cm
Sharpness 0.0039 /cm
Viscereality Inhale
Midpoint 151.1 [-1.0, 273.3] cm
Sharpness 0.0029 /cm
Audio–Tactile minus matched Baseline RT (ms)
50
25
0
−25
−50
−75
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

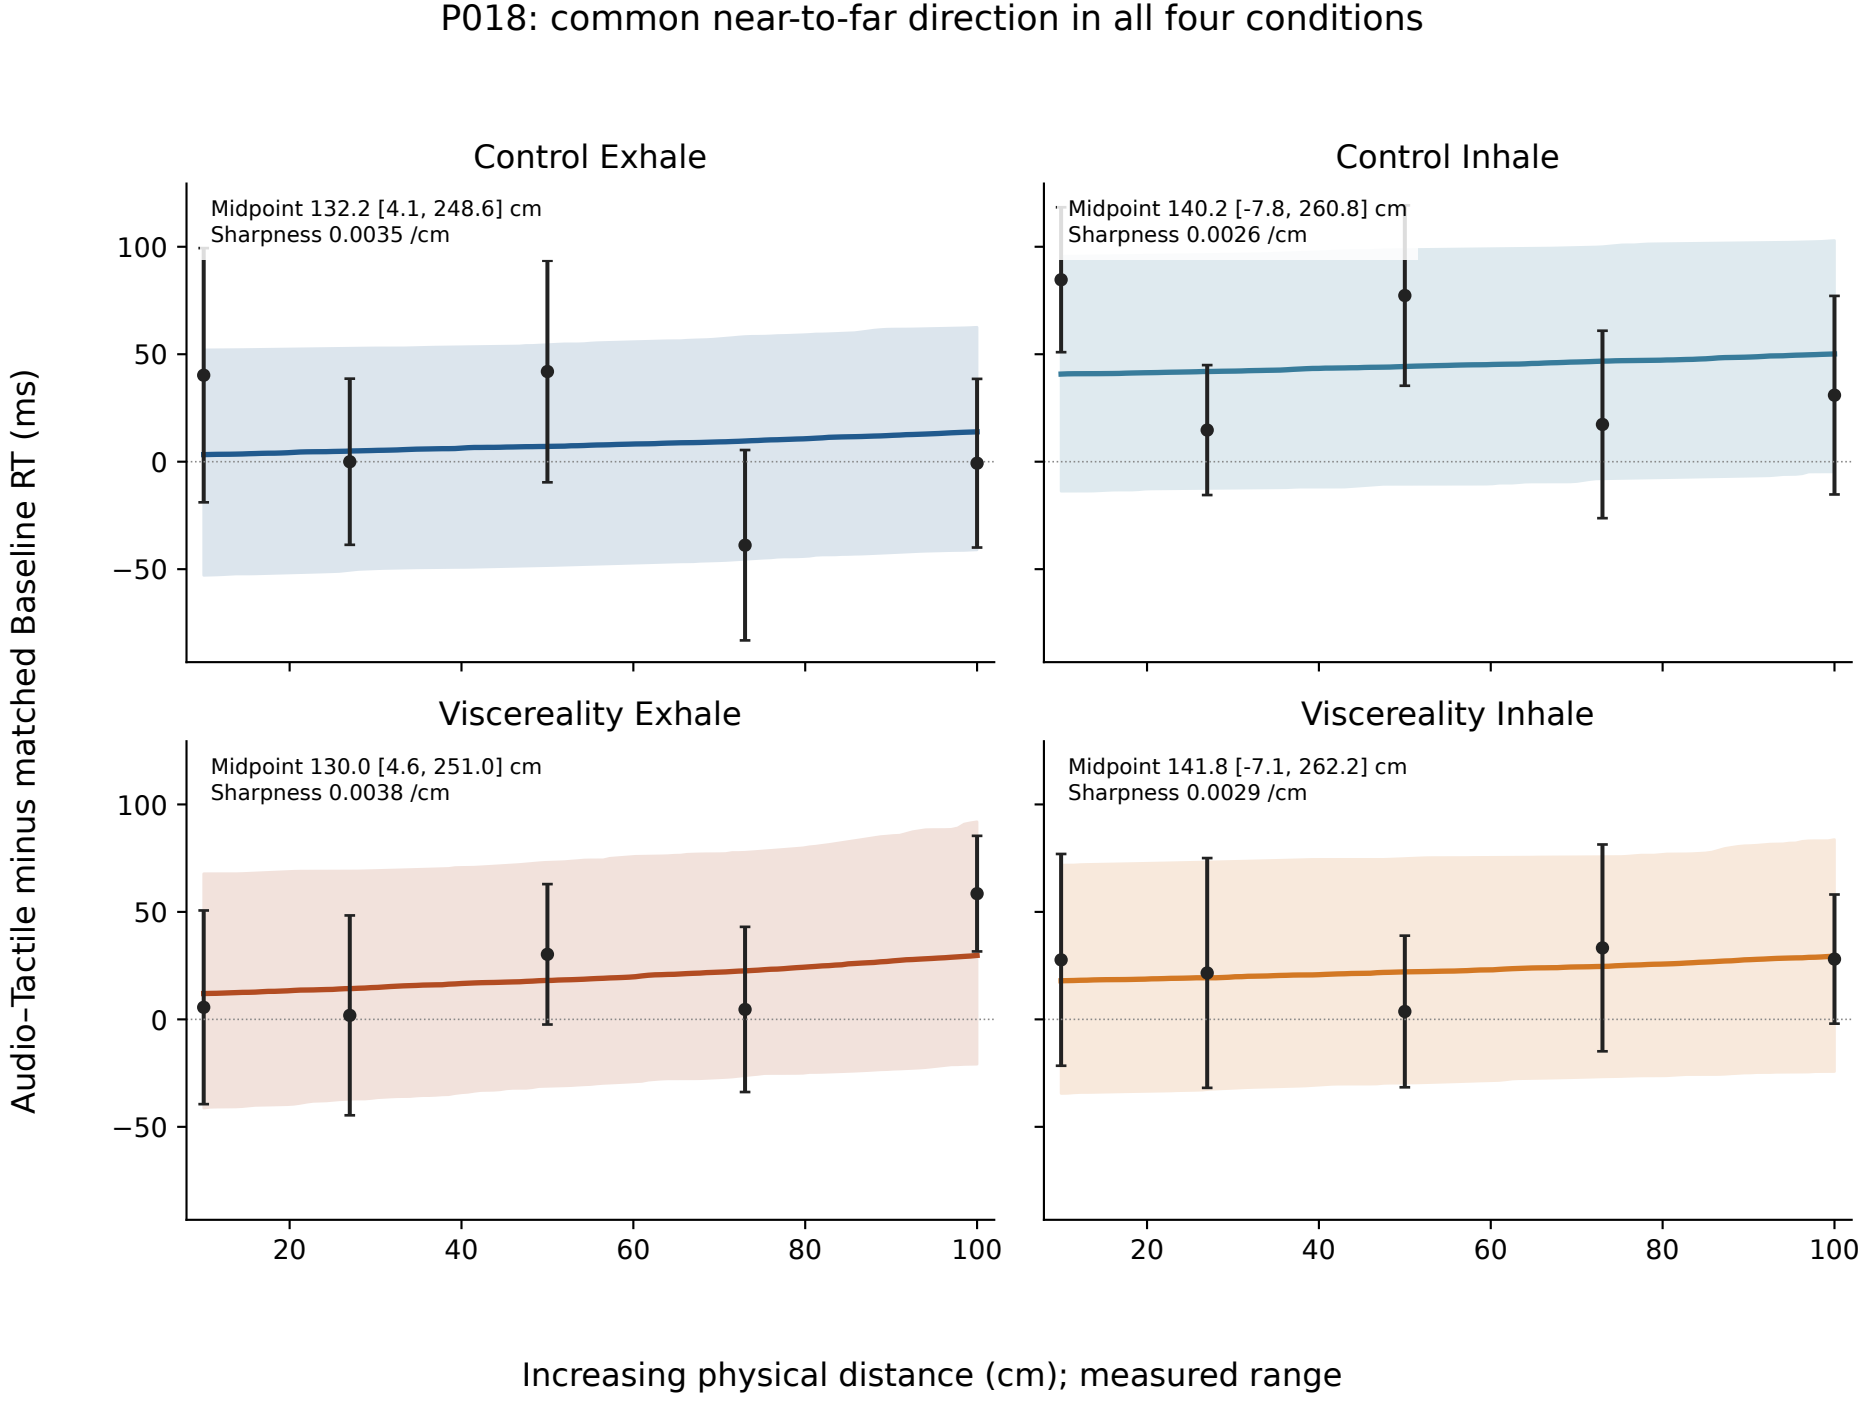

P013: common near-to-far direction in all four conditions
Control Exhale
Midpoint 115.4 [8.3, 224.4] cm
Sharpness 0.0042 /cm
Control Inhale
Midpoint 128.7 [-5.7, 240.8] cm
Sharpness 0.0032 /cm
Viscereality Exhale
Midpoint 121.0 [4.9, 226.2] cm
Sharpness 0.0043 /cm
Viscereality Inhale
Midpoint 133.2 [-7.5, 243.6] cm
Sharpness 0.0033 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
−100
−150
−200
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

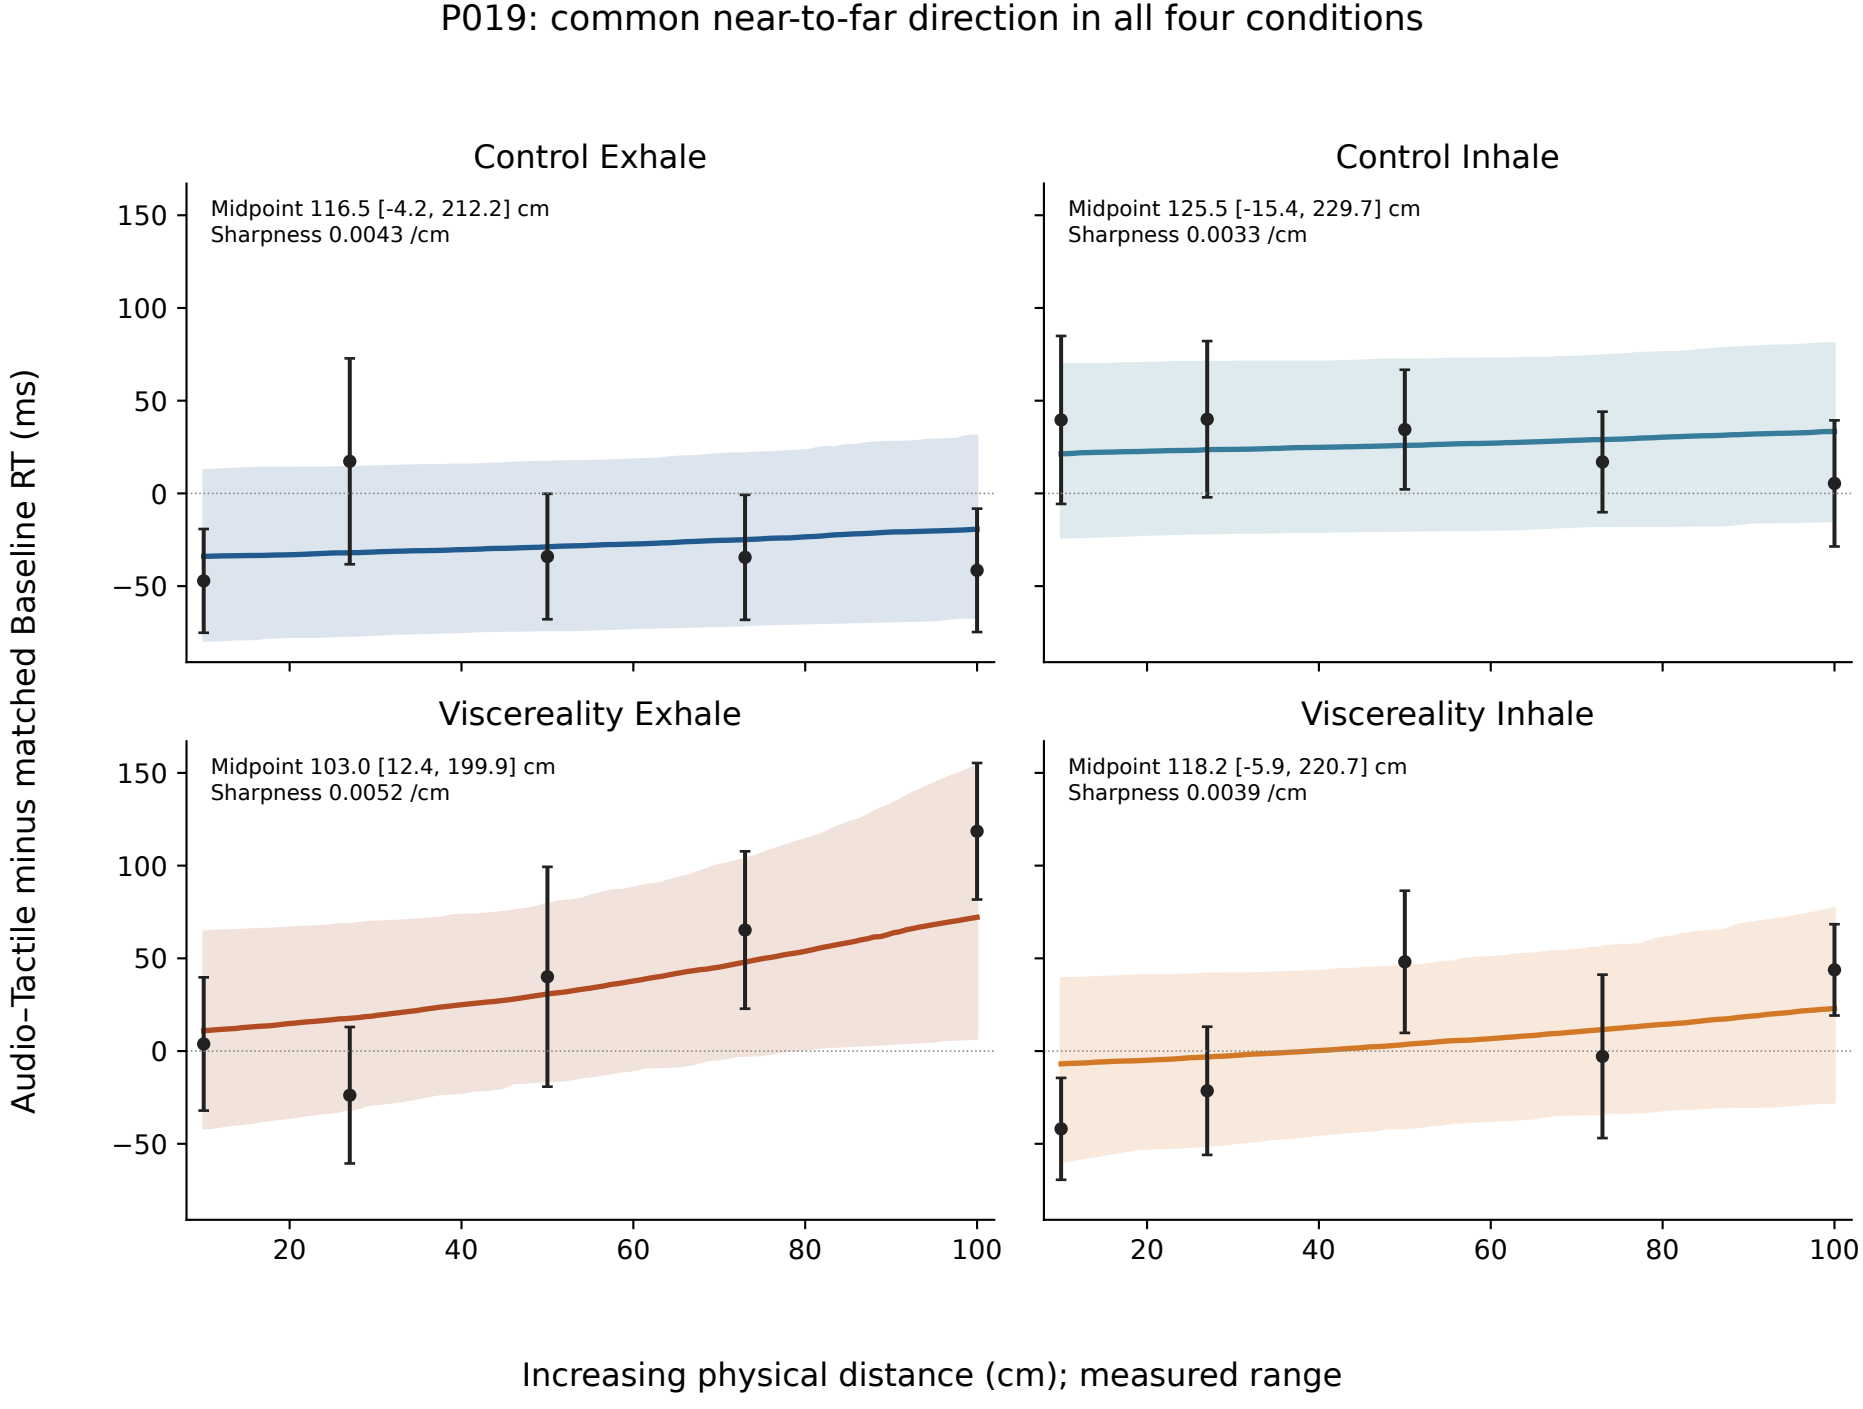

P014: common near-to-far direction in all four conditions
Control Exhale
Midpoint 134.2 [9.6, 253.4] cm
Sharpness 0.0035 /cm
Control Inhale
Midpoint 144.1 [0.1, 267.2] cm
Sharpness 0.0026 /cm
Viscereality Exhale
Midpoint 133.0 [10.7, 258.4] cm
Sharpness 0.0038 /cm
Viscereality Inhale
Midpoint 147.5 [-3.6, 270.2] cm
Sharpness 0.0028 /cm
Audio–Tactile minus matched Baseline RT (ms)
50
0
−50
−100
−150
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

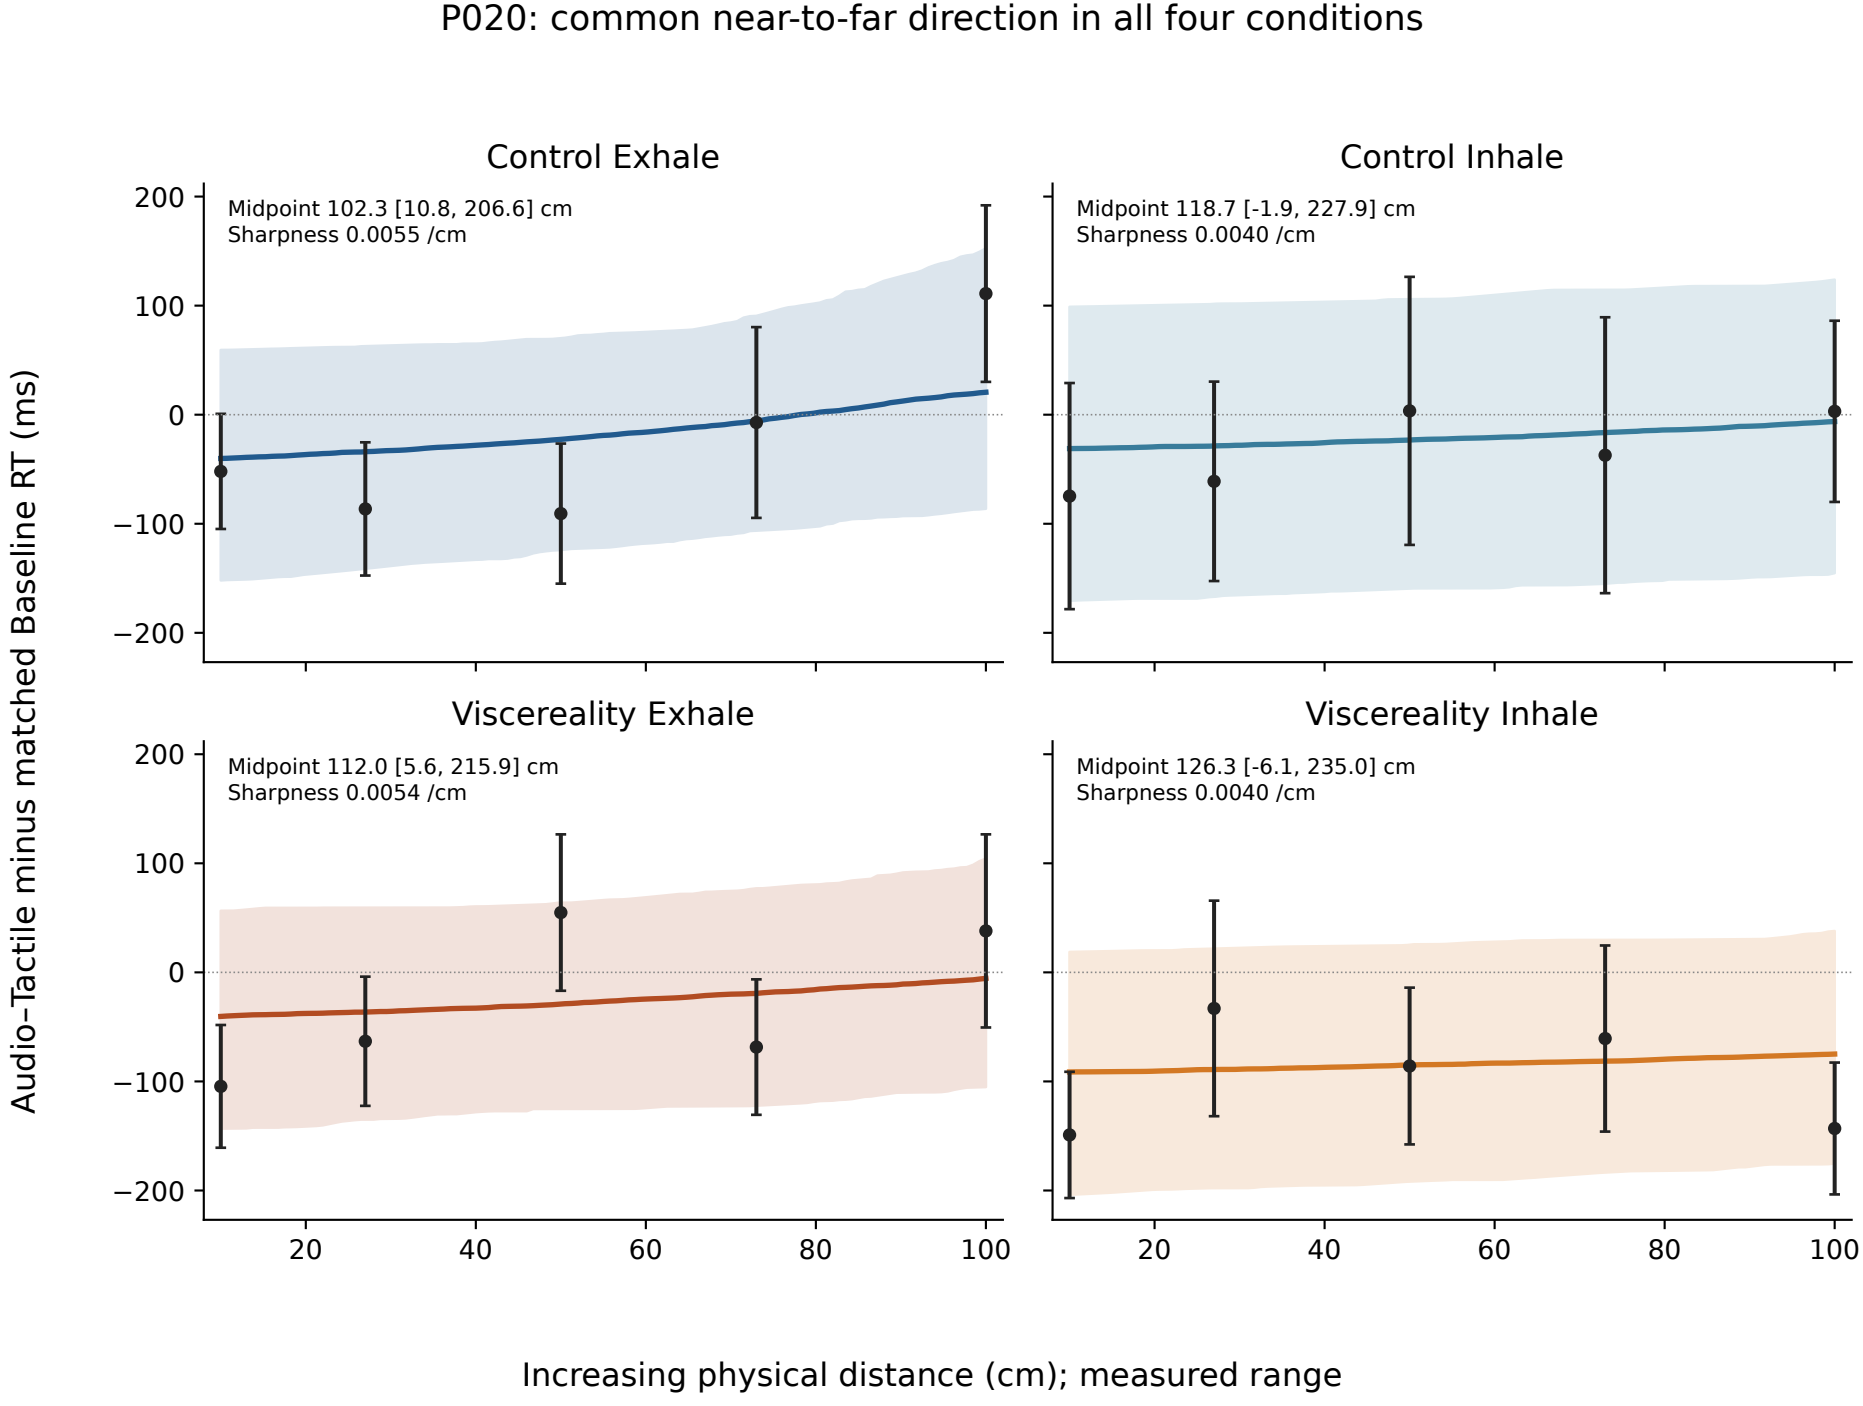

P015: common near-to-far direction in all four conditions
Control Exhale
Midpoint 126.7 [8.8, 229.6] cm
Sharpness 0.0040 /cm
Control Inhale
Midpoint 128.0 [2.8, 235.8] cm
Sharpness 0.0033 /cm
Viscereality Exhale
Midpoint 128.7 [4.5, 234.8] cm
Sharpness 0.0042 /cm
Viscereality Inhale
Midpoint 130.6 [0.8, 242.3] cm
Sharpness 0.0034 /cm
Audio–Tactile minus matched Baseline RT (ms)
50
25
0
−25
−50
−75
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

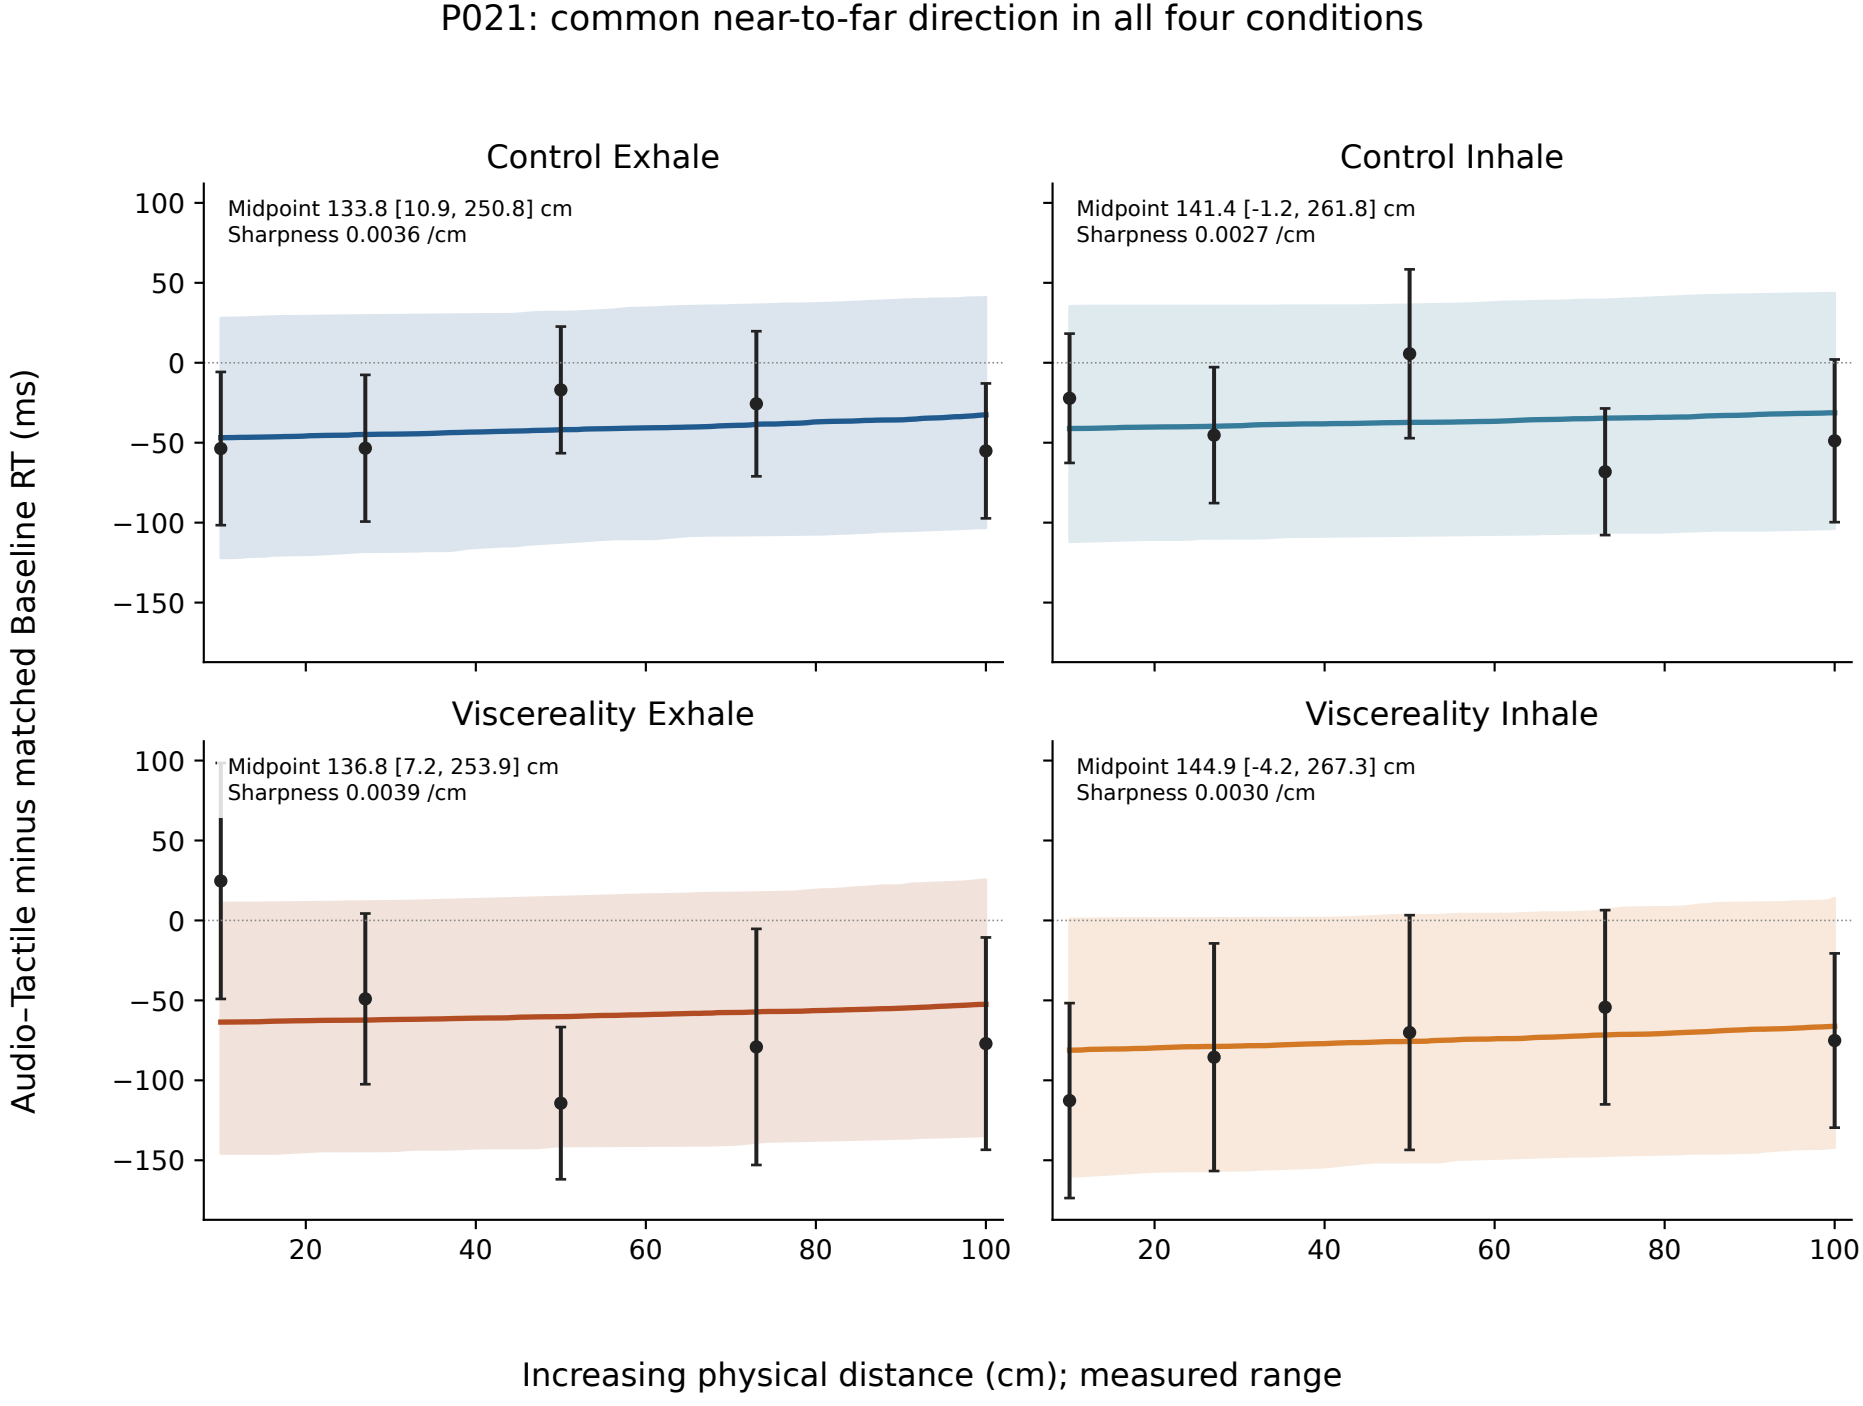

P016: common near-to-far direction in all four conditions
Control Exhale
Midpoint 118.0 [6.9, 222.2] cm
Sharpness 0.0045 /cm
Control Inhale
Midpoint 123.0 [-1.1, 236.8] cm
Sharpness 0.0038 /cm
Viscereality Exhale
Midpoint 113.0 [15.5, 225.5] cm
Sharpness 0.0051 /cm
Viscereality Inhale
Midpoint 127.7 [-3.4, 239.1] cm
Sharpness 0.0039 /cm
Audio–Tactile minus matched Baseline RT (ms)
150
100
50
0
−50
−100
−150
−200
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

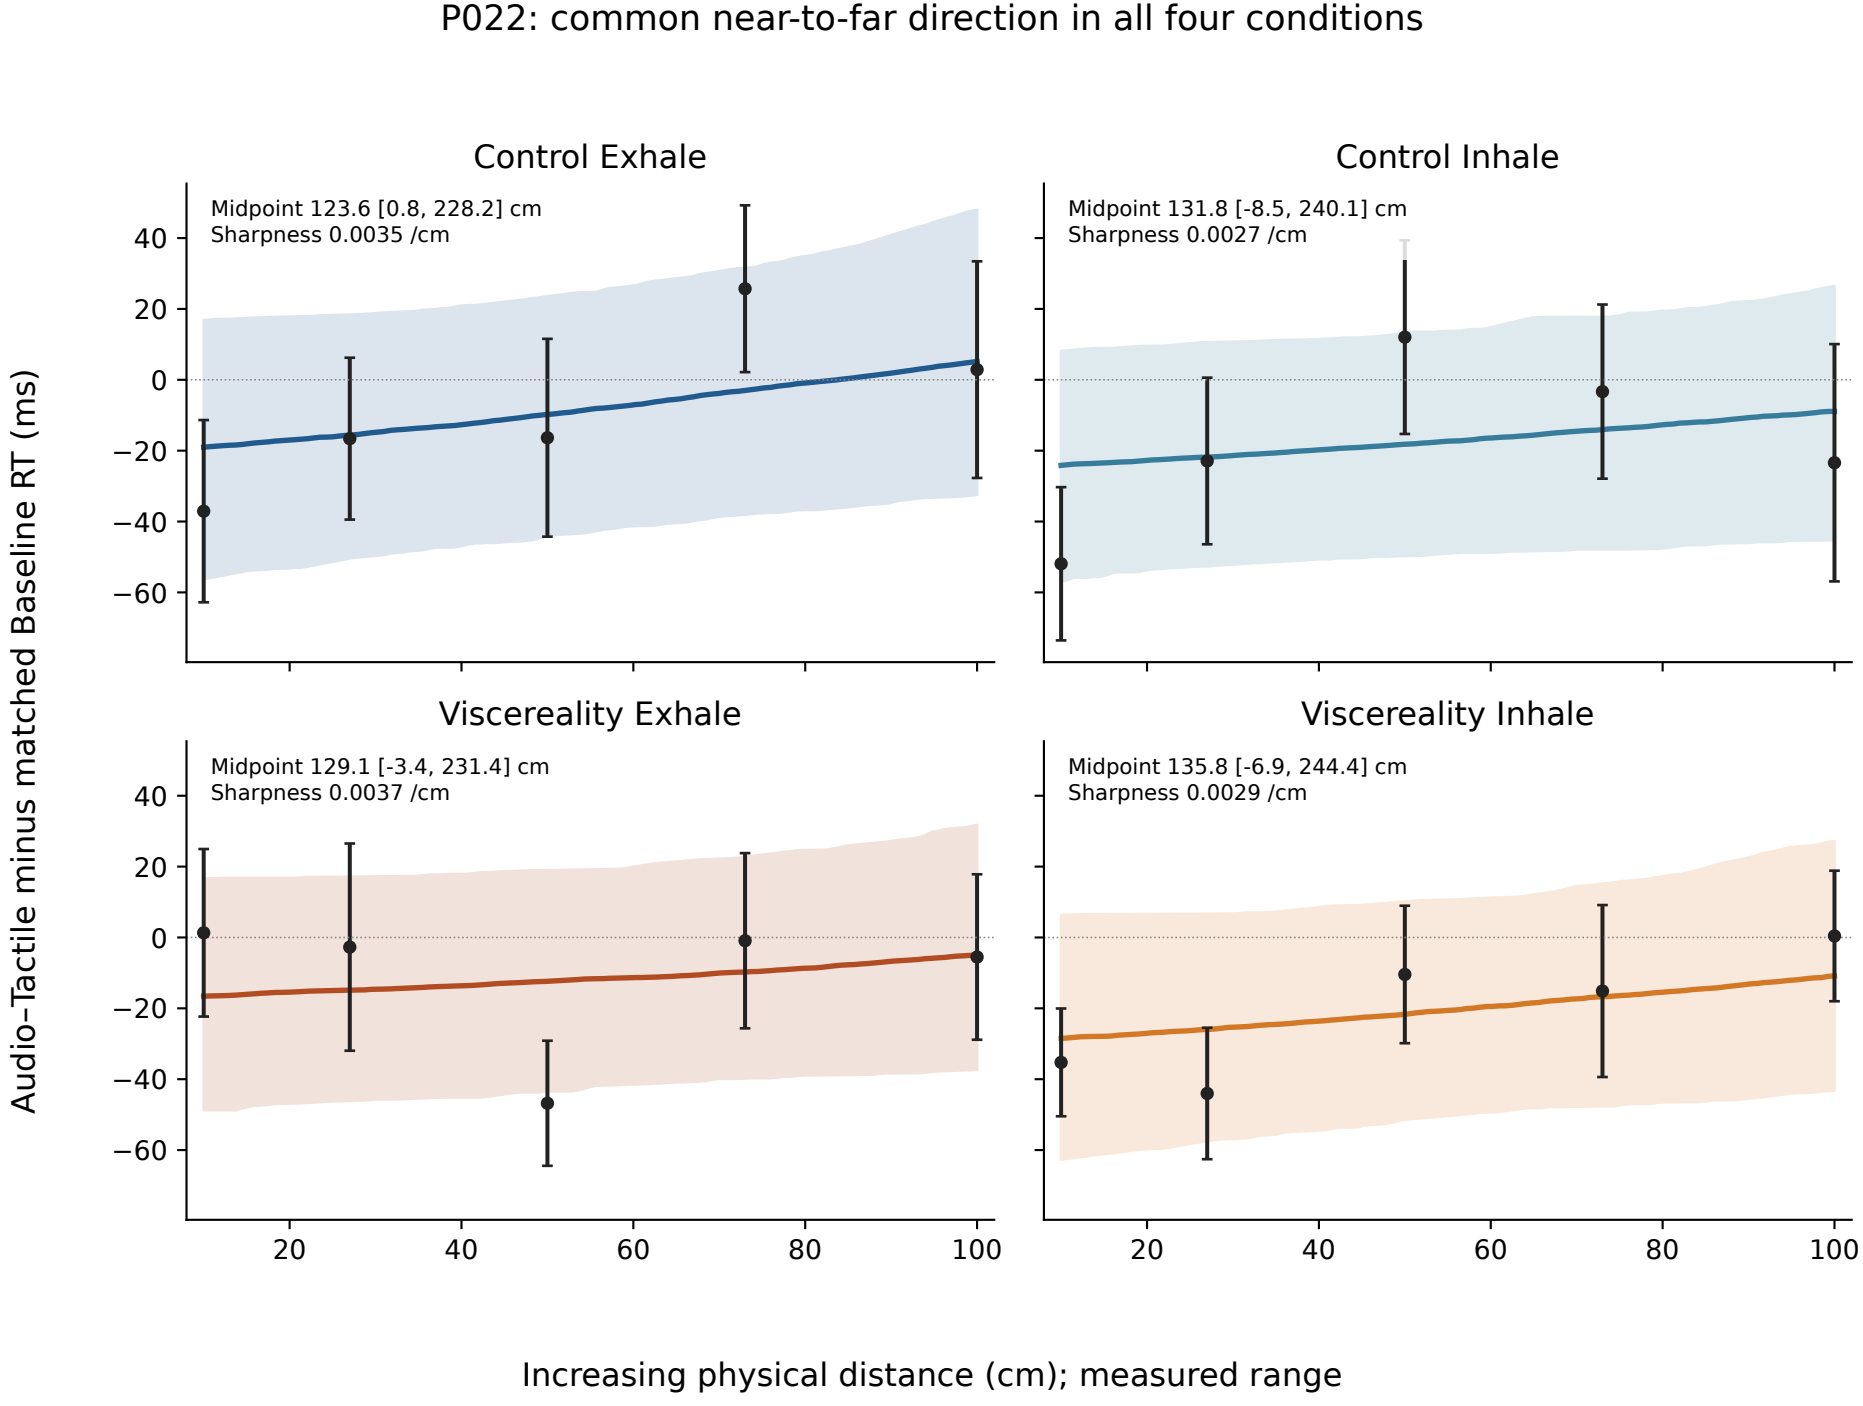

P017: common near-to-far direction in all four conditions
Control Exhale
Midpoint 120.7 [3.7, 225.7] cm
Sharpness 0.0040 /cm
Control Inhale
Midpoint 128.7 [-5.1, 240.9] cm
Sharpness 0.0031 /cm
Viscereality Exhale
Midpoint 122.9 [4.0, 226.8] cm
Sharpness 0.0042 /cm
Viscereality Inhale
Midpoint 133.0 [-6.7, 242.9] cm
Sharpness 0.0032 /cm
Audio–Tactile minus matched Baseline RT (ms)
50
0
−50
−100
−150
−200
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

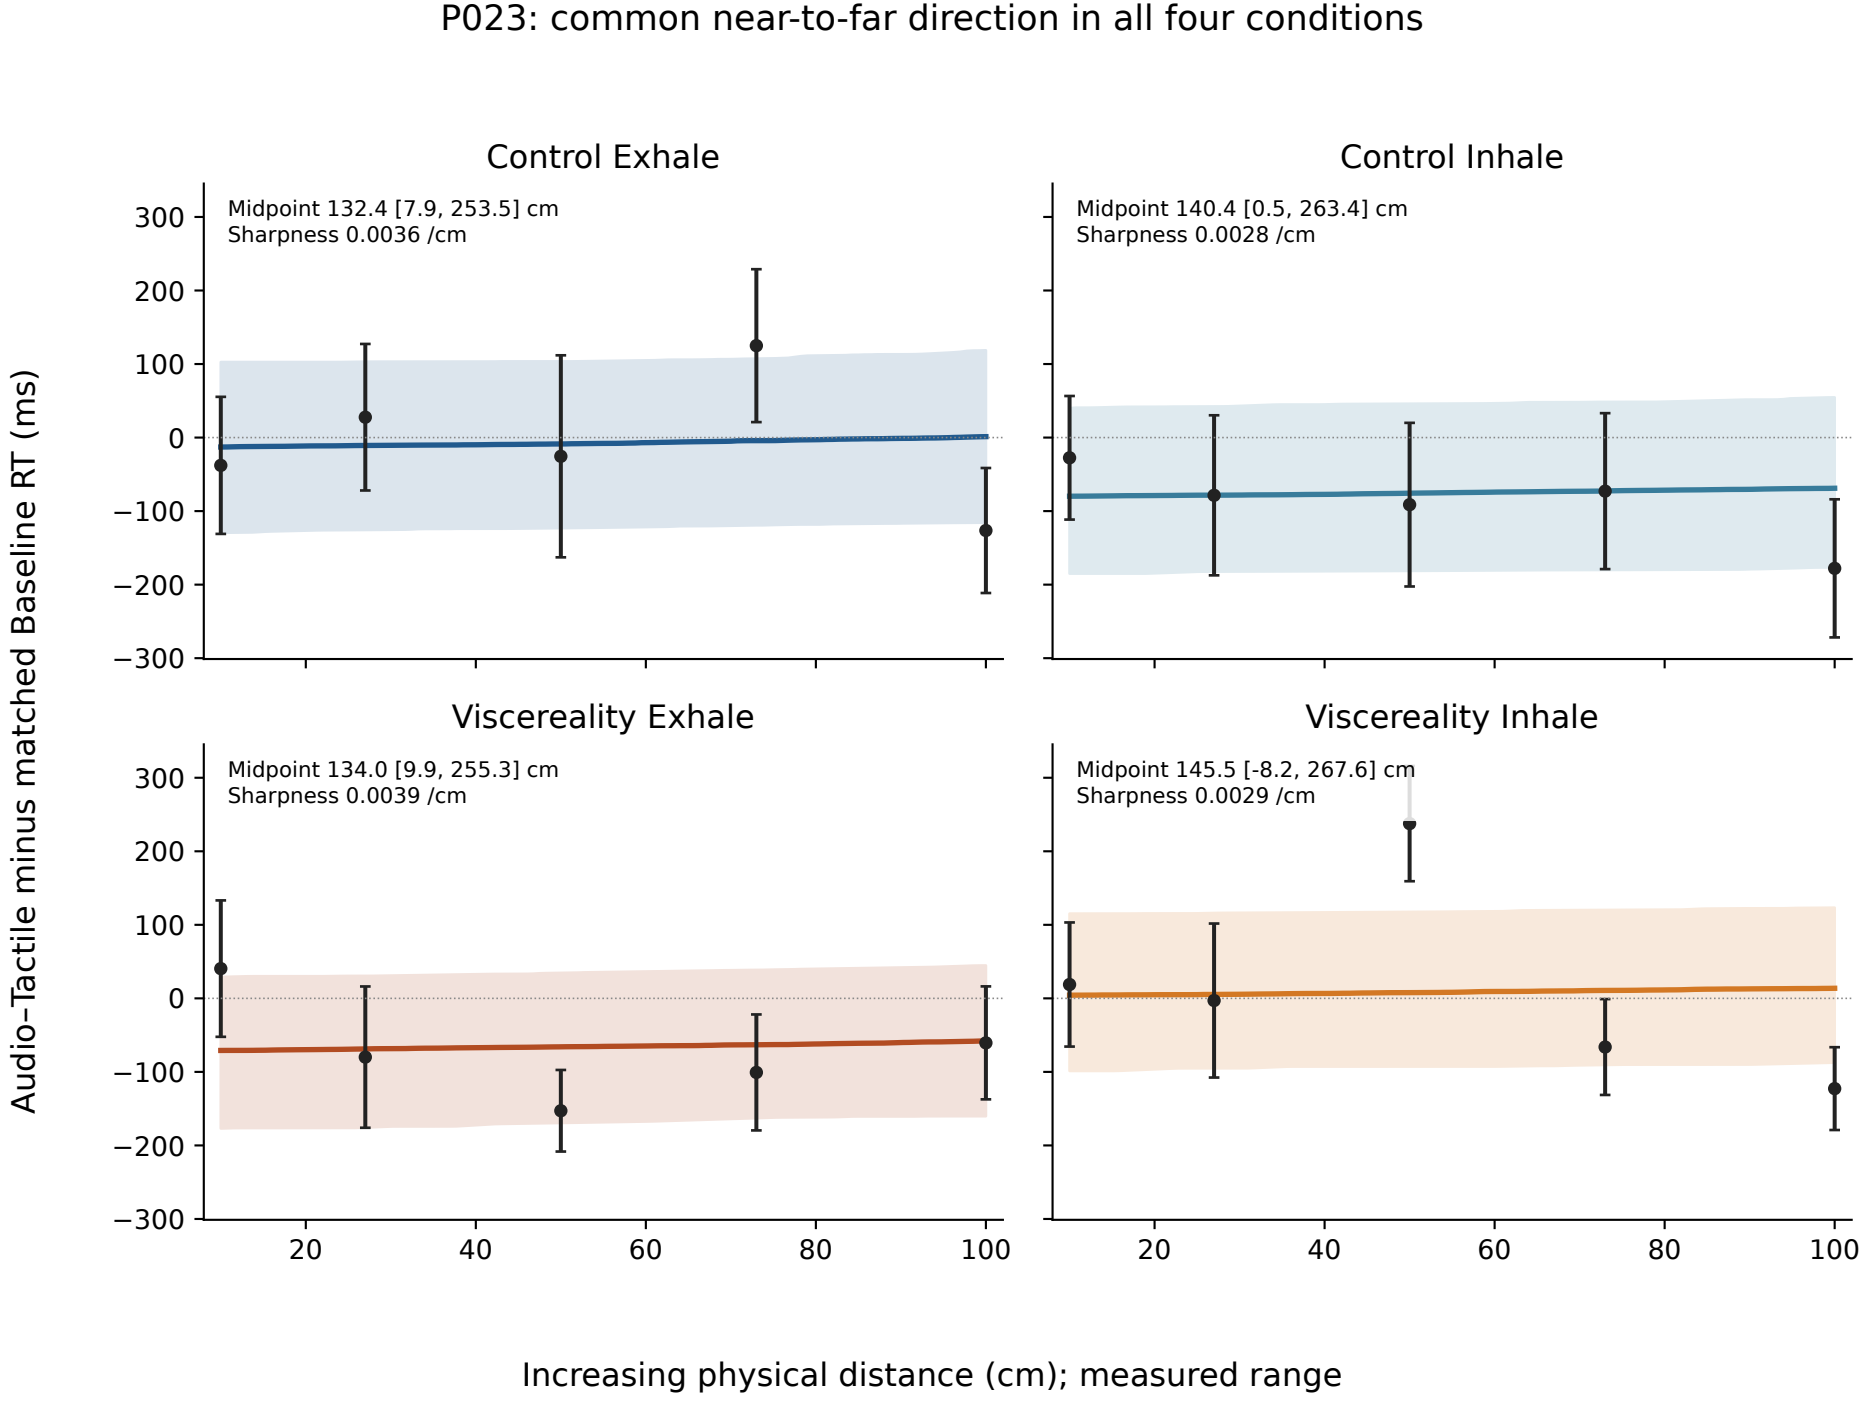

P018: common near-to-far direction in all four conditions
Control Exhale
Midpoint 132.2 [4.1, 248.6] cm
Sharpness 0.0035 /cm
Control Inhale
Midpoint 140.2 [-7.8, 260.8] cm
Sharpness 0.0026 /cm
Viscereality Exhale
Midpoint 130.0 [4.6, 251.0] cm
Sharpness 0.0038 /cm
Viscereality Inhale
Midpoint 141.8 [-7.1, 262.2] cm
Sharpness 0.0029 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

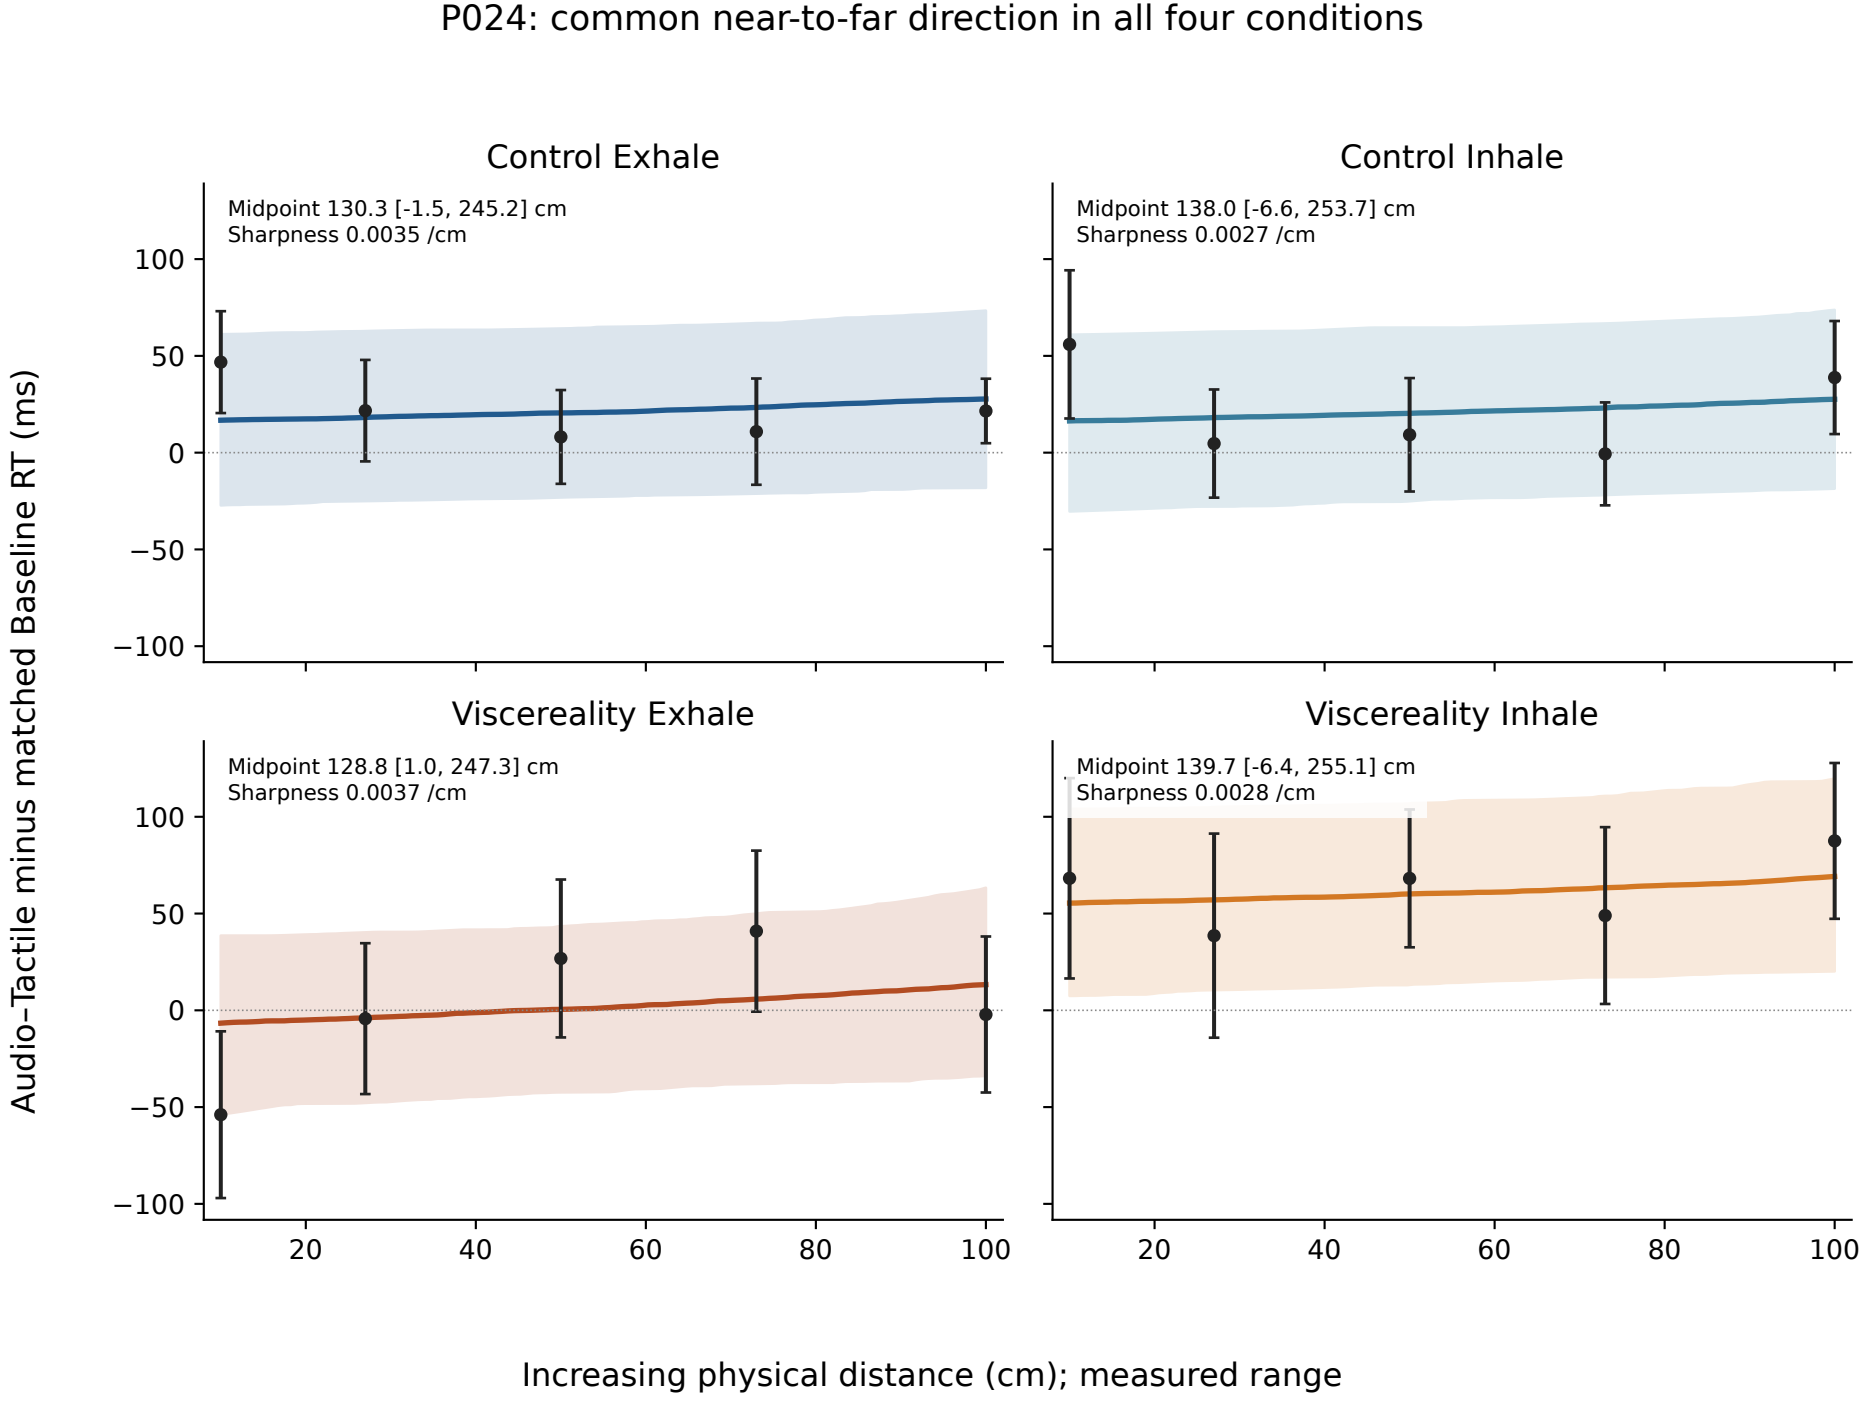

P019: common near-to-far direction in all four conditions
Control Exhale
Midpoint 116.5 [-4.2, 212.2] cm
Sharpness 0.0043 /cm
Control Inhale
Midpoint 125.5 [-15.4, 229.7] cm
Sharpness 0.0033 /cm
Viscereality Exhale
Midpoint 103.0 [12.4, 199.9] cm
Sharpness 0.0052 /cm
Viscereality Inhale
Midpoint 118.2 [-5.9, 220.7] cm
Sharpness 0.0039 /cm
Audio–Tactile minus matched Baseline RT (ms)
150
100
50
0
−50
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

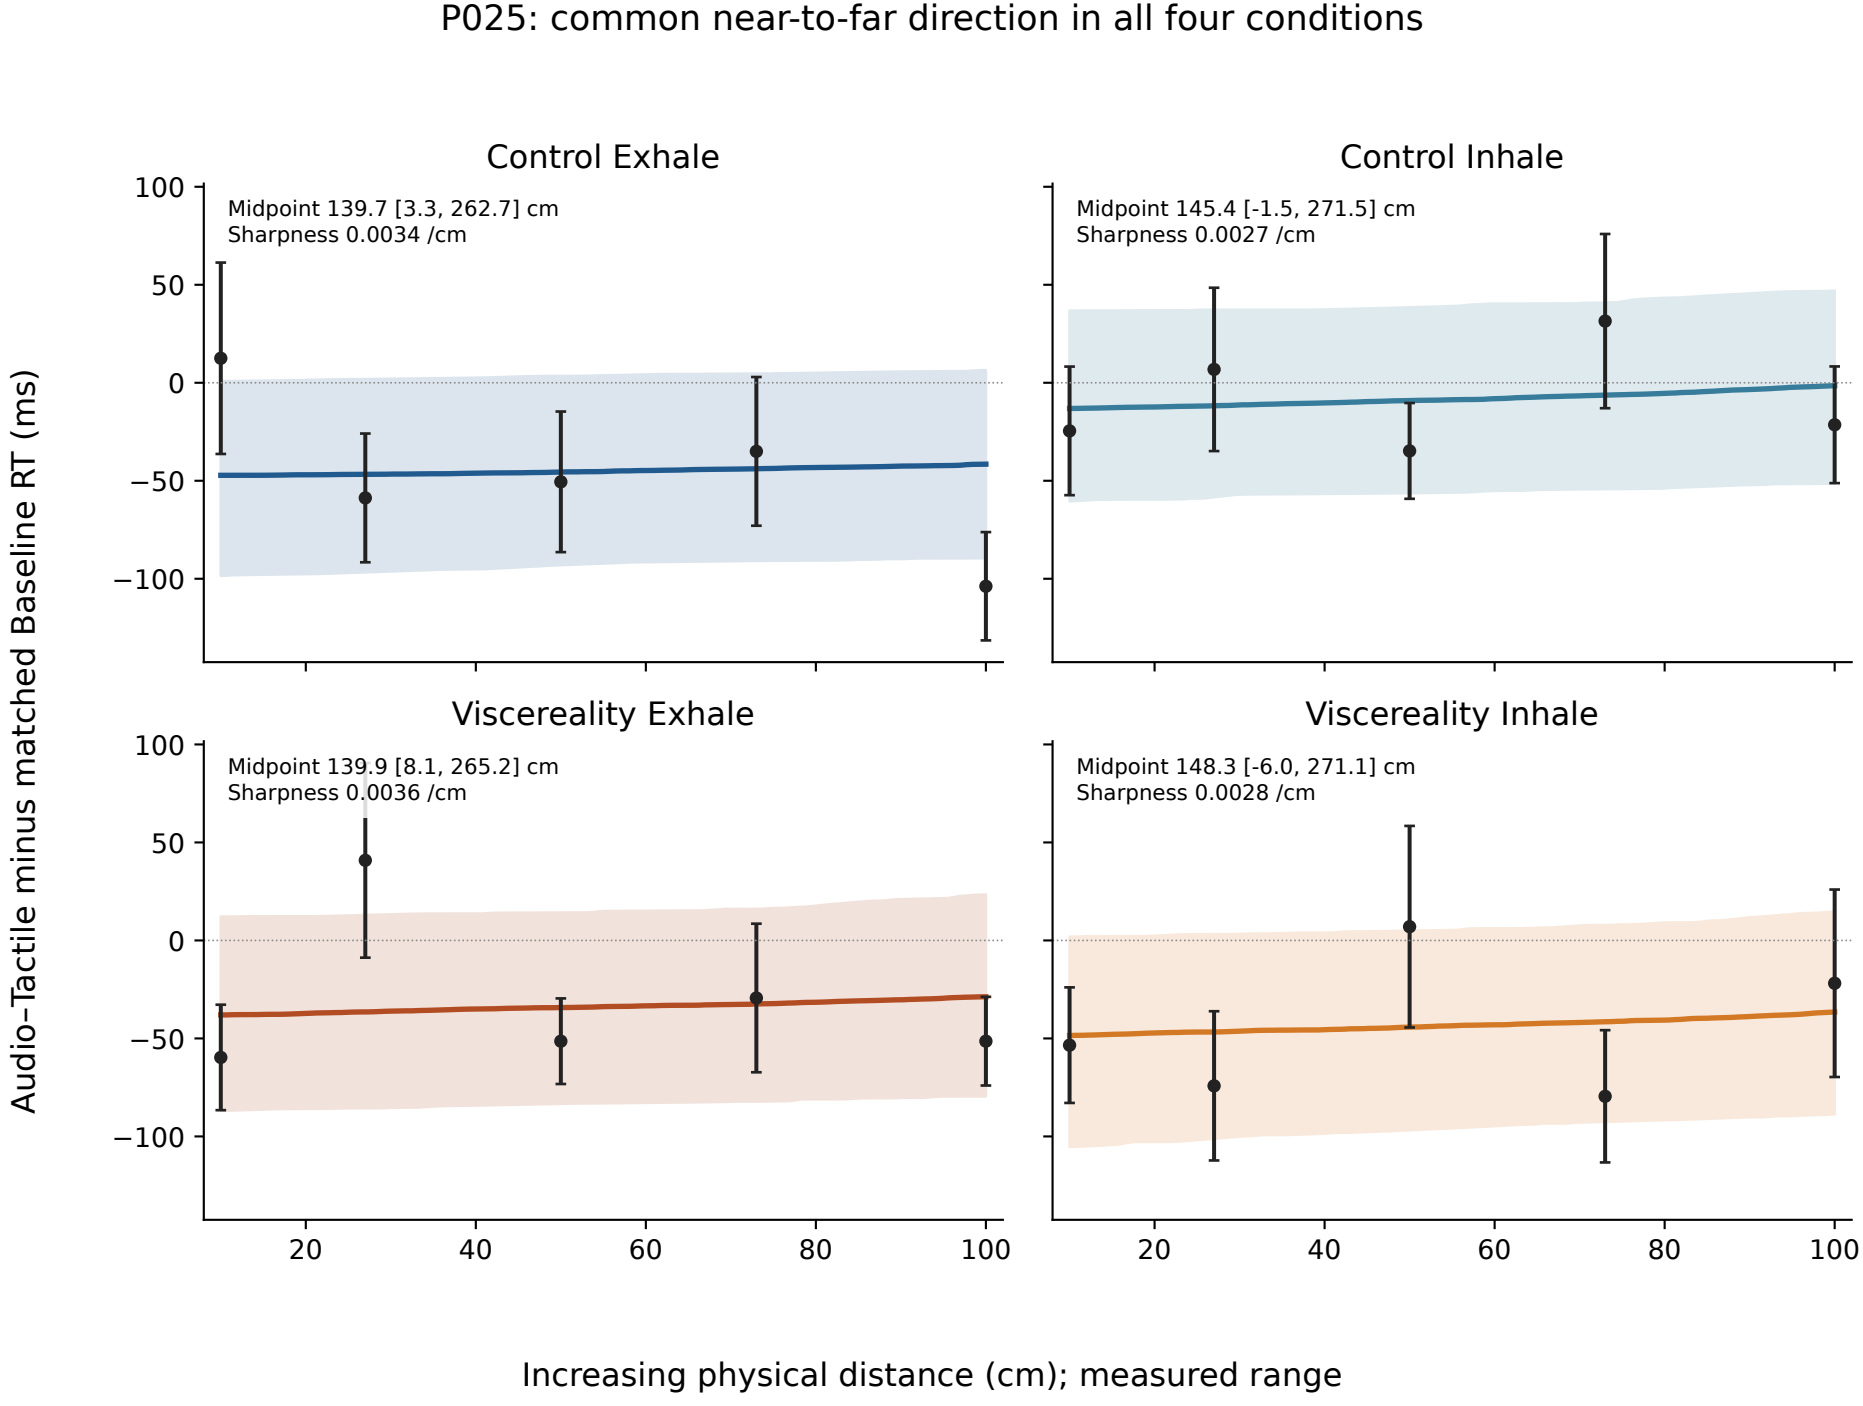

P020: common near-to-far direction in all four conditions
Control Exhale
Midpoint 102.3 [10.8, 206.6] cm
Sharpness 0.0055 /cm
Control Inhale
Midpoint 118.7 [-1.9, 227.9] cm
Sharpness 0.0040 /cm
Viscereality Exhale
Midpoint 112.0 [5.6, 215.9] cm
Sharpness 0.0054 /cm
Viscereality Inhale
Midpoint 126.3 [-6.1, 235.0] cm
Sharpness 0.0040 /cm
Audio–Tactile minus matched Baseline RT (ms)
200
100
0
−100
−200
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

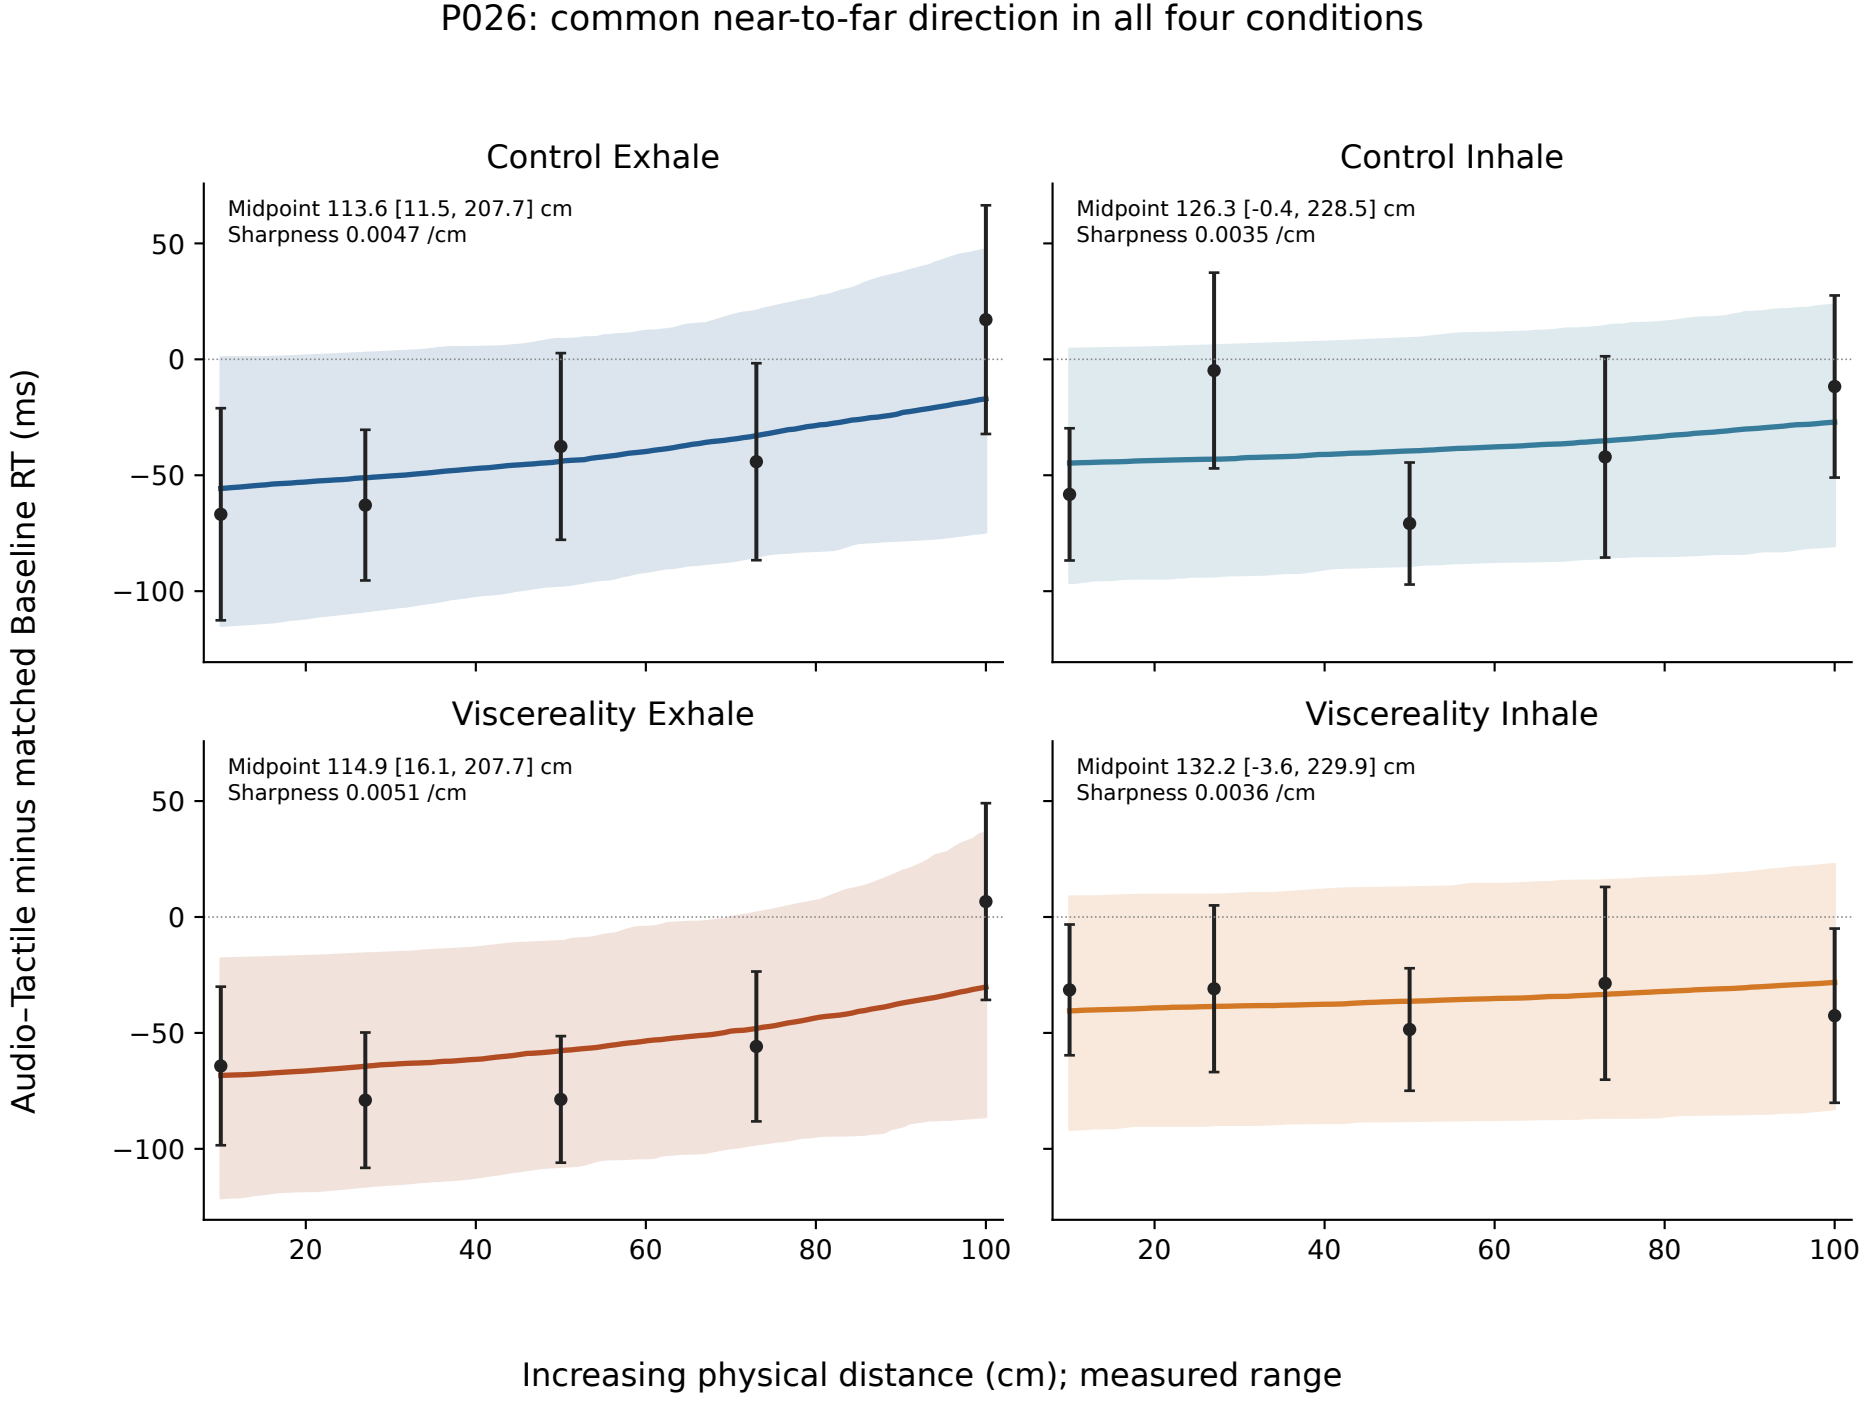

P021: common near-to-far direction in all four conditions
Control Exhale
Midpoint 133.8 [10.9, 250.8] cm
Sharpness 0.0036 /cm
Control Inhale
Midpoint 141.4 [-1.2, 261.8] cm
Sharpness 0.0027 /cm
Viscereality Exhale
Midpoint 136.8 [7.2, 253.9] cm
Sharpness 0.0039 /cm
Viscereality Inhale
Midpoint 144.9 [-4.2, 267.3] cm
Sharpness 0.0030 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
−100
−150
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

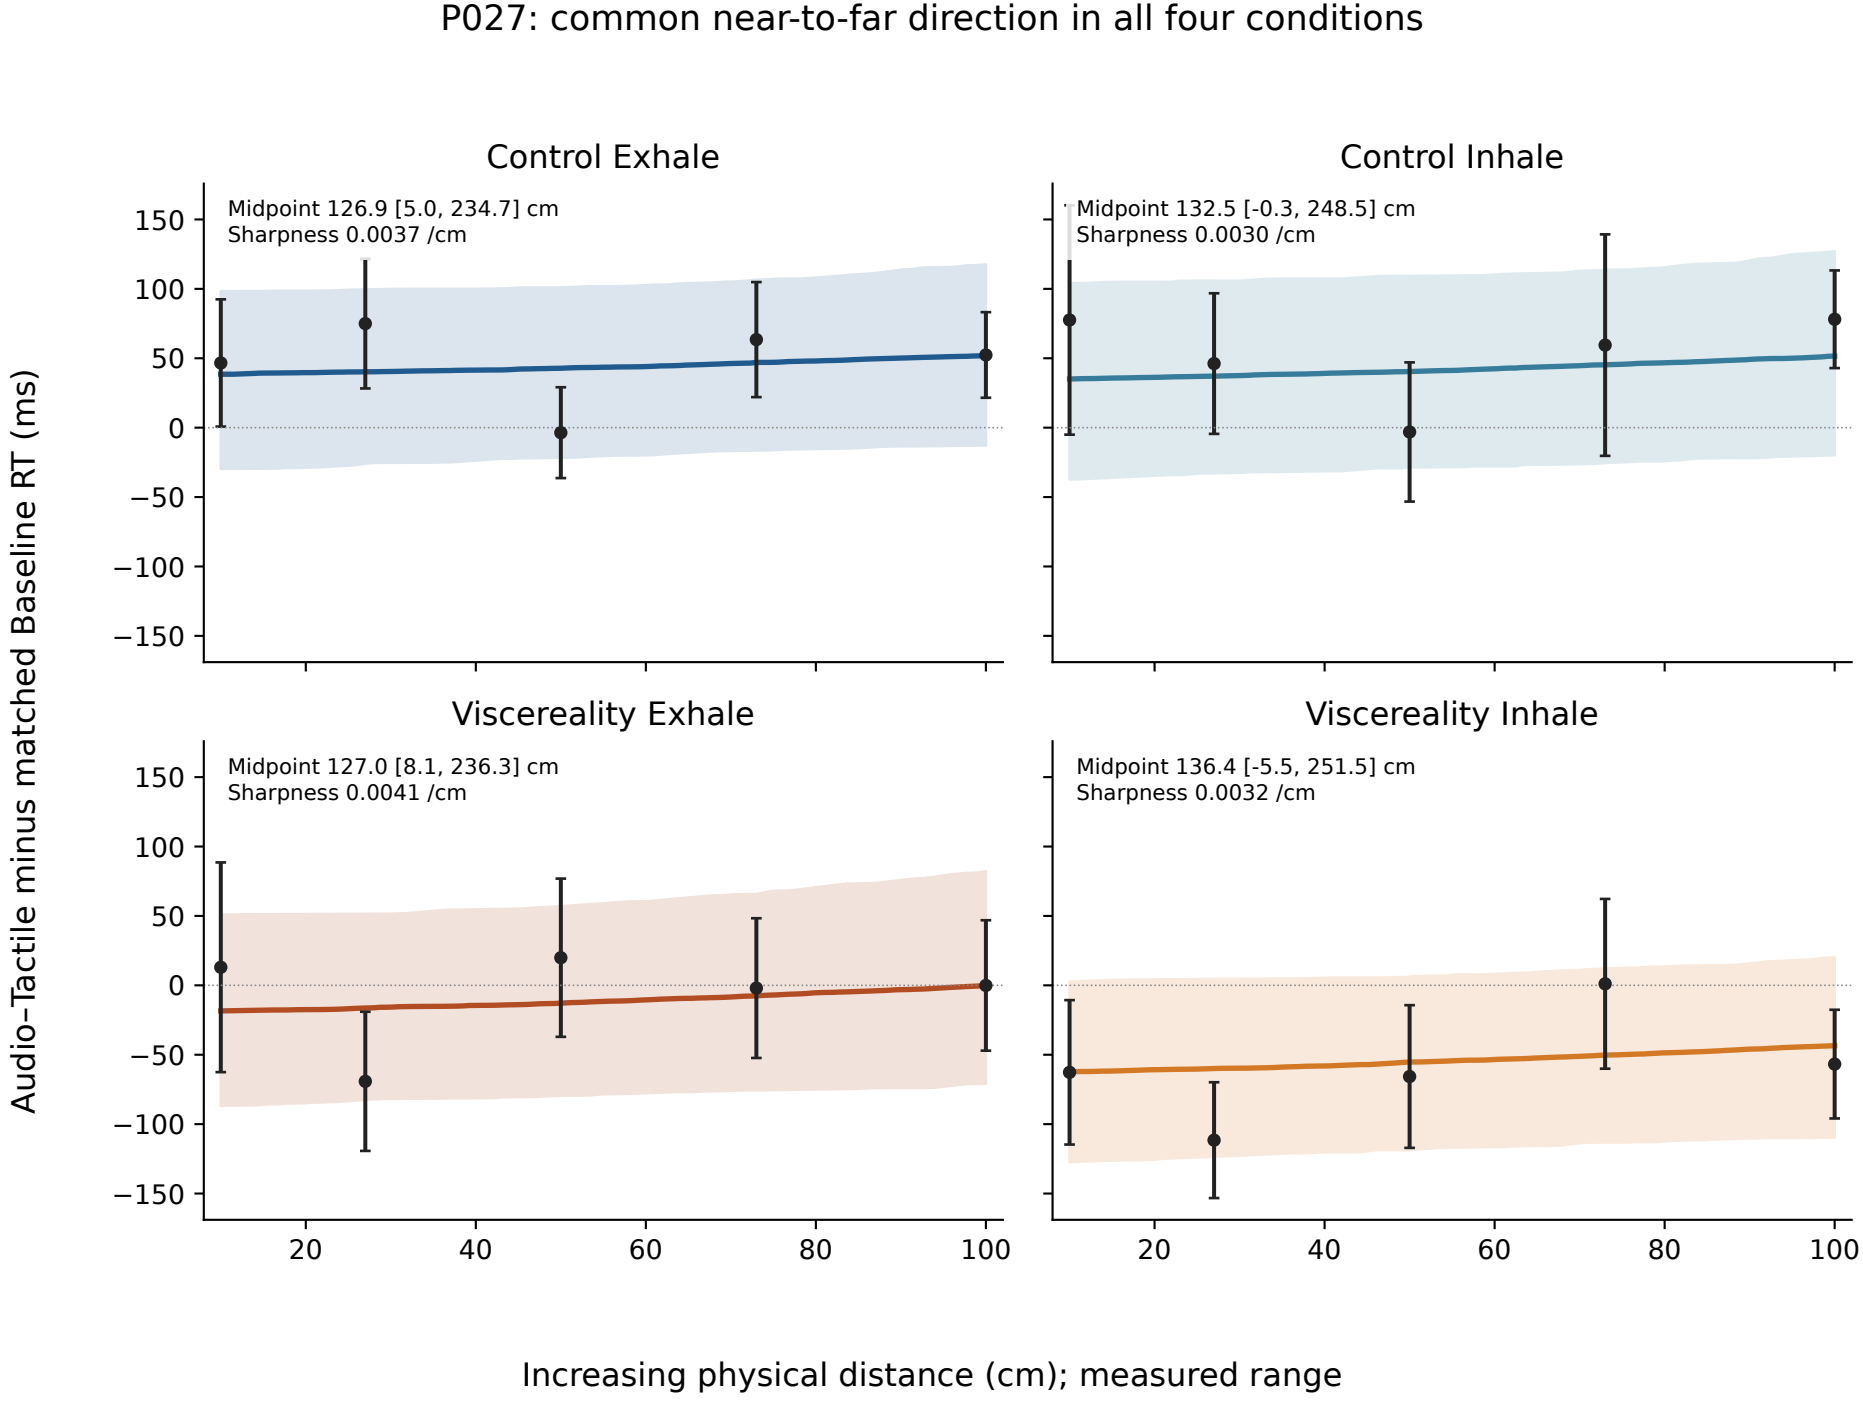

P022: common near-to-far direction in all four conditions
Control Exhale
Midpoint 123.6 [0.8, 228.2] cm
Sharpness 0.0035 /cm
Control Inhale
Midpoint 131.8 [-8.5, 240.1] cm
Sharpness 0.0027 /cm
Viscereality Exhale
Midpoint 129.1 [-3.4, 231.4] cm
Sharpness 0.0037 /cm
Viscereality Inhale
Midpoint 135.8 [-6.9, 244.4] cm
Sharpness 0.0029 /cm
Audio–Tactile minus matched Baseline RT (ms)
40
20
0
−20
−40
−60
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

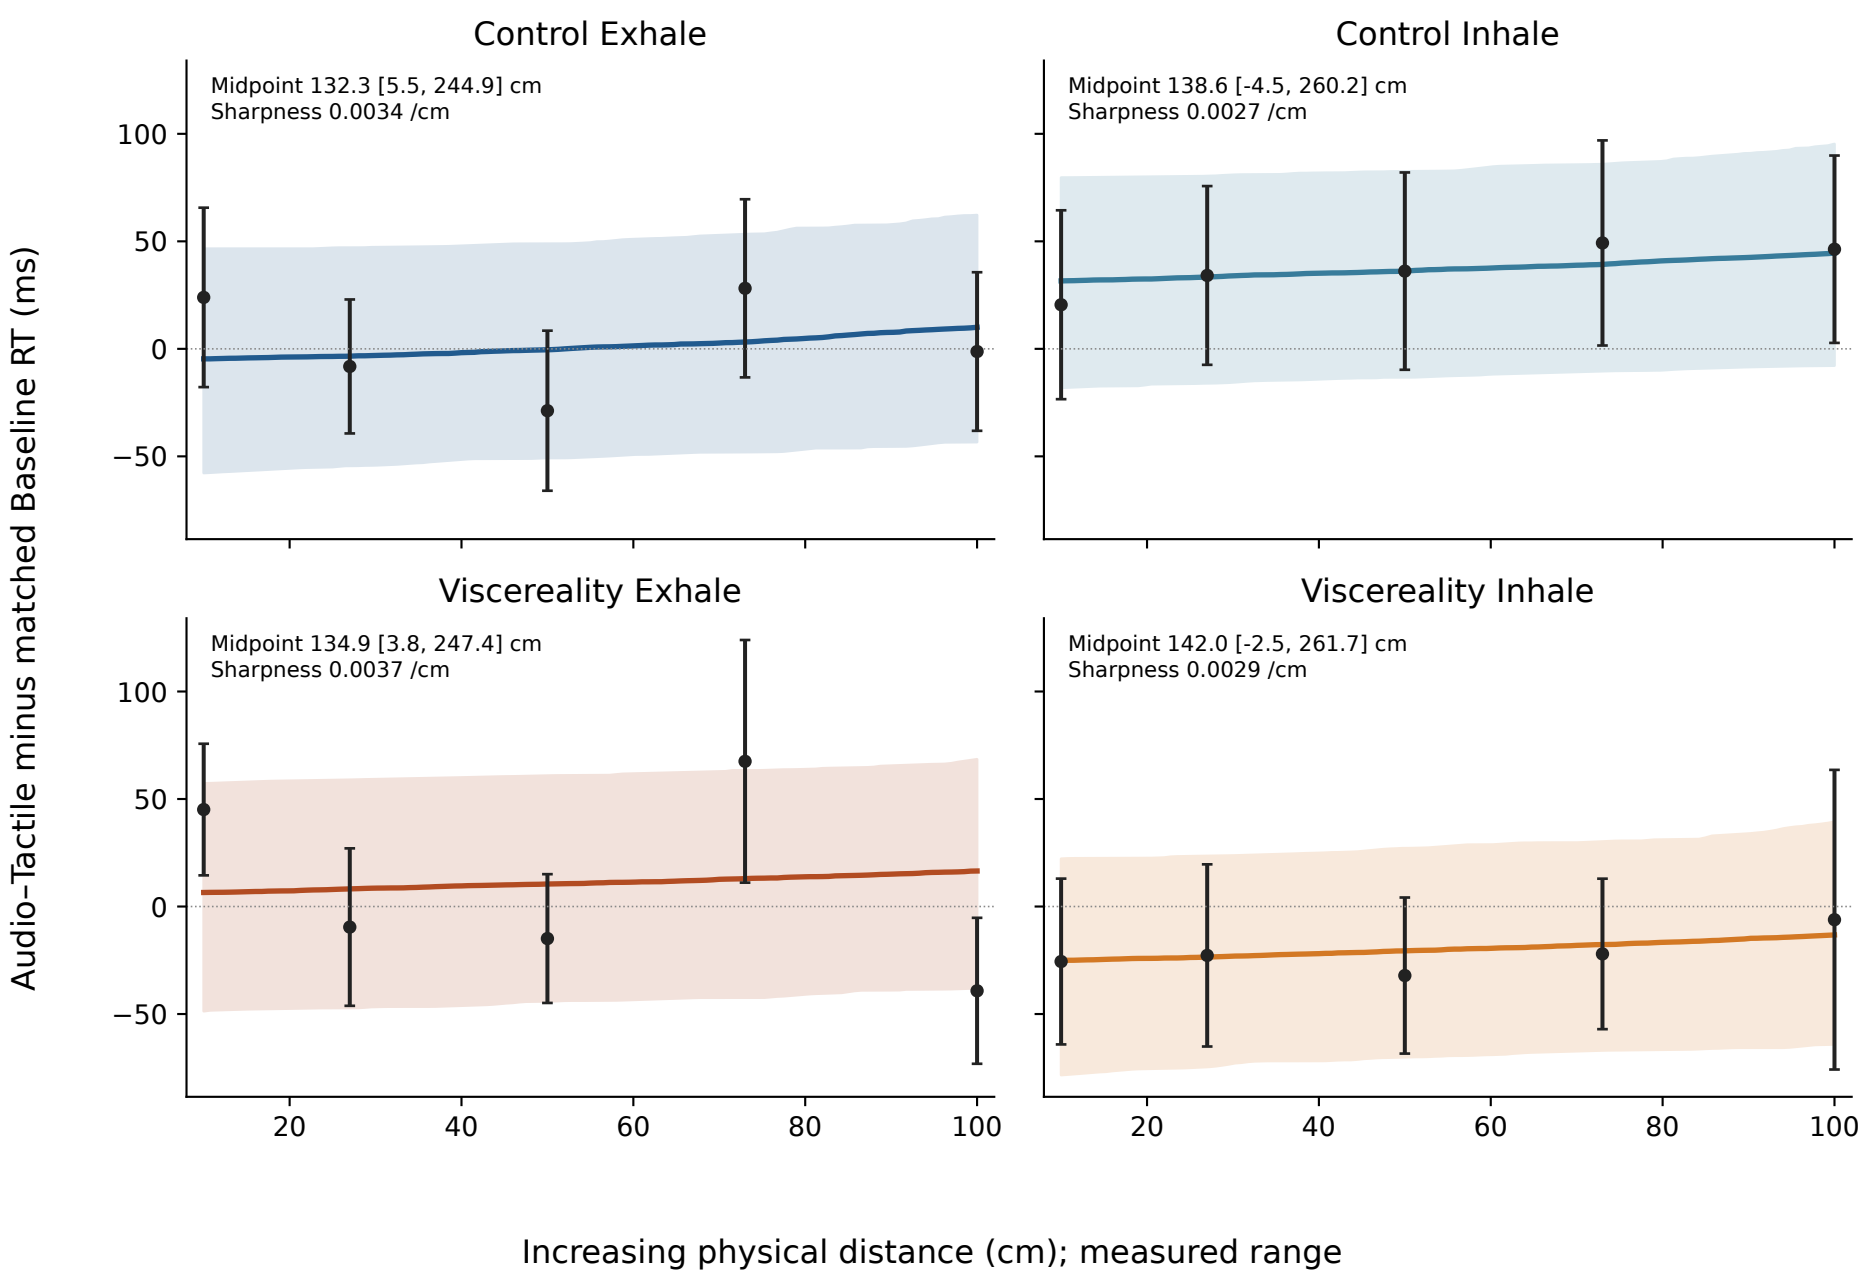

P023: common near-to-far direction in all four conditions
Control Exhale
Midpoint 132.4 [7.9, 253.5] cm
Sharpness 0.0036 /cm
Control Inhale
Midpoint 140.4 [0.5, 263.4] cm
Sharpness 0.0028 /cm
Viscereality Exhale
Midpoint 134.0 [9.9, 255.3] cm
Sharpness 0.0039 /cm
Viscereality Inhale
Midpoint 145.5 [-8.2, 267.6] cm
Sharpness 0.0029 /cm
Audio–Tactile minus matched Baseline RT (ms)
300
200
100
0
−100
−200
−300
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

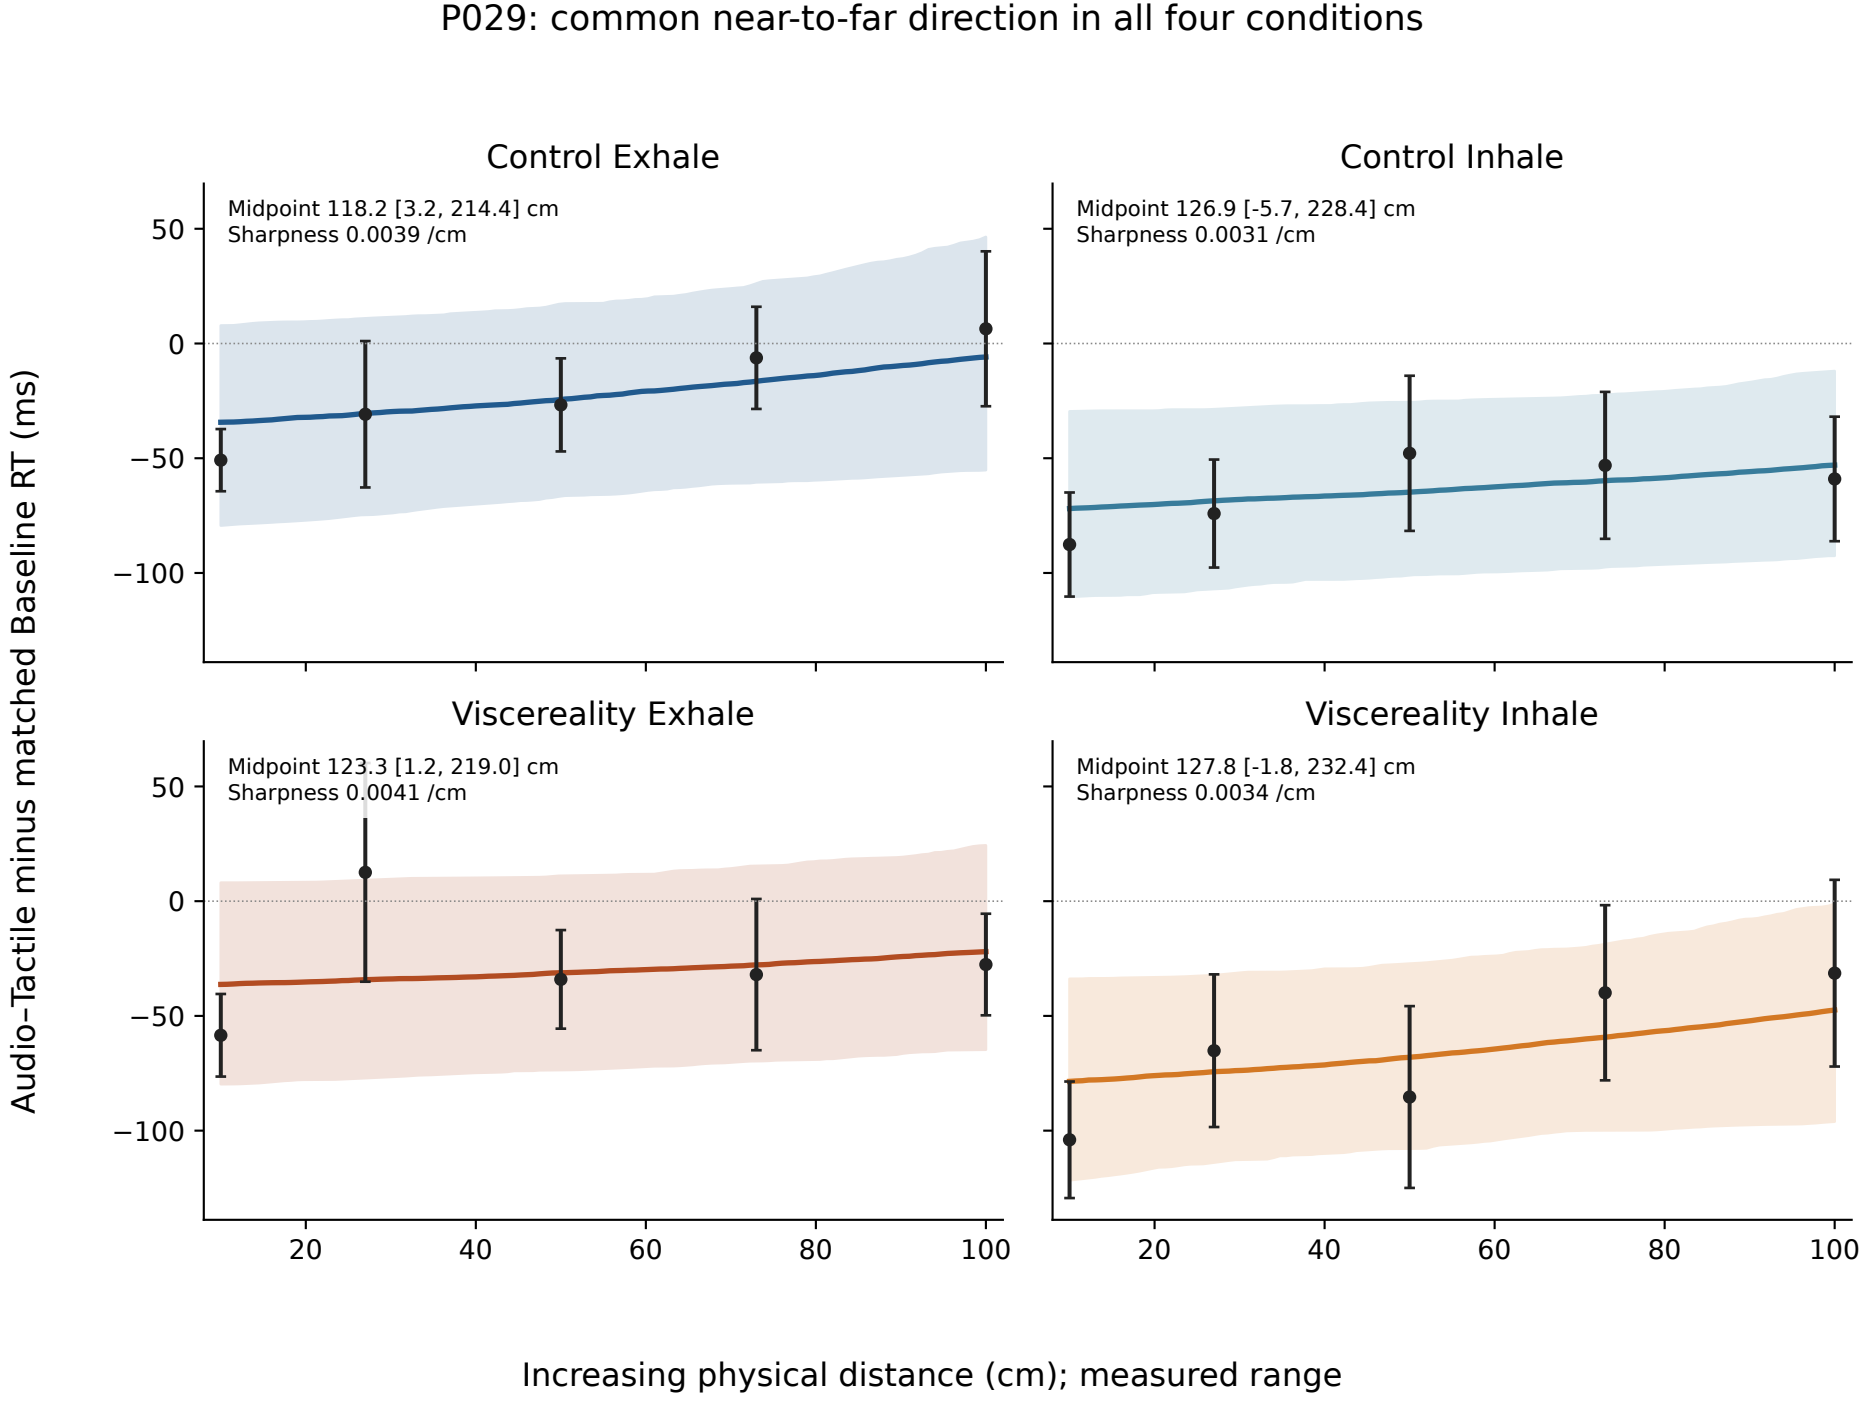

P024: common near-to-far direction in all four conditions
Control Exhale
Midpoint 130.3 [-1.5, 245.2] cm
Sharpness 0.0035 /cm
Control Inhale
Midpoint 138.0 [-6.6, 253.7] cm
Sharpness 0.0027 /cm
Viscereality Exhale
Midpoint 128.8 [1.0, 247.3] cm
Sharpness 0.0037 /cm
Viscereality Inhale
Midpoint 139.7 [-6.4, 255.1] cm
Sharpness 0.0028 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

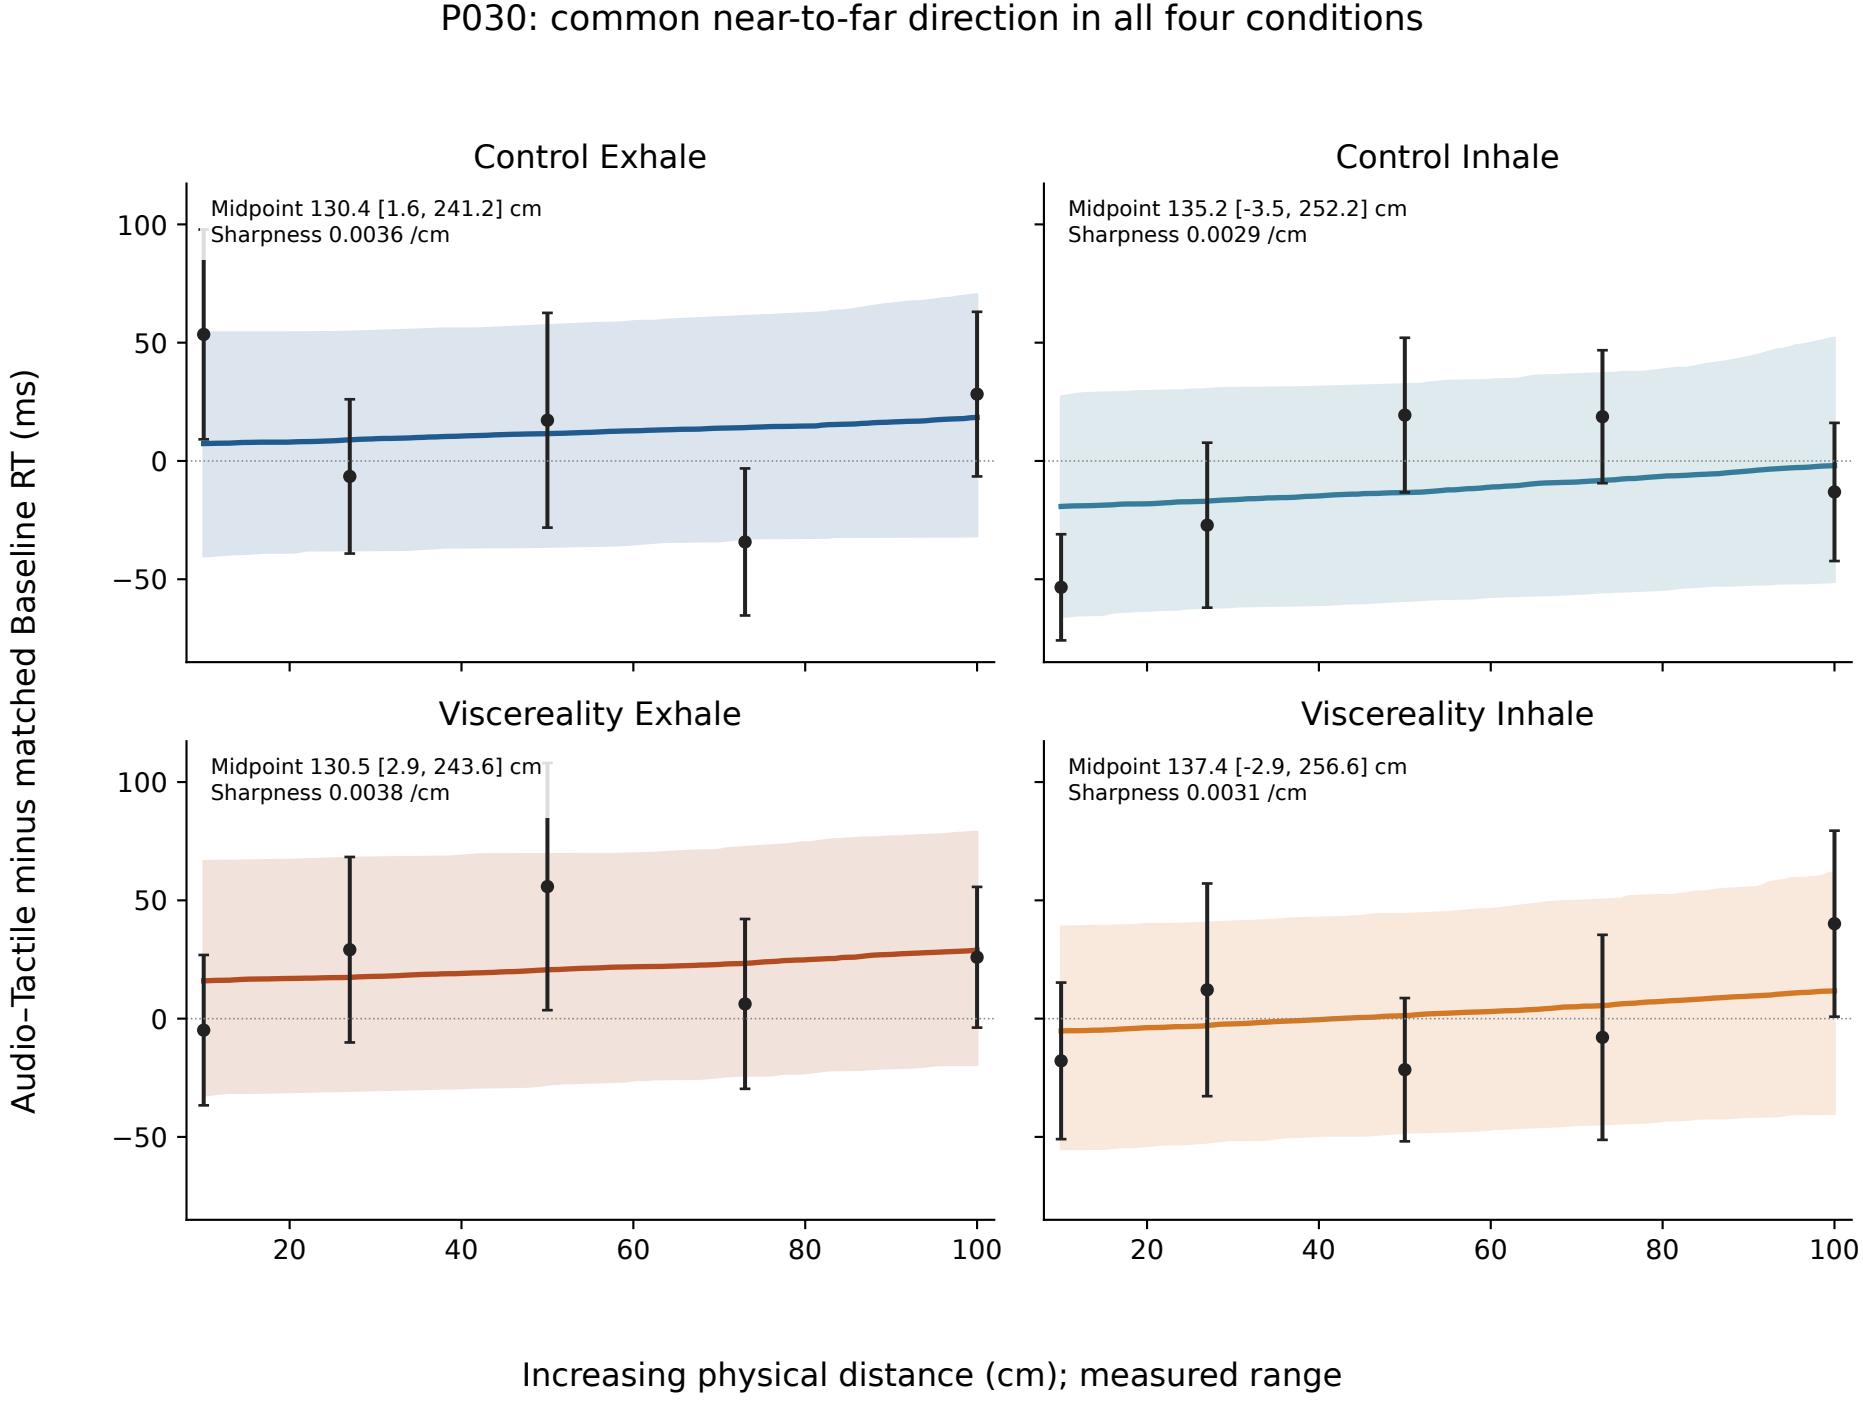

P025: common near-to-far direction in all four conditions
Control Exhale
Midpoint 139.7 [3.3, 262.7] cm
Sharpness 0.0034 /cm
Control Inhale
Midpoint 145.4 [-1.5, 271.5] cm
Sharpness 0.0027 /cm
Viscereality Exhale
Midpoint 139.9 [8.1, 265.2] cm
Sharpness 0.0036 /cm
Viscereality Inhale
Midpoint 148.3 [-6.0, 271.1] cm
Sharpness 0.0028 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

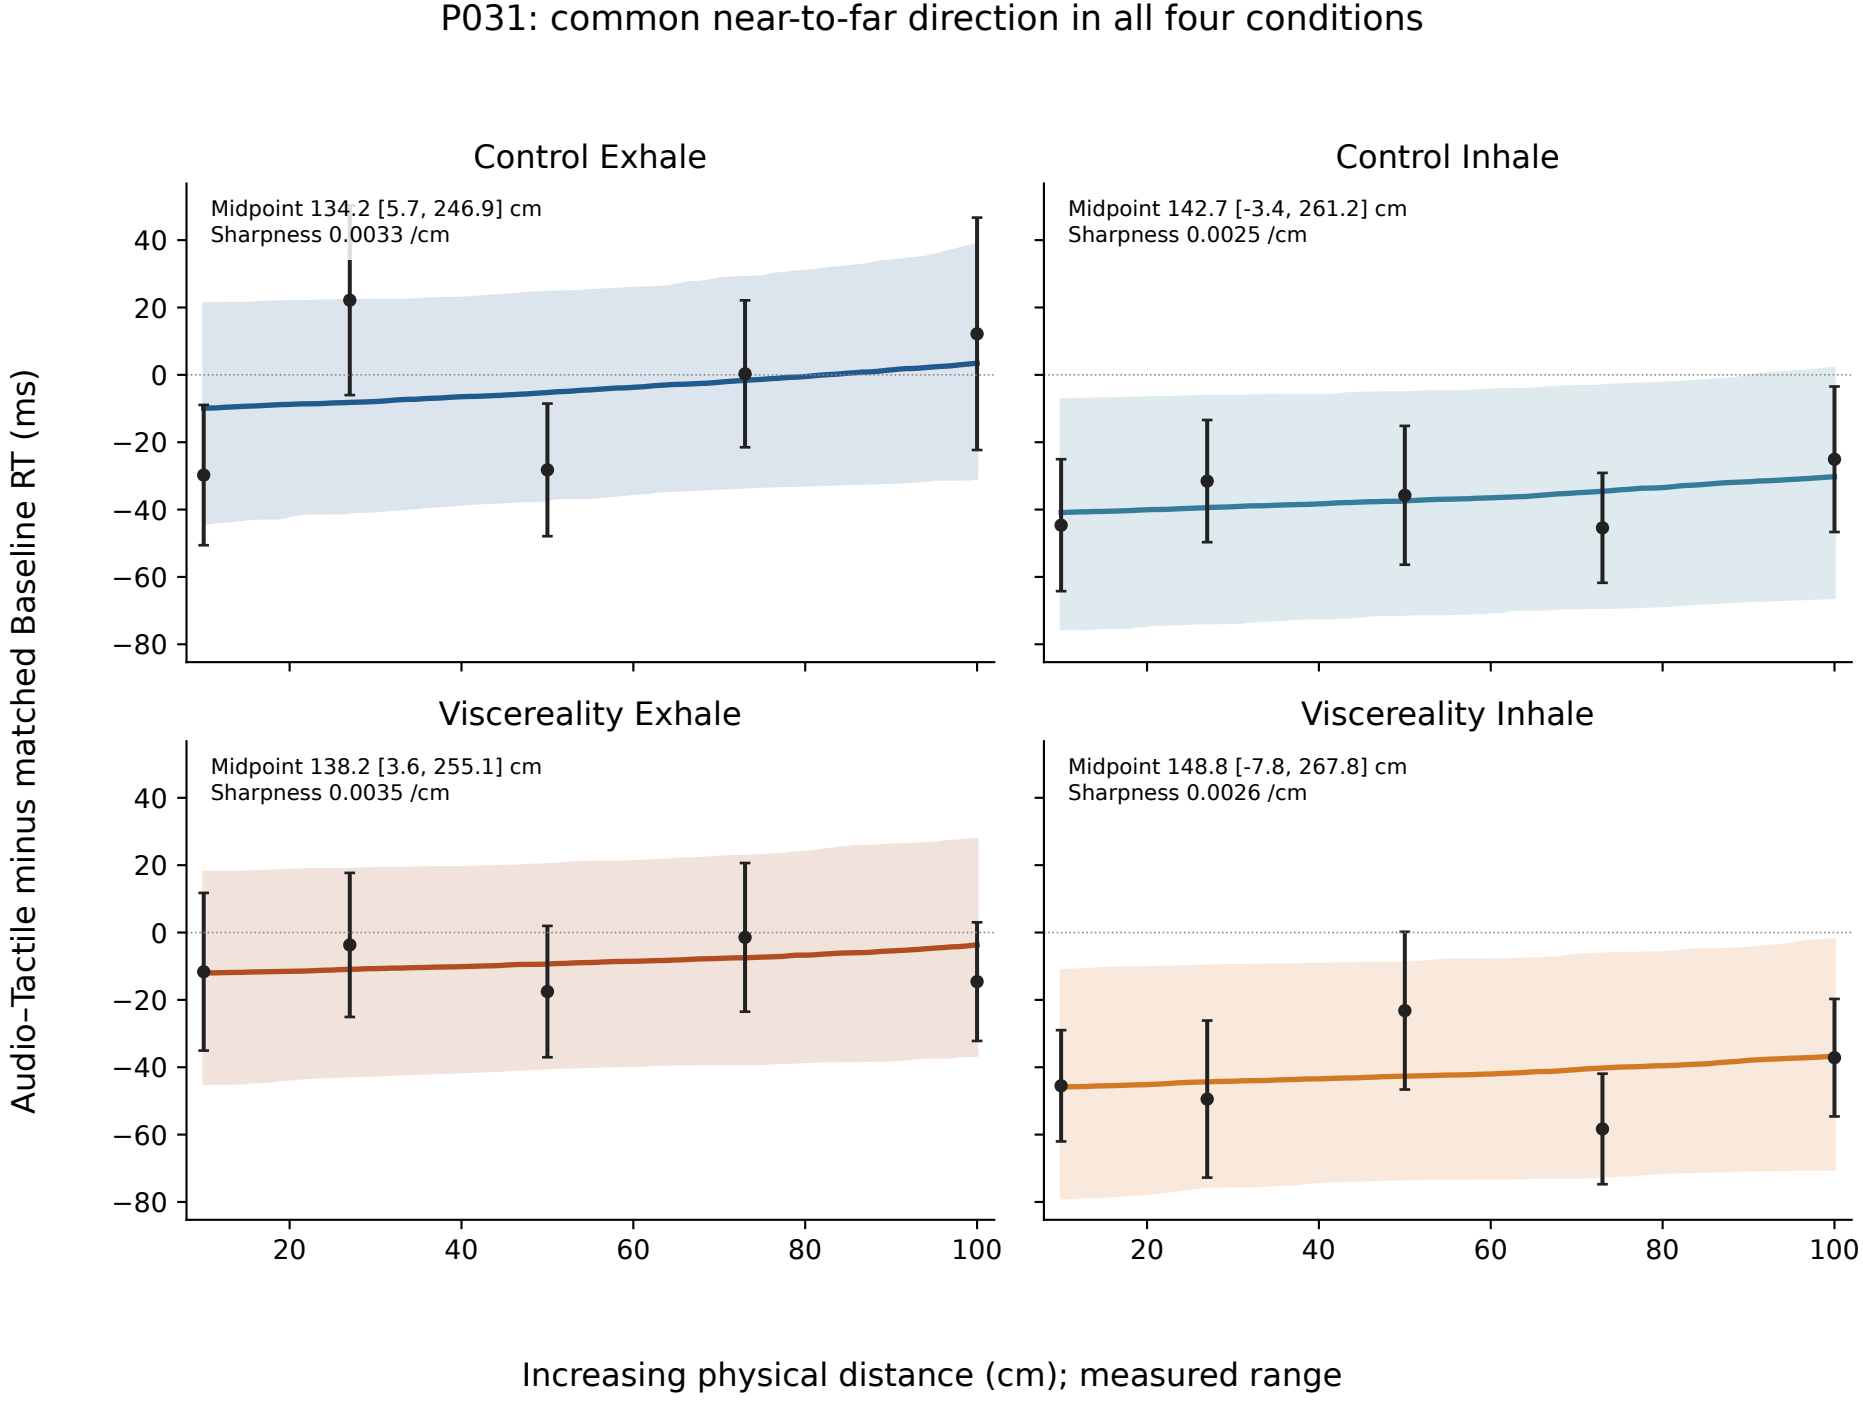

P026: common near-to-far direction in all four conditions
Control Exhale
Midpoint 113.6 [11.5, 207.7] cm
Sharpness 0.0047 /cm
Control Inhale
Midpoint 126.3 [-0.4, 228.5] cm
Sharpness 0.0035 /cm
Viscereality Exhale
Midpoint 114.9 [16.1, 207.7] cm
Sharpness 0.0051 /cm
Viscereality Inhale
Midpoint 132.2 [-3.6, 229.9] cm
Sharpness 0.0036 /cm
Audio–Tactile minus matched Baseline RT (ms)
50
0
−50
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

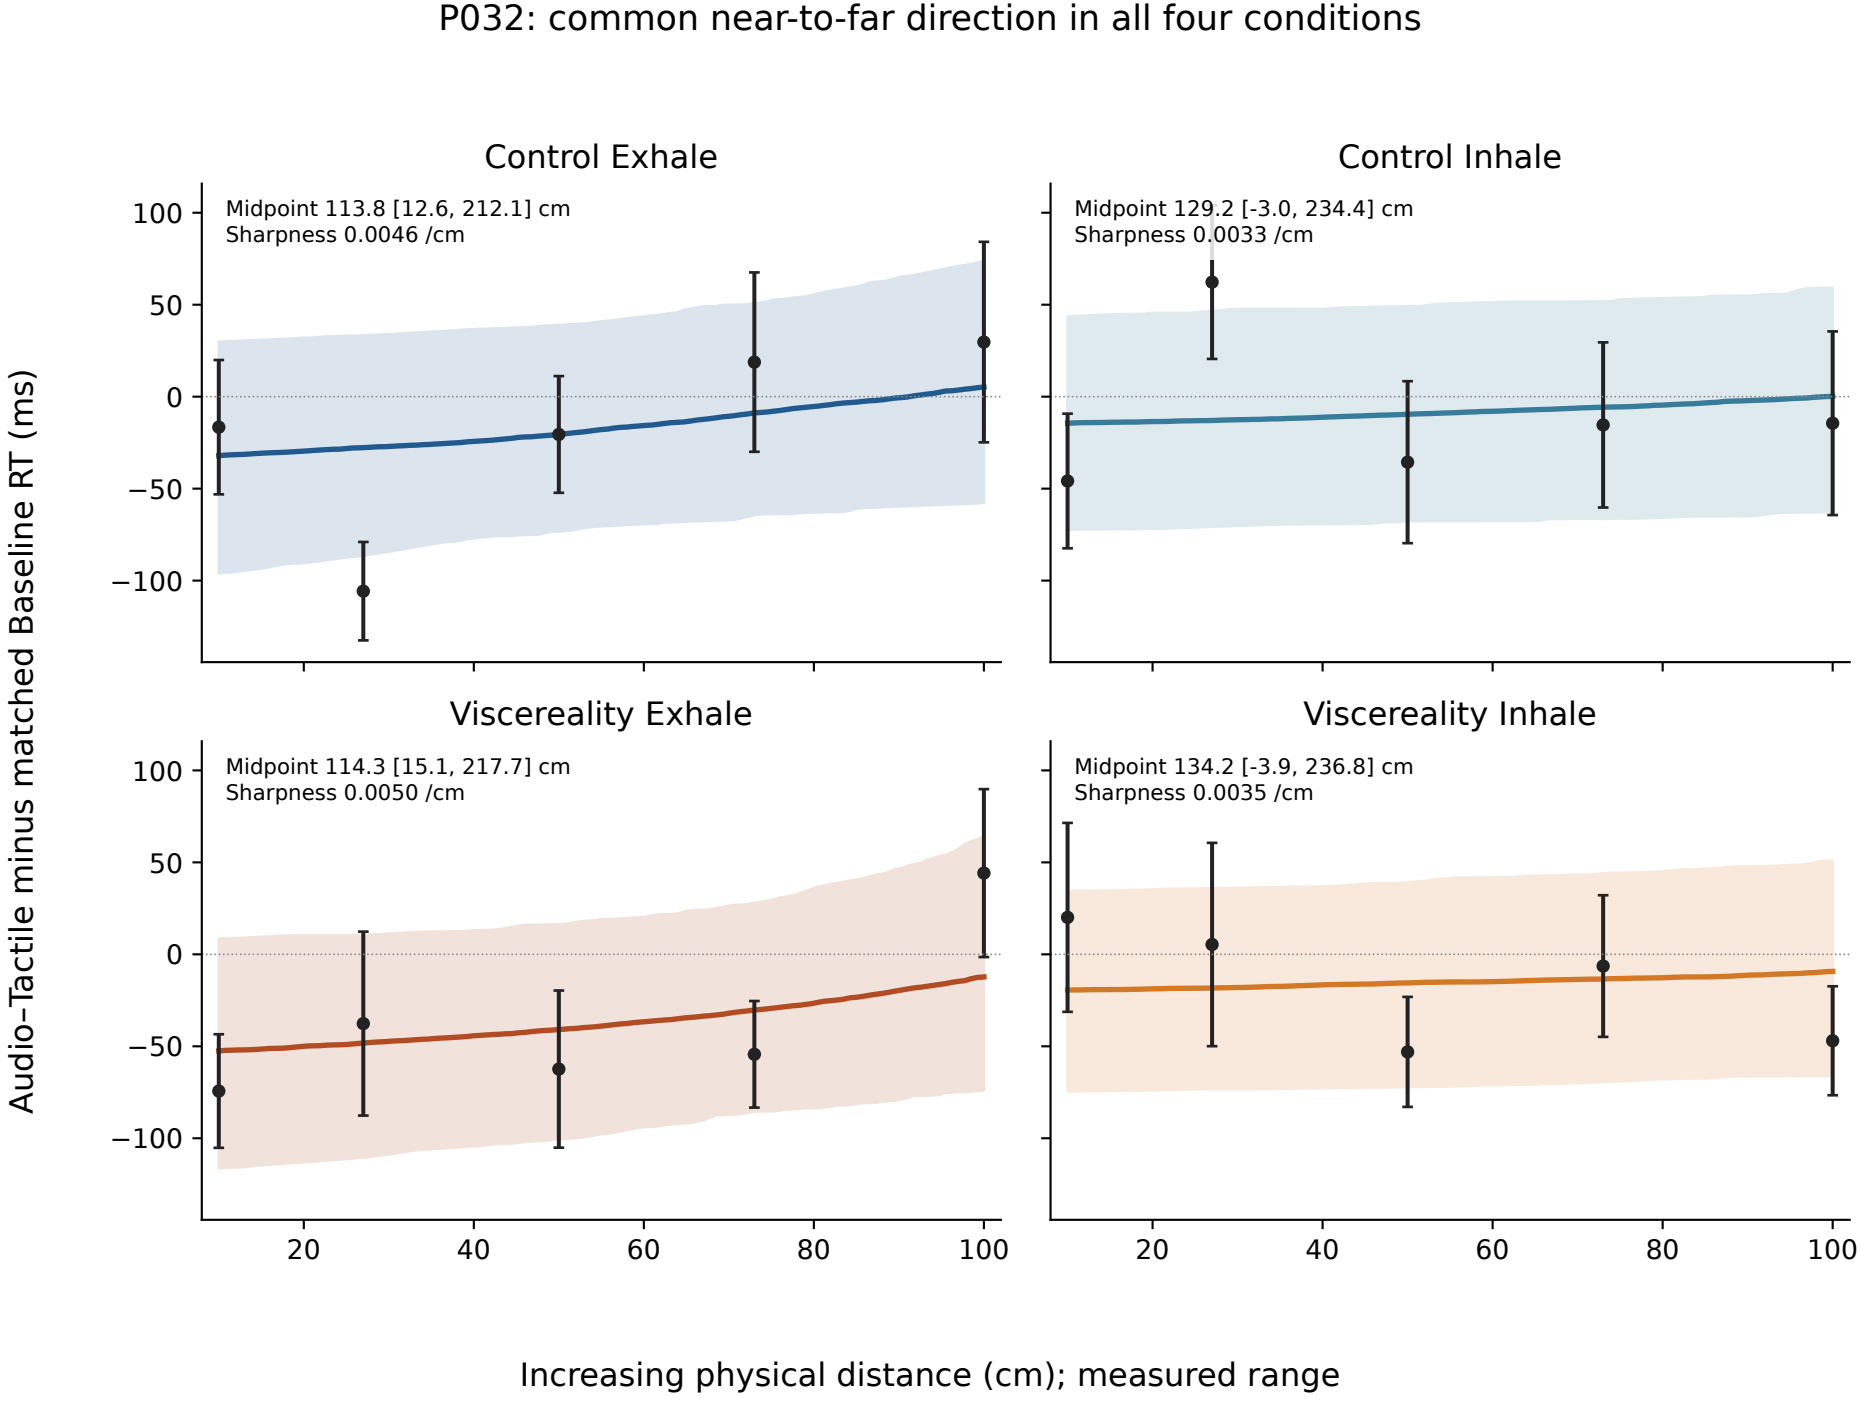

P027: common near-to-far direction in all four conditions
Control Exhale
Midpoint 126.9 [5.0, 234.7] cm
Sharpness 0.0037 /cm
Control Inhale
Midpoint 132.5 [-0.3, 248.5] cm
Sharpness 0.0030 /cm
Viscereality Exhale
Midpoint 127.0 [8.1, 236.3] cm
Sharpness 0.0041 /cm
Viscereality Inhale
Midpoint 136.4 [-5.5, 251.5] cm
Sharpness 0.0032 /cm
Audio–Tactile minus matched Baseline RT (ms)
150
100
50
0
−50
−100
−150
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

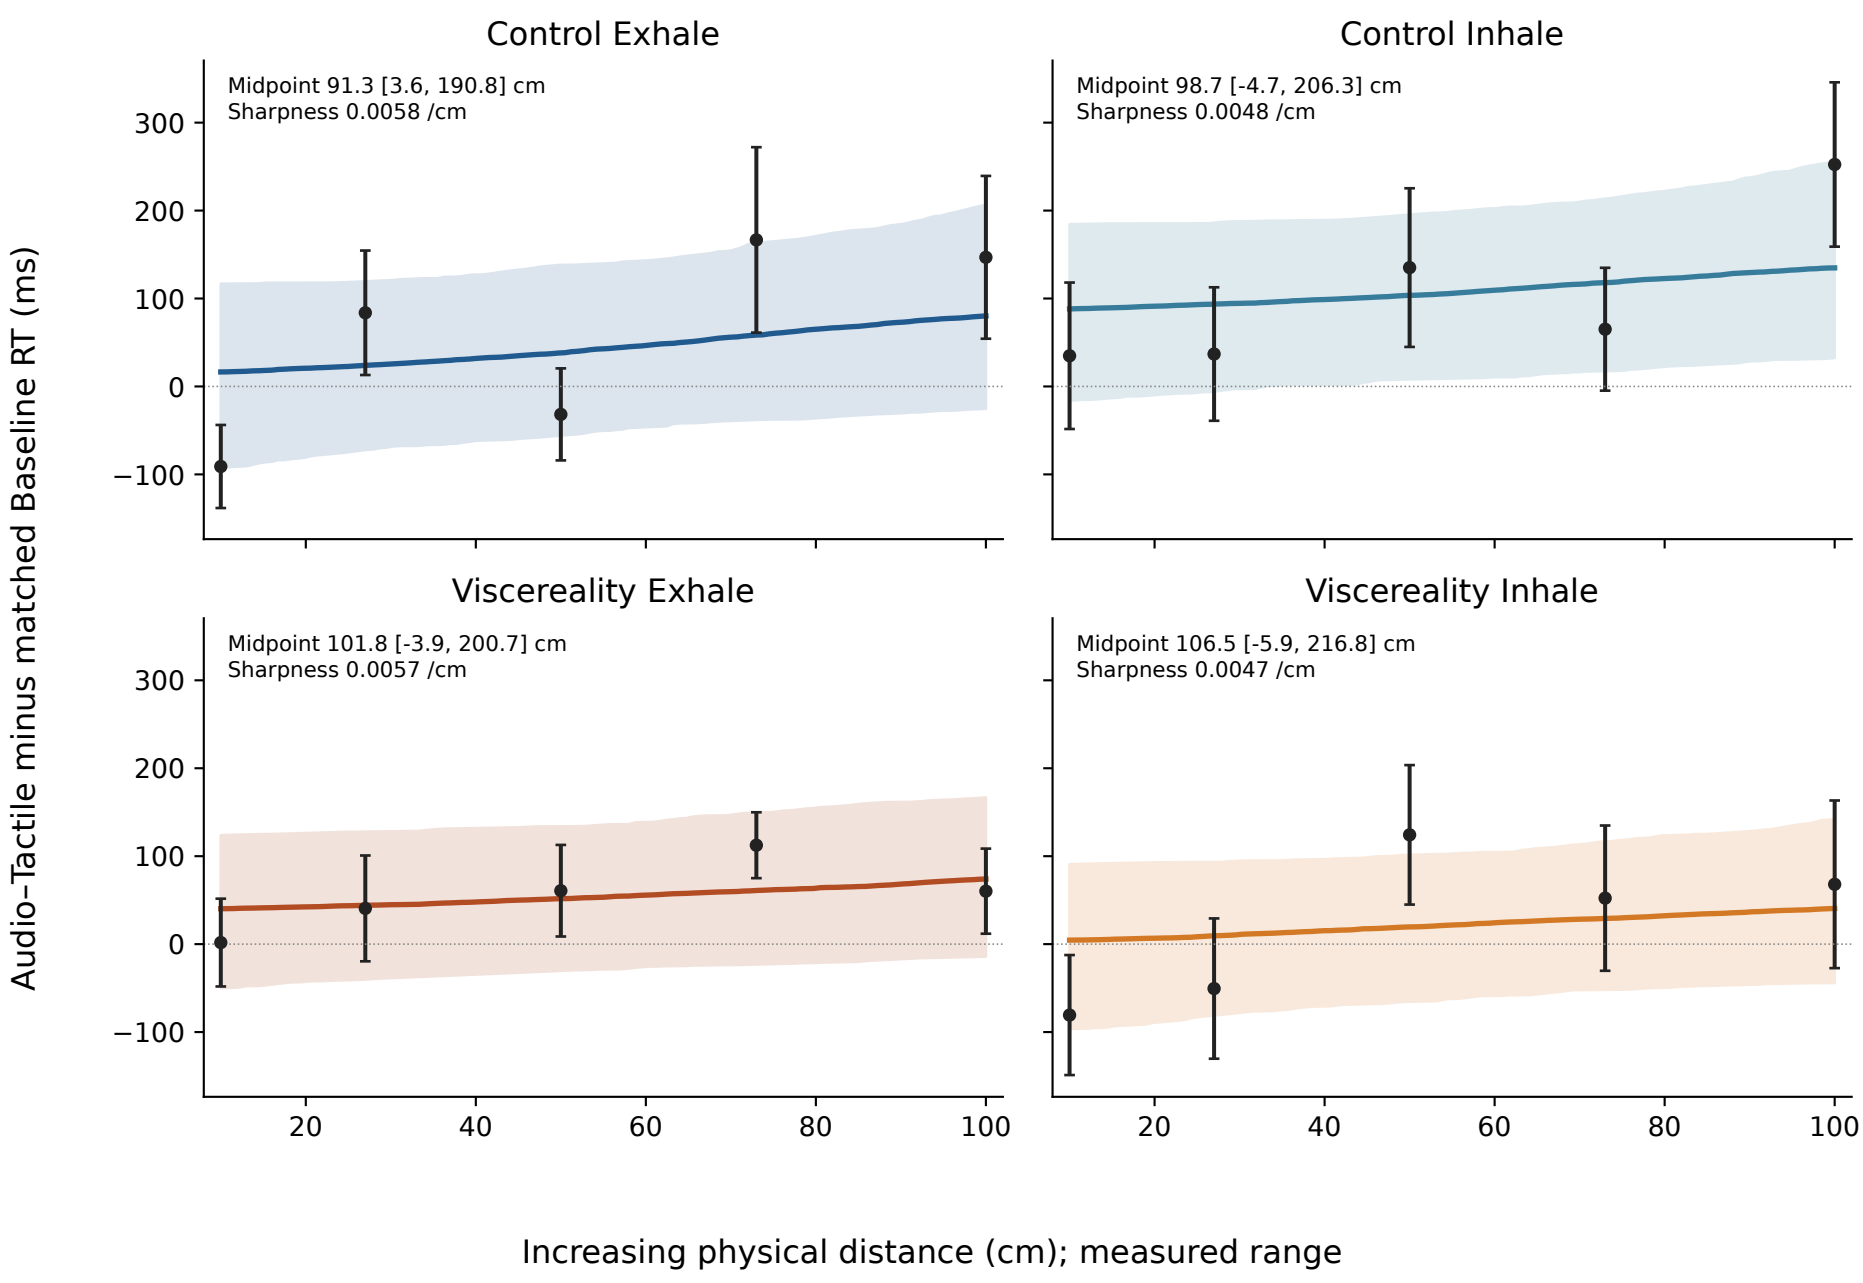

P028: common near-to-far direction in all four conditions
Control Exhale
Midpoint 132.3 [5.5, 244.9] cm
Sharpness 0.0034 /cm
Control Inhale
Midpoint 138.6 [-4.5, 260.2] cm
Sharpness 0.0027 /cm
Viscereality Exhale
Midpoint 134.9 [3.8, 247.4] cm
Sharpness 0.0037 /cm
Viscereality Inhale
Midpoint 142.0 [-2.5, 261.7] cm
Sharpness 0.0029 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

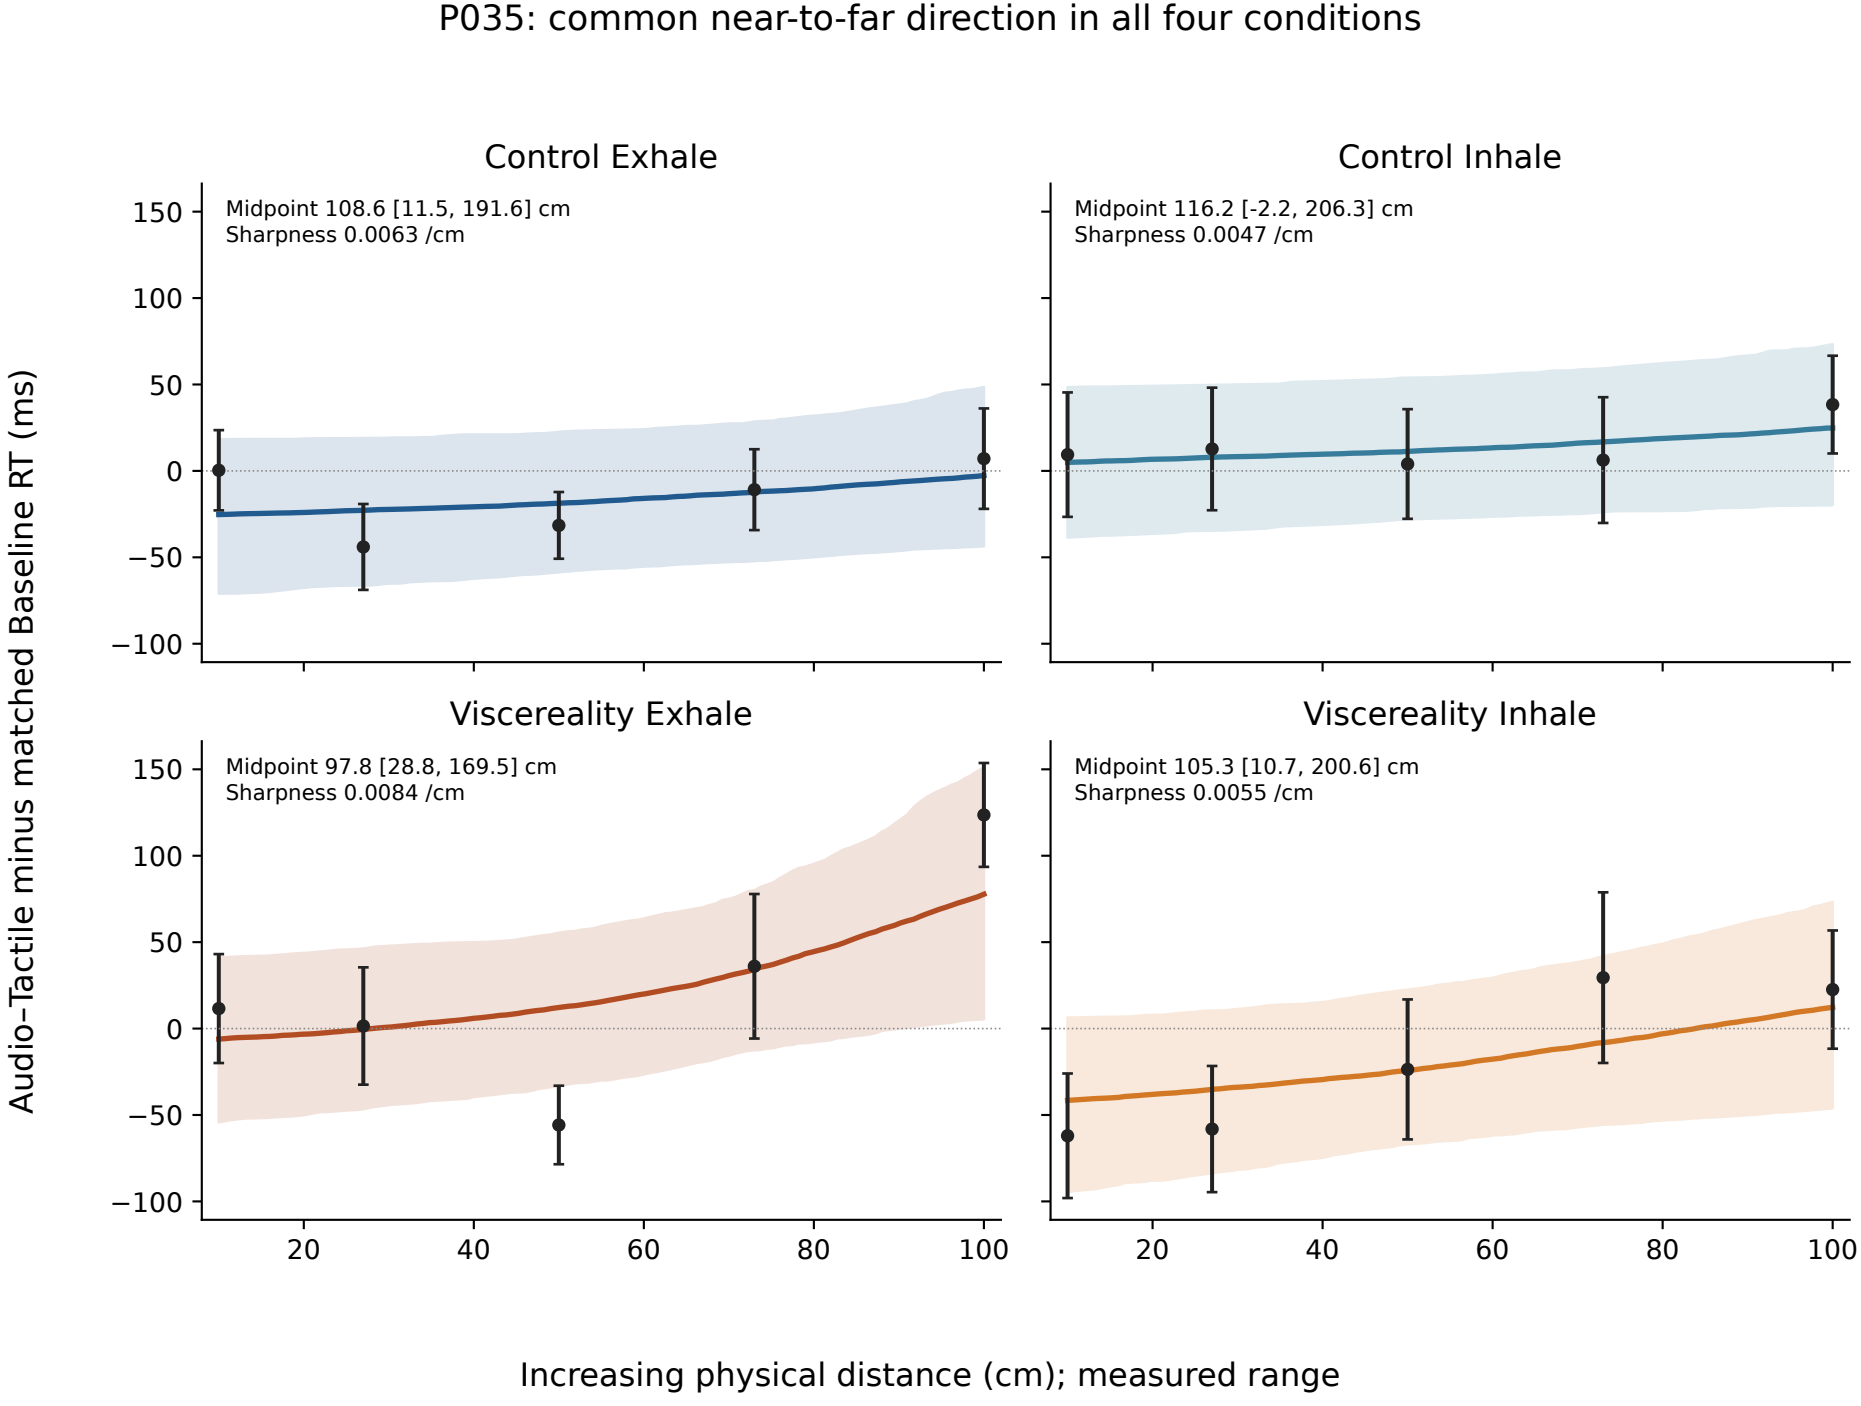

P029: common near-to-far direction in all four conditions
Control Exhale
Midpoint 118.2 [3.2, 214.4] cm
Sharpness 0.0039 /cm
Control Inhale
Midpoint 126.9 [-5.7, 228.4] cm
Sharpness 0.0031 /cm
Viscereality Exhale
Midpoint 123.3 [1.2, 219.0] cm
Sharpness 0.0041 /cm
Viscereality Inhale
Midpoint 127.8 [-1.8, 232.4] cm
Sharpness 0.0034 /cm
Audio–Tactile minus matched Baseline RT (ms)
50
0
−50
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

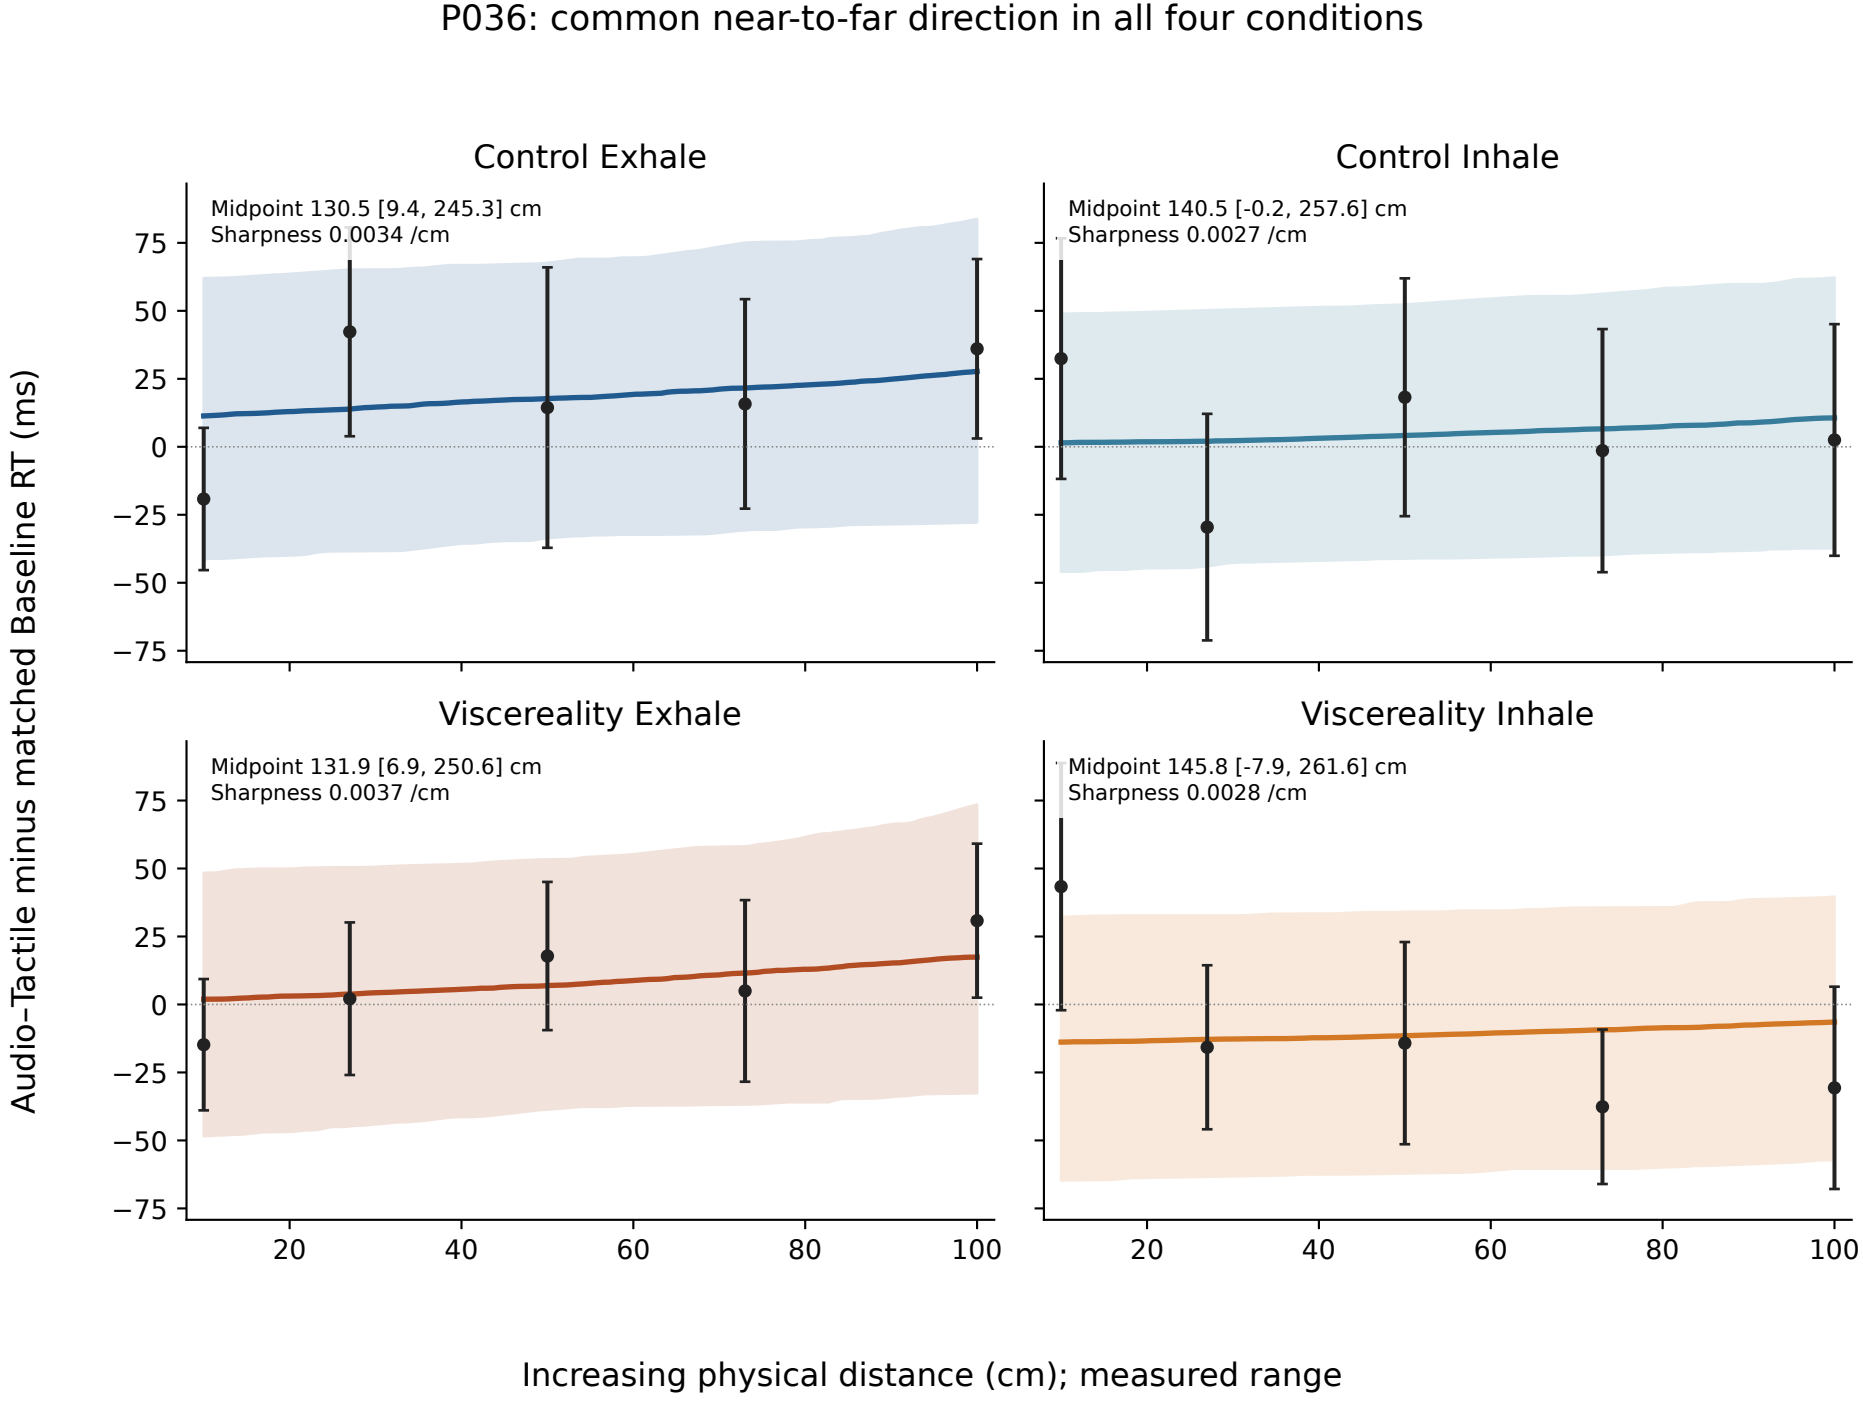

P030: common near-to-far direction in all four conditions
Control Exhale
Midpoint 130.4 [1.6, 241.2] cm
Sharpness 0.0036 /cm
Control Inhale
Midpoint 135.2 [-3.5, 252.2] cm
Sharpness 0.0029 /cm
Viscereality Exhale
Midpoint 130.5 [2.9, 243.6] cm
Sharpness 0.0038 /cm
Viscereality Inhale
Midpoint 137.4 [-2.9, 256.6] cm
Sharpness 0.0031 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

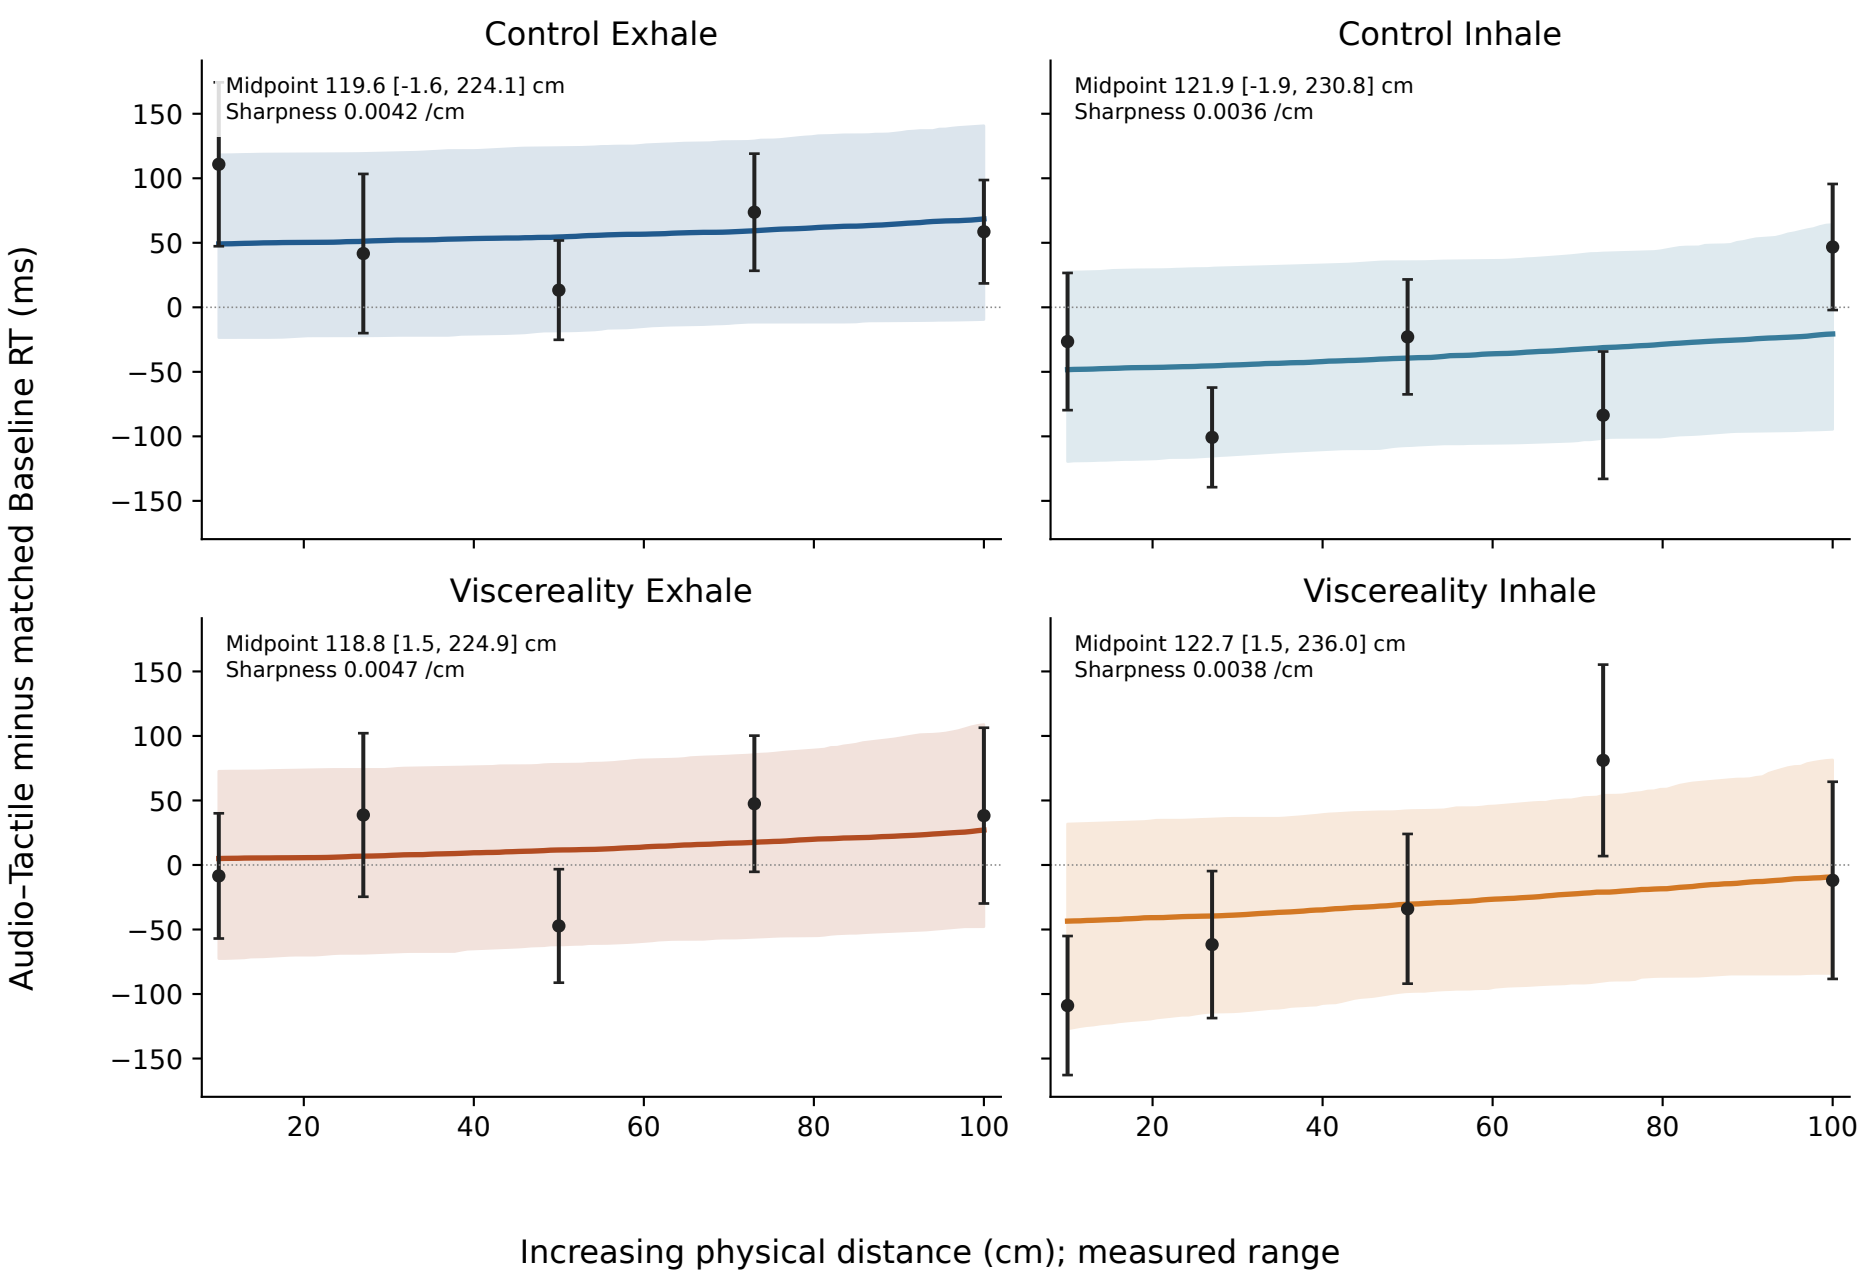

P031: common near-to-far direction in all four conditions
Control Exhale
Midpoint 134.2 [5.7, 246.9] cm
Sharpness 0.0033 /cm
Control Inhale
Midpoint 142.7 [-3.4, 261.2] cm
Sharpness 0.0025 /cm
Viscereality Exhale
Midpoint 138.2 [3.6, 255.1] cm
Sharpness 0.0035 /cm
Viscereality Inhale
Midpoint 148.8 [-7.8, 267.8] cm
Sharpness 0.0026 /cm
Audio–Tactile minus matched Baseline RT (ms)
40
20
0
−20
−40
−60
−80
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

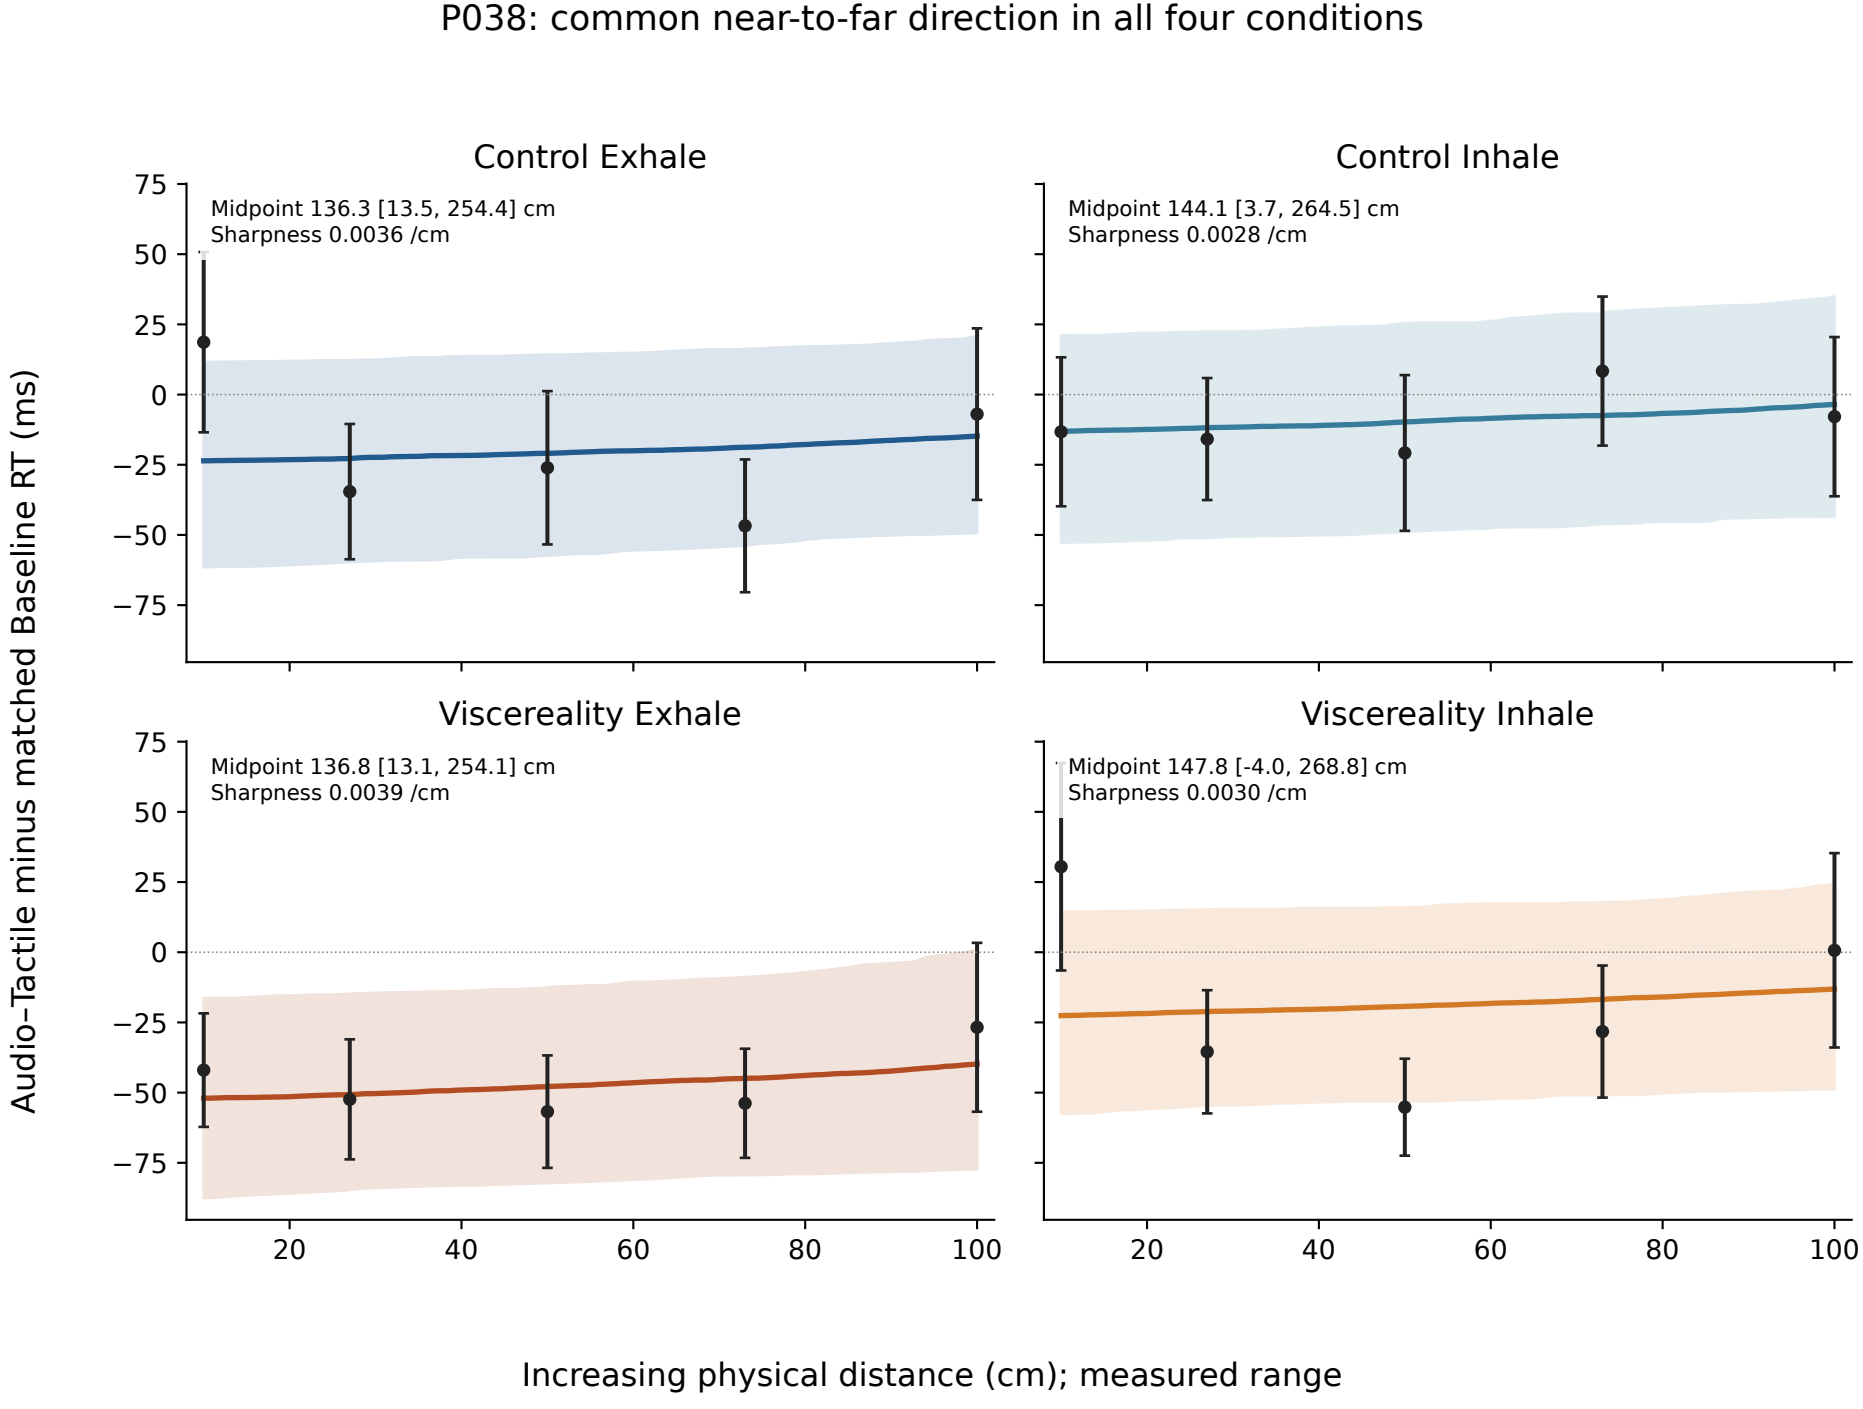

P032: common near-to-far direction in all four conditions
Control Exhale
Midpoint 113.8 [12.6, 212.1] cm
Sharpness 0.0046 /cm
Control Inhale
Midpoint 129.2 [-3.0, 234.4] cm
Sharpness 0.0033 /cm
Viscereality Exhale
Midpoint 114.3 [15.1, 217.7] cm
Sharpness 0.0050 /cm
Viscereality Inhale
Midpoint 134.2 [-3.9, 236.8] cm
Sharpness 0.0035 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

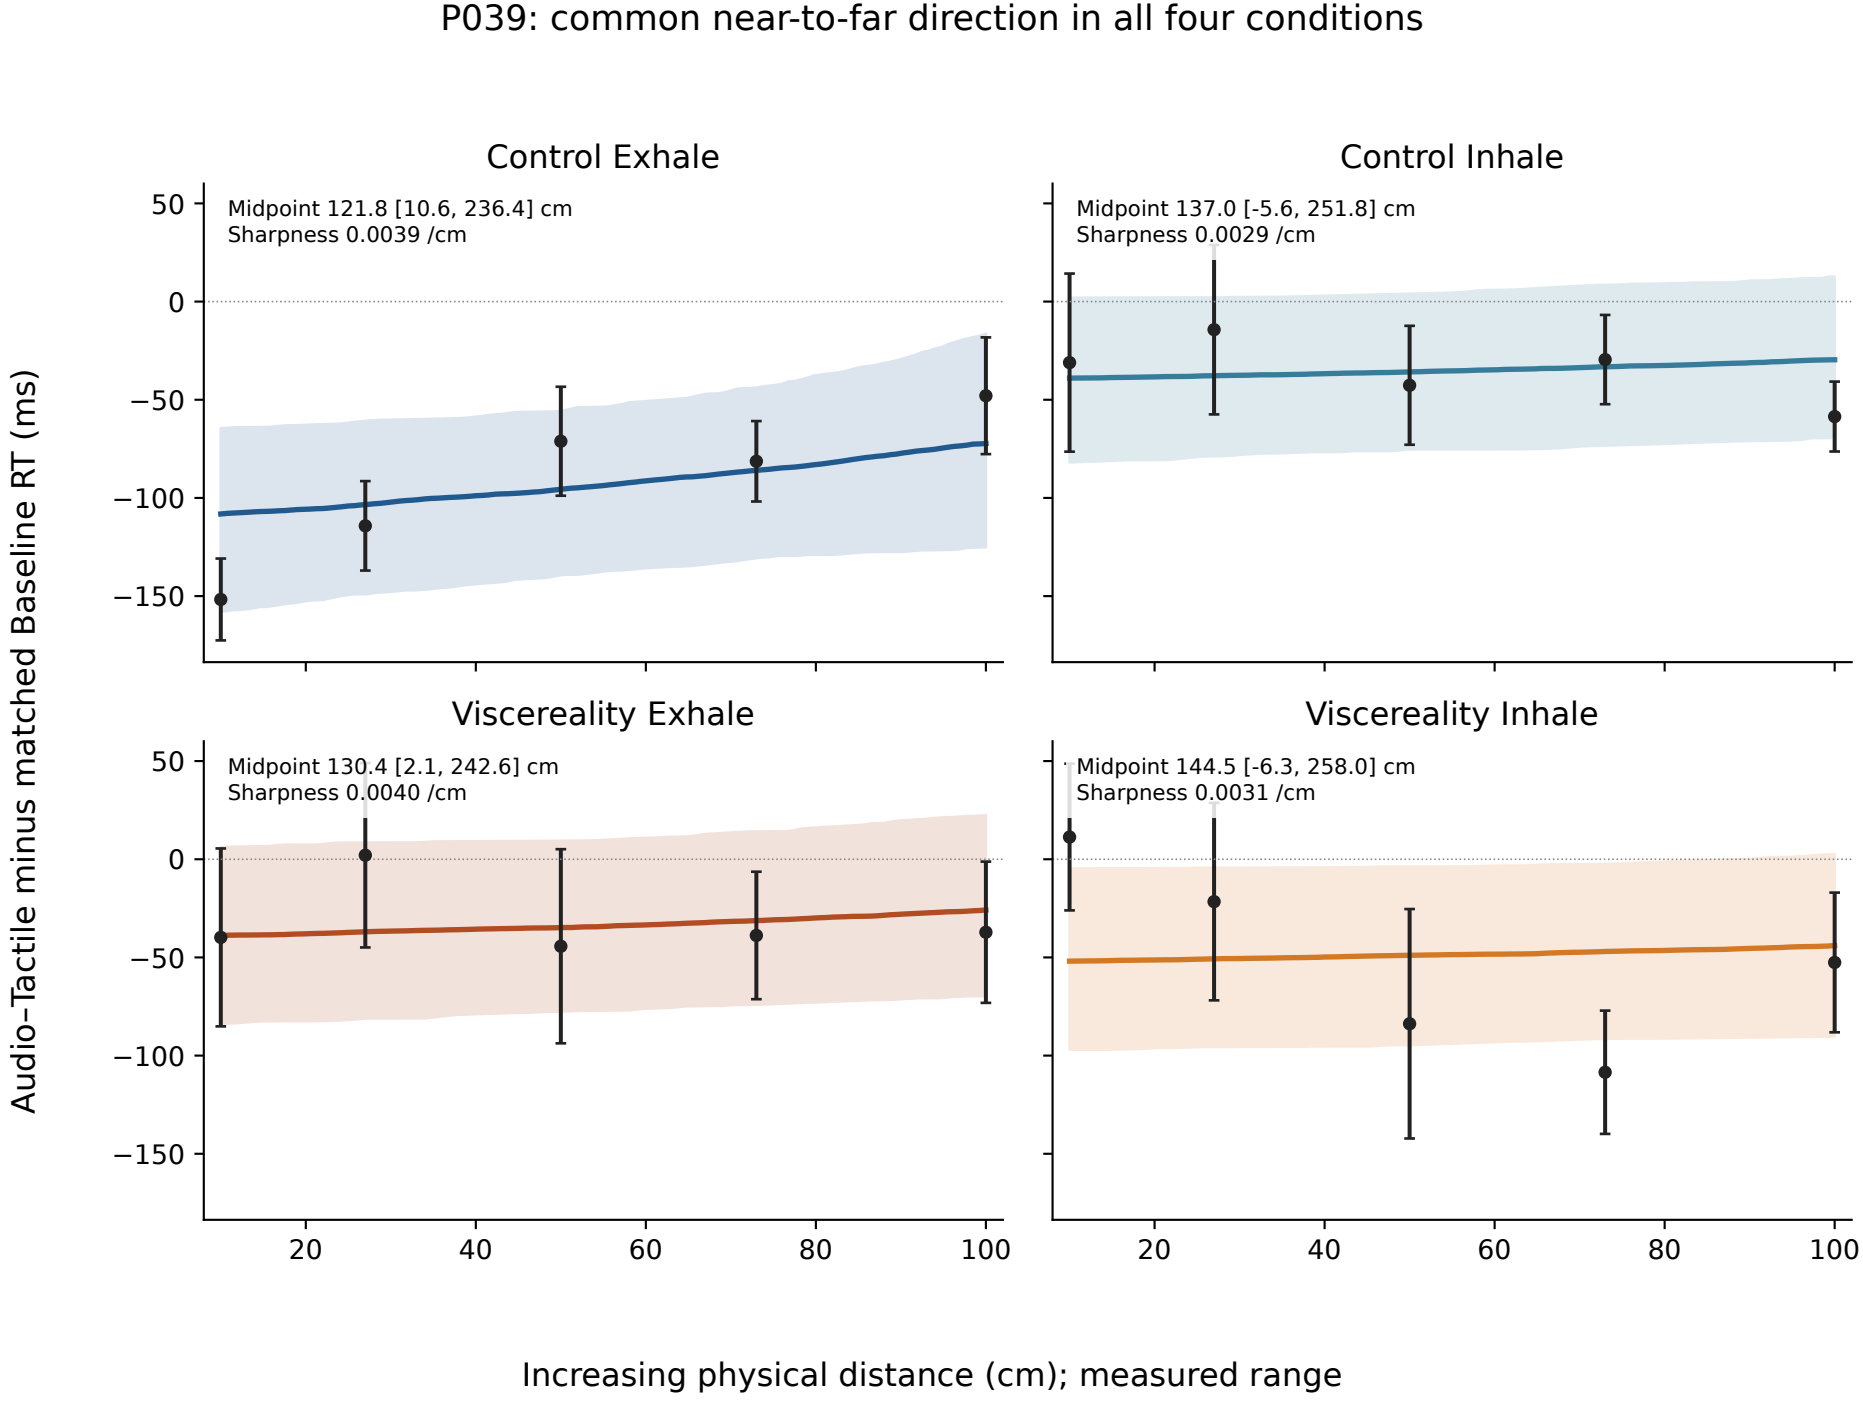

P034: common near-to-far direction in all four conditions
Control Exhale
Midpoint 91.3 [3.6, 190.8] cm
Sharpness 0.0058 /cm
Control Inhale
Midpoint 98.7 [-4.7, 206.3] cm
Sharpness 0.0048 /cm
Viscereality Exhale
Midpoint 101.8 [-3.9, 200.7] cm
Sharpness 0.0057 /cm
Viscereality Inhale
Midpoint 106.5 [-5.9, 216.8] cm
Sharpness 0.0047 /cm
Audio–Tactile minus matched Baseline RT (ms)
300
200
100
0
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

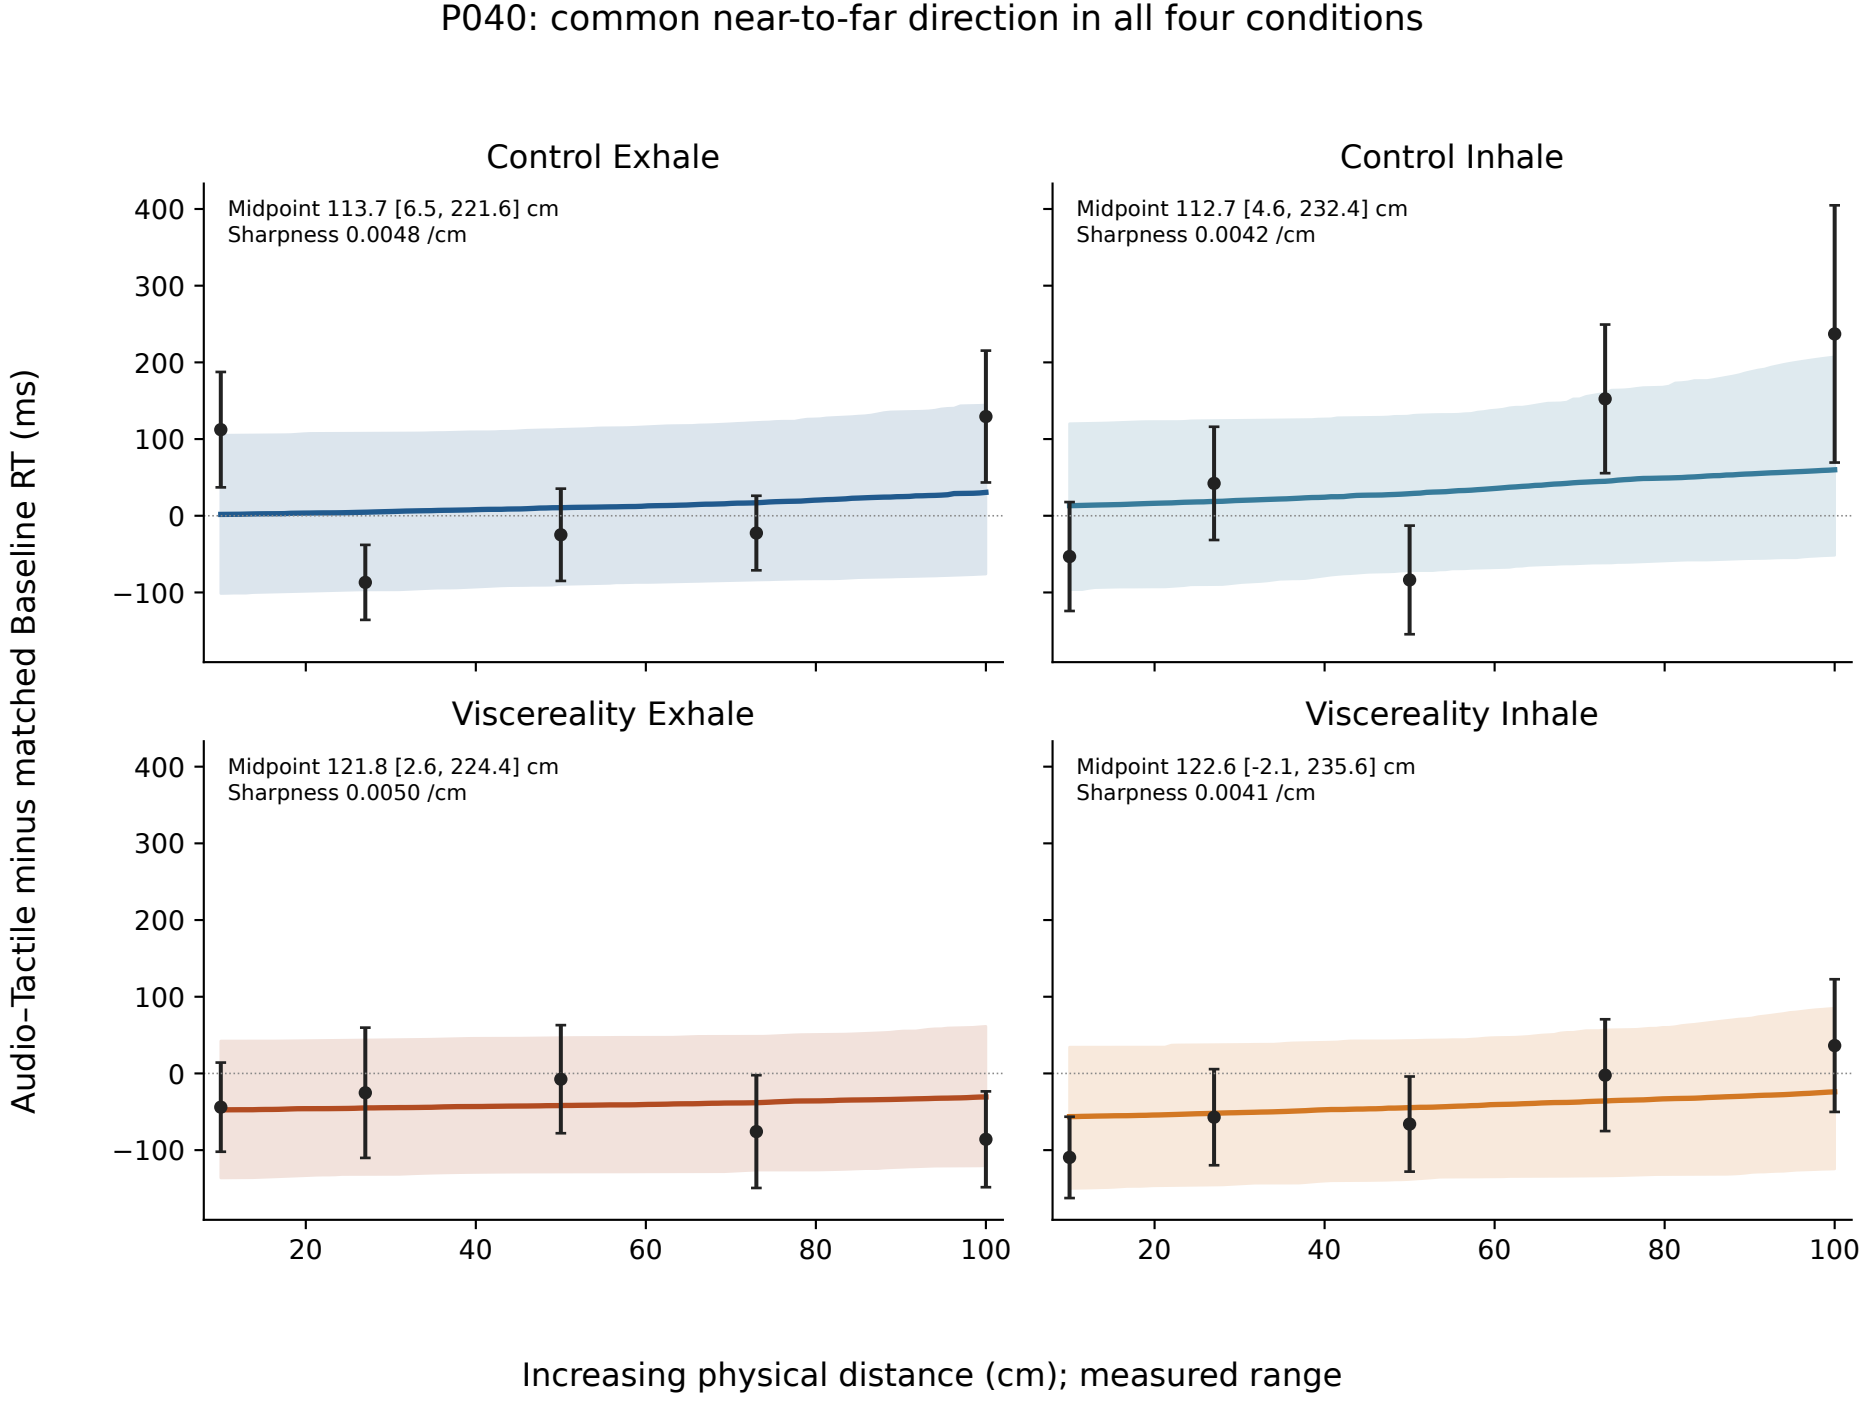

P035: common near-to-far direction in all four conditions
Control Exhale
Midpoint 108.6 [11.5, 191.6] cm
Sharpness 0.0063 /cm
Control Inhale
Midpoint 116.2 [-2.2, 206.3] cm
Sharpness 0.0047 /cm
Viscereality Exhale
Midpoint 97.8 [28.8, 169.5] cm
Sharpness 0.0084 /cm
Viscereality Inhale
Midpoint 105.3 [10.7, 200.6] cm
Sharpness 0.0055 /cm
Audio–Tactile minus matched Baseline RT (ms)
150
100
50
0
−50
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.

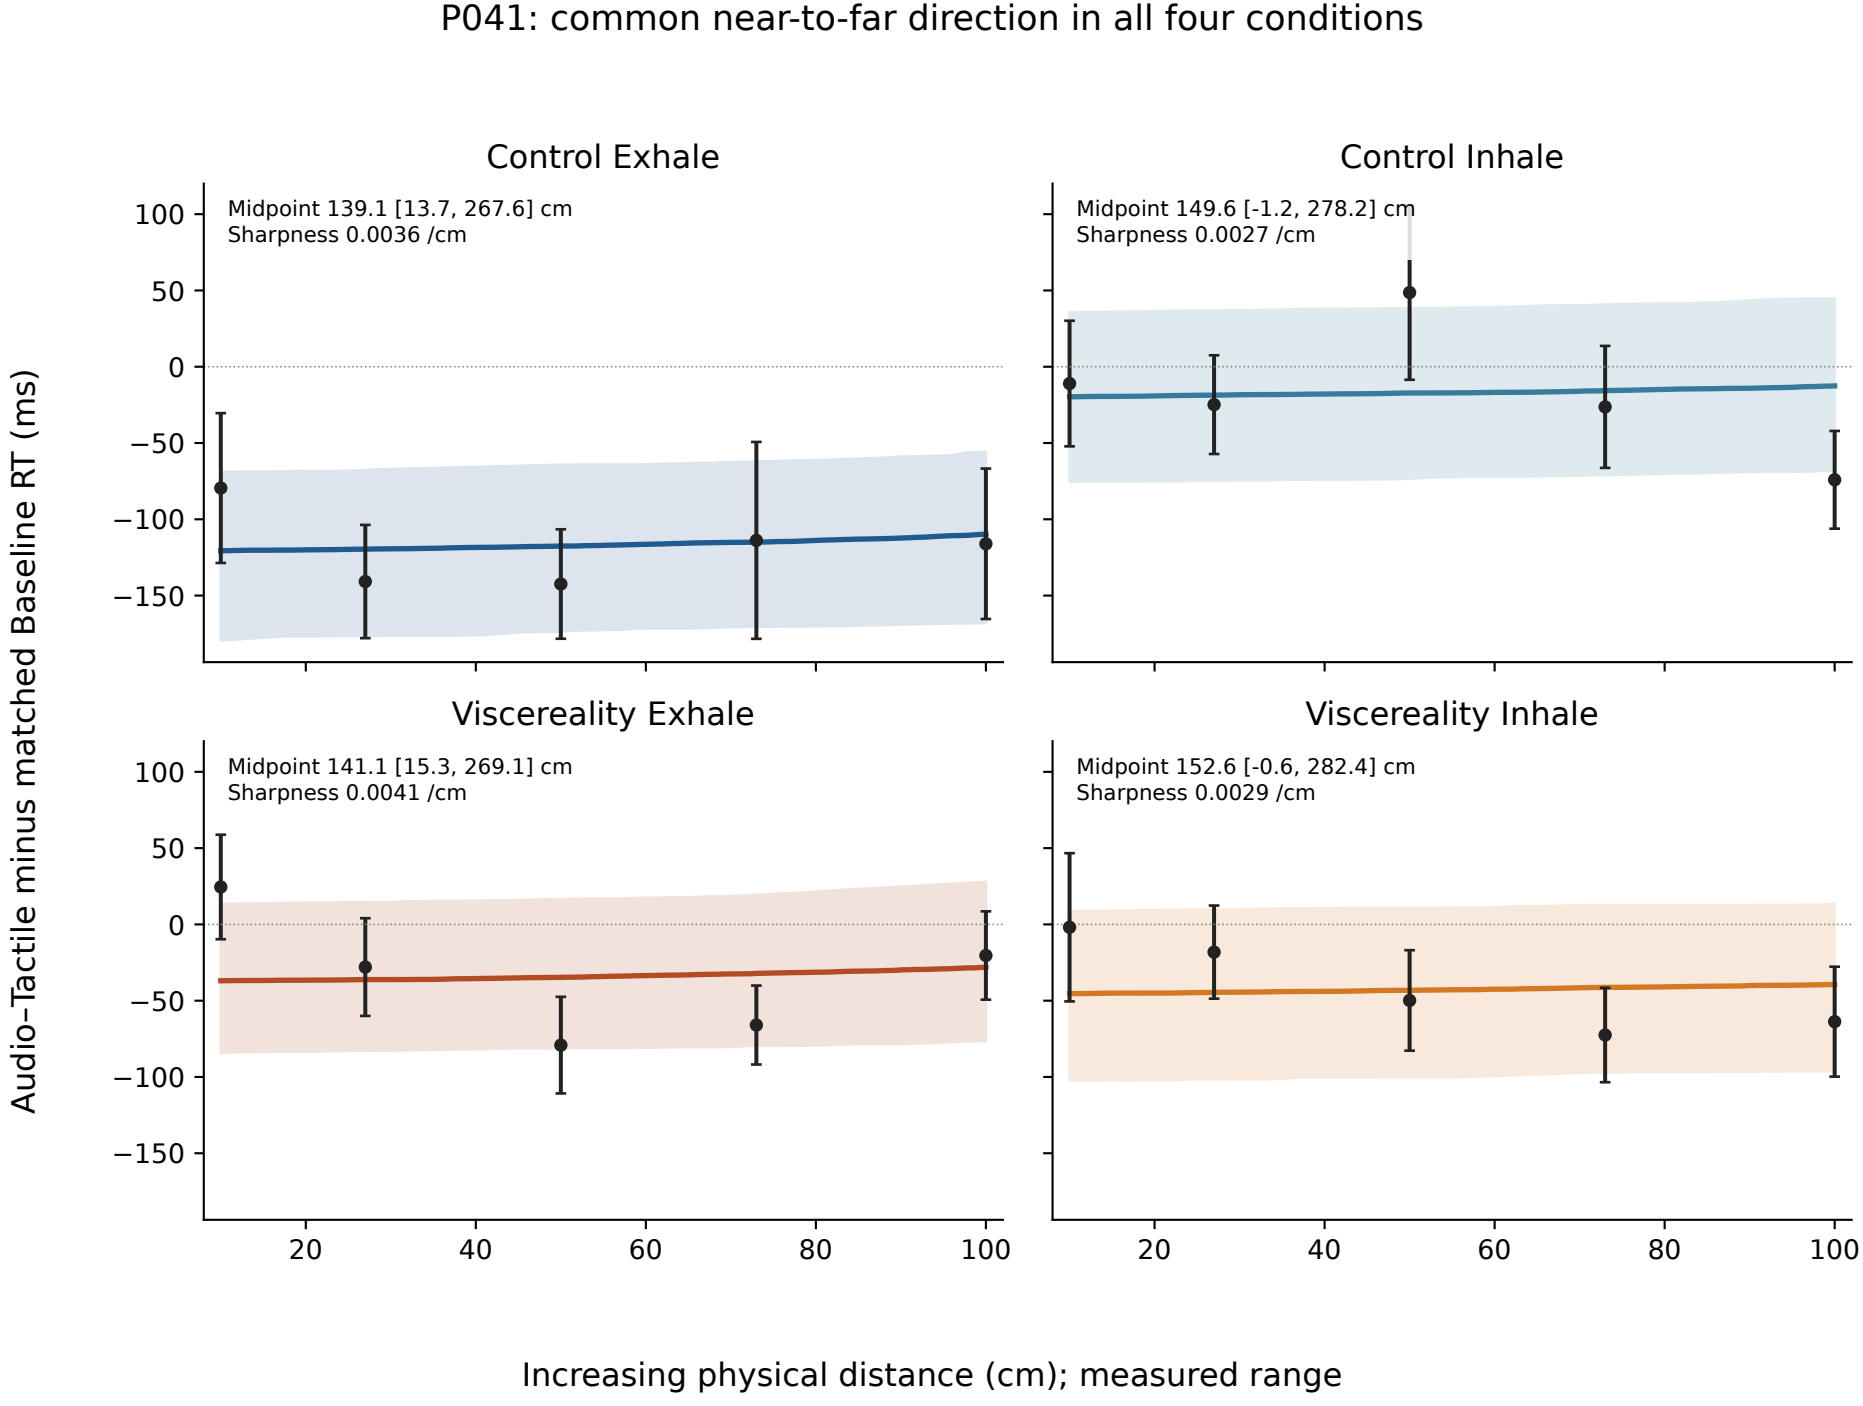

P036: common near-to-far direction in all four conditions
Control Exhale
Midpoint 130.5 [9.4, 245.3] cm
Sharpness 0.0034 /cm
Control Inhale
Midpoint 140.5 [-0.2, 257.6] cm
Sharpness 0.0027 /cm
Viscereality Exhale
Midpoint 131.9 [6.9, 250.6] cm
Sharpness 0.0037 /cm
Viscereality Inhale
Midpoint 145.8 [-7.9, 261.6] cm
Sharpness 0.0028 /cm
Audio–Tactile minus matched Baseline RT (ms)
75
50
25
0
−25
−50
−75
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.


P037: common near-to-far direction in all four conditions
Control Exhale
Midpoint 119.6 [-1.6, 224.1] cm
Sharpness 0.0042 /cm
Control Inhale
Midpoint 121.9 [-1.9, 230.8] cm
Sharpness 0.0036 /cm
Viscereality Exhale
Midpoint 118.8 [1.5, 224.9] cm
Sharpness 0.0047 /cm
Viscereality Inhale
Midpoint 122.7 [1.5, 236.0] cm
Sharpness 0.0038 /cm
Audio–Tactile minus matched Baseline RT (ms)
150
100
50
0
−50
−100
−150
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.


P038: common near-to-far direction in all four conditions
Control Exhale
Midpoint 136.3 [13.5, 254.4] cm
Sharpness 0.0036 /cm
Control Inhale
Midpoint 144.1 [3.7, 264.5] cm
Sharpness 0.0028 /cm
Viscereality Exhale
Midpoint 136.8 [13.1, 254.1] cm
Sharpness 0.0039 /cm
Viscereality Inhale
Midpoint 147.8 [-4.0, 268.8] cm
Sharpness 0.0030 /cm
Audio–Tactile minus matched Baseline RT (ms)
75
50
25
0
−25
−50
−75
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.


P039: common near-to-far direction in all four conditions
Control Exhale
Midpoint 121.8 [10.6, 236.4] cm
Sharpness 0.0039 /cm
Control Inhale
Midpoint 137.0 [-5.6, 251.8] cm
Sharpness 0.0029 /cm
Viscereality Exhale
Midpoint 130.4 [2.1, 242.6] cm
Sharpness 0.0040 /cm
Viscereality Inhale
Midpoint 144.5 [-6.3, 258.0] cm
Sharpness 0.0031 /cm
Audio–Tactile minus matched Baseline RT (ms)
50
0
−50
−100
−150
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.


P040: common near-to-far direction in all four conditions
Control Exhale
Midpoint 113.7 [6.5, 221.6] cm
Sharpness 0.0048 /cm
Control Inhale
Midpoint 112.7 [4.6, 232.4] cm
Sharpness 0.0042 /cm
Viscereality Exhale
Midpoint 121.8 [2.6, 224.4] cm
Sharpness 0.0050 /cm
Viscereality Inhale
Midpoint 122.6 [-2.1, 235.6] cm
Sharpness 0.0041 /cm
Audio–Tactile minus matched Baseline RT (ms)
400
300
200
100
0
−100
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.


P041: common near-to-far direction in all four conditions
Control Exhale
Midpoint 139.1 [13.7, 267.6] cm
Sharpness 0.0036 /cm
Control Inhale
Midpoint 149.6 [-1.2, 278.2] cm
Sharpness 0.0027 /cm
Viscereality Exhale
Midpoint 141.1 [15.3, 269.1] cm
Sharpness 0.0041 /cm
Viscereality Inhale
Midpoint 152.6 [-0.6, 282.4] cm
Sharpness 0.0029 /cm
Audio–Tactile minus matched Baseline RT (ms)
100
50
0
−50
−100
−150
20
40
60
80
100
Increasing physical distance (cm); measured range
Dots: unsmoothed means ± marginal SE; baseline error is shared. Band: 95% expected-response interval.
Near lower / far higher RT is imposed by A ≥ 0; a flat-looking curve or an unobserved plateau remains possible.