



CHAPTER

Dosing System

Antiscalant, pH correction and CIP dosing pumps

IN THIS CHAPTER

12.1	Overview and function	84
12.2	Key specifications	85
12.3	Operation	86
12.4	Maintenance	87
12.5	Troubleshooting	88

12.1 Overview and function

Dosing pumps inject antiscalant and pH-correction chemicals (NaOH, HCl, and in the pilot configuration also H₂SO₄) into the feed stream, and supply CIP (clean-in-place) chemicals for periodic cleaning. The documented pilot configuration used 5 dosing channels.

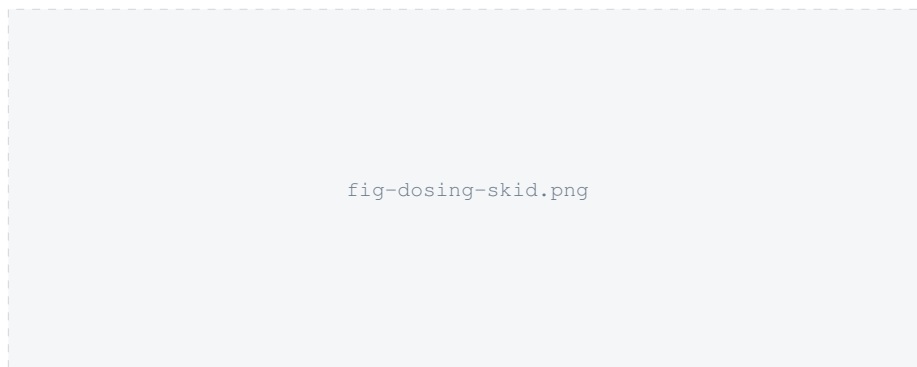


Figure 12.1. Suggested figure: photograph of the dosing skid, with each chemical tank and pump labeled (antiscalant, NaOH, HCl, CIP).

12.2 Key specifications

- 5 dosing channels (pilot configuration), each controlled via a 4–20 mA signal from ADAM I/O modules.
- Signal range: SET 1 = 4.0 mA (0 impulses/min, pump stopped), SET 2 = 20.0 mA (180 impulses/min).
- Chemicals confirmed in the pilot tag list and in Safety Data Sheets held by HydroVolta: antiscalant (AS), NaOH, HCl, NaOCl (sodium hypochlorite) and, in some configurations, H₂SO₄ as an alternative acid.
- Candidate dosing pump: **Etatron GB eOne** series — flow rate 1–30 l/h, max. pressure 20 bar, 100–250 V AC 50/60 Hz supply, max. 300 pulses/min, PVDF pump head with double ceramic ball valves and PTFE diaphragm. The **MF** (multifunction) variant adds proportional dosing, 4–20 mA control, level-switch input and failure alarms; the **PLUS** variant integrates a pH/ORP/Cl controller. TODO: confirm which variant, and which alternative (Lutz-Jesco MEMDOS Smart / EasyChlorGen also appear in HydroVolta's component library), is fitted to the standard SalinBloc™ product.

12.3 Operation

See section 5.4 in chapter 5 for the default 4–20 mA signal configuration and functional-test procedure used to verify each dosing channel. Setting a dosing pump's frequency from a 4–20 mA signal uses two settings: the **pulse amplitude** (mL per stroke, set manually at the pump) and the **pulse frequency** (set remotely as a % of the pump's maximum, via the 4–20 mA signal). Worked example from a real HydroVolta dosing calculation (antiscalant, 10 ppm target): dilution factor 1333, pulse amplitude 0.01–0.1 mL, giving a dose rate of ≈ 0.167 mL/min (36 mL/h).



WARNING

Never dose NaOH into feed or process water — HydroVolta's own CIP procedure documents this explicitly as a scaling risk. NaOH is only used against pure (permeate-quality) water during CIP.

A documented weekly CIP cycle (source: HydroVolta pilot CIP procedure) runs as follows:

1. **Acid step:** dose HCl to pH 2.5 in the CIP loop, circulating 30 minutes forward-flow then 30 minutes reverse-flow through the stack, using pretreated feedwater.
2. Drain the CIP loop to the concentrate tank, then flush with fresh feed water for 15–20 minutes.
3. **Hypochlorite step:** dose NaOCl to 2 ppm (effective only near pH 7–7.5 — check/correct pH before this step), circulating 30 minutes forward then 30 minutes reverse.
4. Drain 5 minutes, then flush with fresh feed water for 30 minutes.
5. A variant of this cycle that also treats the electrolyte compartment uses NaOH instead of/alongside HCl — **only ever with pure water**, per the warning above.

Typical HCl/NaOH CIP dose rates from a real pilot's dosing calculation sheet (pure, low-alkalinity water): HCl ≈ 5.5 mL/min at 1000 l/h CIP flow, pulse amplitude 0.1 mL, $\approx 31\%$ of max. pump frequency; NaOH ≈ 17.4 mL/min, pulse amplitude 0.3 mL, $\approx 32\%$ of max. frequency. For natural (higher-alkalinity) feed water, acid demand scales with the water's total alkalinity (TA) — a seawater-range feed (TA 25–30 °f) needs roughly 3–4 $\times$ the acid dose of a low-alkalinity feed. TODO: confirm the CIP interval and dose rates that apply to the standard SalinBloc™ product; the figures above are a real, sourced pilot example, not a general specification.

12.4 Maintenance

TODO: no chemical replenishment interval, tubing/diaphragm replacement schedule, or dosing-pump calibration procedure specific to the standard product was found. The CIP cycle above ran approximately weekly in the documented pilot — use this as a starting reference for the maintenance schedule in chapter 7 until a formal interval is confirmed. Per the chemicals' Safety Data Sheets, store all dosing chemicals in their original, tightly closed containers, away from food/drink, at a recommended **15–25 °C**; keep incompatible chemicals (acids vs. NaOH vs. NaOCl) in separate secondary containment. See section 2.5 for first-aid and spill-response guidance.

12.5 Troubleshooting

Low-level alarms exist per chemical: LL_Alarm_AS (antiscalant), LL_Alarm_NaOH, LL_Alarm_HCl, plus per-channel Dosing1_Alarm...Dosing5_Alarm. On any dosing alarm, check chemical tank level first, then verify the 4–20 mA signal at the pump terminal using the bench-test method in chapter 13. If a CIP cycle fails to reach its target pH (2.5 for the acid step), verify the dosing pump's pulse amplitude/frequency setting against the worked example above before suspecting a pump fault.