

Water Quality Data Factsheet

Stations with Discharge (cfs) Data



pH -between 6 and 9

Cause Name :

Cause Group Name :

Cause Description :

STORET No. :


TMDL Pollutant Flag :

Aquatic Life Criteria (acute / chronic) ($\mu\text{g/L}$) :
/


Human Health Criteria (water+organism /organism) ($\mu\text{g/L}$):
/

Organoleptic Effects Criteria ($\mu\text{g/L}$):


Parameter values by waterbody

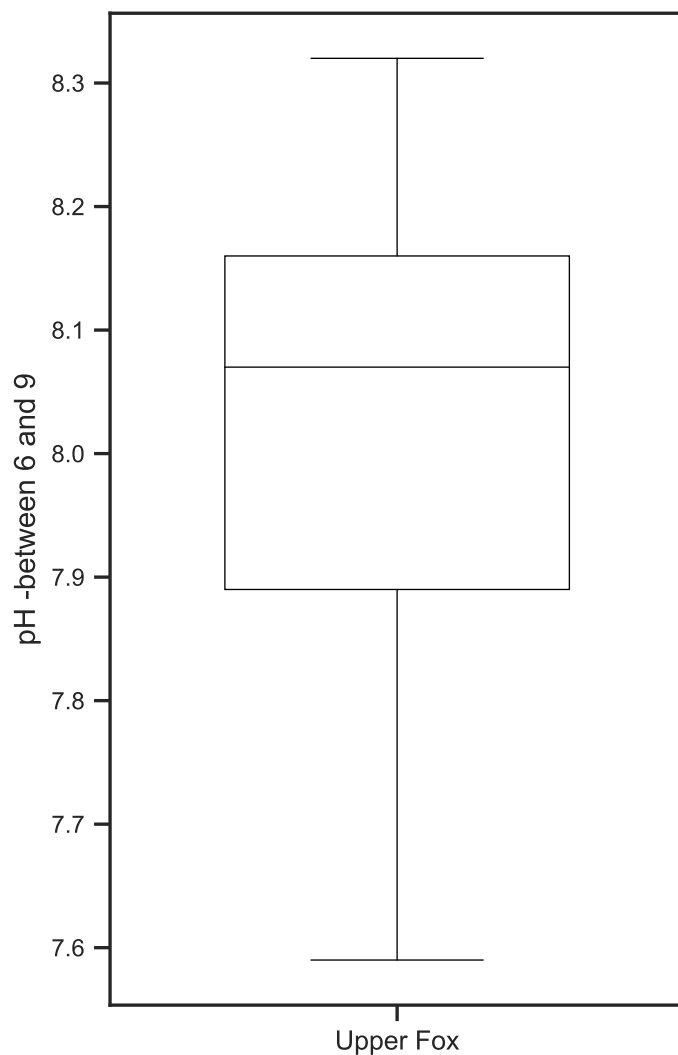


Parameter data availability by station ID and year

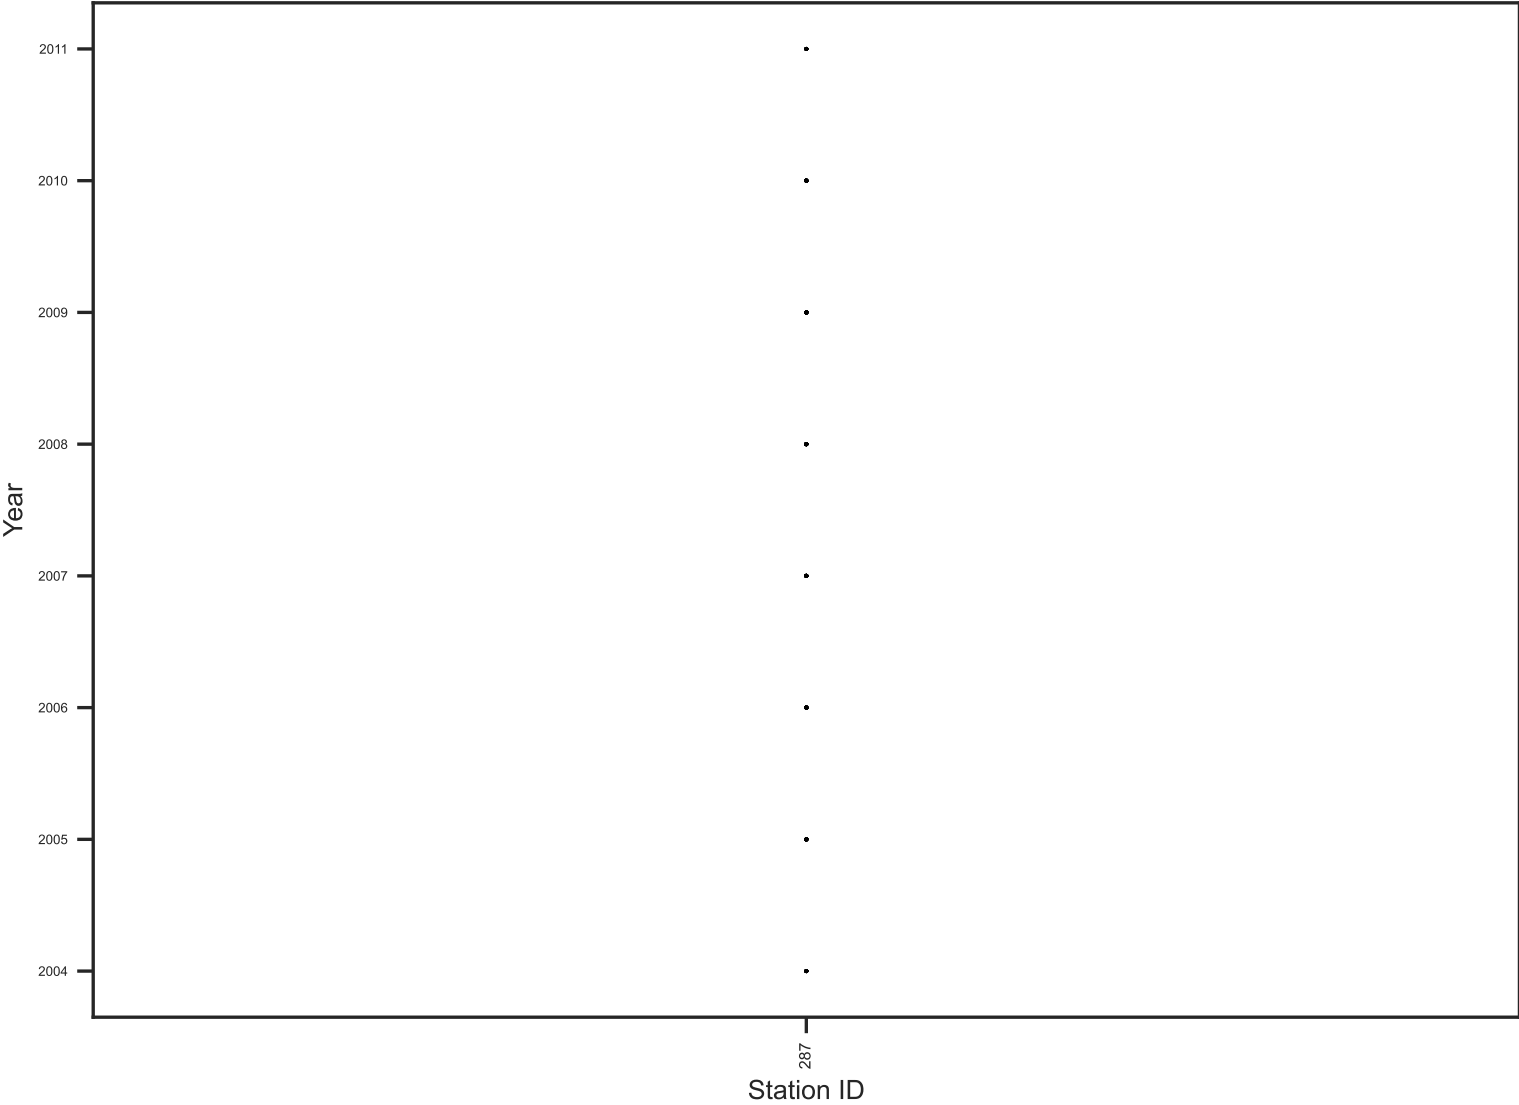


Strip chart of parameter values by station ID

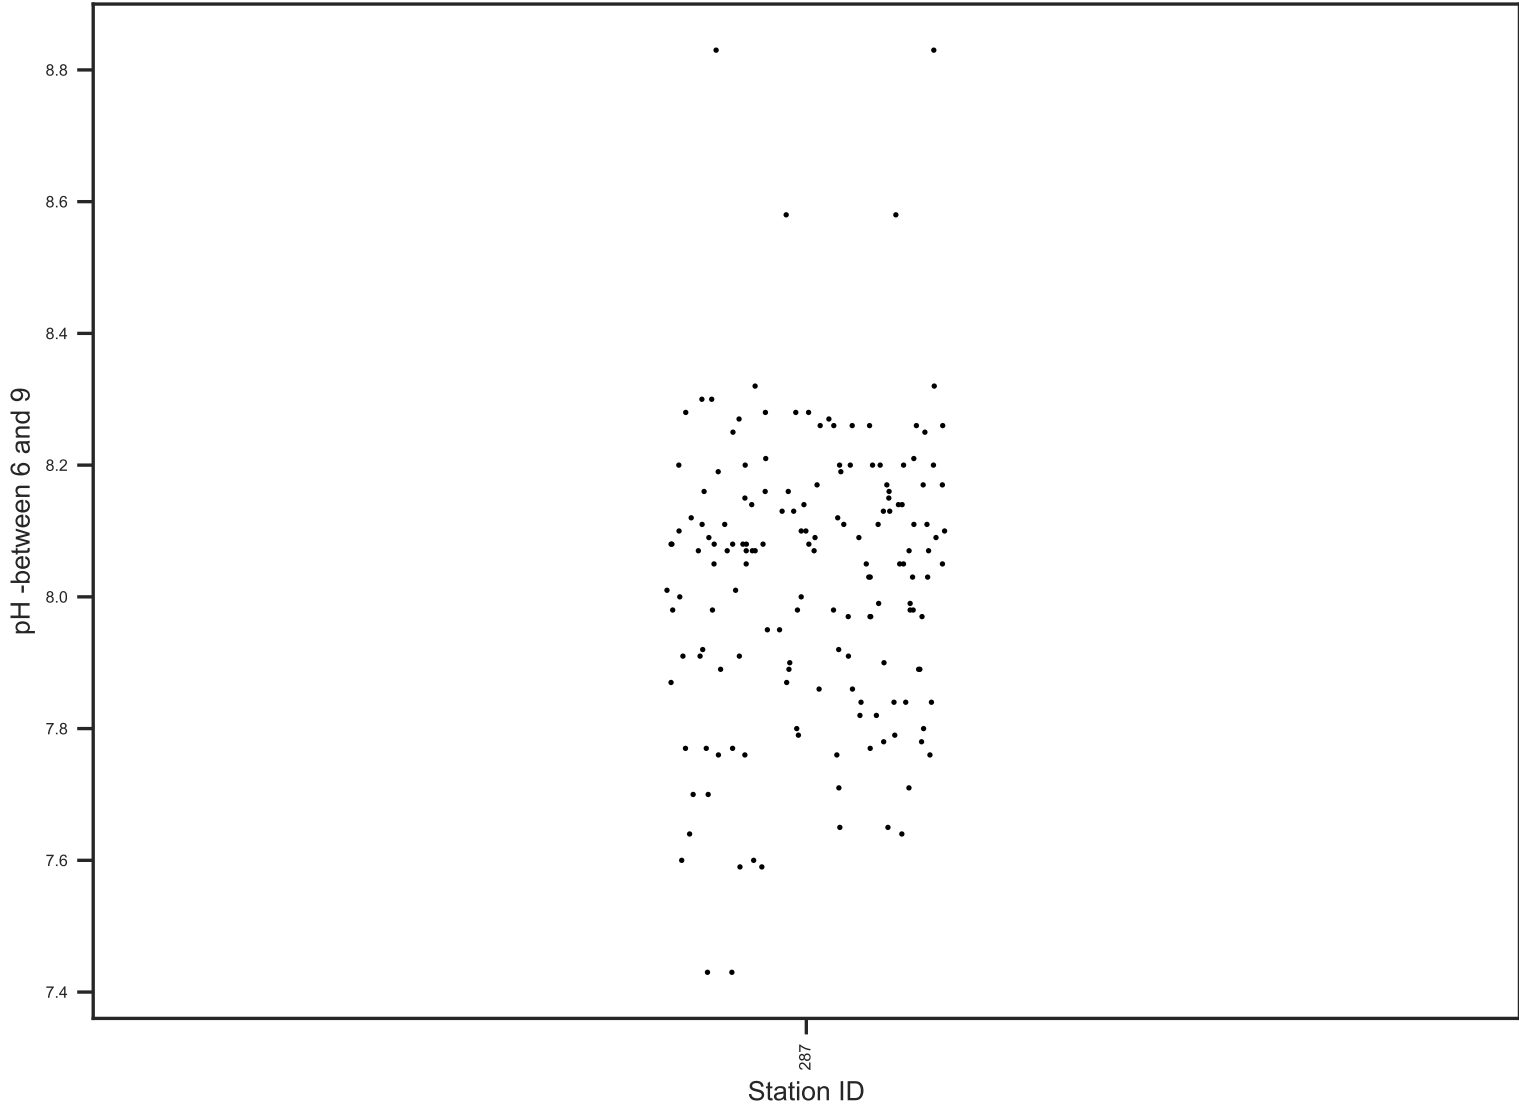

Boxplots of parameter values by Station ID

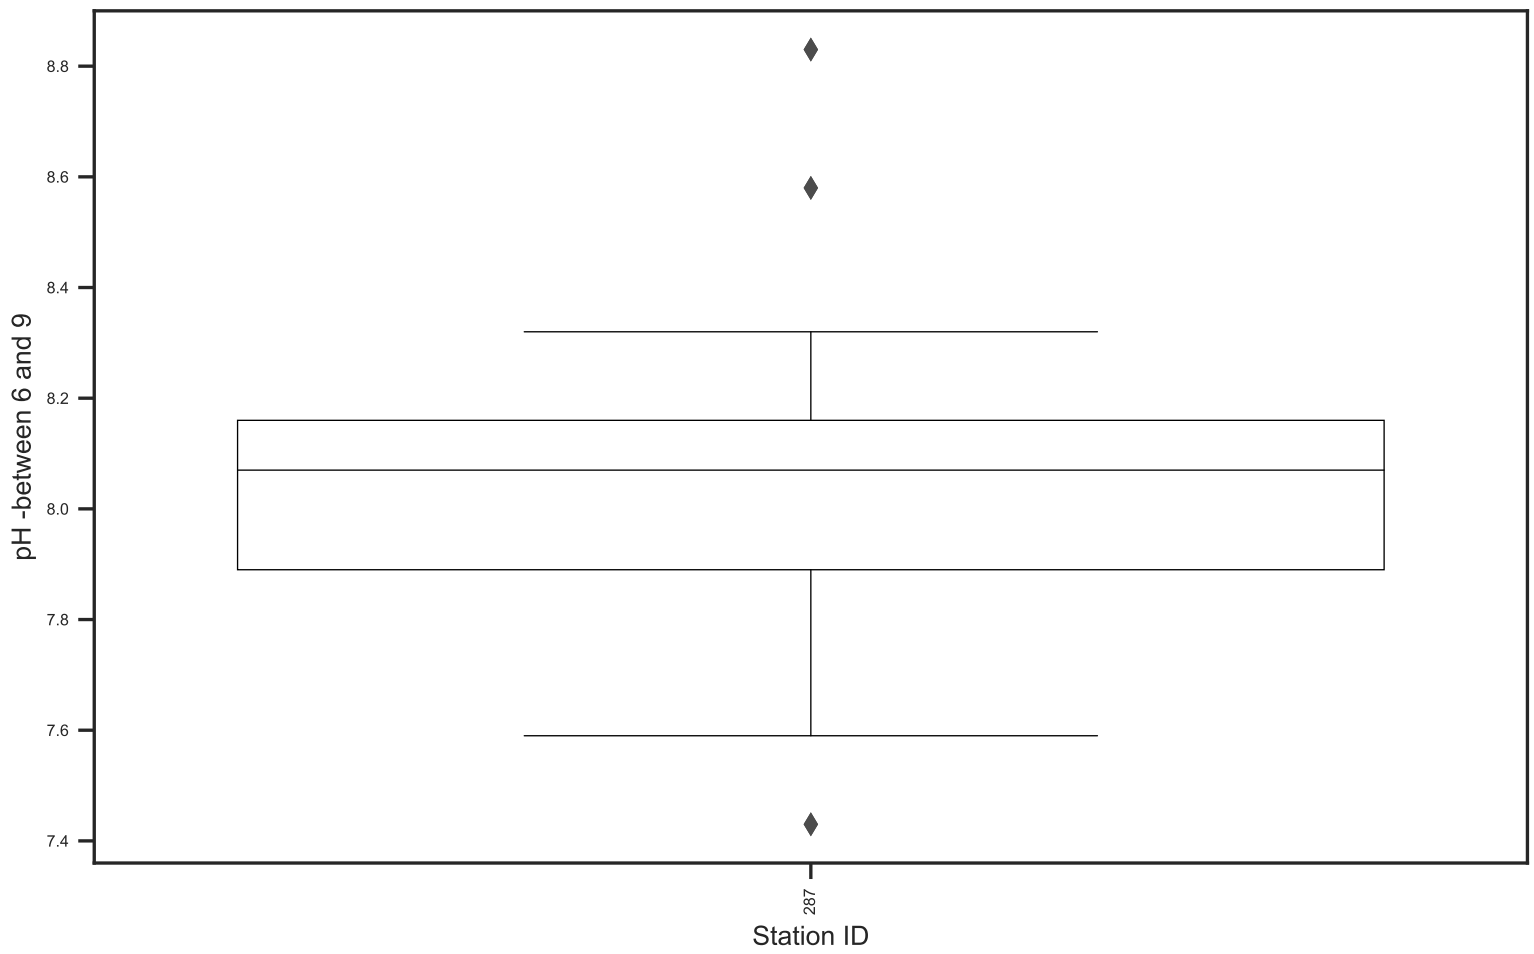

Boxplots of parameter values by waterbody

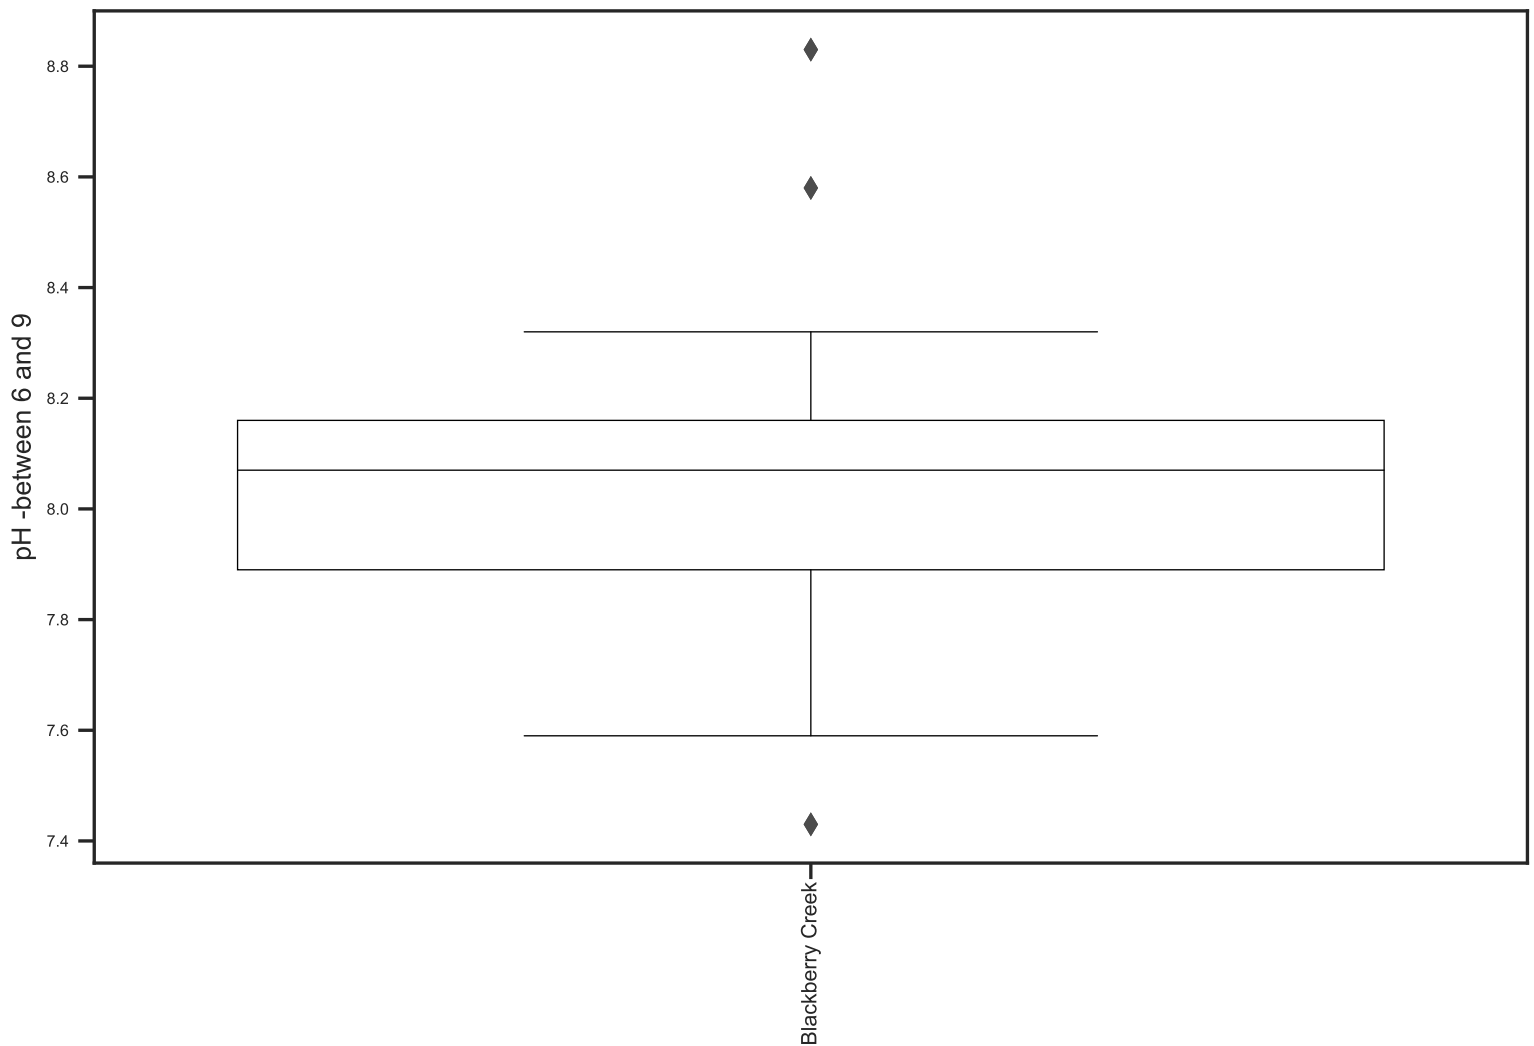

Summary statistics for pH -between 6 and 9

Station_ID	Start Date	End Date	N	Mean	Median	Max	Min	StdDev	Q1	Q3	Skew	Kurtosis
287	2004-05-18	2011-06-21	81.0	8.03	8.07	8.83	7.43	0.219	7.89	8.16	0.188	1.732