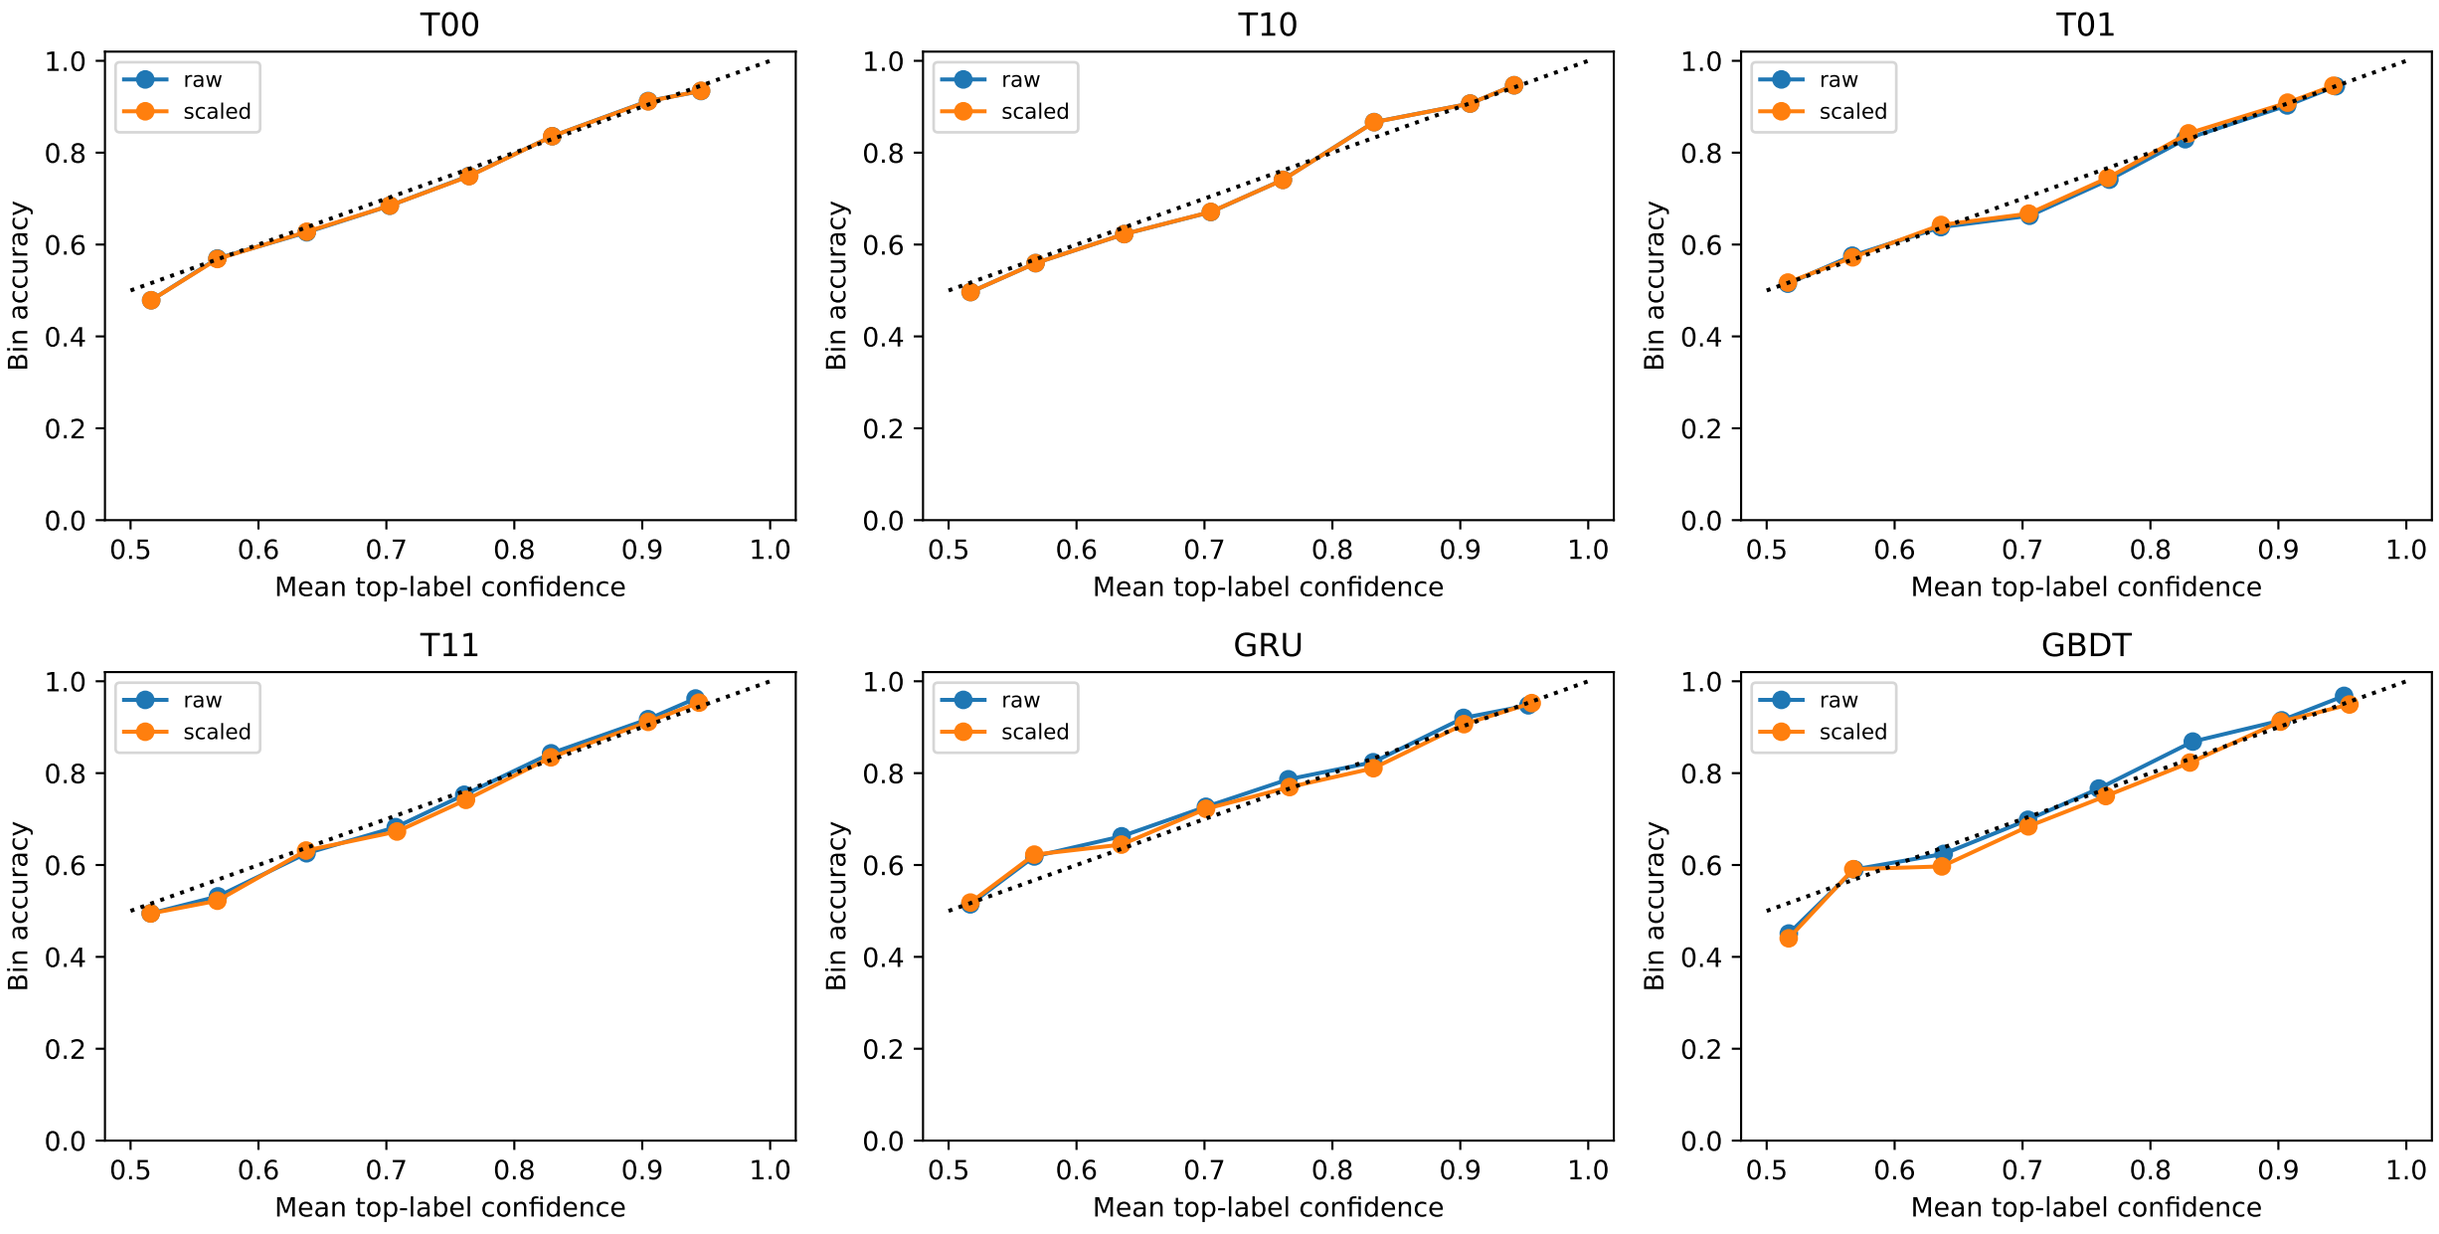
Top-label reliability; diagonal indicates agreement
EXP-06 v0.1 | Held-out clean test | Display seed 1001
T00
T10
T01
T11
GRU
GBDT
raw
scaled
Bin accuracy
Mean top-label confidence
0.0
0.2
0.4
0.6
0.8
1.0
0.5
0.6
0.7
0.8
0.9
1.0