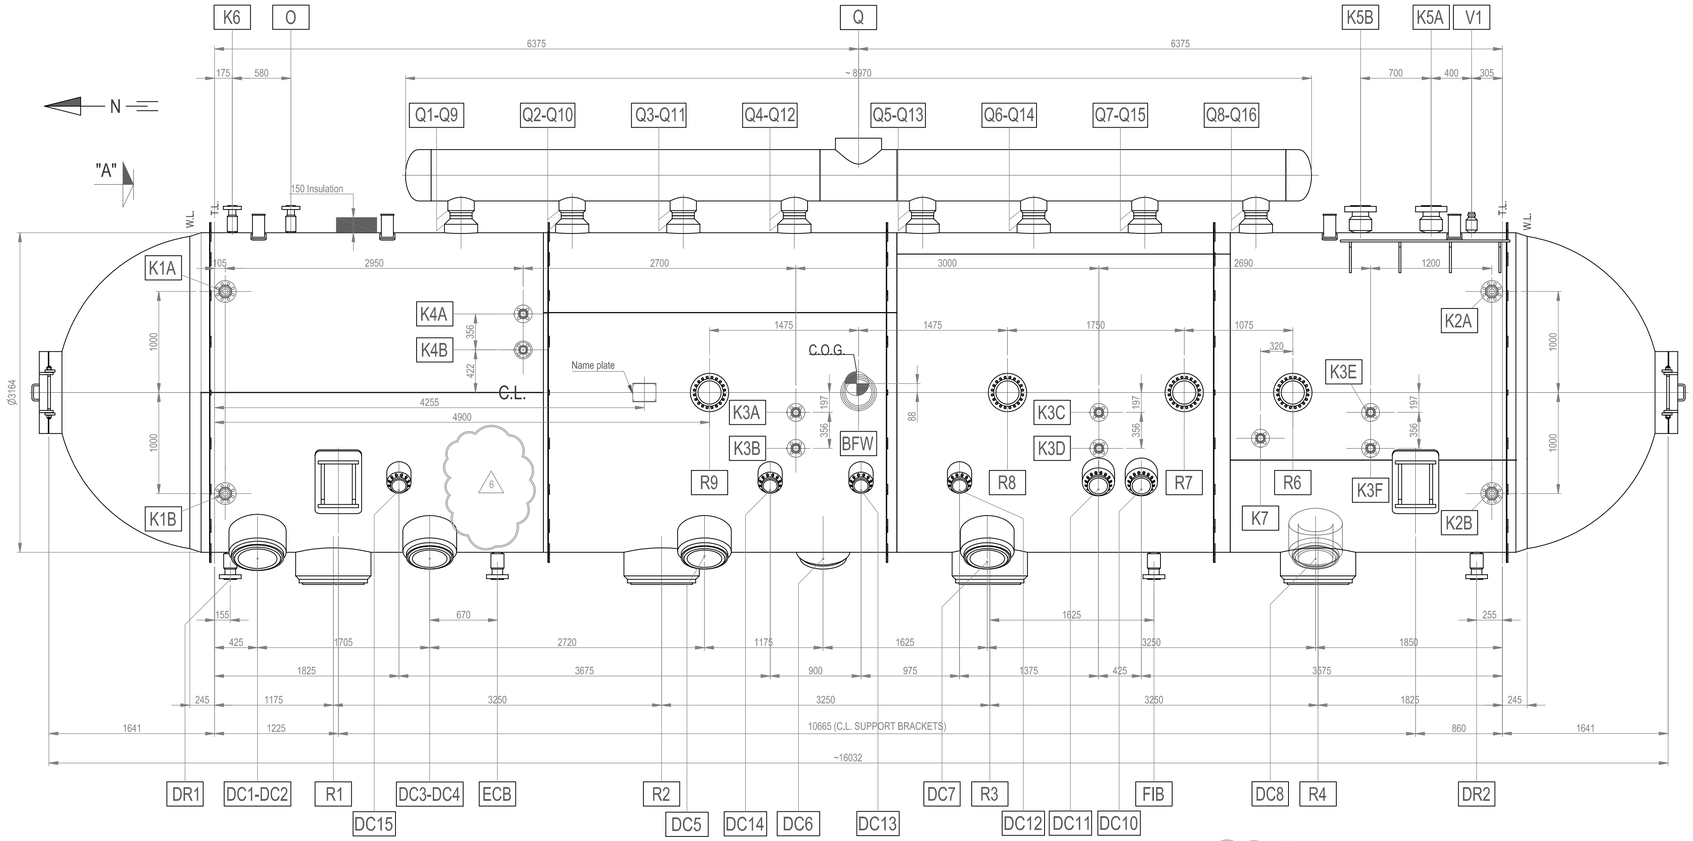

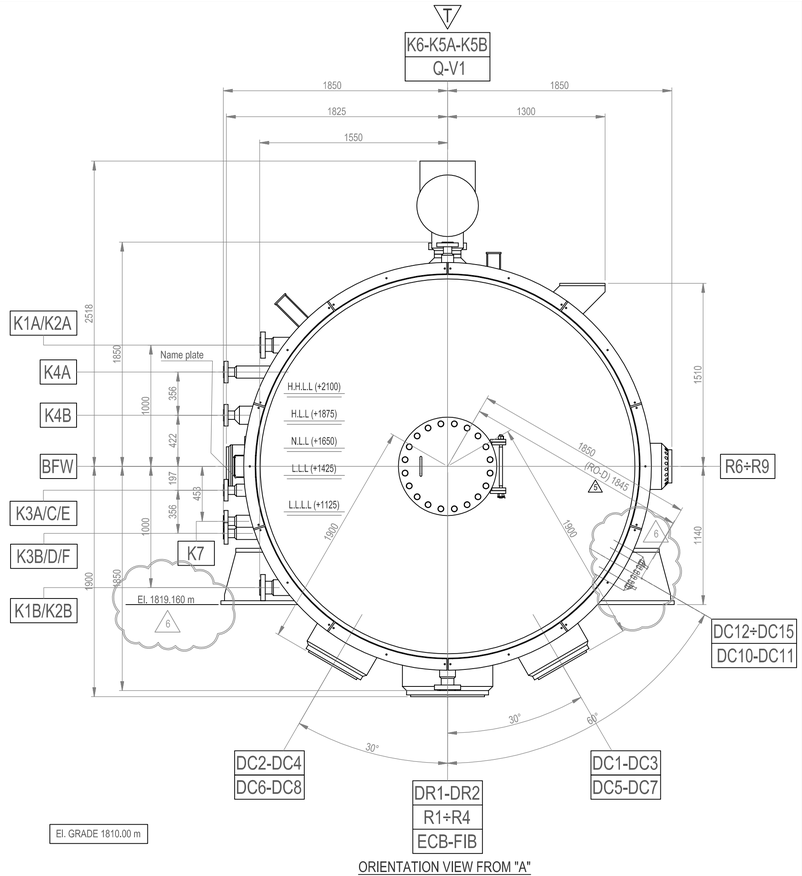

El. GRADE 1810.00 m

ORIENTATION VIEW FROM "A"

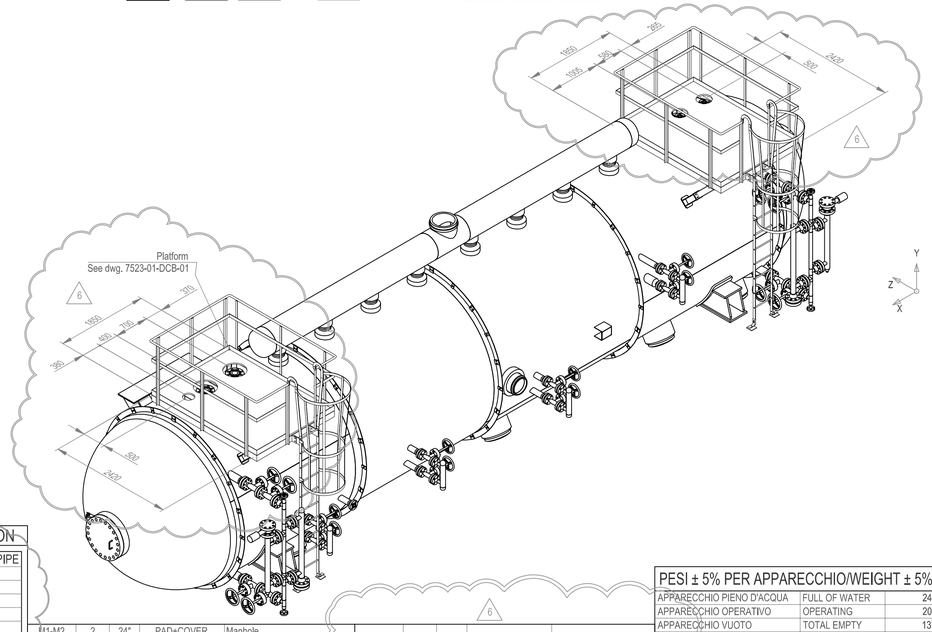

For fondation load
see dwg 7523-00-000-01

NOZZLE LOADS						
	MY	MX	MZ	FY	FX	FZ
Q	50 kNM	70 kNM	30 kNM	-40 kN	-30 kN	+12 kN
BFW	-35 kNM	-35 kNM	-35 kNM	-23 kN	-23 kN	23 kN

	PAINTING
8	EXTERNAL SURFACES: ACCORDING TO OLMI SPEC. 7523-00-SSP-01 & 2103-ESS-00-QC-810 rev. 1.
7	PROTECTION INTERNAL SURFACES: DRAINED AND THROUGHLY CLEANED. N2 FILLED FOR SHIPMENT. INSULATION BY OTHERS-INSULATION SUPPORT BY OLMI ACC. TO 7523-03-500-03. STUB END BEVEL: COATED WITH SUITABLE CORROSION INHIBITOR. BOLTING: LUBRIFICATED WITH MOLYKOTE OR EQUIV. PRIOR TO FITTING.
6	HYDROTEST ACC. TO: OLMI SPEC. 7523-00-HYT-01.
5	SPARE PARTS: / COMM. AND START-UP: 10% OF BOLTING. N°2 SET GASKET.
4	T DENOTES MATCH MARK FOR ASSEMBLING.
3	FABRICATION TOLERANCES ACC. TO PROCEDURE "DC-001" AND "2103-ESS-00-PV-201". AND "SALD-001" FOR WELDING BEVELS.
2	NOZZLE AND MAIN FLANGES BOLT HOLES TO BE EQUALLY SPACED AND STRADDLE TO MAIN AXIS.
1	IF NOT OTHERWISE SPECIFIED. ALL DIMENSION ARE IN MM UNLESS OTHERWISE SPECIFIED.

NOTE GENERALI / GENERAL NOTES

STUB END BEVEL PREPARATION

NOZZLE	t	ID	TYPE	MATCHING PIPE
R1 ÷ R4	46	518	1	24"
DC1 - DC2	35	387	1	18"
DC3 ÷ DC8	31	344	1	16"
DC10 - DC11	18.5	182	2	8"
DC12 ÷ DC15	14	140	2	6"
R6 ÷ R9	21.5	230	1	10"
BFW	31.75	292.5	1	14"
Q	38.1	431.8	1	18"



TYPE 1 TYPE 2

POS. ITEM	Q.TA' Q.TY	SIZE DN	TIPO / TYPE	SERVIZIO SERVICE	POS. ITEM	Q.TA' Q.TY	SIZE DN	TIPO / TYPE	SERVIZIO SERVICE
M1-M2	2	24"	PAD+COVER	Manhole					
DR1-DR2	2	2"	1500Lb. LWN-RTJ	Drain					
V1	1	2"	BEVEL END	Vent					
O	1	1 1/2"	1500Lb. LWN-RTJ	Pressure transmitter (PT-14100)	FIB	1	2"	1500Lb. LWN-RTJ	Internal blowdown
K7	1	1 1/2"	1500Lb. LWN-RTJ	Thermowell (TT-14090)	ECB	1	2"	1500Lb. LWN-RTJ	Continuos blowdown
K6	1	1 1/2"	1500Lb. LWN-RTJ	Pressure gauge (PG-14099)	BFW	1	14"	BEVEL END	BFW Inlet
K5B	1	4"	1500Lb. LWN-RTJ	Safety valve (PSV-14021)	DC12÷DC15	4	6"	BEVEL END	Downcomers to 3-E-1801
K5A	1	4"	1500Lb. LWN-RTJ	Safety valve (PSV-14020)	DC10-DC11	2	8"	BEVEL END	Downcomers to 3-E-1801
K4A-K4B	2	1 1/2"	1500Lb. LWN-RTJ	Level switch (LSHH-14015)	DC3÷DC8	6	16"	BEVEL END	Downcomers to 3-E-1401
K3E-K3F	2	1 1/2"	1500Lb. LWN-RTJ	Level switch (LSLL-14018)	DC1-DC2	2	18"	BEVEL END	Downcomers to 3-E-1401
K3C-K3D	2	1 1/2"	1500Lb. LWN-RTJ	Level switch (LSLL-14017)	R6÷R9	4	10"	BEVEL END	Risers to 3-E-1801
K3A-K3B	2	1 1/2"	1500Lb. LWN-RTJ	Level switch (LSLL-14016)	R1÷R4	4	24"	BEVEL END	Risers to 3-E-1401
K2A-K2B	2	2"	1500Lb. LWN-RTJ	Level bridle (LG-14011 & LT-14010)	Q1÷Q16	16	8"	BEVEL END	STEAM OUTLET
K1A-K1B	2	2"	1500Lb. LWN-RTJ	Level bridle (LG-14013 & LT-14012)	Q	1	18"	BEVEL END	STEAM OUTLET

TABELLA CONNESSIONI / CONNECTIONS TABLE

PESI ± 5% PER APPARECCHIO/WEIGHT ± 5% EACH EXCH.			
APPARECCHIO PIENO D'ACQUA	FULL OF WATER	244915	kg.
APPARECCHIO OPERATIVO	OPERATING	208116	kg.
APPARECCHIO VUOTO	TOTAL EMPTY	137000	kg.
COPERCHIO PASSO D'UOMO	MANHOLE COVER	280	kg.
CAPACITA'	CAPACITY	107915	LL.

ATTACCHI EST.	EXT. ATTACHMENTS	FOR FULL EXTENT OF NDE INSPECTIONS SEE NDE PLAN 7523-03-NDE-01		
BOCCH./VIROLA	NOZZLE ATTACH.			
ULTIMA SALDATURA	LAST WELDING			
SALD. CIRCONF.	CIRCUMF. SEAM			
SALD. LONGIT.	LONGIT. SEAM			
PARTI SALDATE / WELDED JOINTS		UT	DP	MP

NON DESTRUCIVE EXAMINATION (NDE)

DESIGN DATA			
SPECIFICHE CLIENTE	CLIENT SPECIFICATION	2103-ESS-01-PR-101 rev.2	
CARICHI AMM. MATER.	MATER. ALLOW. STRESS	ASME II PART D ED.2010	
NORME & CODICI	CODES & NORMS	ASME VIII DIV.2-2010+Ad.2011 ASME U2-STAMP	
COLLAUDO APPAR.	EXCH. INSP. & TEST	-	
CERTIFICAZIONE	CODE STAMP	ASME U2-STAMP	
CONTR. RADIOGRAFICO	RADIOGRAPHIC TEST	FULL	
TRATTAMENTO TERMICO	P.W.H.T.	YES	
EFFICIENZA SALDATURA	JOINT EFFICIENCY	1	
COIBENTAZIONE SP.	INSULATION THK.	150	mm.
CORROSIONE	CORR. ALLOWANCE	3	mm.
TEMP. DI ESERCIZIO	OPERATING TEMP.	-	°C
TEMP. DI PROGETTO	DESIGN TEMPERATURE	335	°C
TEMP. MIN. PROGETTO	M.D.M.T.	-27	°C
PRESS. DI PROVA	HYDROTEST PRESSURE	186,1	Bar g.
PRESS. DI ESERCIZIO	OPERATING PRESSURE	-	Bar g.
PRESS. DI PROGETTO	DESIGN PRESSURE	130 / F.V.	Bar g.
STATO DEL FLUIDO	FLUID STATUS	LIQUID / VAPOUR	
FLUIDO CIRCOLANTE	FLUID CIRCULATED	WATER / STEAM	

NO COMMENT

By: seraj.mohammad

8:52 am, Oct 26, 2015

REFERENCE VENDOR DRAWINGS		
FOUNDATION LOAD	7523-00-000-01	2103-A-VD-255-A1-ST-001
GENERAL ARRANGEMENT	7523-00-000-02	2103-A-VD-255-A1-MD-087
SETTING PLAN	7523-03-000-01	2103-A-VD-255-A1-MD-062
CONSTRUCTION DRAWING	7523-03-100-01	2103-A-VD-255-A1-MD-060
NAME PLATE DRAWING	7523-03-400-01	2103-A-VD-255-A3-MD-063
INTERNAL PARTS DRAWING	7523-03-500-01	2103-A-VD-255-A1-MD-064
INTERNAL PARTS DRAWING AND DEMISTER	7523-03-500-02	2103-A-VD-255-A1-MD-065
INSULATION SUPPORT	7523-03-500-03	2103-A-VD-255-A1-MD-034
SHIPPING DRAWING	7523-03-700-01	2103-A-VD-255-A1-MD-068

NOTE:

ASME CONSTRUCTION

ENGINEERING MANAGER Dott. Ing. Silvio Sarti

QUALITY CONTROL MANAGER Dott. Ing. Marco Colombo

DISEGNO DEFINITIVO

Il cliente ha già preso visione del disegno ed ha approvato le parti non evidenziate dalla/linea rev.

VALID FOR CONSTRUCTION

Drawing already approved by client except where indicated with last revision mark.

DATA: 19/11/2014 FIRMA: Sarti

REV.	ISSUE DATE	DESCRIPTION	DWN. BY	CHKD BY	APPR. BY	APPR. BY
5	19/11/14	REVISED WHERE MARKED & REISSUED FOR FINAL APPROVAL	GPS	SP	SS	
4	15/05/14	REVISED AS INDICATED	SP	SS	SS	
3	05/03/14	REVISED AS INDICATED	AC	SS	SS	
2	25/10/13	REVISED AS INDICATED	PM	FG	SS	
6	25/09/15	REVISED AS PER CLIENT COMMENTS	NL	SS	SS	

DISCIPLINE: PROJ

OWNER: LORDEGAN PETROCHEMICAL COMPANY

Project: LORDEGAN AMMONIA AND UREA PROJECT

CONTRACTOR: HAMPA ENGINEERING CORPORATION

DETAIL ENGINEER: HEIDCO Heidco Engineering & Design Company

ALFA LAVAL SUISIO - BERGAMO - ITALY

TITLE: SETTING PLAN 3-D-4201

PURCHASE ORDER	FZMC-13450-R1		
IMPIANTO E LOC., LOCATION & UNIT	Ammonia Urea Project		
SERVIZIO SERVICES	Steam Drum		
TITOLO TITLE	Setting plan		
SCALA/FORMATO SCALE/FORMAT	NO / A1	TIPO / TEMA / TYPE	N.A.
DATA DATE	09/03/2012	NUMERO APPAR. NUMBER REQUIRED	1
DISEGNATO DRAWN.	Mazzoleni	SIGLA / ITEM No.	3-D-4201
CONTROLL. CHECKED	Passerini	DIMENSIONI / SIZE	--
APPROVATO APPROVED	Zanardi	NUM. DI FABBRICA SERIAL NUMBER	12544
		ANNO DI COS. YEAR OF CONS.	2014
		COMM. / JOB	7523
		NUM. DIS. / DWG. NUM.	7523-03-000-01
		REV.	6

Project No:2103
Scale:
Sheet of

HAMPA Vendor

Doc. No. 7523-03-000-01 REV. 6

2103-A-VD-255-A1-MD-062

THIS DRAWING AND THE DESIGN IT COVERS IS THE PROPERTY OF LORDEGAN PETROCHEMICAL COMPANY AND IS NOT TO BE COPIED, REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.