


- Utilities
- Directors
- Actors
- MyActors
- BACnet
- ADInterfaceMCC
- UserLibrary

### SDF Director



- timeStep: 5
- beginTime: 0
- endTime: 15

This example illustrates how to read properties from BACnet devices. Running the example requires a connection to a demo case from Automate Logical Corporation. This demo case has two device objects with device instance number 637501 and 637502.

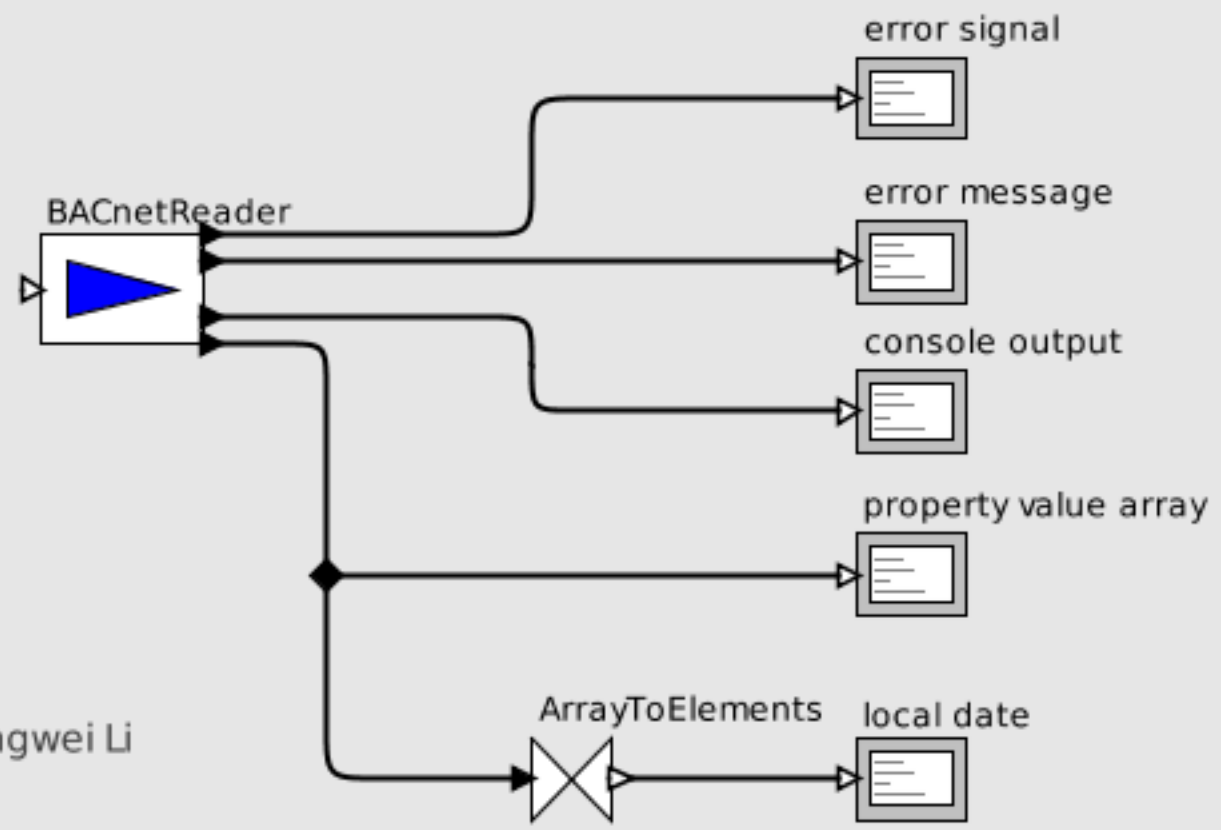

Author: Zhengwei Li

