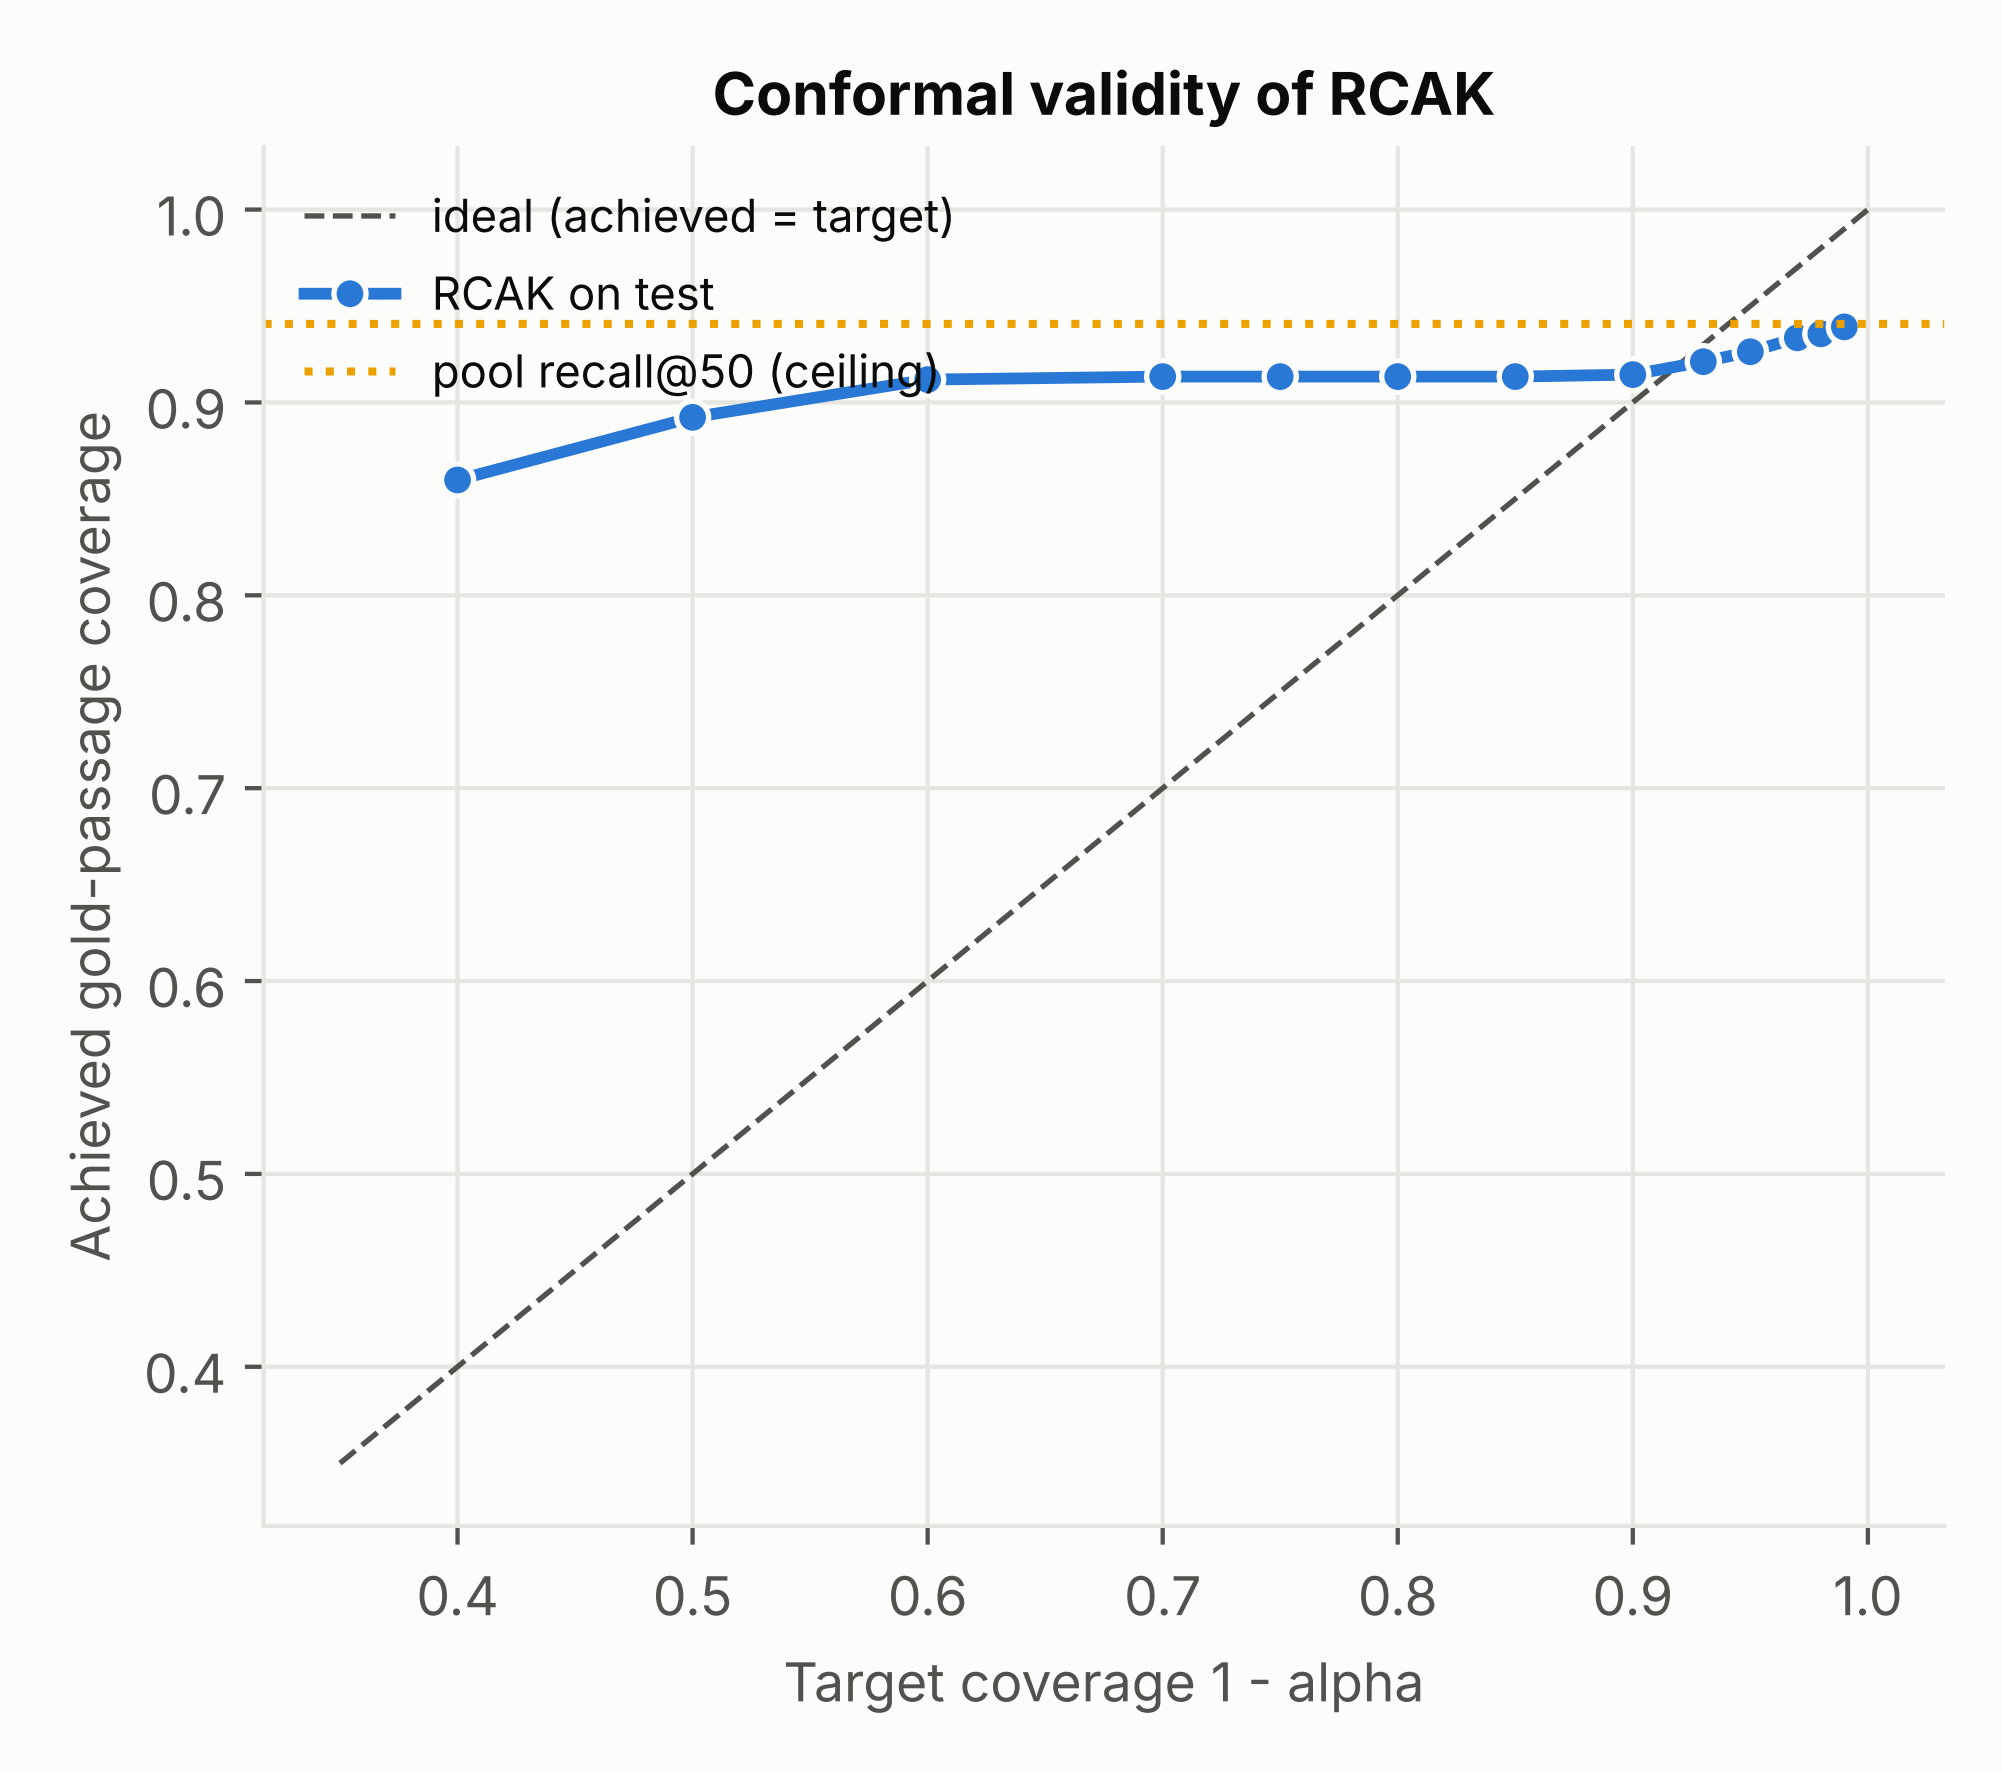
Conformal validity of RCAK
ideal (achieved = target)
RCAK on test
pool recall@50 (ceiling)
Achieved gold-passage coverage
Target coverage 1 - alpha
1.0
0.9
0.8
0.7
0.6
0.5
0.4
0.4
0.5
0.6
0.7
0.8
0.9
1.0