


Building B · FIRST FOOR (Light scene 1)

Room list

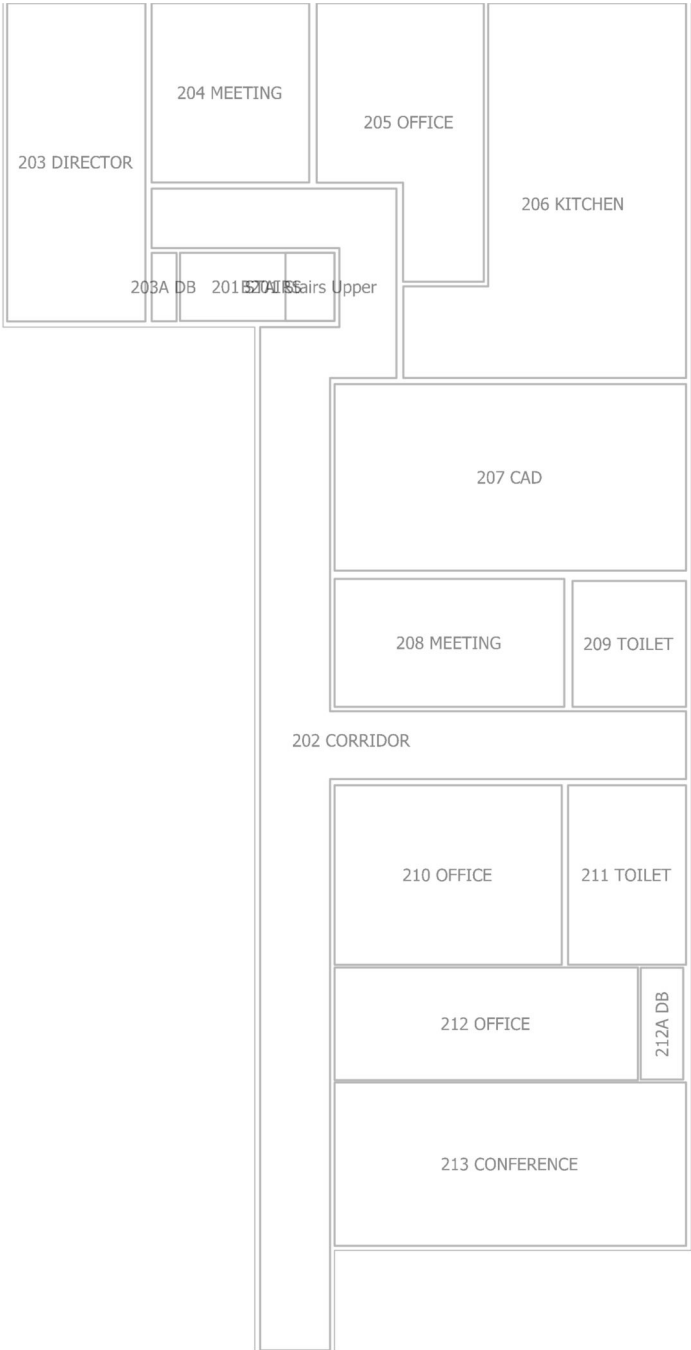

Building B · FIRST FOOR (Light scene 1)

Room list

201 STAIRS

P_{total}
76.0 W

A_{Room}
6.18 m²

Lighting power density
12.30 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	Philips		2x36W	76.0 W	4663 lm

202 CORRIDOR

P_{total}
684.0 W

A_{Room}
69.35 m²

Lighting power density
9.86 W/m² = 5.86 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$
168 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
9	Philips		2x36W	76.0 W	4663 lm

203 DIRECTOR

P_{total}
304.0 W

A_{Room}
25.83 m²

Lighting power density
11.77 W/m² = 4.04 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$
291 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
4	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

204 MEETING

P_{total} 304.0 W	A_{Room} 16.60 m ²	Lighting power density 18.32 W/m ² = 4.77 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 384 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	Philips		2x36W	76.0 W	4663 lm

205 OFFICE

P_{total} 380.0 W	A_{Room} 22.32 m ²	Lighting power density 17.03 W/m ² = 4.54 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 375 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
5	Philips		2x36W	76.0 W	4663 lm

206 KITCHEN

P_{total} 532.0 W	A_{Room} 48.10 m ²	Lighting power density 11.06 W/m ² = 3.50 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 316 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
7	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

207 CAD

P_{total}
684.0 W**A_{Room}**
38.48 m²**Lighting power density**
17.77 W/m² = 3.74 W/m²/100 lx (Space)**E_{perpendicular} (Working plane)**
476 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
9	Philips		2x36W	76.0 W	4663 lm

208 MEETING

P_{total}
456.0 W**A_{Room}**
17.26 m²**Lighting power density**
26.43 W/m² = 4.79 W/m²/100 lx (Space)**E_{perpendicular} (Working plane)**
552 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
6	Philips		2x36W	76.0 W	4663 lm

209 TOILET

P_{total}
152.0 W**A_{Room}**
8.39 m²**Lighting power density**
18.12 W/m² = 7.97 W/m²/100 lx (Space)**E_{perpendicular} (Working plane)**
227 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
2	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

210 OFFICE

P_{total}
684.0 W**A_{Room}**
23.95 m²**Lighting power density**
 $28.56 \text{ W/m}^2 = 4.22 \text{ W/m}^2/100 \text{ lx (Space)}$ **E_{perpendicular} (Working plane)**
676 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
9	Philips		2x36W	76.0 W	4663 lm

211 TOILET

P_{total}
228.0 W**A_{Room}**
12.43 m²**Lighting power density**
 $18.35 \text{ W/m}^2 = 6.73 \text{ W/m}^2/100 \text{ lx (Space)}$ **E_{perpendicular} (Working plane)**
273 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
3	Philips		2x36W	76.0 W	4663 lm

212 OFFICE

P_{total}
608.0 W**A_{Room}**
20.07 m²**Lighting power density**
 $30.30 \text{ W/m}^2 = 4.87 \text{ W/m}^2/100 \text{ lx (Space)}$ **E_{perpendicular} (Working plane)**
622 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
8	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

212A DB

P_{total} 76.0 W	A_{Room} 2.79 m ²	Lighting power density 27.23 W/m ² = 20.09 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 136 lx
------------------------------------	--	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	Philips		2x36W	76.0 W	4663 lm

213 CONFERENCE

P_{total} 608.0 W	A_{Room} 33.71 m ²	Lighting power density 18.04 W/m ² = 3.94 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 458 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
8	Philips		2x36W	76.0 W	4663 lm

B201 Stairs Upper

P_{total} 76.0 W	A_{Room} 1.96 m ²	Lighting power density 38.83 W/m ² = 16.94 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 229 lx
------------------------------------	--	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR

Luminaire list Φ_{total}

359051 lm

 P_{total}

5852.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
77	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR (Light scene 1)

Calculation objects

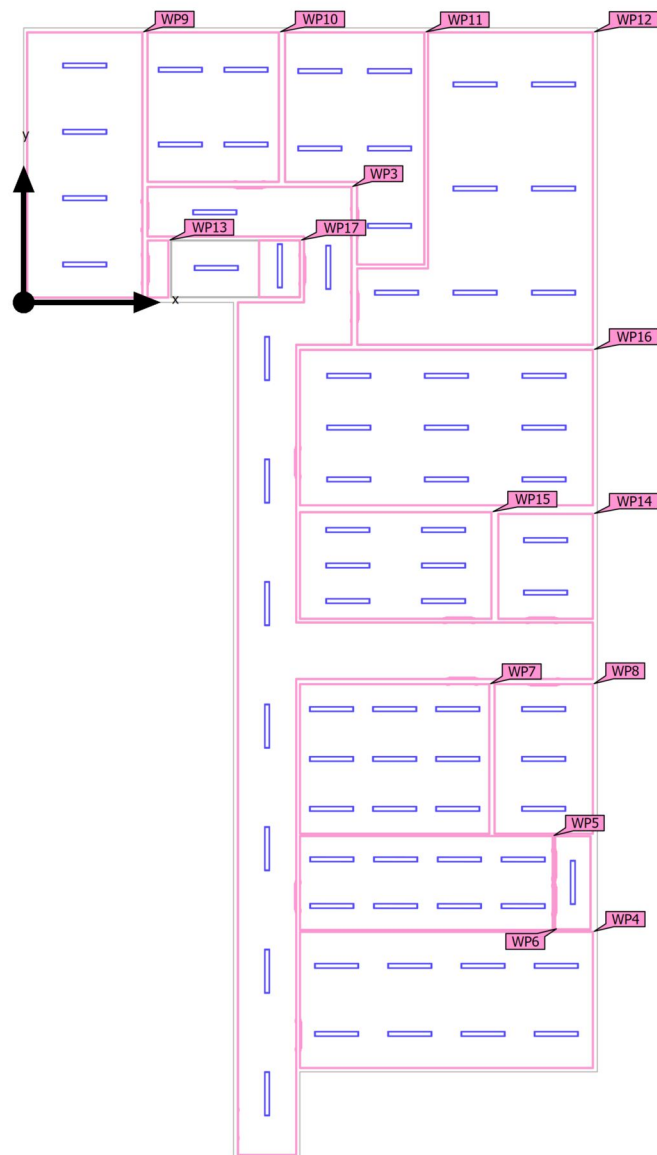

Building B · FIRST FOOR (Light scene 1)

Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
B201 Stairs Upper Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	229 lx (≥ 500 lx) ✗	213 lx	241 lx	0.93 (≥ 0.60) ✓	0.88	WP17
Working plane (202 CORRIDOR) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	168 lx (≥ 500 lx) ✗	11.8 lx	305 lx	0.070 (≥ 0.60) ✗	0.039	WP3
Working plane (203 DIRECTOR) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	291 lx (≥ 500 lx) ✗	195 lx	370 lx	0.67 (≥ 0.60) ✓	0.53	WP9
Working plane (203A DB) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	0.00 lx (≥ 500 lx) ✗	0.00 lx	0.00 lx	- (≥ 0.60)	-	WP13
Working plane (204 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	384 lx (≥ 500 lx) ✗	295 lx	460 lx	0.77 (≥ 0.60) ✓	0.64	WP10
Working plane (205 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	375 lx (≥ 500 lx) ✗	223 lx	477 lx	0.59 (≥ 0.60) ✗	0.47	WP11
Working plane (206 KITCHEN) Perpendicular illuminance (adaptive) Height: 0.850 m, Wall zone: 0.000 m	316 lx (≥ 500 lx) ✗	195 lx	391 lx	0.62 (≥ 0.60) ✓	0.50	WP12
Working plane (207 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	476 lx (≥ 500 lx) ✗	314 lx	577 lx	0.66 (≥ 0.60) ✓	0.54	WP16
Working plane (208 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	552 lx (≥ 500 lx) ✓	396 lx	649 lx	0.72 (≥ 0.60) ✓	0.61	WP15
Working plane (209 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	227 lx (≥ 500 lx) ✗	197 lx	258 lx	0.87 (≥ 0.60) ✓	0.76	WP14
Working plane (210 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	676 lx (≥ 500 lx) ✓	461 lx	814 lx	0.68 (≥ 0.60) ✓	0.57	WP7

Building B · FIRST FOOR (Light scene 1)

Calculation objects

Working plane (211 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	273 lx (≥ 500 lx) ✗	179 lx	322 lx	0.66 (≥ 0.60) ✓	0.56	WP8
Working plane (212 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	622 lx (≥ 500 lx) ✓	434 lx	731 lx	0.70 (≥ 0.60) ✓	0.59	WP5
Working plane (212A DB) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	136 lx (≥ 500 lx) ✗	104 lx	145 lx	0.76 (≥ 0.60) ✓	0.72	WP6
Working plane (213 CONFERENCE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	458 lx (≥ 500 lx) ✗	286 lx	550 lx	0.62 (≥ 0.60) ✓	0.52	WP4