

Building A · FIRST FLOOR (Light scene 1)

Room list



Building A · FIRST FLOOR (Light scene 1)

Room list

201 STARIS

P_{total}
76.0 W

A_{Room}
4.00 m²

Lighting power density
18.98 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	Philips		2x36W	76.0 W	4663 lm

202 CORRIDOR

P_{total}
304.0 W

A_{Room}
27.25 m²

Lighting power density
11.15 W/m² = 7.94 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$
140 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
4	Philips		2x36W	76.0 W	4663 lm

203 MEETING

P_{total}
152.0 W

A_{Room}
6.59 m²

Lighting power density
23.07 W/m² = 6.97 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$
331 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
2	Philips		2x36W	76.0 W	4663 lm

Building A · FIRST FLOOR (Light scene 1)

Room list

204 MANAGER

P_{total}
532.0 W

A_{Room}
24.86 m²

Lighting power density
 $21.40 \text{ W/m}^2 = 4.56 \text{ W/m}^2/100 \text{ lx (Space)}$

$\bar{E}_{\text{perpendicular (Working plane)}}$
470 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
7	Philips		2x36W	76.0 W	4663 lm

205 BALCONY

P_{total}
76.0 W

A_{Room}
7.38 m²

Lighting power density
 $10.31 \text{ W/m}^2 = 5.71 \text{ W/m}^2/100 \text{ lx (Space)}$

$\bar{E}_{\text{perpendicular (Working plane)}}$
181 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	Philips		2x36W	76.0 W	4663 lm

206 TOILET

P_{total}
152.0 W

A_{Room}
5.03 m²

Lighting power density
 $30.21 \text{ W/m}^2 = 11.22 \text{ W/m}^2/100 \text{ lx (Space)}$

$\bar{E}_{\text{perpendicular (Working plane)}}$
269 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
2	Philips		2x36W	76.0 W	4663 lm

Building A · FIRST FLOOR (Light scene 1)

Room list

207 OFFICE

P_{total}
456.0 W

A_{Room}
15.71 m²

Lighting power density
29.02 W/m² = 5.63 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular}}$ (Working plane)
516 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
6	Philips		2x36W	76.0 W	4663 lm

208 MEETING

P_{total}
304.0 W

A_{Room}
11.30 m²

Lighting power density
26.91 W/m² = 5.87 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular}}$ (Working plane)
458 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
4	Philips		2x36W	76.0 W	4663 lm

209 MEETING

P_{total}
304.0 W

A_{Room}
12.60 m²

Lighting power density
24.13 W/m² = 5.72 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular}}$ (Working plane)
422 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
4	Philips		2x36W	76.0 W	4663 lm

Building A · FIRST FLOOR (Light scene 1)

Room list

210 CAD

 P_{total}

608.0 W

 A_{Room} 34.98 m²

Lighting power density

17.38 W/m² = 3.82 W/m²/100 lx (Space) $\bar{E}_{\text{perpendicular}}$ (Working plane)

455 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
8	Philips		2x36W	76.0 W	4663 lm

211 CORRIDOR

 P_{total}

608.0 W

 A_{Room} 59.96 m²

Lighting power density

10.14 W/m² = 7.61 W/m²/100 lx (Space) $\bar{E}_{\text{perpendicular}}$ (Working plane)

133 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
8	Philips		2x36W	76.0 W	4663 lm

212 COMMON

 P_{total}

608.0 W

 A_{Room} 41.15 m²

Lighting power density

14.78 W/m² = 3.40 W/m²/100 lx (Space) $\bar{E}_{\text{perpendicular}}$ (Working plane)

435 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
8	Philips		2x36W	76.0 W	4663 lm

Building A · FIRST FLOOR (Light scene 1)

Room list

213 BALCONY

P_{total} 76.0 W	A_{Room} 10.84 m ²	Lighting power density 7.01 W/m ² = 5.92 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 118 lx
------------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	Philips		2x36W	76.0 W	4663 lm

214 OFFICE

P_{total} 304.0 W	A_{Room} 13.60 m ²	Lighting power density 22.36 W/m ² = 5.37 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 416 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	Philips		2x36W	76.0 W	4663 lm

215 MEETING

P_{total} 304.0 W	A_{Room} 12.81 m ²	Lighting power density 23.74 W/m ² = 5.66 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 419 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	Philips		2x36W	76.0 W	4663 lm

Building A · FIRST FLOOR (Light scene 1)

Room list

216 MEETING

P_{total} 304.0 W	A_{Room} 12.65 m ²	Lighting power density 24.03 W/m ² = 6.00 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 400 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	Philips		2x36W	76.0 W	4663 lm

217 TOILET

P_{total} 76.0 W	A_{Room} 5.03 m ²	Lighting power density 15.11 W/m ² = 10.83 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 140 lx
------------------------------------	--	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	Philips		2x36W	76.0 W	4663 lm

218 TOILET

P_{total} 76.0 W	A_{Room} 4.60 m ²	Lighting power density 16.53 W/m ² = 11.81 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 140 lx
------------------------------------	--	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	Philips		2x36W	76.0 W	4663 lm

Building A · FIRST FLOOR (Light scene 1)

Room list

219 MEETING

P_{total}
228.0 W**A_{Room}**
8.23 m²**Lighting power density**
27.72 W/m² = 6.84 W/m²/100 lx (Space)**E_{perpendicular} (Working plane)**
405 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
3	Philips		2x36W	76.0 W	4663 lm

220 OFFICE

P_{total}
304.0 W**A_{Room}**
15.37 m²**Lighting power density**
19.78 W/m² = 5.04 W/m²/100 lx (Space)**E_{perpendicular} (Working plane)**
392 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	Philips		2x36W	76.0 W	4663 lm

Building A · FIRST FLOOR

Luminaire list Φ_{total}

359051 lm

 P_{total}

5852.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
77	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR (Light scene 1)

Calculation objects

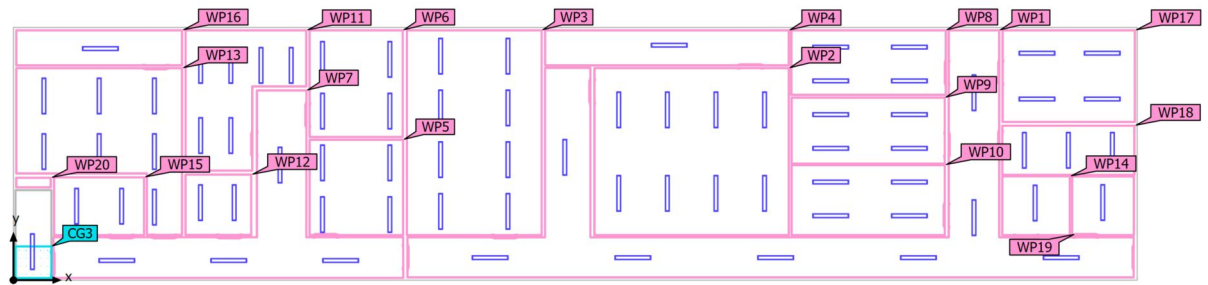

Building A · FIRST FLOOR (Light scene 1)

Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (202 CORRIDOR) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	140 lx (≥ 500 lx) ✗	65.0 lx	175 lx	0.46 (≥ 0.60) ✗	0.37	WP7
Working plane (203 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	331 lx (≥ 500 lx) ✗	281 lx	377 lx	0.85 (≥ 0.60) ✓	0.75	WP15
Working plane (204 MANAGER) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	470 lx (≥ 500 lx) ✗	248 lx	569 lx	0.53 (≥ 0.60) ✗	0.44	WP13
Working plane (204A DB) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	0.00 lx (≥ 500 lx) ✗	0.00 lx	0.00 lx	- (≥ 0.60)	-	WP20
Working plane (205 BALCONY) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	181 lx (≥ 500 lx) ✗	63.6 lx	341 lx	0.35 (≥ 0.60) ✗	0.19	WP16
Working plane (206 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	269 lx (≥ 500 lx) ✗	248 lx	286 lx	0.92 (≥ 0.60) ✓	0.87	WP12
Working plane (207 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	516 lx (≥ 500 lx) ✓	317 lx	666 lx	0.61 (≥ 0.60) ✓	0.48	WP11
Working plane (208 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	458 lx (≥ 500 lx) ✗	374 lx	514 lx	0.82 (≥ 0.60) ✓	0.73	WP5
Working plane (209 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	422 lx (≥ 500 lx) ✗	340 lx	489 lx	0.81 (≥ 0.60) ✓	0.70	WP6
Working plane (210 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	455 lx (≥ 500 lx) ✗	309 lx	549 lx	0.68 (≥ 0.60) ✓	0.56	WP3
Working plane (211 CORRIDOR) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	133 lx (≥ 500 lx) ✗	53.7 lx	220 lx	0.40 (≥ 0.60) ✗	0.24	WP1

Building A · FIRST FLOOR (Light scene 1)

Calculation objects


Working plane (212 COMMON) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	435 lx (≥ 500 lx) ✗	290 lx	528 lx	0.67 (≥ 0.60) ✓	0.55	WP2
Working plane (213 BALCONY) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	118 lx (≥ 500 lx) ✗	22.1 lx	305 lx	0.19 (≥ 0.60) ✗	0.072	WP4
Working plane (214 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	416 lx (≥ 500 lx) ✗	302 lx	480 lx	0.73 (≥ 0.60) ✓	0.63	WP10
Working plane (215 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	419 lx (≥ 500 lx) ✗	304 lx	477 lx	0.73 (≥ 0.60) ✓	0.64	WP9
Working plane (216 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	400 lx (≥ 500 lx) ✗	285 lx	460 lx	0.71 (≥ 0.60) ✓	0.62	WP8
Working plane (217 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	140 lx (≥ 500 lx) ✗	127 lx	150 lx	0.91 (≥ 0.60) ✓	0.85	WP14
Working plane (218 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	140 lx (≥ 500 lx) ✗	101 lx	150 lx	0.72 (≥ 0.60) ✓	0.67	WP19
Working plane (219 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	405 lx (≥ 500 lx) ✗	325 lx	464 lx	0.80 (≥ 0.60) ✓	0.70	WP18
Working plane (220 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	392 lx (≥ 500 lx) ✗	300 lx	469 lx	0.77 (≥ 0.60) ✓	0.64	WP17

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
201 Stair Upper Perpendicular illuminance Height: 0.000 m	150 lx	133 lx	161 lx	0.89	0.83	CG3

Building A · FIRST FLOOR · 201 STARIS (Light scene 1)

Summary

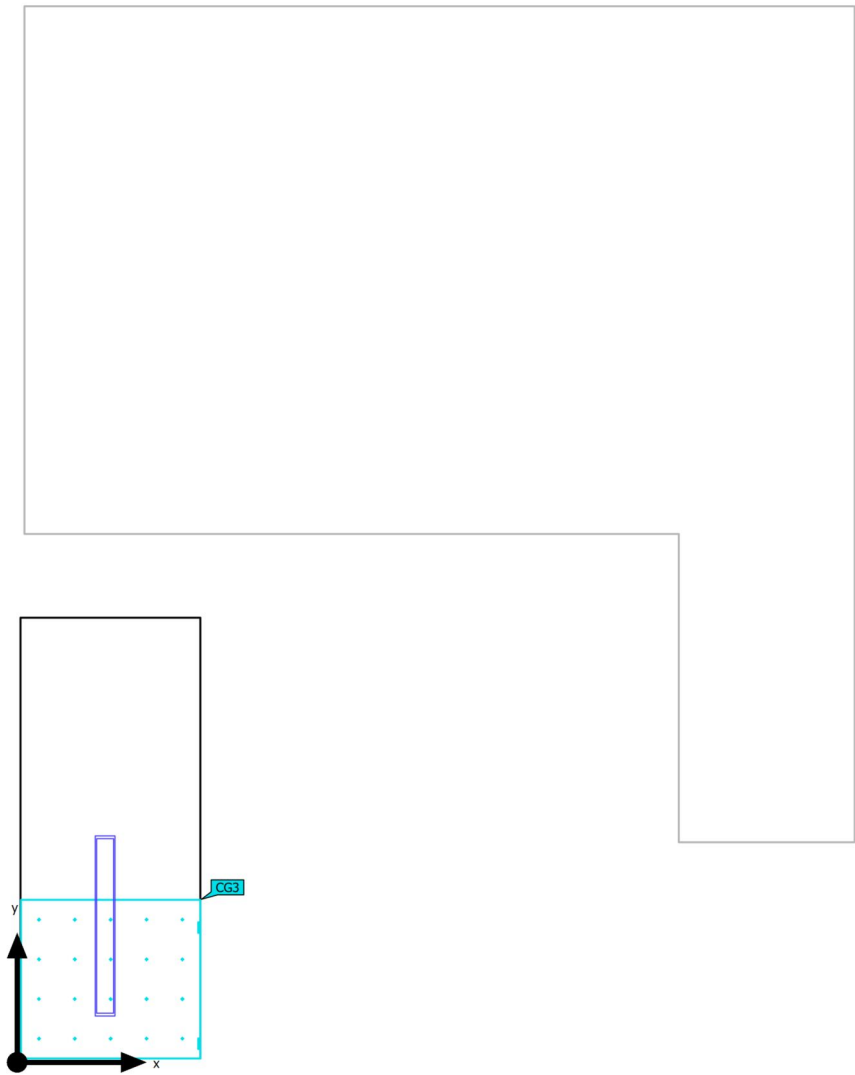

Ground area	4.00 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m

Building A · FIRST FLOOR · 201 STARIS (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 150 kWh/a	✗	
Space	Lighting power density	18.98 W/m ²	–		

(1) Based on a rectangular space of 1.278 m x 3.132 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 201 STARIS

Luminaire layout plan

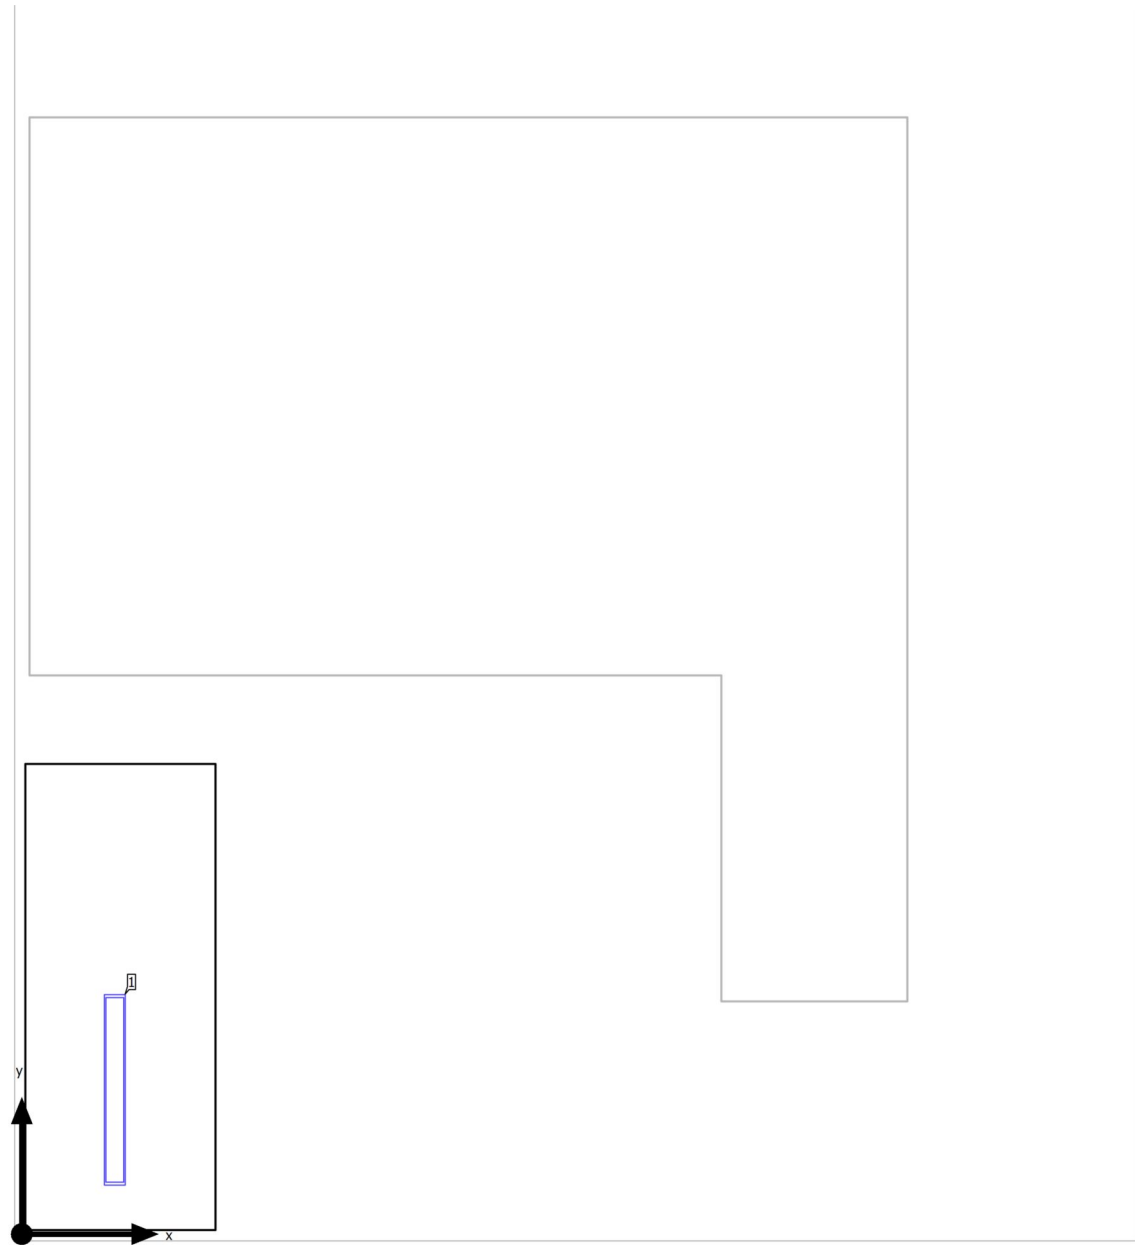

Building A · FIRST FLOOR · 201 STARIS

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
0.625 m	0.969 m	3.300 m	1

Building A · FIRST FLOOR · 201 STARIS


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 201 STARIS (Light scene 1)

Calculation objects

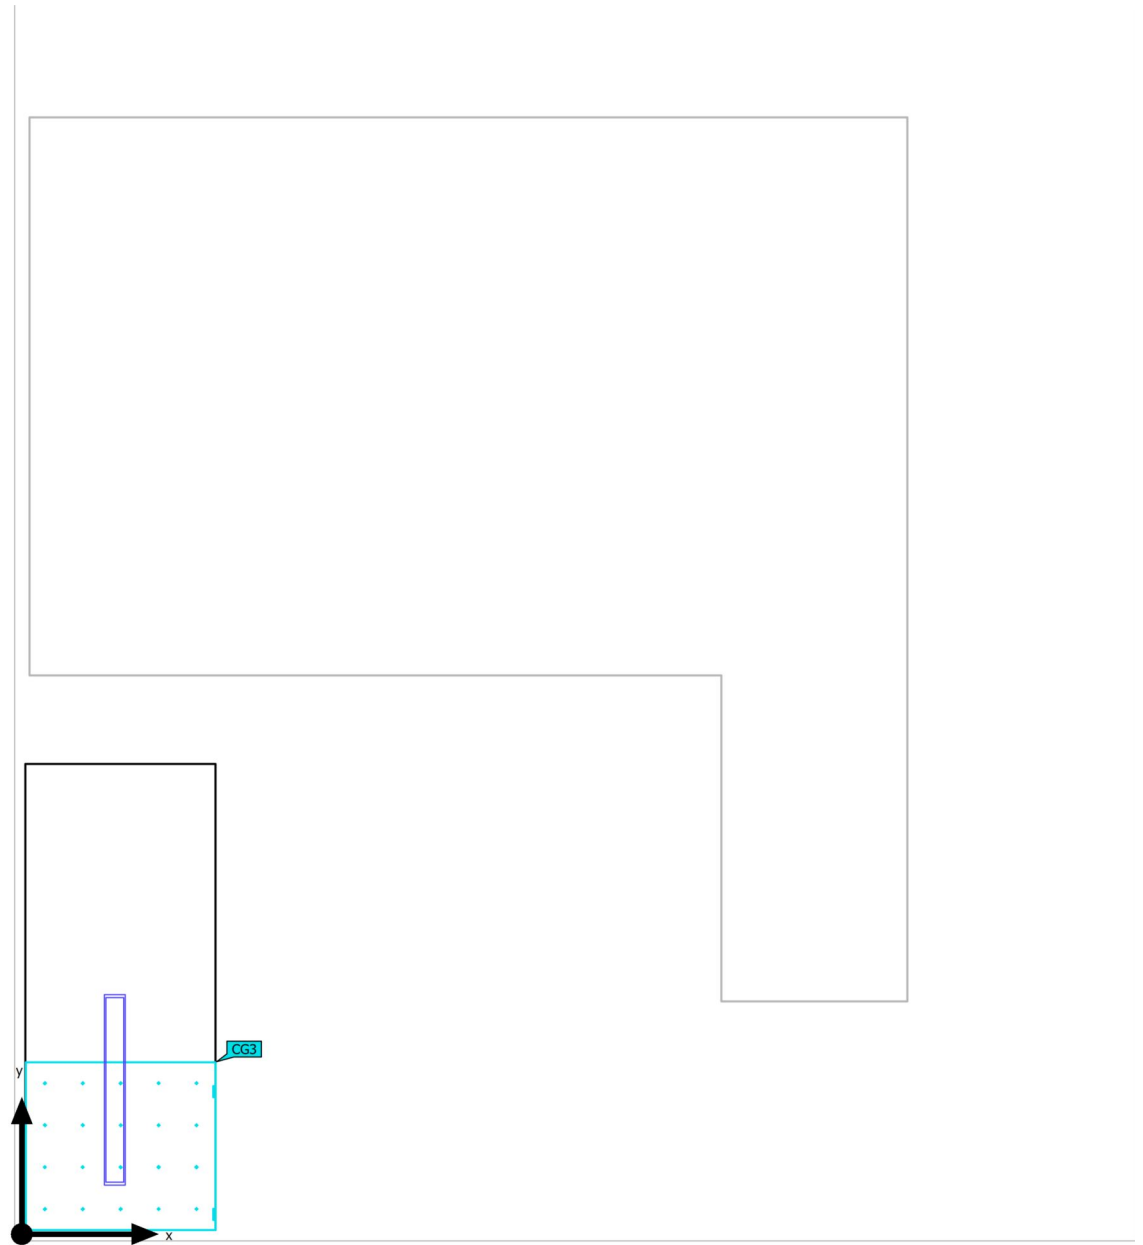

Building A · FIRST FLOOR · 201 STARIS (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
201 Stair Upper Perpendicular illuminance Height: 0.000 m	150 lx	133 lx	161 lx	0.89	0.83	CG3

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 201 STARIS (Light scene 1)

201 Stair Upper

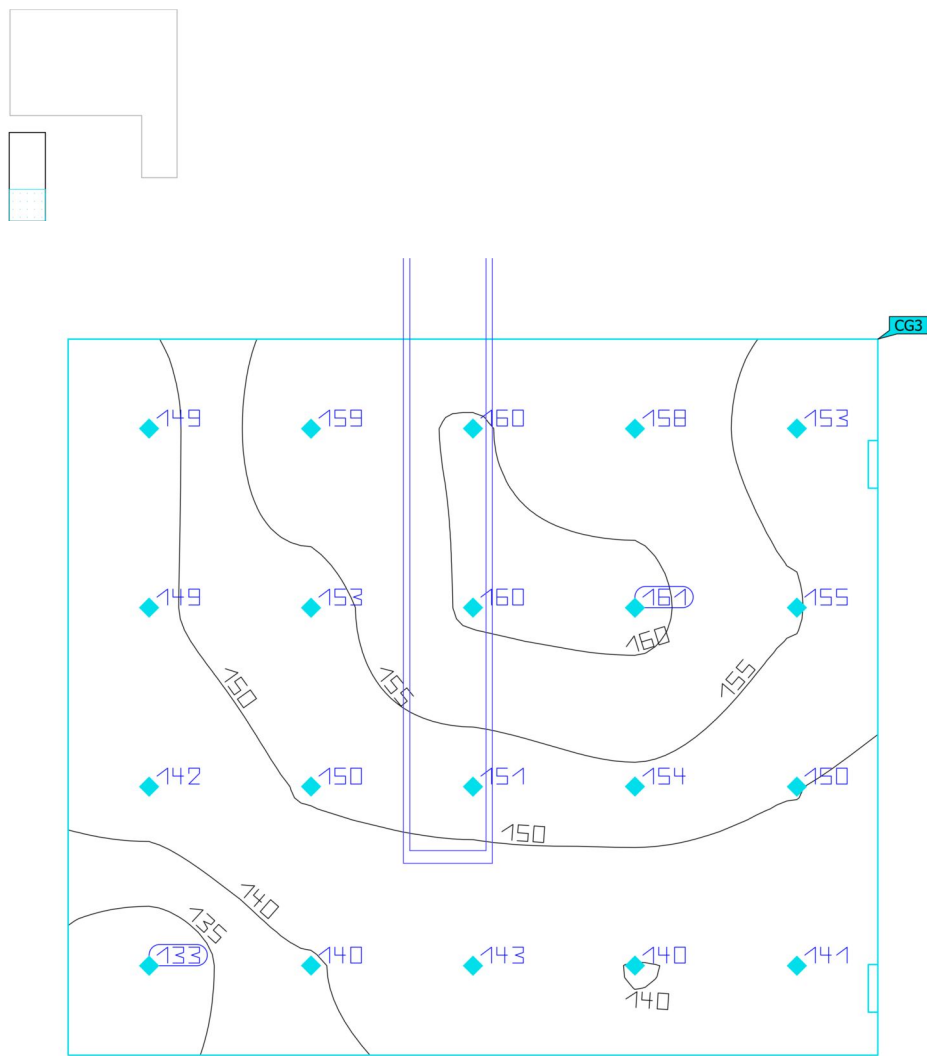


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
201 Stair Upper Perpendicular illuminance Height: 0.000 m	150 lx	133 lx	161 lx	0.89	0.83	CG3

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 202 CORRIDOR (Light scene 1)

Summary

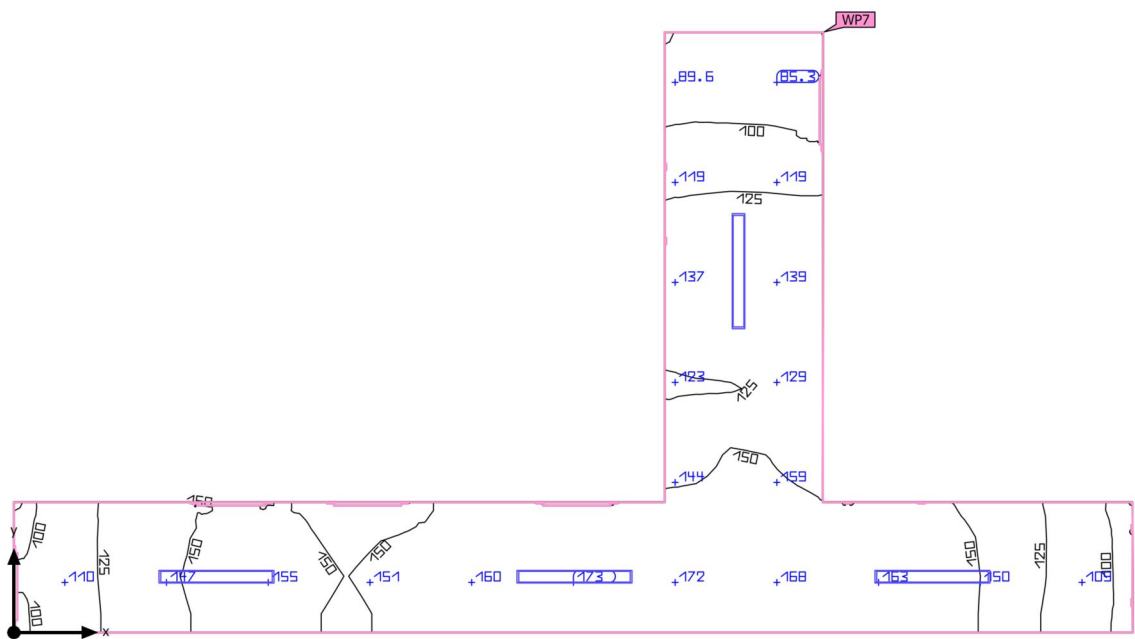

Ground area	27.25 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 202 CORRIDOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	140 lx	$\geq 500 \text{ lx}$	✗	WP7
	$U_o (g_1)$	0.46	≥ 0.60	✗	WP7
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	27	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[474 - 752] kWh/a	max. 1000 kWh/a	✓	
Space	Lighting power density	11.15 W/m ²	–		
		7.94 W/m ² /100 lx	–		

(1) Based on a rectangular space of 12.450 m x 6.678 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	27	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 202 CORRIDOR

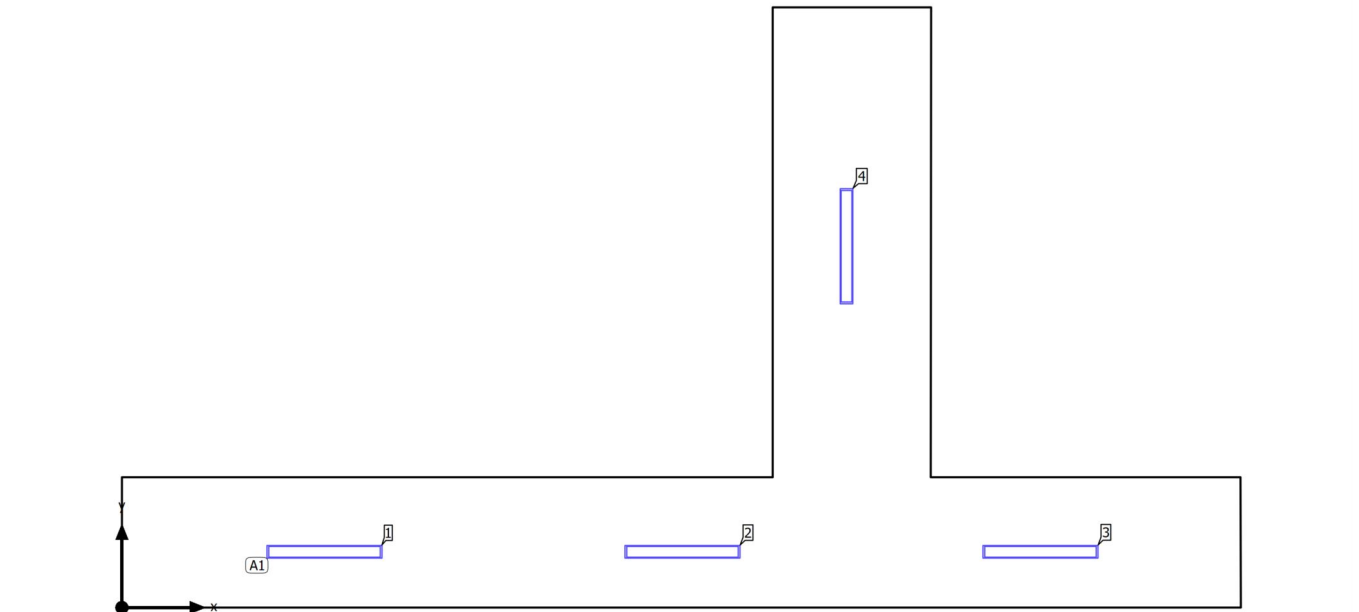Luminaire layout plan

Building A · FIRST FLOOR · 202 CORRIDOR

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

3 x Philips 2x36W

Type	Line arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	2.254 m / 0.620 m / 3.300 m	2.254 m	0.620 m	3.300 m	1
X-direction	3 pcs., Centre - centre, 3.983 m	6.237 m	0.620 m	3.300 m	2
Arrangement	A1	10.220 m	0.620 m	3.300 m	3

Individual luminaires

X	Y	Mounting height	Luminaire
8.062 m	4.020 m	3.300 m	4

Building A · FIRST FLOOR · 202 CORRIDOR


Luminaire list

Φ_{total} 18652 lm	P_{total} 304.0 W	Luminous efficacy 61.4 lm/W
-----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 202 CORRIDOR (Light scene 1)

Calculation objects

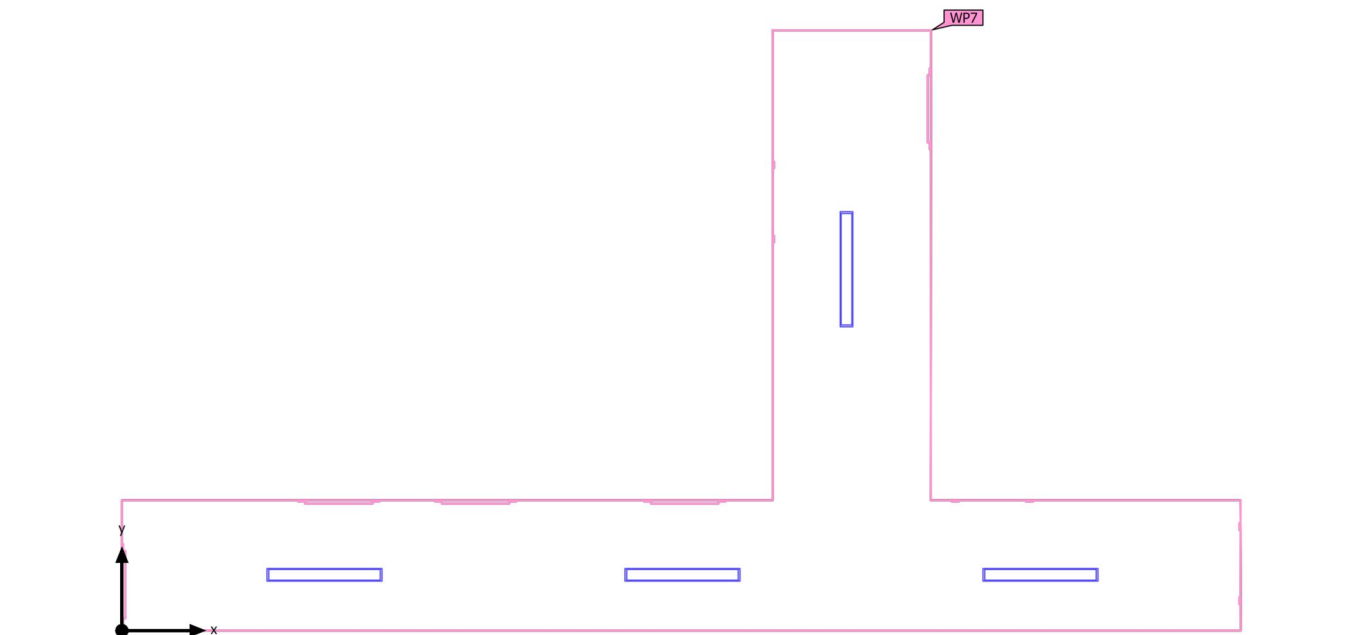

Building A · FIRST FLOOR · 202 CORRIDOR (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (202 CORRIDOR) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	140 lx (≥ 500 lx) ✗	65.0 lx	175 lx	0.46 (≥ 0.60) ✗	0.37	WP7

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 202 CORRIDOR (Light scene 1)

Working plane (202 CORRIDOR)

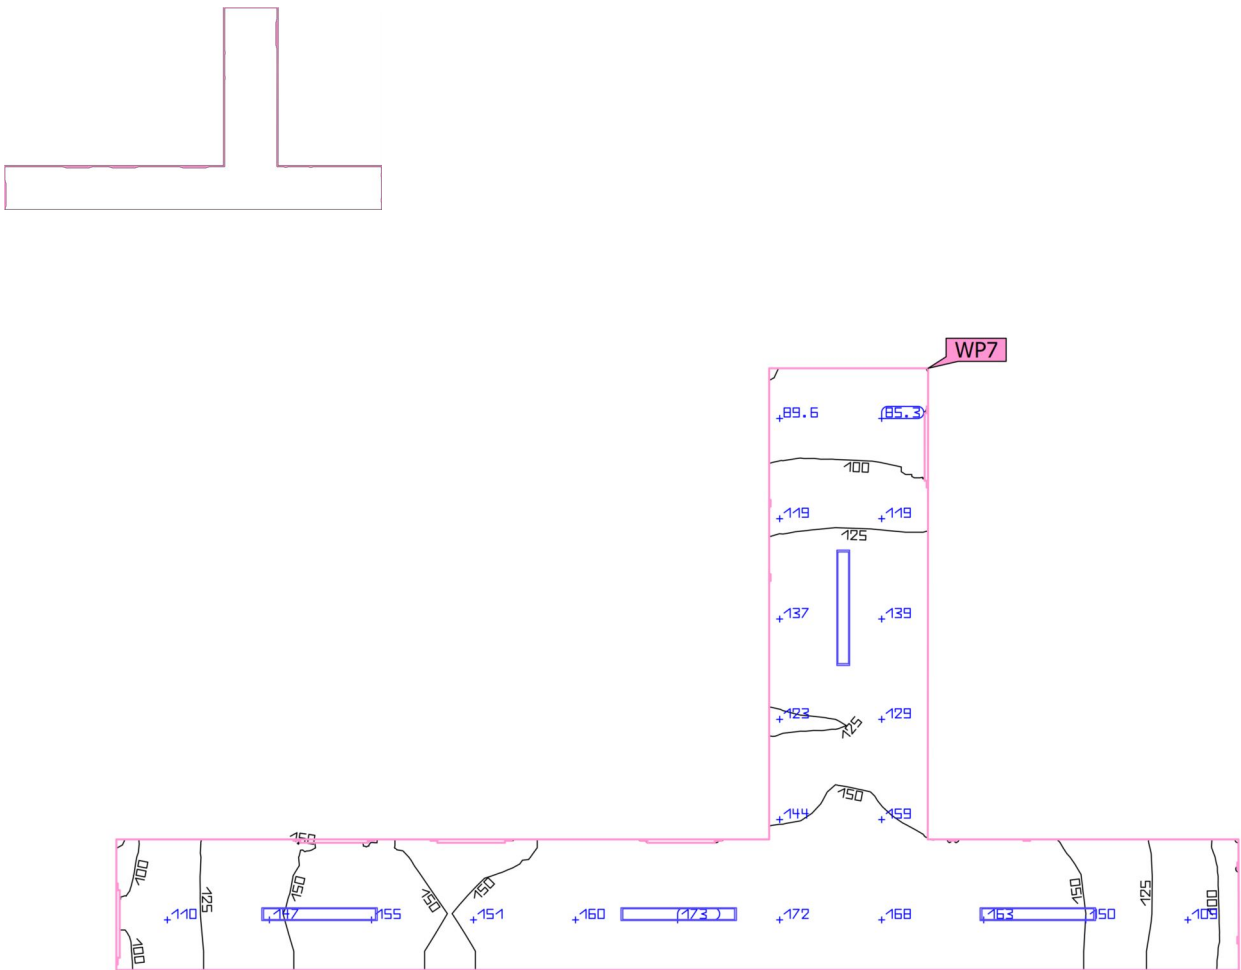


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (202 CORRIDOR)	140 lx	65.0 lx	175 lx	0.46	0.37	WP7
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.000 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 203 MEETING (Light scene 1)

Summary

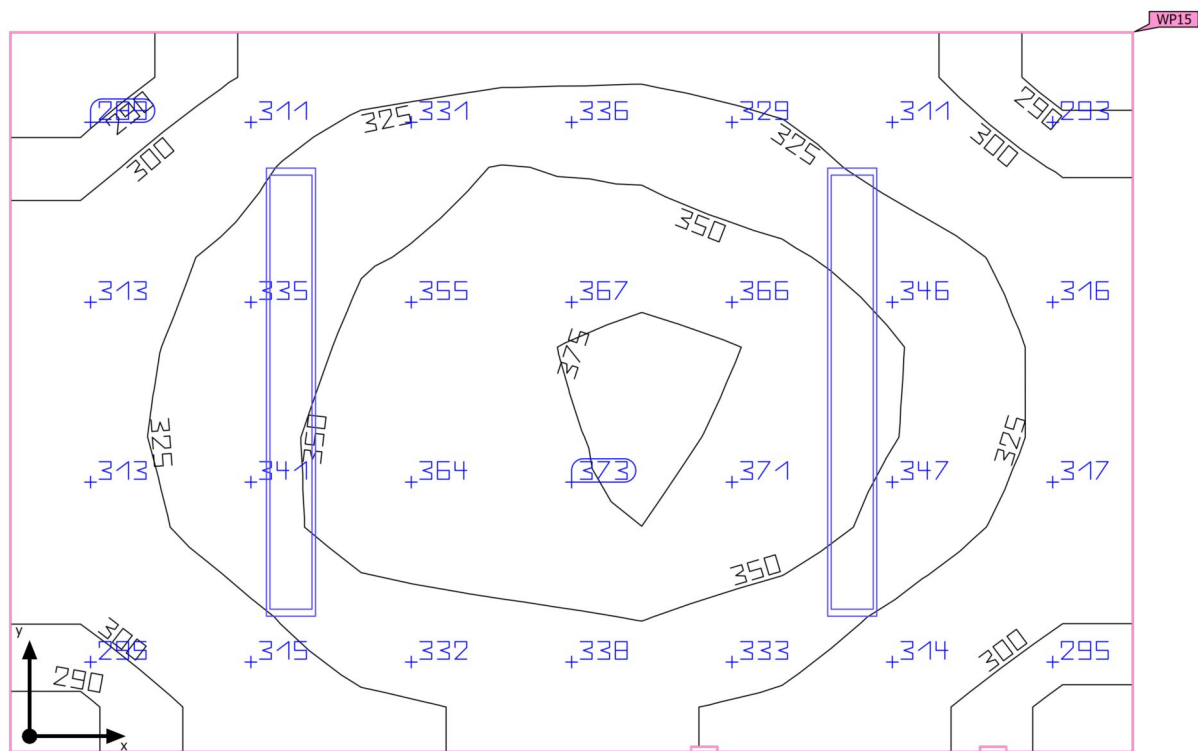

Ground area	6.59 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 203 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	331 lx	≥ 500 lx	✗	WP15
	$U_o (g_1)$	0.85	≥ 0.60	✓	WP15
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	376 kWh/a	max. 250 kWh/a	✗	
Space	Lighting power density	23.07 W/m ²	–		
		6.97 W/m ² /100 lx	–		

(1) Based on a rectangular space of 2.056 m x 3.205 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 203 MEETING

Luminaire layout plan

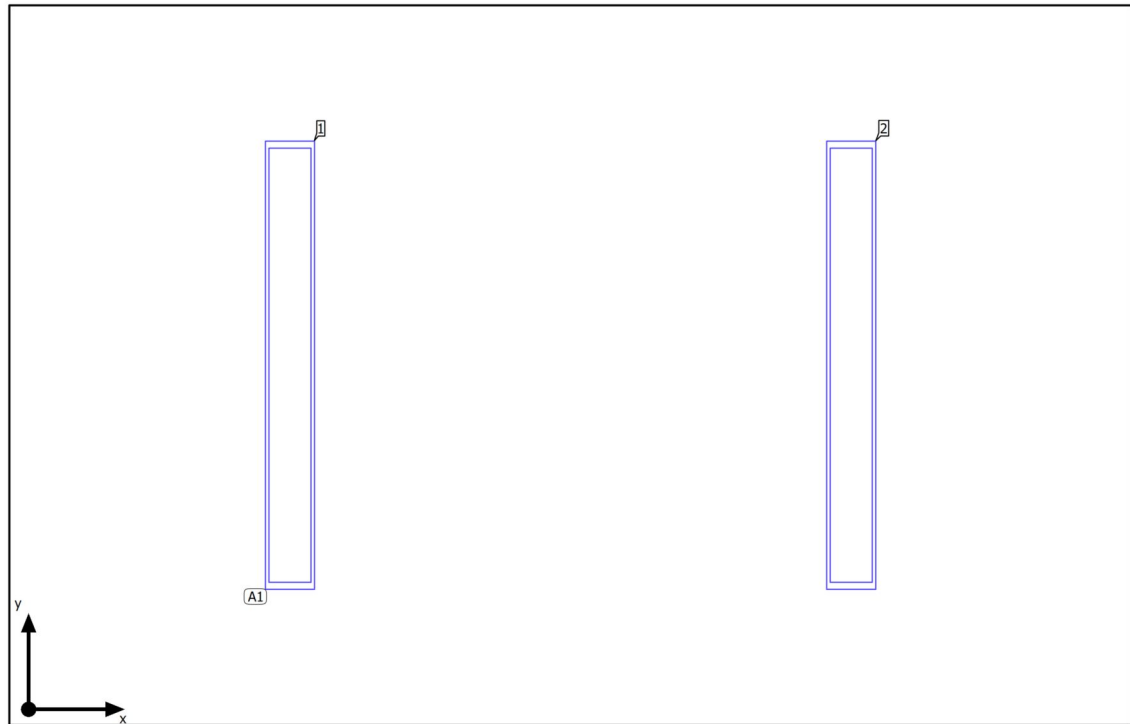

Building A · FIRST FLOOR · 203 MEETING

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

2 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.746 m / 0.983 m / 3.300 m	0.746 m	0.983 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 1.602 m	2.349 m	0.983 m	3.300 m	2
Y-direction	1 pcs., Centre - centre, 2.056 m				
Arrangement	A1				

Building A · FIRST FLOOR · 203 MEETING

Luminaire list Φ_{total}

9326 lm

 P_{total}

152.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
2	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 203 MEETING (Light scene 1)

Calculation objects

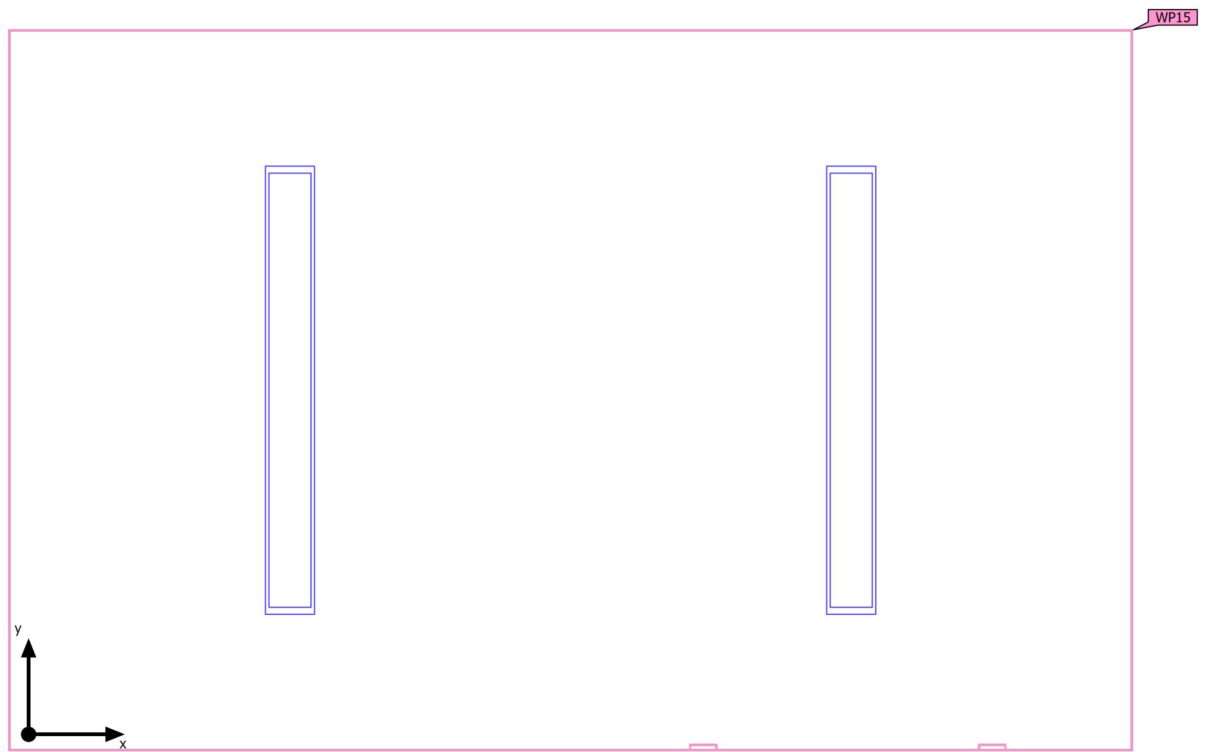

Building A · FIRST FLOOR · 203 MEETING (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (203 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	331 lx (≥ 500 lx) ✗	281 lx	377 lx	0.85 (≥ 0.60) ✓	0.75	WP15

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 203 MEETING (Light scene 1)

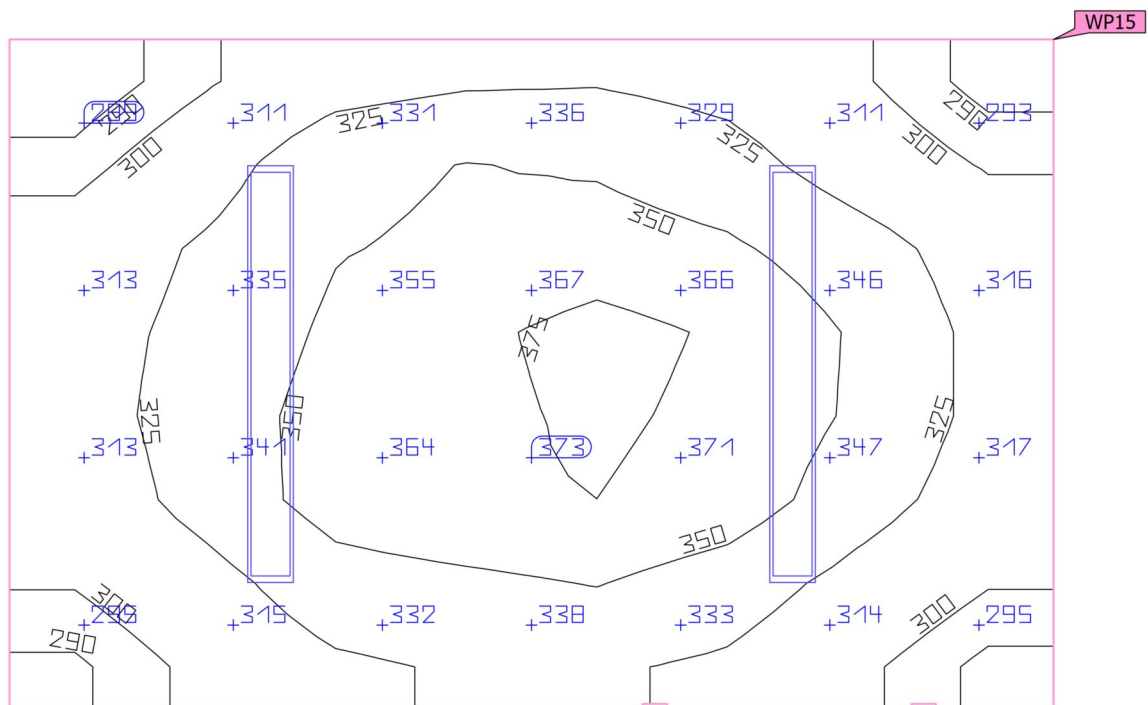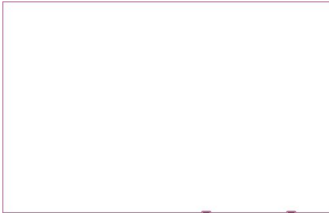
Working plane (203 MEETING)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (203 MEETING)	331 lx	281 lx	377 lx	0.85	0.75	WP15
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 204 MANAGER (Light scene 1)

Summary

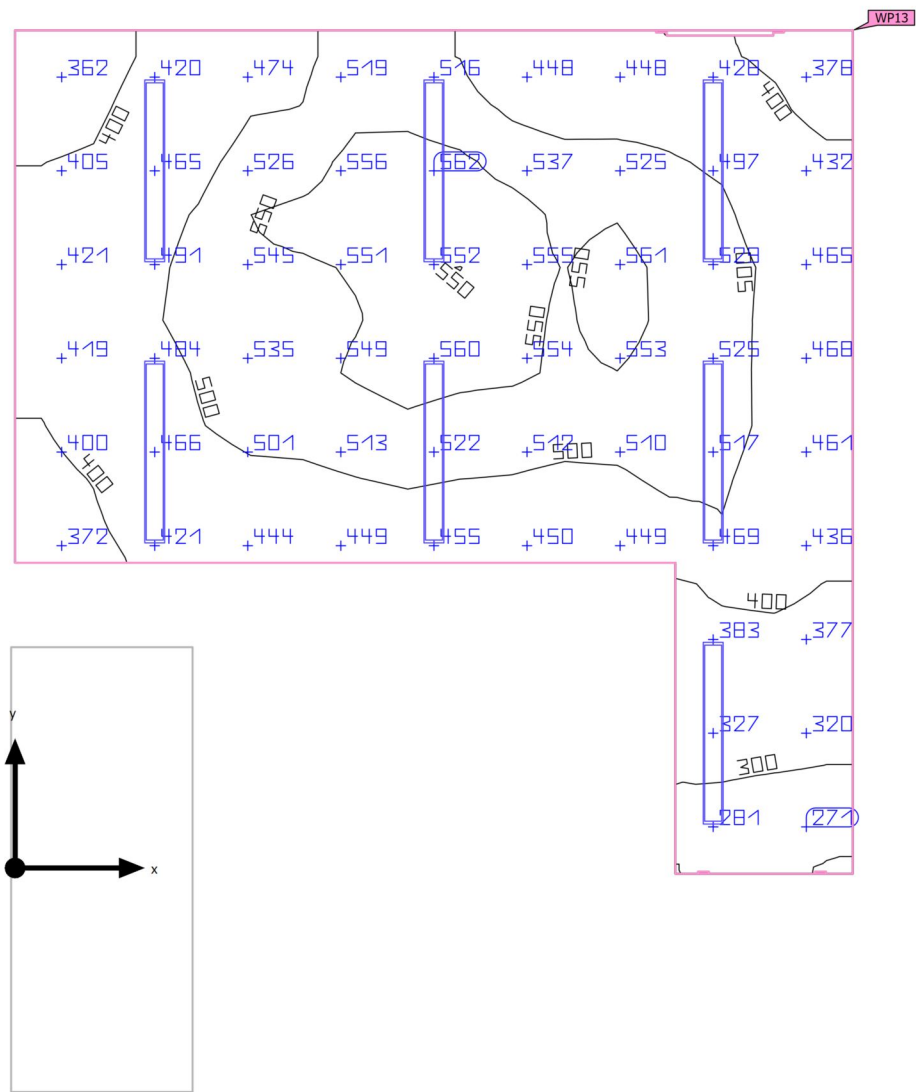

Ground area	24.86 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 204 MANAGER (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	470 lx	$\geq 500 \text{ lx}$	✗	WP13
	$U_o (g_1)$	0.53	≥ 0.60	✗	WP13
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[899 - 1317] kWh/a	max. 900 kWh/a	✗	
Space	Lighting power density	21.40 W/m ²	–		
		4.56 W/m ² /100 lx	–		

(1) Based on a rectangular space of 5.900 m x 5.941 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
7	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 204 MANAGER

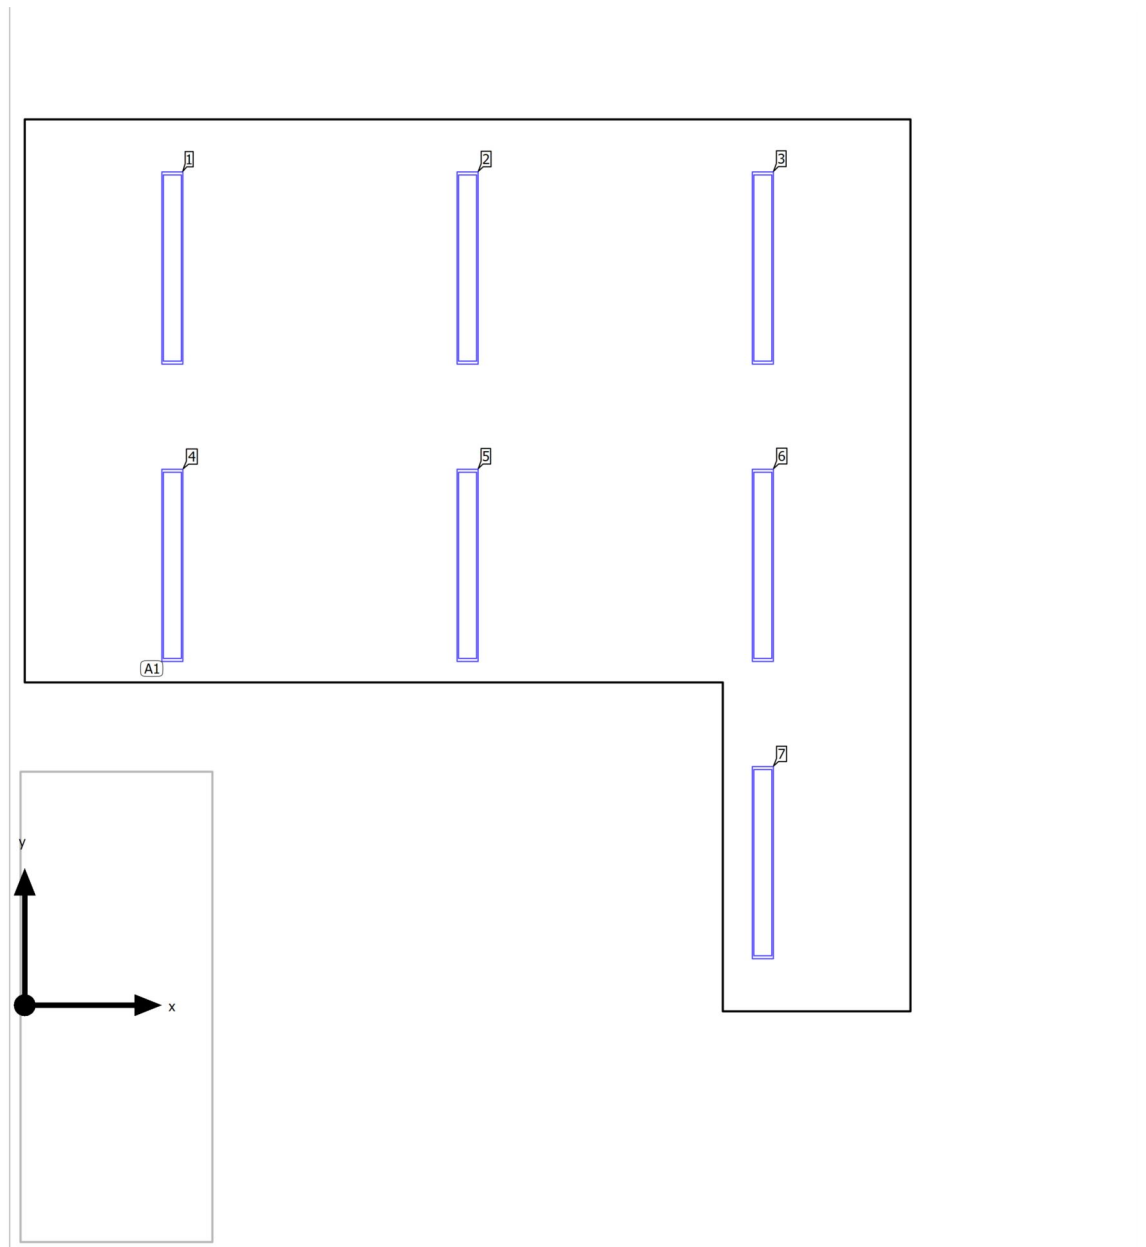Luminaire layout plan

Building A · FIRST FLOOR · 204 MANAGER

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

7 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.983 m / 2.930 m / 3.300 m	0.983 m	4.910 m	3.300 m	1
X-direction	3 pcs., Centre - centre, 1.967 m	2.950 m	4.910 m	3.300 m	2
		4.917 m	4.910 m	3.300 m	3
Y-direction	3 pcs., Centre - centre, 1.980 m	0.983 m	2.930 m	3.300 m	4
		2.950 m	2.930 m	3.300 m	5
		4.917 m	2.930 m	3.300 m	6
Arrangement	A1	4.917 m	0.949 m	3.300 m	7

Building A · FIRST FLOOR · 204 MANAGER

Luminaire list Φ_{total}

32641 lm

 P_{total}

532.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
7	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 204 MANAGER (Light scene 1)

Calculation objects

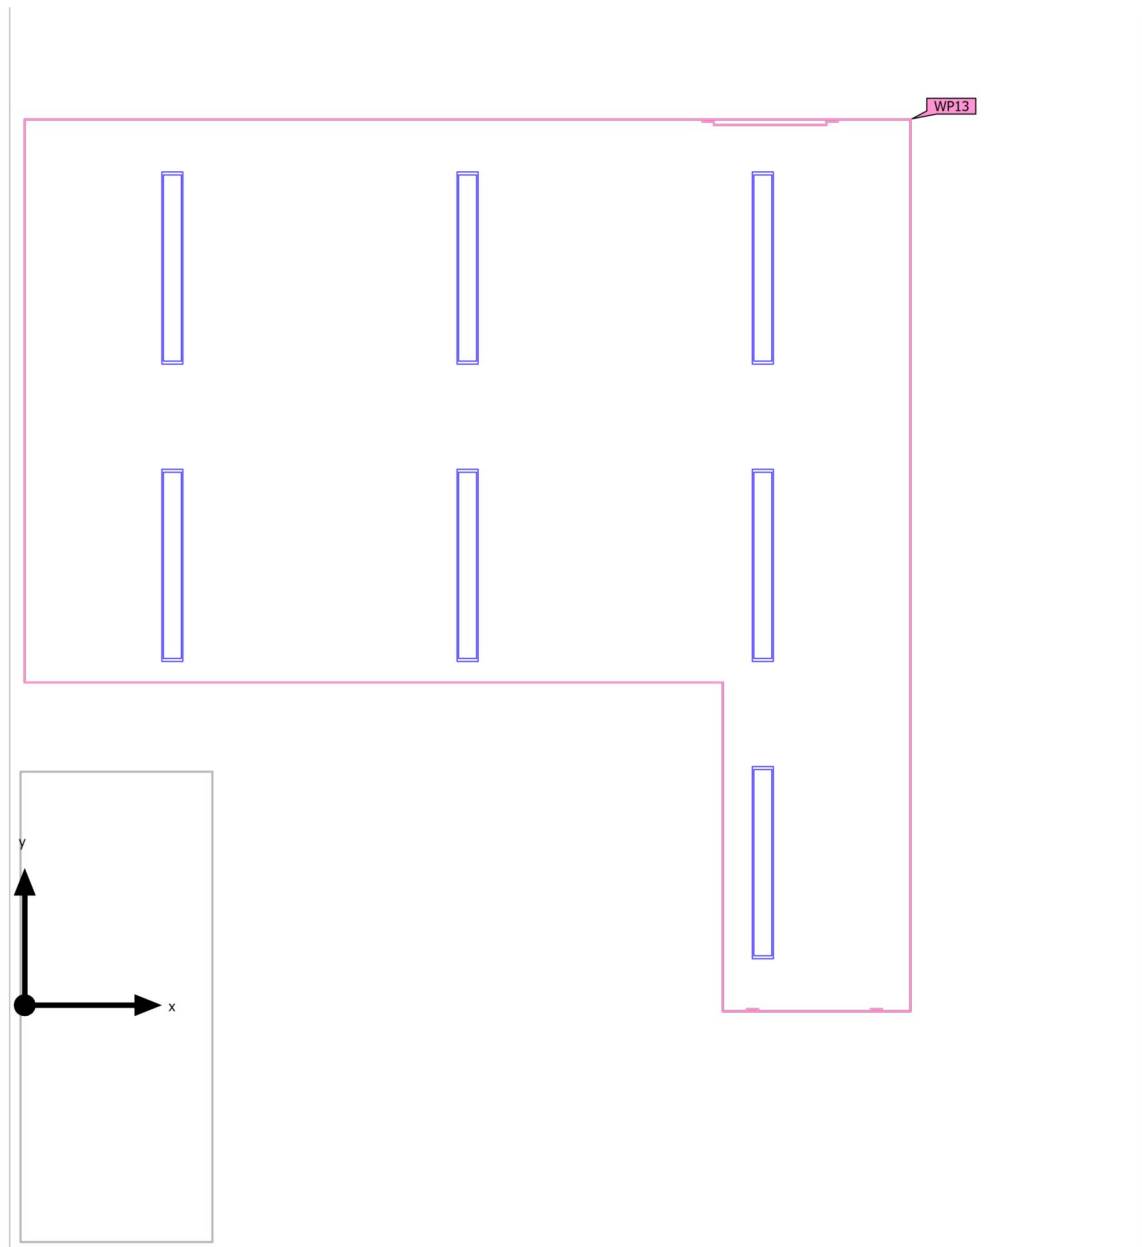

Building A · FIRST FLOOR · 204 MANAGER (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (204 MANAGER)	470 lx	248 lx	569 lx	0.53	0.44	WP13
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 204 MANAGER (Light scene 1)

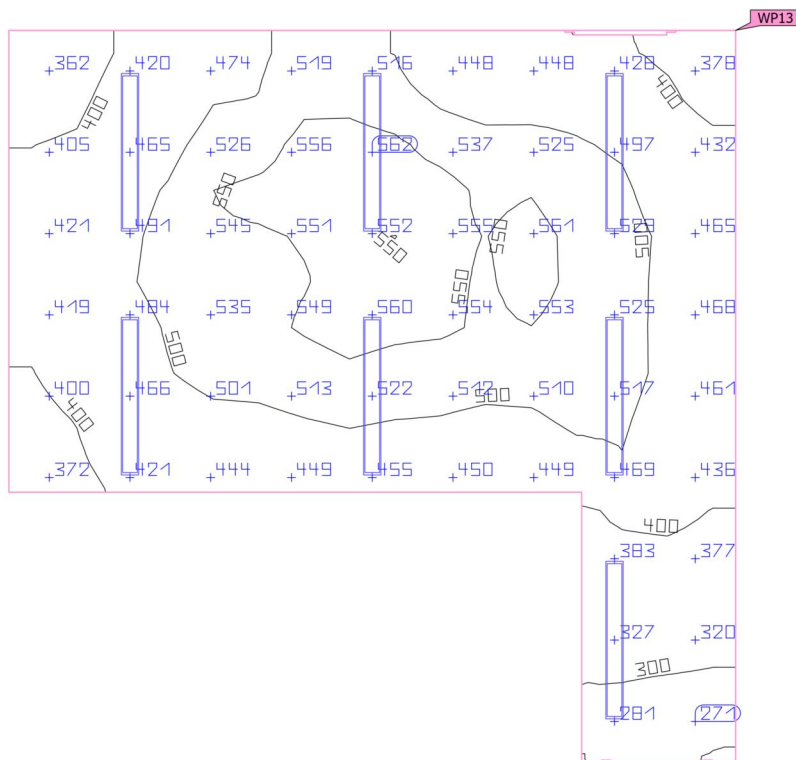
Working plane (204 MANAGER)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (204 MANAGER)	470 lx	248 lx	569 lx	0.53	0.44	WP13
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 204A DB (Light scene 1)

Summary

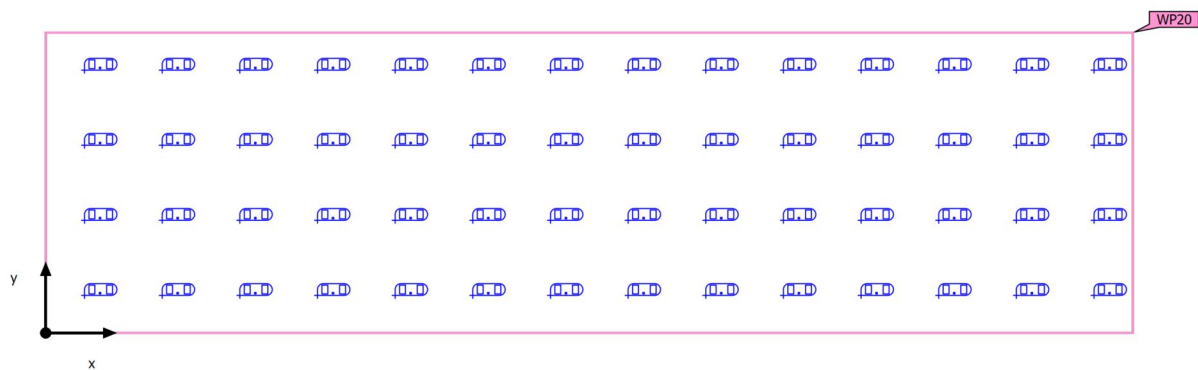

Ground area	0.42 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.80 (fixed)

Clearance height	0.000 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 204A DB (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	0.00 lx	$\geq 500 \text{ lx}$	✗	WP20
	$U_o (g_1)$	-	≥ 0.60		WP20
Energy estimation ⁽²⁾	Consumption	0.00 kWh/a	max. 50 kWh/a	✓	
Space	Lighting power density	0.00 W/m ²	-		


(1) Based on a rectangular space of 1.230 m x 0.340 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 204A DB (Light scene 1)

Calculation objects

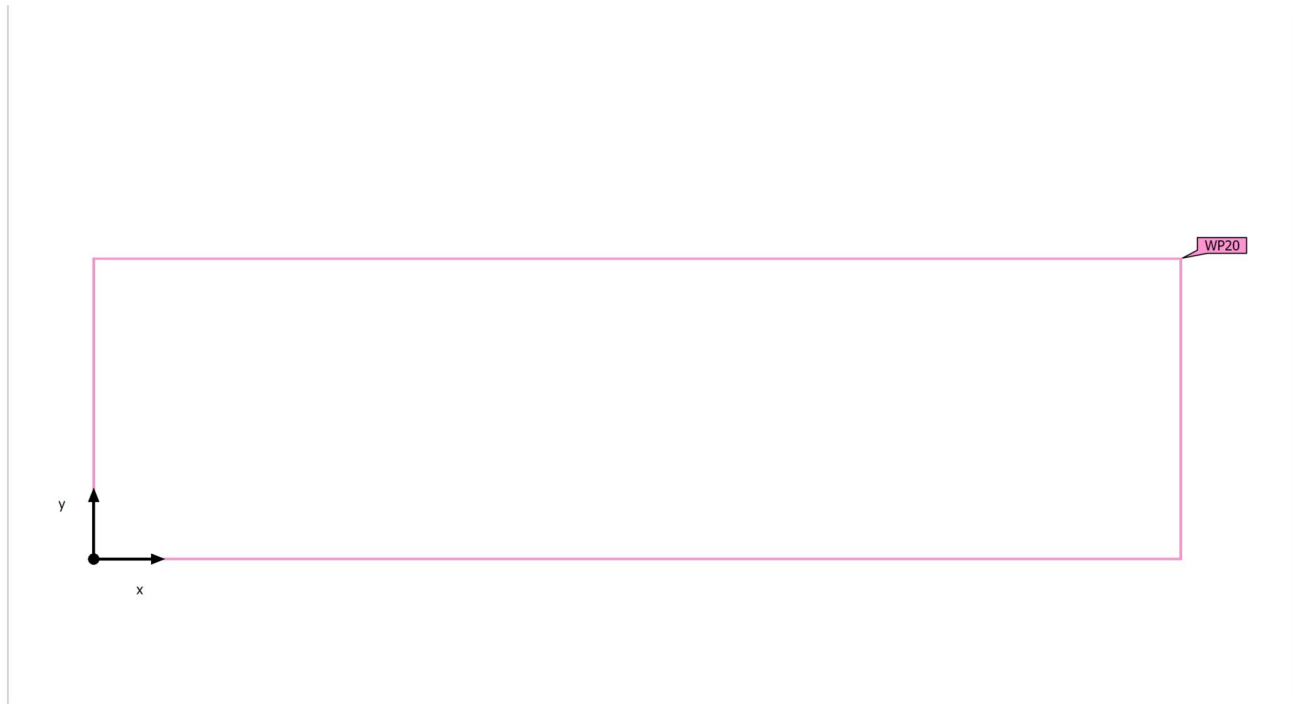

Building A · FIRST FLOOR · 204A DB (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (204A DB) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	0.00 lx (≥ 500 lx) ✗	0.00 lx	0.00 lx	- (≥ 0.60)	-	WP20

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 204A DB (Light scene 1)

Working plane (204A DB)

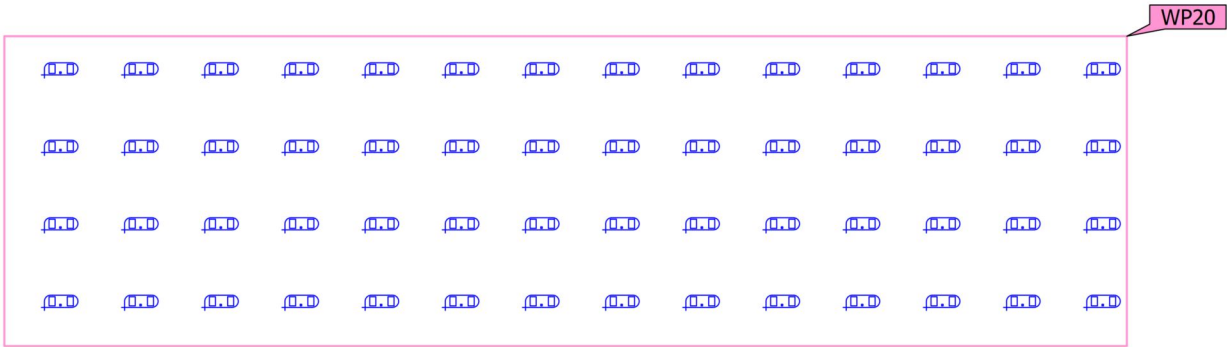


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (204A DB) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	0.00 lx (≥ 500 lx) ✗	0.00 lx	0.00 lx	- (≥ 0.60)	-	WP20

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 205 BALCONY (Light scene 1)

Summary

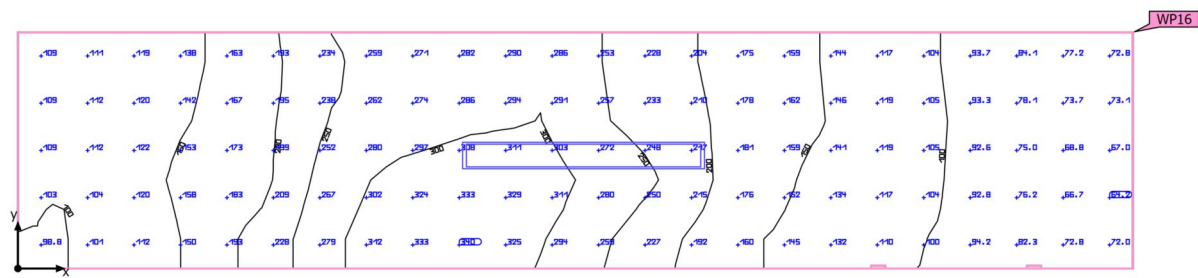

Ground area	7.38 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 205 BALCONY (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	181 lx	$\geq 500 \text{ lx}$	✗	WP16
	$U_o (g_1)$	0.35	≥ 0.60	✗	WP16
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 300 kWh/a	✓	
Space	Lighting power density	10.31 W/m ²	–		
		5.71 W/m ² /100 lx	–		

(1) Based on a rectangular space of 1.250 m x 5.900 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W


Building A · FIRST FLOOR · 205 BALCONY

Luminaire layout plan

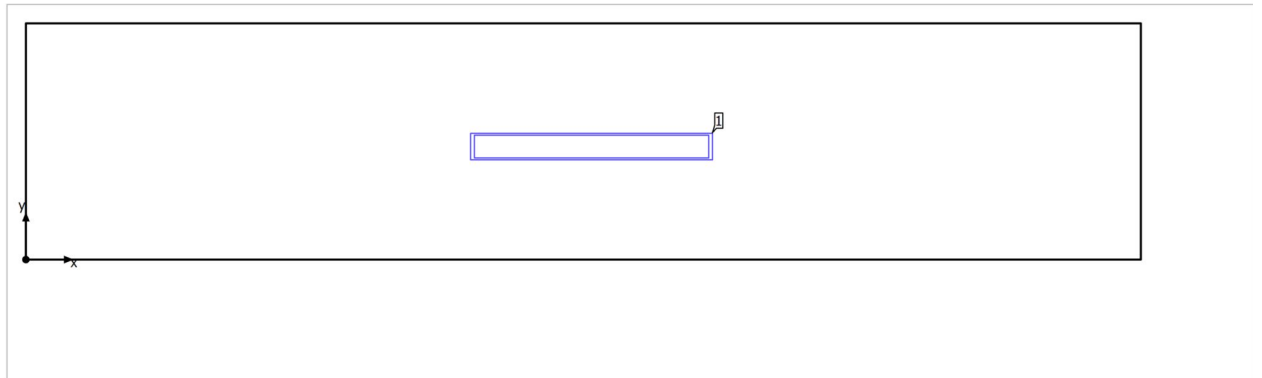

Building A · FIRST FLOOR · 205 BALCONY

Luminaire layout plan



Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
2.993 m	0.598 m	3.300 m	1

Building A · FIRST FLOOR · 205 BALCONY


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 205 BALCONY (Light scene 1)

Calculation objects

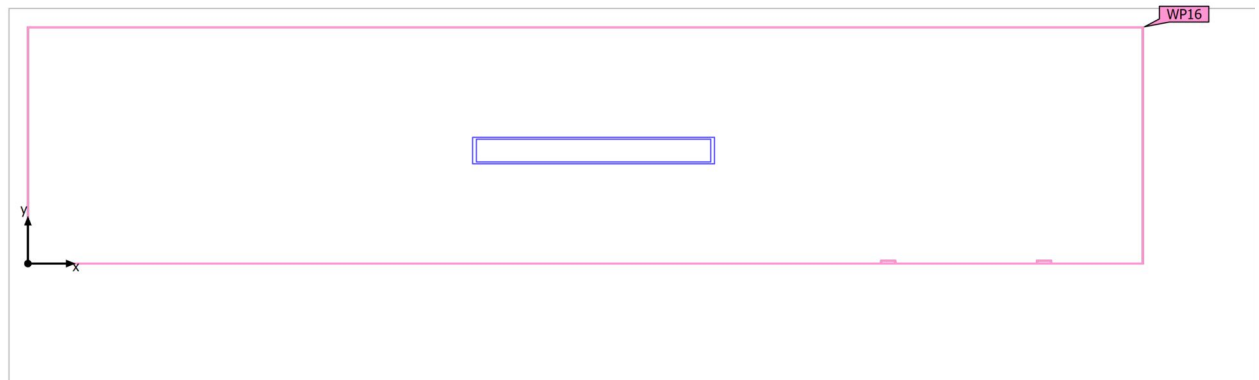

Building A · FIRST FLOOR · 205 BALCONY (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (205 BALCONY)	181 lx	63.6 lx	341 lx	0.35	0.19	WP16
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 205 BALCONY (Light scene 1)

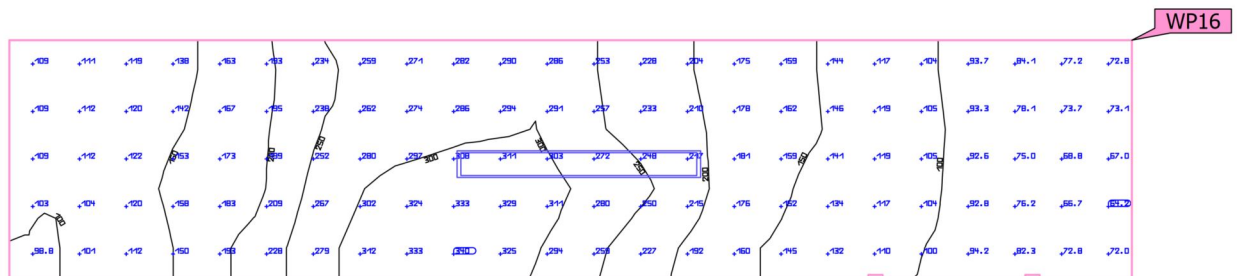
Working plane (205 BALCONY)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (205 BALCONY)	181 lx	63.6 lx	341 lx	0.35	0.19	WP16
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 206 TOILET (Light scene 1)

Summary

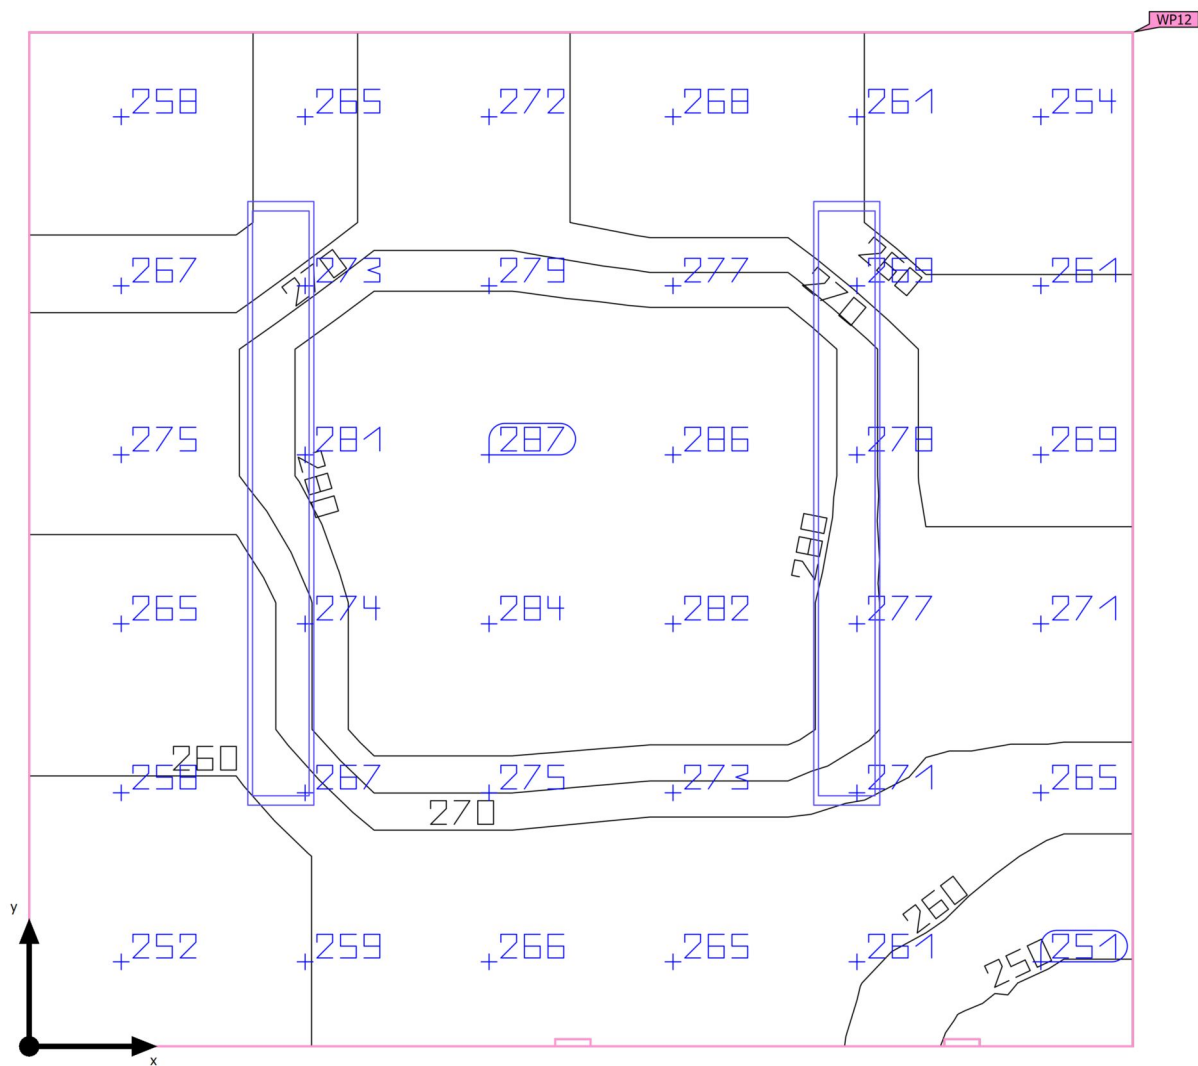

Ground area	5.03 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 206 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	269 lx	$\geq 500 \text{ lx}$	✗	WP12
	$U_o (g_1)$	0.92	≥ 0.60	✓	WP12
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	376 kWh/a	max. 200 kWh/a	✗	
Space	Lighting power density	30.21 W/m ²	–		
		11.22 W/m ² /100 lx	–		

(1) Based on a rectangular space of 2.340 m x 2.150 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 206 TOILET

Luminaire layout plan

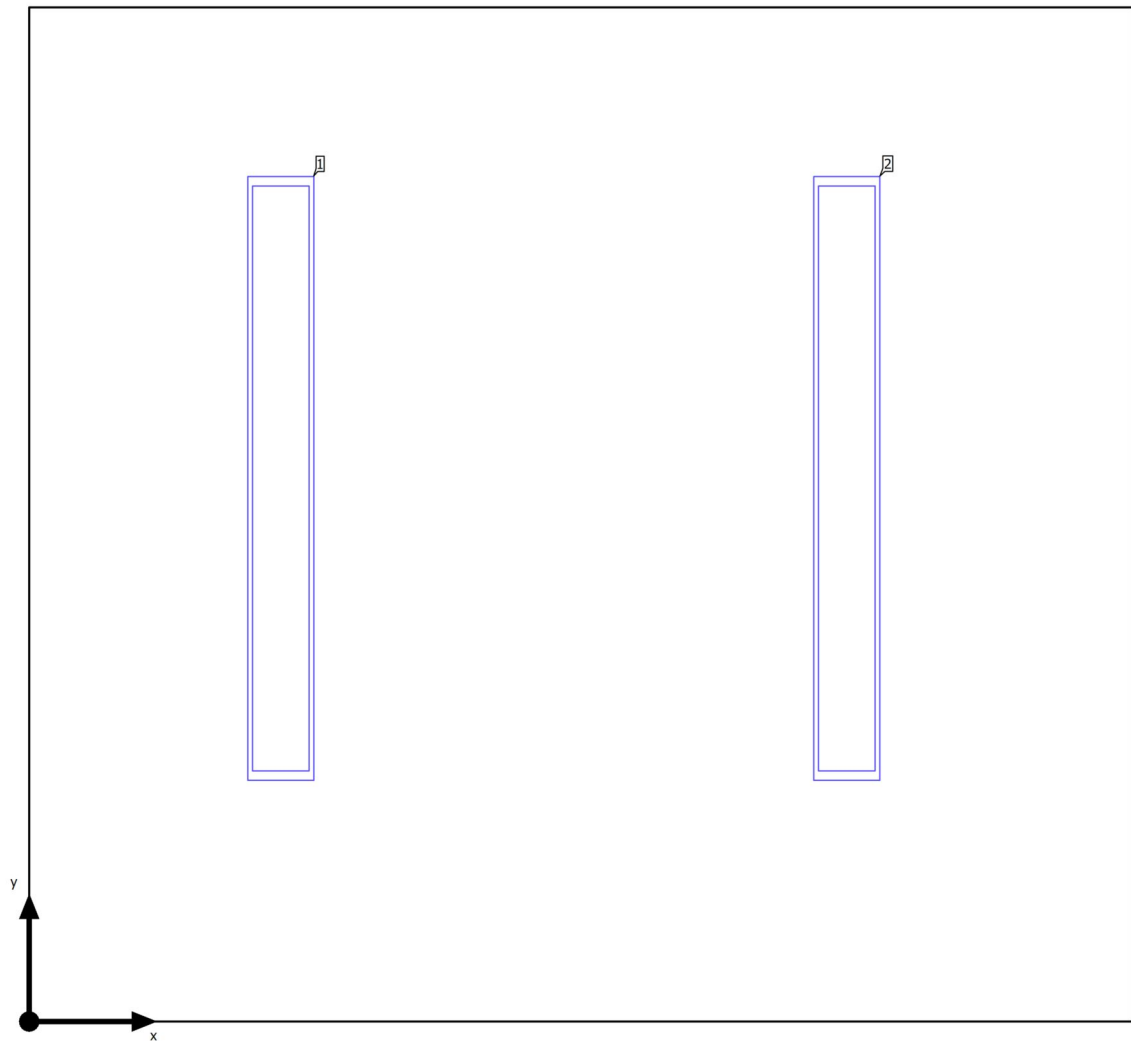

Building A · FIRST FLOOR · 206 TOILET

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
0.533 m	1.151 m	3.300 m	1
1.733 m	1.151 m	3.300 m	2

Building A · FIRST FLOOR · 206 TOILET


Luminaire list

Φ_{total} 9326 lm	P_{total} 152.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
2	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 206 TOILET (Light scene 1)

Calculation objects

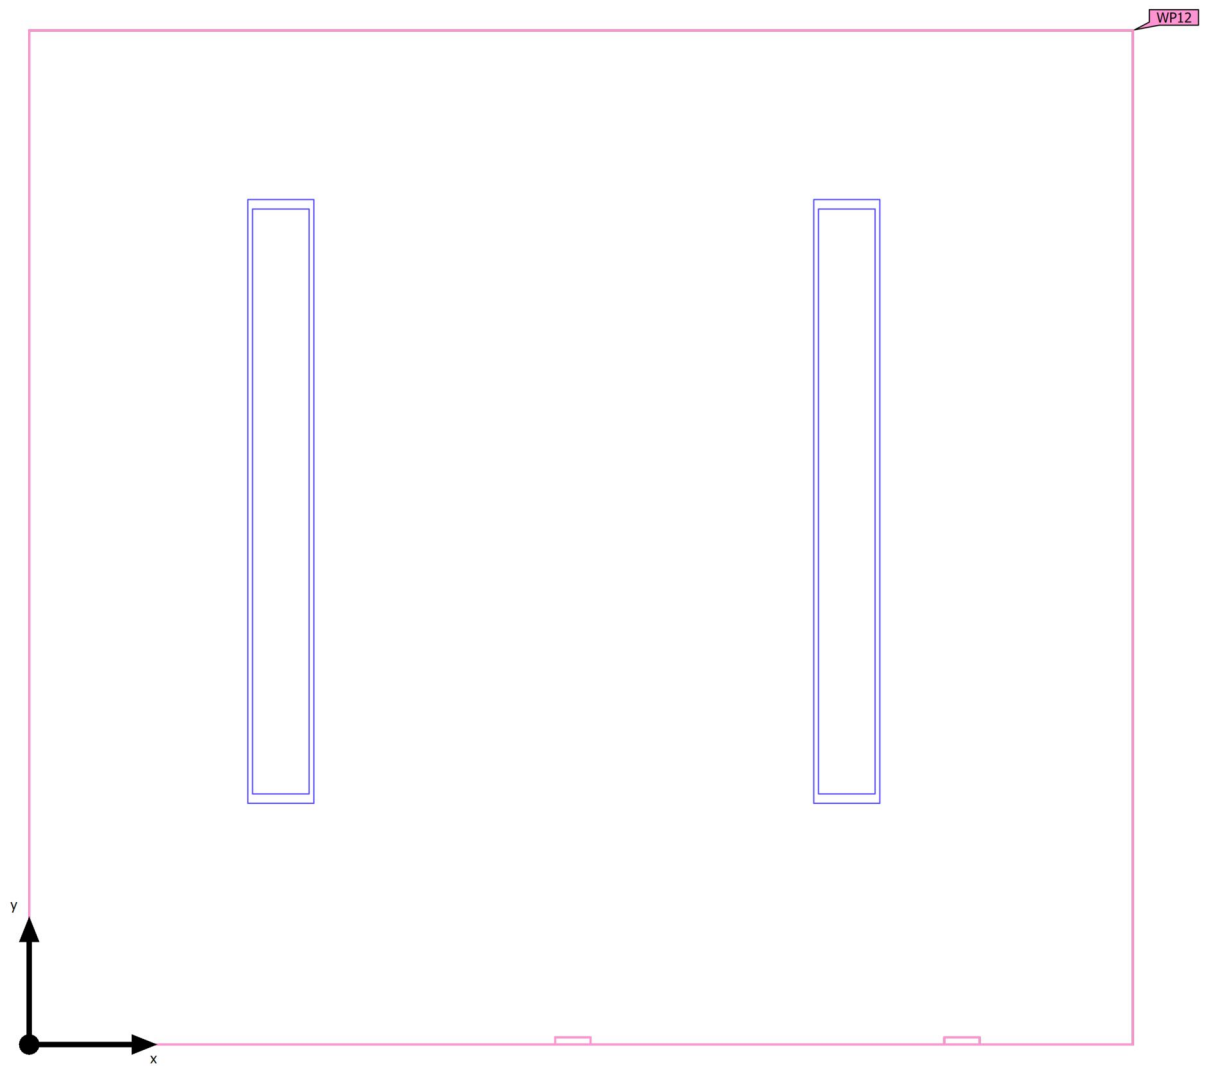

Building A · FIRST FLOOR · 206 TOILET (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (206 TOILET)	269 lx	248 lx	286 lx	0.92	0.87	WP12
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 206 TOILET (Light scene 1)

Working plane (206 TOILET)

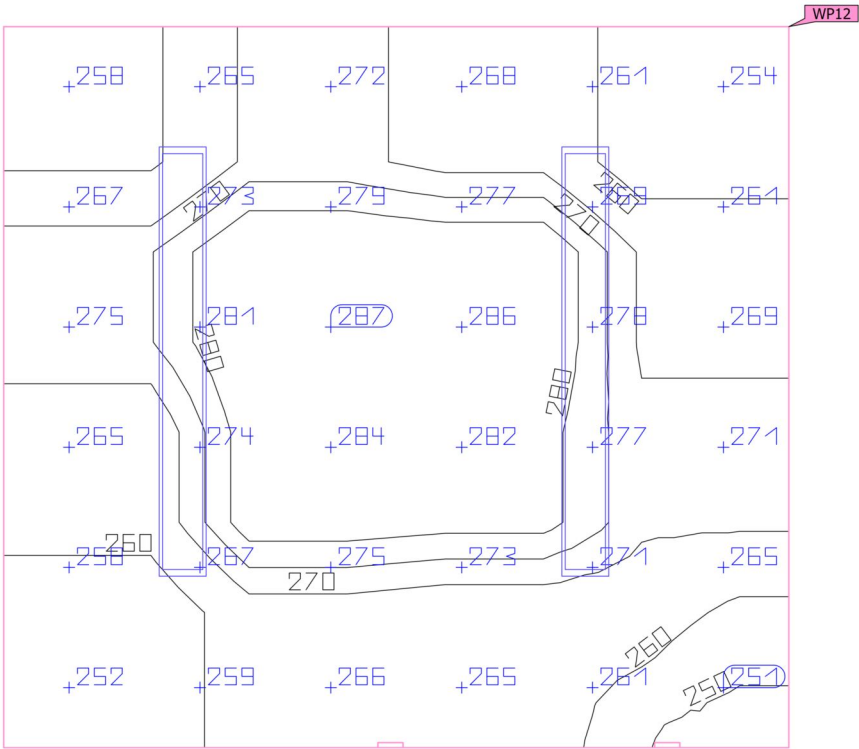


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (206 TOILET)	269 lx	248 lx	286 lx	0.92	0.87	WP12
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 207 OFFICE (Light scene 1)

Summary

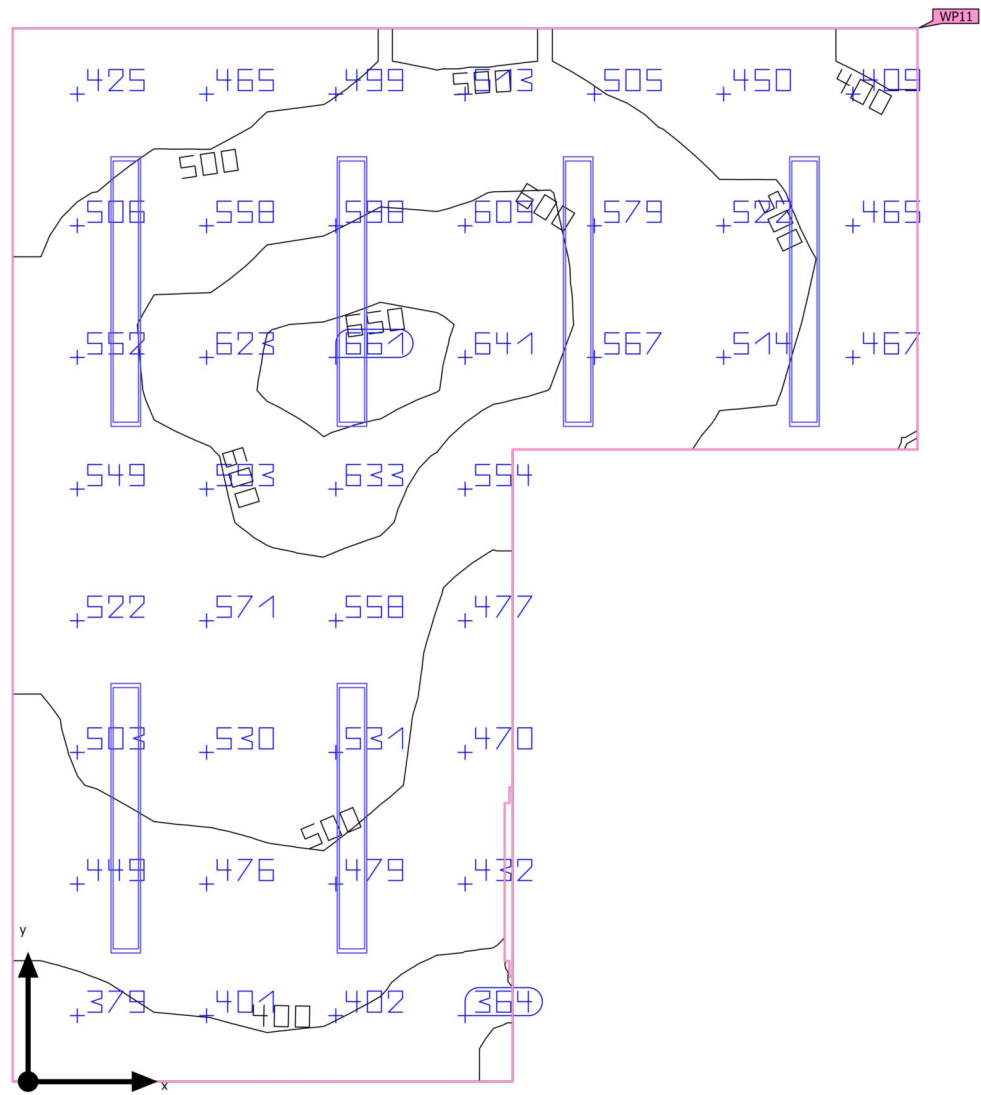

Ground area	15.71 m ²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 207 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	516 lx	$\geq 500 \text{ lx}$	✓	WP11
	$U_o (g_1)$	0.61	≥ 0.60	✓	WP11
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[711 - 1129] kWh/a	max. 600 kWh/a	✗	
Space	Lighting power density	29.02 W/m ²	–		
		5.63 W/m ² /100 lx	–		

(1) Based on a rectangular space of 5.000 m x 4.296 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
6	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 207 OFFICE

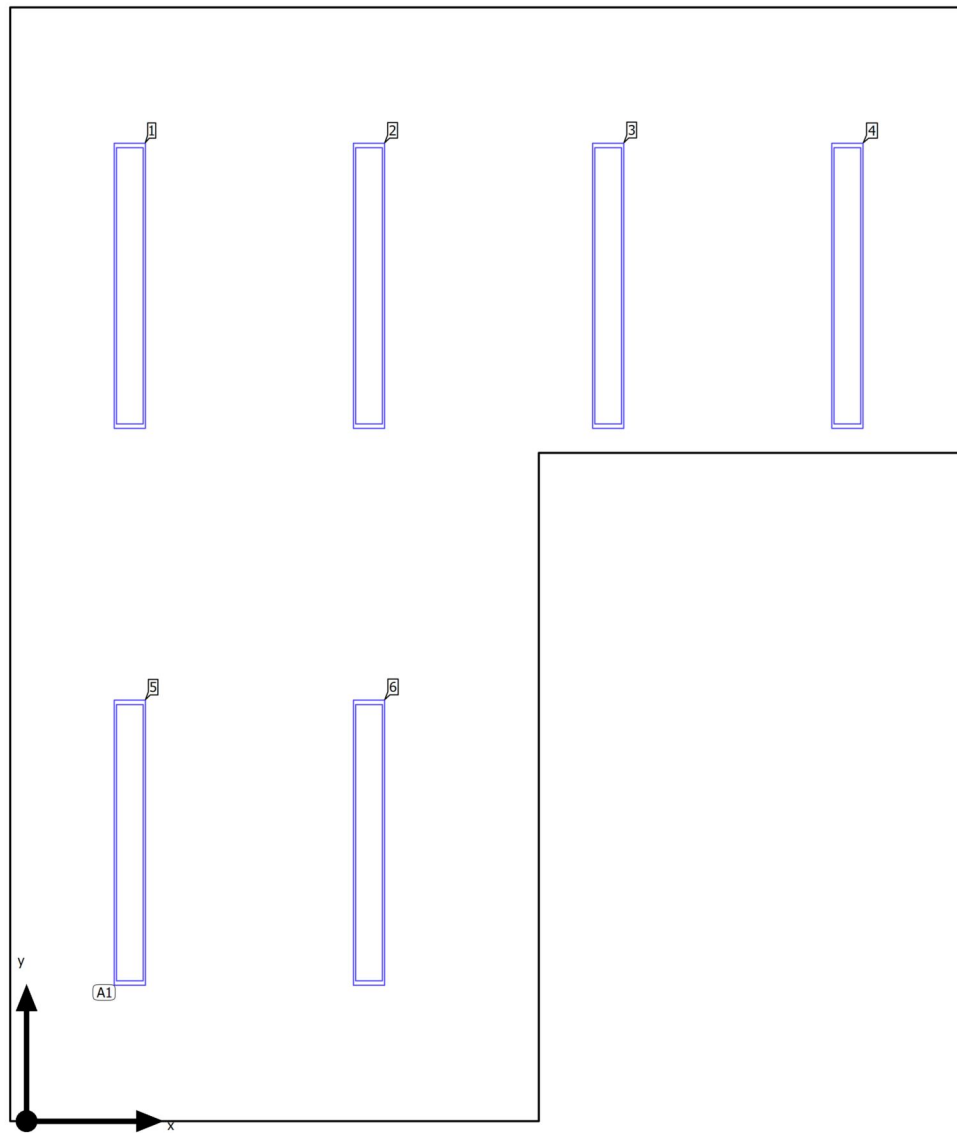Luminaire layout plan

Building A · FIRST FLOOR · 207 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

6 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.464 m / 1.250 m / 3.300 m	0.464 m	3.750 m	3.300 m	1
X-direction	4 pcs., Centre - centre, 1.074 m	1.538 m	3.750 m	3.300 m	2
Y-direction	2 pcs., Centre - centre, 2.500 m	2.611 m	3.750 m	3.300 m	3
		3.685 m	3.750 m	3.300 m	4
Arrangement	A1	0.464 m	1.250 m	3.300 m	5
		1.538 m	1.250 m	3.300 m	6

Building A · FIRST FLOOR · 207 OFFICE

Luminaire list Φ_{total}

27978 lm

 P_{total}

456.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
6	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 207 OFFICE (Light scene 1)

Calculation objects

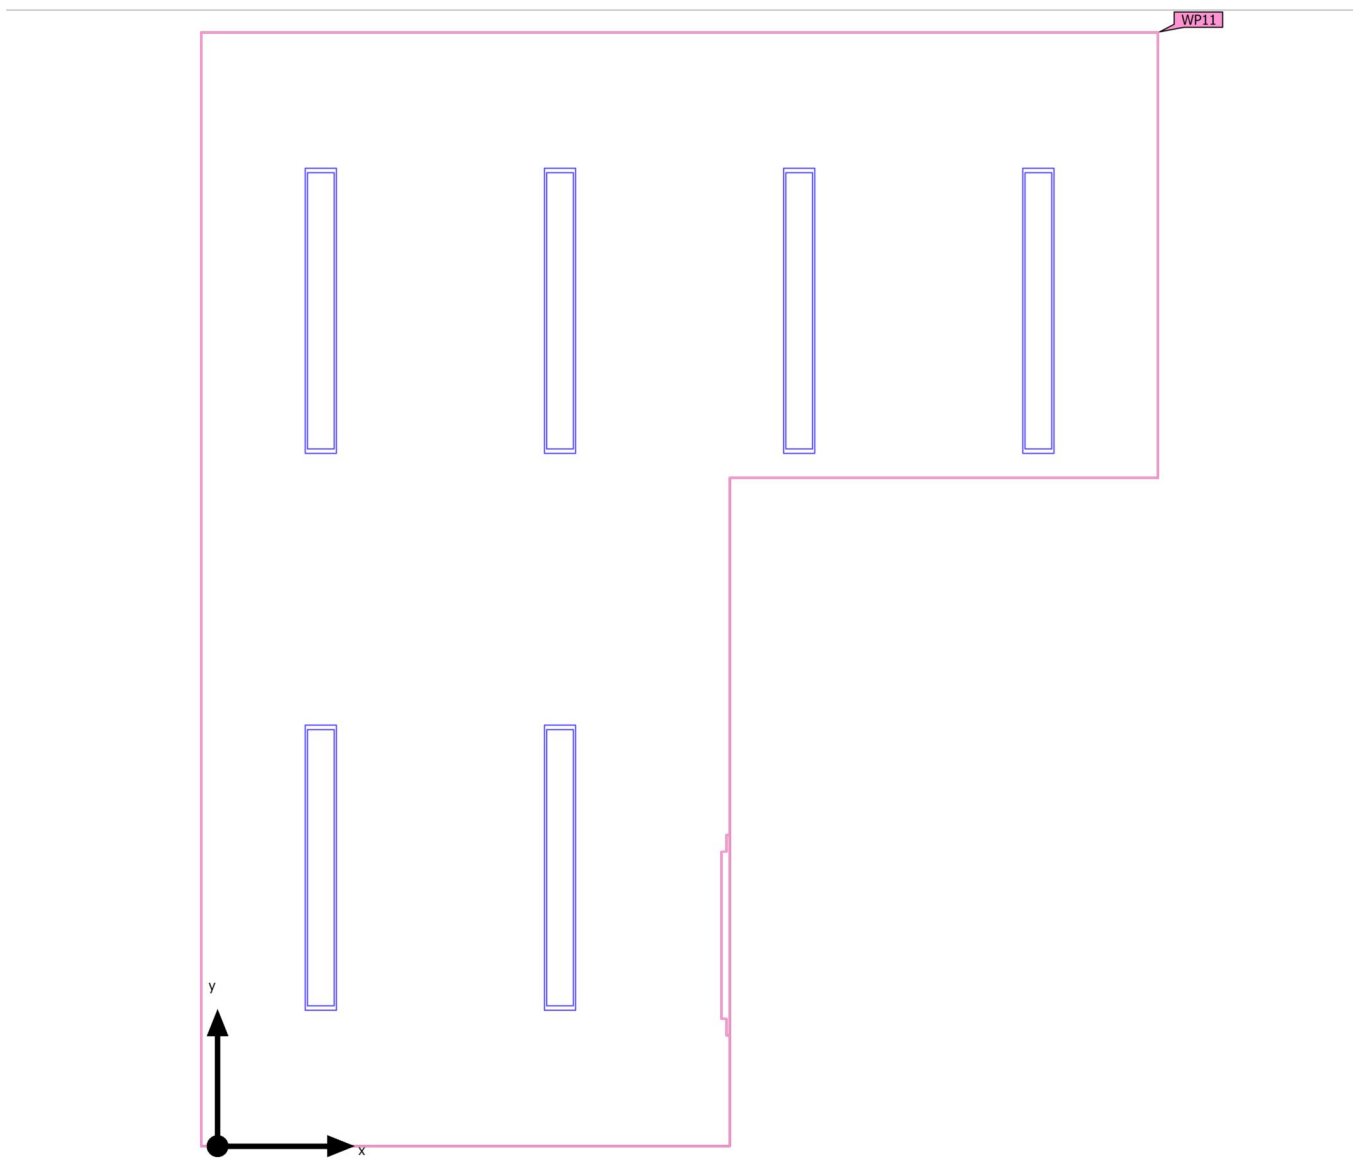

Building A · FIRST FLOOR · 207 OFFICE (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (207 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	516 lx (≥ 500 lx) ✓	317 lx	666 lx	0.61 (≥ 0.60) ✓	0.48	WP11

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 207 OFFICE (Light scene 1)

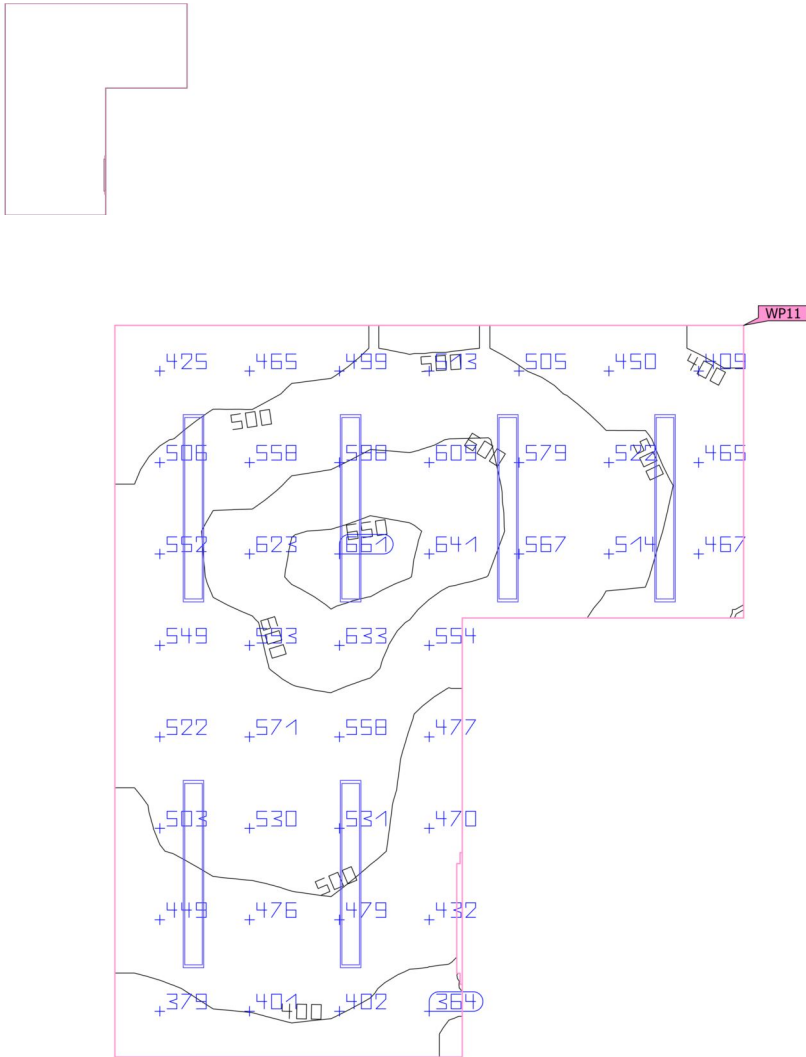
Working plane (207 OFFICE)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (207 OFFICE)	516 lx	317 lx	666 lx	0.61	0.48	WP11
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✓			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 208 MEETING (Light scene 1)

Summary

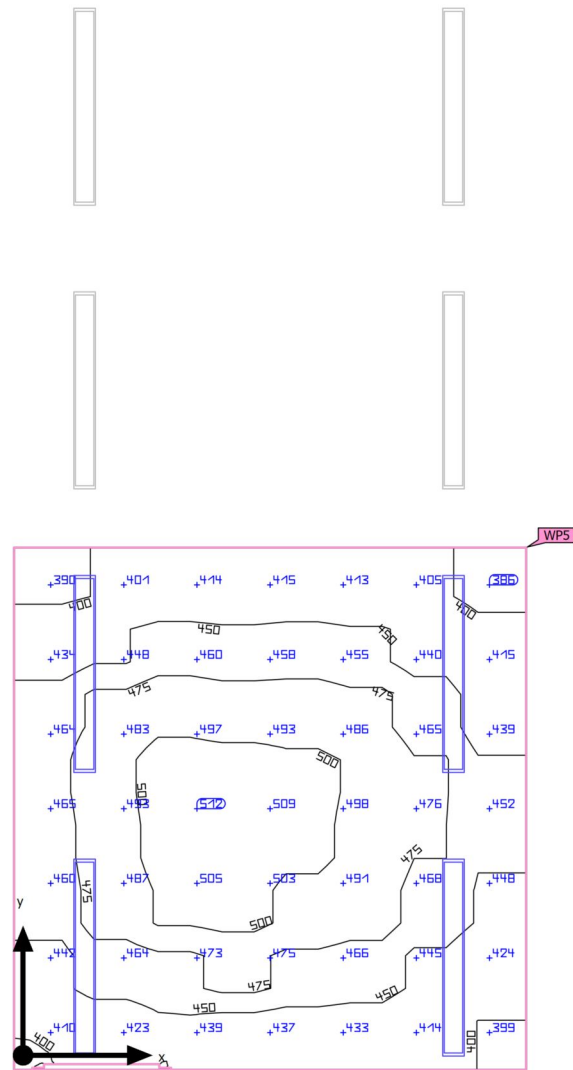

Ground area	11.30 m²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 208 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	458 lx	$\geq 500 \text{ lx}$	✗	WP5
	$U_o (g_1)$	0.82	≥ 0.60	✓	WP5
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	752 kWh/a	max. 400 kWh/a	✗	
Space	Lighting power density	26.91 W/m ²	–		
		5.87 W/m ² /100 lx	–		

(1) Based on a rectangular space of 3.328 m x 3.395 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 208 MEETING

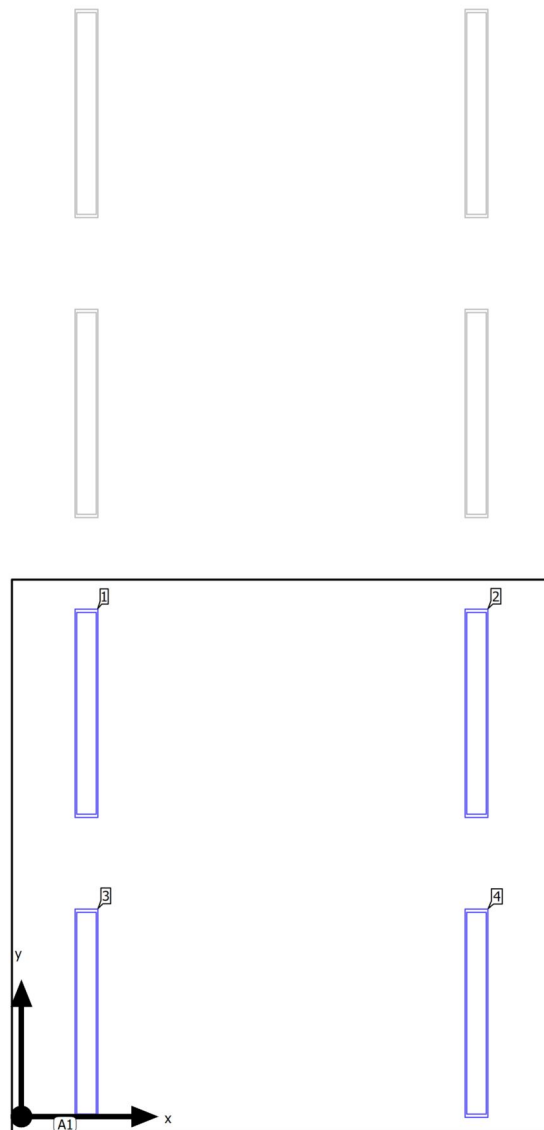Luminaire layout plan

Building A · FIRST FLOOR · 208 MEETING

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

8 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.400 m / 0.635 m / 3.300 m	0.400 m	2.478 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.397 m	2.797 m	2.478 m	3.300 m	2
Y-direction	4 pcs., Centre - centre, 1.843 m	0.400 m	0.635 m	3.300 m	3
		2.797 m	0.635 m	3.300 m	4
Arrangement	A1				

Building A · FIRST FLOOR · 208 MEETING

Luminaire list Φ_{total}

18652 lm

 P_{total}

304.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 208 MEETING (Light scene 1)

Calculation objects

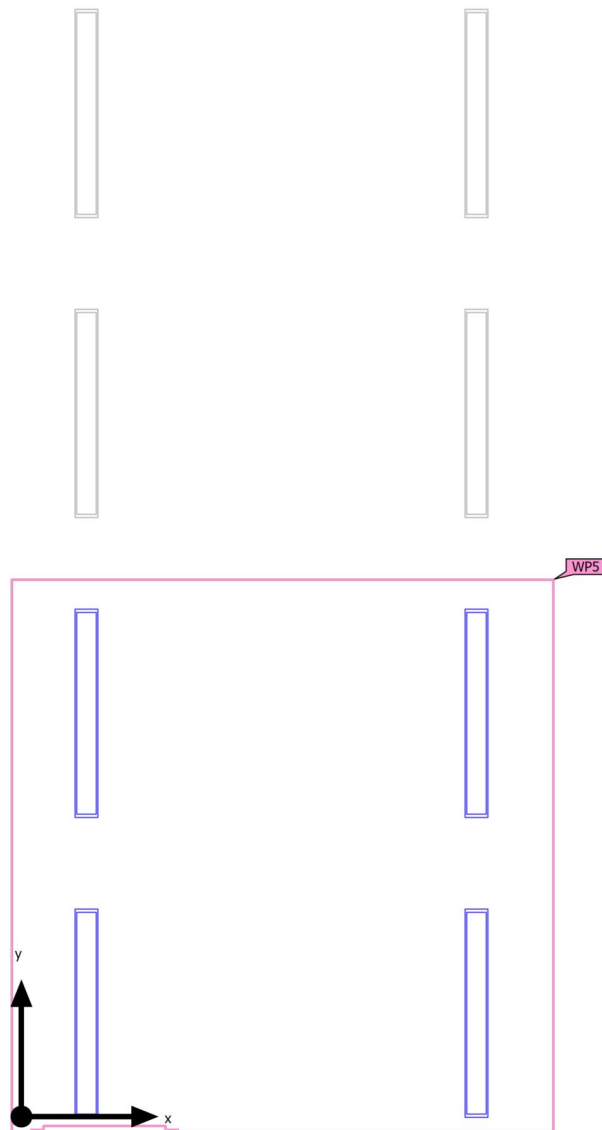

Building A · FIRST FLOOR · 208 MEETING (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (208 MEETING)	458 lx	374 lx	514 lx	0.82	0.73	WP5
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 208 MEETING (Light scene 1)

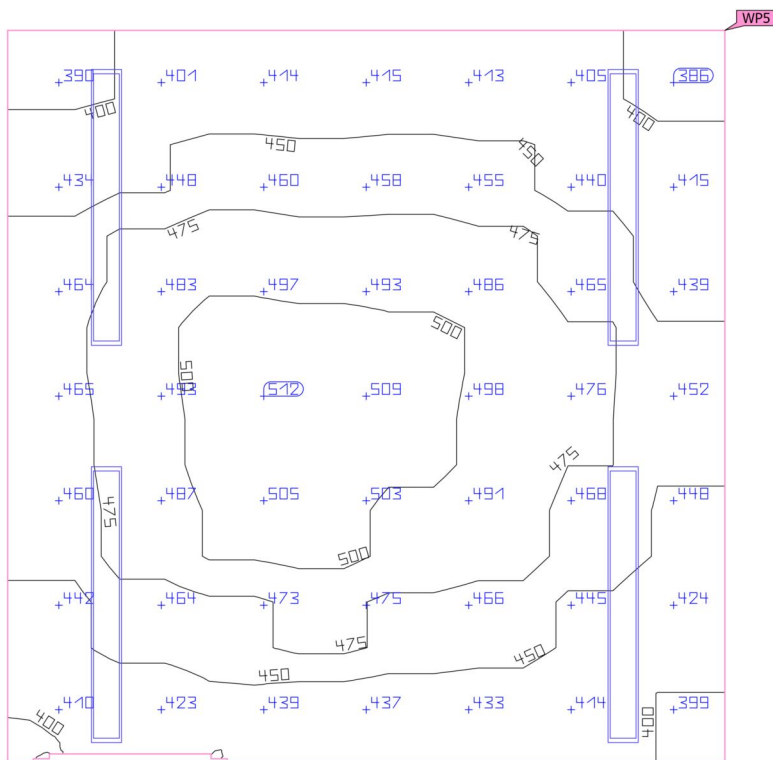
Working plane (208 MEETING)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (208 MEETING)	458 lx	374 lx	514 lx	0.82	0.73	WP5
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 209 MEETING (Light scene 1)

Summary

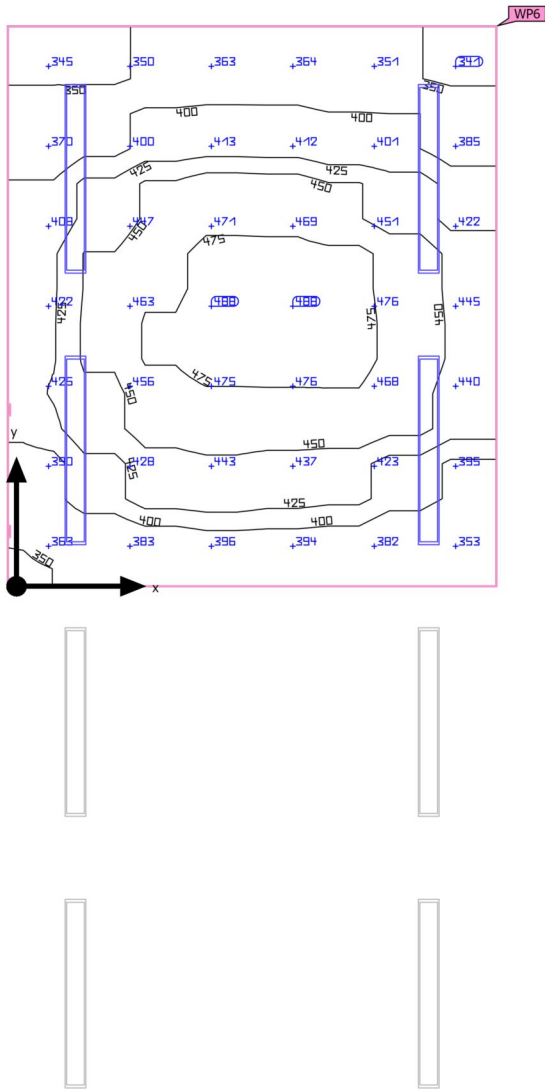

Ground area	12.60 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 209 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	422 lx	$\geq 500 \text{ lx}$	✗	WP6
	$U_o (g_1)$	0.81	≥ 0.60	✓	WP6
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[474 - 752] kWh/a	max. 450 kWh/a	✗	
Space	Lighting power density	24.13 W/m ²	–		
		5.72 W/m ² /100 lx	–		

(1) Based on a rectangular space of 3.800 m x 3.316 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 209 MEETING

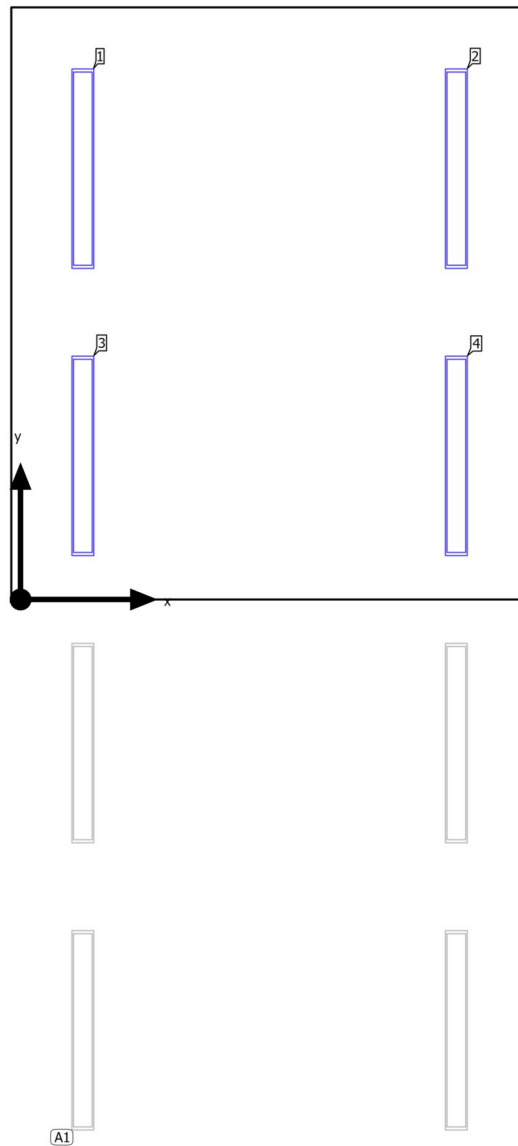Luminaire layout plan

Building A · FIRST FLOOR · 209 MEETING

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

8 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.400 m / 0.922 m / 3.300 m	0.400 m	2.765 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.397 m	2.797 m	2.765 m	3.300 m	2
Y-direction	4 pcs., Centre - centre, 1.843 m	0.400 m	0.922 m	3.300 m	3
		2.797 m	0.922 m	3.300 m	4
Arrangement	A1				

Building A · FIRST FLOOR · 209 MEETING


Luminaire list

Φ_{total} 18652 lm	P_{total} 304.0 W	Luminous efficacy 61.4 lm/W
-----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 209 MEETING (Light scene 1)

Calculation objects

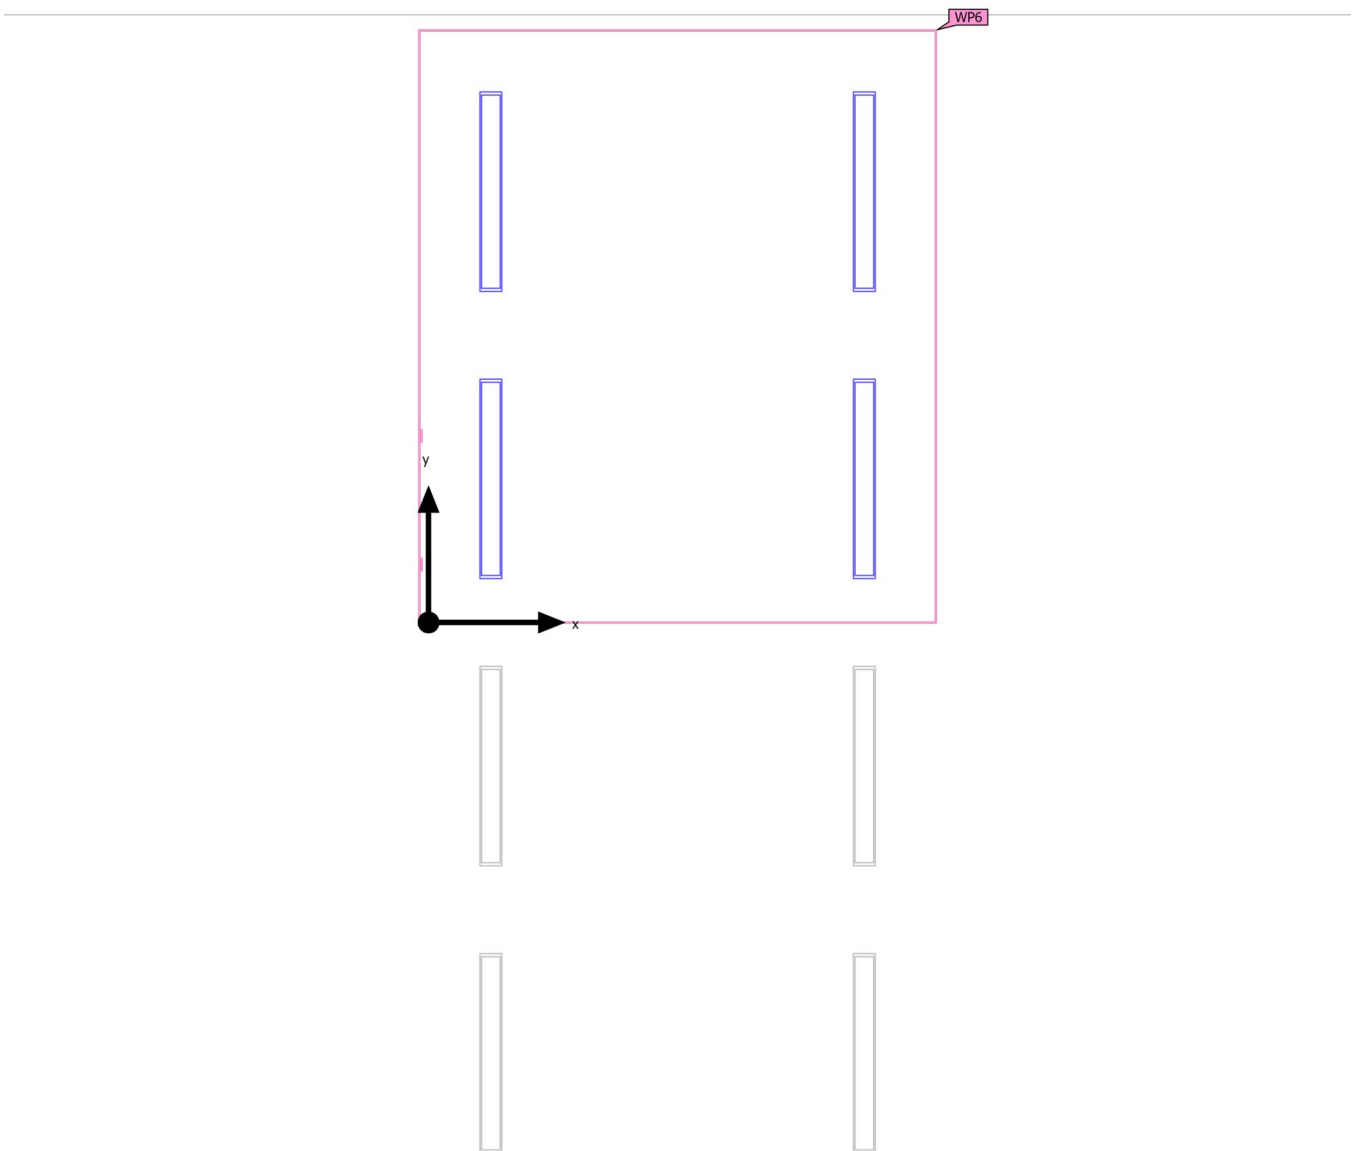

Building A · FIRST FLOOR · 209 MEETING (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (209 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	422 lx (≥ 500 lx) ✗	340 lx	489 lx	0.81 (≥ 0.60) ✓	0.70	WP6

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 209 MEETING (Light scene 1)

Working plane (209 MEETING)

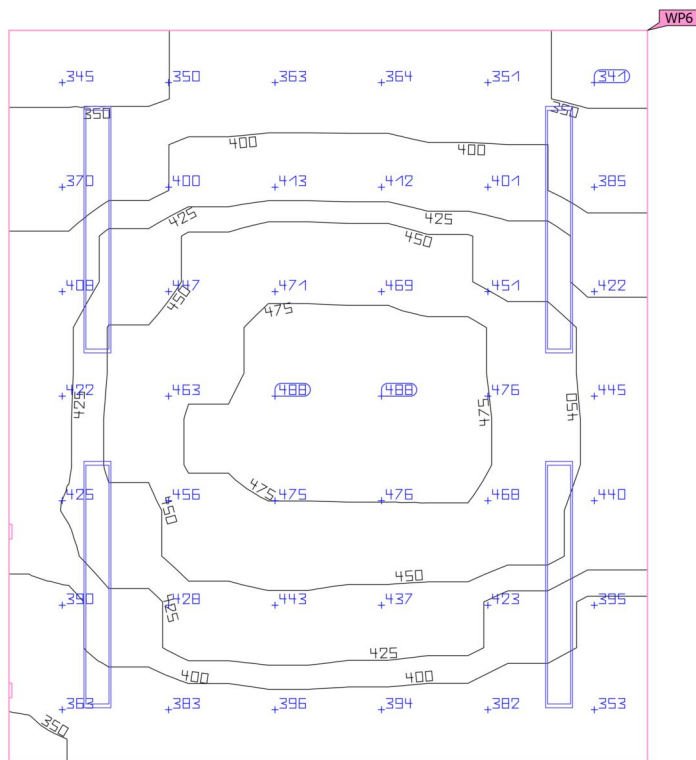


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (209 MEETING)	422 lx	340 lx	489 lx	0.81	0.70	WP6
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 210 CAD (Light scene 1)

Summary

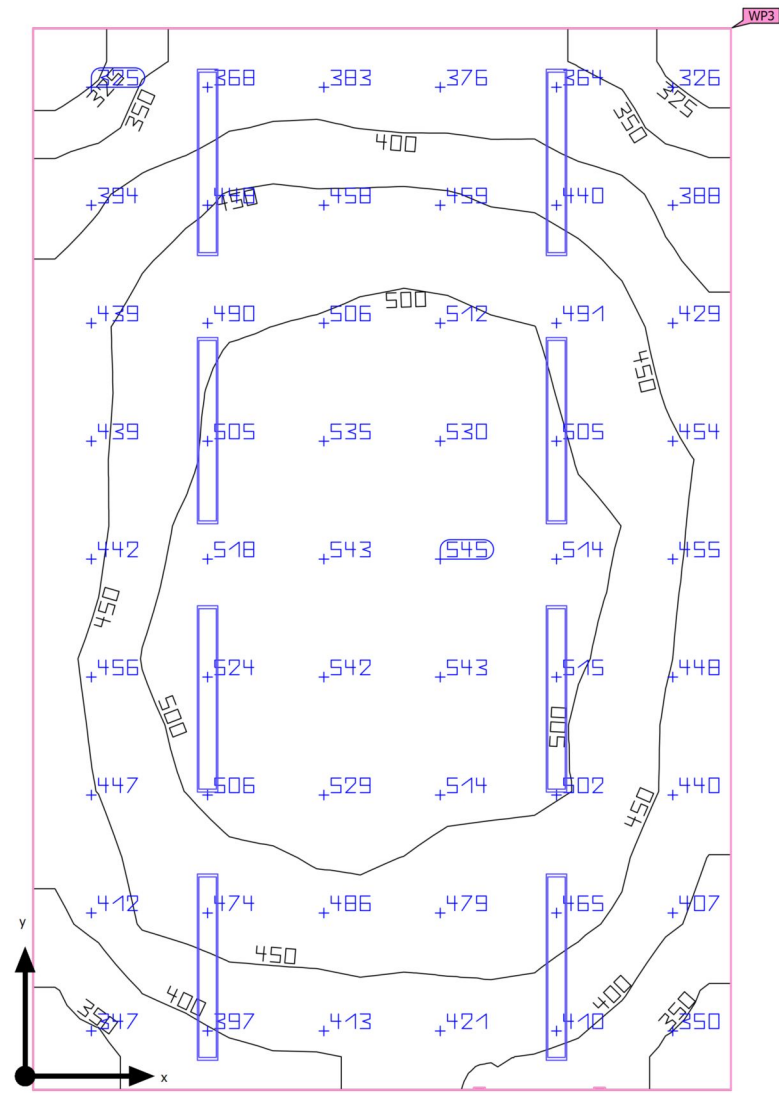

Ground area	34.98 m ²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 210 CAD (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	455 lx	≥ 500 lx	✗	WP3
	$U_o (g_1)$	0.68	≥ 0.60	✓	WP3
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	25	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[948 - 1505] kWh/a	max. 1250 kWh/a	✗	
Space	Lighting power density	17.38 W/m ²	–		
		3.82 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.795 m x 7.295 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
8	Philips		2x36W	25	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 210 CAD

Luminaire layout plan

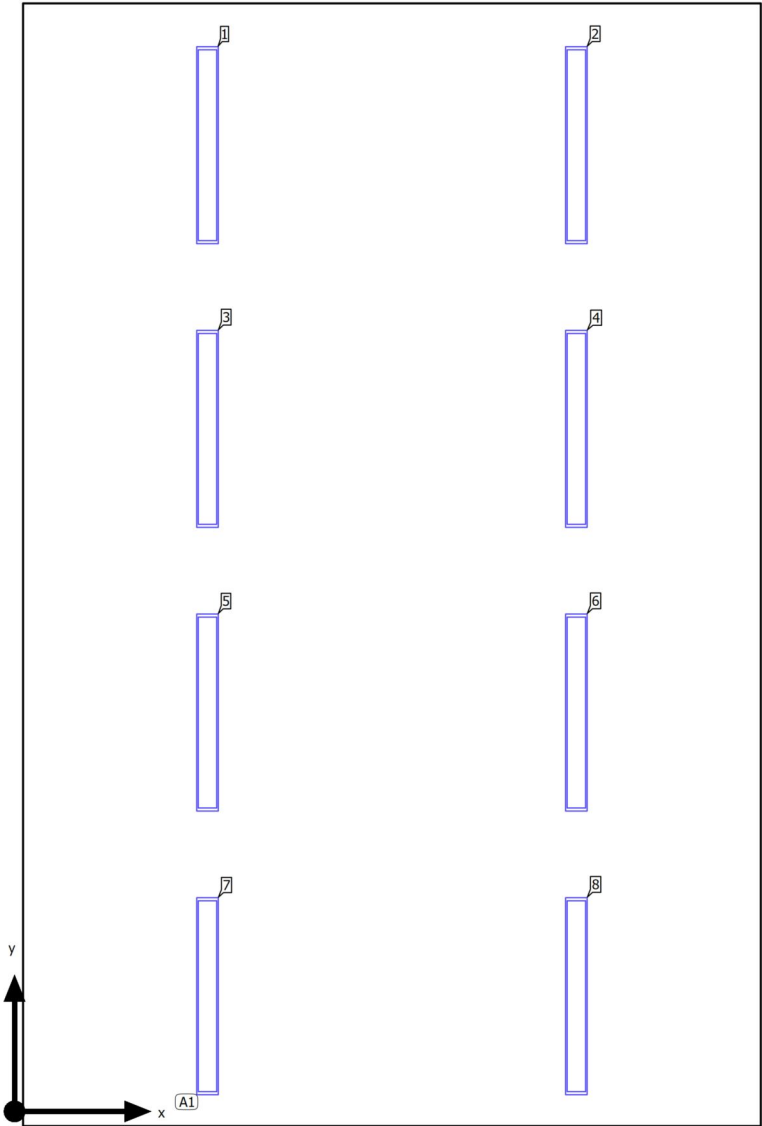

Building A · FIRST FLOOR · 210 CAD

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

8 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	3.651 m / 6.278 m / 3.300 m	1.254 m	6.278 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.397 m	3.651 m	6.278 m	3.300 m	2
Y-direction	4 pcs., Centre - centre, 1.843 m	1.254 m	4.435 m	3.300 m	3
		3.651 m	4.435 m	3.300 m	4
Arrangement	A1	1.254 m	2.592 m	3.300 m	5
		3.651 m	2.592 m	3.300 m	6
		1.254 m	0.749 m	3.300 m	7
		3.651 m	0.749 m	3.300 m	8

Building A · FIRST FLOOR · 210 CAD

Luminaire list Φ_{total}

37304 lm

 P_{total}

608.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
8	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 210 CAD (Light scene 1)

Calculation objects

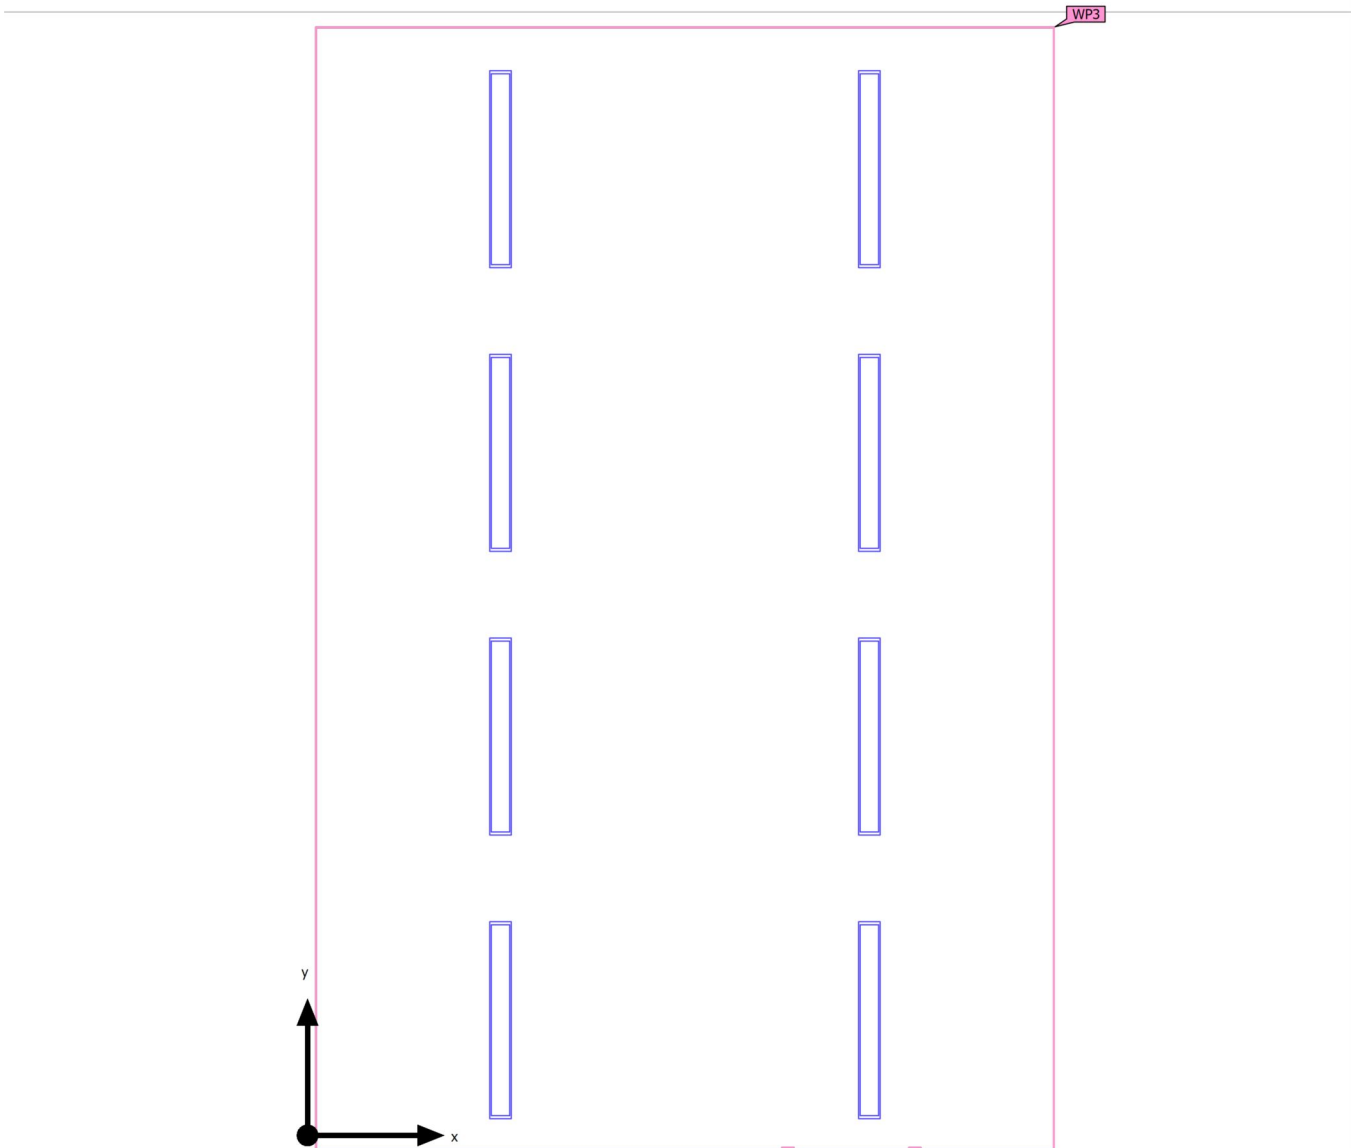

Building A · FIRST FLOOR · 210 CAD (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (210 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	455 lx (≥ 500 lx) ✗	309 lx	549 lx	0.68 (≥ 0.60) ✓	0.56	WP3

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 210 CAD (Light scene 1)

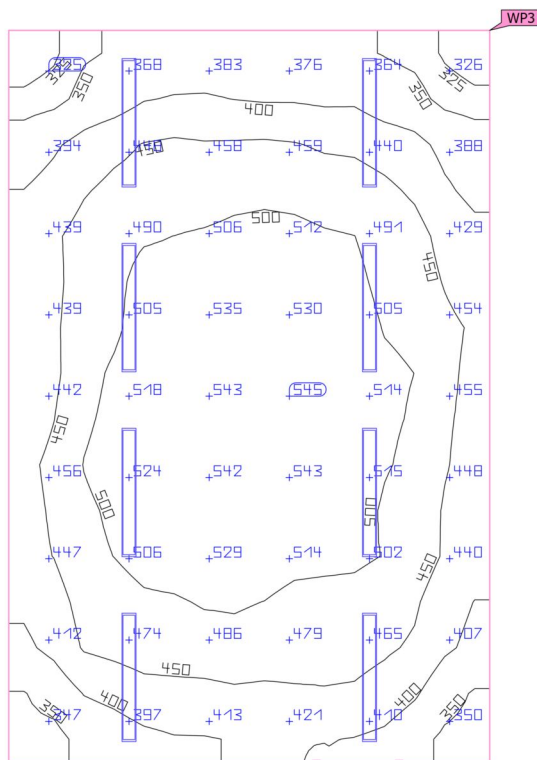
Working plane (210 CAD)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (210 CAD)	455 lx	309 lx	549 lx	0.68	0.56	WP3
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 211 CORRIDOR (Light scene 1)

Summary

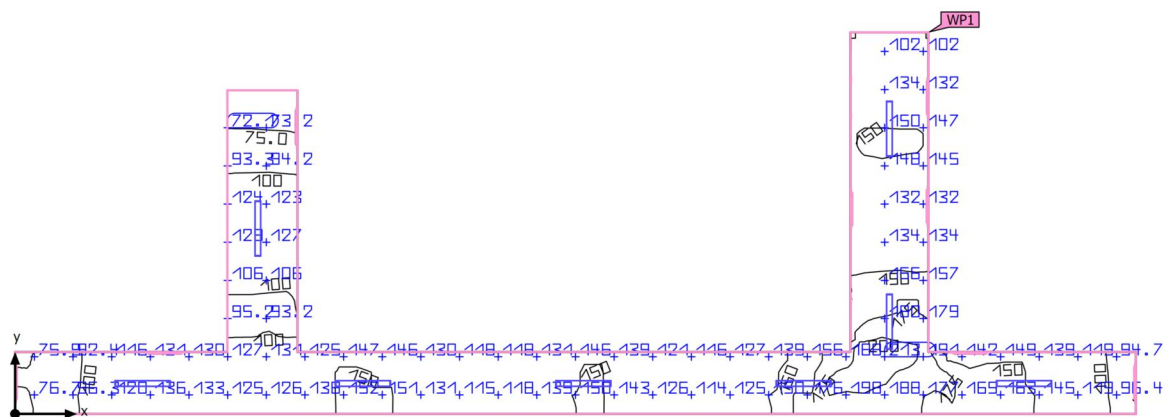

Ground area	59.96 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 211 CORRIDOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	133 lx	$\geq 500 \text{ lx}$	✗	WP1
	$U_o (g_1)$	0.40	≥ 0.60	✗	WP1
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	29	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[1157 - 1505] kWh/a	max. 2100 kWh/a	✓	
Space	Lighting power density	10.14 W/m ²	–		
		7.61 W/m ² /100 lx	–		

(1) Based on a rectangular space of 25.850 m x 8.803 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
8	Philips		2x36W	29	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 211 CORRIDOR

Luminaire layout plan

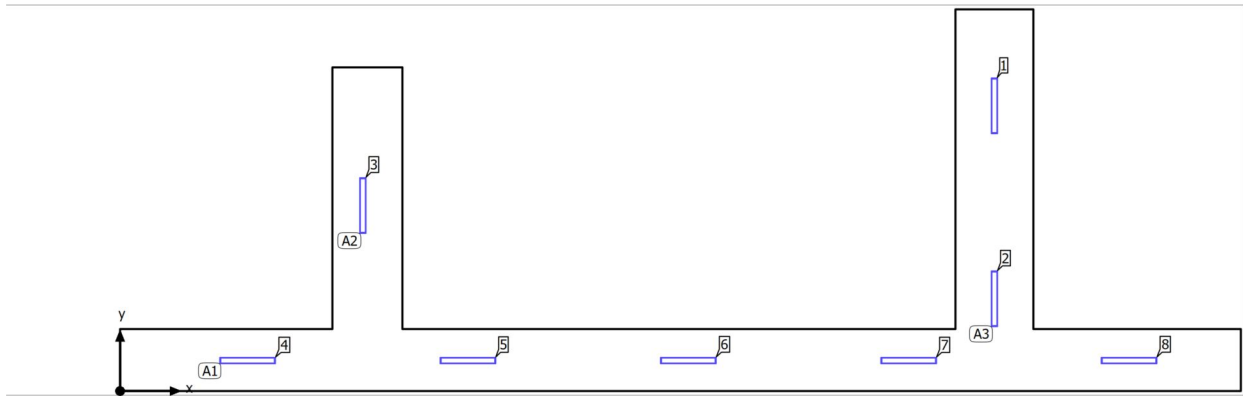

Building A · FIRST FLOOR · 211 CORRIDOR

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

5 x Philips 2x36W

Type	Line arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	2.941 m / 0.703 m / 3.300 m	2.941 m	0.703 m	3.300 m	4
X-direction	5 pcs., Centre - centre, 5.083 m	8.024 m	0.703 m	3.300 m	5
Arrangement	A1	13.106 m	0.703 m	3.300 m	6
		18.189 m	0.703 m	3.300 m	7
		23.271 m	0.703 m	3.300 m	8

1 x Philips 2x36W

Type	Line arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	5.600 m / 4.278 m / 3.300 m	5.600 m	4.278 m	3.300 m	3
X-direction	1 pcs., Centre - centre, 5.850 m				
Arrangement	A2				

Building A · FIRST FLOOR · 211 CORRIDOR

Luminaire layout plan

2 x Philips 2x36W

Type	Line arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	20.166 m / 6.578 m / 3.300 m	20.166 m	6.578 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 4.450 m	20.166 m	2.128 m	3.300 m	2
Arrangement	A3				

Building A · FIRST FLOOR · 211 CORRIDOR

Luminaire list Φ_{total}

37304 lm

 P_{total}

608.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
8	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 211 CORRIDOR (Light scene 1)

Calculation objects

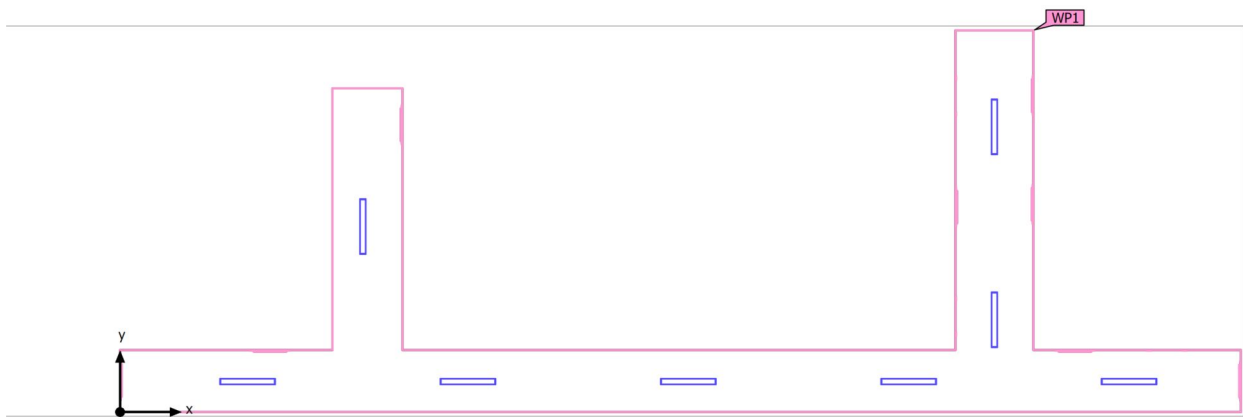

Building A · FIRST FLOOR · 211 CORRIDOR (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (211 CORRIDOR)	133 lx	53.7 lx	220 lx	0.40	0.24	WP1
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 211 CORRIDOR (Light scene 1)

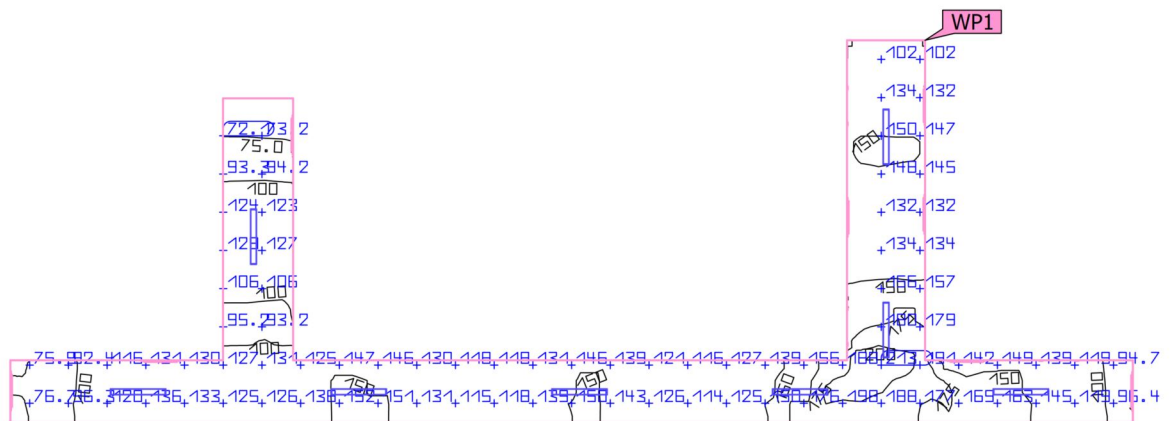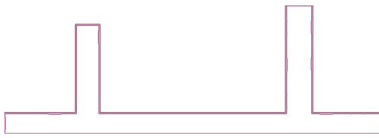
Working plane (211 CORRIDOR)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (211 CORRIDOR)	133 lx	53.7 lx	220 lx	0.40	0.24	WP1
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 212 COMMON (Light scene 1)

Summary

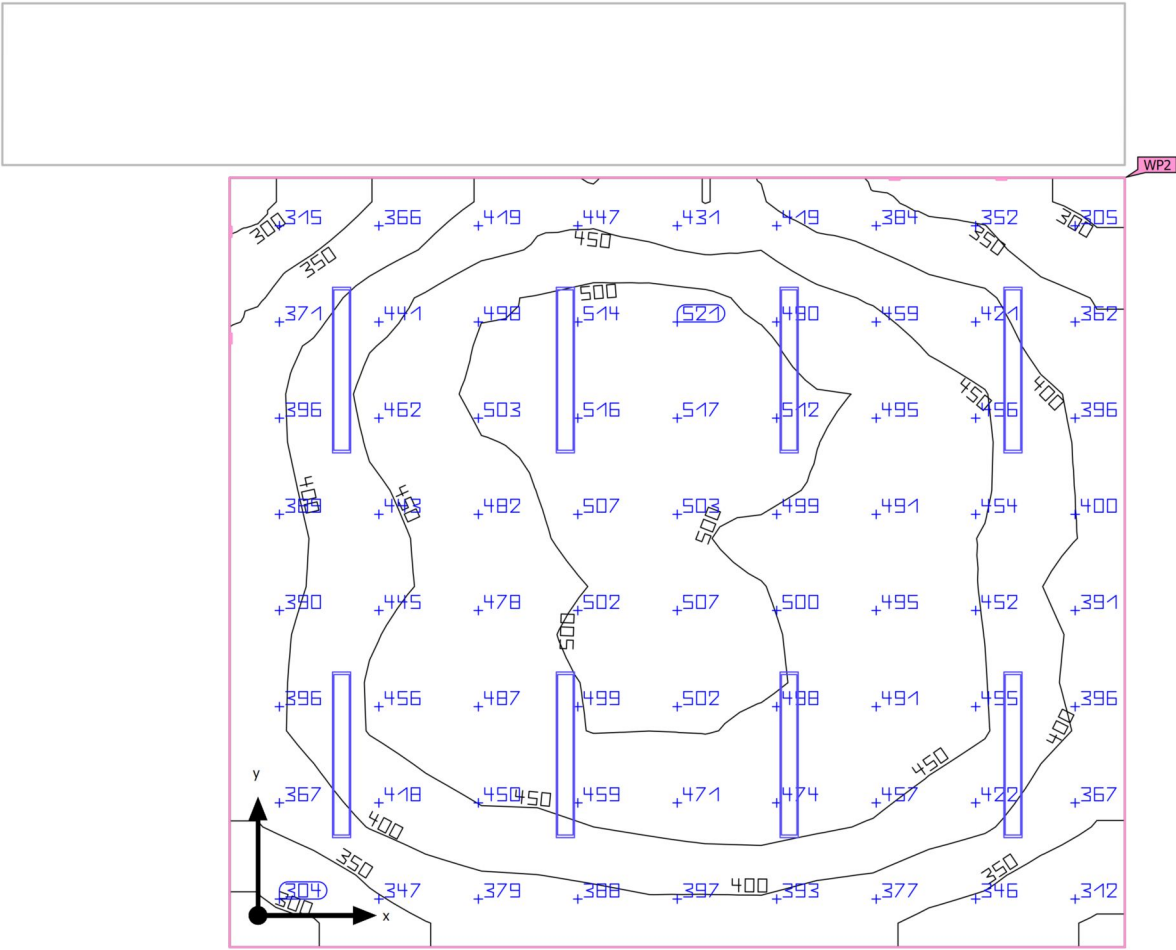

Ground area	41.15 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 212 COMMON (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	435 lx	$\geq 500 \text{ lx}$	✗	WP2
	$U_o (g_1)$	0.67	≥ 0.60	✓	WP2
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	24	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	1505 kWh/a	max. 1450 kWh/a	✗	
Space	Lighting power density	14.78 W/m ²	–		
		3.40 W/m ² /100 lx	–		

(1) Based on a rectangular space of 6.919 m x 5.947 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
8	Philips		2x36W	24	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 212 COMMON

Luminaire layout plan

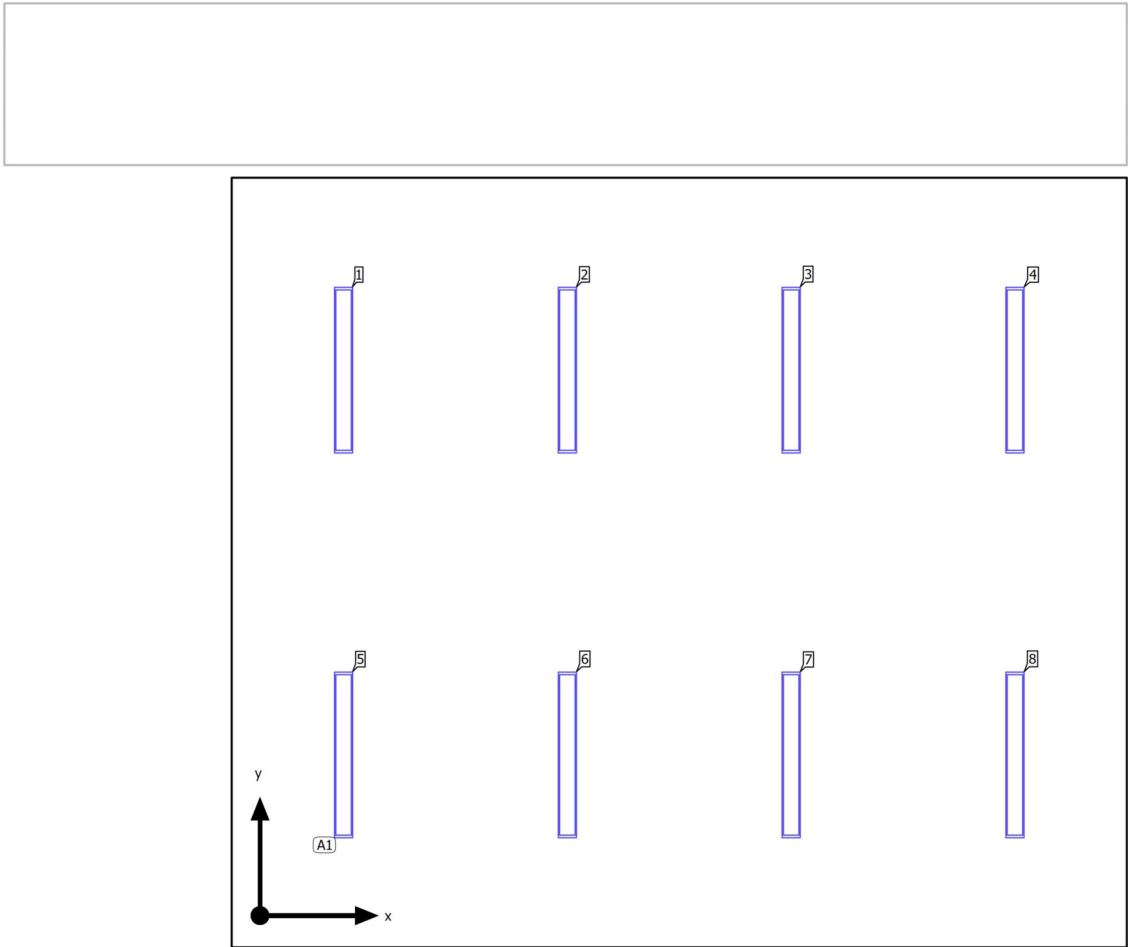

Building A · FIRST FLOOR · 212 COMMON

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

8 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.646 m / 1.242 m / 3.300 m	0.646 m	4.215 m	3.300 m	1
X-direction	4 pcs., Centre - centre, 1.730 m	2.376 m	4.215 m	3.300 m	2
		4.105 m	4.215 m	3.300 m	3
Y-direction	2 pcs., Centre - centre, 2.974 m	5.835 m	4.215 m	3.300 m	4
Arrangement	A1	0.646 m	1.242 m	3.300 m	5
		2.376 m	1.242 m	3.300 m	6
		4.105 m	1.242 m	3.300 m	7
		5.835 m	1.242 m	3.300 m	8

Building A · FIRST FLOOR · 212 COMMON

Luminaire list Φ_{total}

37304 lm

 P_{total}

608.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
8	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 212 COMMON (Light scene 1)

Calculation objects

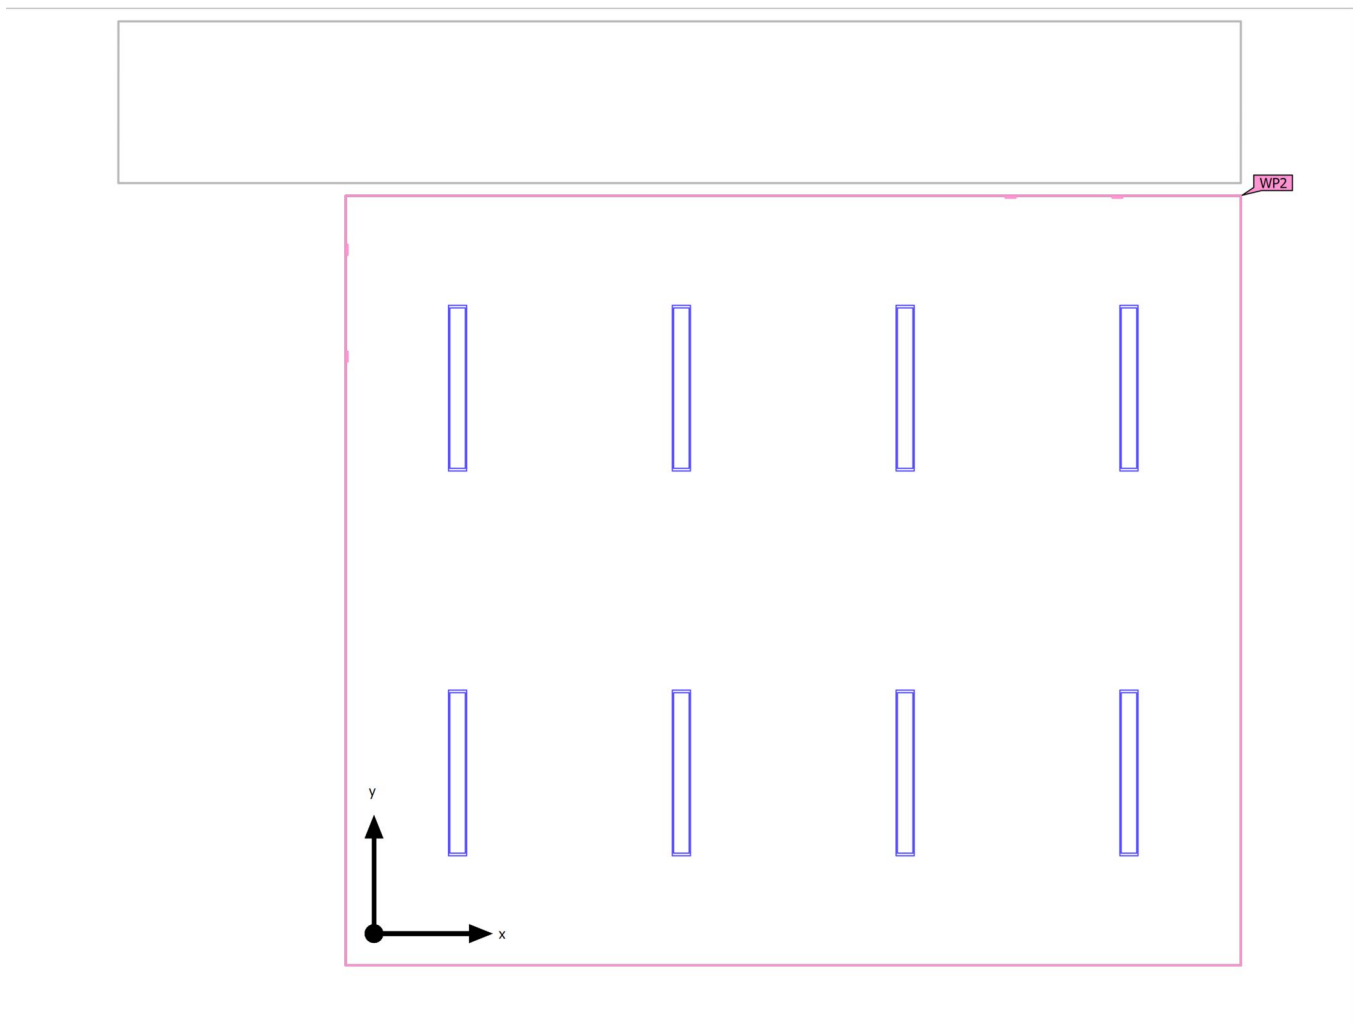

Building A · FIRST FLOOR · 212 COMMON (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (212 COMMON) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	435 lx (≥ 500 lx) ✗	290 lx	528 lx	0.67 (≥ 0.60) ✓	0.55	WP2

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 212 COMMON (Light scene 1)

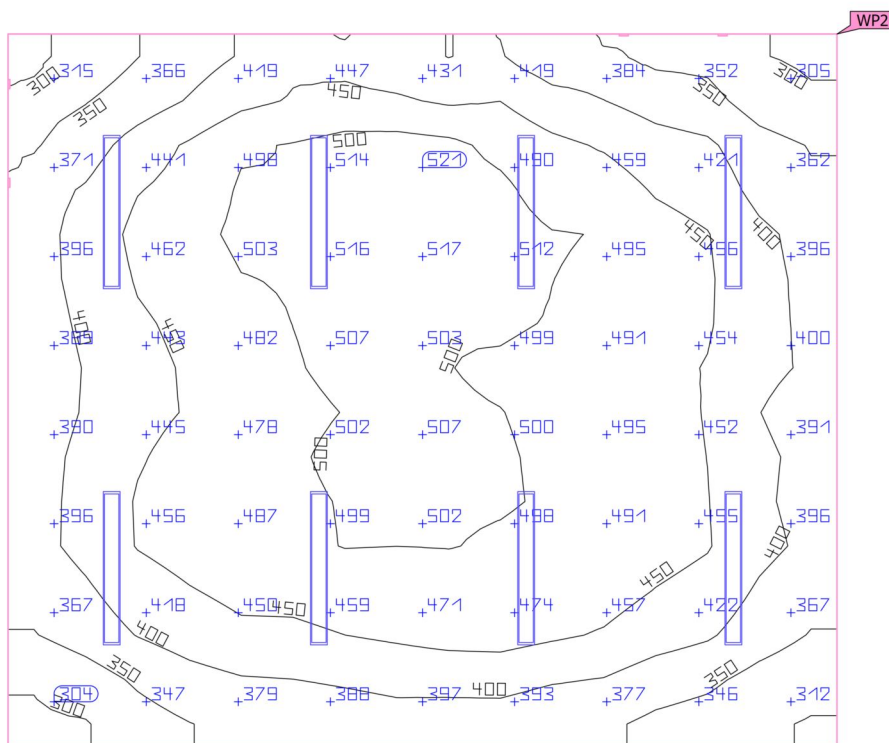
Working plane (212 COMMON)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (212 COMMON)	435 lx	290 lx	528 lx	0.67	0.55	WP2
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 213 BALCONY (Light scene 1)

Summary

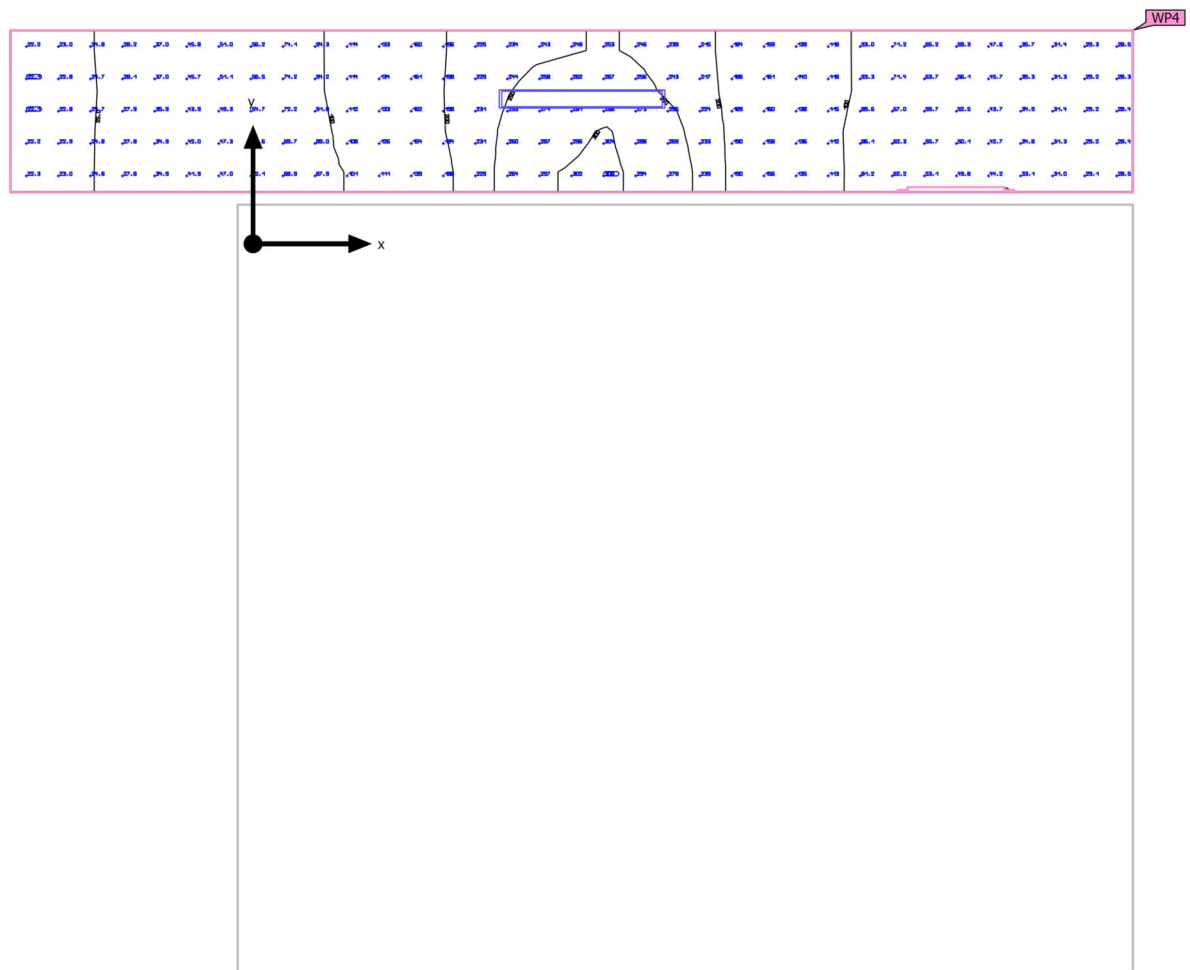

Ground area	10.84 m ²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 213 BALCONY (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	118 lx	$\geq 500 \text{ lx}$	✗	WP4
	$U_o (g_1)$	0.19	≥ 0.60	✗	WP4
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	25	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 400 kWh/a	✓	
Space	Lighting power density	7.01 W/m ²	–		
		5.92 W/m ² /100 lx	–		

(1) Based on a rectangular space of 8.676 m x 1.250 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	25	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 213 BALCONY

Luminaire layout plan

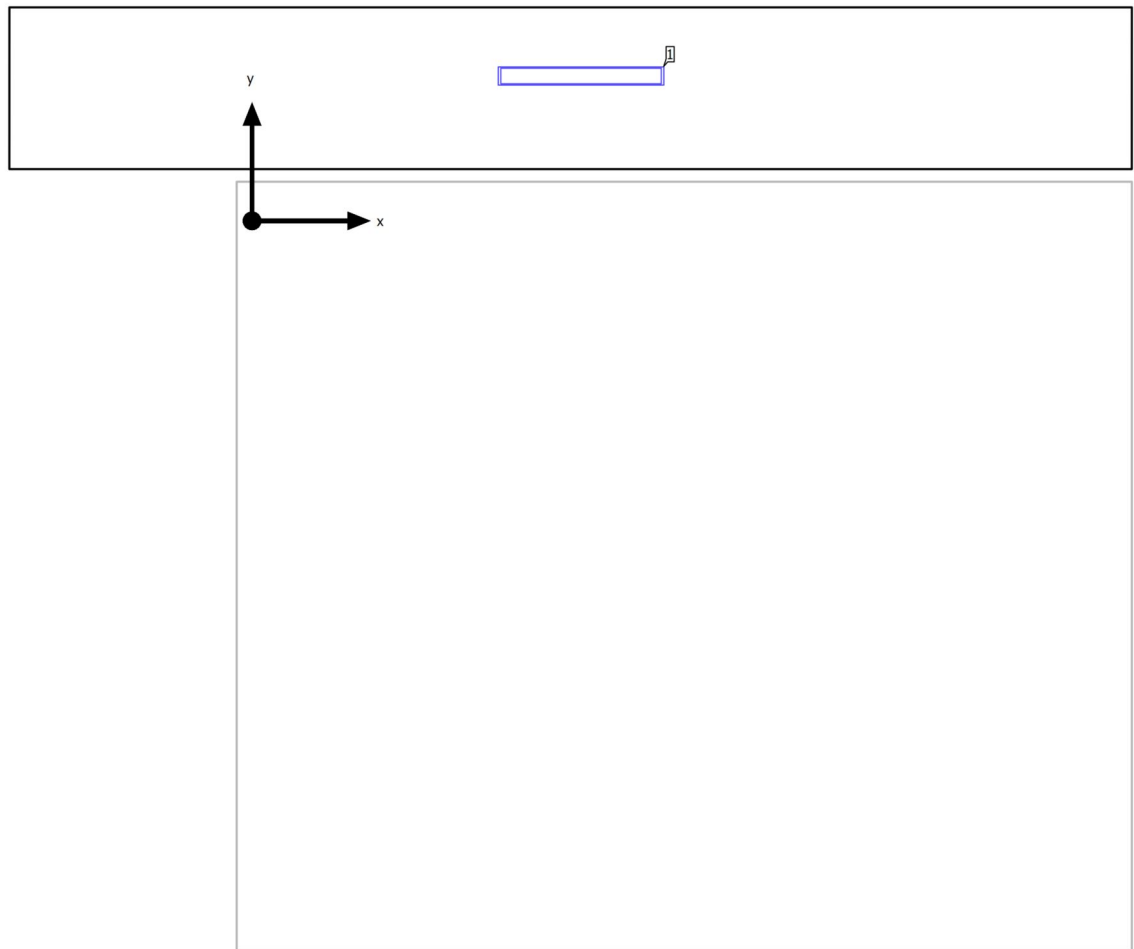

Building A · FIRST FLOOR · 213 BALCONY

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
2.543 m	1.120 m	3.300 m	1

Building A · FIRST FLOOR · 213 BALCONY


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 213 BALCONY (Light scene 1)

Calculation objects

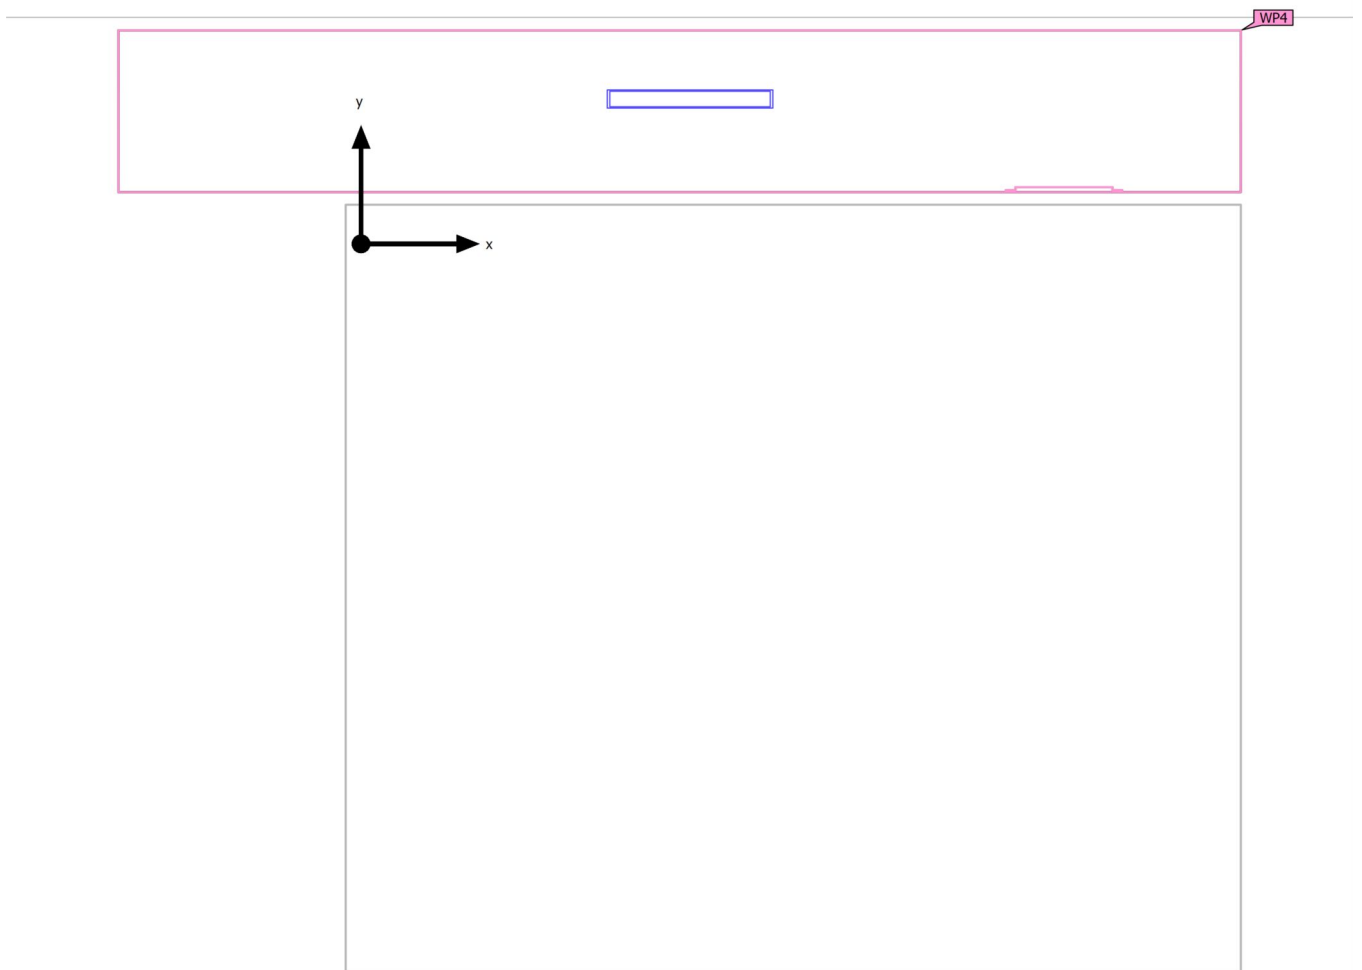

Building A · FIRST FLOOR · 213 BALCONY (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (213 BALCONY)	118 lx	22.1 lx	305 lx	0.19	0.072	WP4
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 213 BALCONY (Light scene 1)

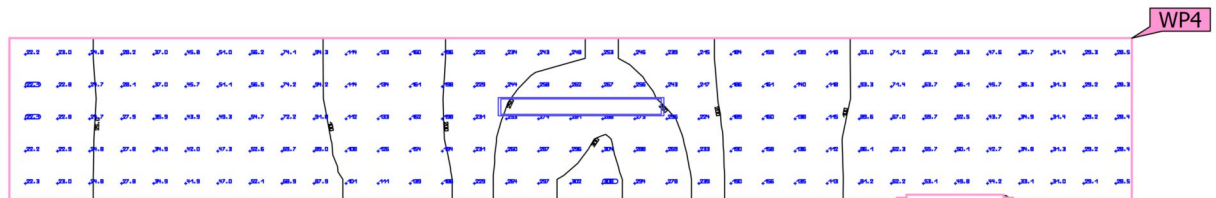
Working plane (213 BALCONY)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (213 BALCONY)	118 lx	22.1 lx	305 lx	0.19	0.072	WP4
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 214 OFFICE (Light scene 1)

Summary

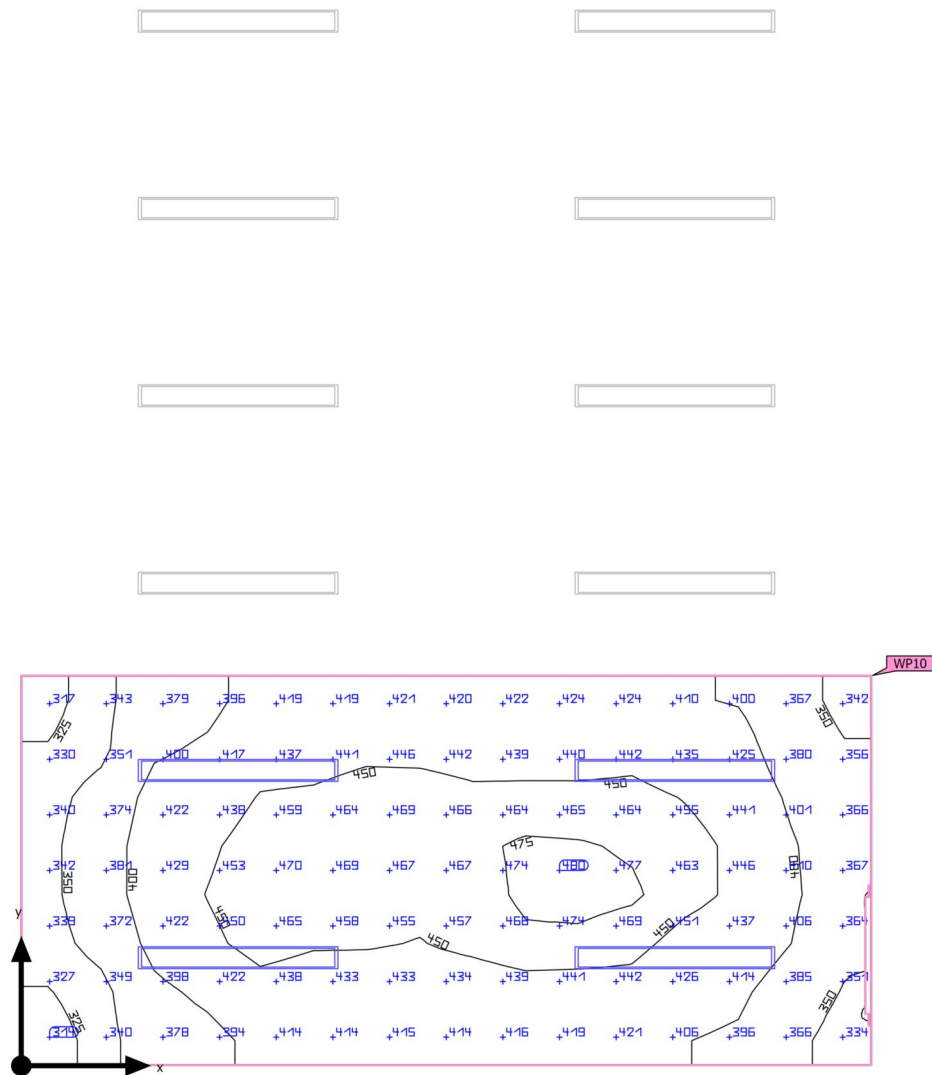

Ground area	13.60 m ²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 214 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	416 lx	$\geq 500 \text{ lx}$	✗	WP10
	$U_o (g_1)$	0.73	≥ 0.60	✓	WP10
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	752 kWh/a	max. 500 kWh/a	✗	
Space	Lighting power density	22.36 W/m ²	–		
		5.37 W/m ² /100 lx	–		

(1) Based on a rectangular space of 5.450 m x 2.495 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 214 OFFICE

Luminaire layout plan

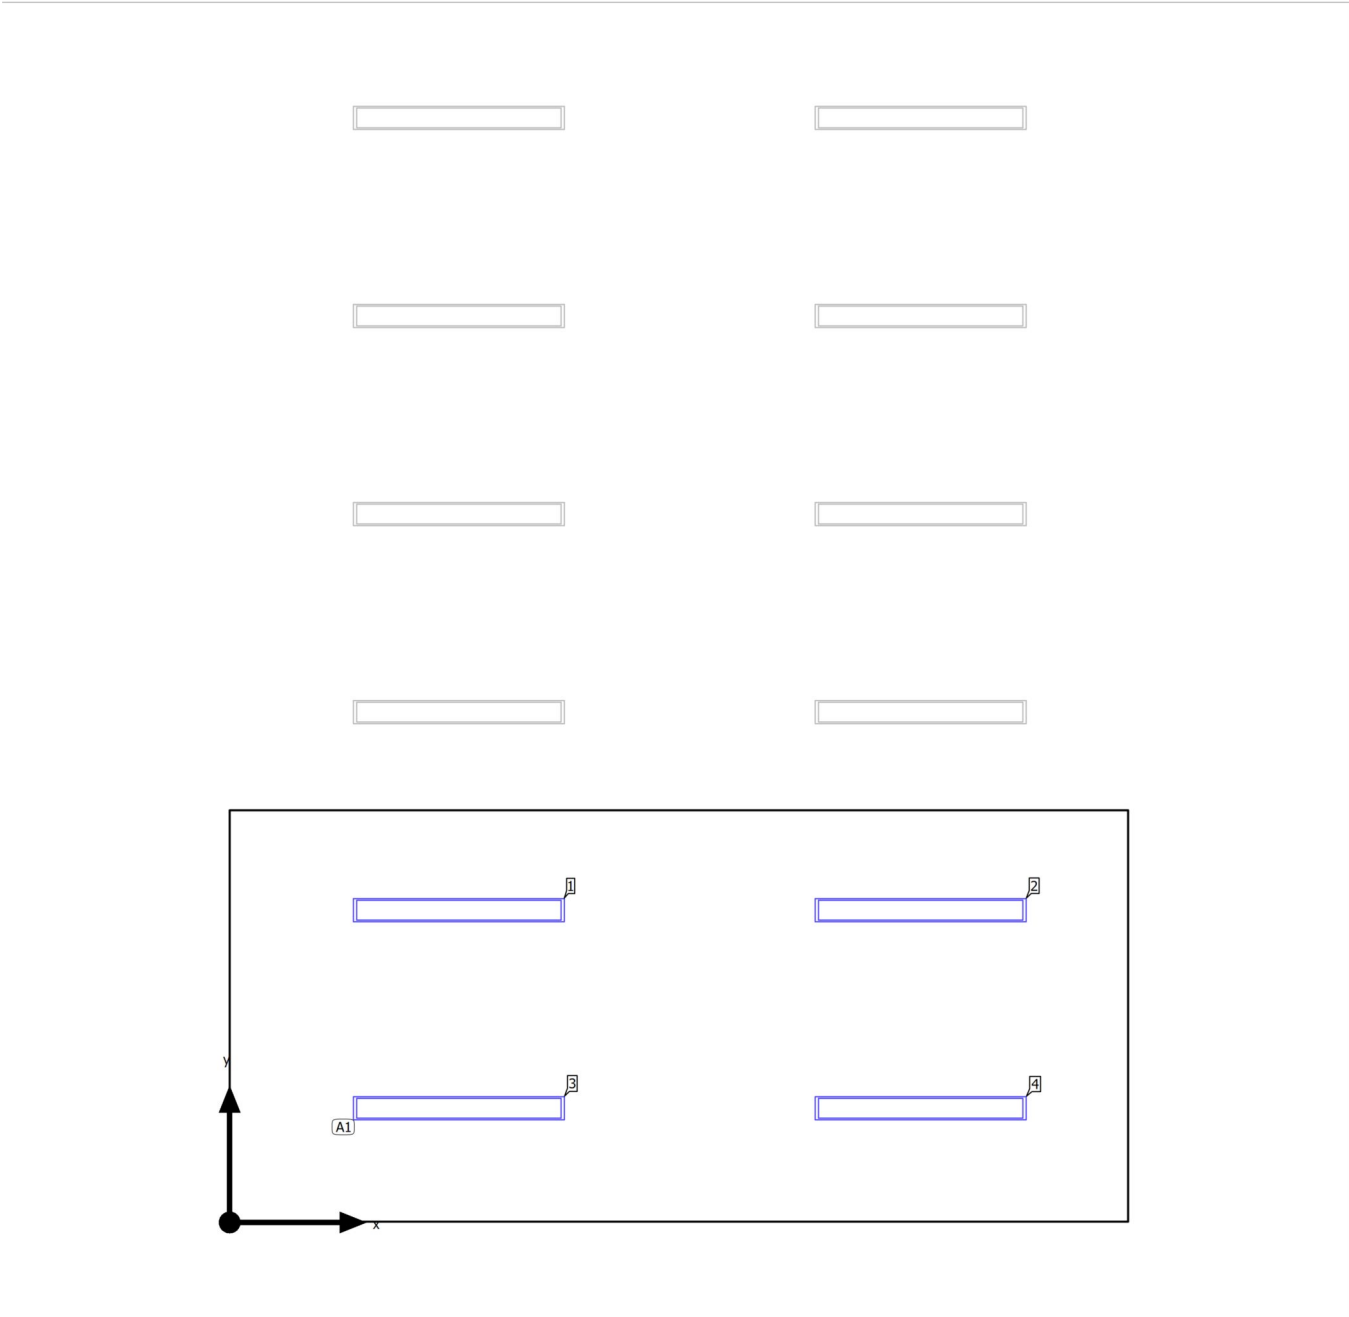

Building A · FIRST FLOOR · 214 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

12 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.390 m / 0.693 m / 3.300 m	1.390 m	1.894 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.801 m	4.192 m	1.894 m	3.300 m	2
Y-direction	6 pcs., Centre - centre, 1.201 m	1.390 m	0.693 m	3.300 m	3
		4.192 m	0.693 m	3.300 m	4
Arrangement	A1				

Building A · FIRST FLOOR · 214 OFFICE

Luminaire list Φ_{total}

18652 lm

 P_{total}

304.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 214 OFFICE (Light scene 1)

Calculation objects

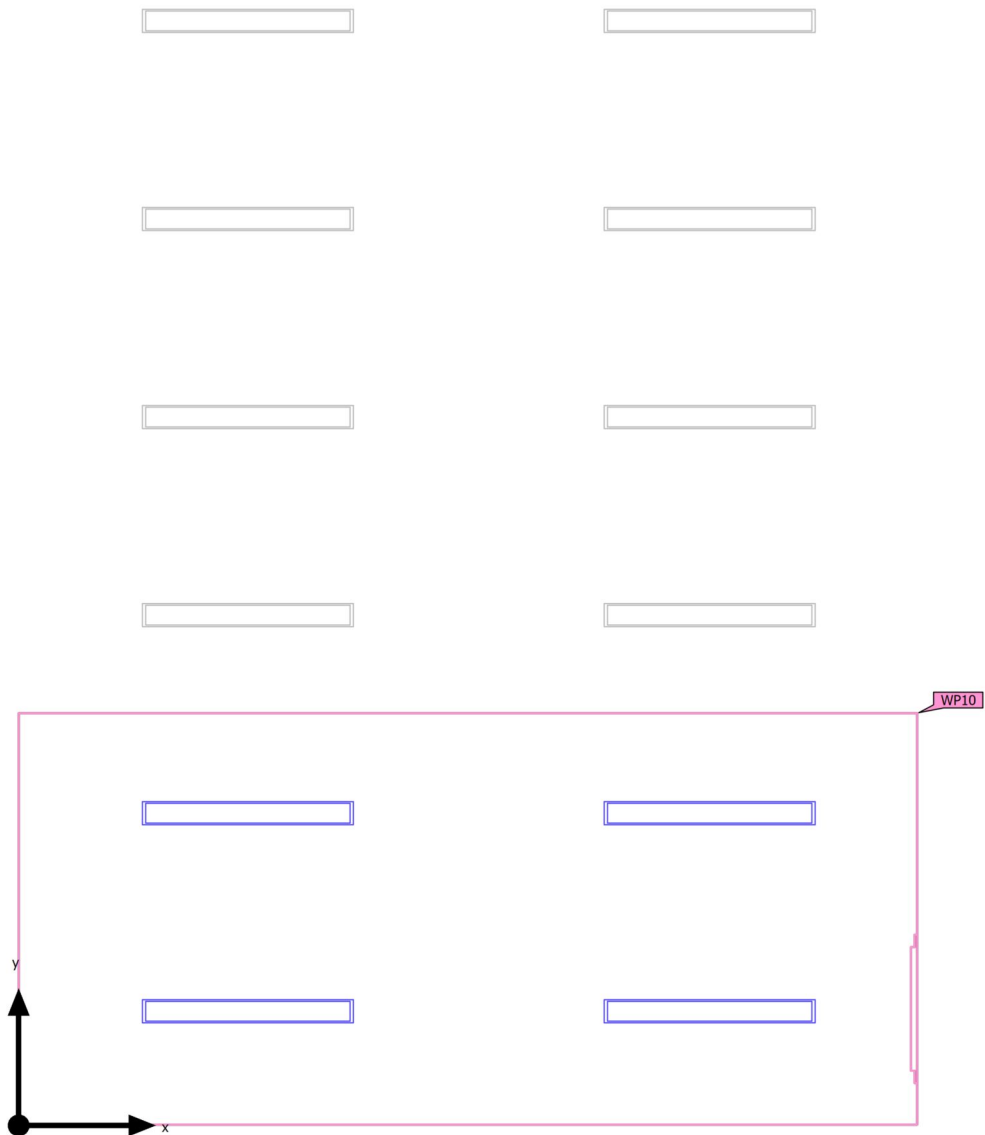

Building A · FIRST FLOOR · 214 OFFICE (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (214 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	416 lx (≥ 500 lx) ✗	302 lx	480 lx	0.73 (≥ 0.60) ✓	0.63	WP10

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 214 OFFICE (Light scene 1)

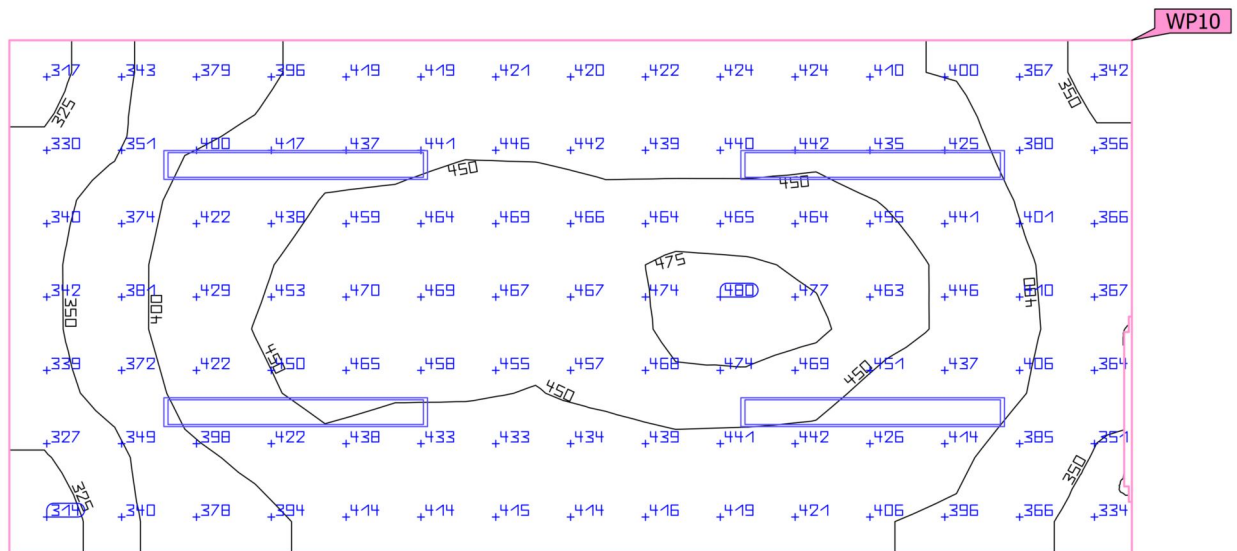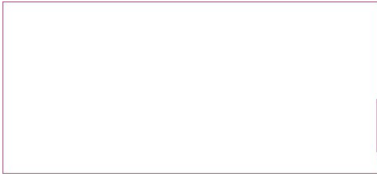
Working plane (214 OFFICE)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (214 OFFICE)	416 lx	302 lx	480 lx	0.73	0.63	WP10
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 215 MEETING (Light scene 1)

Summary

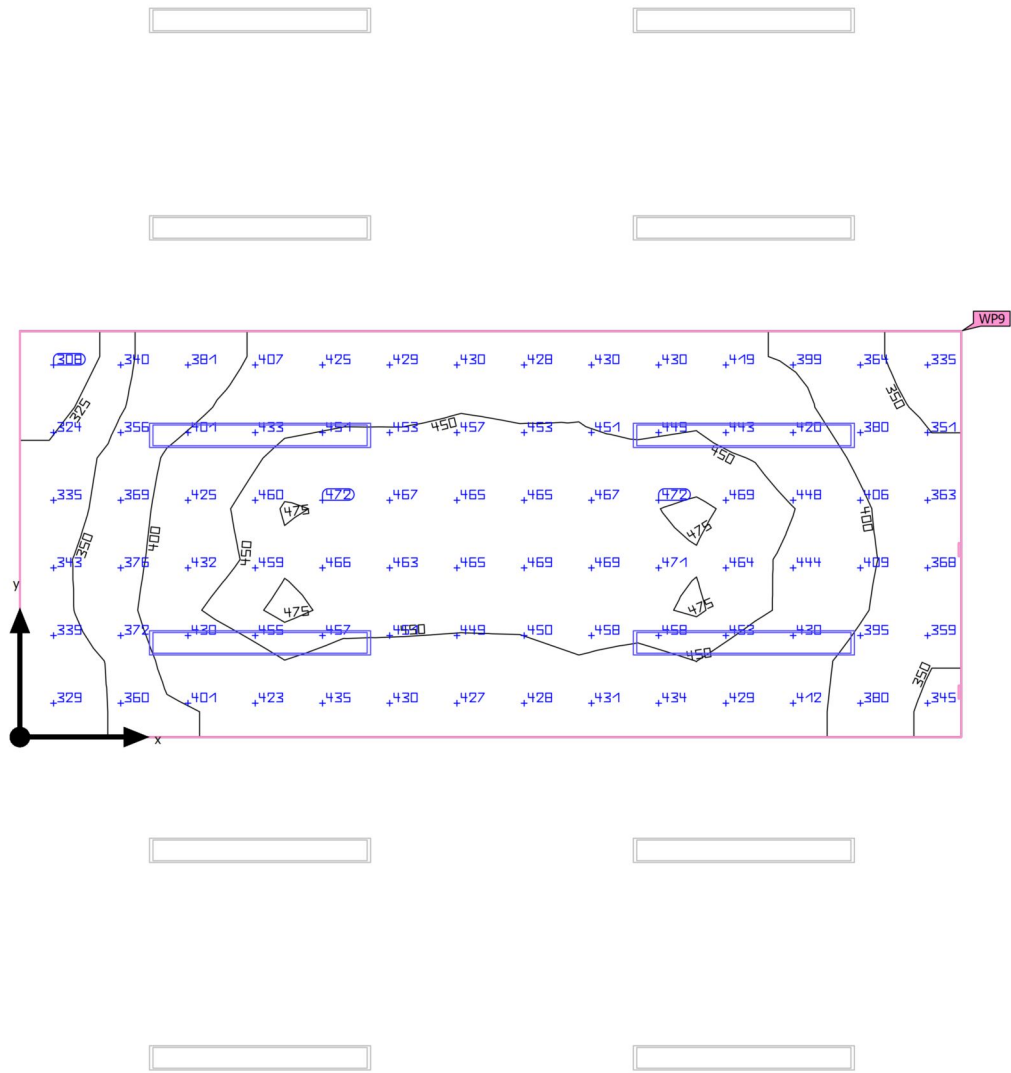

Ground area	12.81 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 215 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	419 lx	$\geq 500 \text{ lx}$	✗	WP9
	$U_o (g_1)$	0.73	≥ 0.60	✓	WP9
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	752 kWh/a	max. 450 kWh/a	✗	
Space	Lighting power density	23.74 W/m ²	–		
		5.66 W/m ² /100 lx	–		

(1) Based on a rectangular space of 5.450 m x 2.350 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 215 MEETING

Luminaire layout plan

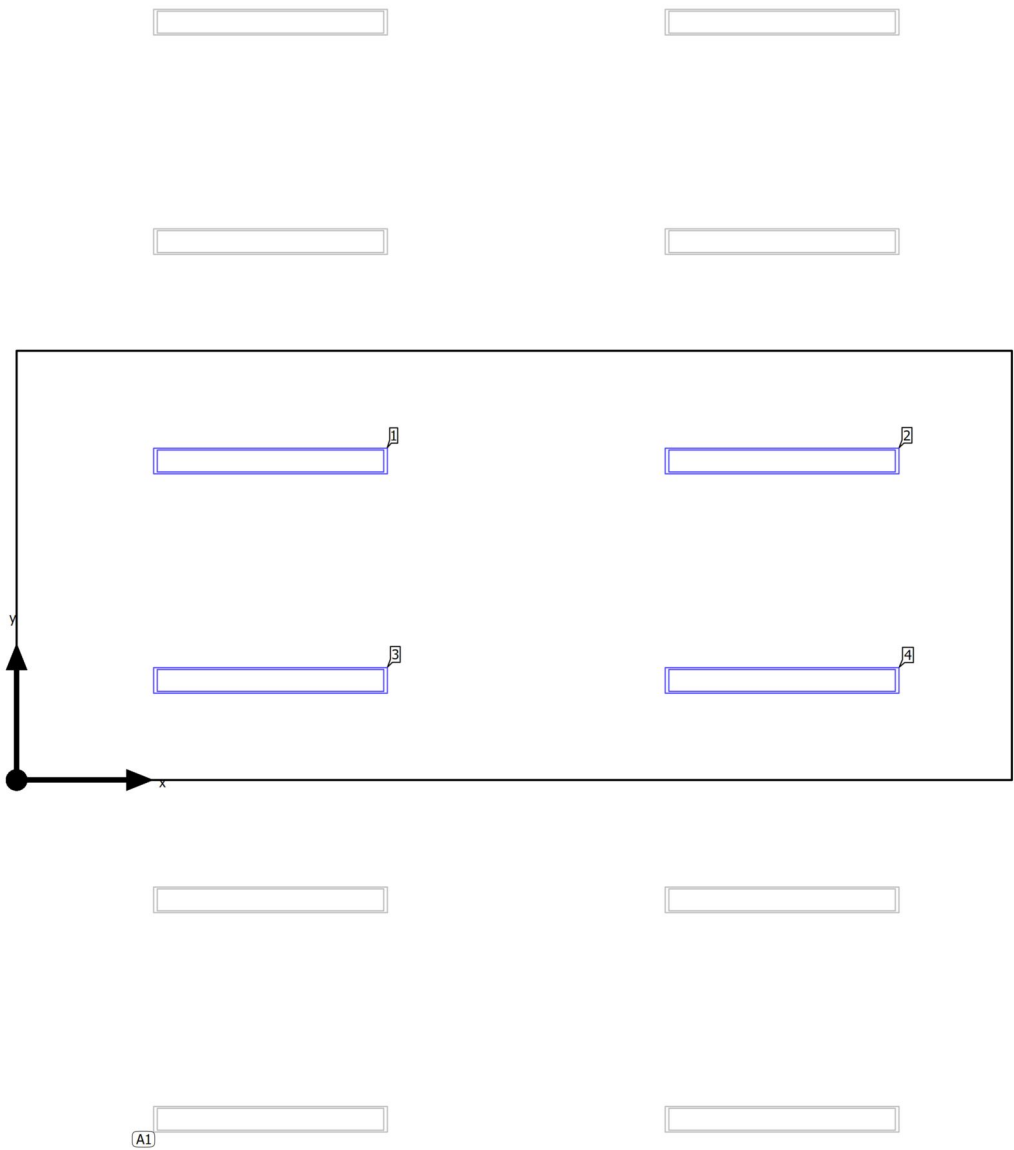

Building A · FIRST FLOOR · 215 MEETING

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

12 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.390 m / 0.545 m / 3.300 m	1.390 m	1.747 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.801 m	4.192 m	1.747 m	3.300 m	2
Y-direction	6 pcs., Centre - centre, 1.201 m	1.390 m	0.545 m	3.300 m	3
		4.192 m	0.545 m	3.300 m	4
Arrangement	A1				

Building A · FIRST FLOOR · 215 MEETING

Luminaire list Φ_{total}

18652 lm

 P_{total}

304.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 215 MEETING (Light scene 1)

Calculation objects

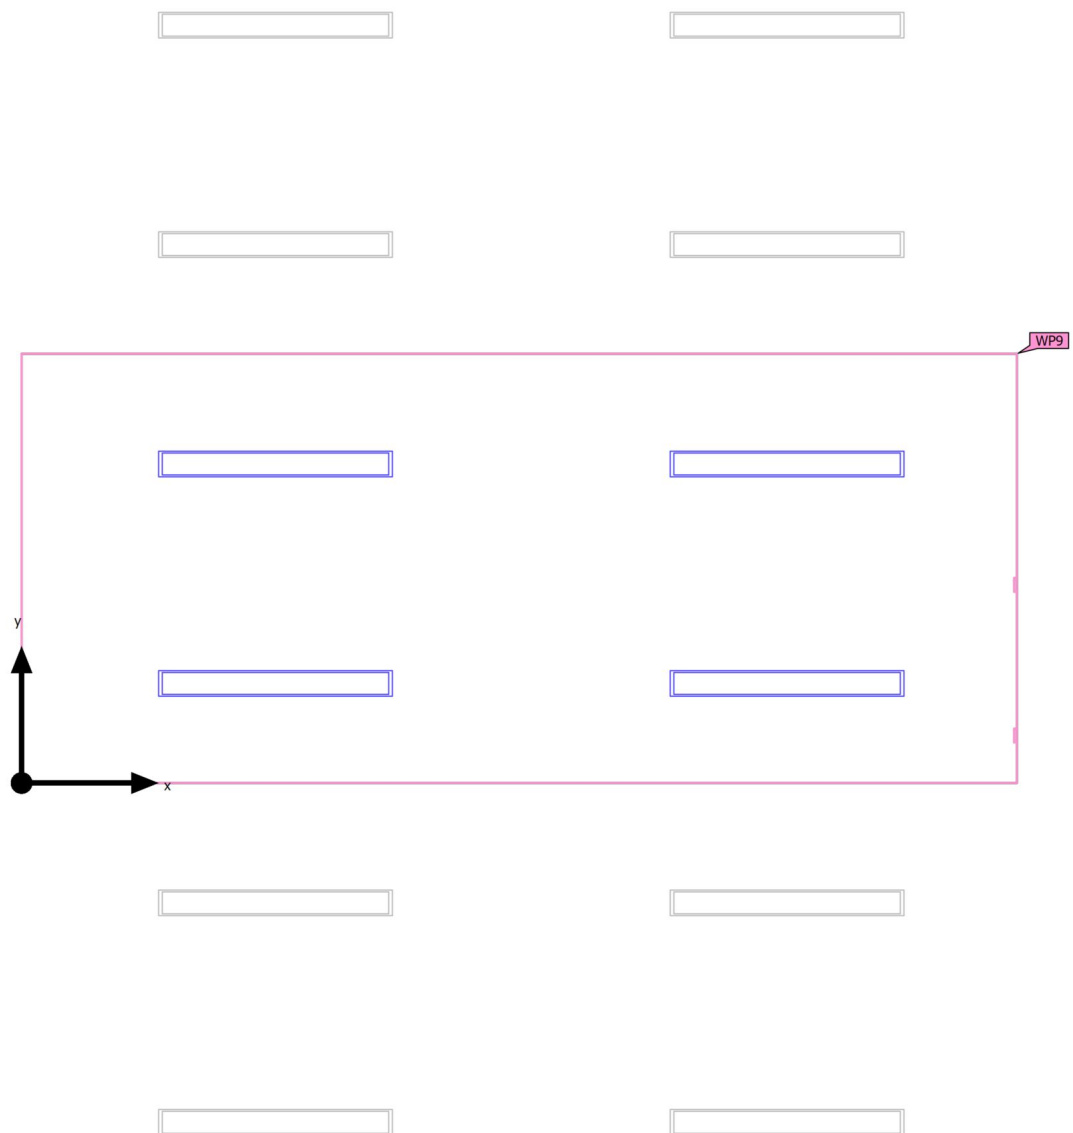

Building A · FIRST FLOOR · 215 MEETING (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (215 MEETING)	419 lx	304 lx	477 lx	0.73	0.64	WP9
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 215 MEETING (Light scene 1)

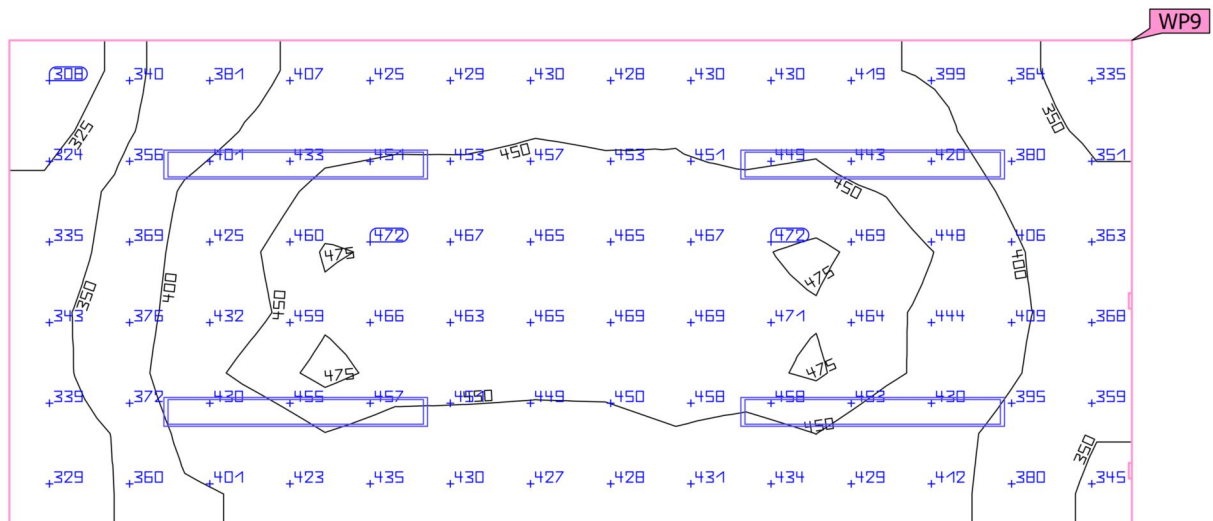
Working plane (215 MEETING)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (215 MEETING)	419 lx	304 lx	477 lx	0.73	0.64	WP9
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 216 MEETING (Light scene 1)

Summary

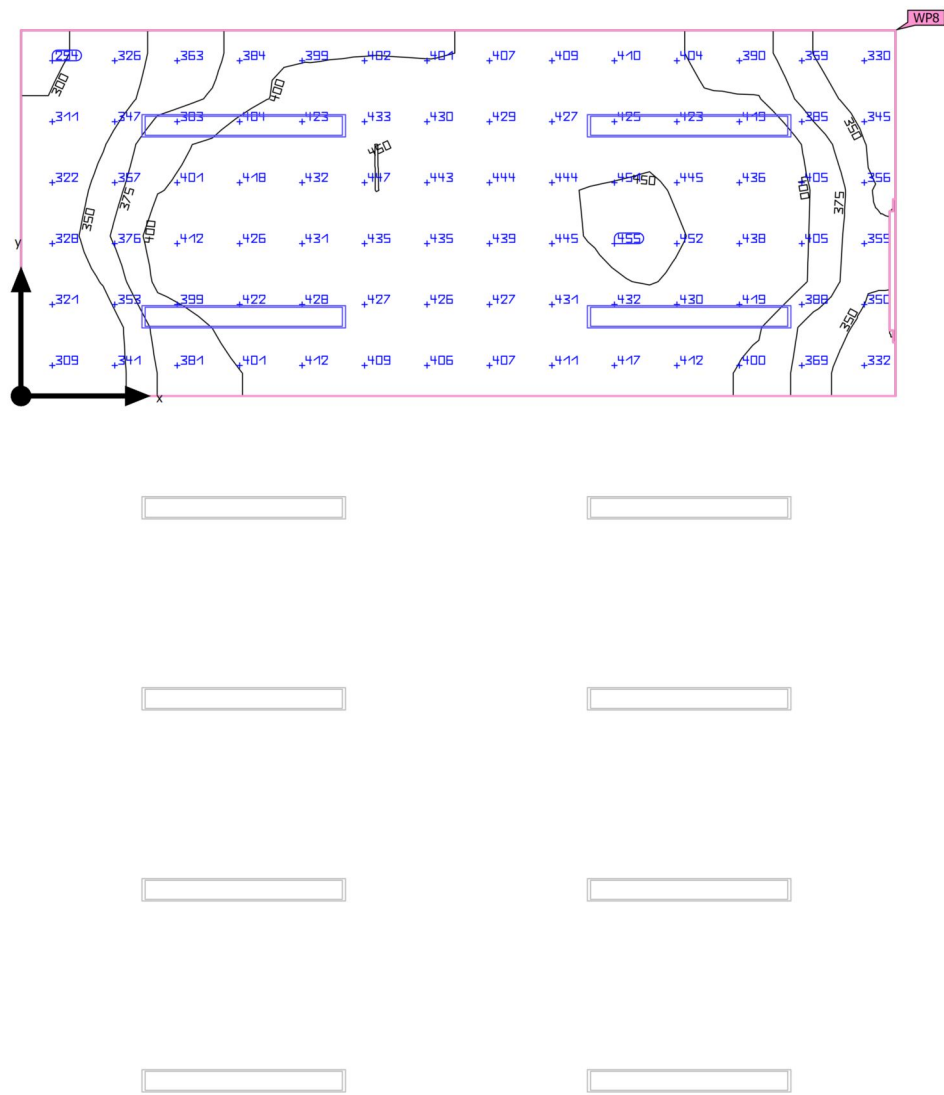

Ground area	12.65 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 216 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	400 lx	$\geq 500 \text{ lx}$	✗	WP8
	$U_o (g_1)$	0.71	≥ 0.60	✓	WP8
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[474 - 752] kWh/a	max. 450 kWh/a	✗	
Space	Lighting power density	24.03 W/m ²	–		
		6.00 W/m ² /100 lx	–		

(1) Based on a rectangular space of 5.500 m x 2.300 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 216 MEETING

Luminaire layout plan

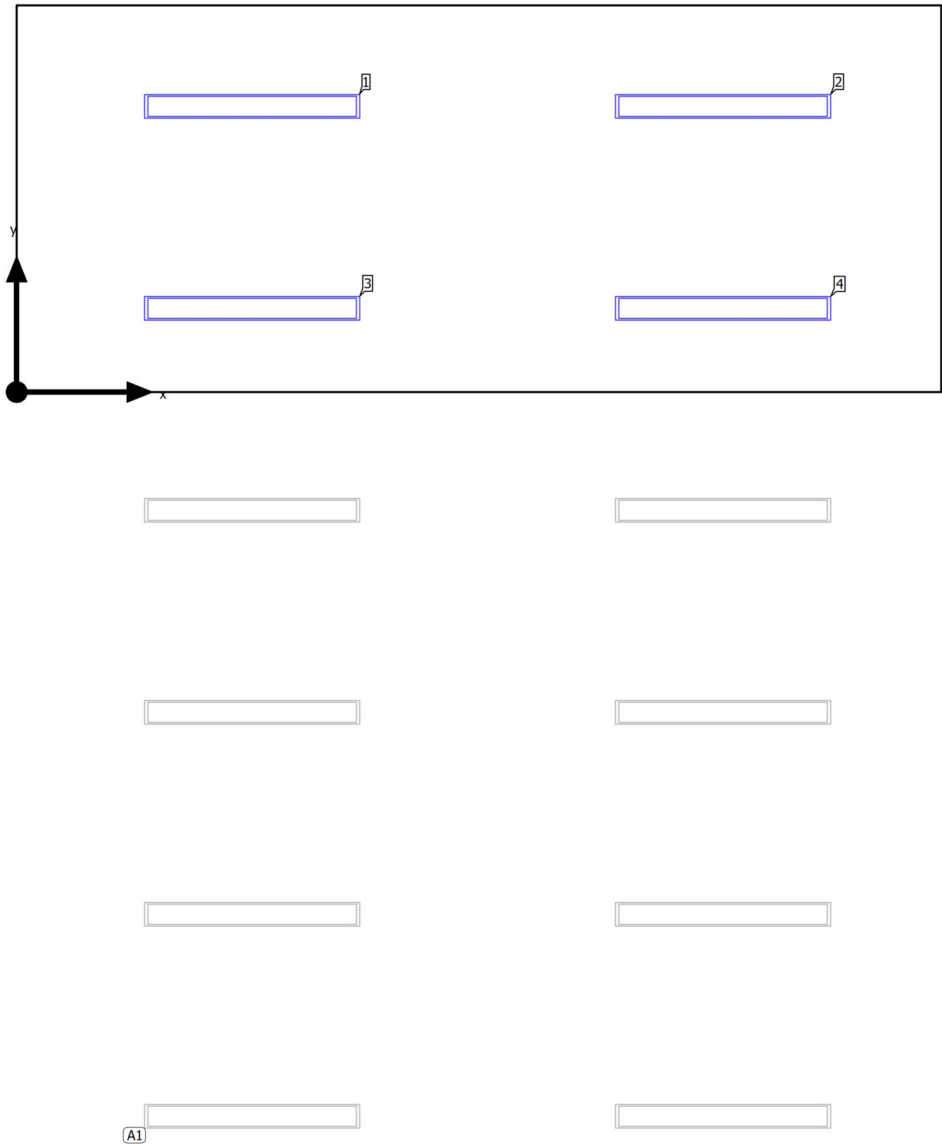

Building A · FIRST FLOOR · 216 MEETING

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

12 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.401 m / 0.498 m / 3.300 m	1.401 m	1.699 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.801 m	4.202 m	1.699 m	3.300 m	2
Y-direction	6 pcs., Centre - centre, 1.201 m	1.401 m	0.498 m	3.300 m	3
		4.202 m	0.498 m	3.300 m	4
Arrangement	A1				

Building A · FIRST FLOOR · 216 MEETING

Luminaire list Φ_{total}

18652 lm

 P_{total}

304.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 216 MEETING (Light scene 1)

Calculation objects

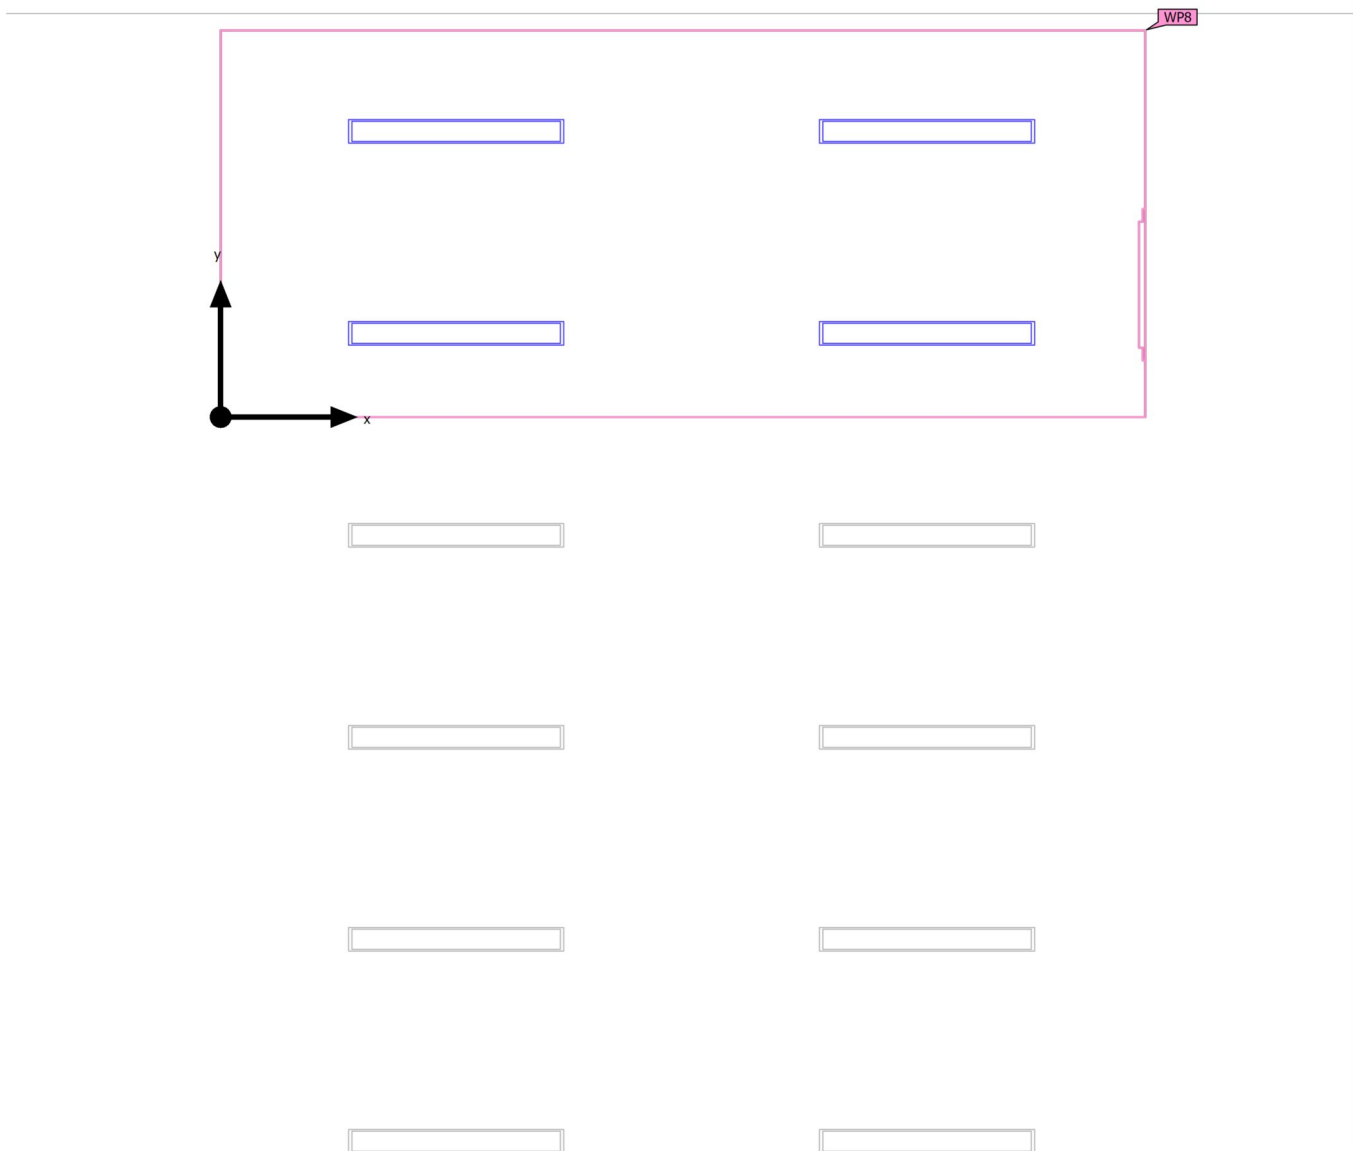

Building A · FIRST FLOOR · 216 MEETING (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (216 MEETING)	400 lx	285 lx	460 lx	0.71	0.62	WP8
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 216 MEETING (Light scene 1)

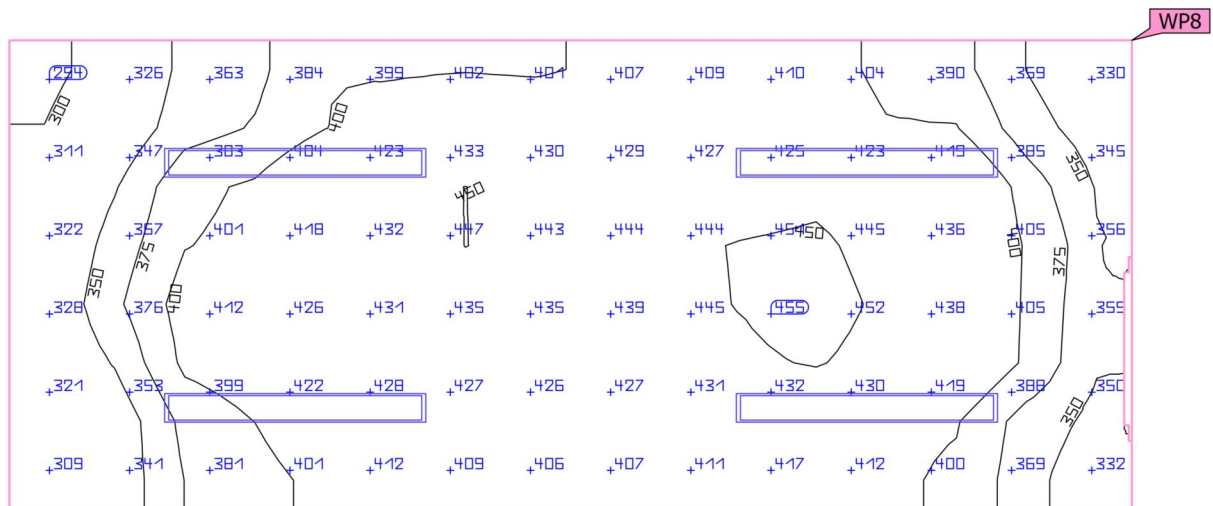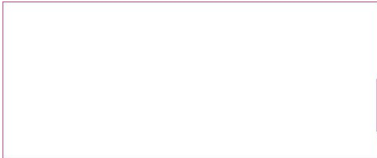
Working plane (216 MEETING)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (216 MEETING)	400 lx	285 lx	460 lx	0.71	0.62	WP8
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 217 TOILET (Light scene 1)

Summary

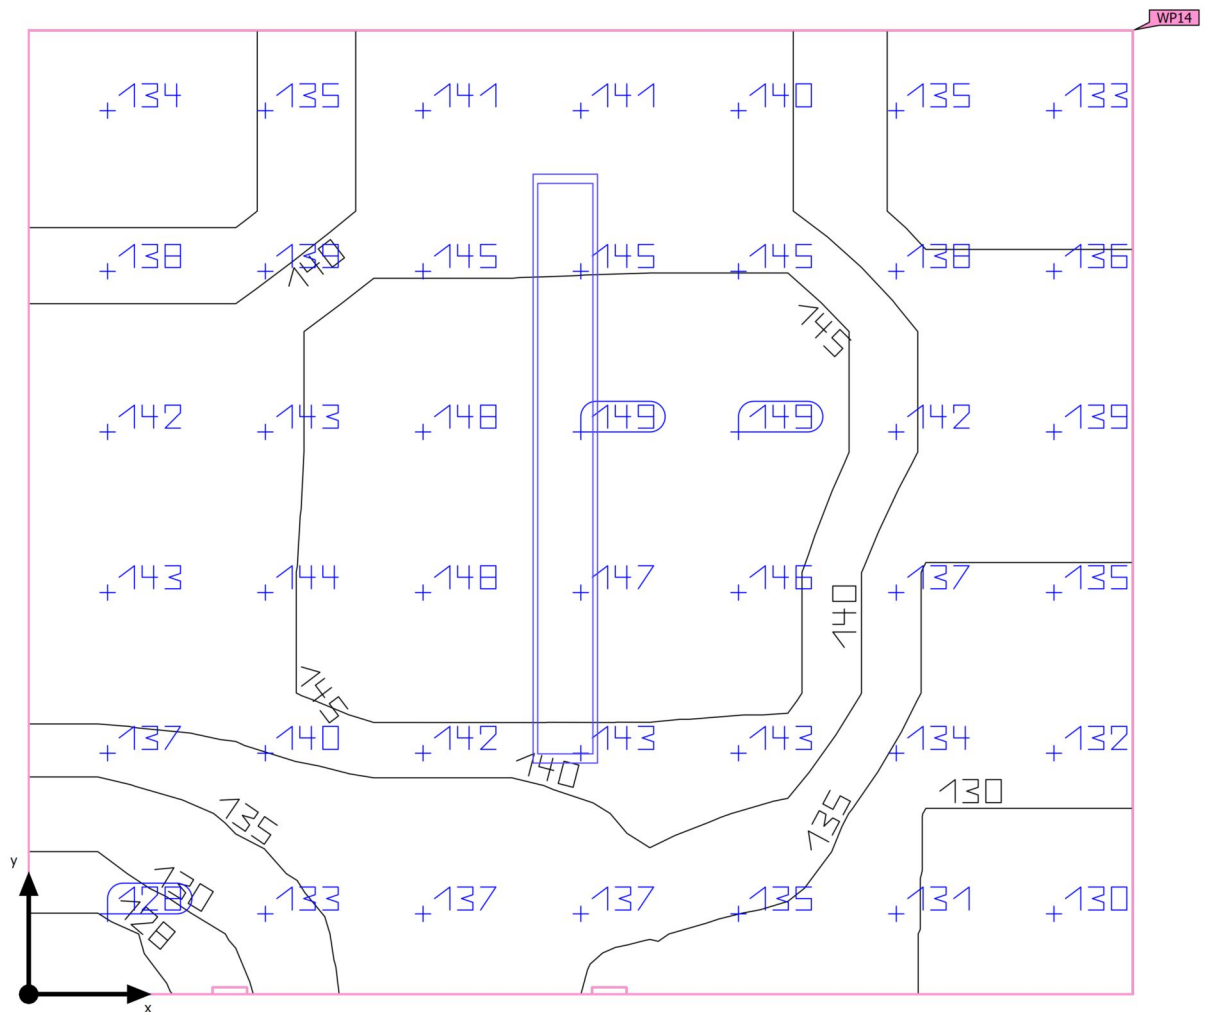

Ground area	5.03 m²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.000 m
		Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 217 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	140 lx	$\geq 500 \text{ lx}$	✗	WP14
	$U_o (g_1)$	0.91	≥ 0.60	✓	WP14
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 200 kWh/a	✓	
Space	Lighting power density	15.11 W/m ²	–		
		10.83 W/m ² /100 lx	–		

(1) Based on a rectangular space of 2.095 m x 2.400 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W


Building A · FIRST FLOOR · 217 TOILET

Luminaire layout plan

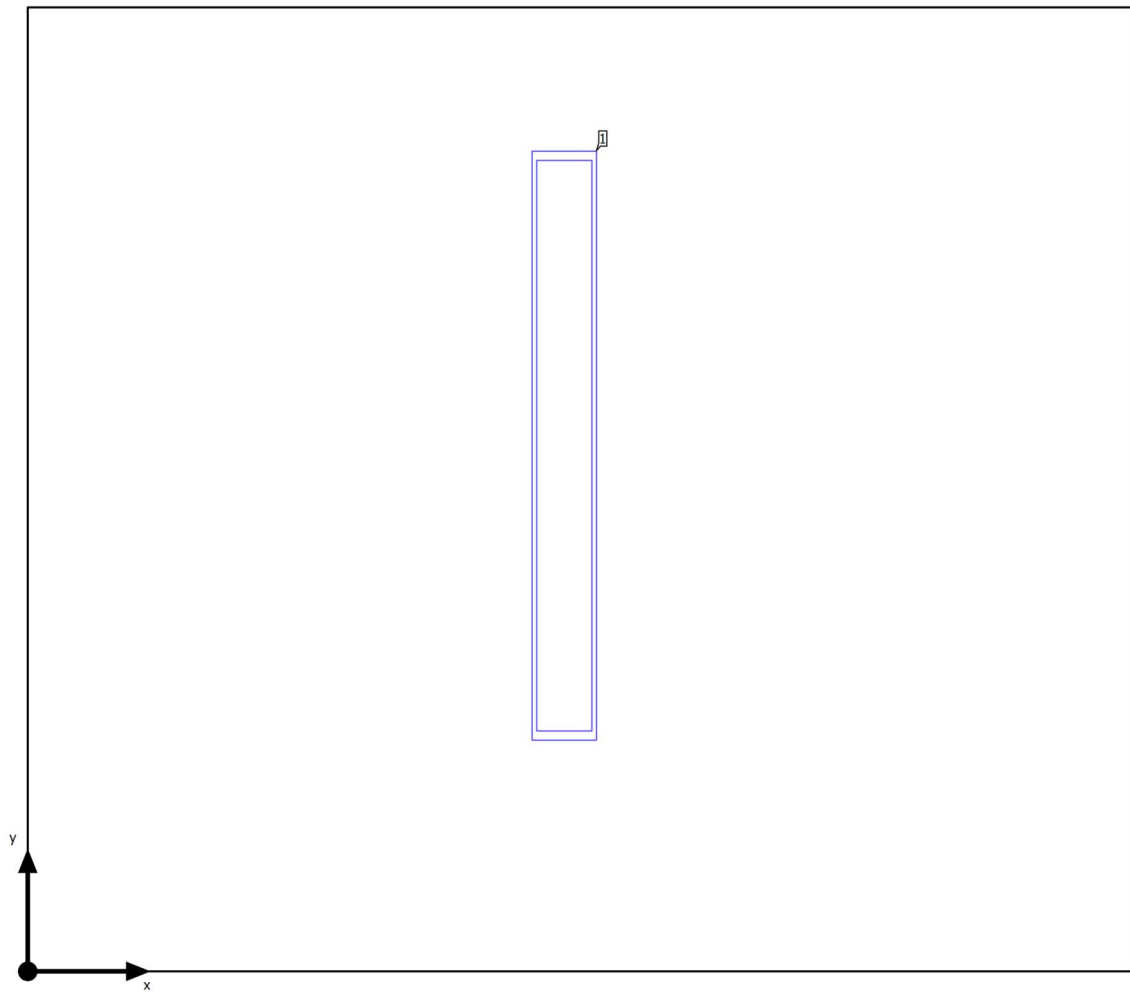

Building A · FIRST FLOOR · 217 TOILET

Luminaire layout plan



Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
1.166 m	1.142 m	3.300 m	1

Building A · FIRST FLOOR · 217 TOILET


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 217 TOILET (Light scene 1)

Calculation objects

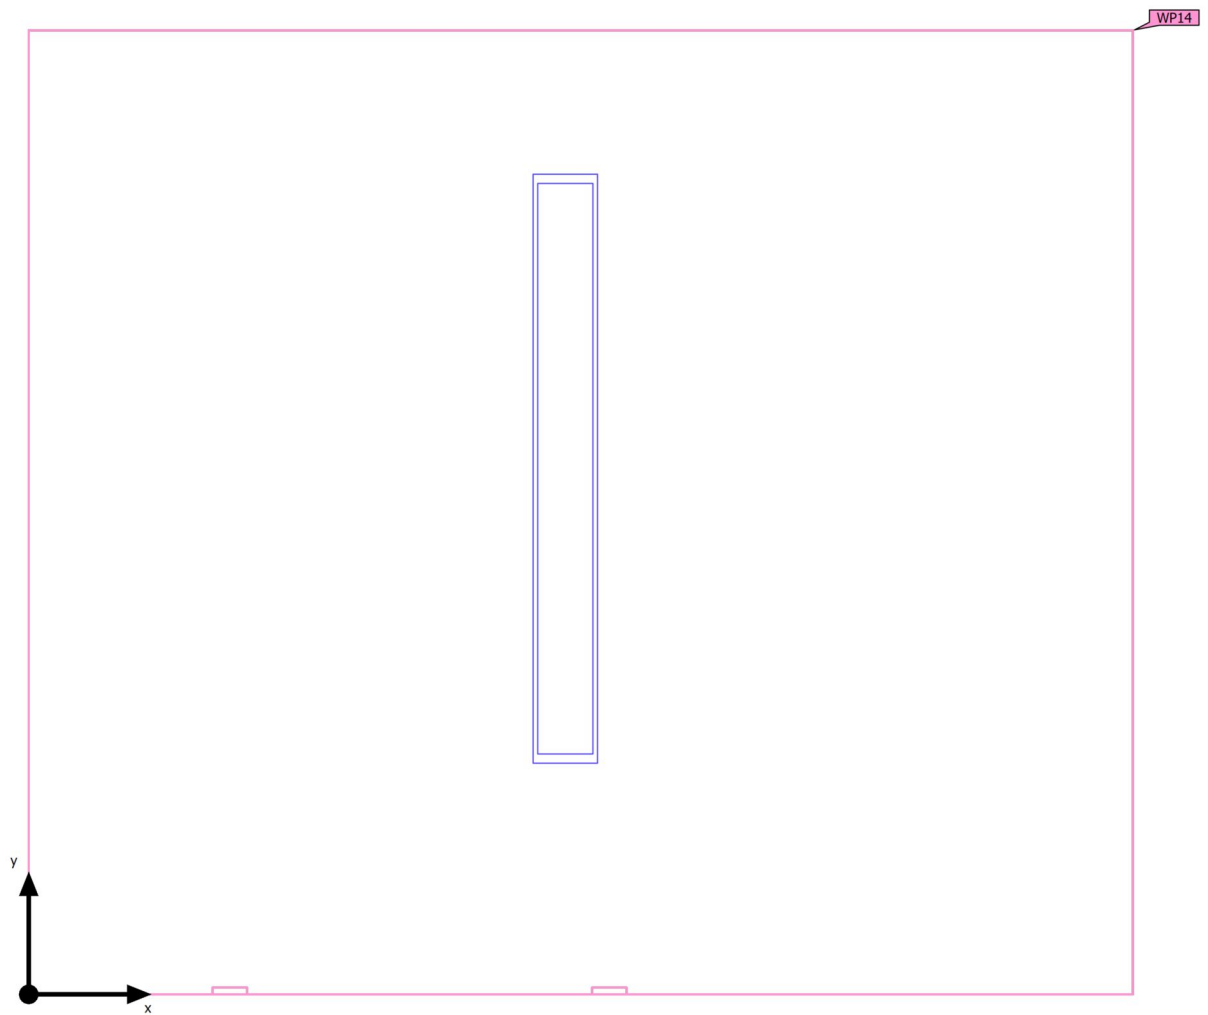

Building A · FIRST FLOOR · 217 TOILET (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (217 TOILET)	140 lx	127 lx	150 lx	0.91	0.85	WP14
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 217 TOILET (Light scene 1)

Working plane (217 TOILET)

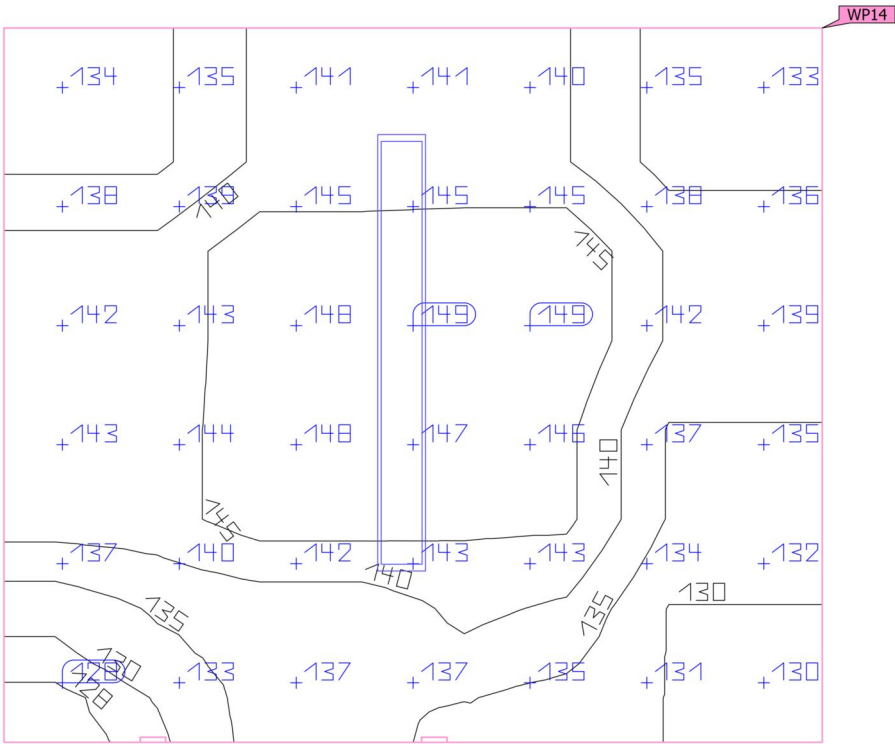


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (217 TOILET)	140 lx	127 lx	150 lx	0.91	0.85	WP14
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 218 TOILET (Light scene 1)

Summary

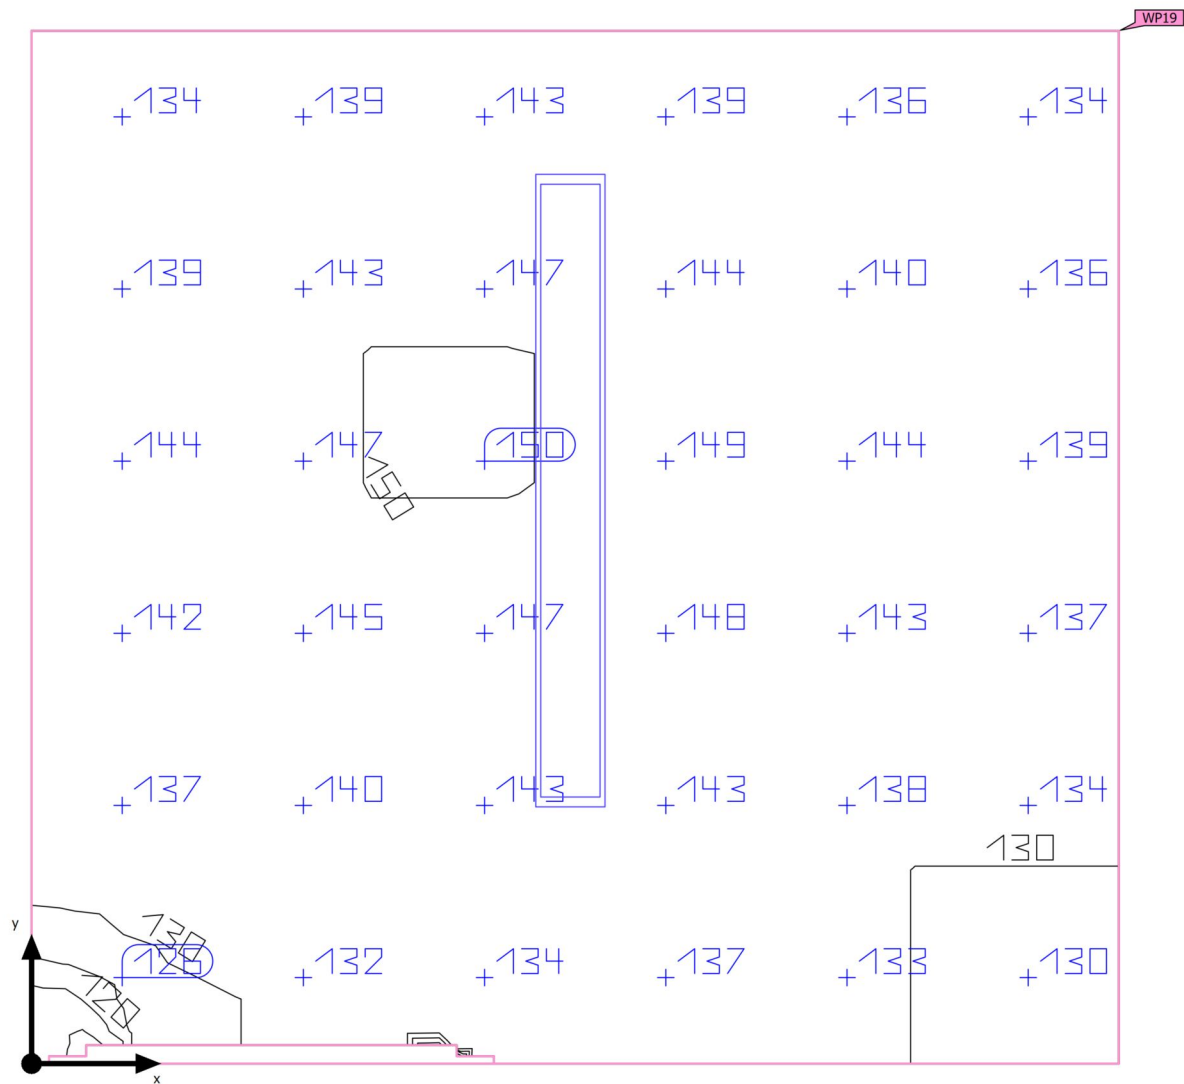

Ground area	4.60 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 218 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	140 lx	$\geq 500 \text{ lx}$	✗	WP19
	$U_o (g_1)$	0.72	≥ 0.60	✓	WP19
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 200 kWh/a	✓	
Space	Lighting power density	16.53 W/m ²	–		
		11.81 W/m ² /100 lx	–		

(1) Based on a rectangular space of 2.090 m x 2.200 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W


Building A · FIRST FLOOR · 218 TOILET

Luminaire layout plan

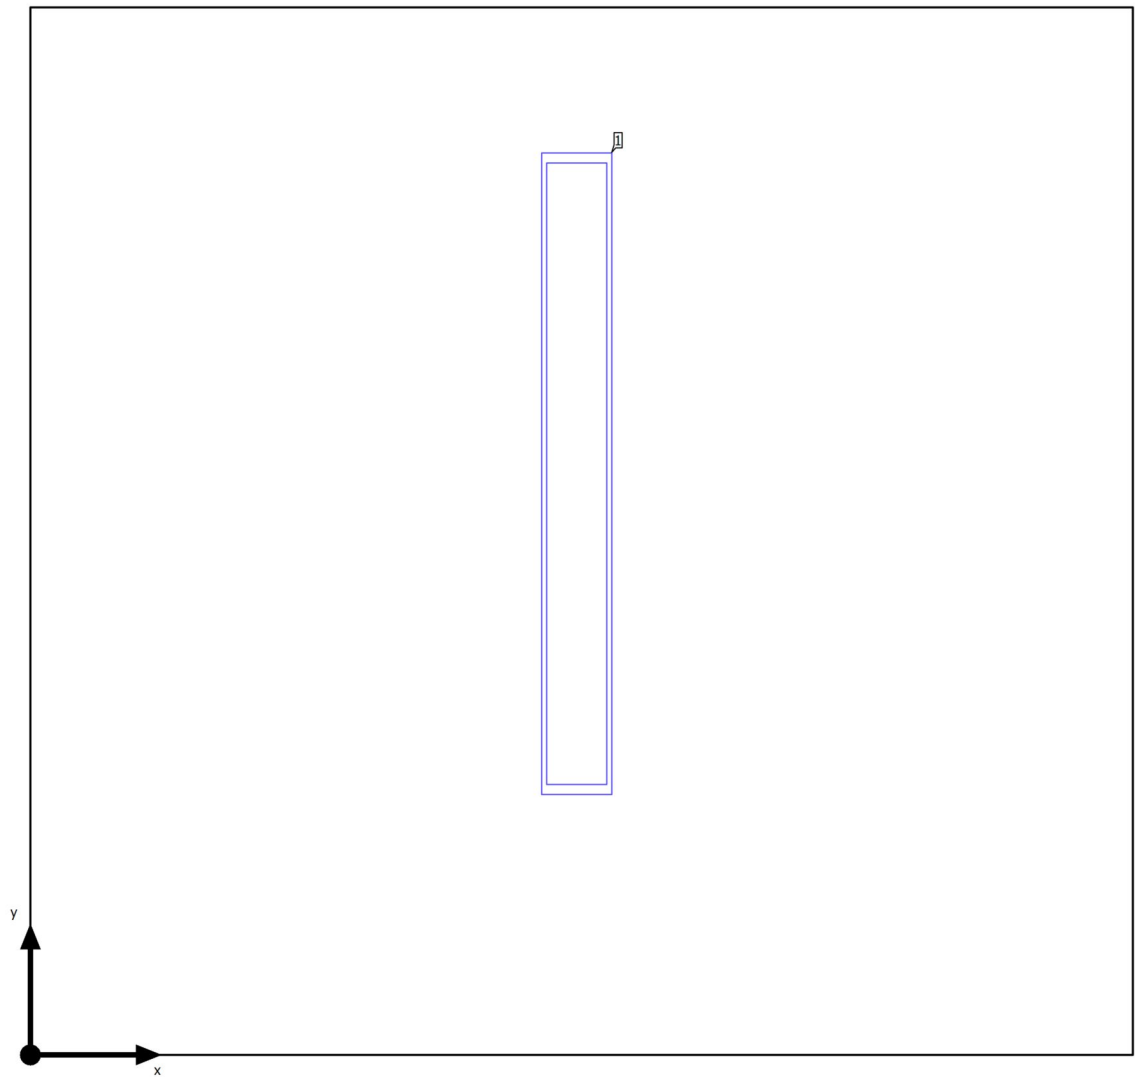

Building A · FIRST FLOOR · 218 TOLET

Luminaire layout plan



Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
1.090 m	1.160 m	3.300 m	1

Building A · FIRST FLOOR · 218 TOILET


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 218 TOILET (Light scene 1)

Calculation objects

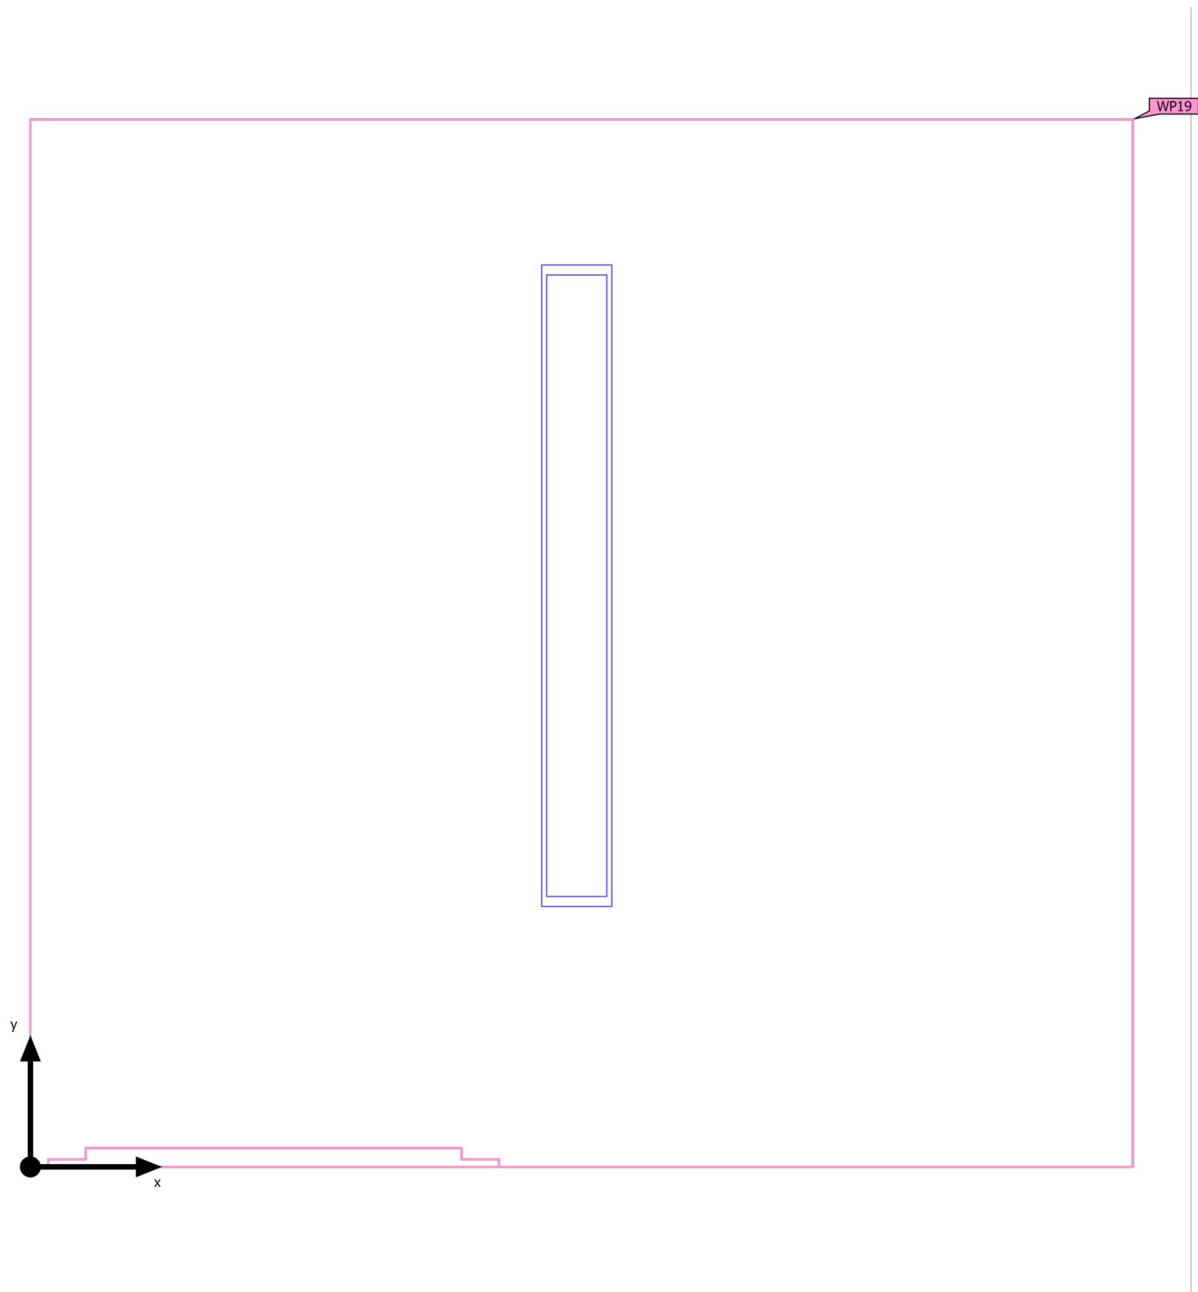

Building A · FIRST FLOOR · 218 TOILET (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (218 TOILET)	140 lx	101 lx	150 lx	0.72	0.67	WP19
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 218 TOILET (Light scene 1)

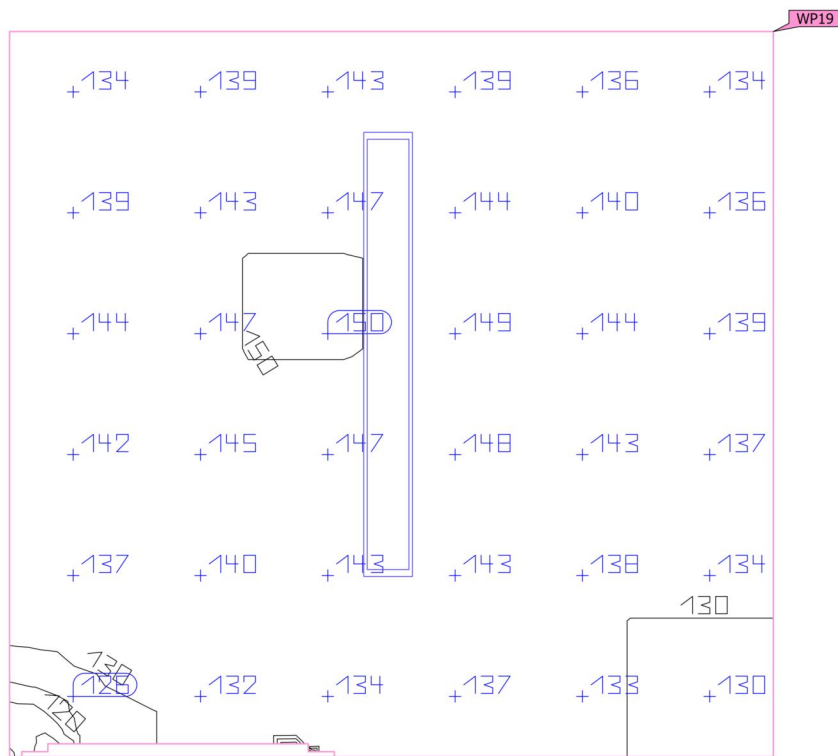
Working plane (218 TOILET)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (218 TOILET)	140 lx	101 lx	150 lx	0.72	0.67	WP19
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 219 MEETING (Light scene 1)

Summary

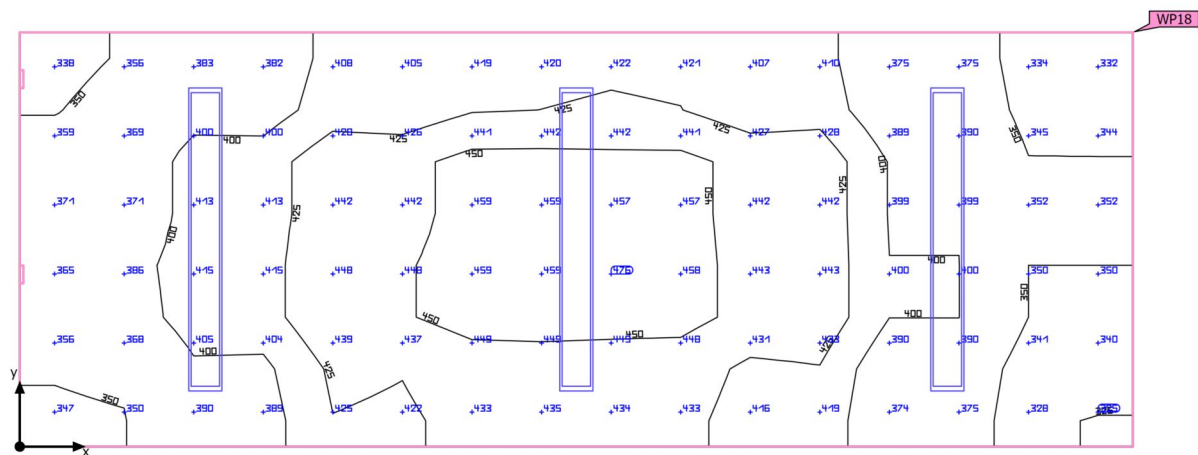

Ground area	8.23 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 219 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	405 lx	$\geq 500 \text{ lx}$	✗	WP18
	$U_o (g_1)$	0.80	≥ 0.60	✓	WP18
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	564 kWh/a	max. 300 kWh/a	✗	
Space	Lighting power density	27.72 W/m ²	–		
		6.84 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.700 m x 1.750 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
3	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 219 MEETING

Luminaire layout plan

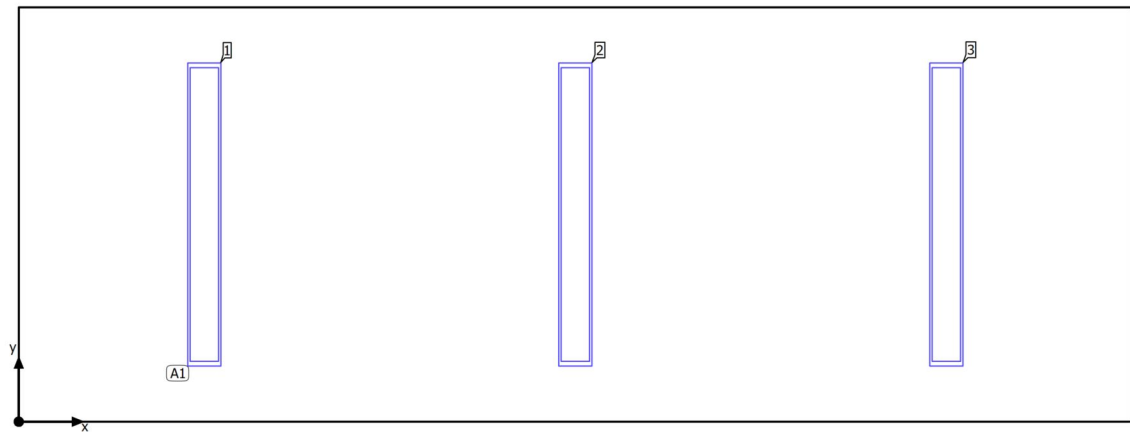

Building A · FIRST FLOOR · 219 MEETING

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

3 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.783 m / 0.875 m / 3.300 m	0.783 m	0.875 m	3.300 m	1
X-direction	3 pcs., Centre - centre, 1.567 m	2.350 m	0.875 m	3.300 m	2
Y-direction	1 pcs., Centre - centre, 1.750 m	3.917 m	0.875 m	3.300 m	3
Arrangement	A1				

Building A · FIRST FLOOR · 219 MEETING

Luminaire list Φ_{total}

13989 lm

 P_{total}

228.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
3	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 219 MEETING (Light scene 1)

Calculation objects

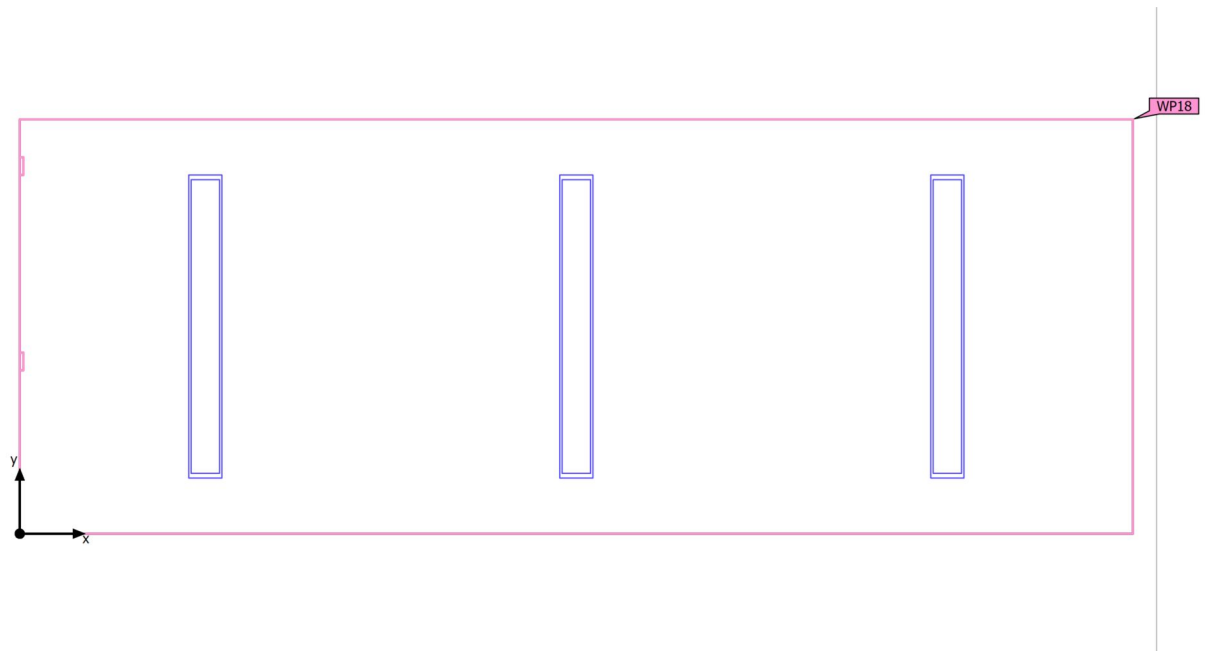

Building A · FIRST FLOOR · 219 MEETING (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (219 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	405 lx (≥ 500 lx) ✗	325 lx	464 lx	0.80 (≥ 0.60) ✓	0.70	WP18

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 219 MEETING (Light scene 1)

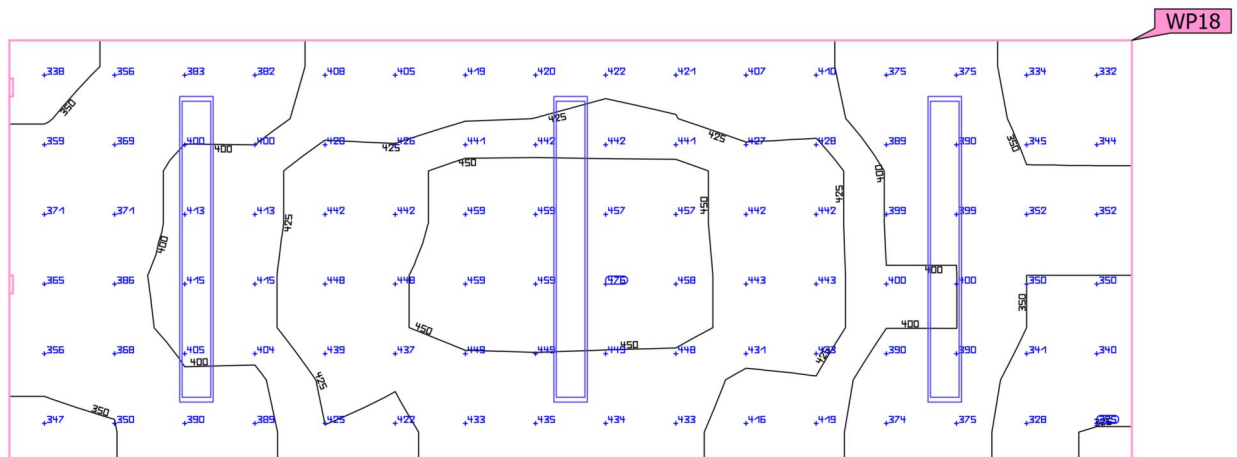
Working plane (219 MEETING)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (219 MEETING)	405 lx	325 lx	464 lx	0.80	0.70	WP18
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 220 OFFICE (Light scene 1)

Summary

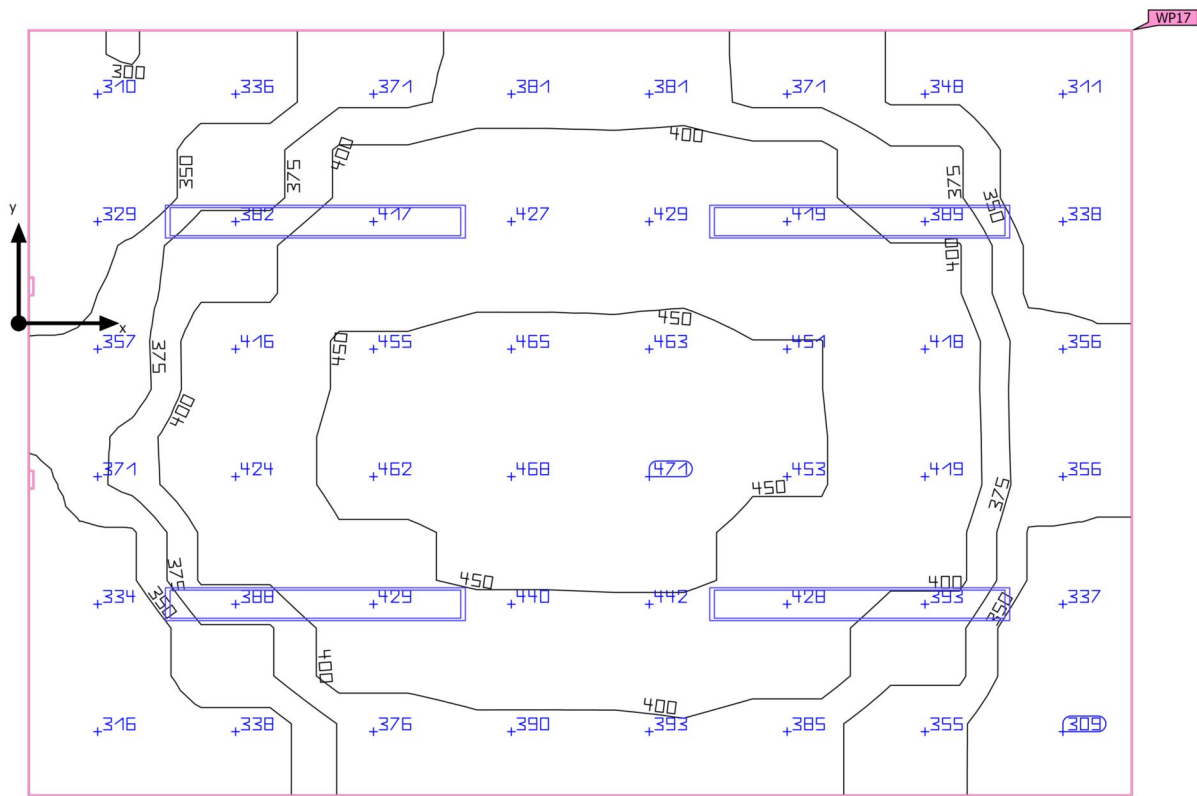

Ground area	15.37 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · FIRST FLOOR · 220 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	392 lx	≥ 500 lx	✗	WP17
	$U_o (g_1)$	0.77	≥ 0.60	✓	WP17
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[474 - 752] kWh/a	max. 550 kWh/a	✗	
Space	Lighting power density	19.78 W/m ²	–		
		5.04 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.707 m x 3.265 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 220 OFFICE

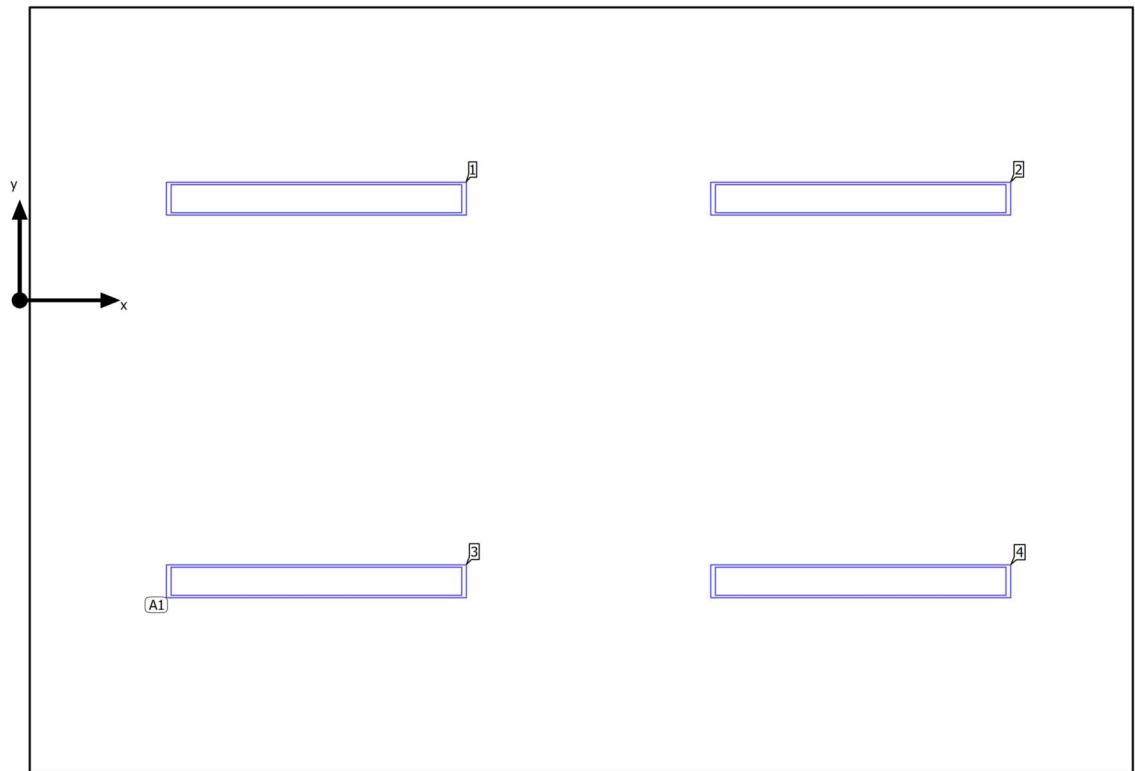Luminaire layout plan

Building A · FIRST FLOOR · 220 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

4 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.266 m / -1.199 m / 3.300 m	1.266 m	0.434 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.323 m	3.589 m	0.434 m	3.300 m	2
Y-direction	2 pcs., Centre - centre, 1.632 m	1.266 m	-1.199 m	3.300 m	3
		3.589 m	-1.199 m	3.300 m	4
Arrangement	A1				

Building A · FIRST FLOOR · 220 OFFICE


Luminaire list

Φ_{total} 18652 lm	P_{total} 304.0 W	Luminous efficacy 61.4 lm/W
-----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · FIRST FLOOR · 220 OFFICE (Light scene 1)

Calculation objects

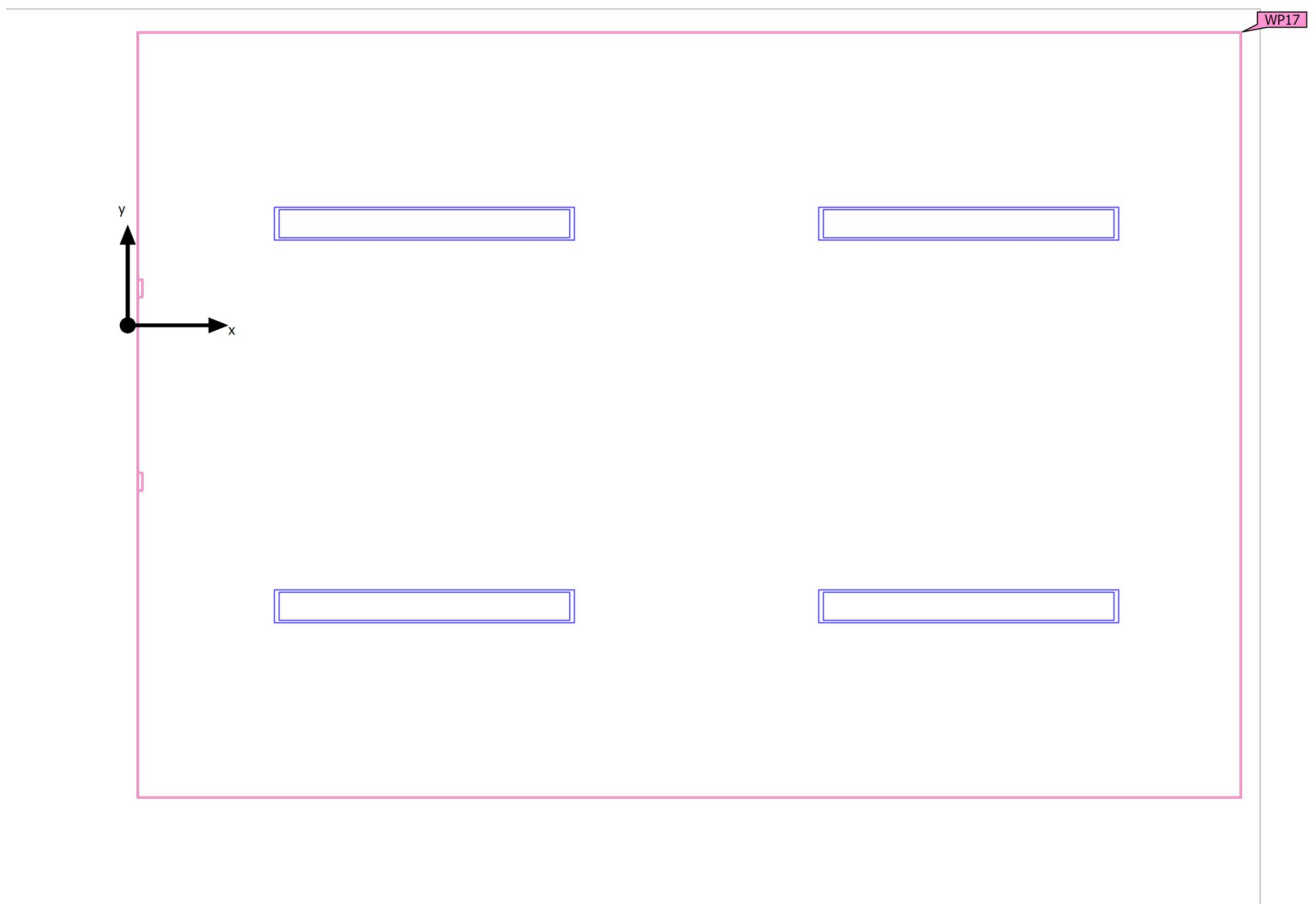

Building A · FIRST FLOOR · 220 OFFICE (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (220 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	392 lx (≥ 500 lx) ✗	300 lx	469 lx	0.77 (≥ 0.60) ✓	0.64	WP17

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · FIRST FLOOR · 220 OFFICE (Light scene 1)

Working plane (220 OFFICE)

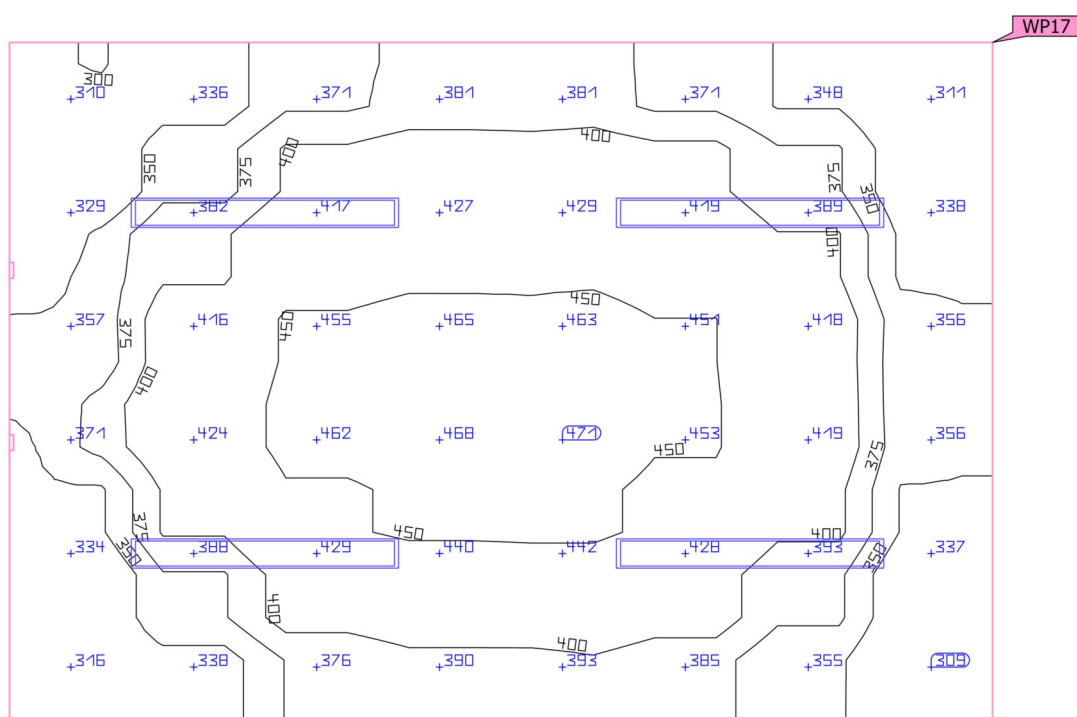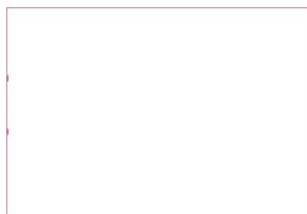

Properties	Ē (Target)	E _{min}	E _{max}	U _o (g ₁) (Target)	g ₂	Index
Working plane (220 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	392 lx (≥ 500 lx) ✗	300 lx	469 lx	0.77 (≥ 0.60) ✓	0.64	WP17

Utilisation profile: DIALux presetting (5.26.2 Standard (office))