


Building B · FIRST FOOR (Light scene 1)

Room list

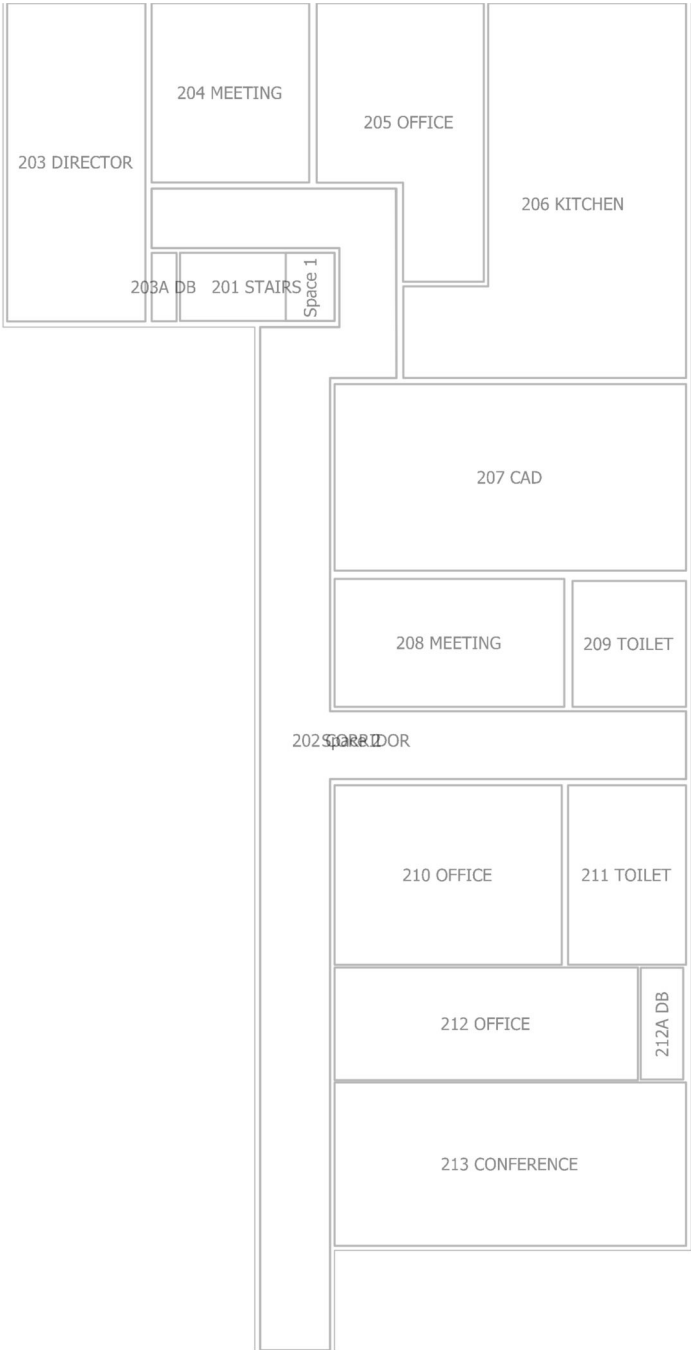

Building B · FIRST FOOR (Light scene 1)

**Room list**

## 201 STAIRS

**P<sub>total</sub>**  
76.0 W**A<sub>Room</sub>**  
6.18 m<sup>2</sup>**Lighting power density**  
12.30 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|--------|------------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                |

## 202 CORRIDOR

**P<sub>total</sub>**  
684.0 W**A<sub>Room</sub>**  
69.35 m<sup>2</sup>**Lighting power density**  
9.86 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|--------|------------------------|
| 9    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                |

## 203 DIRECTOR

**P<sub>total</sub>**  
304.0 W**A<sub>Room</sub>**  
25.83 m<sup>2</sup>**Lighting power density**  
11.77 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|--------|------------------------|
| 4    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                |

Building B · FIRST FOOR (Light scene 1)

**Room list**

## 204 MEETING

$P_{\text{total}}$   
304.0 W

$A_{\text{Room}}$   
16.60 m<sup>2</sup>

Lighting power density  
18.32 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|--------|---------------------------|
| 4    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                   |

## 205 OFFICE

$P_{\text{total}}$   
380.0 W

$A_{\text{Room}}$   
22.32 m<sup>2</sup>

Lighting power density  
17.03 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|--------|---------------------------|
| 5    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                   |

## 206 KITCHEN

$P_{\text{total}}$   
532.0 W

$A_{\text{Room}}$   
48.10 m<sup>2</sup>

Lighting power density  
11.06 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|--------|---------------------------|
| 7    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                   |

Building B · FIRST FOOR (Light scene 1)

**Room list**

207 CAD

**P<sub>total</sub>**  
684.0 W**A<sub>Room</sub>**  
38.48 m<sup>2</sup>**Lighting power density**  
17.77 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|--------|------------------------|
| 9    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                |

208 MEETING

**P<sub>total</sub>**  
456.0 W**A<sub>Room</sub>**  
17.26 m<sup>2</sup>**Lighting power density**  
26.43 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|--------|------------------------|
| 6    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                |

209 TOILET

**P<sub>total</sub>**  
152.0 W**A<sub>Room</sub>**  
8.39 m<sup>2</sup>**Lighting power density**  
18.12 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|--------|------------------------|
| 2    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                |

Building B · FIRST FOOR (Light scene 1)

**Room list**

## 210 OFFICE

$P_{\text{total}}$   
684.0 W

$A_{\text{Room}}$   
23.95 m<sup>2</sup>

Lighting power density  
28.56 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|--------|---------------------------|
| 9    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                   |

## 211 TOILET

$P_{\text{total}}$   
228.0 W

$A_{\text{Room}}$   
12.43 m<sup>2</sup>

Lighting power density  
18.35 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|--------|---------------------------|
| 3    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                   |

## 212 OFFICE

$P_{\text{total}}$   
608.0 W

$A_{\text{Room}}$   
20.07 m<sup>2</sup>

Lighting power density  
30.30 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|--------|---------------------------|
| 8    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                   |

Building B · FIRST FOOR (Light scene 1)

**Room list**

212A DB

**P<sub>total</sub>**  
76.0 W**A<sub>Room</sub>**  
2.79 m<sup>2</sup>**Lighting power density**  
27.23 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|--------|------------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                |

213 CONFERENCE

**P<sub>total</sub>**  
608.0 W**A<sub>Room</sub>**  
33.71 m<sup>2</sup>**Lighting power density**  
18.04 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|--------|------------------------|
| 8    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                |

Space 1

**P<sub>total</sub>**  
76.0 W**A<sub>Room</sub>**  
1.95 m<sup>2</sup>**Lighting power density**  
38.94 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|--------|------------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                |

Building B · FIRST FOOR

**Luminaire list** $\Phi_{\text{total}}$ 

359051 lm

 $P_{\text{total}}$ 

5852.0 W


Luminous efficacy

61.4 lm/W

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 77   | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR (Light scene 1)

## Calculation objects

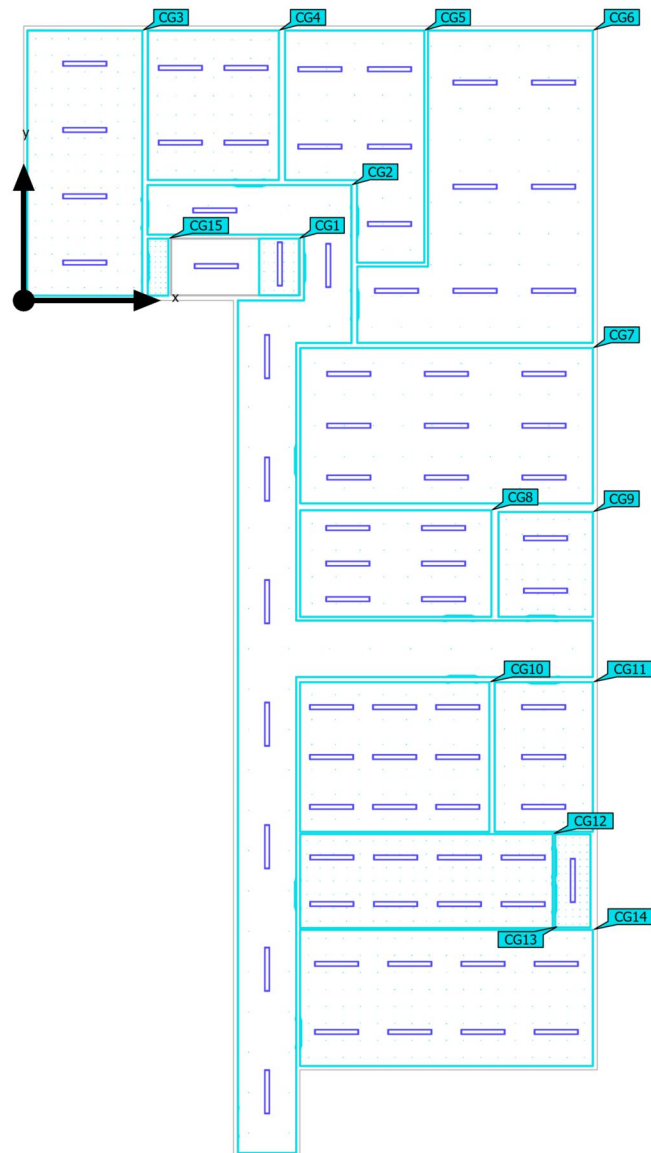

Building B · FIRST FOOR (Light scene 1)

**Calculation objects**

## Calculation surfaces

| Properties                                                   | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|--------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 201 Stairs<br>Perpendicular illuminance<br>Height: 0.000 m   | 243 lx    | 208 lx    | 269 lx    | 0.86        | 0.77  | CG1   |
| 202 Corridor<br>Perpendicular illuminance<br>Height: 0.000 m | 174 lx    | 9.95 lx   | 304 lx    | 0.057       | 0.033 | CG2   |
| 203 Director<br>Perpendicular illuminance<br>Height: 0.700 m | 288 lx    | 191 lx    | 362 lx    | 0.66        | 0.53  | CG3   |
| 203A DB<br>Perpendicular illuminance<br>Height: 0.000 m      | 0.017 lx  | 0.00 lx   | 0.17 lx   | 0.00        | 0.00  | CG15  |
| 204 Meeting<br>Perpendicular illuminance<br>Height: 0.700 m  | 385 lx    | 288 lx    | 460 lx    | 0.75        | 0.63  | CG4   |
| 205 Office<br>Perpendicular illuminance<br>Height: 0.700 m   | 376 lx    | 267 lx    | 460 lx    | 0.71        | 0.58  | CG5   |
| 206 Kitchen<br>Perpendicular illuminance<br>Height: 0.850 m  | 310 lx    | 185 lx    | 383 lx    | 0.60        | 0.48  | CG6   |
| 207 CAD<br>Perpendicular illuminance<br>Height: 0.700 m      | 473 lx    | 344 lx    | 570 lx    | 0.73        | 0.60  | CG7   |
| 208 Meeting<br>Perpendicular illuminance<br>Height: 0.700 m  | 550 lx    | 426 lx    | 637 lx    | 0.77        | 0.67  | CG8   |
| 209 Toilet<br>Perpendicular illuminance<br>Height: 0.000 m   | 222 lx    | 181 lx    | 260 lx    | 0.82        | 0.70  | CG9   |
| 210 Office<br>Perpendicular illuminance<br>Height: 0.700 m   | 674 lx    | 492 lx    | 800 lx    | 0.73        | 0.62  | CG10  |

Building B · FIRST FOOR (Light scene 1)

**Calculation objects**

|                                                                |        |        |        |      |      |      |
|----------------------------------------------------------------|--------|--------|--------|------|------|------|
| 211 Toilet<br>Perpendicular illuminance<br>Height: 0.000 m     | 271 lx | 218 lx | 319 lx | 0.80 | 0.68 | CG11 |
| 212 Office<br>Perpendicular illuminance<br>Height: 0.700 m     | 613 lx | 417 lx | 721 lx | 0.68 | 0.58 | CG12 |
| 212A DB<br>Perpendicular illuminance<br>Height: 0.000 m        | 142 lx | 118 lx | 160 lx | 0.83 | 0.74 | CG13 |
| 213 Conference<br>Perpendicular illuminance<br>Height: 0.700 m | 454 lx | 304 lx | 543 lx | 0.67 | 0.56 | CG14 |

Building B · FIRST FOOR (Light scene 1)

## Calculation objects


205 Office (RUG)

|                    |           |
|--------------------|-----------|
| Strongest glare at | 105°      |
| max                | 22.7      |
| Target             | ≤ 19.0    |
| Viewing sector     | 0° - 360° |
| Step width         | 15°       |
| Height             | 1.200 m   |
| Index              | CG5       |

Building B · FIRST FOOR (Light scene 1)

## Calculation objects

205 Office (RUG)

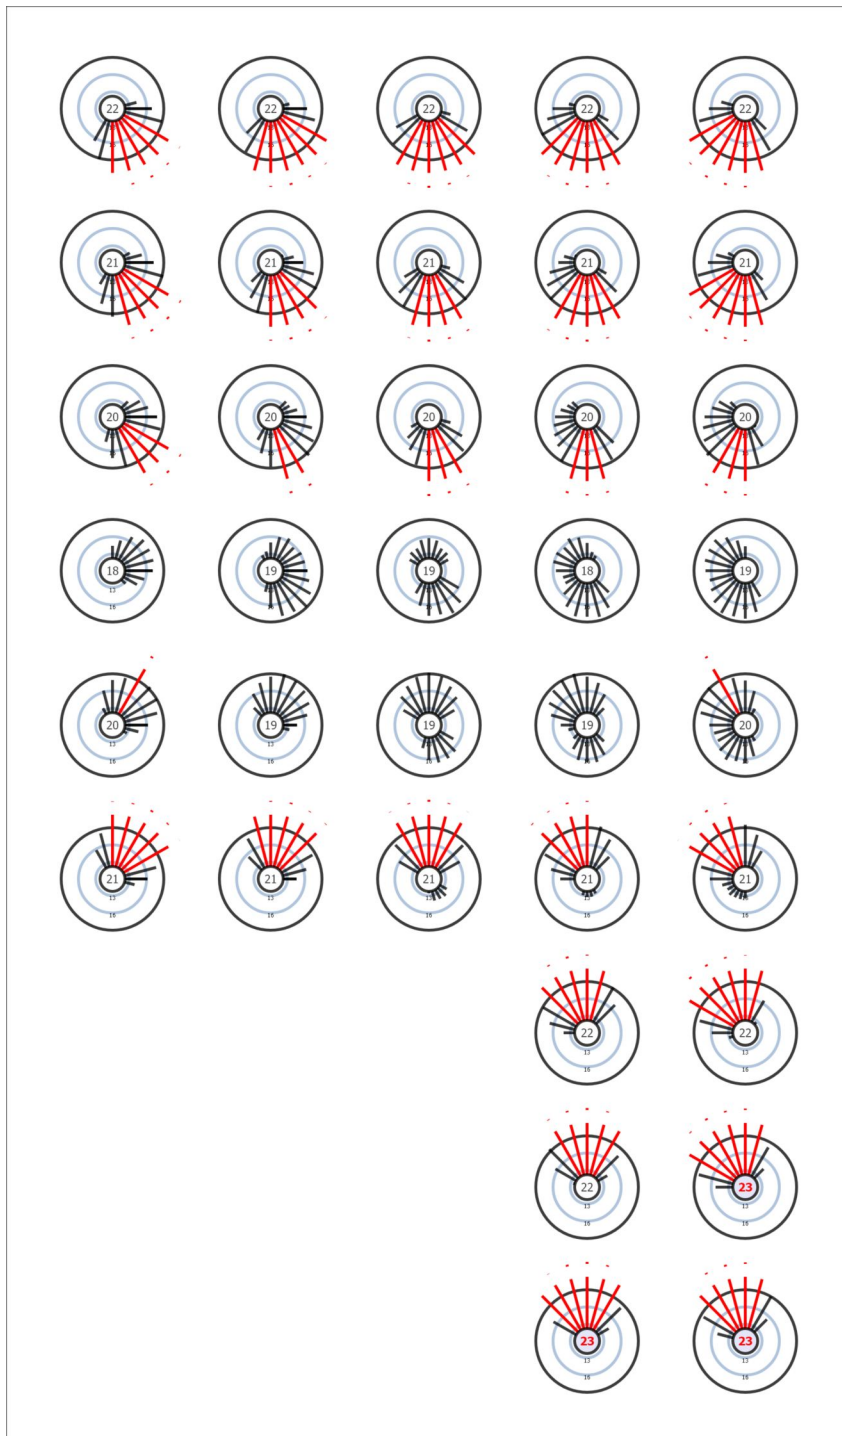

Building B · FIRST FOOR (Light scene 1)

## Calculation objects


207 CAD (RUG)

|                    |           |
|--------------------|-----------|
| Strongest glare at | 240°      |
| max                | 21.4      |
| Target             | ≤ 19.0    |
| Viewing sector     | 0° - 360° |
| Step width         | 15°       |
| Height             | 1.200 m   |
| Index              | CG7       |

Building B · FIRST FOOR (Light scene 1)

## Calculation objects

207 CAD (RUG)

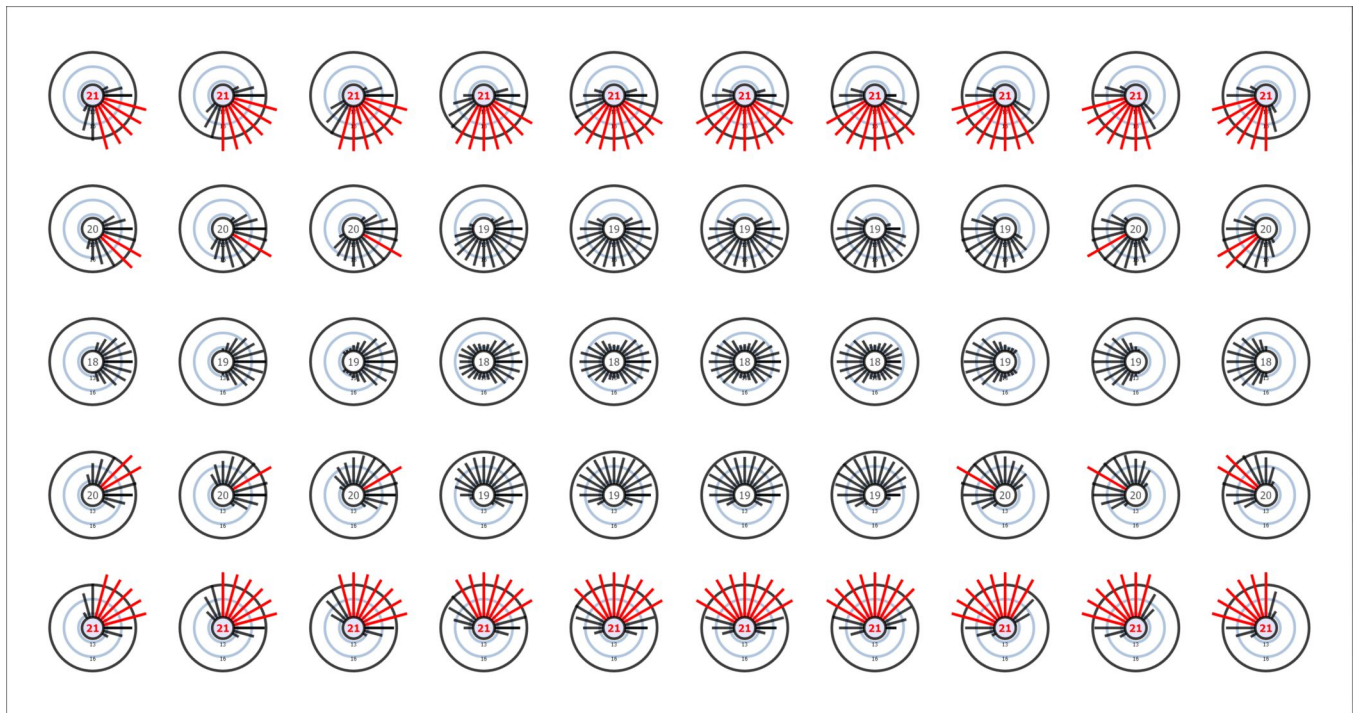

Building B · FIRST FOOR (Light scene 1)

## Calculation objects


210 Office (RUG)

|                    |           |
|--------------------|-----------|
| Strongest glare at | 60°       |
| max                | 21.5      |
| Target             | ≤ 19.0    |
| Viewing sector     | 0° - 360° |
| Step width         | 15°       |
| Height             | 1.200 m   |
| Index              | CG10      |

Building B · FIRST FOOR (Light scene 1)

## Calculation objects

210 Office (RUG)

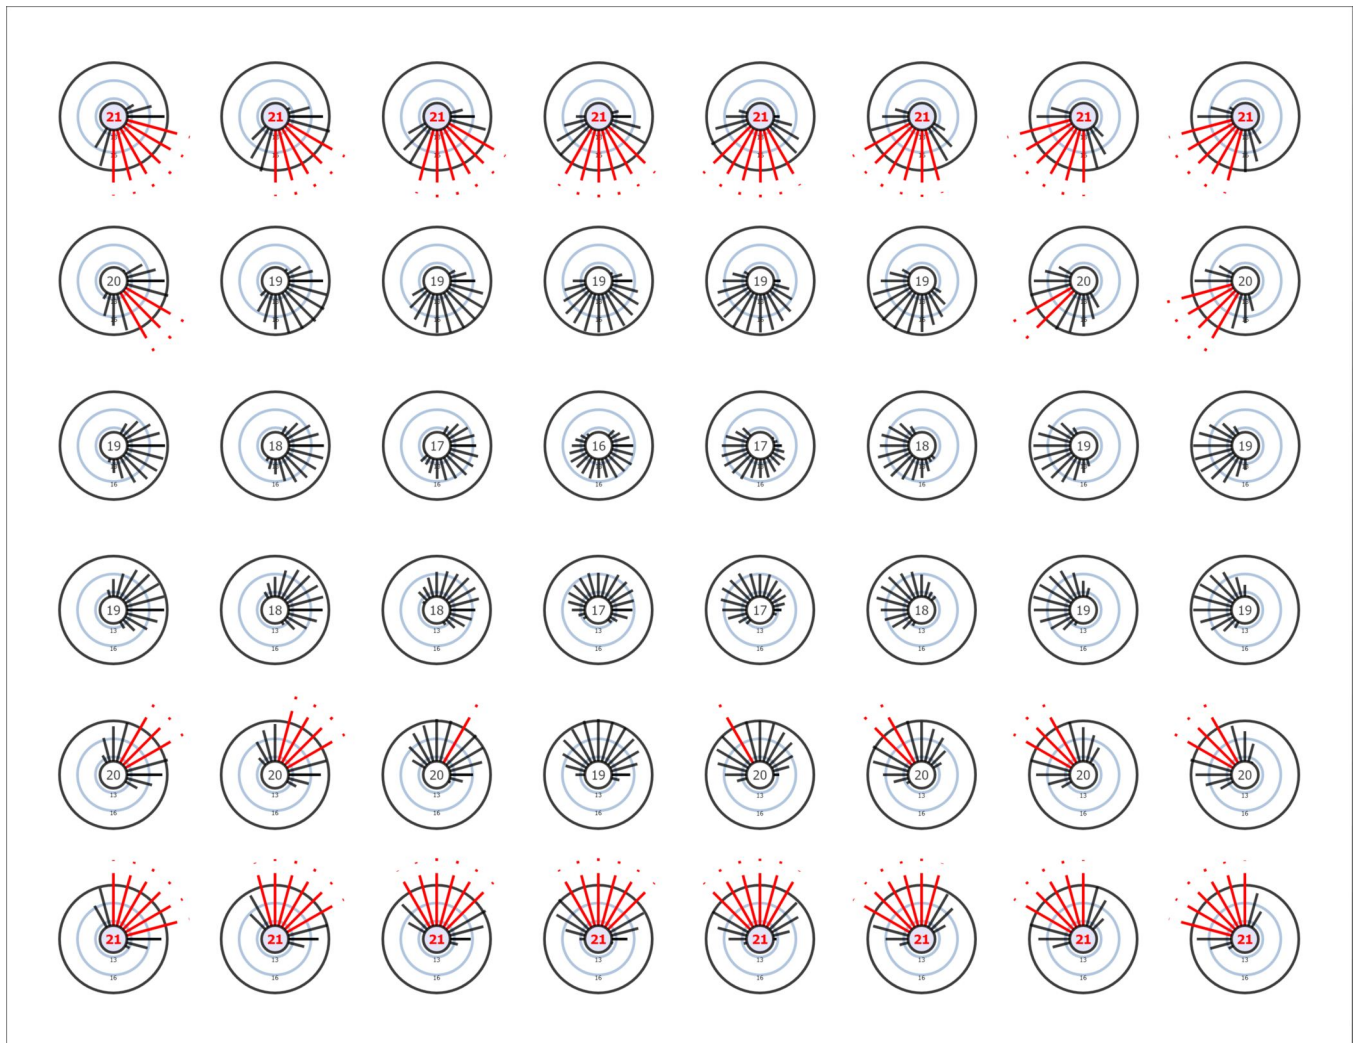

Building B · FIRST FOOR (Light scene 1)

## Calculation objects


212 Office (RUG)

|                    |           |
|--------------------|-----------|
| Strongest glare at | 30°       |
| max                | 18.6      |
| Target             | ≤ 19.0    |
| Viewing sector     | 0° - 360° |
| Step width         | 15°       |
| Height             | 1.200 m   |
| Index              | CG12      |

Building B · FIRST FOOR (Light scene 1)


## Calculation objects

212 Office (RUG)

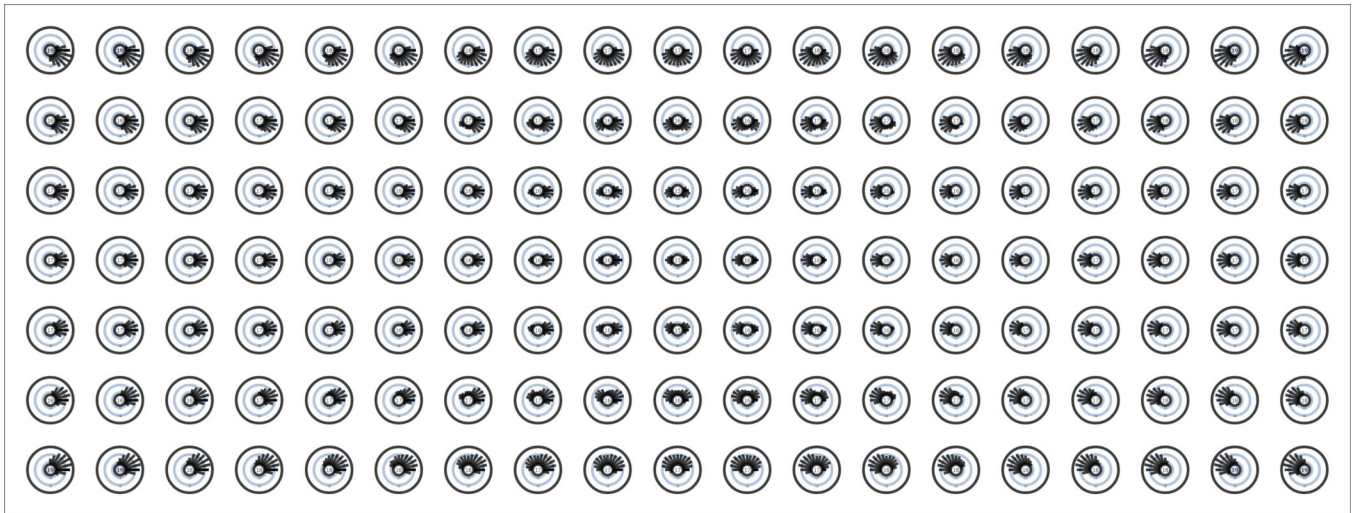


Building B · FIRST FOOR · 201 STAIRS

## Luminaire layout plan

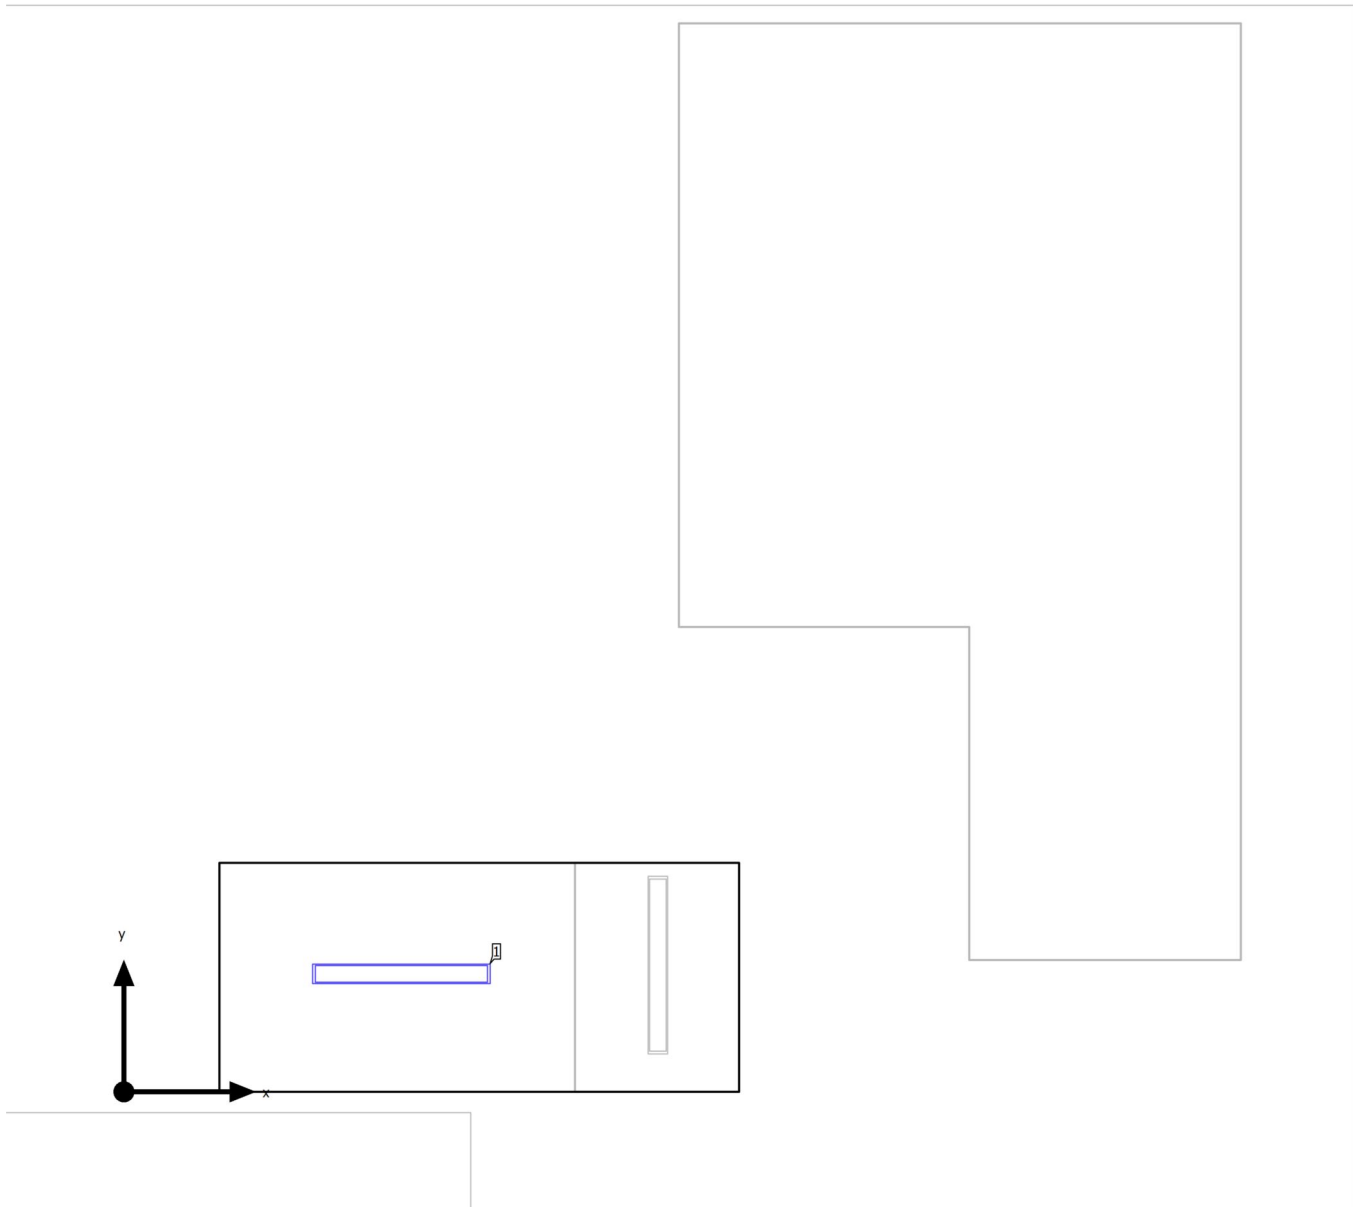

Building B · FIRST FOOR · 201 STAIRS

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 2.000 m | 0.850 m | 3.300 m         | 1         |

Building B · FIRST FOOR · 201 STAIRS


**Luminaire list**

|                                  |                              |                                |
|----------------------------------|------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>4663 lm | $P_{\text{total}}$<br>76.0 W | Luminous efficacy<br>61.4 lm/W |
|----------------------------------|------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Summary

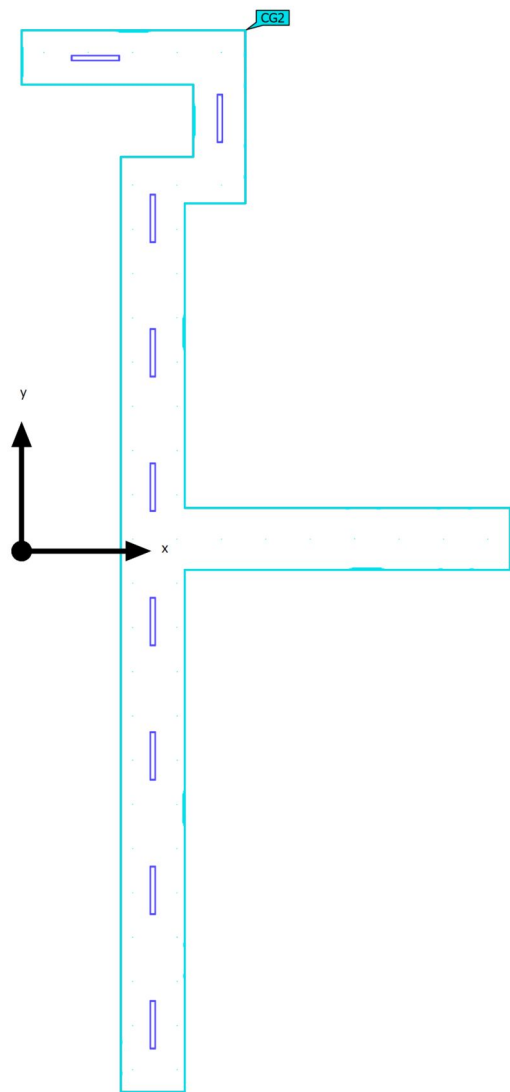

|                    |                                                     |                  |         |
|--------------------|-----------------------------------------------------|------------------|---------|
| Ground area        | 69.35 m²                                            |                  |         |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % | Clearance height | 3.300 m |
| Maintenance factor | 0.76 (fixed)                                        | Mounting height  | 3.300 m |

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated            | Target          | Check | Index |
|----------------------------------|------------------------|-----------------------|-----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 31                    | ≤ 19            | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | [1275 - 1693] kWh/a   | max. 2450 kWh/a | ✓     |       |
| Space                            | Lighting power density | 9.86 W/m <sup>2</sup> | –               |       |       |

(1) Based on a rectangular space of 28.146 m x 12.950 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 9    | Philips      |             | 2x36W        | 31              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 202 CORRIDOR

## Luminaire layout plan

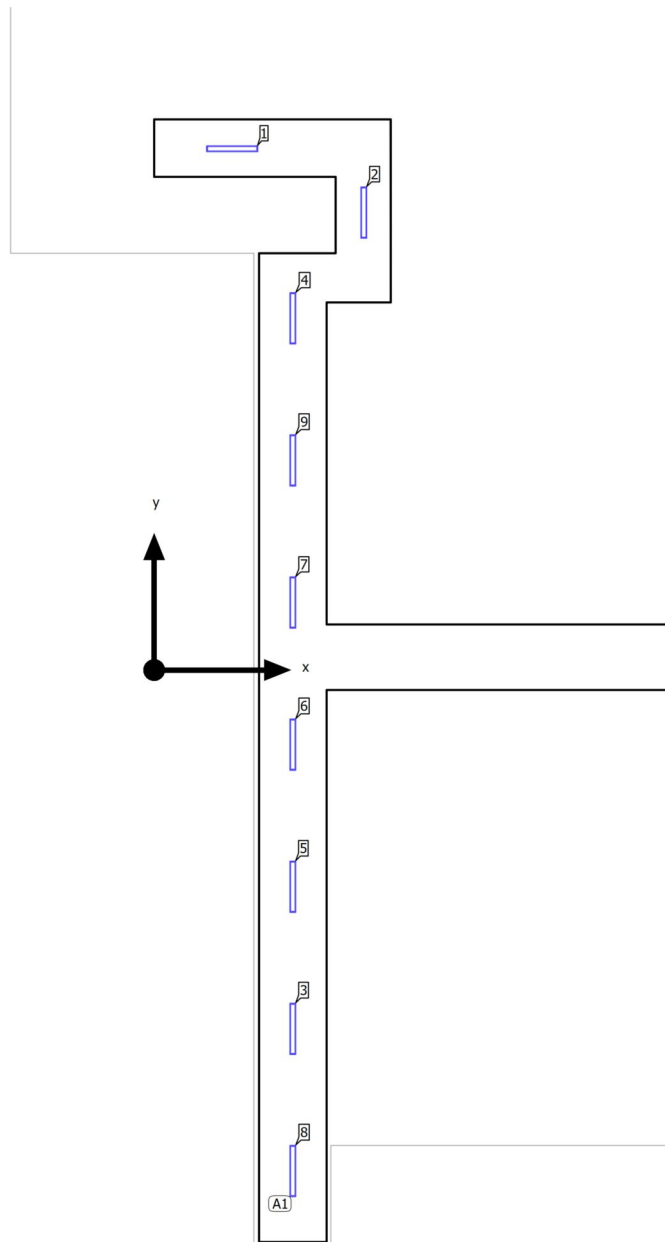

Building B · FIRST FOOR · 202 CORRIDOR

**Luminaire layout plan**

|              |               |                        |         |
|--------------|---------------|------------------------|---------|
| Manufacturer | Philips       | P                      | 76.0 W  |
| Article name | 2x36W         | Φ <sub>Luminaire</sub> | 4663 lm |
| Fitting      | 2x T8 36W/827 |                        |         |

**7 x Philips 2x36W**

| Type                  | Line arrangement                 | X       | Y         | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|-----------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 3.477 m / 8.819 m / 3.300 m      | 3.477 m | -8.996 m  | 3.300 m         | 3         |
| X-direction           | 7 pcs., Centre - centre, 3.563 m | 3.477 m | 8.819 m   | 3.300 m         | 4         |
| Arrangement           | A1                               | 3.477 m | -5.433 m  | 3.300 m         | 5         |
|                       |                                  | 3.477 m | -1.870 m  | 3.300 m         | 6         |
|                       |                                  | 3.477 m | 1.693 m   | 3.300 m         | 7         |
|                       |                                  | 3.477 m | -12.559 m | 3.300 m         | 8         |
|                       |                                  | 3.477 m | 5.256 m   | 3.300 m         | 9         |

**Individual luminaires**

| X       | Y        | Mounting height | Luminaire |
|---------|----------|-----------------|-----------|
| 1.956 m | 13.069 m | 3.300 m         | 1         |
| 5.256 m | 11.469 m | 3.300 m         | 2         |

Building B · FIRST FOOR · 202 CORRIDOR

**Luminaire list** $\Phi_{\text{total}}$ 

41967 lm

 $P_{\text{total}}$ 

684.0 W


Luminous efficacy

61.4 lm/W

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 9    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

### Calculation objects

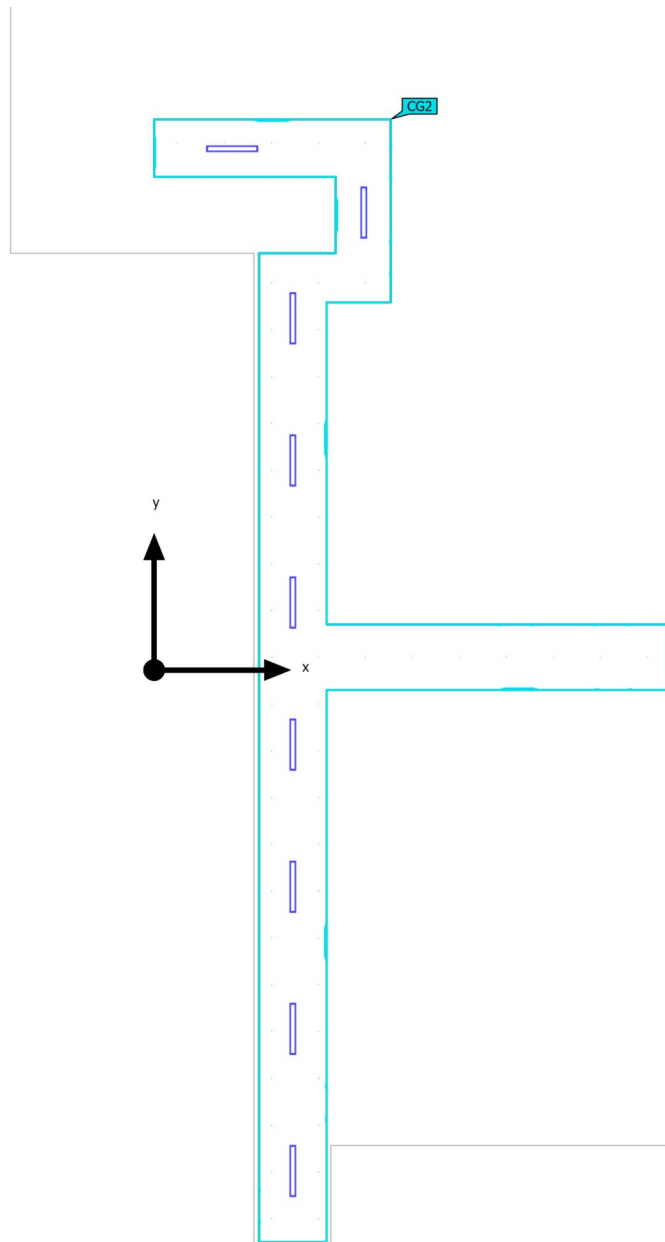

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

## Calculation objects


### Calculation surfaces

| Properties                                                   | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|--------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 202 Corridor<br>Perpendicular illuminance<br>Height: 0.000 m | 174 lx    | 9.95 lx   | 304 lx    | 0.057       | 0.033 | CG2   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

202 Corridor

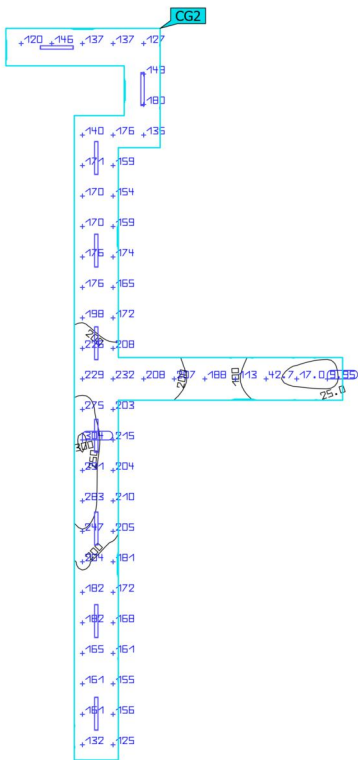


| Properties                                                   | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|--------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 202 Corridor<br>Perpendicular illuminance<br>Height: 0.000 m | 174 lx    | 9.95 lx   | 304 lx    | 0.057       | 0.033 | CG2   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Summary

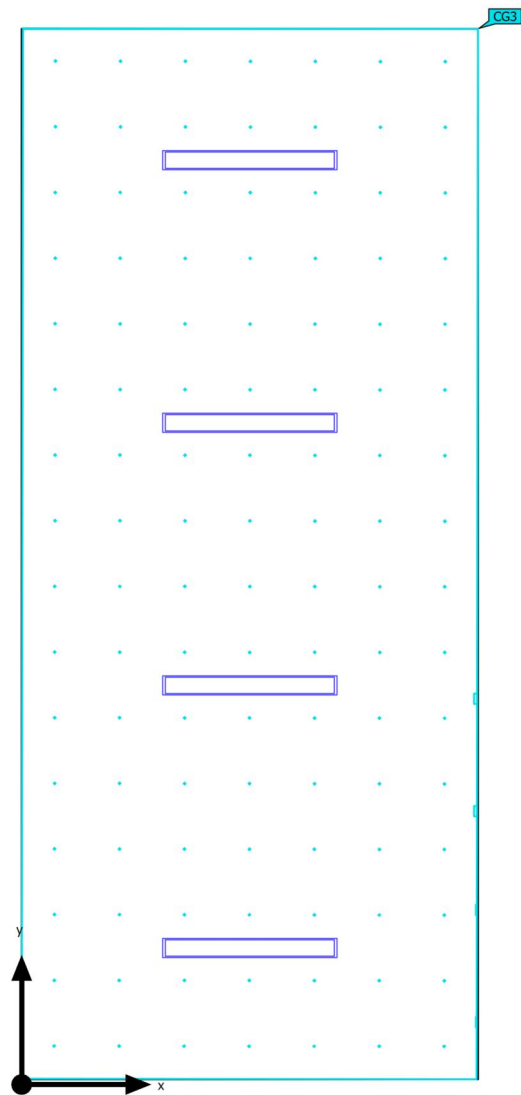

|                    |                                                     |                  |         |
|--------------------|-----------------------------------------------------|------------------|---------|
| Ground area        | 25.83 m²                                            |                  |         |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % | Clearance height | 3.300 m |
| Maintenance factor | 0.76 (fixed)                                        | Mounting height  | 3.300 m |

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target         | Check | Index |
|----------------------------------|------------------------|------------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 25                     | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | [474 - 752] kWh/a      | max. 950 kWh/a | ✓     |       |
| Space                            | Lighting power density | 11.77 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 3.350 m x 7.712 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 4    | Philips      |             | 2x36W        | 25              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 203 DIRECTOR

## Luminaire layout plan

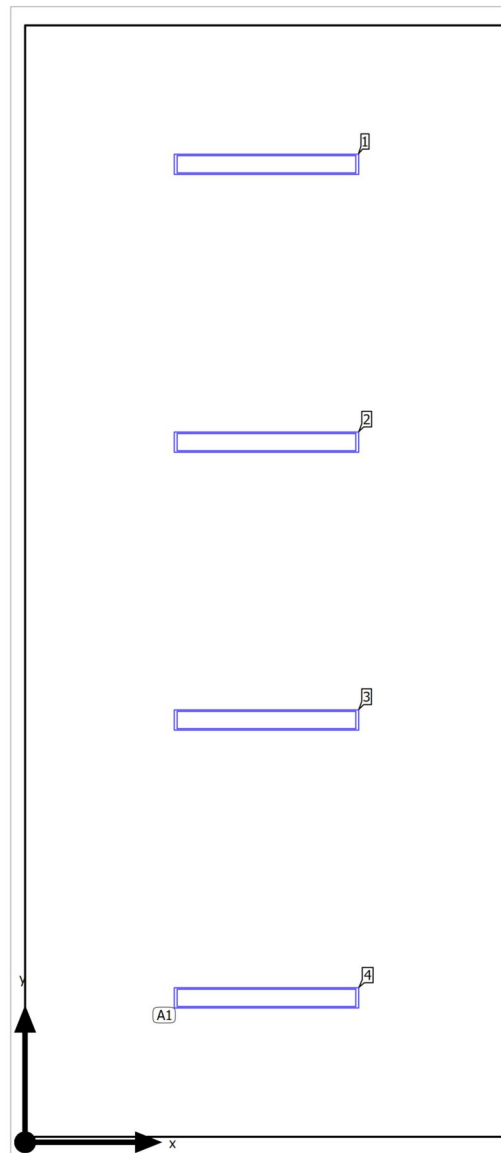

Building B · FIRST FOOR · 203 DIRECTOR

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

**4 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 1.675 m / 1.002 m / 3.300 m      | 1.675 m | 6.786 m | 3.300 m         | 1         |
| X-direction           | 1 pcs., Centre - centre, 3.350 m | 1.675 m | 4.858 m | 3.300 m         | 2         |
| Y-direction           | 4 pcs., Centre - centre, 1.928 m | 1.675 m | 2.930 m | 3.300 m         | 3         |
|                       |                                  | 1.675 m | 1.002 m | 3.300 m         | 4         |
| Arrangement           | A1                               |         |         |                 |           |

Building B · FIRST FOOR · 203 DIRECTOR


**Luminaire list**

|                                   |                               |                                |
|-----------------------------------|-------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>18652 lm | $P_{\text{total}}$<br>304.0 W | Luminous efficacy<br>61.4 lm/W |
|-----------------------------------|-------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 4    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

## Calculation objects

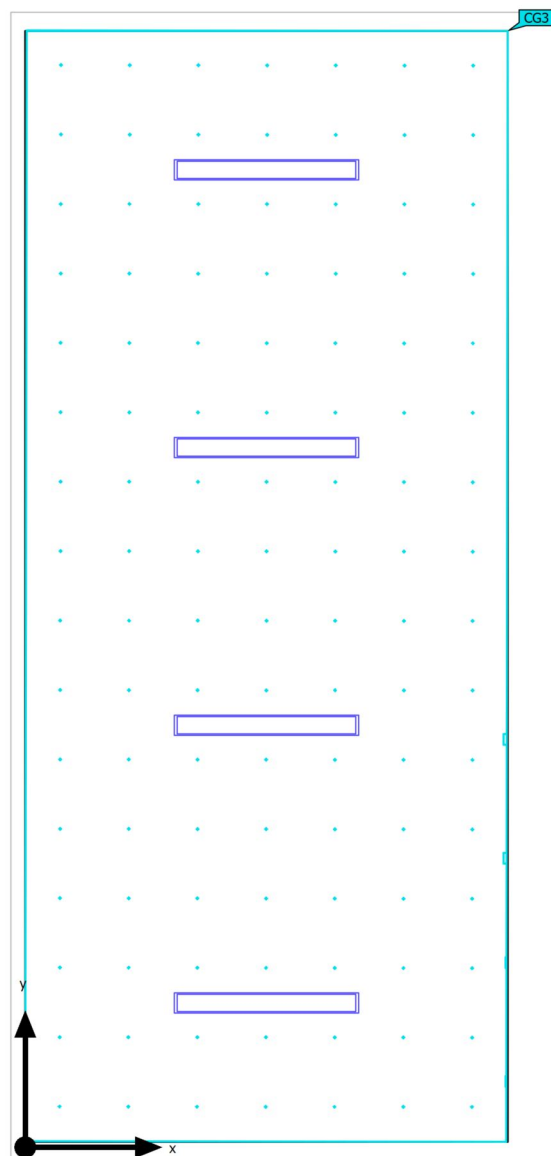

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

## Calculation objects


### Calculation surfaces

| Properties                                                   | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|--------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 203 Director<br>Perpendicular illuminance<br>Height: 0.700 m | 288 lx    | 191 lx    | 362 lx    | 0.66        | 0.53  | CG3   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

203 Director

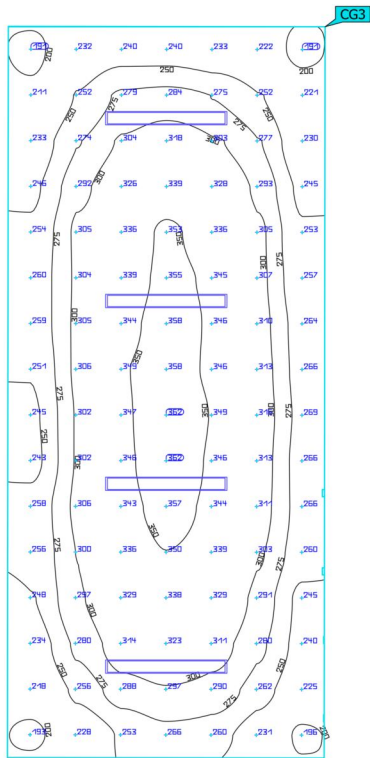


| Properties                                                   | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|--------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 203 Director<br>Perpendicular illuminance<br>Height: 0.700 m | 288 lx    | 191 lx    | 362 lx    | 0.66        | 0.53  | CG3   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203A DB (Light scene 1)

Summary

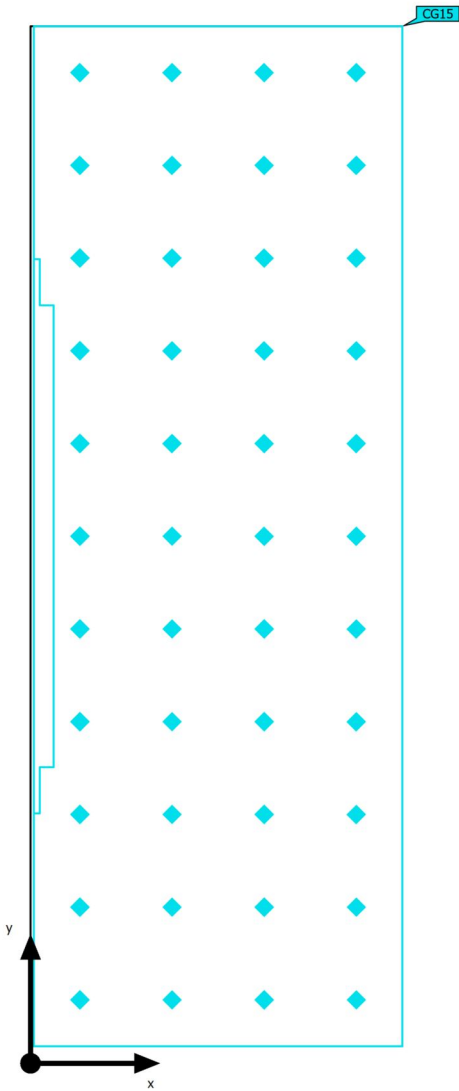

|                    |                                                     |                  |         |
|--------------------|-----------------------------------------------------|------------------|---------|
| Ground area        | 1.00 m <sup>2</sup>                                 |                  |         |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |                  |         |
| Maintenance factor | 0.76 (fixed)                                        | Clearance height | 3.300 m |

Building B · FIRST FOOR · 203A DB (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated            | Target        | Check | Index |
|----------------------------------|------------------------|-----------------------|---------------|-------|-------|
| Energy estimation <sup>(2)</sup> | Consumption            | 0.00 kWh/a            | max. 50 kWh/a | ✓     |       |
| Space                            | Lighting power density | 0.00 W/m <sup>2</sup> | –             |       |       |


(1) Based on a rectangular space of 1.656 m x 0.604 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203A DB (Light scene 1)

## Calculation objects

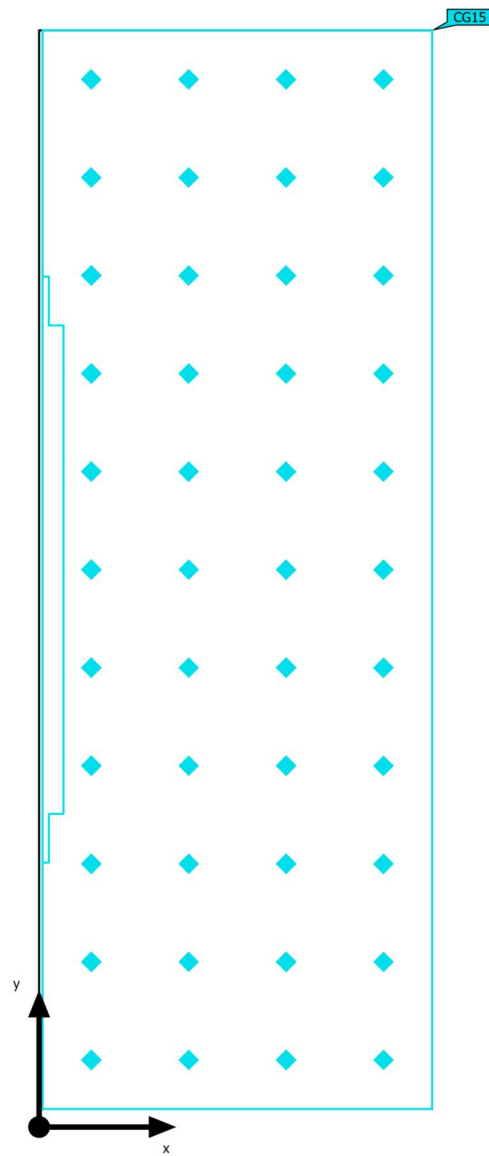

Building B · FIRST FOOR · 203A DB (Light scene 1)

## Calculation objects



### Calculation surfaces

| Properties                                              | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|---------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 203A DB<br>Perpendicular illuminance<br>Height: 0.000 m | 0.017 lx  | 0.00 lx   | 0.17 lx   | 0.00        | 0.00  | CG15  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203A DB (Light scene 1)

## 203A DB

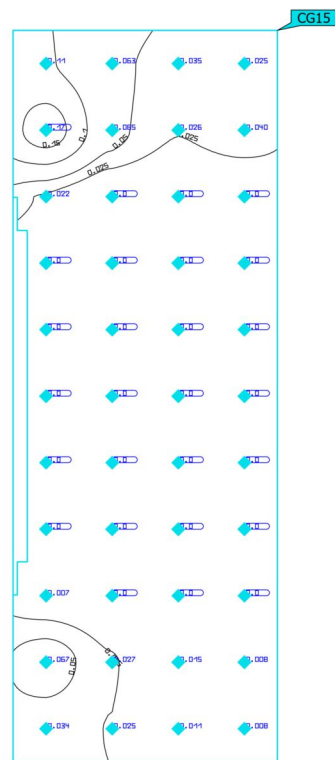


| Properties                                              | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o(g_1)$ | $g_2$ | Index |
|---------------------------------------------------------|-----------|-----------|-----------|------------|-------|-------|
| 203A DB<br>Perpendicular illuminance<br>Height: 0.000 m | 0.017 lx  | 0.00 lx   | 0.17 lx   | 0.00       | 0.00  | CG15  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Summary

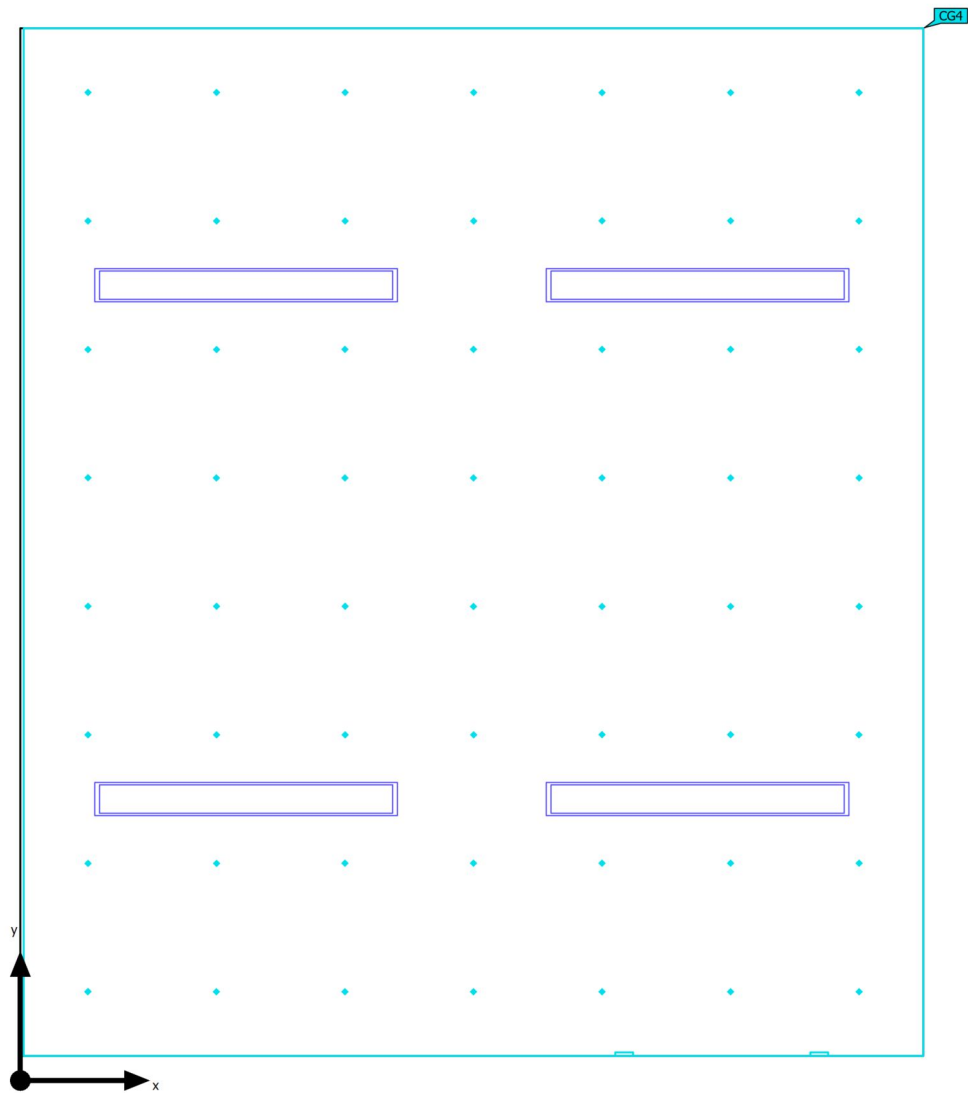

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 16.60 m²                                            |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                  |         |
|------------------|---------|
| Clearance height | 3.300 m |
| Mounting height  | 3.300 m |

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target         | Check | Index |
|----------------------------------|------------------------|------------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 21                     | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | [474 - 752] kWh/a      | max. 600 kWh/a | ✗     |       |
| Space                            | Lighting power density | 18.32 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 3.819 m x 4.346 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 4    | Philips      |             | 2x36W        | 21              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 204 MEETING

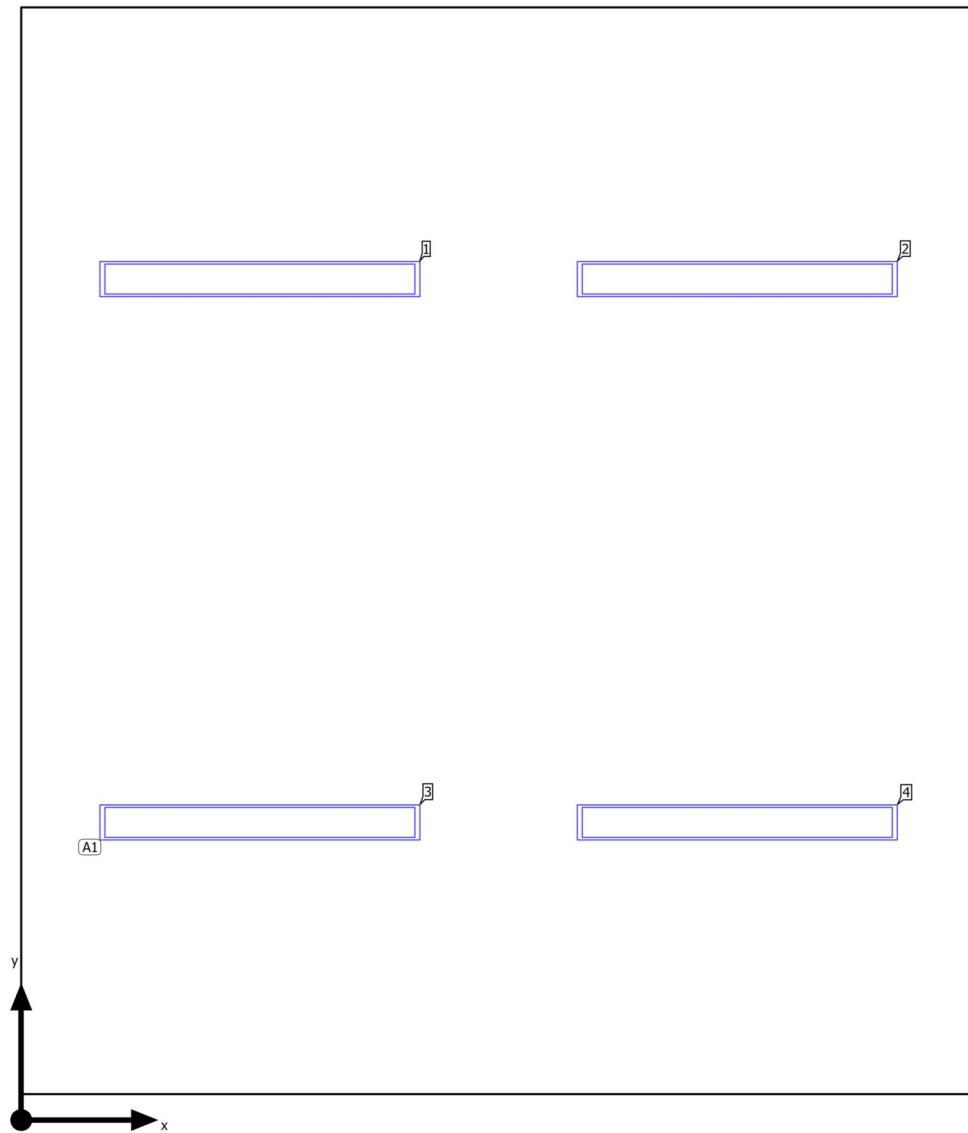**Luminaire layout plan**

Building B · FIRST FOOR · 204 MEETING

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

**4 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 0.955 m / 1.190 m / 3.300 m      | 0.955 m | 3.363 m | 3.300 m         | 1         |
| X-direction           | 2 pcs., Centre - centre, 1.909 m | 2.864 m | 3.363 m | 3.300 m         | 2         |
| Y-direction           | 2 pcs., Centre - centre, 2.173 m | 0.955 m | 1.190 m | 3.300 m         | 3         |
|                       |                                  | 2.864 m | 1.190 m | 3.300 m         | 4         |
| Arrangement           | A1                               |         |         |                 |           |

Building B · FIRST FOOR · 204 MEETING

**Luminaire list** $\Phi_{\text{total}}$ 

18652 lm

 $P_{\text{total}}$ 

304.0 W


Luminous efficacy

61.4 lm/W

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 4    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

## Calculation objects

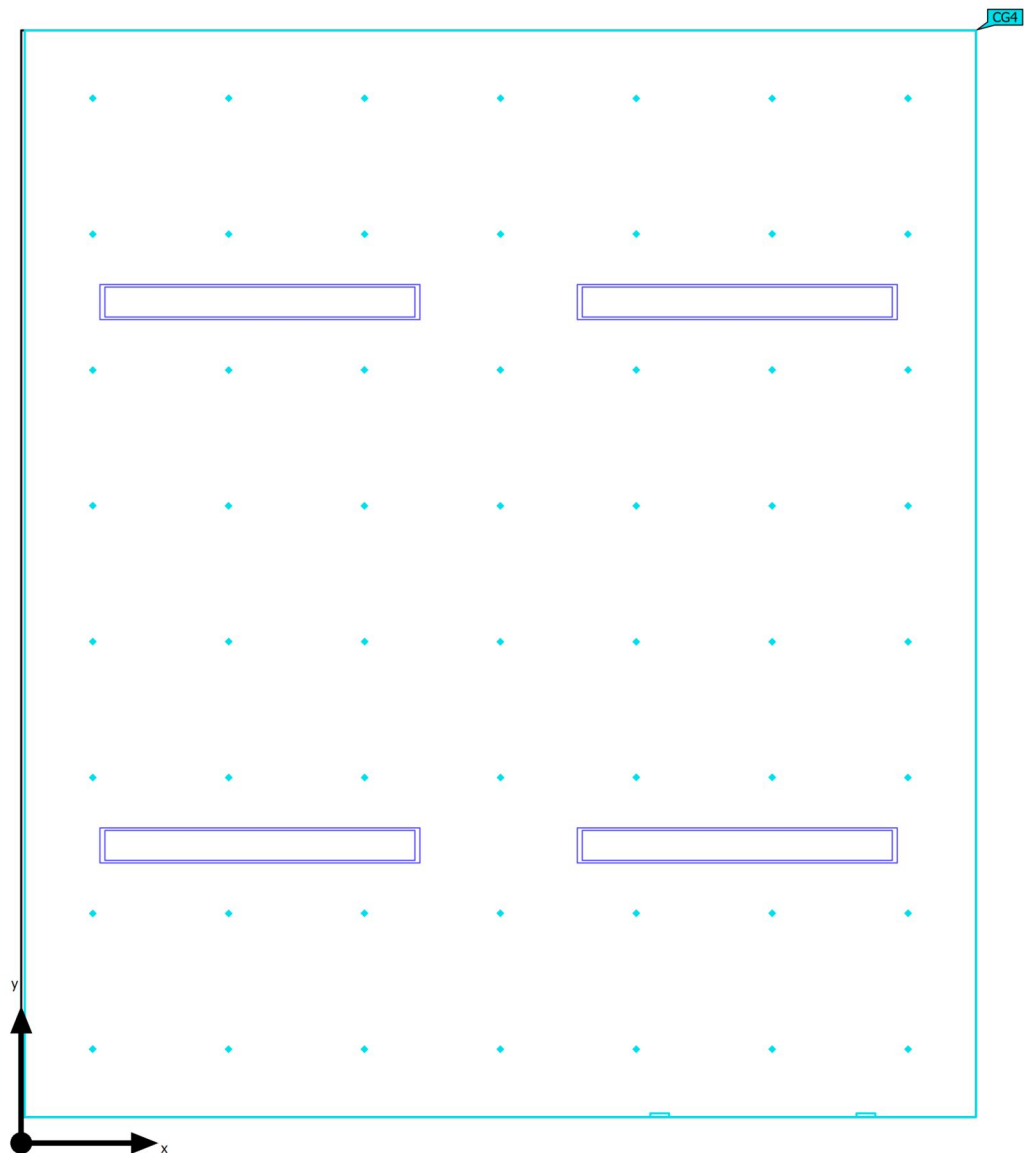

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

## Calculation objects



### Calculation surfaces

| Properties                                                  | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|-------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 204 Meeting<br>Perpendicular illuminance<br>Height: 0.700 m | 385 lx    | 288 lx    | 460 lx    | 0.75        | 0.63  | CG4   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

204 Meeting

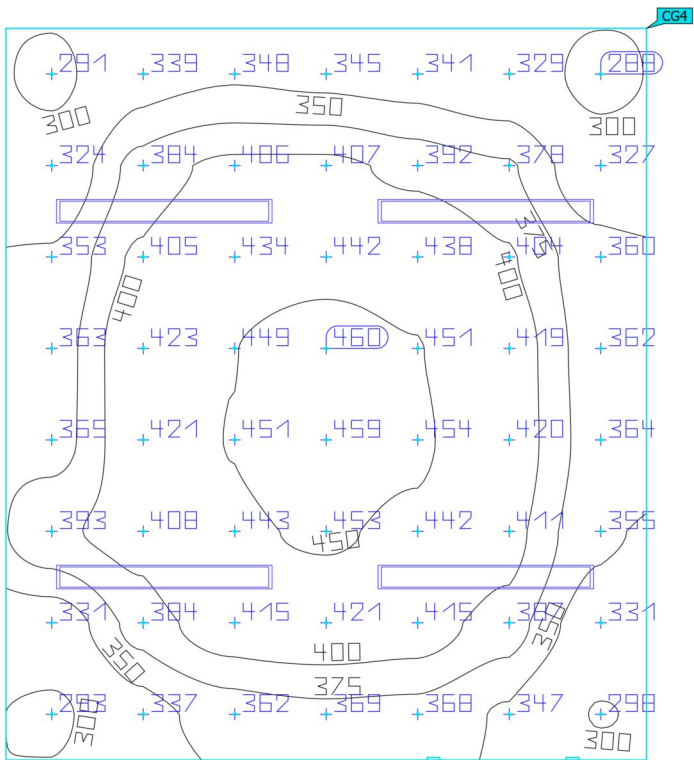


| Properties                                                  | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|-------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 204 Meeting<br>Perpendicular illuminance<br>Height: 0.700 m | 385 lx    | 288 lx    | 460 lx    | 0.75        | 0.63  | CG4   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Summary

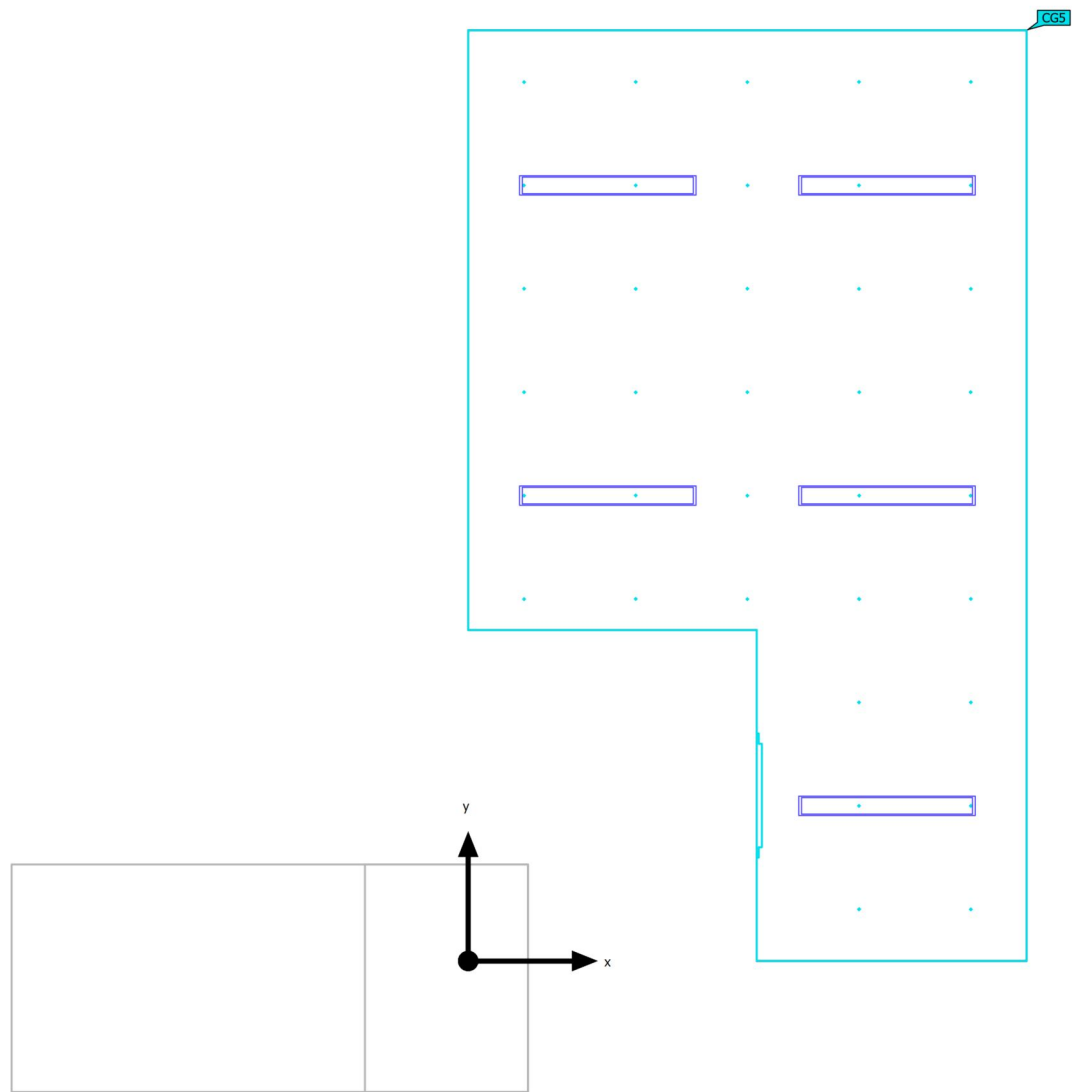

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 22.32 m²                                            |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                  |         |
|------------------|---------|
| Clearance height | 3.300 m |
| Mounting height  | 3.300 m |

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target         | Check | Index |
|----------------------------------|------------------------|------------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 23                     | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | [593 - 941] kWh/a      | max. 800 kWh/a | ✗     |       |
| Space                            | Lighting power density | 17.03 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 6.750 m x 4.050 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 5    | Philips      |             | 2x36W        | 23              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 205 OFFICE

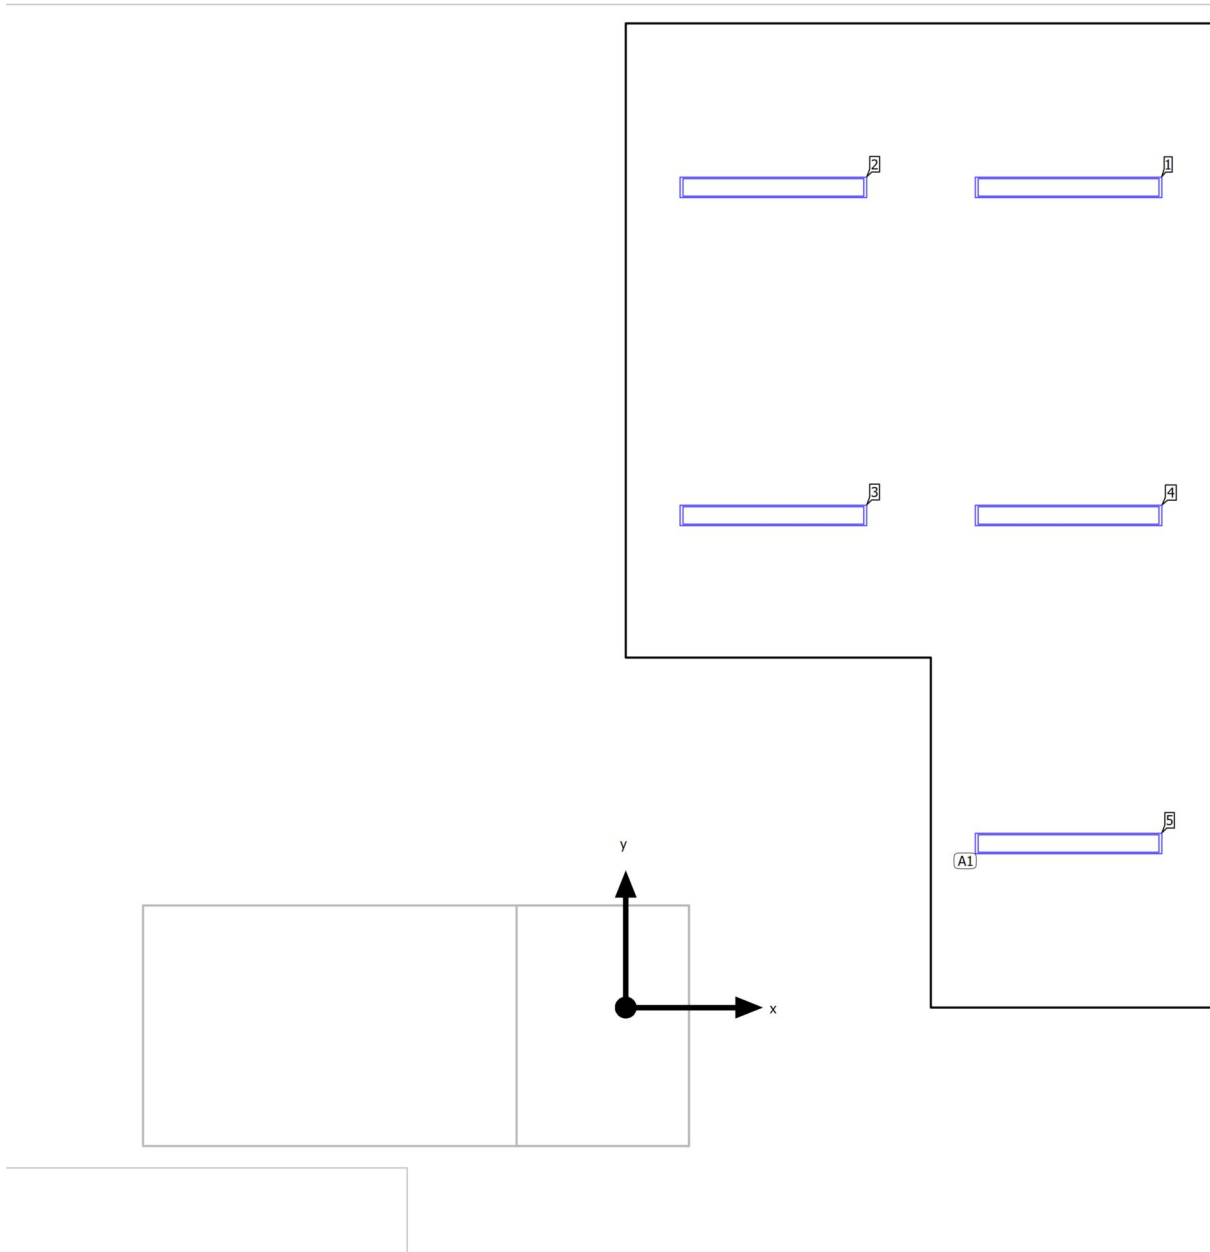**Luminaire layout plan**

Building B · FIRST FOOR · 205 OFFICE

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

**5 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 3.037 m / 1.125 m / 3.300 m      | 3.037 m | 5.625 m | 3.300 m         | 1         |
| X-direction           | 2 pcs., Centre - centre, 2.025 m | 1.012 m | 5.625 m | 3.300 m         | 2         |
| Y-direction           | 3 pcs., Centre - centre, 2.250 m | 1.012 m | 3.375 m | 3.300 m         | 3         |
|                       |                                  | 3.037 m | 3.375 m | 3.300 m         | 4         |
| Arrangement           | A1                               | 3.037 m | 1.125 m | 3.300 m         | 5         |

Building B · FIRST FOOR · 205 OFFICE


**Luminaire list**

|                                   |                               |                                |
|-----------------------------------|-------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>23315 lm | $P_{\text{total}}$<br>380.0 W | Luminous efficacy<br>61.4 lm/W |
|-----------------------------------|-------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 5    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

## Calculation objects

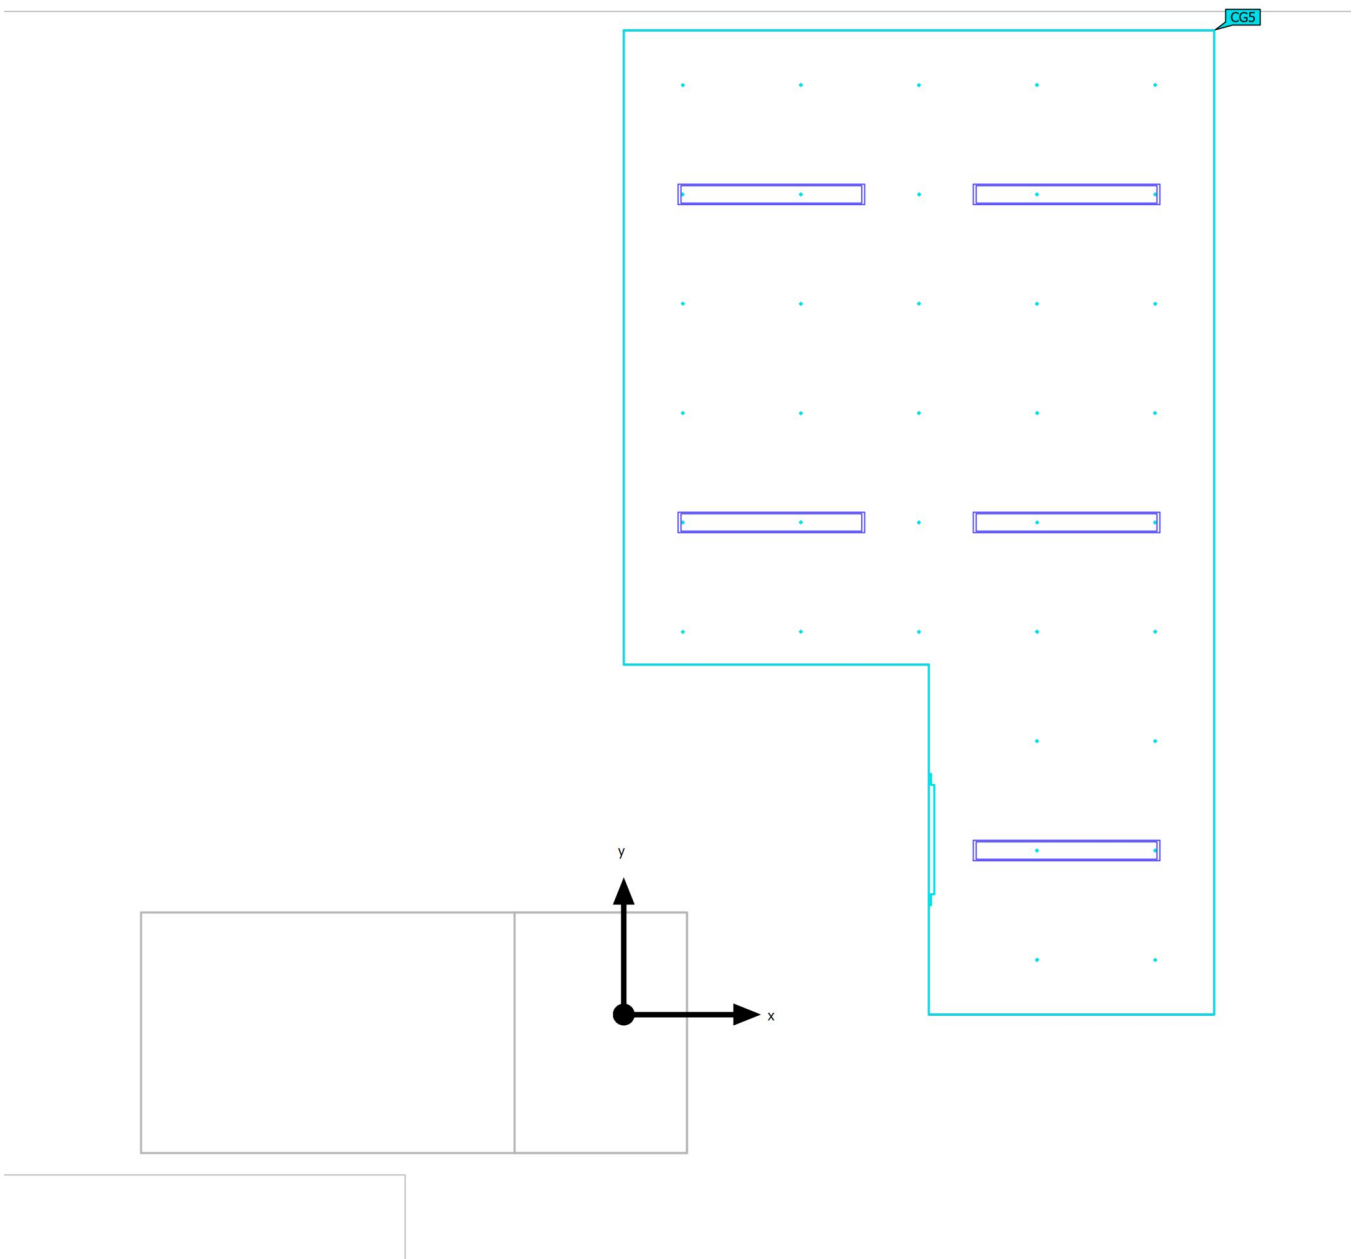

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

## Calculation objects

Calculation surfaces

| Properties                                                 | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 205 Office<br>Perpendicular illuminance<br>Height: 0.700 m | 376 lx    | 267 lx    | 460 lx    | 0.71        | 0.58  | CG5   |

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

## Calculation objects


205 Office (RUG)

|                    |           |
|--------------------|-----------|
| Strongest glare at | 105°      |
| max                | 22.7      |
| Target             | ≤ 19.0    |
| Viewing sector     | 0° - 360° |
| Step width         | 15°       |
| Height             | 1.200 m   |
| Index              | CG5       |

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

## Calculation objects



205 Office (RUG)

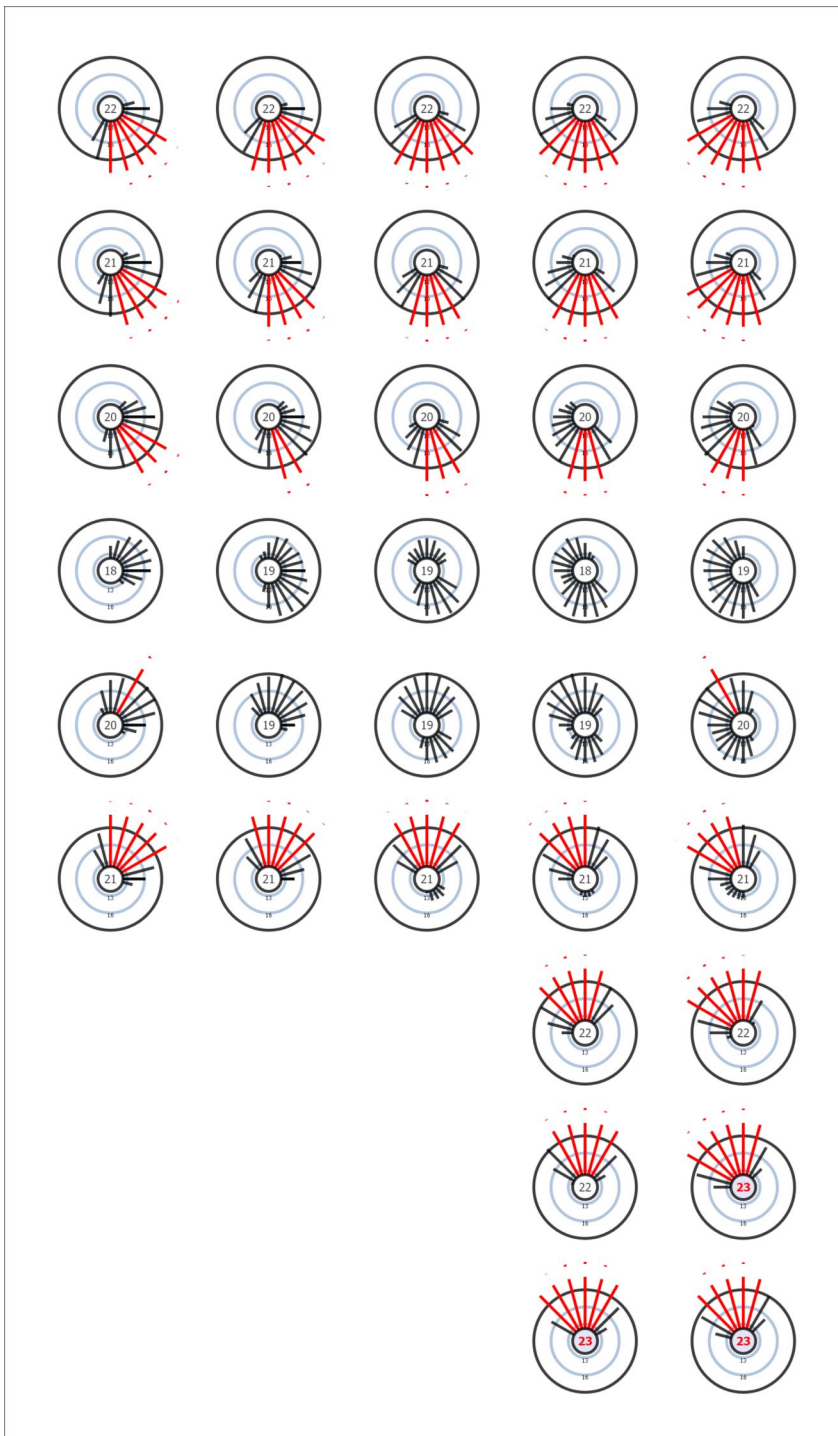

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

205 Office

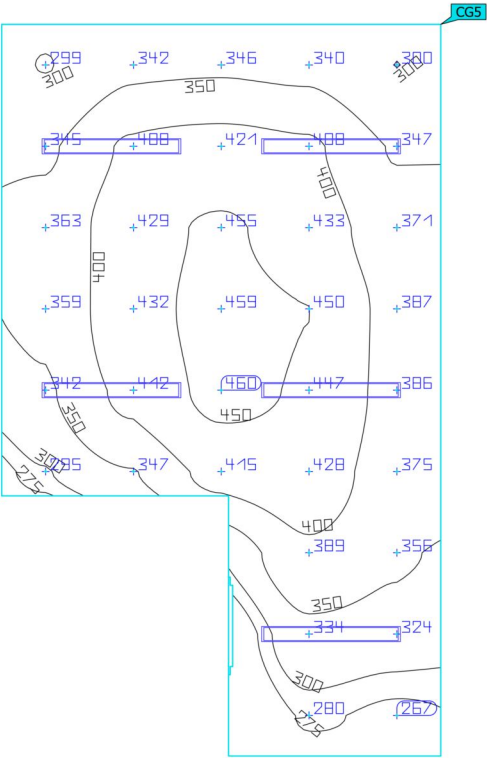


| Properties                                                 | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 205 Office<br>Perpendicular illuminance<br>Height: 0.700 m | 376 lx    | 267 lx    | 460 lx    | 0.71        | 0.58  | CG5   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Summary

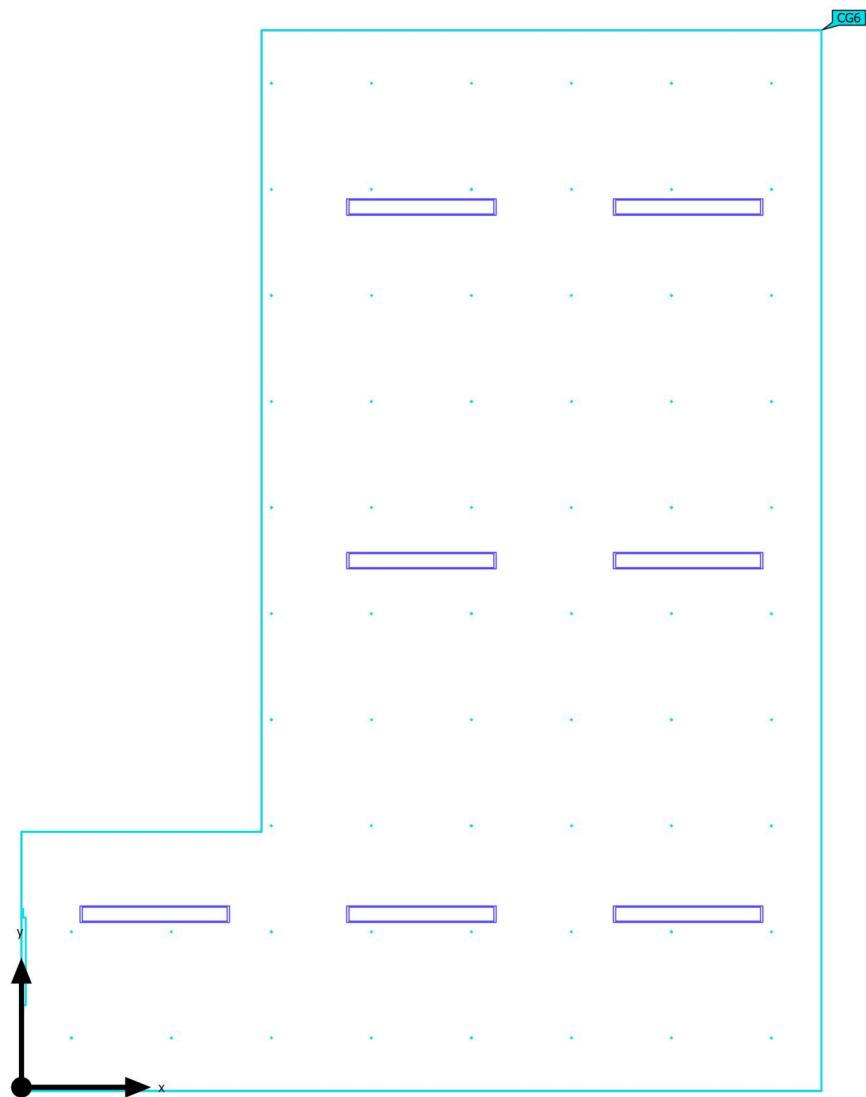

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 48.10 m²                                            |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                  |         |
|------------------|---------|
| Clearance height | 3.300 m |
| Mounting height  | 3.300 m |

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target          | Check | Index |
|----------------------------------|------------------------|------------------------|-----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 26                     | ≤ 19            | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | [830 - 1317] kWh/a     | max. 1700 kWh/a | ✓     |       |
| Space                            | Lighting power density | 11.06 W/m <sup>2</sup> | –               |       |       |

(1) Based on a rectangular space of 6.850 m x 9.082 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 7    | Philips      |             | 2x36W        | 26              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 206 KITCHEN

**Luminaire layout plan**

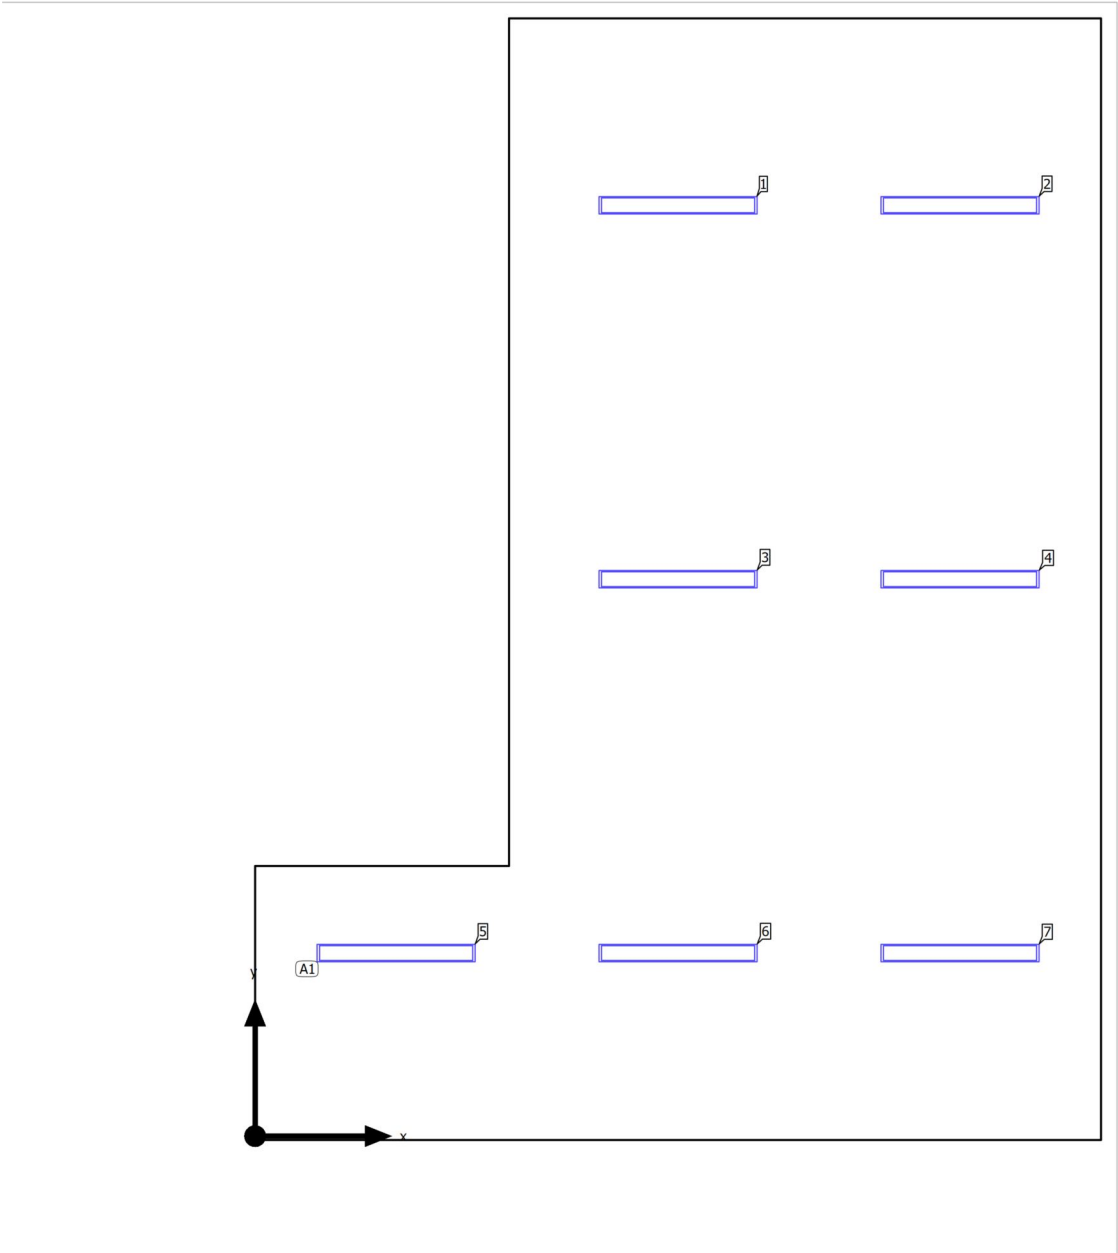

Building B · FIRST FOOR · 206 KITCHEN

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

**7 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 1.142 m / 1.482 m / 3.300 m      | 3.425 m | 7.536 m | 3.300 m         | 1         |
| X-direction           | 3 pcs., Centre - centre, 2.283 m | 5.708 m | 7.536 m | 3.300 m         | 2         |
| Y-direction           | 3 pcs., Centre - centre, 3.027 m | 3.425 m | 4.509 m | 3.300 m         | 3         |
|                       |                                  | 5.708 m | 4.509 m | 3.300 m         | 4         |
| Arrangement           | A1                               | 1.142 m | 1.482 m | 3.300 m         | 5         |
|                       |                                  | 3.425 m | 1.482 m | 3.300 m         | 6         |
|                       |                                  | 5.708 m | 1.482 m | 3.300 m         | 7         |

Building B · FIRST FOOR · 206 KITCHEN

**Luminaire list** $\Phi_{\text{total}}$ 

32641 lm

 $P_{\text{total}}$ 

532.0 W


Luminous efficacy

61.4 lm/W

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 7    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

## Calculation objects

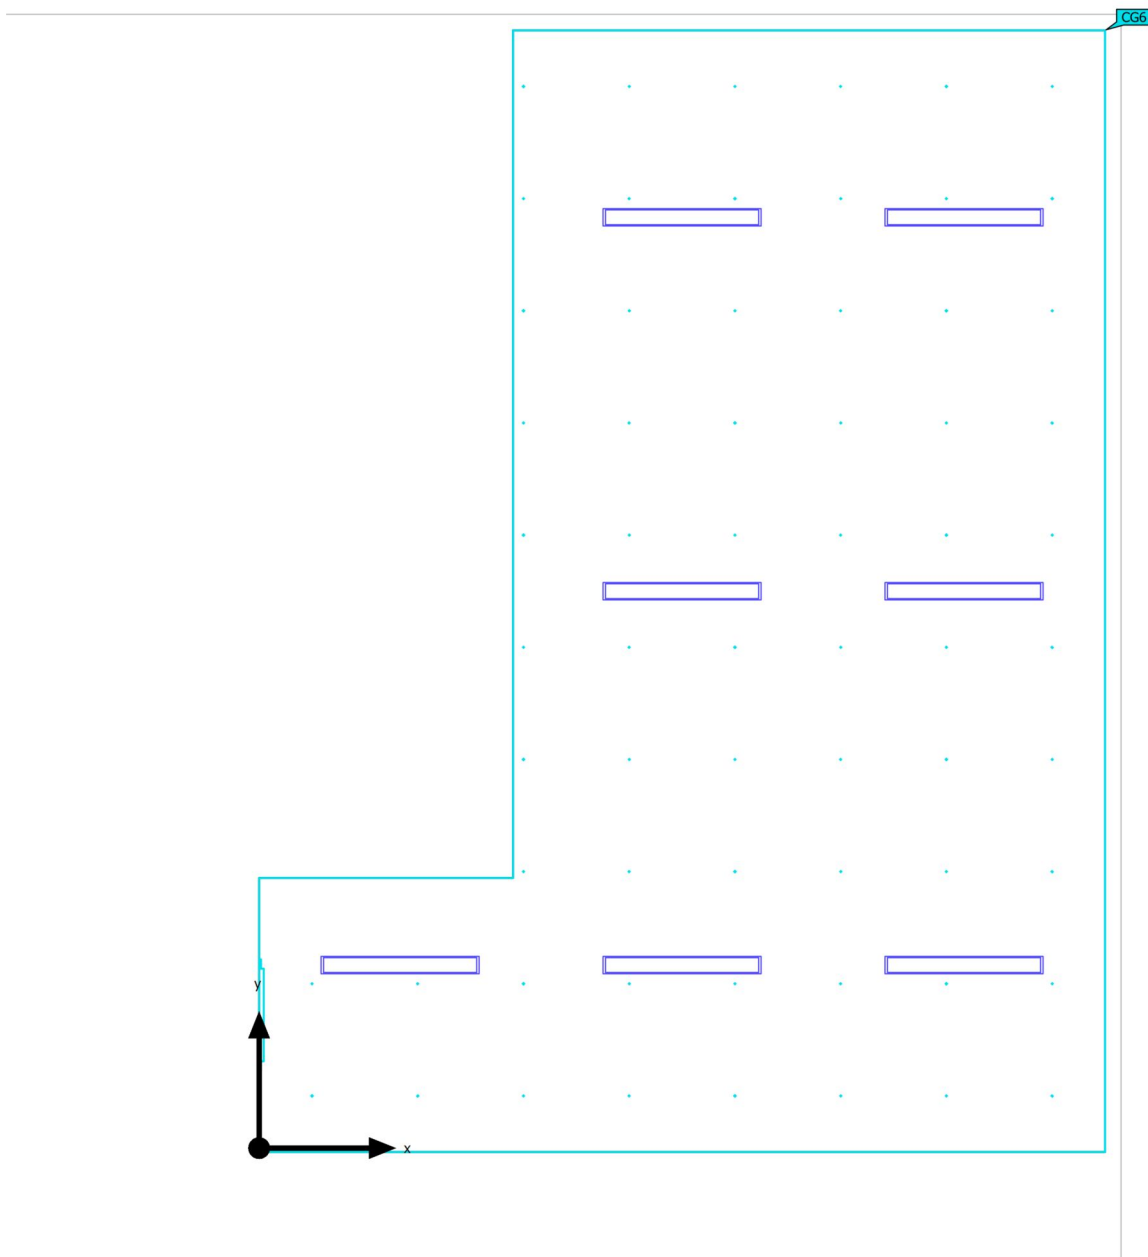

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

## Calculation objects



### Calculation surfaces

| Properties                                                  | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|-------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 206 Kitchen<br>Perpendicular illuminance<br>Height: 0.850 m | 310 lx    | 185 lx    | 383 lx    | 0.60        | 0.48  | CG6   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

206 Kitchen

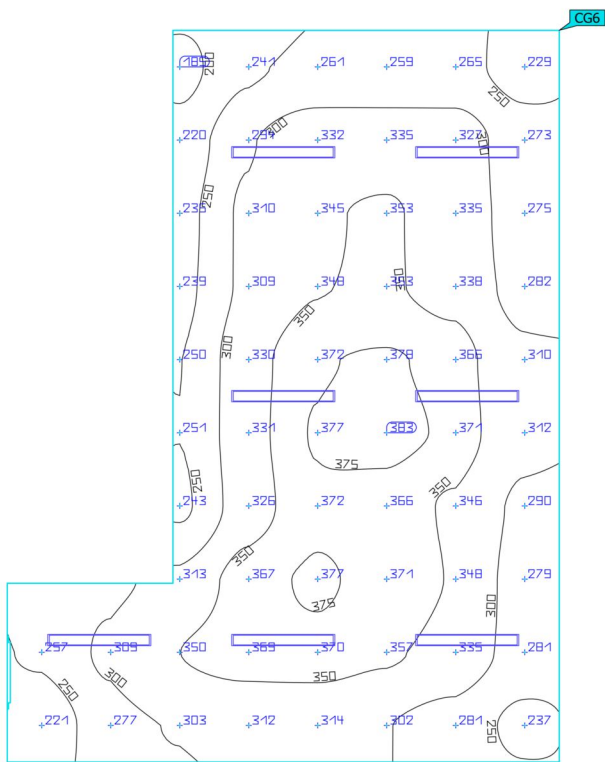


| Properties                                                  | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|-------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 206 Kitchen<br>Perpendicular illuminance<br>Height: 0.850 m | 310 lx    | 185 lx    | 383 lx    | 0.60        | 0.48  | CG6   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Summary

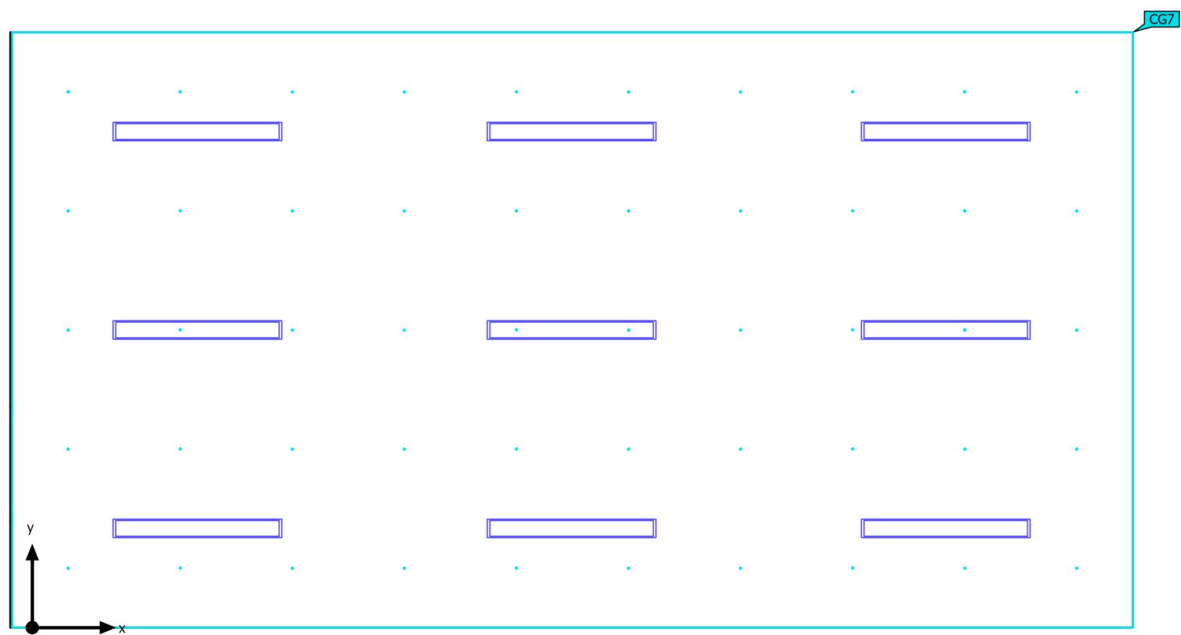

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 38.48 m²                                            |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                  |         |
|------------------|---------|
| Clearance height | 3.300 m |
| Mounting height  | 3.300 m |

Building B · FIRST FOOR · 207 CAD (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target          | Check | Index |
|----------------------------------|------------------------|------------------------|-----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 25                     | ≤ 19            | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | [1067 - 1693] kWh/a    | max. 1350 kWh/a | ✗     |       |
| Space                            | Lighting power density | 17.77 W/m <sup>2</sup> | –               |       |       |

(1) Based on a rectangular space of 8.516 m x 4.519 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 9    | Philips      |             | 2x36W        | 25              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 207 CAD

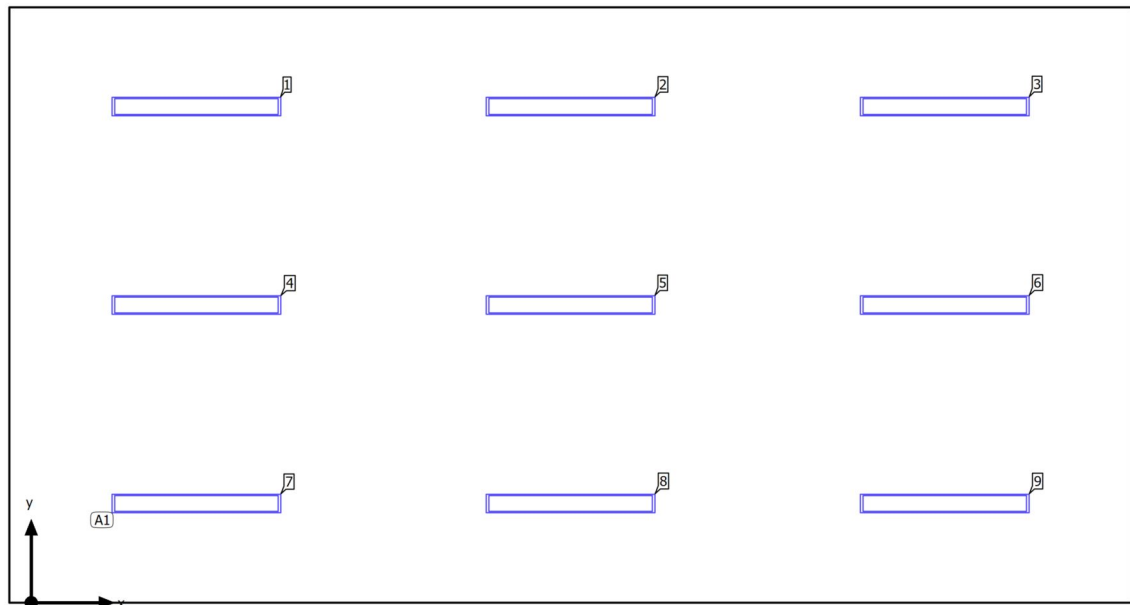**Luminaire layout plan**

Building B · FIRST FOOR · 207 CAD

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

**9 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 1.253 m / 0.753 m / 3.300 m      | 1.253 m | 3.766 m | 3.300 m         | 1         |
| X-direction           | 3 pcs., Centre - centre, 2.839 m | 4.092 m | 3.766 m | 3.300 m         | 2         |
| Y-direction           | 3 pcs., Centre - centre, 1.506 m | 6.931 m | 3.766 m | 3.300 m         | 3         |
| Arrangement           | A1                               | 1.253 m | 2.259 m | 3.300 m         | 4         |
|                       |                                  | 4.092 m | 2.259 m | 3.300 m         | 5         |
|                       |                                  | 6.931 m | 2.259 m | 3.300 m         | 6         |
|                       |                                  | 1.253 m | 0.753 m | 3.300 m         | 7         |
|                       |                                  | 4.092 m | 0.753 m | 3.300 m         | 8         |
|                       |                                  | 6.931 m | 0.753 m | 3.300 m         | 9         |

Building B · FIRST FOOR · 207 CAD

**Luminaire list** $\Phi_{\text{total}}$ 

41967 lm

 $P_{\text{total}}$ 

684.0 W


Luminous efficacy

61.4 lm/W

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 9    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 207 CAD (Light scene 1)

## Calculation objects

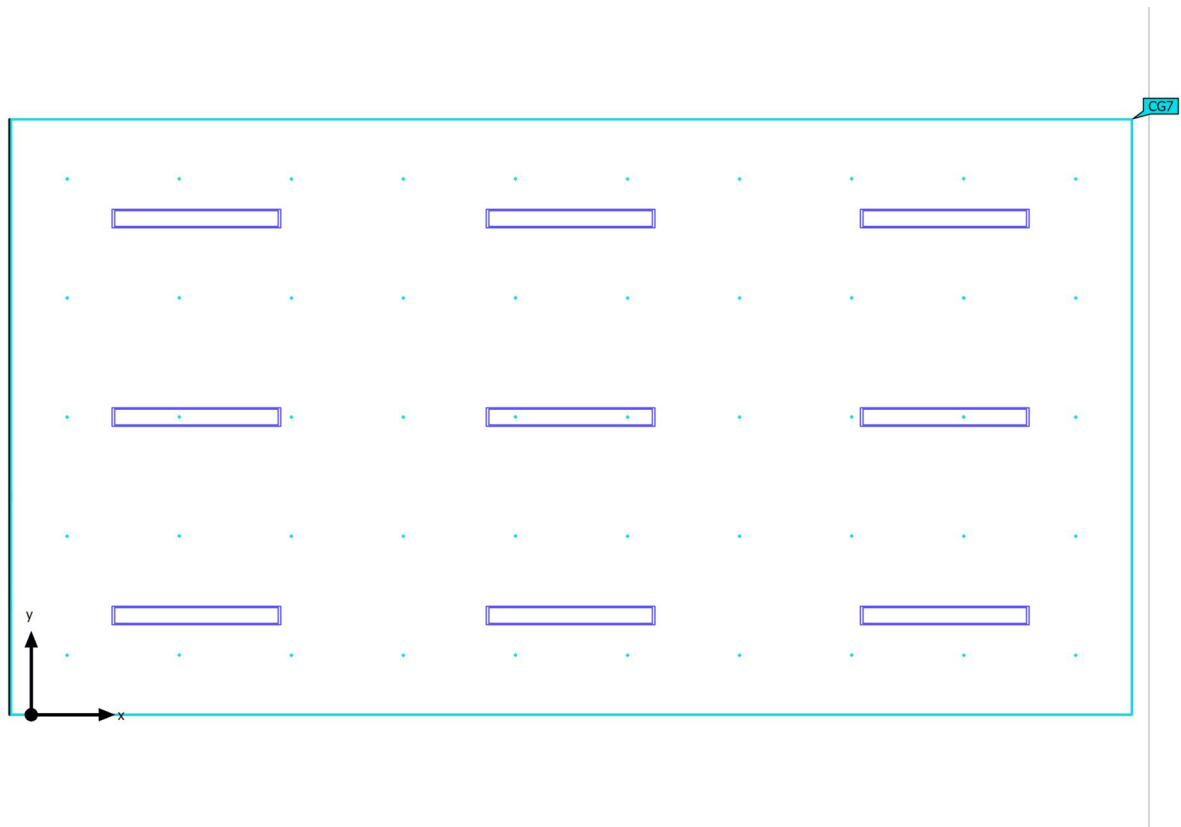

Building B · FIRST FOOR · 207 CAD (Light scene 1)

## Calculation objects

Calculation surfaces

| Properties                                              | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|---------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 207 CAD<br>Perpendicular illuminance<br>Height: 0.700 m | 473 lx    | 344 lx    | 570 lx    | 0.73        | 0.60  | CG7   |

Building B · FIRST FOOR · 207 CAD (Light scene 1)

## Calculation objects


207 CAD (RUG)

|                    |             |
|--------------------|-------------|
| Strongest glare at | 240°        |
| max                | 21.4        |
| Target             | $\leq 19.0$ |
| Viewing sector     | 0° - 360°   |
| Step width         | 15°         |
| Height             | 1.200 m     |
| Index              | CG7         |

Building B · FIRST FOOR · 207 CAD (Light scene 1)

## Calculation objects


207 CAD (RUG)

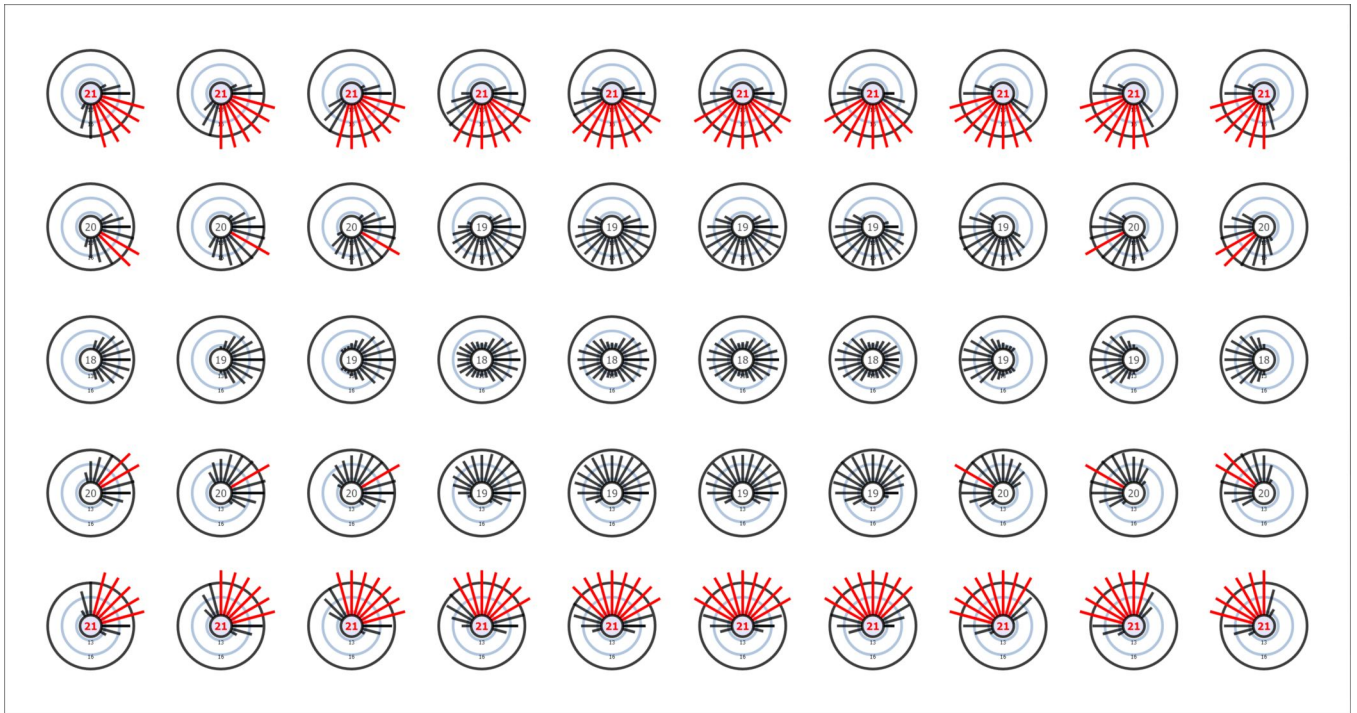

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 207 CAD (Light scene 1)

207 CAD

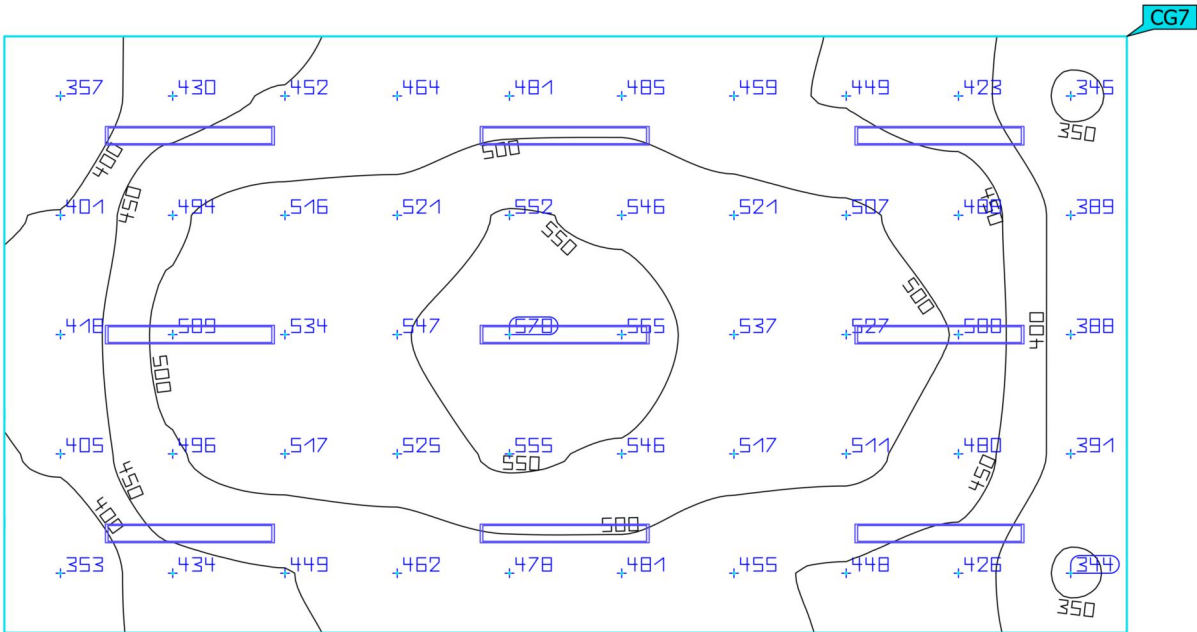


| Properties                                              | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|---------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 207 CAD<br>Perpendicular illuminance<br>Height: 0.700 m | 473 lx    | 344 lx    | 570 lx    | 0.73        | 0.60  | CG7   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Summary

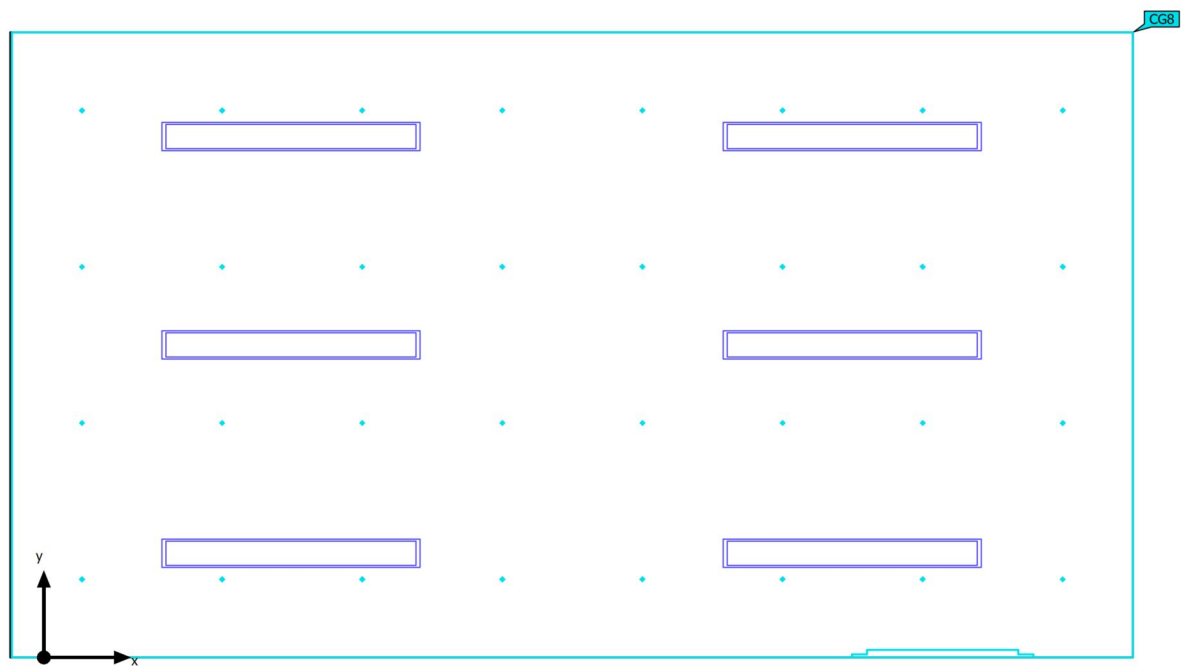

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 17.26 m²                                            |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                  |         |
|------------------|---------|
| Clearance height | 3.300 m |
| Mounting height  | 3.300 m |

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target         | Check | Index |
|----------------------------------|------------------------|------------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 23                     | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | 1129 kWh/a             | max. 650 kWh/a | ✗     |       |
| Space                            | Lighting power density | 26.43 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 5.566 m x 3.100 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 6    | Philips      |             | 2x36W        | 23              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 208 MEETING

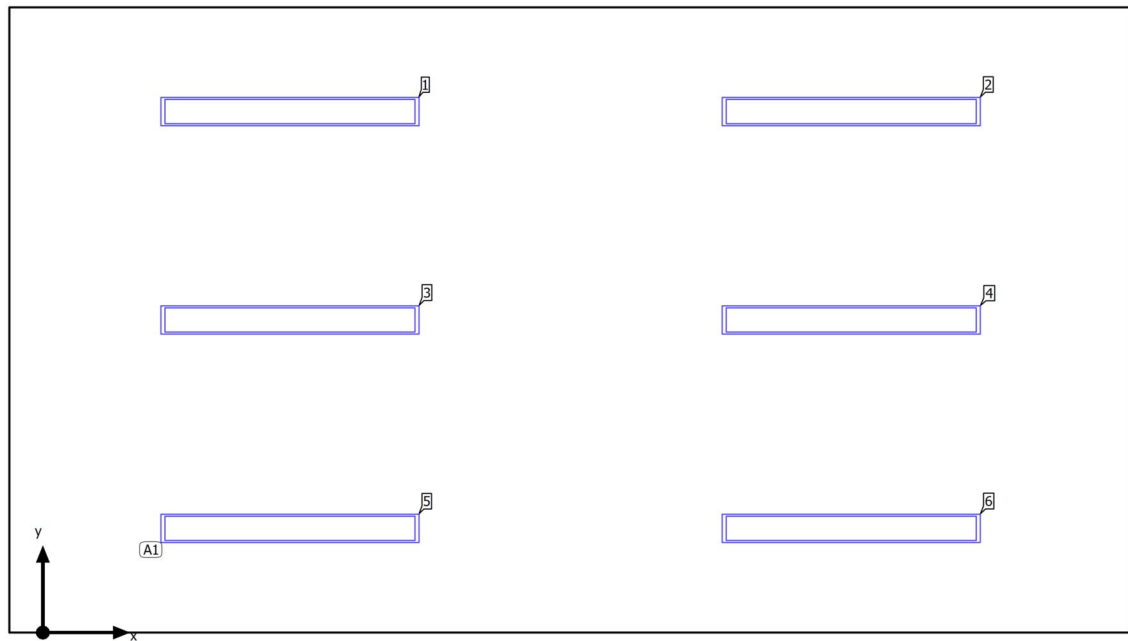**Luminaire layout plan**

Building B · FIRST FOOR · 208 MEETING

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

**6 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 1.225 m / 0.517 m / 3.300 m      | 1.225 m | 2.583 m | 3.300 m         | 1         |
| X-direction           | 2 pcs., Centre - centre, 2.783 m | 4.008 m | 2.583 m | 3.300 m         | 2         |
| Y-direction           | 3 pcs., Centre - centre, 1.033 m | 1.225 m | 1.550 m | 3.300 m         | 3         |
|                       |                                  | 4.008 m | 1.550 m | 3.300 m         | 4         |
| Arrangement           | A1                               | 1.225 m | 0.517 m | 3.300 m         | 5         |
|                       |                                  | 4.008 m | 0.517 m | 3.300 m         | 6         |

Building B · FIRST FOOR · 208 MEETING

**Luminaire list** $\Phi_{\text{total}}$ 

27978 lm

 $P_{\text{total}}$ 

456.0 W


Luminous efficacy

61.4 lm/W

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 6    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

## Calculation objects

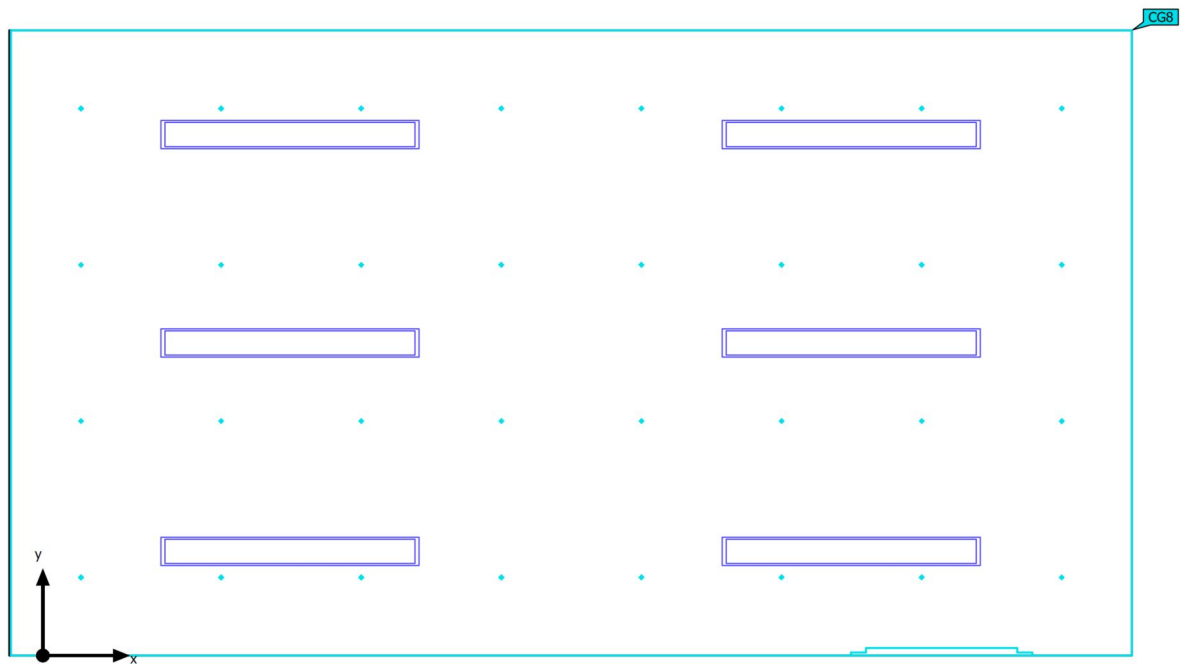

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

## Calculation objects


### Calculation surfaces

| Properties                                                  | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|-------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 208 Meeting<br>Perpendicular illuminance<br>Height: 0.700 m | 550 lx    | 426 lx    | 637 lx    | 0.77        | 0.67  | CG8   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

208 Meeting

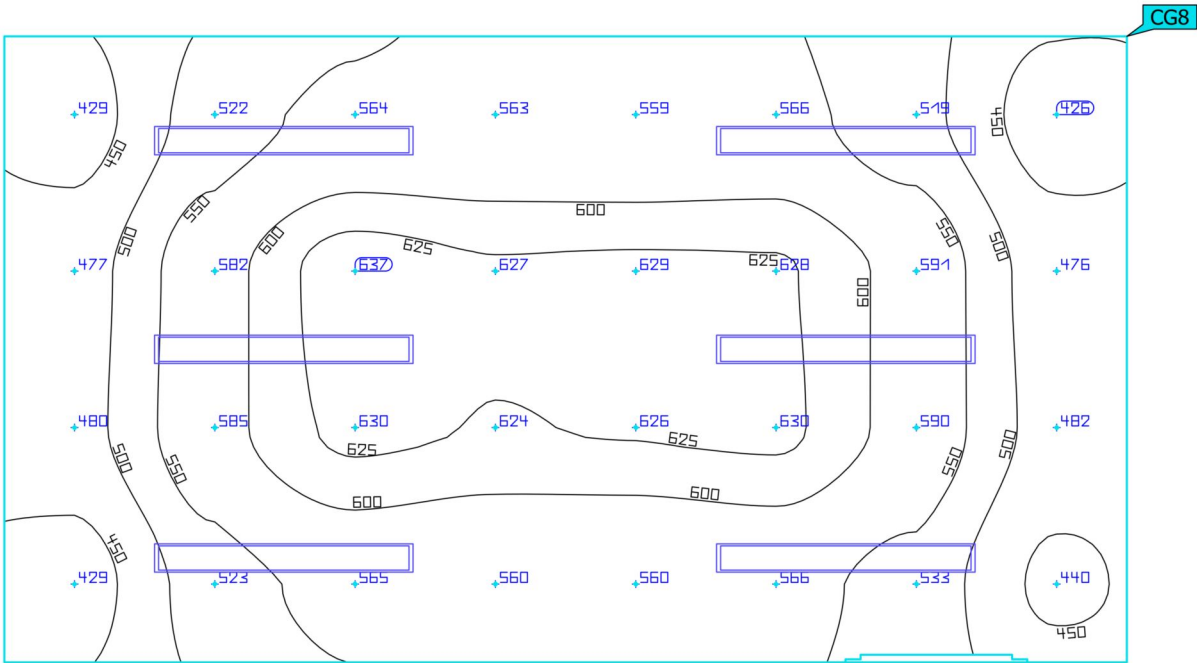


| Properties                                                  | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|-------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 208 Meeting<br>Perpendicular illuminance<br>Height: 0.700 m | 550 lx    | 426 lx    | 637 lx    | 0.77        | 0.67  | CG8   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Summary

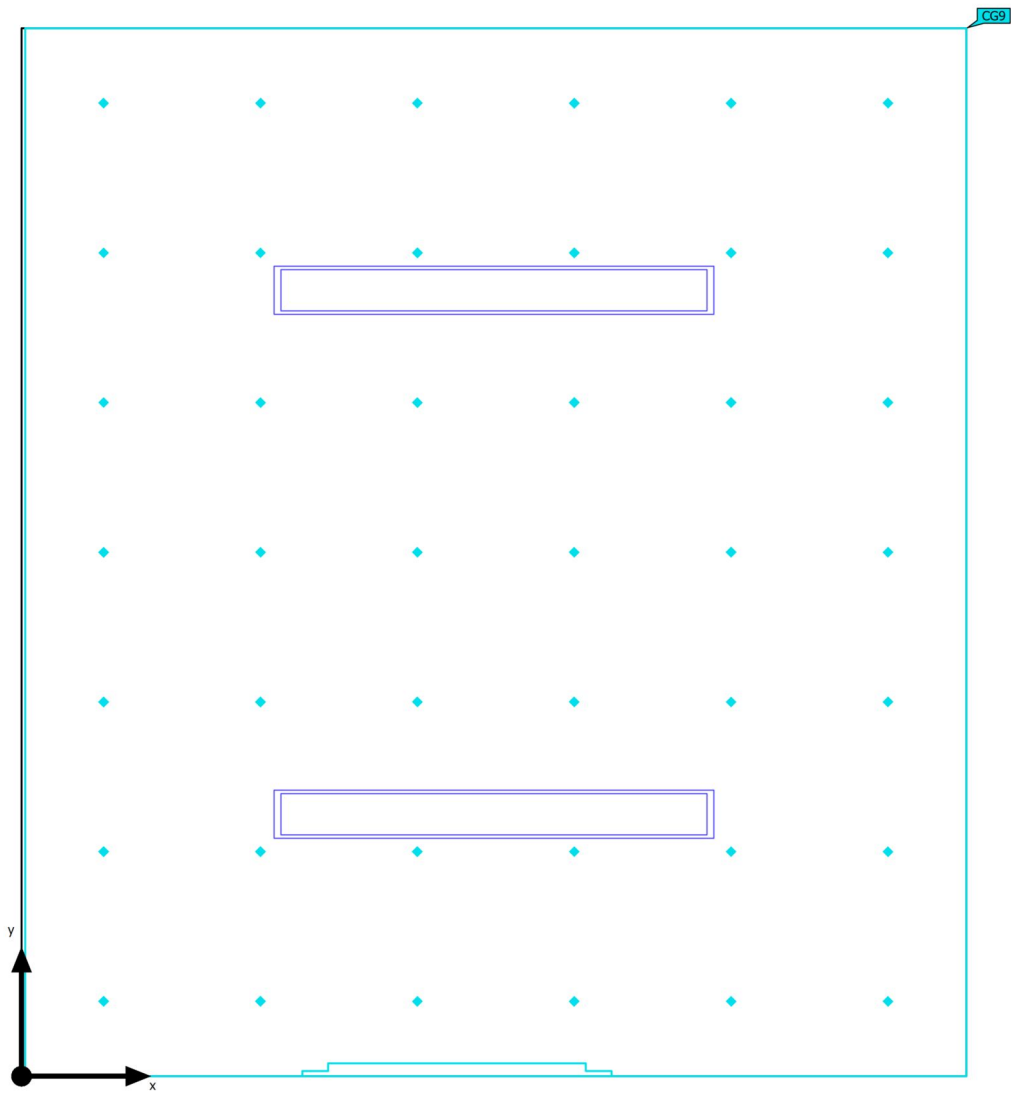

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 8.39 m²                                             |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                  |         |
|------------------|---------|
| Clearance height | 3.300 m |
| Mounting height  | 3.300 m |

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target         | Check | Index |
|----------------------------------|------------------------|------------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 21                     | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | [237 - 376] kWh/a      | max. 300 kWh/a | ✗     |       |
| Space                            | Lighting power density | 18.12 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 3.050 m x 2.750 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 2    | Philips      |             | 2x36W        | 21              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 209 TOILET

## Luminaire layout plan

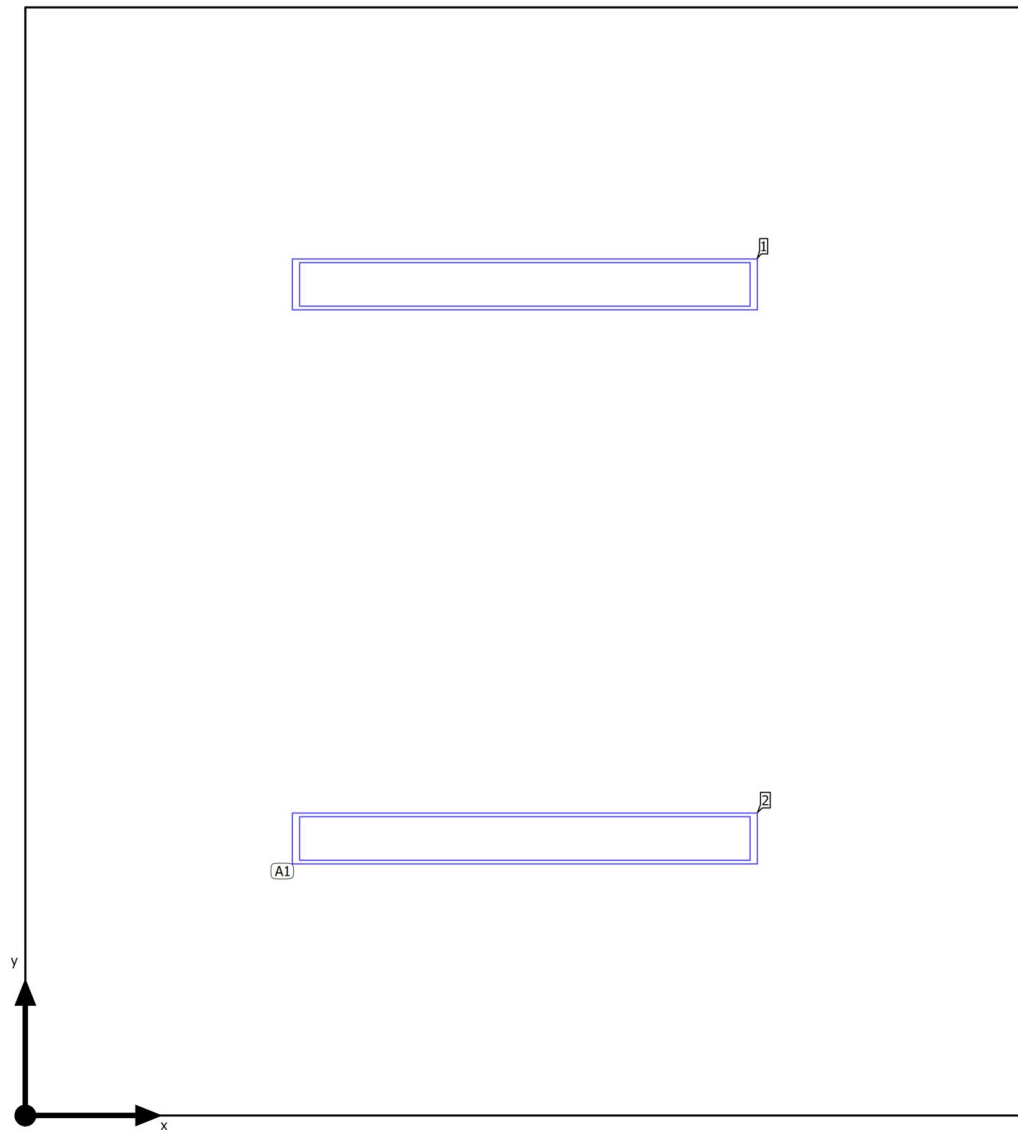

Building B · FIRST FOOR · 209 TOILET

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

**2 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 1.375 m / 0.763 m / 3.300 m      | 1.375 m | 2.287 m | 3.300 m         | 1         |
| X-direction           | 1 pcs., Centre - centre, 2.750 m | 1.375 m | 0.763 m | 3.300 m         | 2         |
| Y-direction           | 2 pcs., Centre - centre, 1.525 m |         |         |                 |           |
| Arrangement           | A1                               |         |         |                 |           |

Building B · FIRST FOOR · 209 TOILET


**Luminaire list**

|                                  |                               |                                |
|----------------------------------|-------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>9326 lm | $P_{\text{total}}$<br>152.0 W | Luminous efficacy<br>61.4 lm/W |
|----------------------------------|-------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 2    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

## Calculation objects

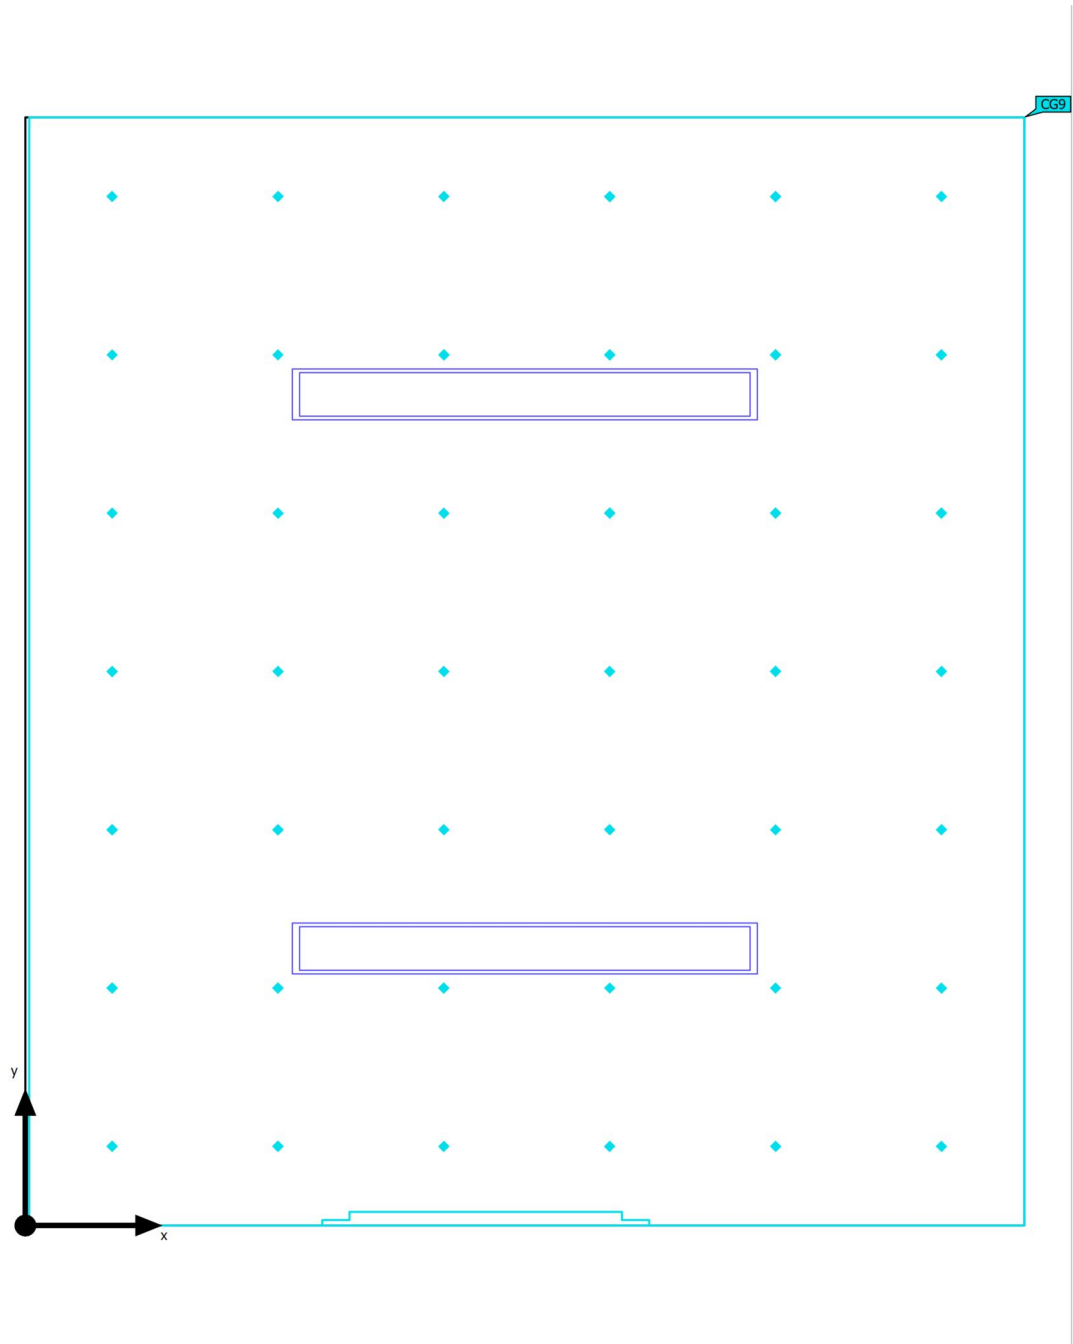

Building B · FIRST FOOR · 209 TOILET (Light scene 1)



## Calculation objects

### Calculation surfaces

| Properties                                                 | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 209 Toilet<br>Perpendicular illuminance<br>Height: 0.000 m | 222 lx    | 181 lx    | 260 lx    | 0.82        | 0.70  | CG9   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

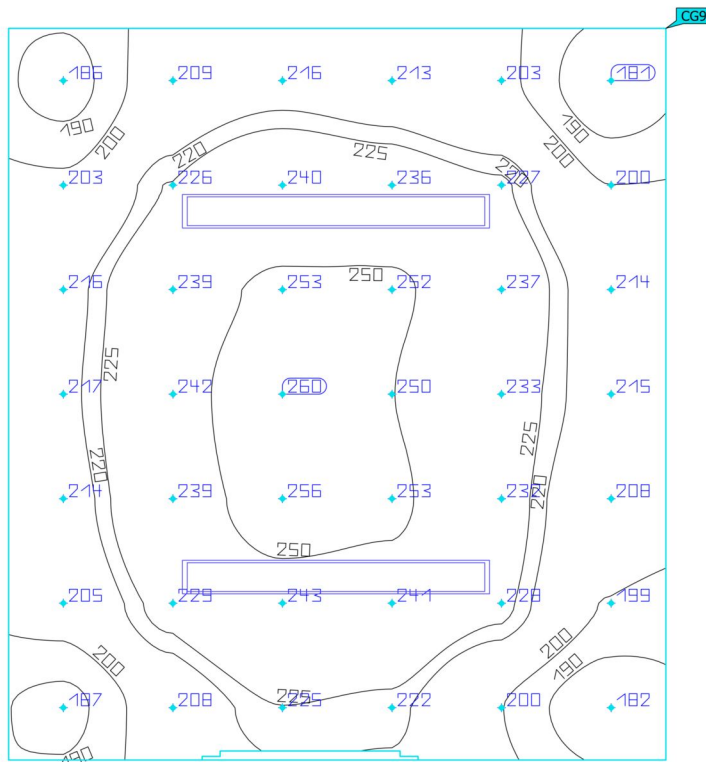
**209 Toilet**

| Properties                | $\bar{E}$ | $E_{\min}$ | $E_{\max}$ | $U_o (g_1)$ | $g_2$ | Index |
|---------------------------|-----------|------------|------------|-------------|-------|-------|
| 209 Toilet                | 222 lx    | 181 lx     | 260 lx     | 0.82        | 0.70  | CG9   |
| Perpendicular illuminance |           |            |            |             |       |       |
| Height: 0.000 m           |           |            |            |             |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Summary

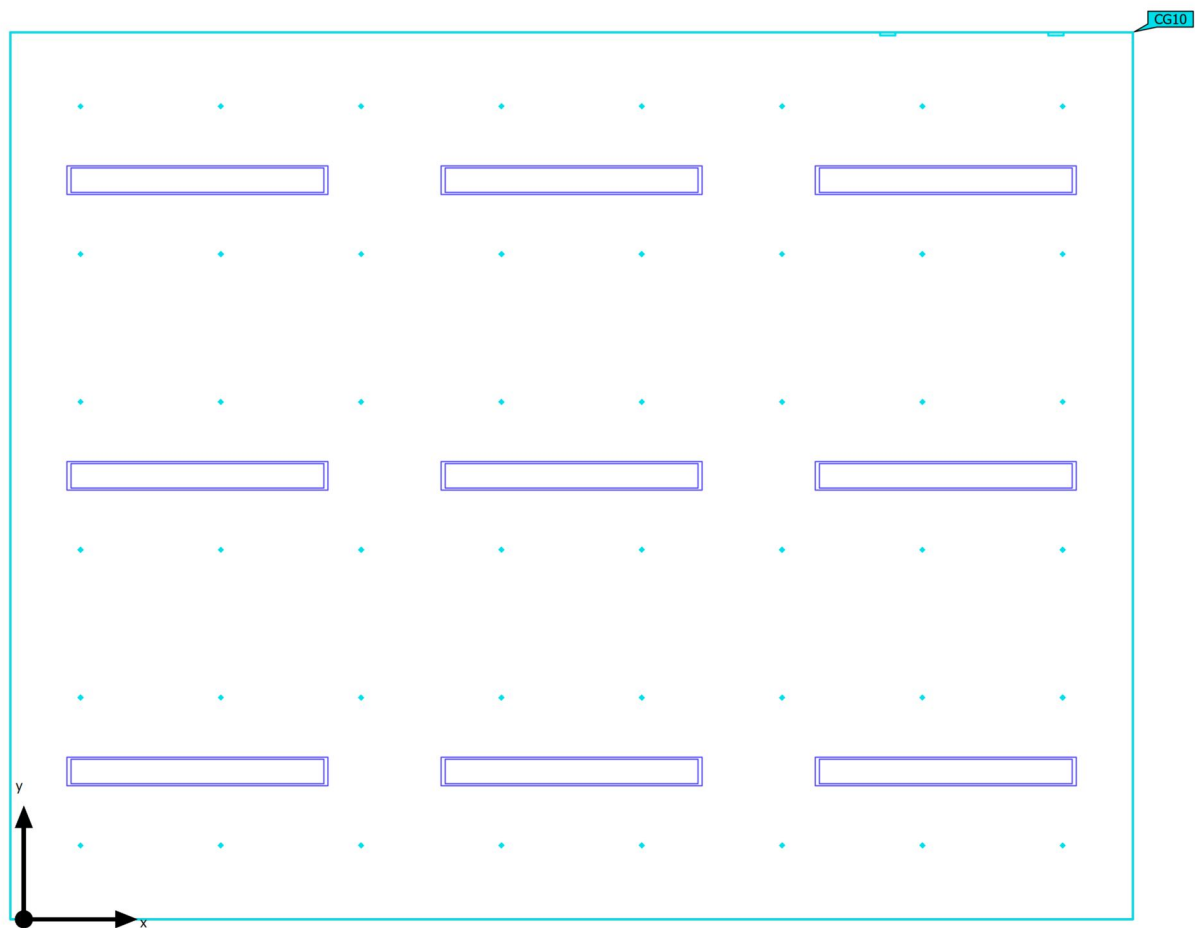

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 23.95 m²                                            |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                  |         |
|------------------|---------|
| Clearance height | 3.300 m |
| Mounting height  | 3.300 m |

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target         | Check | Index |
|----------------------------------|------------------------|------------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 23                     | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | 1693 kWh/a             | max. 850 kWh/a | ✗     |       |
| Space                            | Lighting power density | 28.56 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 5.505 m x 4.350 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 9    | Philips      |             | 2x36W        | 23              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 210 OFFICE

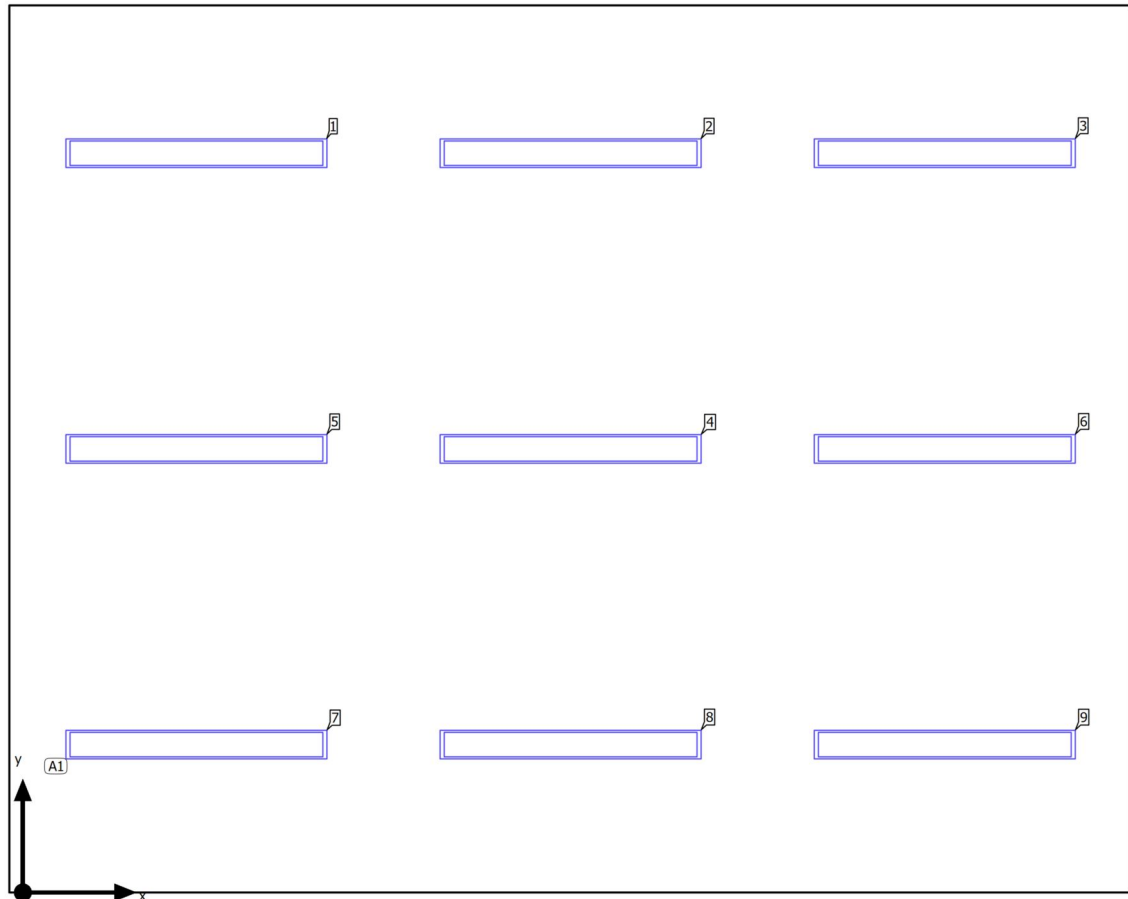**Luminaire layout plan**

Building B · FIRST FOOR · 210 OFFICE

**Luminaire layout plan**

|              |               |                        |         |
|--------------|---------------|------------------------|---------|
| Manufacturer | Philips       | P                      | 76.0 W  |
| Article name | 2x36W         | Φ <sub>Luminaire</sub> | 4663 lm |
| Fitting      | 2x T8 36W/827 |                        |         |

**9 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 0.851 m / 0.725 m / 3.300 m      | 0.851 m | 3.625 m | 3.300 m         | 1         |
| X-direction           | 3 pcs., Centre - centre, 1.835 m | 2.686 m | 3.625 m | 3.300 m         | 2         |
| Y-direction           | 3 pcs., Centre - centre, 1.450 m | 4.521 m | 3.625 m | 3.300 m         | 3         |
| Arrangement           | A1                               | 2.686 m | 2.175 m | 3.300 m         | 4         |
|                       |                                  | 0.851 m | 2.175 m | 3.300 m         | 5         |
|                       |                                  | 4.521 m | 2.175 m | 3.300 m         | 6         |
|                       |                                  | 0.851 m | 0.725 m | 3.300 m         | 7         |
|                       |                                  | 2.686 m | 0.725 m | 3.300 m         | 8         |
|                       |                                  | 4.521 m | 0.725 m | 3.300 m         | 9         |

Building B · FIRST FOOR · 210 OFFICE

**Luminaire list** $\Phi_{\text{total}}$ 

41967 lm

 $P_{\text{total}}$ 

684.0 W


Luminous efficacy

61.4 lm/W

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 9    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

## Calculation objects

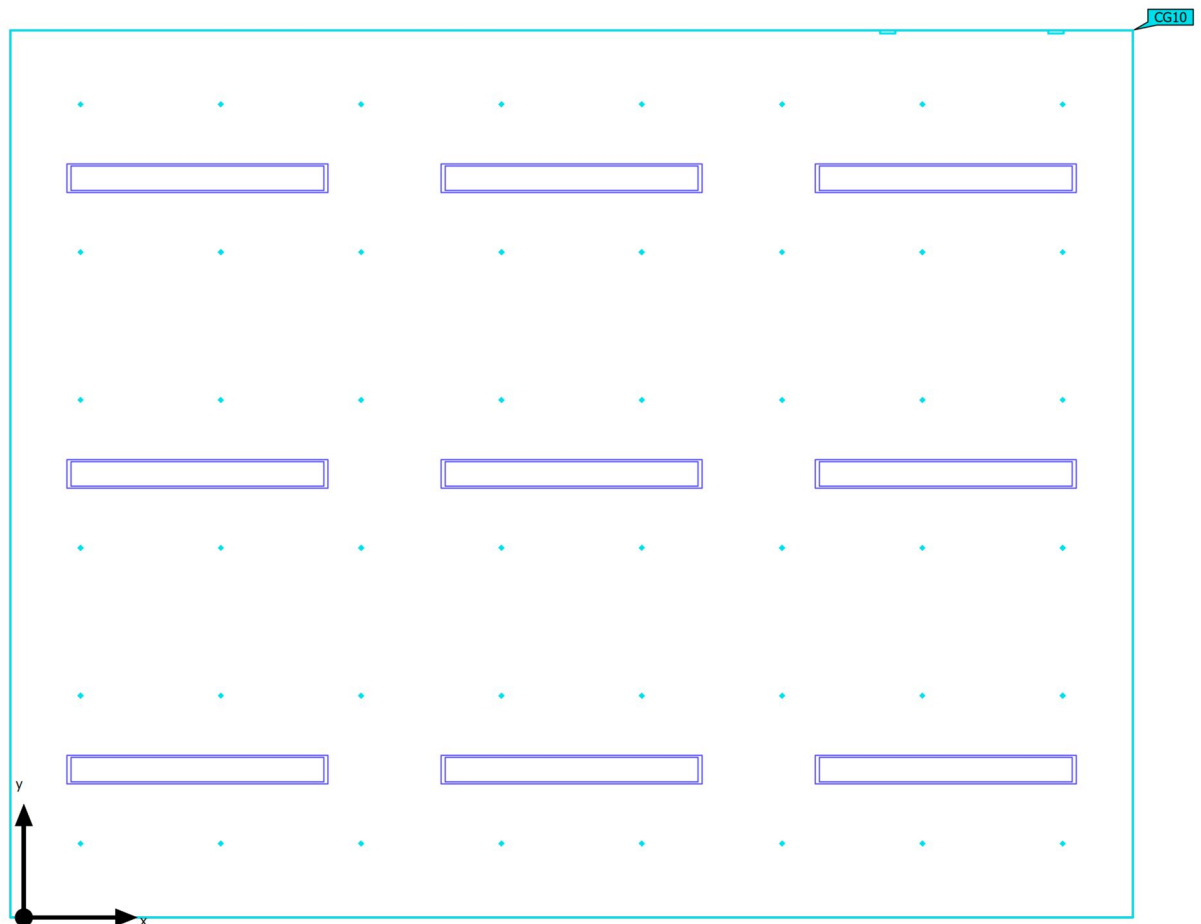

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

## Calculation objects

Calculation surfaces

| Properties                                                 | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 210 Office<br>Perpendicular illuminance<br>Height: 0.700 m | 674 lx    | 492 lx    | 800 lx    | 0.73        | 0.62  | CG10  |

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

## Calculation objects


210 Office (RUG)

|                    |             |
|--------------------|-------------|
| Strongest glare at | 60°         |
| max                | 21.5        |
| Target             | $\leq 19.0$ |
| Viewing sector     | 0° - 360°   |
| Step width         | 15°         |
| Height             | 1.200 m     |
| Index              | CG10        |

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)



## Calculation objects

210 Office (RUG)

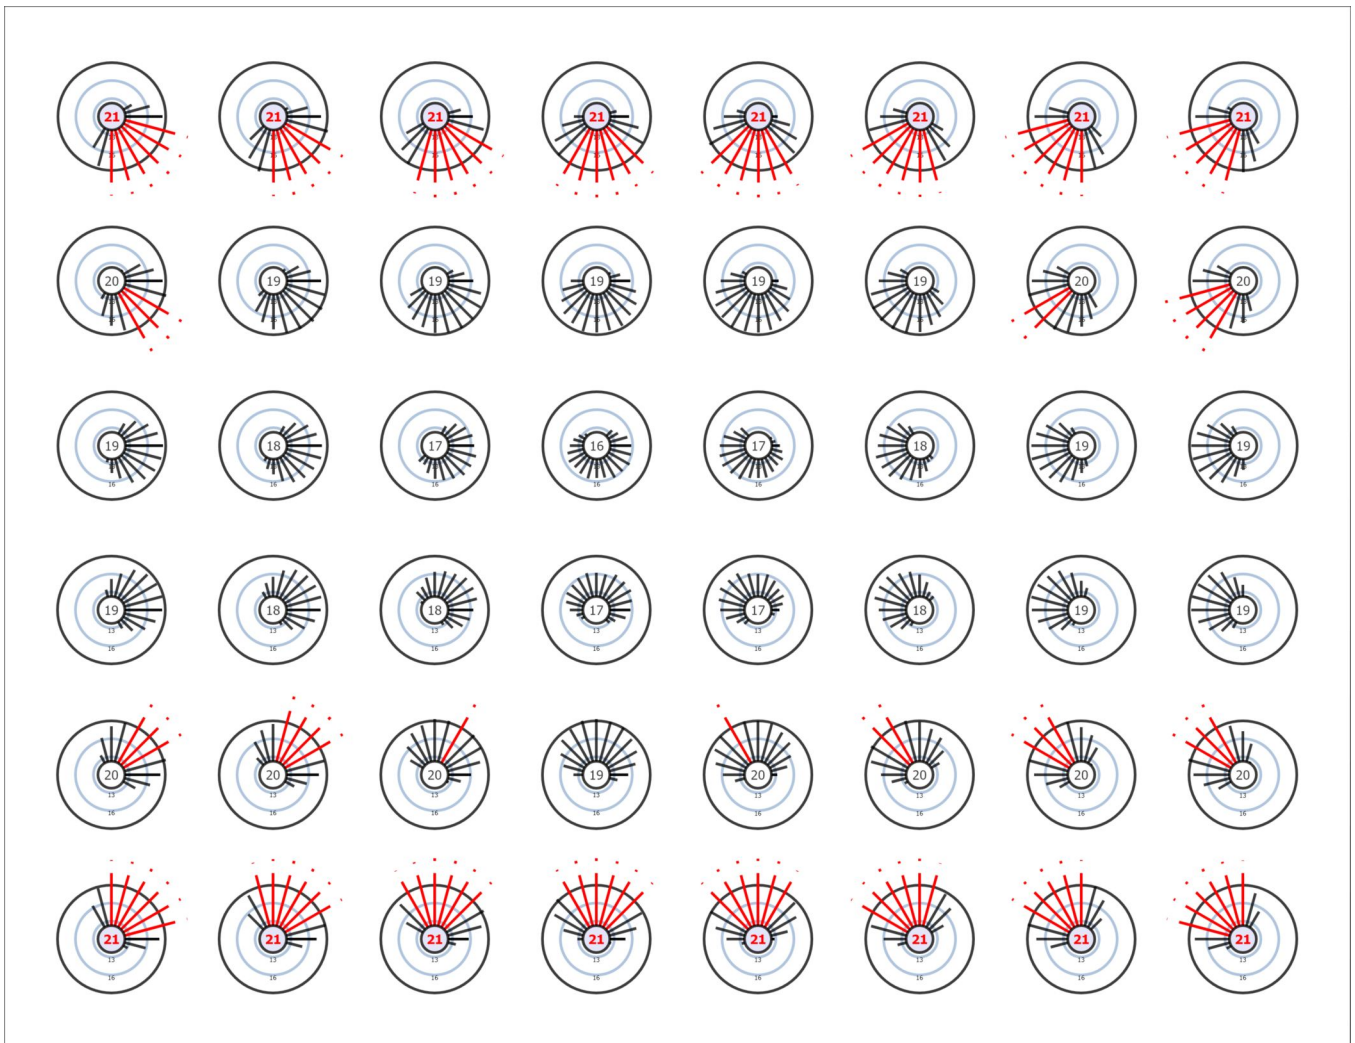

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

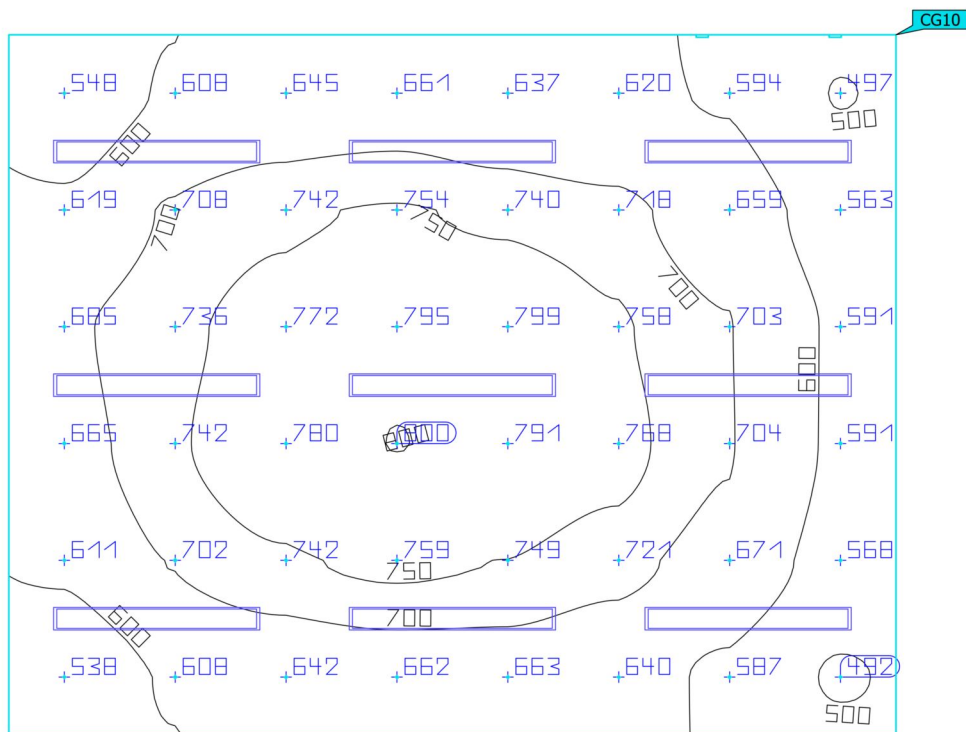
**210 Office**

| Properties                | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|---------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 210 Office                | 674 lx    | 492 lx    | 800 lx    | 0.73        | 0.62  | CG10  |
| Perpendicular illuminance |           |           |           |             |       |       |
| Height: 0.700 m           |           |           |           |             |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Summary

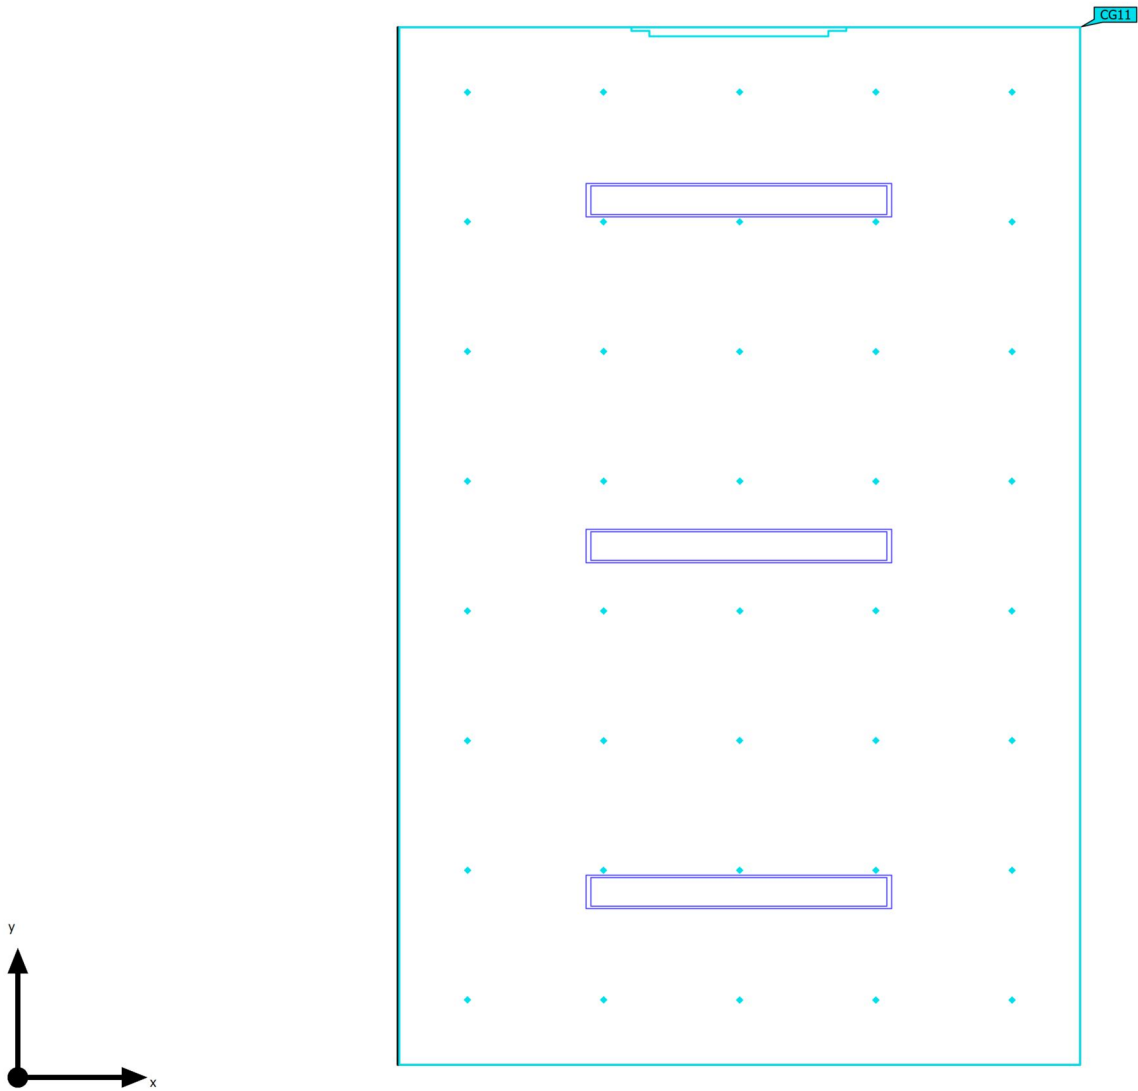

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 12.43 m²                                            |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                  |         |
|------------------|---------|
| Clearance height | 3.300 m |
| Mounting height  | 3.300 m |

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target         | Check | Index |
|----------------------------------|------------------------|------------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 21                     | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | [356 - 564] kWh/a      | max. 450 kWh/a | ✗     |       |
| Space                            | Lighting power density | 18.35 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 4.347 m x 2.859 m and SHR of 0.25.



(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 3    | Philips      |             | 2x36W        | 21              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 211 TOILET

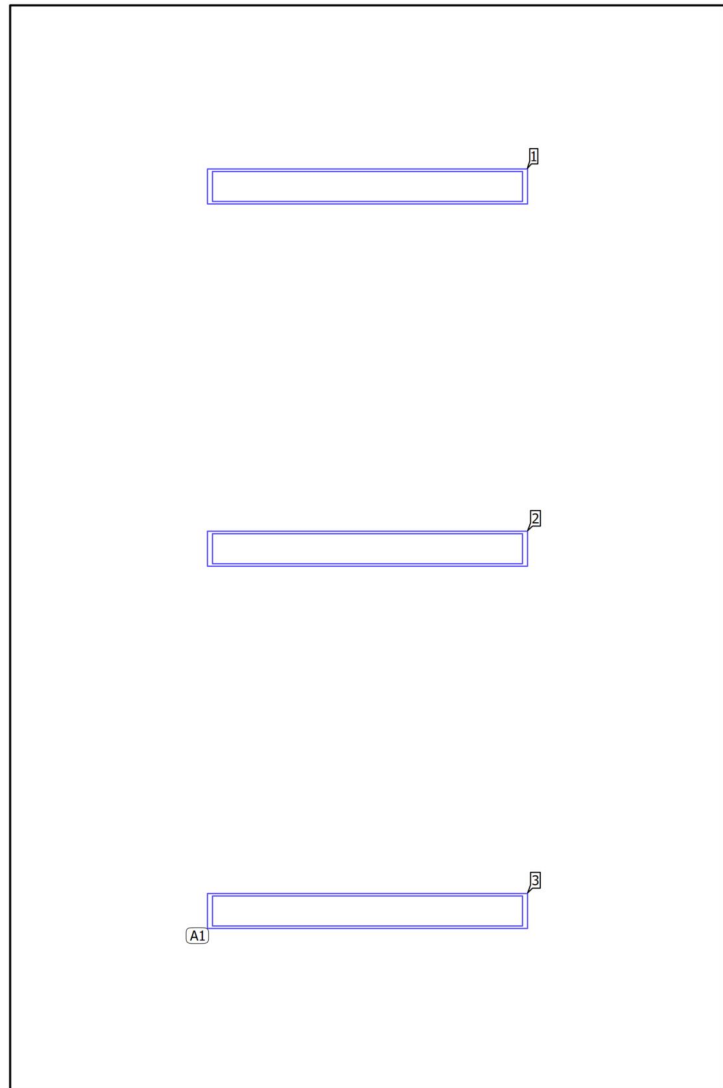**Luminaire layout plan**

Building B · FIRST FOOR · 211 TOILET

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

**3 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 3.021 m / 0.777 m / 3.300 m      | 3.021 m | 3.675 m | 3.300 m         | 1         |
| X-direction           | 1 pcs., Centre - centre, 2.859 m | 3.021 m | 2.226 m | 3.300 m         | 2         |
| Y-direction           | 3 pcs., Centre - centre, 1.449 m | 3.021 m | 0.777 m | 3.300 m         | 3         |
| Arrangement           | A1                               |         |         |                 |           |

Building B · FIRST FOOR · 211 TOILET



**Luminaire list**

|                                   |                               |                                |
|-----------------------------------|-------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>13989 lm | $P_{\text{total}}$<br>228.0 W | Luminous efficacy<br>61.4 lm/W |
|-----------------------------------|-------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 3    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

## Calculation objects

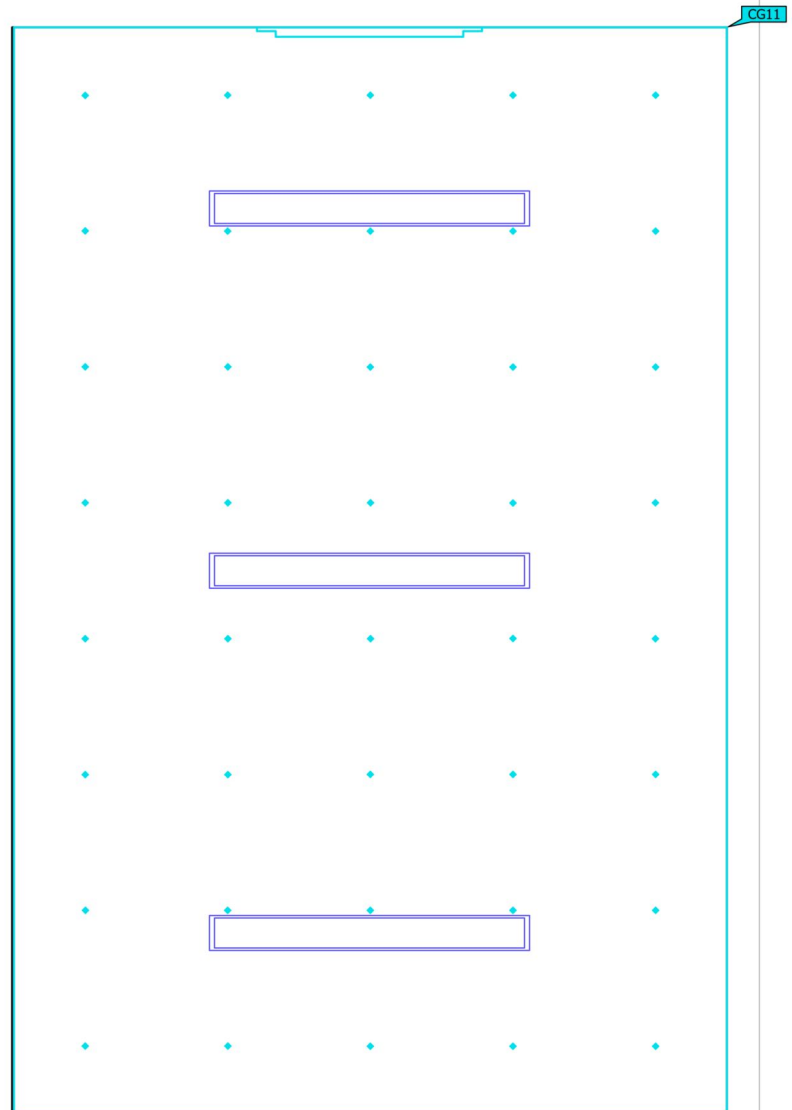

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

## Calculation objects



### Calculation surfaces

| Properties                                                 | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 211 Toilet<br>Perpendicular illuminance<br>Height: 0.000 m | 271 lx    | 218 lx    | 319 lx    | 0.80        | 0.68  | CG11  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

211 Toilet

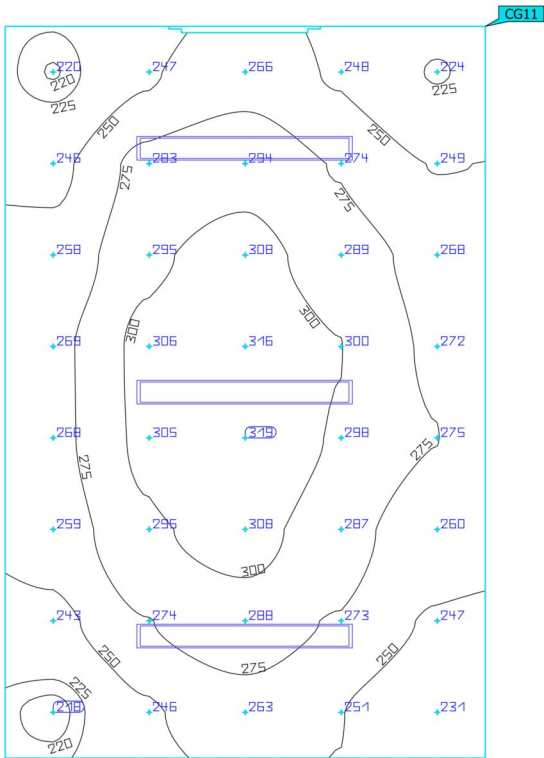


| Properties                                                 | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 211 Toilet<br>Perpendicular illuminance<br>Height: 0.000 m | 271 lx    | 218 lx    | 319 lx    | 0.80        | 0.68  | CG11  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Summary

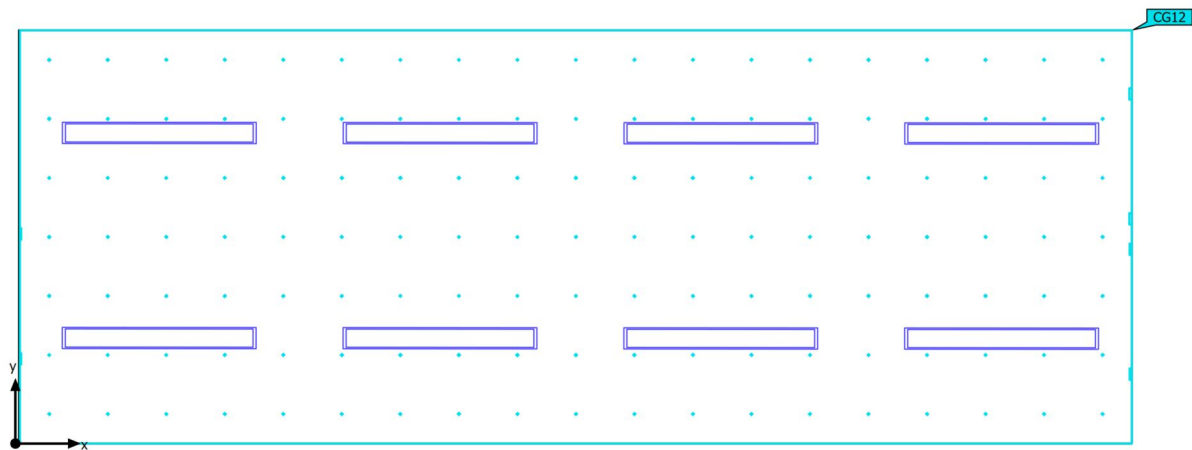

|                    |                                                     |                  |         |
|--------------------|-----------------------------------------------------|------------------|---------|
| Ground area        | 20.07 m²                                            |                  |         |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % | Clearance height | 3.300 m |
| Maintenance factor | 0.76 (fixed)                                        | Mounting height  | 3.300 m |

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target         | Check | Index |
|----------------------------------|------------------------|------------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 25                     | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | 1505 kWh/a             | max. 750 kWh/a | ✗     |       |
| Space                            | Lighting power density | 30.30 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 7.350 m x 2.730 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 8    | Philips      |             | 2x36W        | 25              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 212 OFFICE

## Luminaire layout plan

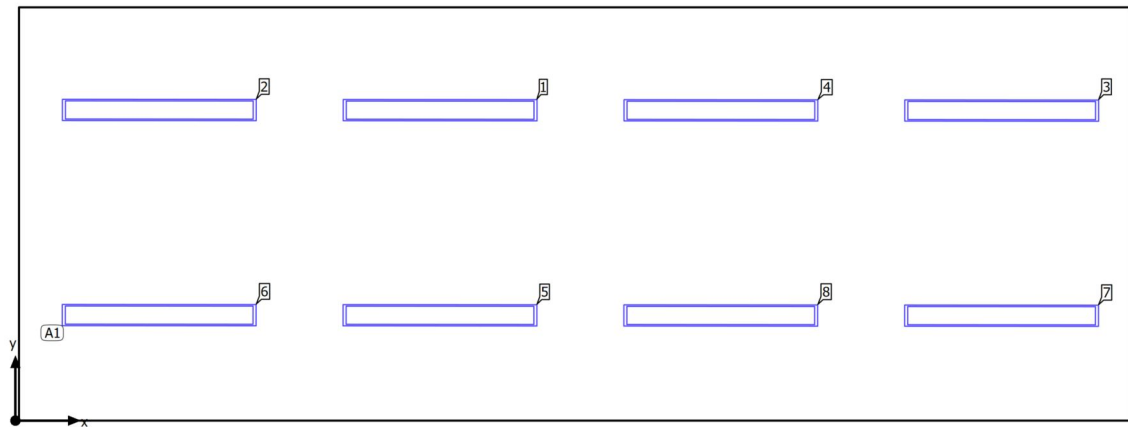

Building B · FIRST FOOR · 212 OFFICE

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

**8 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 0.950 m / 0.697 m / 3.300 m      | 2.805 m | 2.051 m | 3.300 m         | 1         |
| X-direction           | 4 pcs., Centre - centre, 1.855 m | 0.951 m | 2.052 m | 3.300 m         | 2         |
| Y-direction           | 2 pcs., Centre - centre, 1.355 m | 6.514 m | 2.048 m | 3.300 m         | 3         |
| Arrangement           | A1                               | 4.660 m | 2.049 m | 3.300 m         | 4         |
|                       |                                  | 2.804 m | 0.696 m | 3.300 m         | 5         |
|                       |                                  | 0.950 m | 0.697 m | 3.300 m         | 6         |
|                       |                                  | 6.513 m | 0.693 m | 3.300 m         | 7         |
|                       |                                  | 4.659 m | 0.694 m | 3.300 m         | 8         |

Building B · FIRST FOOR · 212 OFFICE

**Luminaire list** $\Phi_{\text{total}}$ 

37304 lm

 $P_{\text{total}}$ 

608.0 W


Luminous efficacy

61.4 lm/W

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 8    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

## Calculation objects

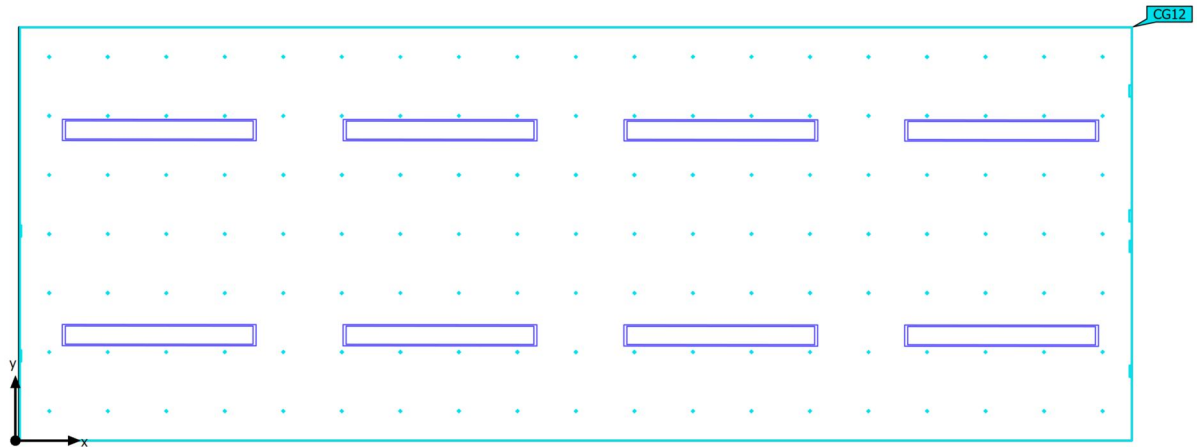

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

## Calculation objects

Calculation surfaces

| Properties                                                 | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 212 Office<br>Perpendicular illuminance<br>Height: 0.700 m | 613 lx    | 417 lx    | 721 lx    | 0.68        | 0.58  | CG12  |

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

## Calculation objects


212 Office (RUG)

|                    |           |
|--------------------|-----------|
| Strongest glare at | 30°       |
| max                | 18.6      |
| Target             | ≤ 19.0    |
| Viewing sector     | 0° - 360° |
| Step width         | 15°       |
| Height             | 1.200 m   |
| Index              | CG12      |

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)


## Calculation objects

212 Office (RUG)

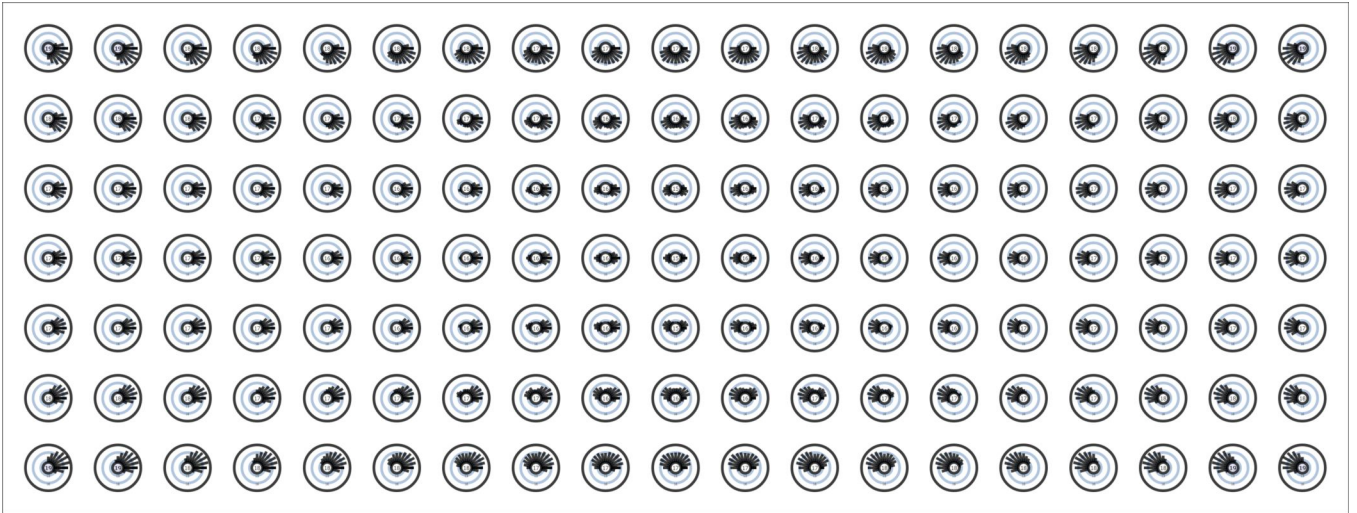

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

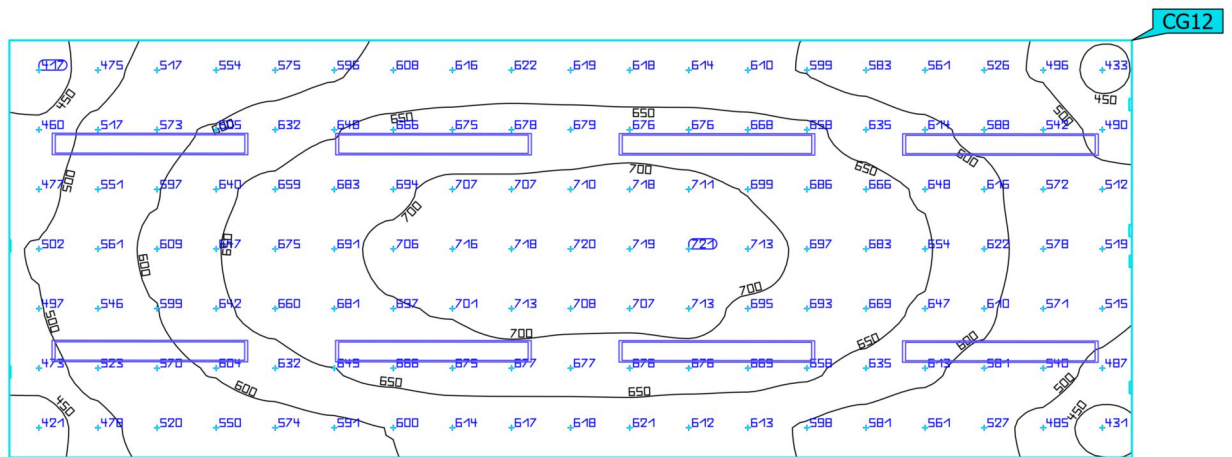
**212 Office**

| Properties                                                 | $\bar{E}$ | $E_{\min}$ | $E_{\max}$ | $U_o (g_1)$ | $g_2$ | Index |
|------------------------------------------------------------|-----------|------------|------------|-------------|-------|-------|
| 212 Office<br>Perpendicular illuminance<br>Height: 0.700 m | 613 lx    | 417 lx     | 721 lx     | 0.68        | 0.58  | CG12  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212A DB (Light scene 1)

Summary

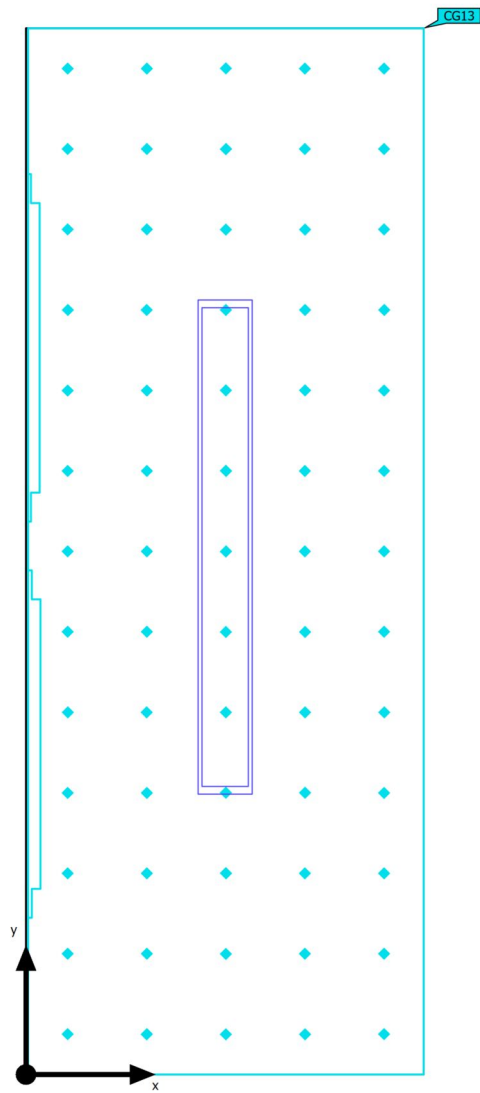

|                    |                                                     |                  |         |
|--------------------|-----------------------------------------------------|------------------|---------|
| Ground area        | 2.79 m²                                             |                  |         |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % | Clearance height | 3.300 m |
| Maintenance factor | 0.76 (fixed)                                        | Mounting height  | 3.300 m |

Building B · FIRST FOOR · 212A DB (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target         | Check | Index |
|----------------------------------|------------------------|------------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 21                     | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | 188 kWh/a              | max. 100 kWh/a | ✗     |       |
| Space                            | Lighting power density | 27.23 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 1.030 m x 2.710 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 21              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 212A DB

## Luminaire layout plan

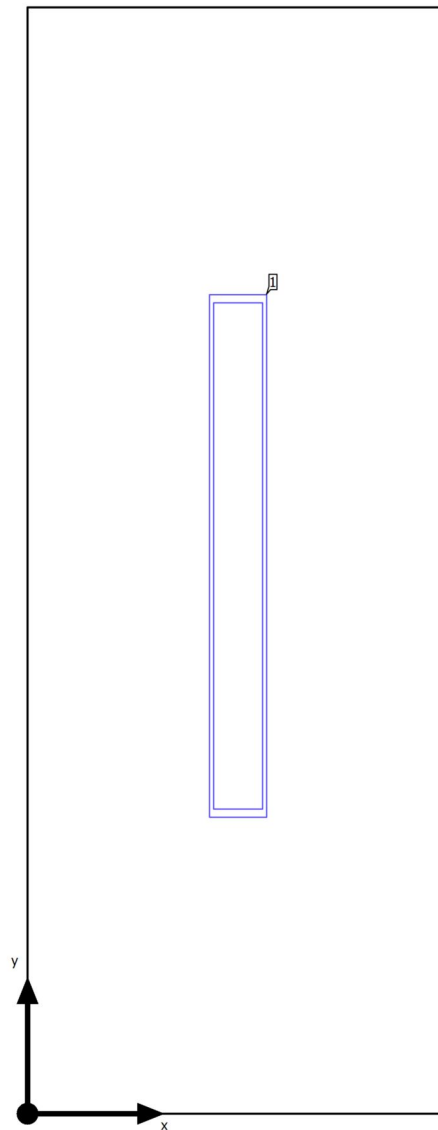

Building B · FIRST FOOR · 212A DB

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 0.516 m | 1.366 m | 3.300 m         | 1         |

Building B · FIRST FOOR · 212A DB


Luminaire list

|                           |                       |                                |
|---------------------------|-----------------------|--------------------------------|
| $\Phi_{total}$<br>4663 lm | $P_{total}$<br>76.0 W | Luminous efficacy<br>61.4 lm/W |
|---------------------------|-----------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 212A DB (Light scene 1)

## Calculation objects

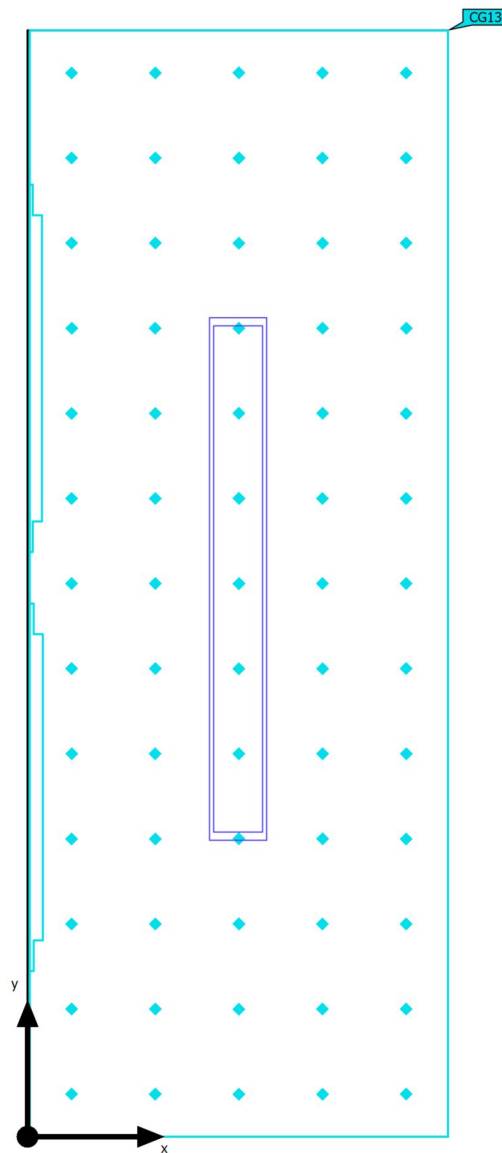

Building B · FIRST FOOR · 212A DB (Light scene 1)

## Calculation objects


### Calculation surfaces

| Properties                                              | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|---------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 212A DB<br>Perpendicular illuminance<br>Height: 0.000 m | 142 lx    | 118 lx    | 160 lx    | 0.83        | 0.74  | CG13  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212A DB (Light scene 1)

212A DB

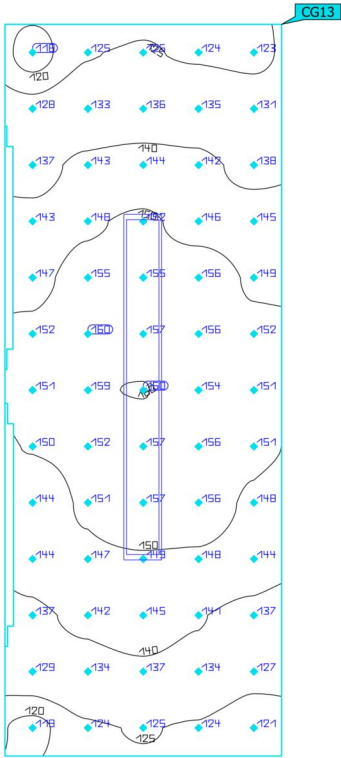


| Properties                                              | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|---------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 212A DB<br>Perpendicular illuminance<br>Height: 0.000 m | 142 lx    | 118 lx    | 160 lx    | 0.83        | 0.74  | CG13  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Summary

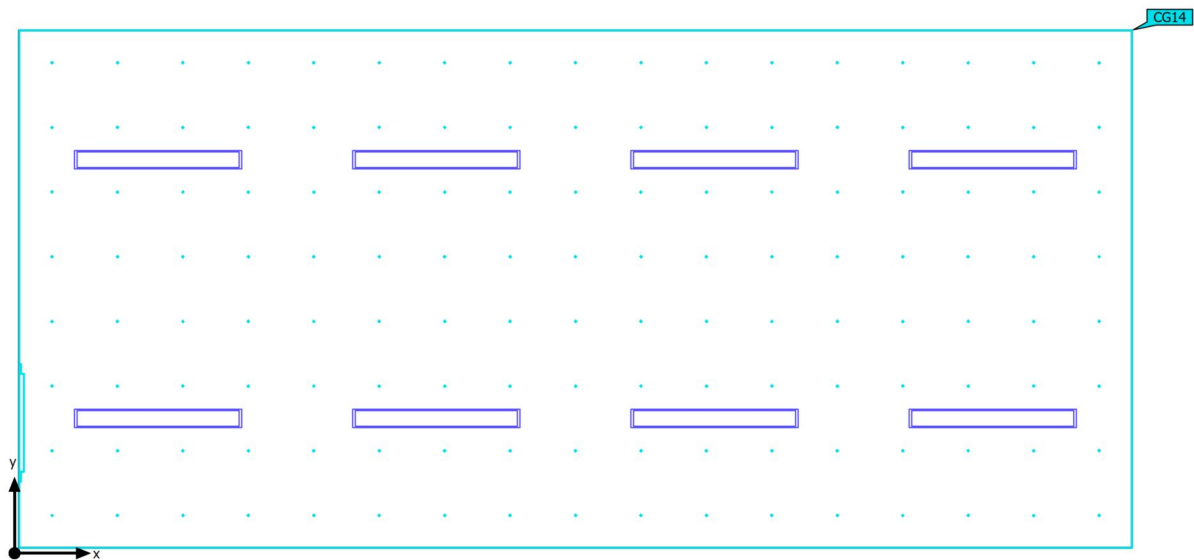

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 33.71 m²                                            |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                  |         |
|------------------|---------|
| Clearance height | 3.300 m |
| Mounting height  | 3.300 m |

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target          | Check | Index |
|----------------------------------|------------------------|------------------------|-----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 25                     | ≤ 19            | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | [948 - 1505] kWh/a     | max. 1200 kWh/a | ✗     |       |
| Space                            | Lighting power density | 18.04 W/m <sup>2</sup> | –               |       |       |

(1) Based on a rectangular space of 8.516 m x 3.958 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 8    | Philips      |             | 2x36W        | 25              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 213 CONFERENCE

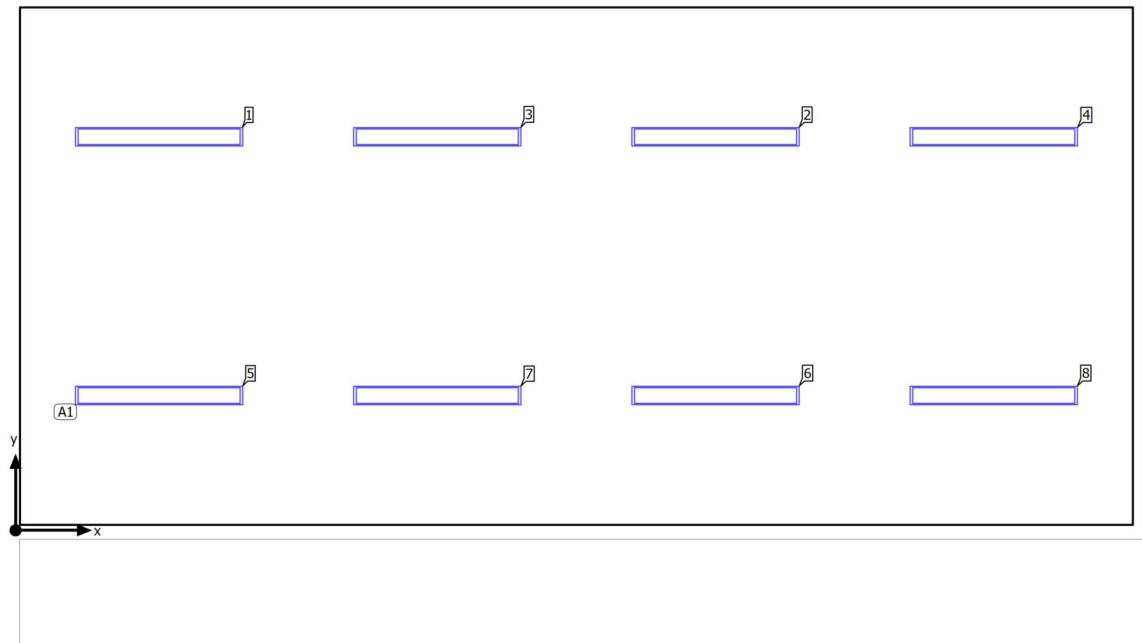**Luminaire layout plan**

Building B · FIRST FOOR · 213 CONFERENCE

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

**8 x Philips 2x36W**

| Type                  | Field Arrangement                | X       | Y       | Mounting height | Luminaire |
|-----------------------|----------------------------------|---------|---------|-----------------|-----------|
| 1st luminaire (X/Y/Z) | 1.098 m / 1.031 m / 3.300 m      | 1.098 m | 3.010 m | 3.300 m         | 1         |
| X-direction           | 4 pcs., Centre - centre, 2.129 m | 5.356 m | 3.010 m | 3.300 m         | 2         |
| Y-direction           | 2 pcs., Centre - centre, 1.979 m | 3.227 m | 3.010 m | 3.300 m         | 3         |
|                       |                                  | 7.485 m | 3.010 m | 3.300 m         | 4         |
| Arrangement           | A1                               | 1.098 m | 1.031 m | 3.300 m         | 5         |
|                       |                                  | 5.356 m | 1.031 m | 3.300 m         | 6         |
|                       |                                  | 3.227 m | 1.031 m | 3.300 m         | 7         |
|                       |                                  | 7.485 m | 1.031 m | 3.300 m         | 8         |

Building B · FIRST FOOR · 213 CONFERENCE

**Luminaire list** $\Phi_{\text{total}}$ 

37304 lm

 $P_{\text{total}}$ 

608.0 W


Luminous efficacy

61.4 lm/W

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 8    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

## Calculation objects

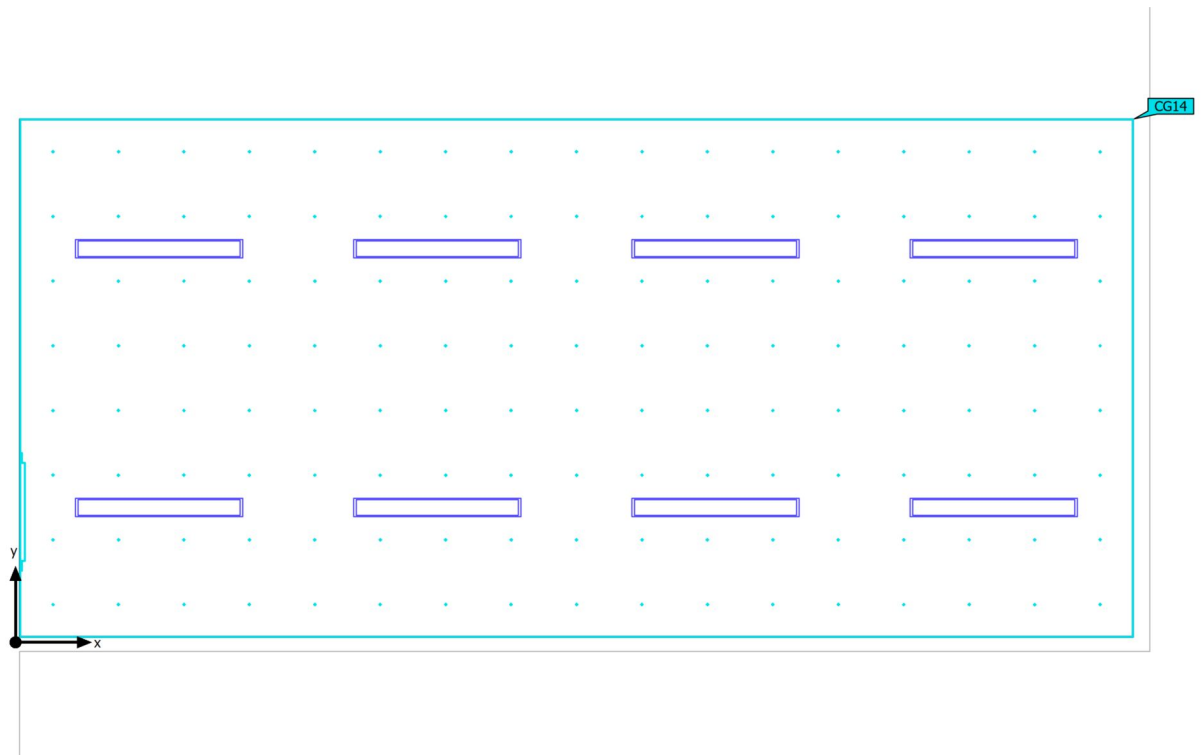

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)


## Calculation objects

### Calculation surfaces

| Properties                                                     | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|----------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 213 Conference<br>Perpendicular illuminance<br>Height: 0.700 m | 454 lx    | 304 lx    | 543 lx    | 0.67        | 0.56  | CG14  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

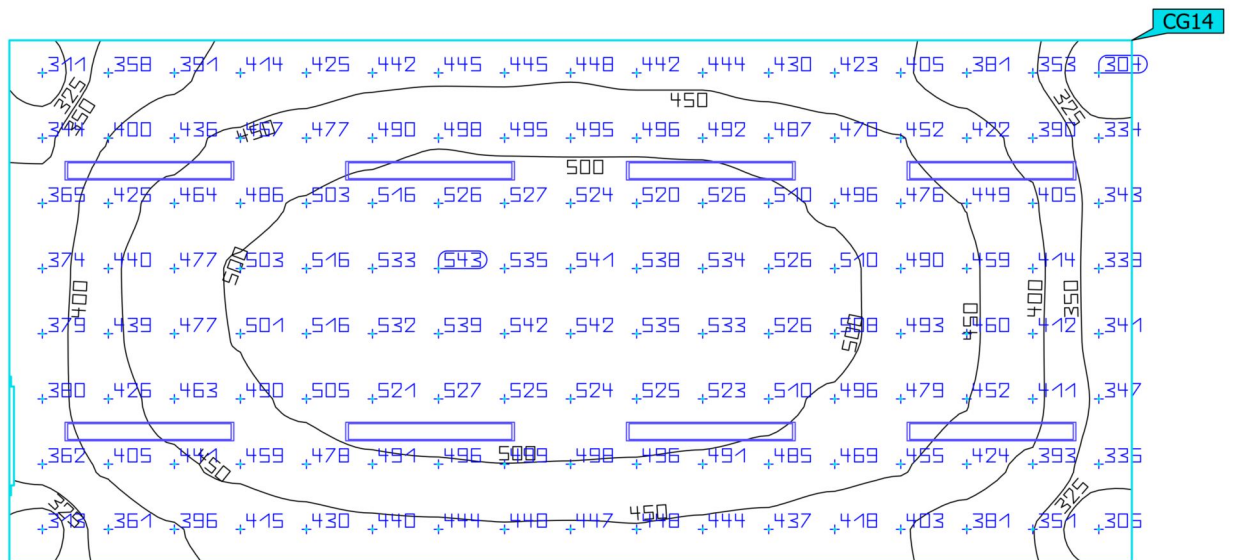
**213 Conference**

| Properties                                                     | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|----------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 213 Conference<br>Perpendicular illuminance<br>Height: 0.700 m | 454 lx    | 304 lx    | 543 lx    | 0.67        | 0.56  | CG14  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · Space 1 (Light scene 1)

Summary

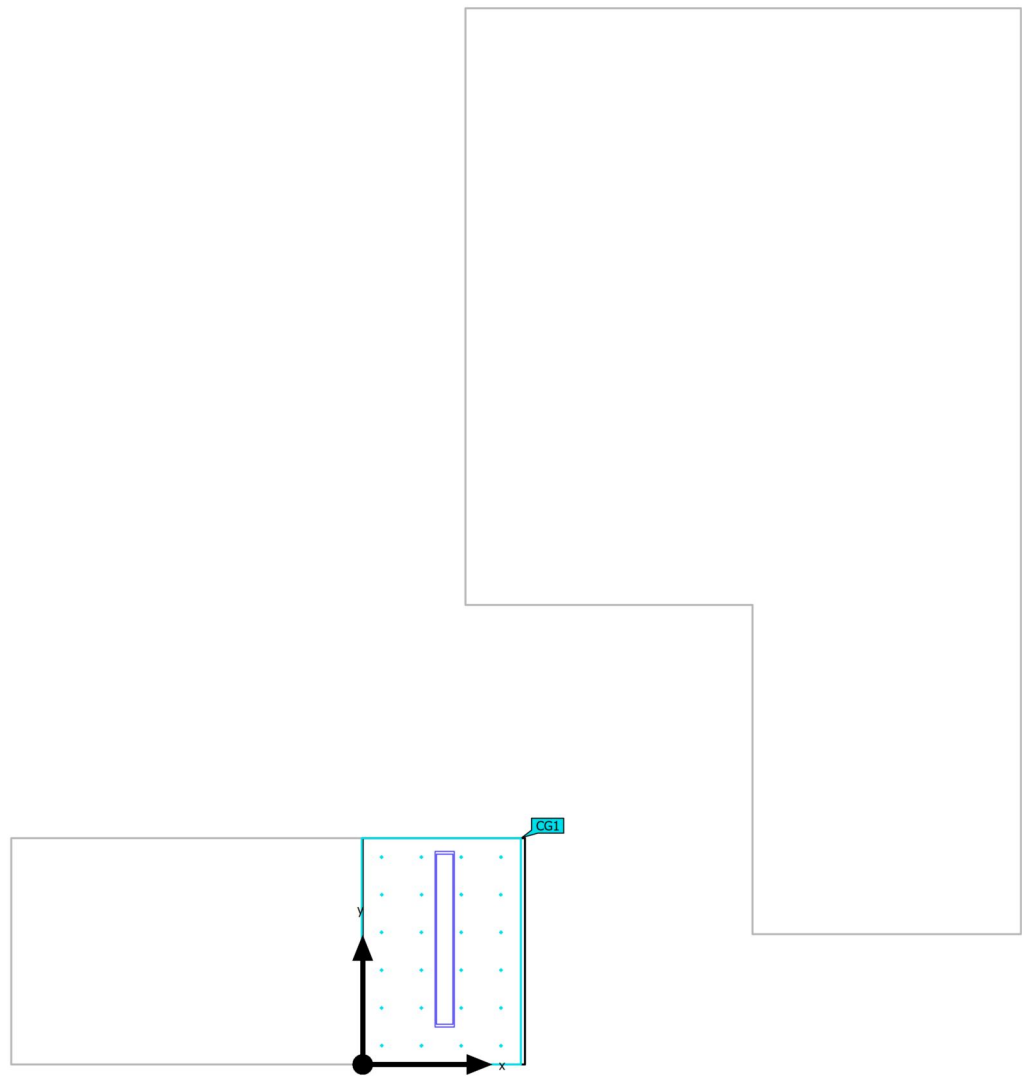

|                    |                                                    |                 |         |
|--------------------|----------------------------------------------------|-----------------|---------|
| Ground area        | 1.95 m²                                            |                 |         |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 0.0 % |                 |         |
| Maintenance factor | 0.80 (fixed)                                       | Mounting height | 3.300 m |

Building B · FIRST FOOR · Space 1 (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated             | Target         | Check | Index |
|----------------------------------|------------------------|------------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 21                     | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | 188 kWh/a              | max. 100 kWh/a | ✗     |       |
| Space                            | Lighting power density | 38.94 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 1.650 m x 1.183 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (34.2 Standard (office))

### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 21              | 76.0 W | 4663 lm | 61.4 lm/W         |


Building B · FIRST FOOR · Space 1

## Luminaire layout plan

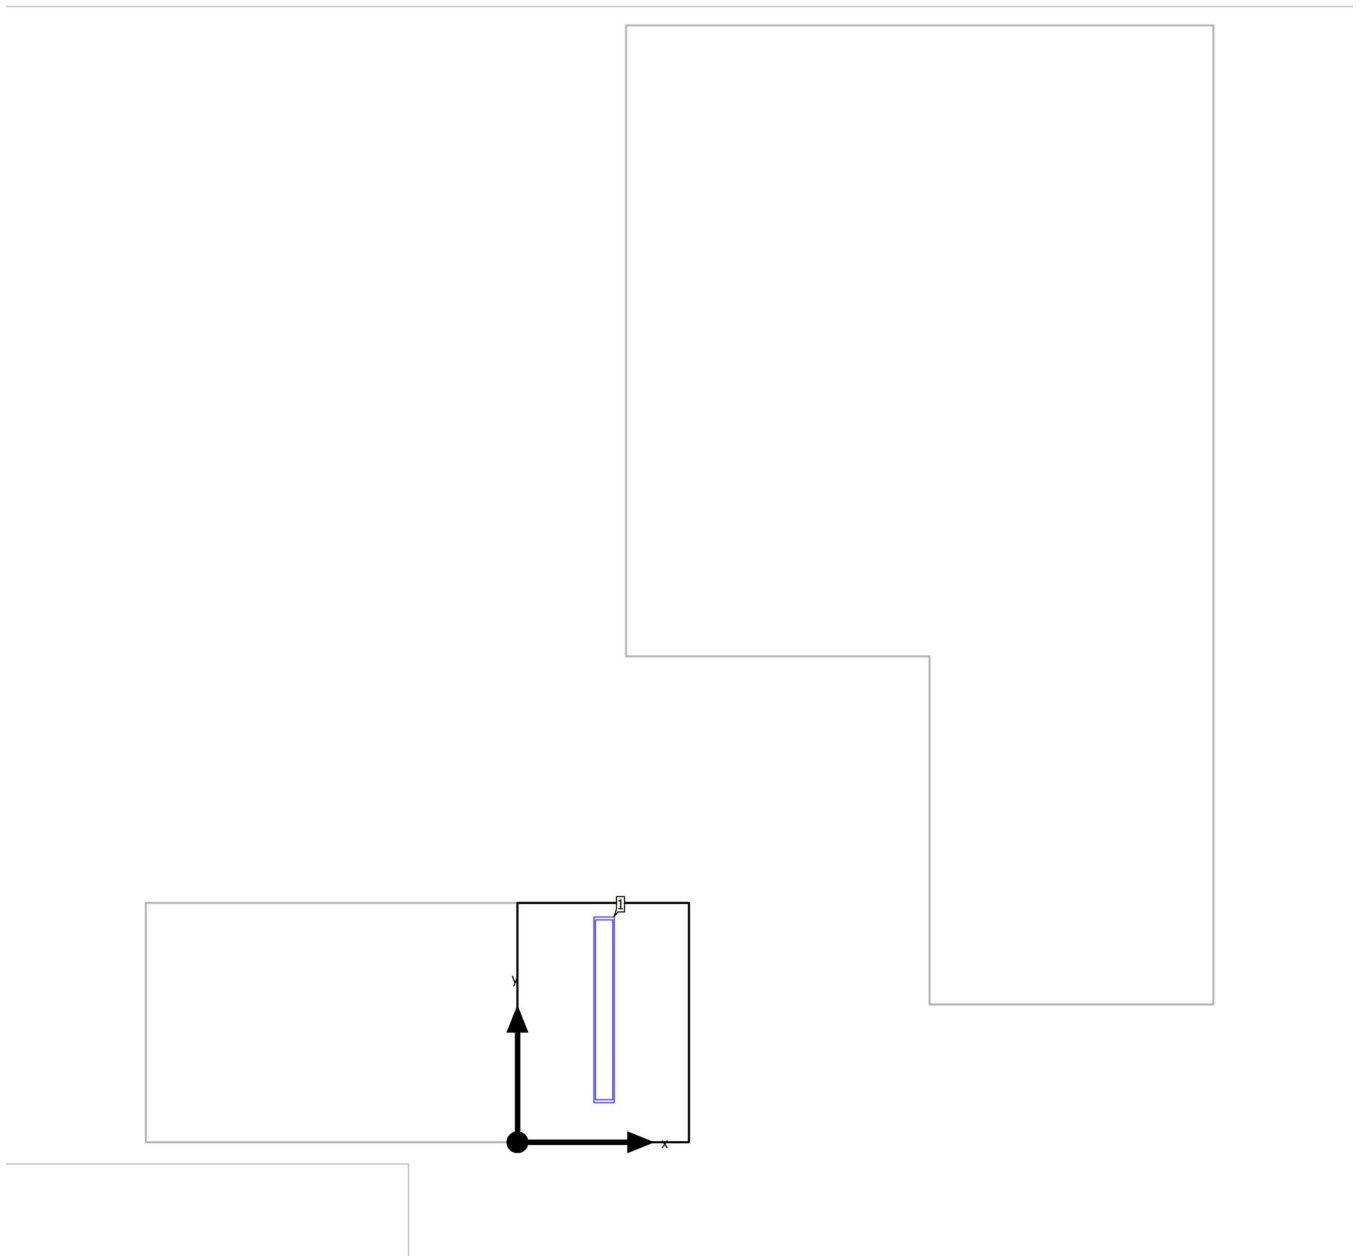

Building B · FIRST FOOR · Space 1

Luminaire layout plan



|              |               |                        |         |
|--------------|---------------|------------------------|---------|
| Manufacturer | Philips       | P                      | 76.0 W  |
| Article name | 2x36W         | Φ <sub>Luminaire</sub> | 4663 lm |
| Fitting      | 2x T8 36W/827 |                        |         |

Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 0.598 m | 0.913 m | 3.300 m         | 1         |


Building B · FIRST FOOR · Space 1

Luminaire list

| $\Phi_{total}$<br>4663 lm |              | $P_{total}$<br>76.0 W |              | Luminous efficacy<br>61.4 lm/W |         |                   |
|---------------------------|--------------|-----------------------|--------------|--------------------------------|---------|-------------------|
| pcs.                      | Manufacturer | Article No.           | Article name | P                              | $\Phi$  | Luminous efficacy |
| 1                         | Philips      |                       | 2x36W        | 76.0 W                         | 4663 lm | 61.4 lm/W         |

Building B · FIRST FOOR · Space 1 (Light scene 1)

## Calculation objects

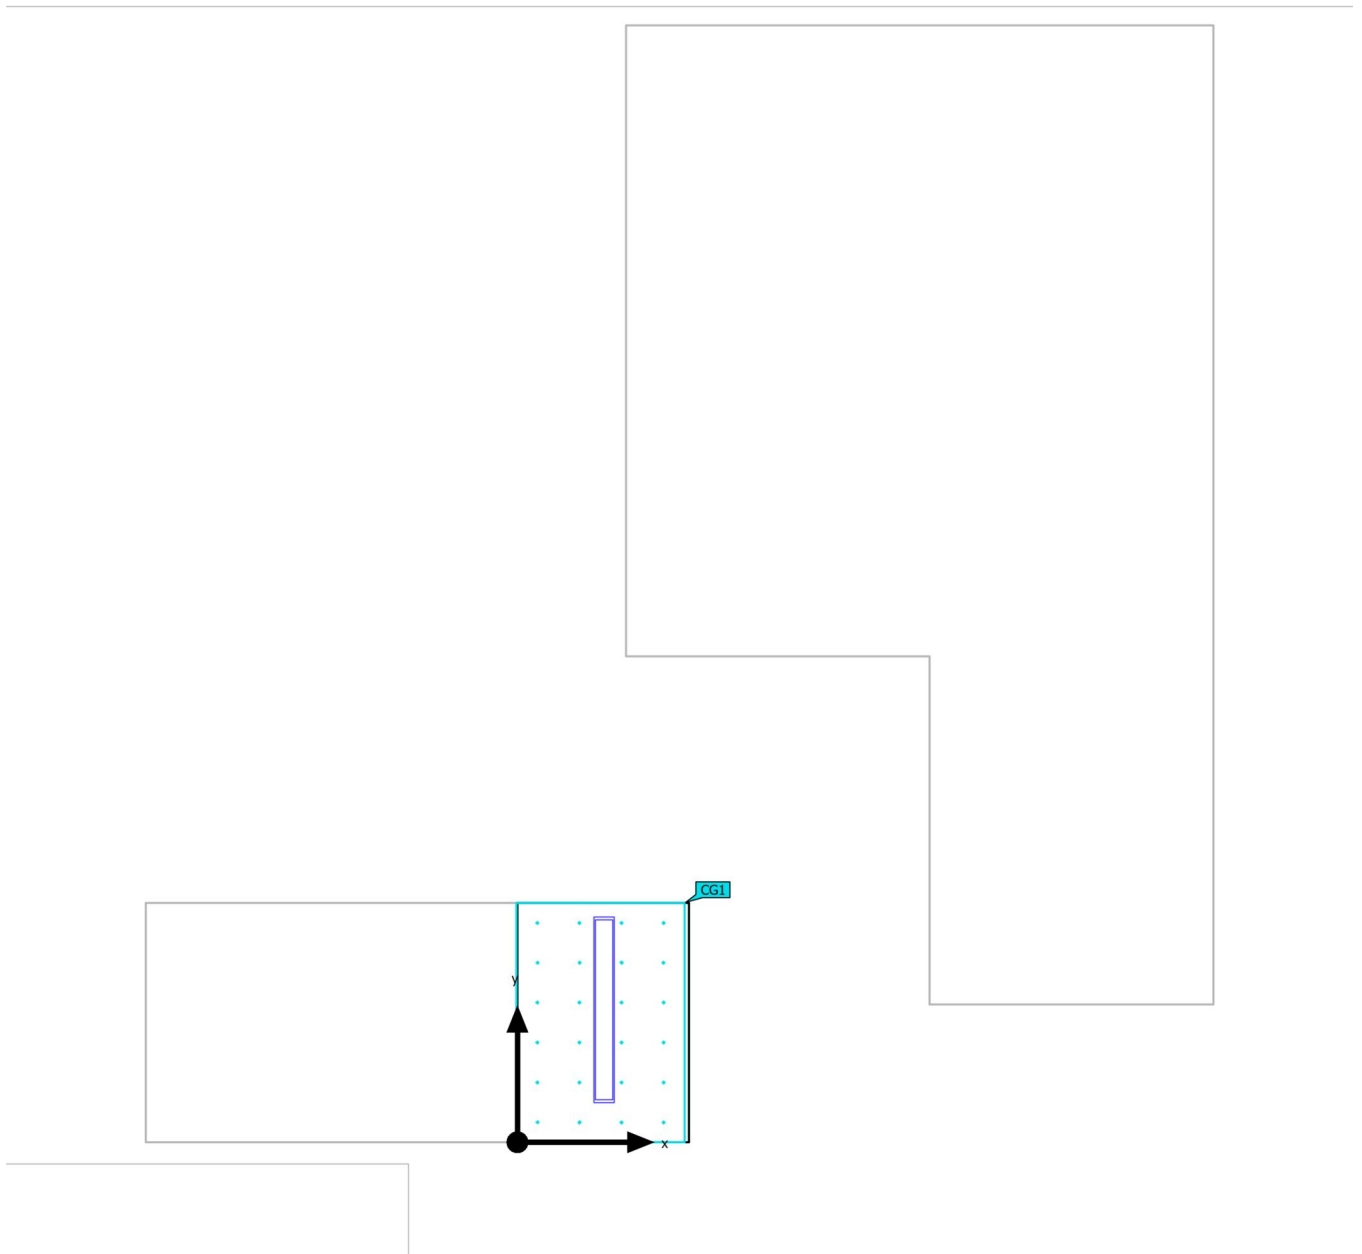

Building B · FIRST FOOR · Space 1 (Light scene 1)

Calculation objects



Calculation surfaces

| Properties                                                 | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 201 Stairs<br>Perpendicular illuminance<br>Height: 0.000 m | 243 lx    | 208 lx    | 269 lx    | 0.86        | 0.77  | CG1   |

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building B · FIRST FOOR · Space 1 (Light scene 1)

201 Stairs

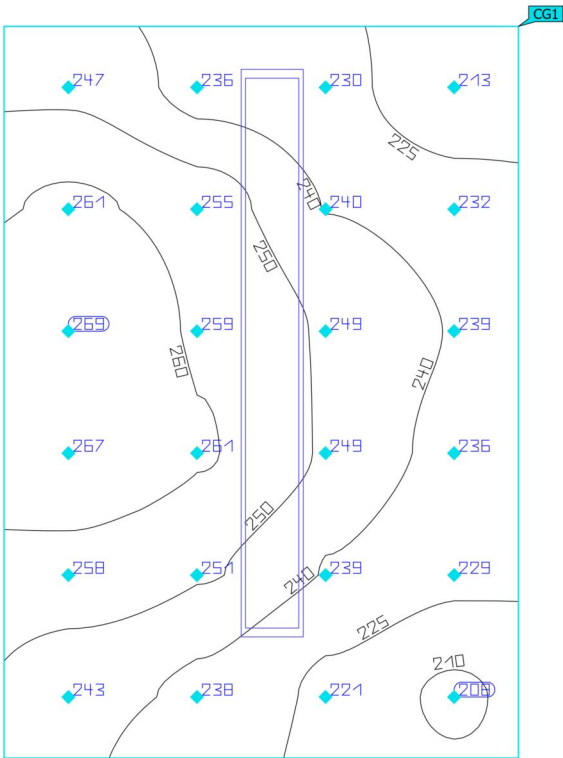

| Properties                                                 | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| 201 Stairs<br>Perpendicular illuminance<br>Height: 0.000 m | 243 lx    | 208 lx    | 269 lx    | 0.86        | 0.77  | CG1   |

Utilisation profile: DIALux presetting (34.2 Standard (office))