


Building B · FIRST FOOR (Emergency light scene)

Room list

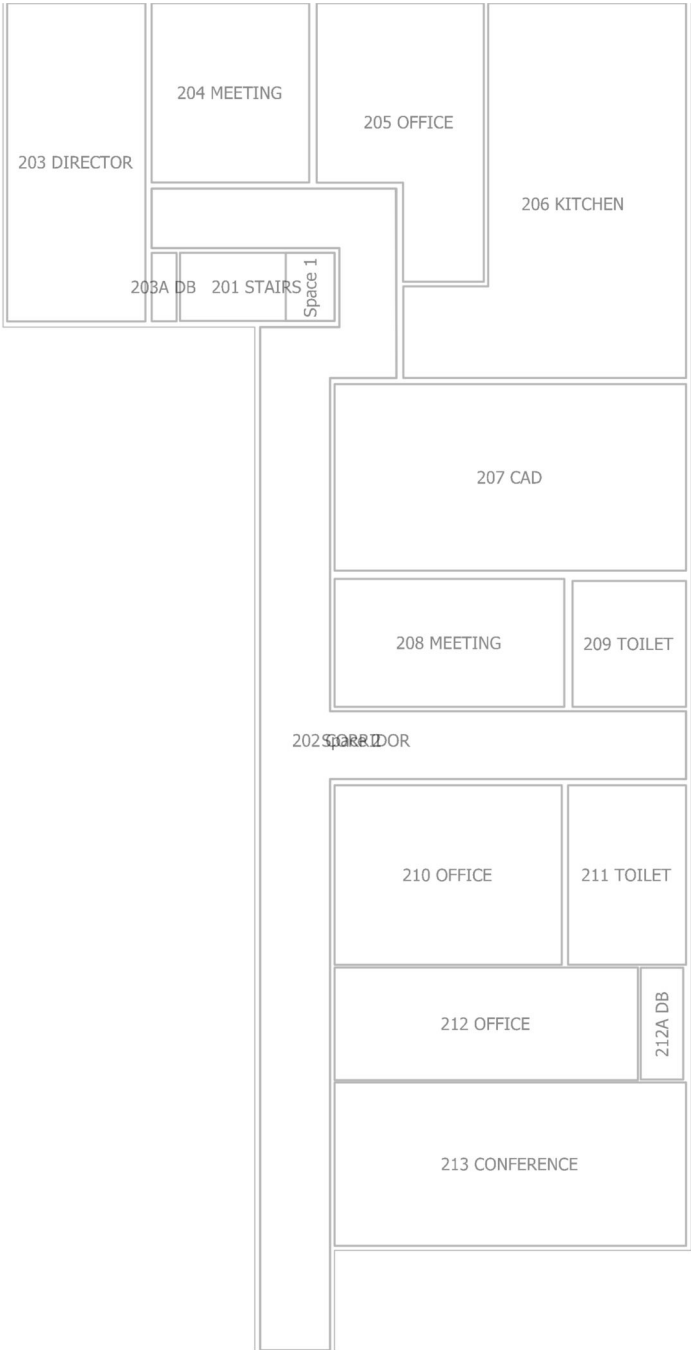

Building B · FIRST FOOR (Emergency light scene)

Room list

202 CORRIDOR

P_{total}
29.7 W**A_{Room}**
69.35 m²**Lighting power density**
0.43 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ
8	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)
9	ETAP	-	K9R142/1-AX1 (_LTRRevAB)	2.5 W	80 lm (100 %)

203 DIRECTOR

P_{total}
0.9 W**A_{Room}**
25.83 m²**Lighting power density**
0.03 W/m² (Space)**E_{min} (Anti panic surface)**
1.81 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

204 MEETING

P_{total}
0.9 W**A_{Room}**
16.60 m²**Lighting power density**
0.05 W/m² (Space)**E_{min} (Anti panic surface)**
2.55 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

Building B · FIRST FOOR (Emergency light scene)

Room list

205 OFFICE

P_{total} 0.9 W	A_{Room} 22.32 m ²	Lighting power density 0.04 W/m ² (Space)	E_{min} (Anti panic surface) 1.52 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

206 KITCHEN

P_{total} 0.9 W	A_{Room} 48.10 m ²	Lighting power density 0.02 W/m ² (Space)	E_{min} (Anti panic surface) 1.10 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

207 CAD

P_{total} 0.9 W	A_{Room} 38.48 m ²	Lighting power density 0.02 W/m ² (Space)	E_{min} (Anti panic surface) 1.16 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

Building B · FIRST FOOR (Emergency light scene)

Room list

208 MEETING

P_{total} 0.9 W	A_{Room} 17.26 m ²	Lighting power density 0.05 W/m ² (Space)	E_{min} (Anti panic surface) 2.02 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

209 TOILET

P_{total} 0.9 W	A_{Room} 8.39 m ²	Lighting power density 0.11 W/m ² (Space)	E_{min} (Anti panic surface) 2.52 lx
-----------------------------------	--	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

210 OFFICE

P_{total} 0.9 W	A_{Room} 23.95 m ²	Lighting power density 0.04 W/m ² (Space)	E_{min} (Anti panic surface) 2.07 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

Building B · FIRST FOOR (Emergency light scene)

Room list

211 TOILET

P_{total}
0.9 W**A_{Room}**
12.43 m²**Lighting power density**
0.07 W/m² (Space)**E_{min} (Anti panic surface)**
2.16 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

212 OFFICE

P_{total}
0.9 W**A_{Room}**
20.07 m²**Lighting power density**
0.04 W/m² (Space)**E_{min} (Anti panic surface)**
1.80 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

213 CONFERENCE

P_{total}
0.9 W**A_{Room}**
33.71 m²**Lighting power density**
0.03 W/m² (Space)**E_{min} (Anti panic surface)**
1.57 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

Building B · FIRST FOOR (Emergency light scene)

Room list

Space 1

P_{total}
0.9 W

A_{Room}
1.95 m²


Lighting power density
0.46 W/m² (Space)

E_{min} (Anti panic surface)
3.12 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm (100 %)

Building B · FIRST FOOR (Light scene 1)

Room list

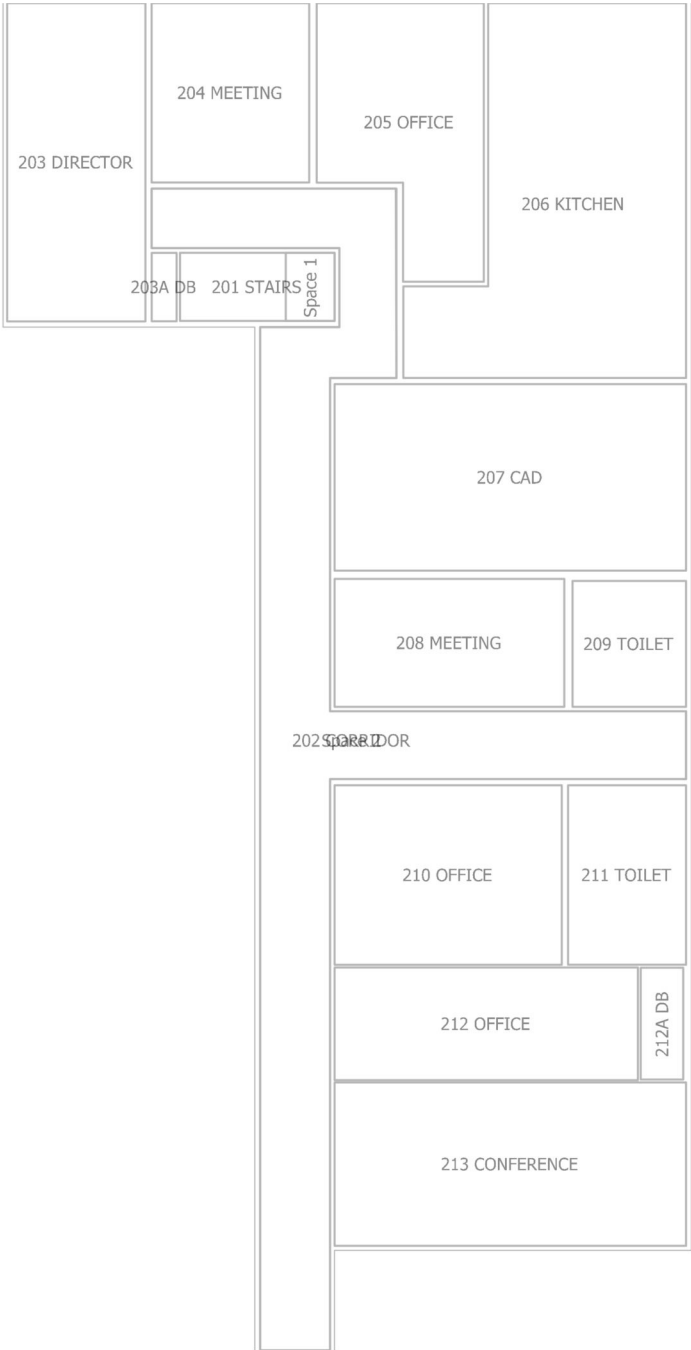

Building B · FIRST FOOR (Light scene 1)

Room list

201 STAIRS

P_{total}
28.0 W**A_{Room}**
6.18 m²**Lighting power density**
4.53 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	ETAP	-	R3111/LEDW445DX1 (_LTRevAC)	28.0 W	4291 lm

202 CORRIDOR

P_{total}
330.0 W**A_{Room}**
69.35 m²**Lighting power density**
4.76 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
11	ETAP	-	R3111/LEDW445DX1 (_LTRevAC)	28.0 W	4291 lm
1	ETAP	-	R810R1/LEDW25D (_LTRevAC)	22.0 W	2499 lm

203 DIRECTOR

P_{total}
106.0 W**A_{Room}**
25.83 m²**Lighting power density**
4.10 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	26.5 W	4291 lm

Building B · FIRST FOOR (Light scene 1)

Room list

203A DB

P_{total}
26.5 W**A_{Room}**
1.00 m²**Lighting power density**
26.50 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	26.5 W	4291 lm

204 MEETING

P_{total}
106.0 W**A_{Room}**
16.60 m²**Lighting power density**
6.39 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	26.5 W	4291 lm

205 OFFICE

P_{total}
132.5 W**A_{Room}**
22.32 m²**Lighting power density**
5.94 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
5	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	26.5 W	4291 lm

Building B · FIRST FOOR (Light scene 1)

Room list

206 KITCHEN

P_{total}
185.5 W

A_{Room}
48.10 m²

Lighting power density
3.86 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
7	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	26.5 W	4291 lm

207 CAD

P_{total}
238.5 W

A_{Room}
38.48 m²

Lighting power density
6.20 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
9	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	26.5 W	4291 lm

208 MEETING

P_{total}
159.0 W

A_{Room}
17.26 m²

Lighting power density
9.21 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
6	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	26.5 W	4291 lm

Building B · FIRST FOOR (Light scene 1)

Room list

209 TOILET

P_{total}
26.5 W

A_{Room}
8.39 m²

Lighting power density
3.16 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	26.5 W	4291 lm

210 OFFICE

P_{total}
238.5 W

A_{Room}
23.95 m²

Lighting power density
9.96 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
9	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	26.5 W	4291 lm

211 TOILET

P_{total}
26.5 W

A_{Room}
12.43 m²

Lighting power density
2.13 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	26.5 W	4291 lm

Building B · FIRST FOOR (Light scene 1)

Room list

212 OFFICE

P_{total}
212.0 W

A_{Room}
20.07 m²

Lighting power density
10.57 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
8	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	26.5 W	4291 lm

212A DB

P_{total}
26.5 W

A_{Room}
2.79 m²

Lighting power density
9.49 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	26.5 W	4291 lm

213 CONFERENCE

P_{total}
212.0 W

A_{Room}
33.71 m²

Lighting power density
6.29 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
8	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	26.5 W	4291 lm

Building B · FIRST FOOR (Light scene 1)

Room list

Space 1

P_{total}
28.0 W

A_{Room}
1.95 m²

Lighting power density
14.35 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	ETAP	-	R3111/LEDW445DX1 (_LTRevAC)	28.0 W	4291 lm

Building B · FIRST FOOR


Luminaire list

Φ_{total} 340320 lm	P_{total} 2122.5 W	Luminous efficacy 160.3 lm/W	$\Phi_{\text{Emergency lighting}}$ 6720 lm	$P_{\text{Emergency lighting}}$ 40.5 W
------------------------------------	--------------------------------	---------------------------------	---	---

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
20	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	-
9	ETAP	-	K9R142/1-AX1 (_LTRRevAB)	2.5 W	80 lm	32.4 lm/W
				 2.5 W	80 lm (100 %)	-
64	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	26.5 W	4291 lm	161.9 lm/W
13	ETAP	-	R3111/LEDW445DX1 (_LTRRevAC)	28.0 W	4291 lm	153.3 lm/W
1	ETAP	-	R810R1/LEDW25D (_LTRRevAC)	22.0 W	2499 lm	113.6 lm/W

Building B · FIRST FOOR (Emergency light scene)

Calculation objects

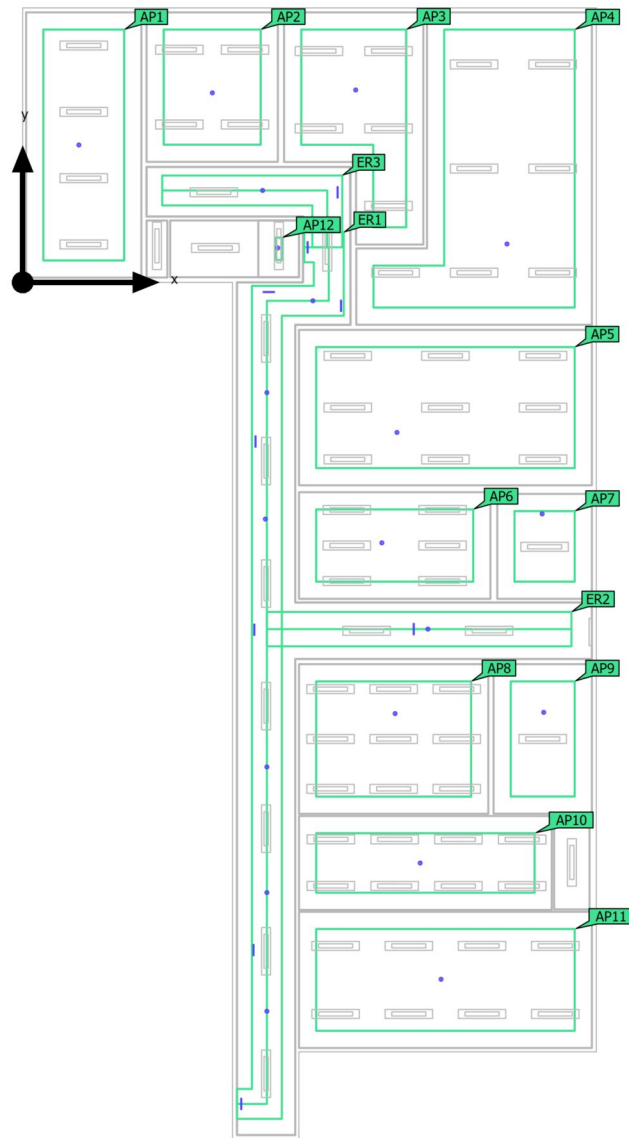

Building B · FIRST FOOR (Emergency light scene)

Calculation objects

Anti panic surfaces

Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (203 DIRECTOR) Perpendicular illuminance (adaptive) Height: 0.000 m	1.81 lx (≥ 0.50 lx) ✓	3.08 lx	0.59 (≥ 0.025) ✓	AP1
Anti panic surface (204 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	2.55 lx (≥ 0.50 lx) ✓	3.09 lx	0.83 (≥ 0.025) ✓	AP2
Anti panic surface (205 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.52 lx (≥ 0.50 lx) ✓	3.08 lx	0.49 (≥ 0.025) ✓	AP3
Anti panic surface (206 KITCHEN) Perpendicular illuminance (adaptive) Height: 0.000 m	1.10 lx (≥ 0.50 lx) ✓	3.10 lx	0.35 (≥ 0.025) ✓	AP4
Anti panic surface (207 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.16 lx (≥ 0.50 lx) ✓	3.08 lx	0.38 (≥ 0.025) ✓	AP5
Anti panic surface (208 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	2.02 lx (≥ 0.50 lx) ✓	3.08 lx	0.66 (≥ 0.025) ✓	AP6
Anti panic surface (209 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m	2.52 lx (≥ 0.50 lx) ✓	3.08 lx	0.82 (≥ 0.025) ✓	AP7
Anti panic surface (210 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	2.07 lx (≥ 0.50 lx) ✓	3.08 lx	0.67 (≥ 0.025) ✓	AP8
Anti panic surface (211 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m	2.16 lx (≥ 0.50 lx) ✓	3.07 lx	0.70 (≥ 0.025) ✓	AP9
Anti panic surface (212 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.80 lx (≥ 0.50 lx) ✓	3.08 lx	0.58 (≥ 0.025) ✓	AP10
Anti panic surface (213 CONFERENCE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.57 lx (≥ 0.50 lx) ✓	3.08 lx	0.51 (≥ 0.025) ✓	AP11

Building B · FIRST FOOR (Emergency light scene)

Calculation objects

Anti panic surfaces

Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (Space 1) Perpendicular illuminance (adaptive) Height: 0.000 m	3.12 lx (≥ 0.50 lx) ✓	3.12 lx	1.00 (≥ 0.025) ✓	AP12

Escape routes


Properties	E_{min} Middle area (Target)	E_{max} Middle area	E_{min} Centerline (Target)	E_{max} Centerline	U_d (Target)	Index
Emergency route 1 Perpendicular illuminance (adaptive) Height: 2.000 m	2.09 lx (≥ 0.50 lx) ✓	46.5 lx	2.84 lx (≥ 1.00 lx) ✓	39.7 lx	0.071 (≥ 0.025) ✓	ER1
Emergency route 2 Perpendicular illuminance (adaptive) Height: 0.000 m	1.65 lx (≥ 0.50 lx) ✓	9.38 lx	1.67 lx (≥ 1.00 lx) ✓	9.17 lx	0.18 (≥ 0.025) ✓	ER2
Emergency route 3 Perpendicular illuminance (adaptive) Height: 0.000 m	2.03 lx (≥ 0.50 lx) ✓	12.4 lx	2.03 lx (≥ 1.00 lx) ✓	12.4 lx	0.16 (≥ 0.025) ✓	ER3

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR (Light scene 1)

Calculation objects

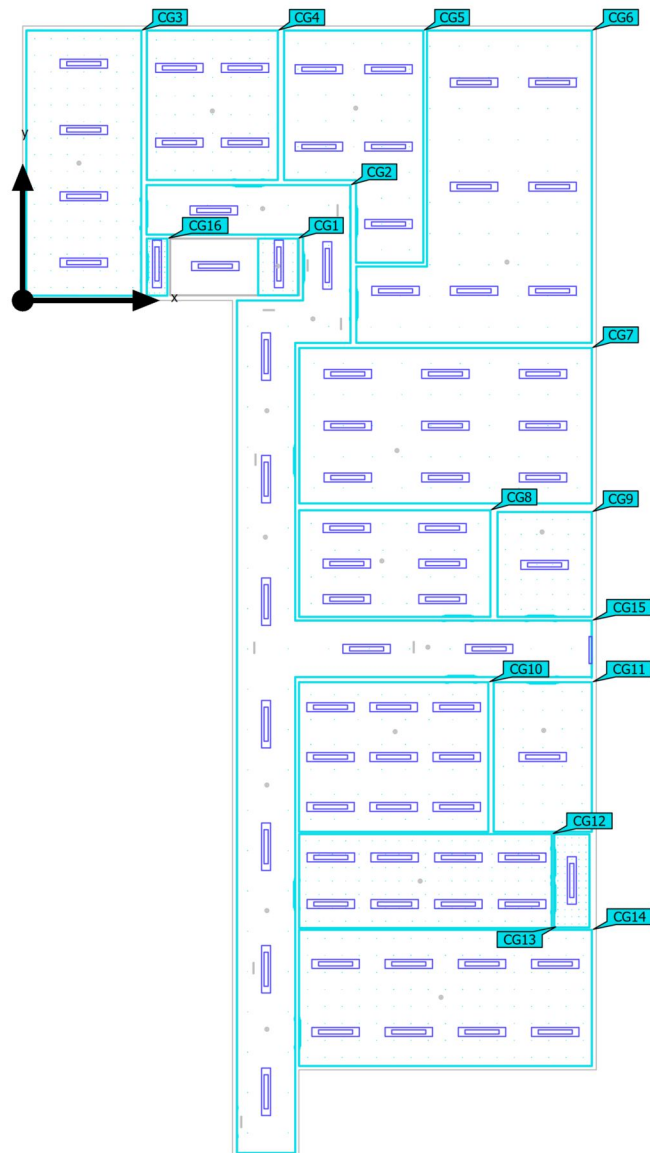

Building B · FIRST FOOR (Light scene 1)

Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
201 Stairs Perpendicular illuminance Height: 0.000 m	282 lx	238 lx	314 lx	0.84	0.76	CG1
202 Corridor Perpendicular illuminance Height: 0.000 m	283 lx	171 lx	515 lx	0.60	0.33	CG2
202 Corridor Wall Perpendicular illuminance Height: 1.650 m	186 lx	42.5 lx	1946 lx	0.23	0.022	CG15
203 Director Perpendicular illuminance Height: 0.700 m	398 lx	213 lx	561 lx	0.54	0.38	CG3
203A DB Perpendicular illuminance Height: 0.000 m	186 lx	169 lx	196 lx	0.91	0.86	CG16
204 Meeting Perpendicular illuminance Height: 0.700 m	553 lx	371 lx	677 lx	0.67	0.55	CG4
205 Office Perpendicular illuminance Height: 0.700 m	530 lx	356 lx	669 lx	0.67	0.53	CG5
206 Kitchen Perpendicular illuminance Height: 0.850 m	391 lx	197 lx	513 lx	0.50	0.38	CG6
207 CAD Perpendicular illuminance Height: 0.700 m	635 lx	423 lx	801 lx	0.67	0.53	CG7
208 Meeting Perpendicular illuminance Height: 0.700 m	796 lx	567 lx	989 lx	0.71	0.57	CG8
209 Toilet Perpendicular illuminance Height: 0.000 m	193 lx	143 lx	244 lx	0.74	0.59	CG9

Building B · FIRST FOOR (Light scene 1)

Calculation objects

210 Office Perpendicular illuminance Height: 0.700 m	959 lx	636 lx	1174 lx	0.66	0.54	CG10
211 Toilet Perpendicular illuminance Height: 0.000 m	155 lx	95.1 lx	225 lx	0.61	0.42	CG11
212 Office Perpendicular illuminance Height: 0.700 m	887 lx	561 lx	1078 lx	0.63	0.52	CG12
212A DB Perpendicular illuminance Height: 0.000 m	261 lx	201 lx	303 lx	0.77	0.66	CG13
213 Conference Perpendicular illuminance Height: 0.700 m	620 lx	370 lx	759 lx	0.60	0.49	CG14

Building B · FIRST FOOR (Light scene 1)

Calculation objects


207 CAD (RUG)

Strongest glare at	15°
max	18.9
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG7

Building B · FIRST FOOR (Light scene 1)



Calculation objects

207 CAD (RUG)

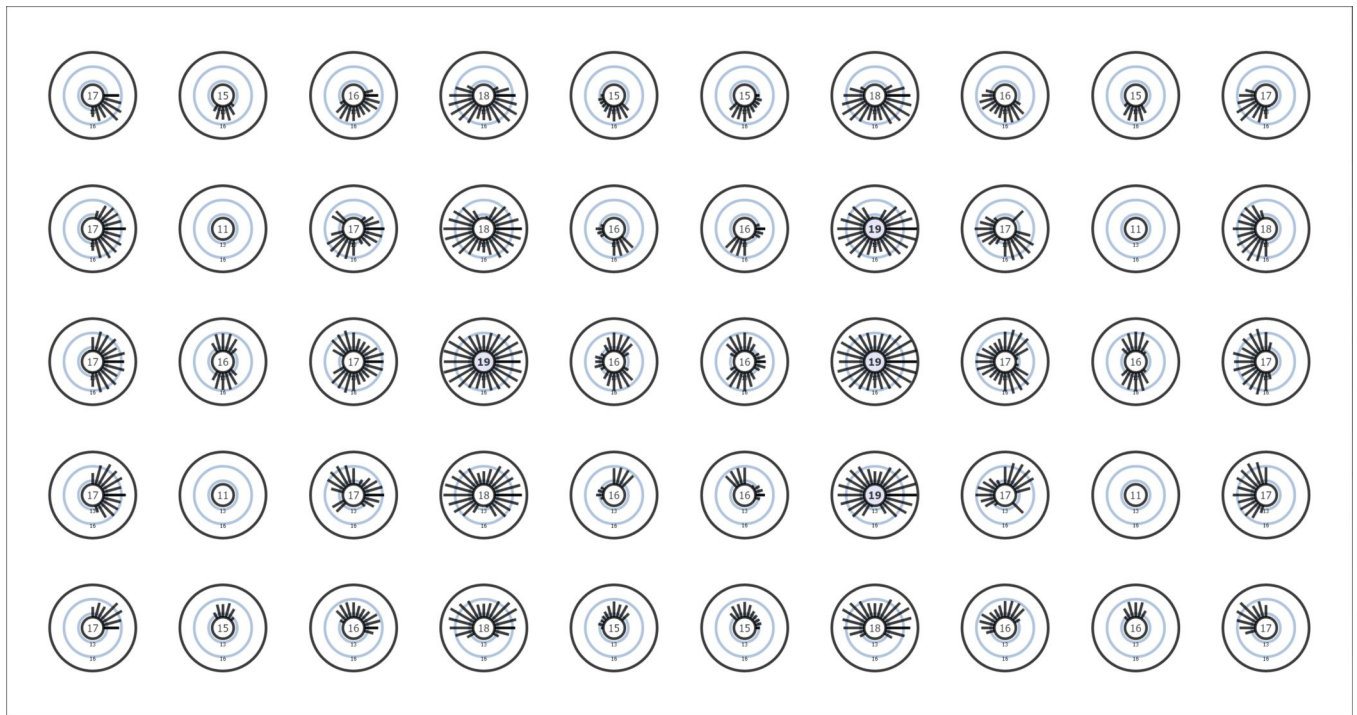

Building B · FIRST FOOR (Emergency light scene)

Emergency route 1

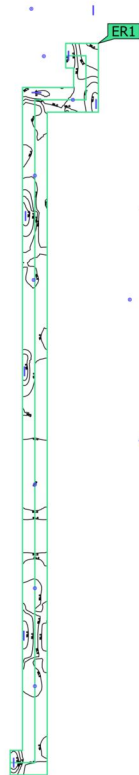


Properties	E_{min} Middle area (Target)	E_{max} Middle area	E_{min} Centerline (Target)	E_{max} Centerline	U_d (Target)	Index
Emergency route 1 Perpendicular illuminance (adaptive) Height: 2.000 m	2.09 lx (≥ 0.50 lx) ✓	46.5 lx	2.84 lx (≥ 1.00 lx) ✓	39.7 lx	0.071 (≥ 0.025) ✓	ER1

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR (Emergency light scene)

Emergency route 2

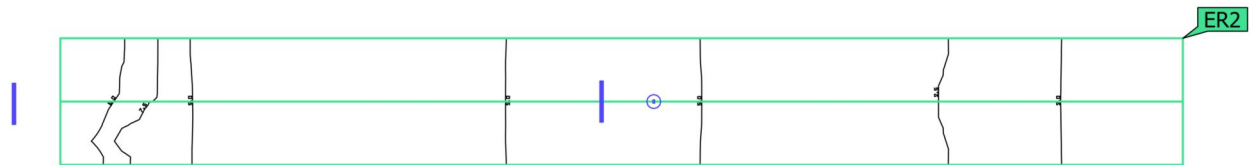


Properties	E_{min} Middle area (Target)	E_{max} Middle area	E_{min} Centerline (Target)	E_{max} Centerline	U_d (Target)	Index
Emergency route 2 Perpendicular illuminance (adaptive) Height: 0.000 m	1.65 lx (≥ 0.50 lx) ✓	9.38 lx	1.67 lx (≥ 1.00 lx) ✓	9.17 lx	0.18 (≥ 0.025) ✓	ER2

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR (Emergency light scene)

Emergency route 3

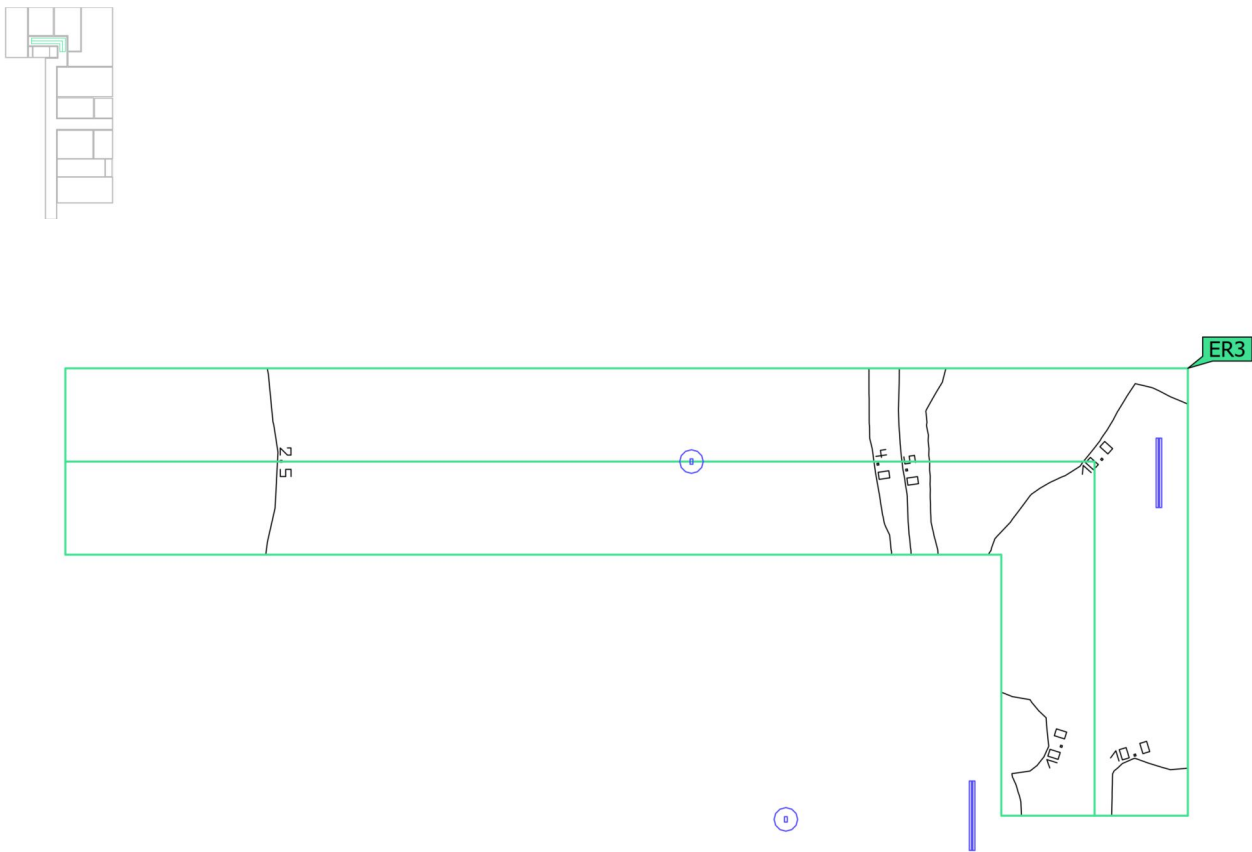


Properties	E_{min} Middle area (Target)	E_{max} Middle area	E_{min} Centerline (Target)	E_{max} Centerline	U_d (Target)	Index
Emergency route 3	2.03 lx	12.4 lx	2.03 lx	12.4 lx	0.16	ER3
Perpendicular illuminance (adaptive)	≥ 0.50 lx		≥ 1.00 lx		≥ 0.025	
Height: 0.000 m	✓		✓		✓	


Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 201 STAIRS

Luminaire layout plan

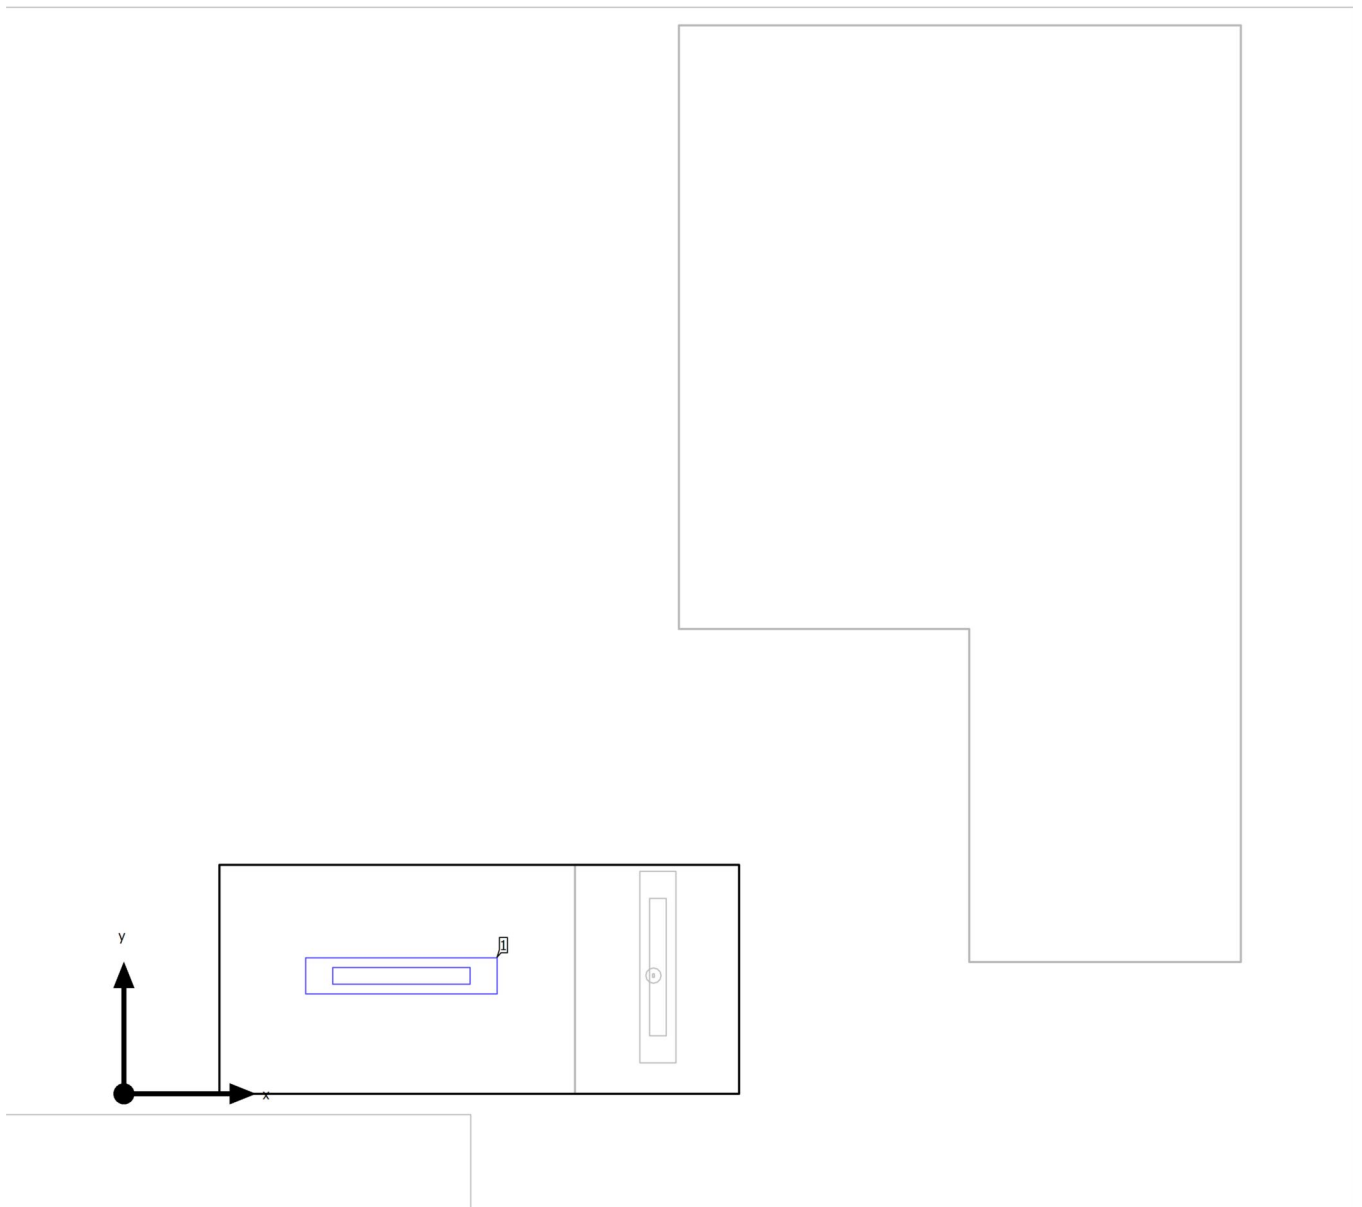

Building B · FIRST FOOR · 201 STAIRS

Luminaire layout plan

Manufacturer	ETAP	P	28.0 W
Article No.	-	$\Phi_{\text{Luminaire}}$	4291 lm
Article name	R3111/LEDW445DX1 (_LTRevAC)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
2.000 m	0.850 m	3.300 m	1

Building B · FIRST FOOR · 201 STAIRS


Luminaire list

Φ_{total} 4300 lm	P_{total} 28.0 W	Luminous efficacy 153.6 lm/W
----------------------------------	------------------------------	---------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	R3111/LEDW445DX1 (_LTRevAC)	28.0 W	4291 lm	153.3 lm/W

Building B · FIRST FOOR · 202 CORRIDOR (Emergency light scene)

Summary

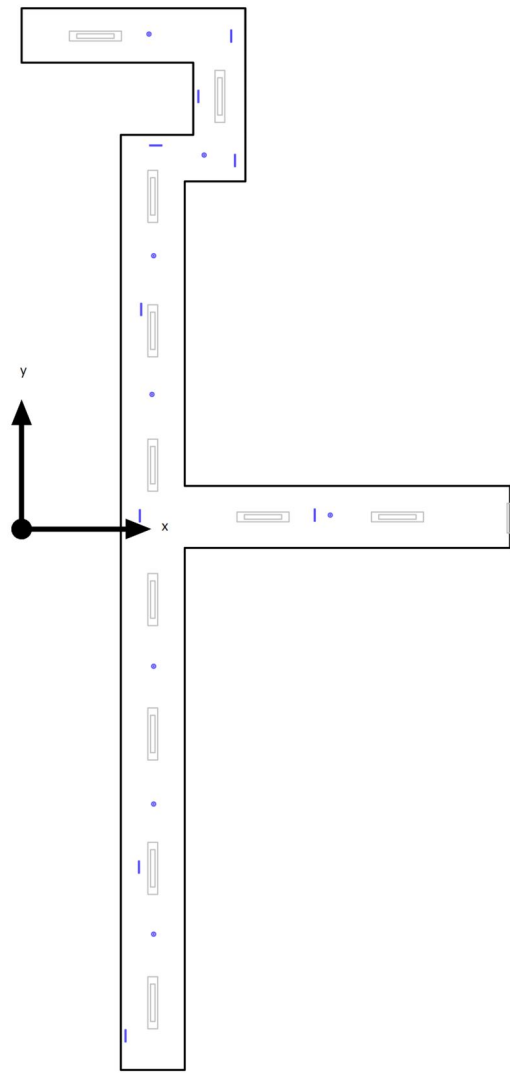

Ground area	69.35 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.86 (fixed)	Mounting height	3.300 m – 3.368 m

Building B · FIRST FOOR · 202 CORRIDOR (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.43 W/m ²	–		

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
8	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–
9	ETAP	-	K9R142/1-AX1 (_LTRRevAB)	2.5 W	80 lm	32.4 lm/W
				 2.5 W	80 lm (100 %)	–

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Summary

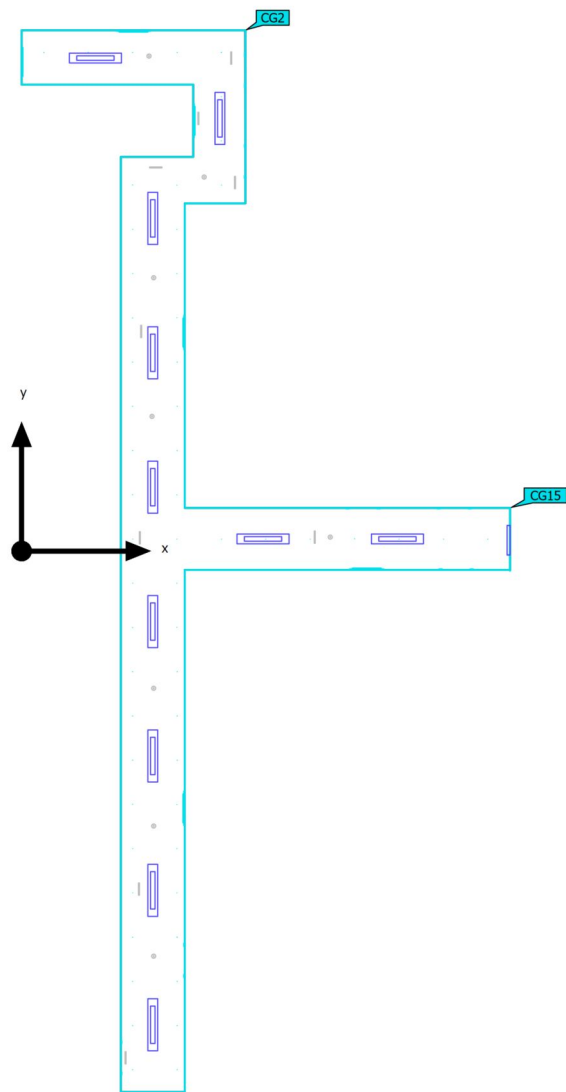

Ground area	69.35 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.86 (fixed)	Mounting height	2.800 m

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	24	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[592 - 817] kWh/a	max. 2450 kWh/a	✓	
Space	Lighting power density	4.76 W/m ²	–		

(1) Based on a rectangular space of 28.146 m x 12.950 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
11	ETAP	-	R3111/LEDW445DX1 (_LTRRevAC)	15	28.0 W	4291 lm	153.3 lm/W
1	ETAP	-	R810R1/LEDW25D (_LTRRevAC)	24	22.0 W	2499 lm	113.6 lm/W

Building B · FIRST FOOR · 202 CORRIDOR

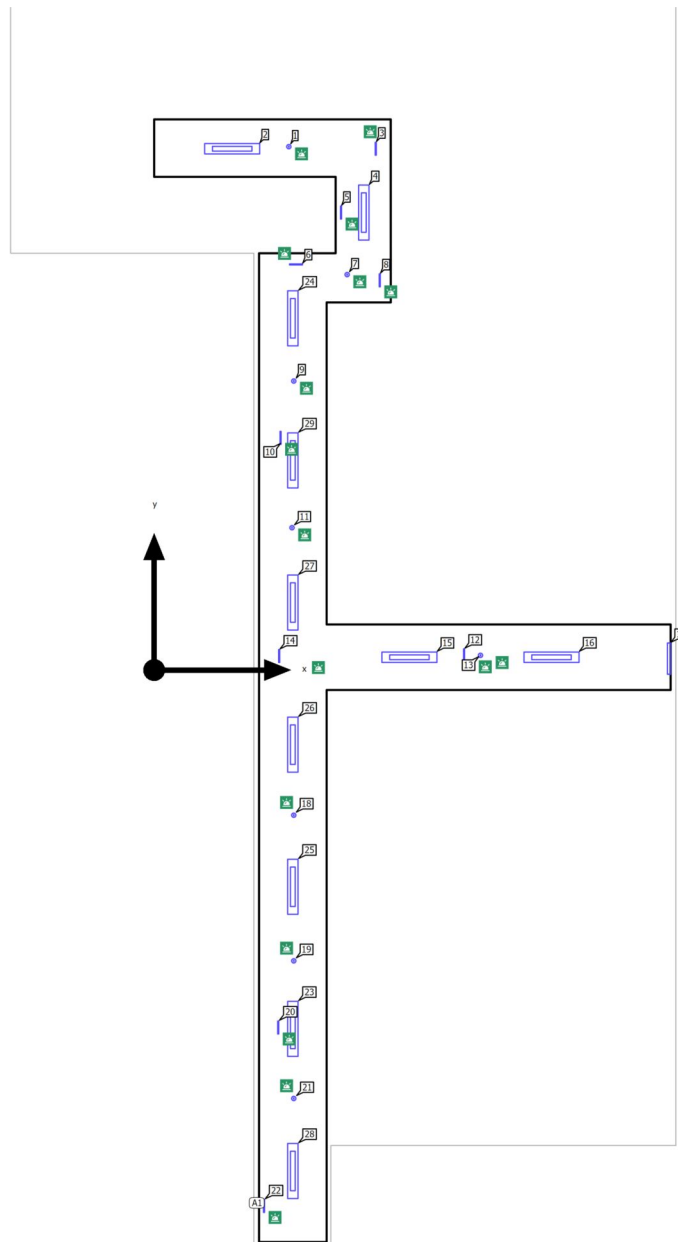Luminaire layout plan

Building B · FIRST FOOR · 202 CORRIDOR


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
3.376 m	13.122 m	3.368 m	1
4.838 m	9.915 m	3.368 m	7
3.500 m	7.245 m	3.368 m	9
3.456 m	3.569 m	3.368 m	11
8.182 m	0.369 m	3.368 m	13
3.500 m	-3.638 m	3.368 m	18
3.500 m	-7.290 m	3.368 m	19
3.500 m	-10.740 m	3.368 m	21

Building B · FIRST FOOR · 202 CORRIDOR


Luminaire layout plan

Manufacturer	ETAP	P	2.5 W
Article No.	-	P _{Emergency lighting}	2.5 W
Article name	K9R142/1-AX1 (_LTRevAB)	Φ _{Luminaire}	80 lm
Fitting	1x sign with picto	Φ _{Emergency lighting}	80 lm
		ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
5.556 m	13.069 m	3.300 m	3
4.685 m	11.469 m	3.300 m	5
3.556 m	10.169 m	3.300 m	6
5.656 m	9.769 m	3.300 m	8
3.169 m	5.822 m	3.300 m	10
7.770 m	0.369 m	3.300 m	12
3.134 m	0.351 m	3.300 m	14
3.110 m	-8.962 m	3.300 m	20
2.754 m	-13.435 m	3.300 m	22

Building B · FIRST FOOR · 202 CORRIDOR

Luminaire layout plan

Manufacturer	ETAP	P	28.0 W
Article No.	-	Φ _{Luminaire}	4291 lm
Article name	R3111/LEDW445DX1 (_LTRRevAC)		
Fitting	1x LED		

7 x ETAP R3111/LEDW445DX1 (_LTRRevAC)

Type	Line arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	3.477 m / 8.819 m / 2.800 m	3.477 m	-8.996 m	2.800 m	23
X-direction	7 pcs., Centre - centre, 3.563 m	3.477 m	8.819 m	2.800 m	24
Arrangement	A1	3.477 m	-5.433 m	2.800 m	25
		3.477 m	-1.870 m	2.800 m	26
		3.477 m	1.693 m	2.800 m	27
		3.477 m	-12.559 m	2.800 m	28
		3.477 m	5.256 m	2.800 m	29

Individual luminaires


X	Y	Mounting height	Luminaire
1.956 m	13.069 m	2.800 m	2
5.256 m	11.469 m	2.800 m	4

Building B · FIRST FOOR · 202 CORRIDOR

Luminaire layout plan

X	Y	Mounting height	Luminaire
6.400 m	0.321 m	2.800 m	15
9.963 m	0.321 m	2.800 m	16

Building B · FIRST FOOR · 202 CORRIDOR

Luminaire layout plan

Manufacturer	ETAP	P	22.0 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2499 lm
Article name	R810R1/LEDW25D (_LTRevAC)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
12.910 m	0.287 m	2.800 m	17

Building B · FIRST FOOR · 202 CORRIDOR


Luminaire list

Φ_{total} 52920 lm	P_{total} 359.7 W	Luminous efficacy 147.1 lm/W	$\Phi_{\text{Emergency lighting}}$ 3120 lm	$P_{\text{Emergency lighting}}$ 29.7 W
-----------------------------------	-------------------------------	---------------------------------	---	---

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
8	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	-
9	ETAP	-	K9R142/1-AX1 (_LTRRevAB)	2.5 W	80 lm	32.4 lm/W
				 2.5 W	80 lm (100 %)	-
11	ETAP	-	R31111/LEDW445DX1 (_LTRRevAC)	28.0 W	4291 lm	153.3 lm/W
1	ETAP	-	R810R1/LEDW25D (_LTRRevAC)	22.0 W	2499 lm	113.6 lm/W

Building B · FIRST FOOR · 202 CORRIDOR (Emergency light scene)

Calculation objects

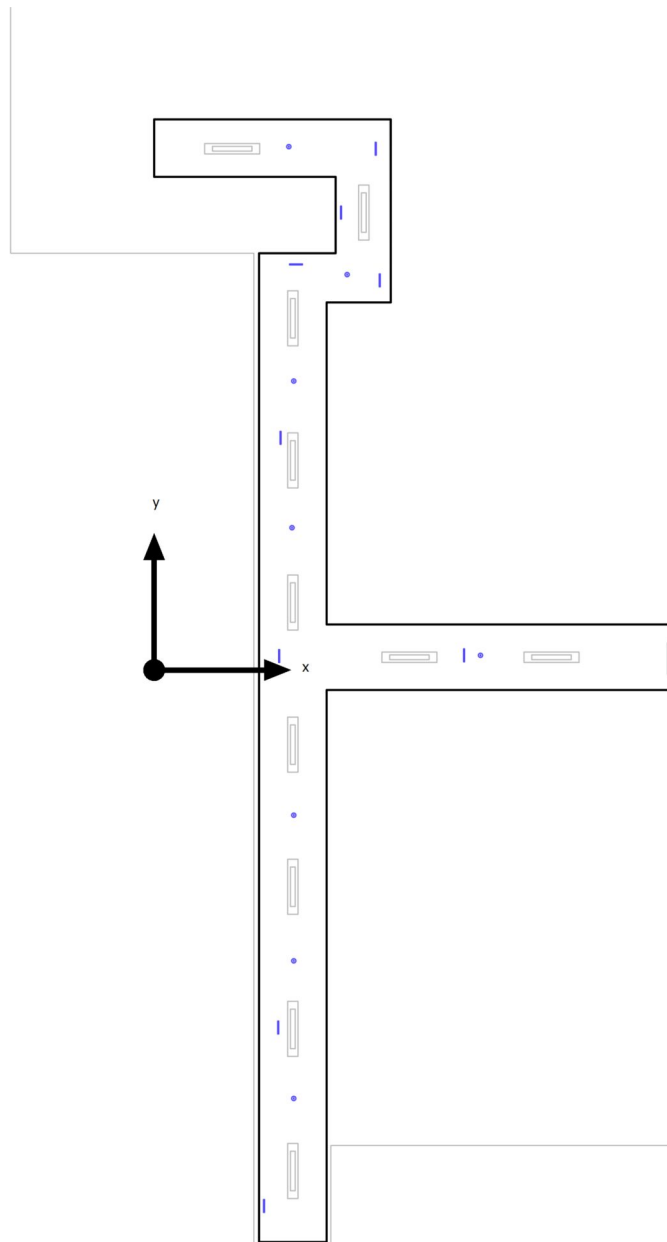

Building B · FIRST FOOR · 202 CORRIDOR (Emergency light scene)


Calculation objects

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Calculation objects

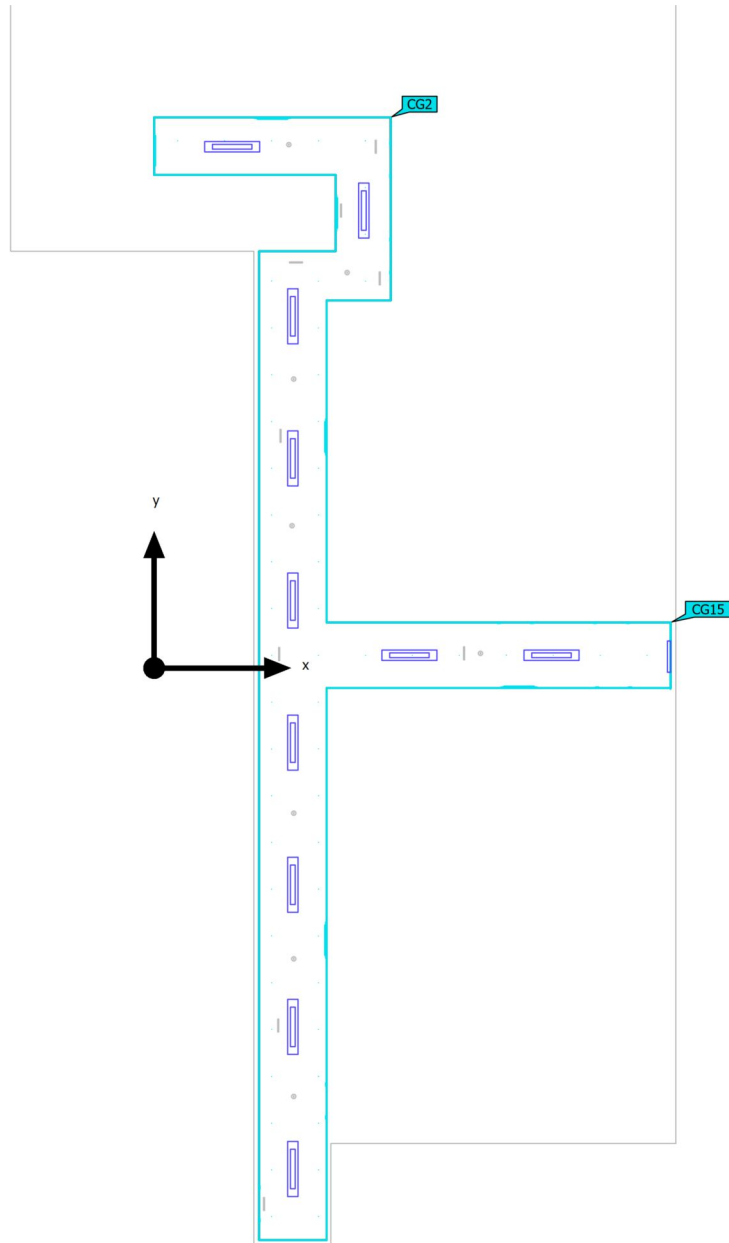

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)


Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
202 Corridor Perpendicular illuminance Height: 0.000 m	283 lx	171 lx	515 lx	0.60	0.33	CG2
202 Corridor Wall Perpendicular illuminance Height: 1.650 m	186 lx	42.5 lx	1946 lx	0.23	0.022	CG15

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Building B · FIRST FOOR · 202 CORRIDOR (Emergency light scene)
202 Corridor

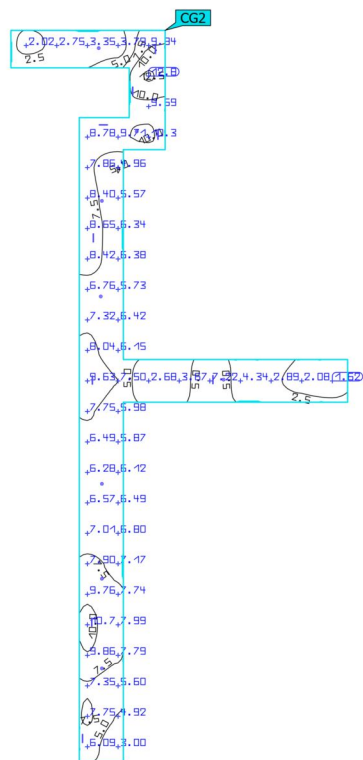

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
202 Corridor Perpendicular illuminance Height: 0.000 m	6.68 lx	1.62 lx	12.8 lx	0.24	0.13	CG2

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 202 CORRIDOR (Emergency light scene)
202 Corridor Wall

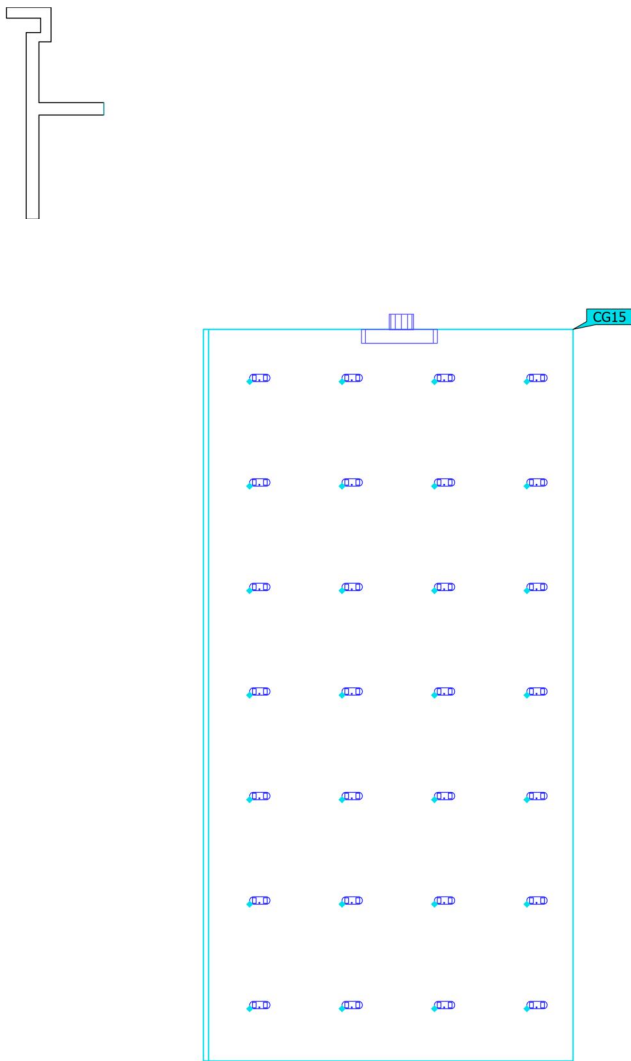


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
202 Corridor Wall Perpendicular illuminance Height: 1.650 m	0.00 lx	0.00 lx	0.00 lx	-	-	CG15

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

202 Corridor

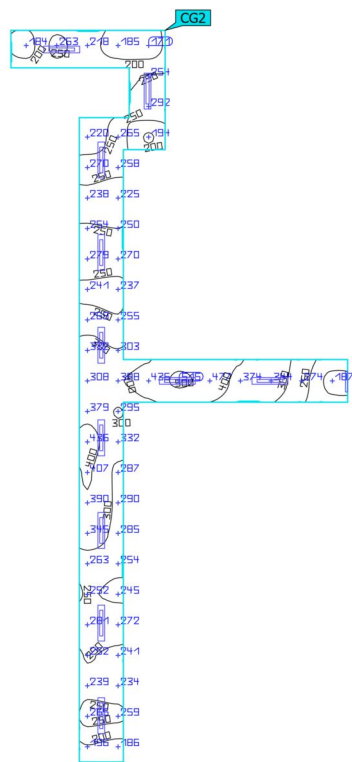


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
202 Corridor Perpendicular illuminance Height: 0.000 m	283 lx	171 lx	515 lx	0.60	0.33	CG2

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

202 Corridor Wall

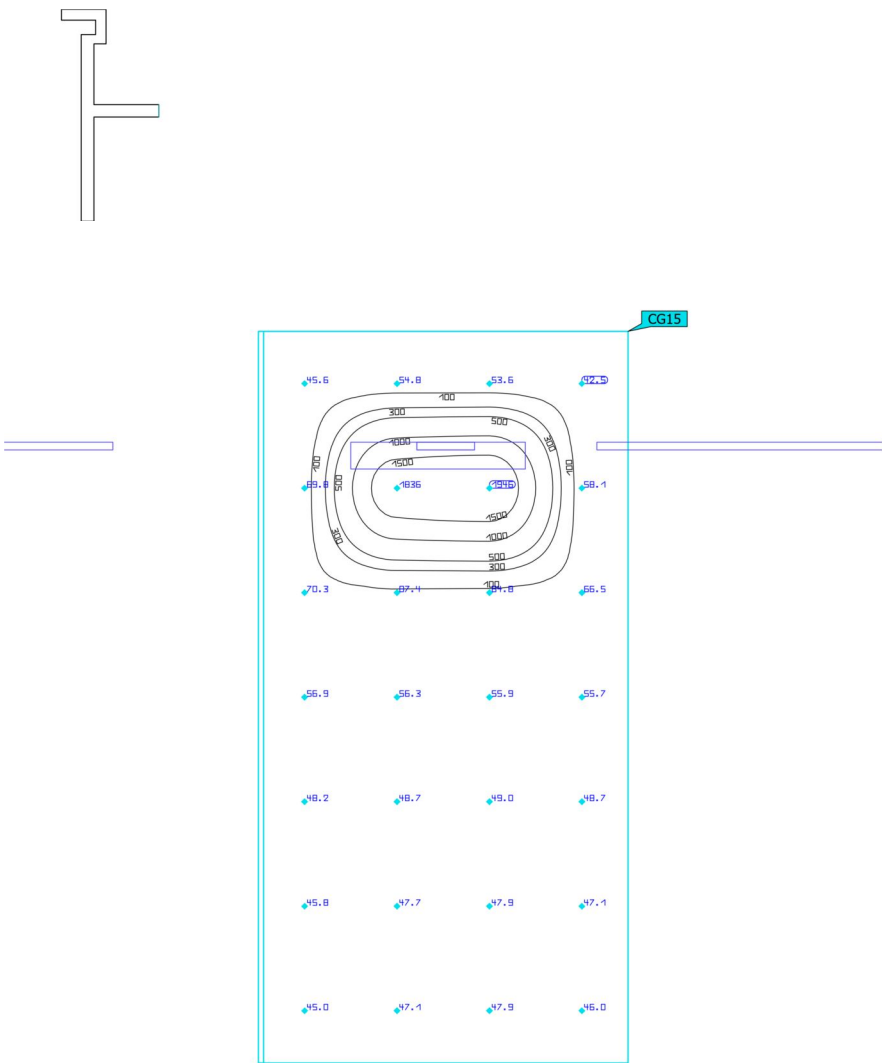


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
202 Corridor Wall Perpendicular illuminance Height: 1.650 m	186 lx	42.5 lx	1946 lx	0.23	0.022	CG15

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203 DIRECTOR (Emergency light scene)

Summary

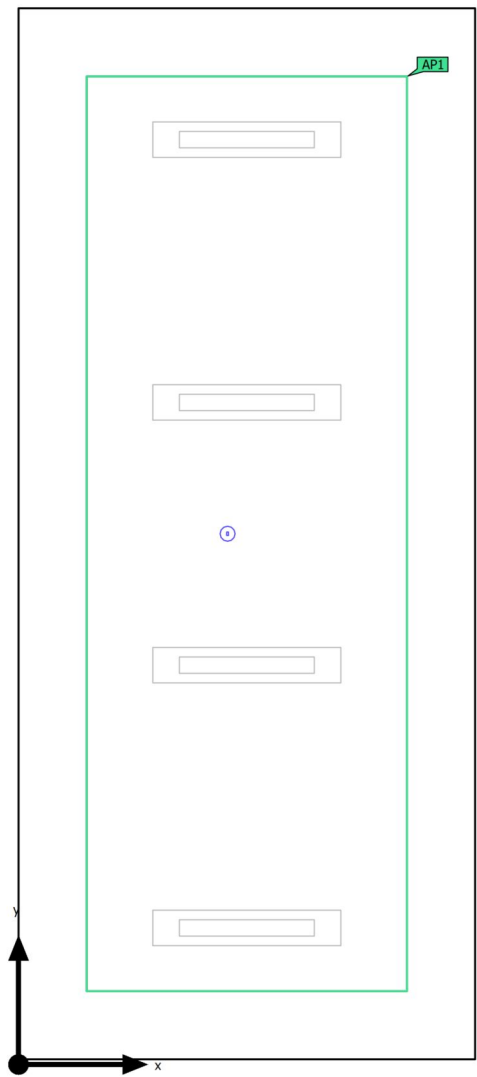

Ground area	25.83 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.88 (fixed)	Mounting height	3.368 m

Building B · FIRST FOOR · 203 DIRECTOR (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.03 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (203 DIRECTOR) Perpendicular illuminance (adaptive) Height: 0.000 m	1.81 lx (≥ 0.50 lx) ✓	3.08 lx	0.59 (≥ 0.025) ✓	AP1

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Summary

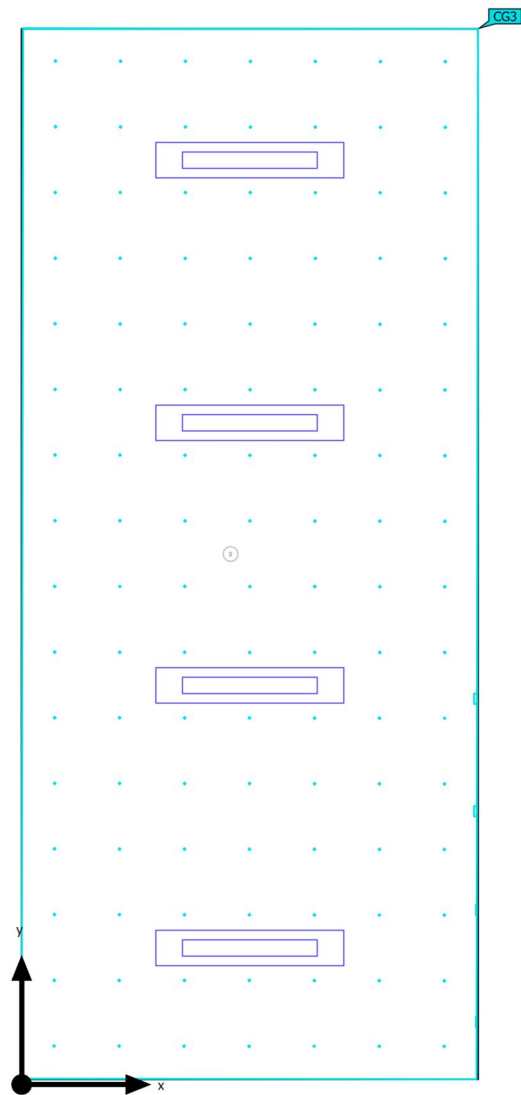

Ground area	25.83 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.88 (fixed)	Mounting height	2.800 m

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[165 - 262] kWh/a	max. 950 kWh/a	✓	
Space	Lighting power density	4.10 W/m ²	–		

(1) Based on a rectangular space of 3.350 m x 7.712 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
4	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 203 DIRECTOR

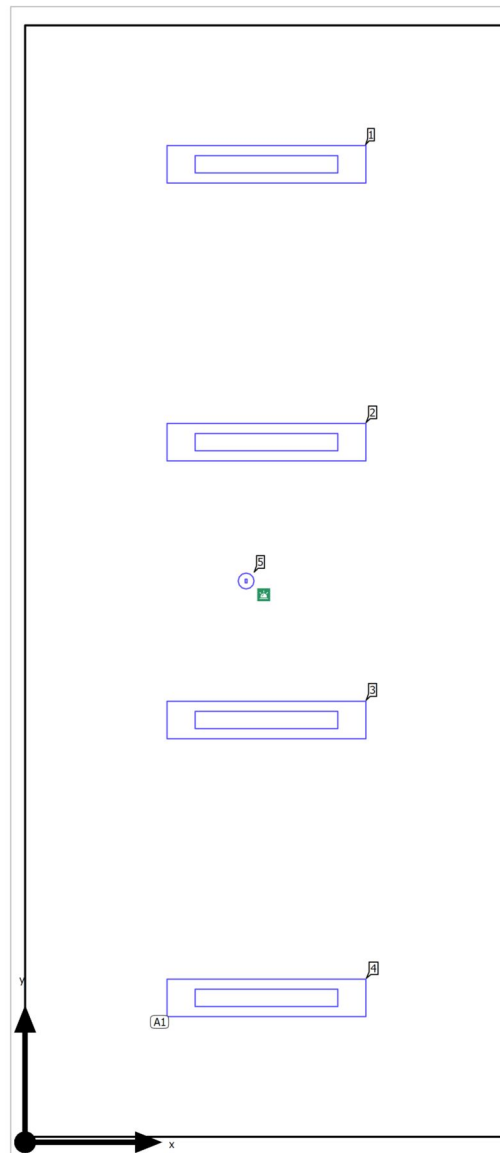Luminaire layout plan

Building B · FIRST FOOR · 203 DIRECTOR


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
1.534 m	3.894 m	3.368 m	5

Building B · FIRST FOOR · 203 DIRECTOR

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

4 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.675 m / 1.002 m / 2.800 m	1.675 m	6.786 m	2.800 m	1
X-direction	1 pcs., Centre - centre, 3.350 m	1.675 m	4.858 m	2.800 m	2
Y-direction	4 pcs., Centre - centre, 1.928 m	1.675 m	2.930 m	2.800 m	3
		1.675 m	1.002 m	2.800 m	4
Arrangement	A1				


Building B · FIRST FOOR · 203 DIRECTOR

Luminaire list

Φ_{total} 17500 lm		P_{total} 106.9 W		Luminous efficacy 163.7 lm/W		$\Phi_{\text{Emergency lighting}}$ 300 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)			0.9 W	300 lm	340.9 lm/W	
						 0.9 W	300 lm (100 %)	-	
4	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)			26.5 W	4291 lm	161.9 lm/W	

Building B · FIRST FOOR · 203 DIRECTOR (Emergency light scene)

Calculation objects

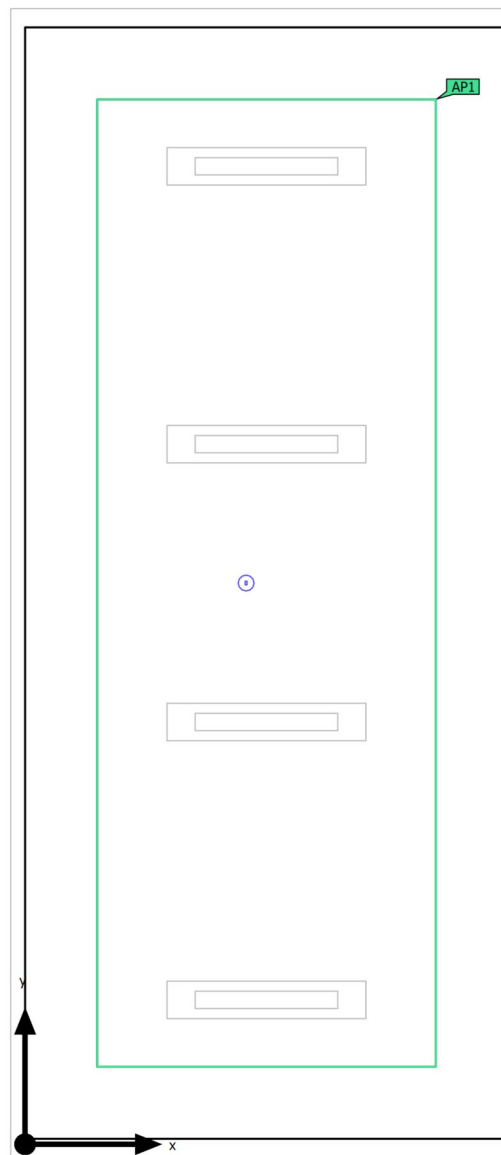

Building B · FIRST FOOR · 203 DIRECTOR (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (203 DIRECTOR) Perpendicular illuminance (adaptive) Height: 0.000 m	1.81 lx (≥ 0.50 lx) ✓	3.08 lx	0.59 (≥ 0.025) ✓	AP1

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Calculation objects

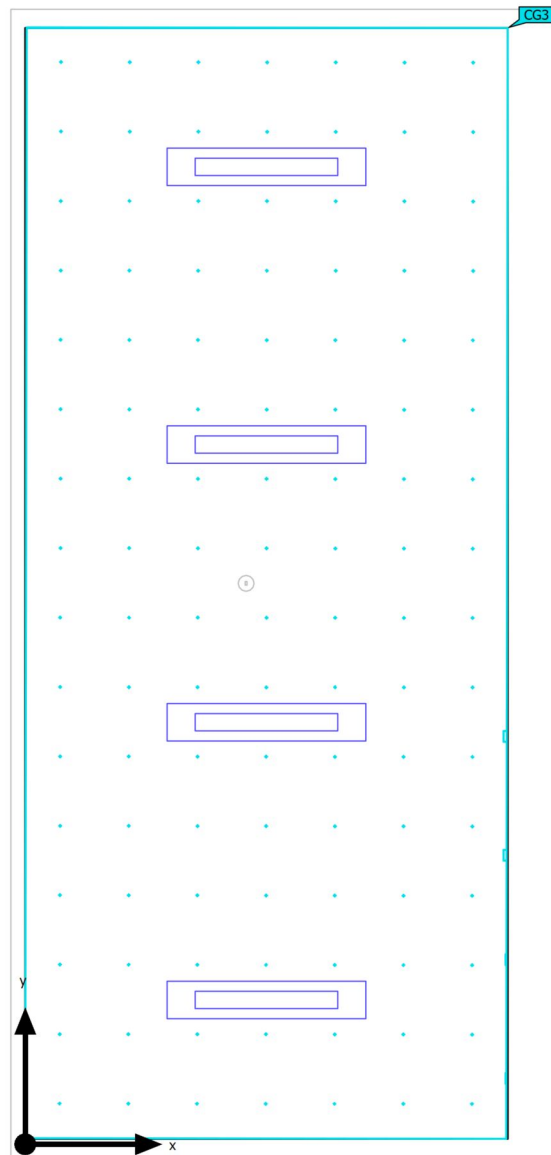

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
203 Director Perpendicular illuminance Height: 0.700 m	398 lx	213 lx	561 lx	0.54	0.38	CG3

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203 DIRECTOR (Emergency light scene)

Anti panic surface (203 DIRECTOR)

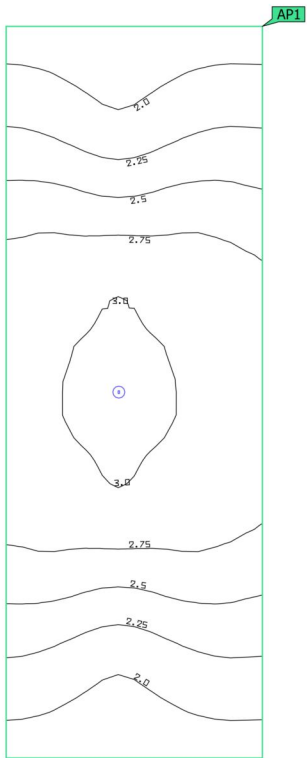


Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (203 DIRECTOR) Perpendicular illuminance (adaptive) Height: 0.000 m	1.81 lx (≥ 0.50 lx) ✓	3.08 lx	0.59 (≥ 0.025) ✓	AP1

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 203 DIRECTOR (Emergency light scene)

203 Director

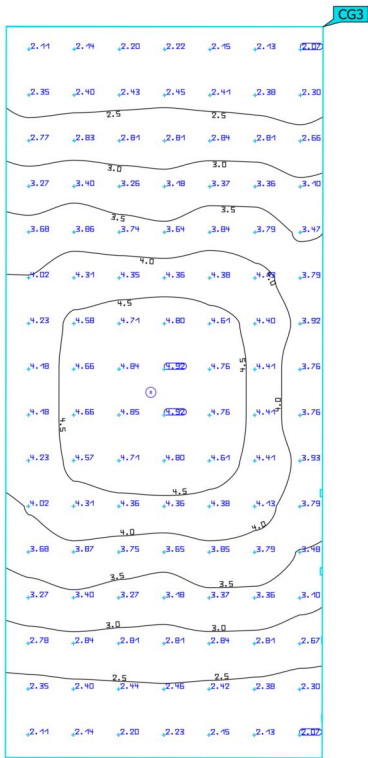


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
203 Director Perpendicular illuminance Height: 0.700 m	3.44 lx	2.07 lx	4.92 lx	0.60	0.42	CG3

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

203 Director

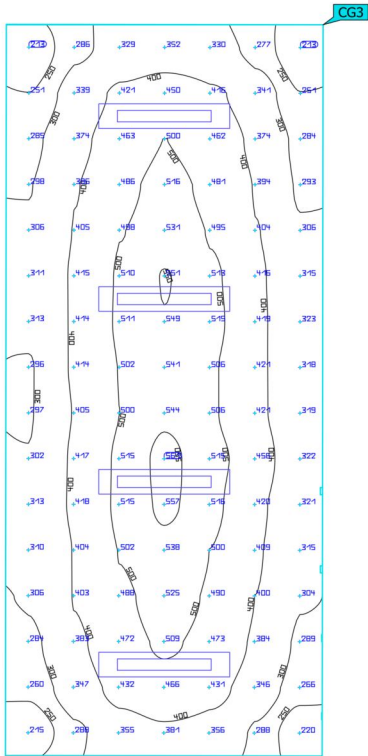


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
203 Director Perpendicular illuminance Height: 0.700 m	398 lx	213 lx	561 lx	0.54	0.38	CG3

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203A DB (Emergency light scene)

Summary

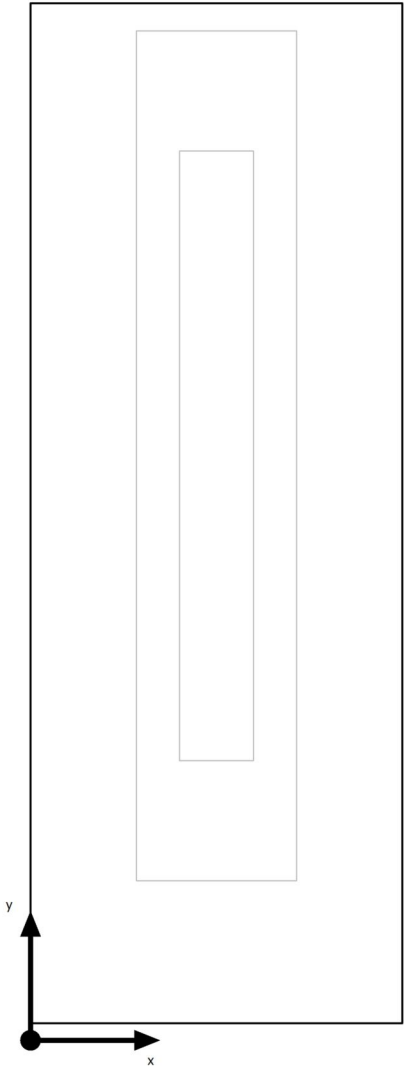

Ground area	1.00 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %		
Maintenance factor	0.88 (fixed)	Clearance height	3.300 m

Building B · FIRST FOOR · 203A DB (Emergency light scene)

Summary

Results


	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.00 W/m ²	–		

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 203A DB (Light scene 1)

Summary

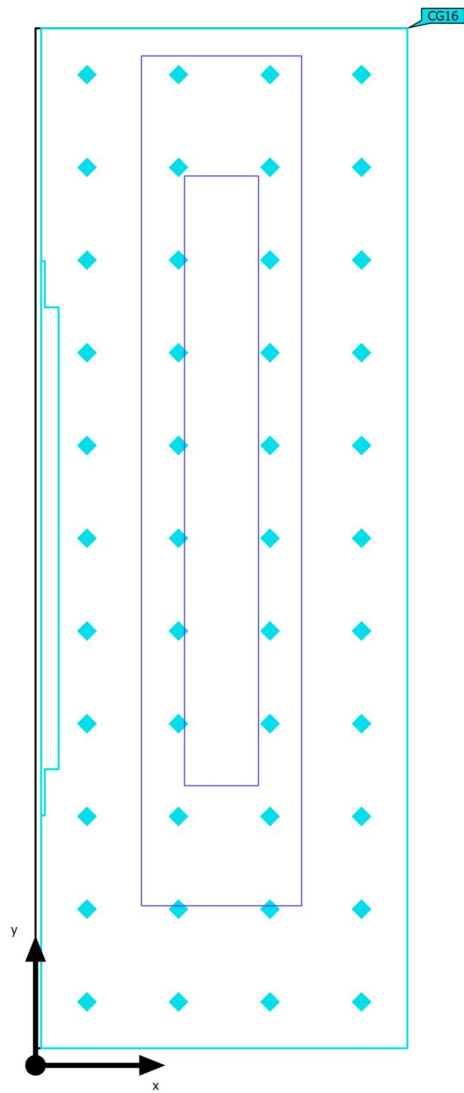

Ground area	1.00 m ²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.88 (fixed)	Mounting height	3.300 m

Building B · FIRST FOOR · 203A DB (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	65.6 kWh/a	max. 50 kWh/a	✗	
Space	Lighting power density	26.50 W/m ²	–		

(1) Based on a rectangular space of 1.656 m x 0.604 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
1	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 203A DB

Luminaire layout plan

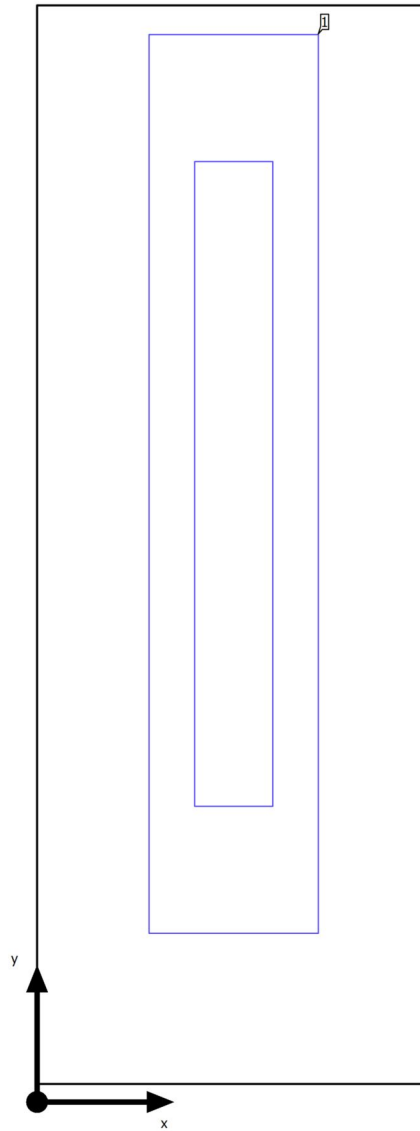

Building B · FIRST FOOR · 203A DB

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.302 m	0.949 m	3.300 m	1

Building B · FIRST FOOR · 203A DB

Luminaire list Φ_{total}

4300 lm

 P_{total}

26.5 W


Luminous efficacy

162.3 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 203A DB (Emergency light scene)

Calculation objects

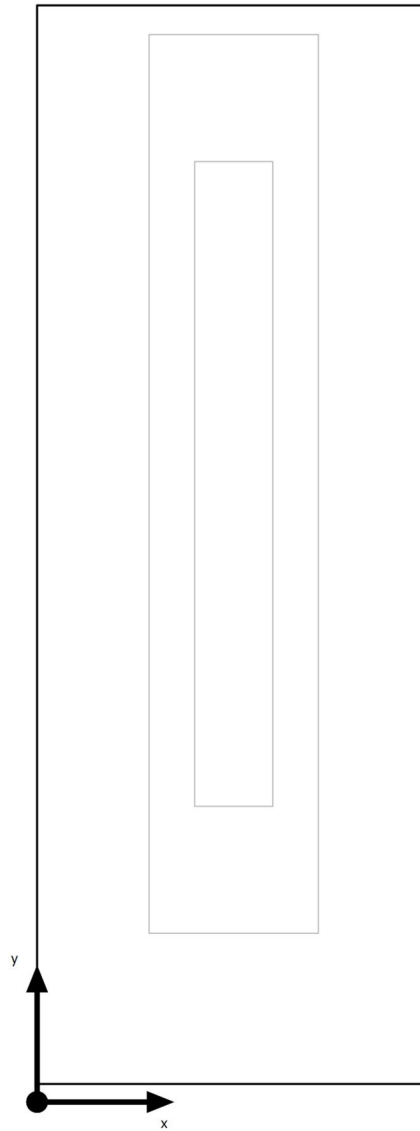

Building B · FIRST FOOR · 203A DB (Emergency light scene)


Calculation objects

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 203A DB (Light scene 1)

Calculation objects

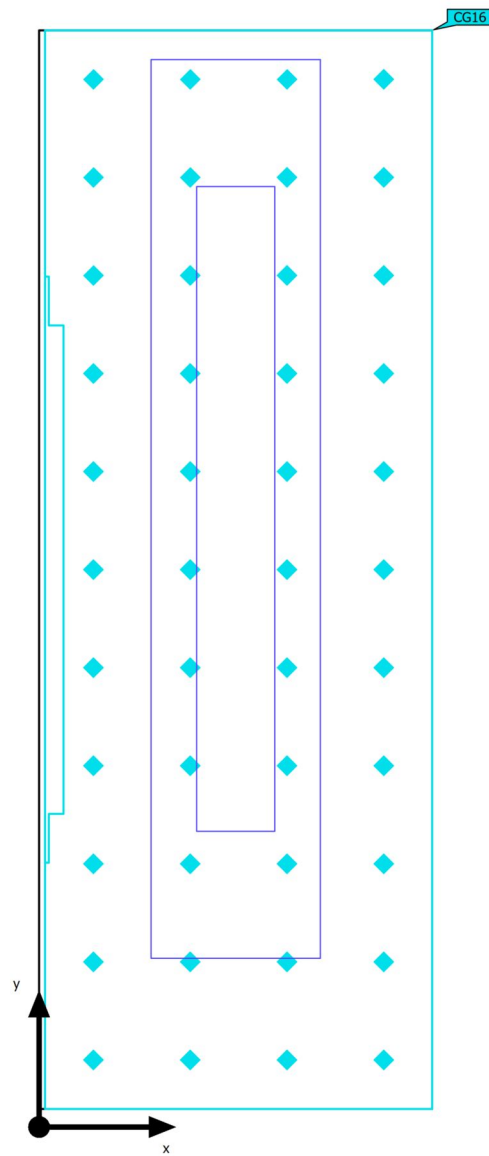

Building B · FIRST FOOR · 203A DB (Light scene 1)

Calculation objects



Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
203A DB Perpendicular illuminance Height: 0.000 m	186 lx	169 lx	196 lx	0.91	0.86	CG16

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203A DB (Emergency light scene)

203A DB

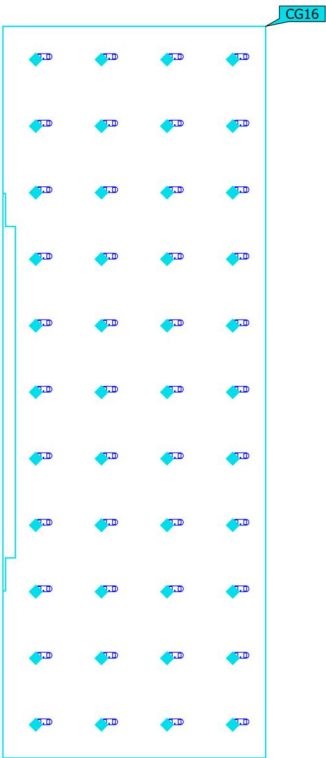



Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
203A DB Perpendicular illuminance Height: 0.000 m	0.00 lx	0.00 lx	0.00 lx	-	-	CG16

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 203A DB (Light scene 1)

203A DB

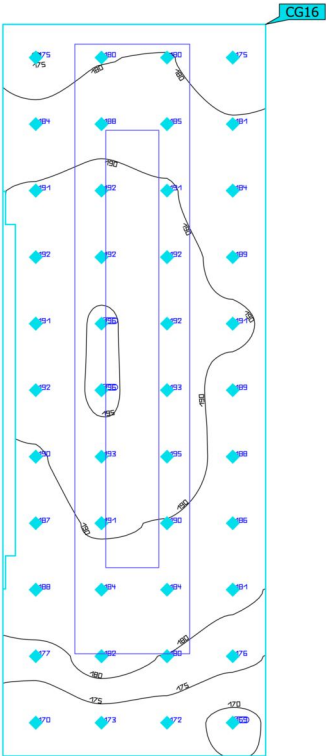


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
203A DB	186 lx	169 lx	196 lx	0.91	0.86	CG16
Perpendicular illuminance						
Height: 0.000 m						

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 204 MEETING (Emergency light scene)

Summary

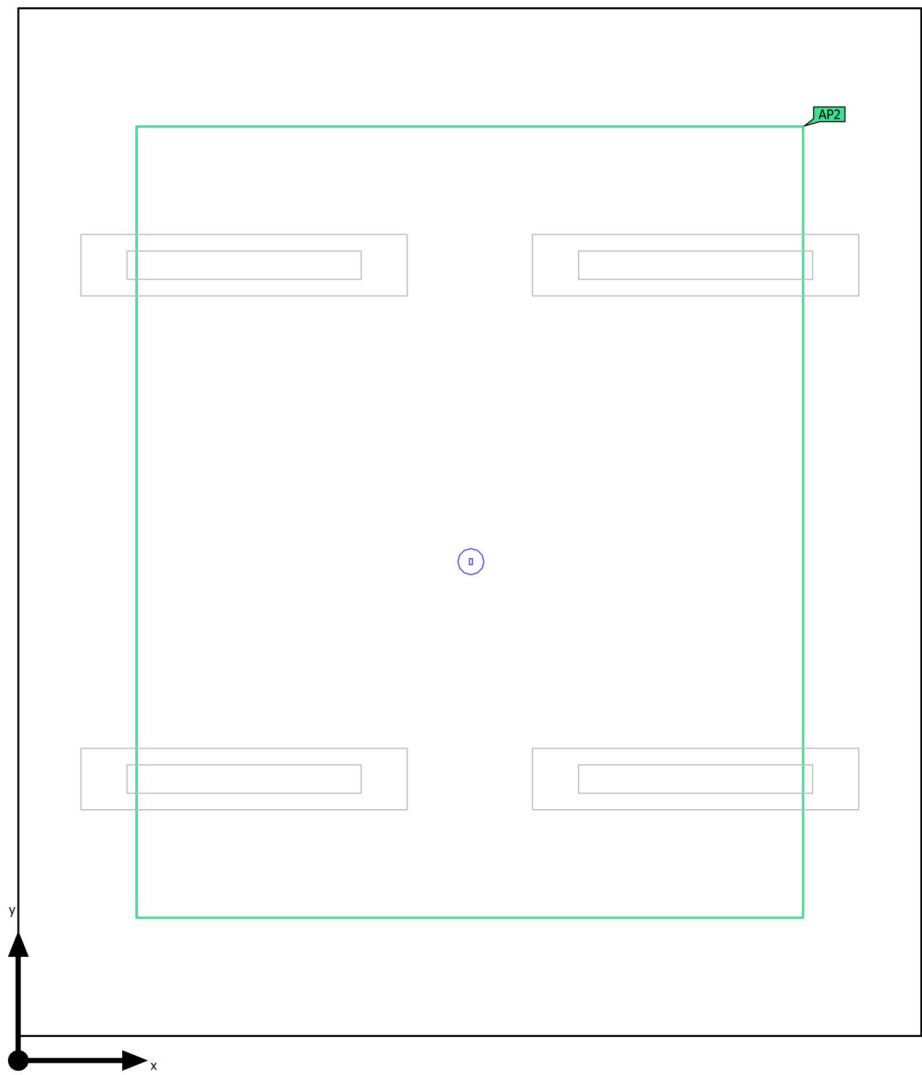

Ground area	16.60 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	3.368 m

Building B · FIRST FOOR · 204 MEETING (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.05 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (204 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	2.55 lx (≥ 0.50 lx) ✓	3.09 lx	0.83 (≥ 0.025) ✓	AP2

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Summary

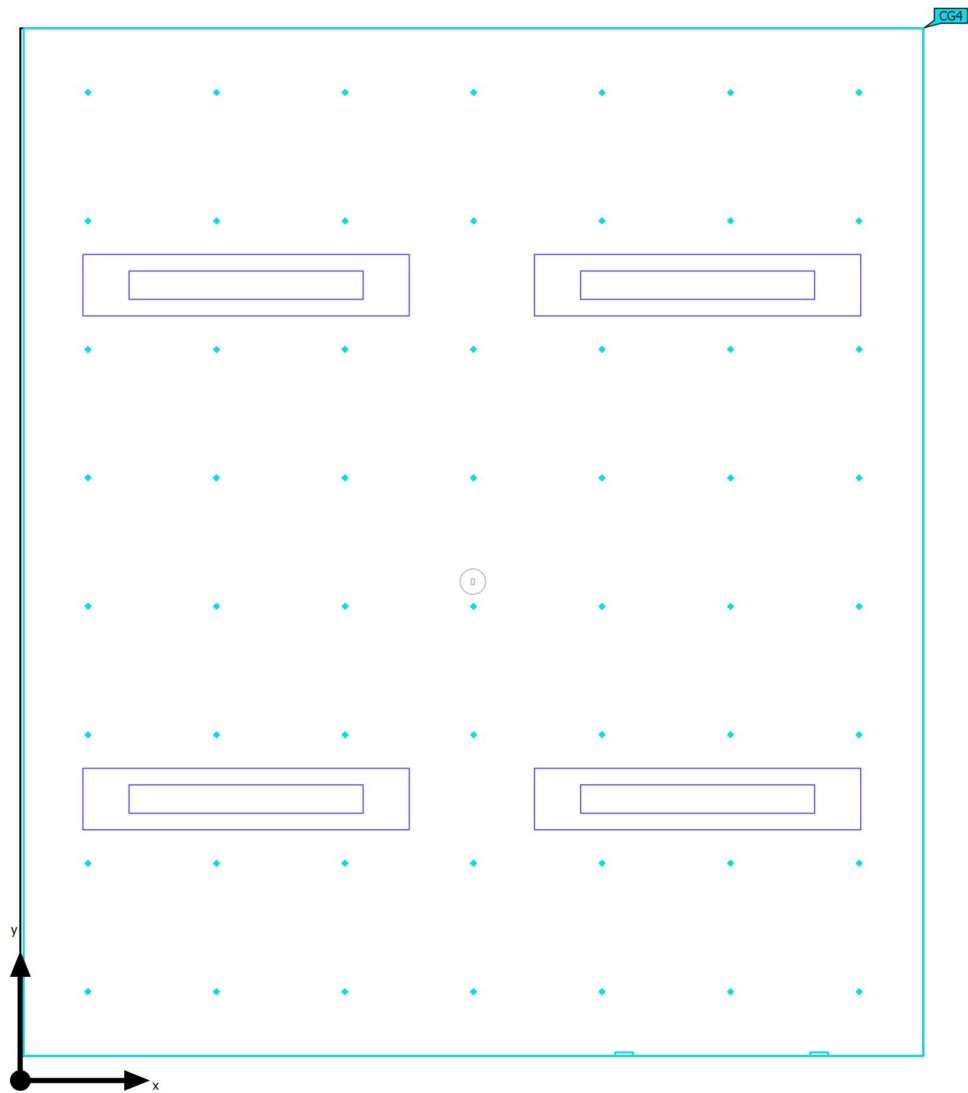

Ground area	16.60 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.88 (fixed)	Mounting height	2.800 m

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[165 - 262] kWh/a	max. 600 kWh/a	✓	
Space	Lighting power density	6.39 W/m ²	–		

(1) Based on a rectangular space of 3.819 m x 4.346 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
4	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 204 MEETING

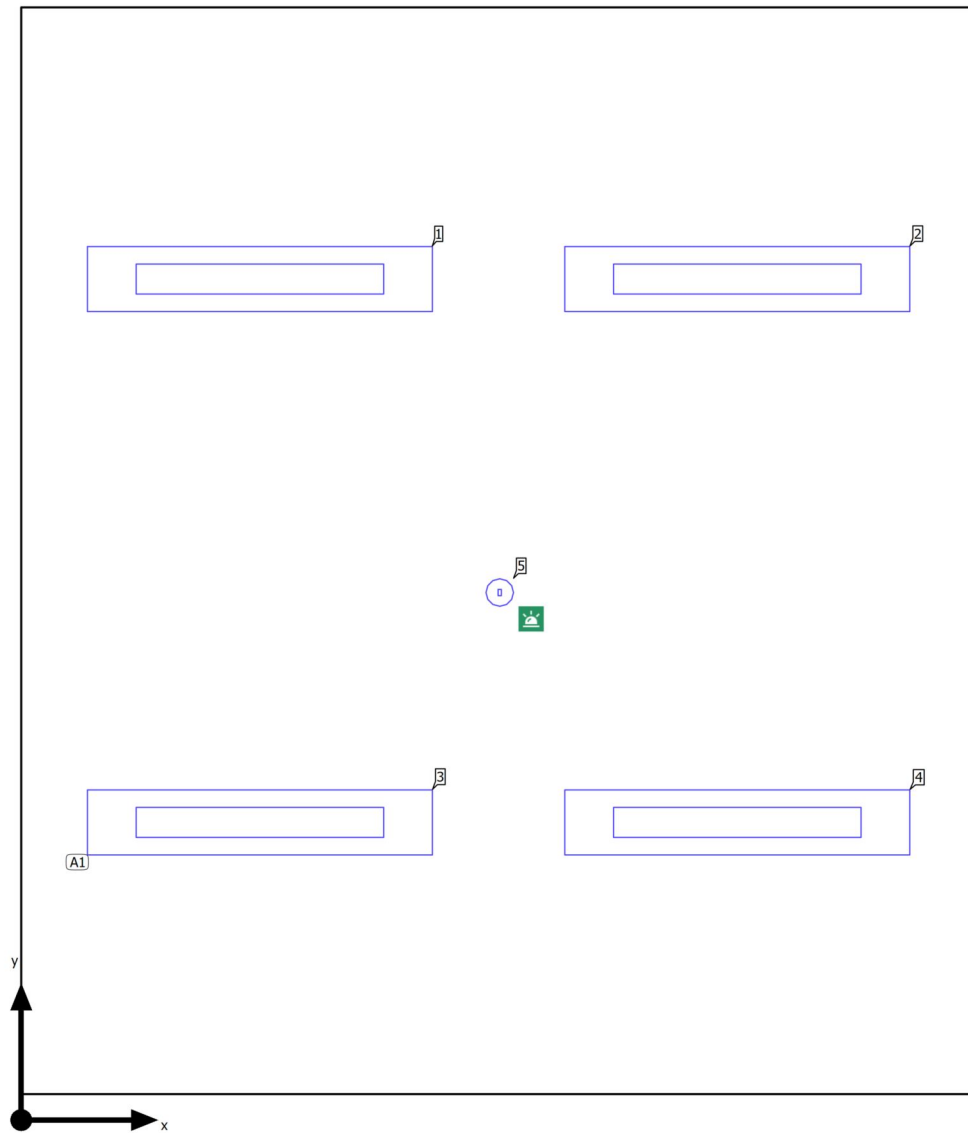Luminaire layout plan

Building B · FIRST FOOR · 204 MEETING


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
1.914 m	2.110 m	3.368 m	5

Building B · FIRST FOOR · 204 MEETING

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	Φ _{Luminaire}	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

4 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.955 m / 1.190 m / 2.800 m	0.955 m	3.363 m	2.800 m	1
X-direction	2 pcs., Centre - centre, 1.909 m	2.864 m	3.363 m	2.800 m	2
Y-direction	2 pcs., Centre - centre, 2.173 m	0.955 m	1.190 m	2.800 m	3
		2.864 m	1.190 m	2.800 m	4
Arrangement	A1				

Building B · FIRST FOOR · 204 MEETING


Luminaire list

Φ_{total} 17500 lm	P_{total} 106.9 W	Luminous efficacy 163.7 lm/W	$\Phi_{\text{Emergency lighting}}$ 300 lm	$P_{\text{Emergency lighting}}$ 0.9 W
-----------------------------------	-------------------------------	---------------------------------	--	--

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)		0.9 W	300 lm	340.9 lm/W
					0.9 W	300 lm (100 %)	-
4	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)		26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 204 MEETING (Emergency light scene)

Calculation objects

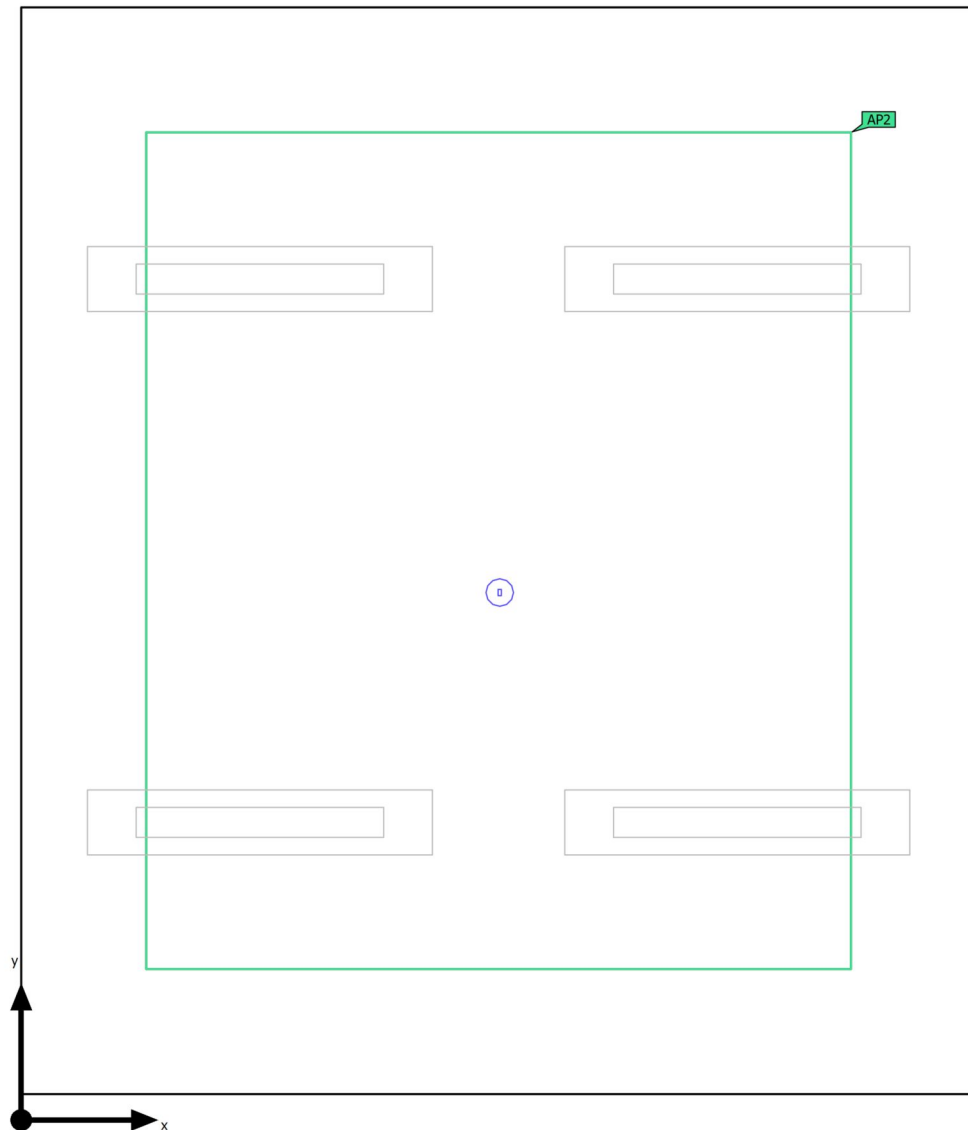

Building B · FIRST FOOR · 204 MEETING (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (204 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	2.55 lx (≥ 0.50 lx) ✓	3.09 lx	0.83 (≥ 0.025) ✓	AP2

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Calculation objects

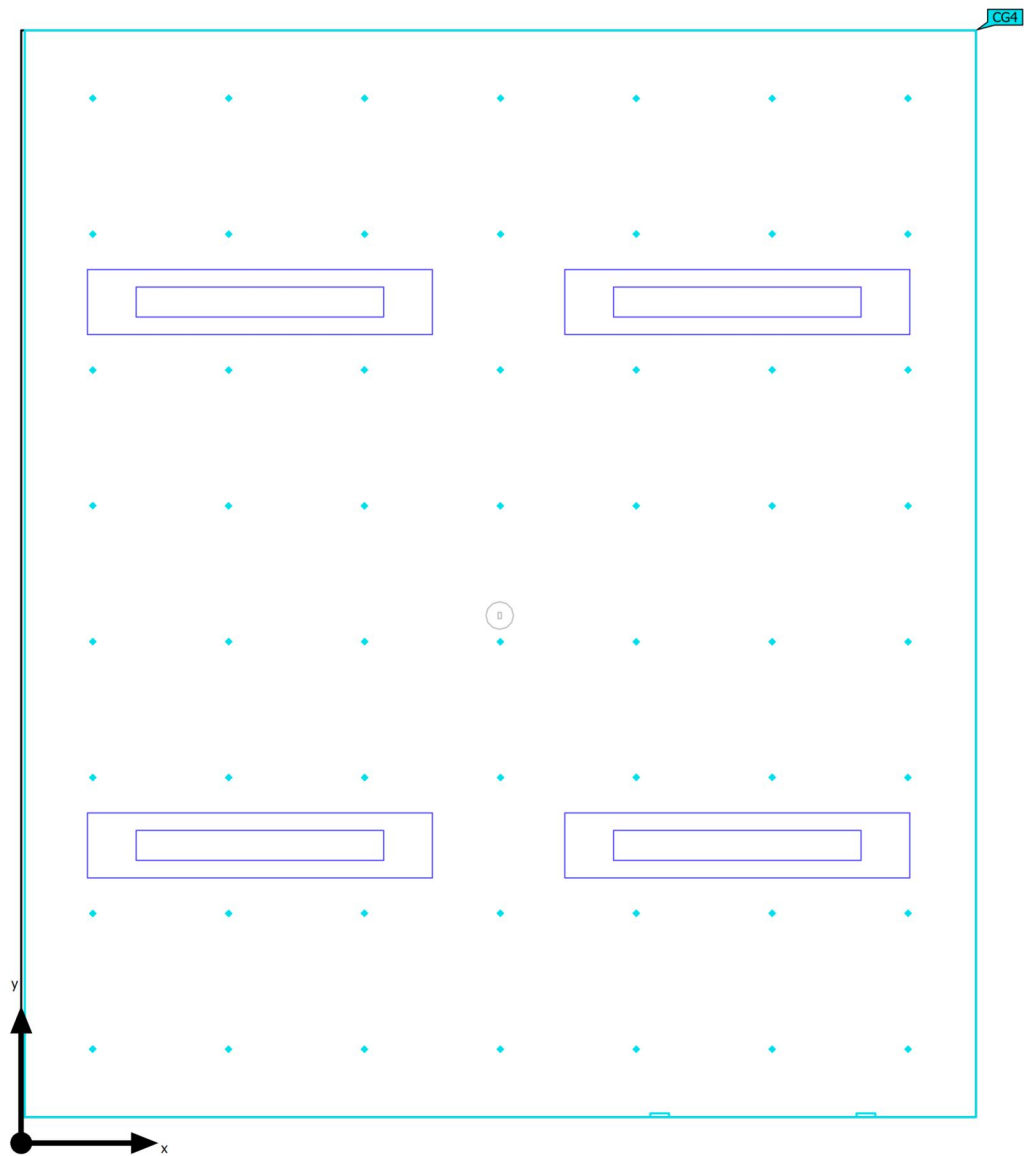

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Calculation objects



Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
204 Meeting Perpendicular illuminance Height: 0.700 m	553 lx	371 lx	677 lx	0.67	0.55	CG4

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 204 MEETING (Emergency light scene)

Anti panic surface (204 MEETING)

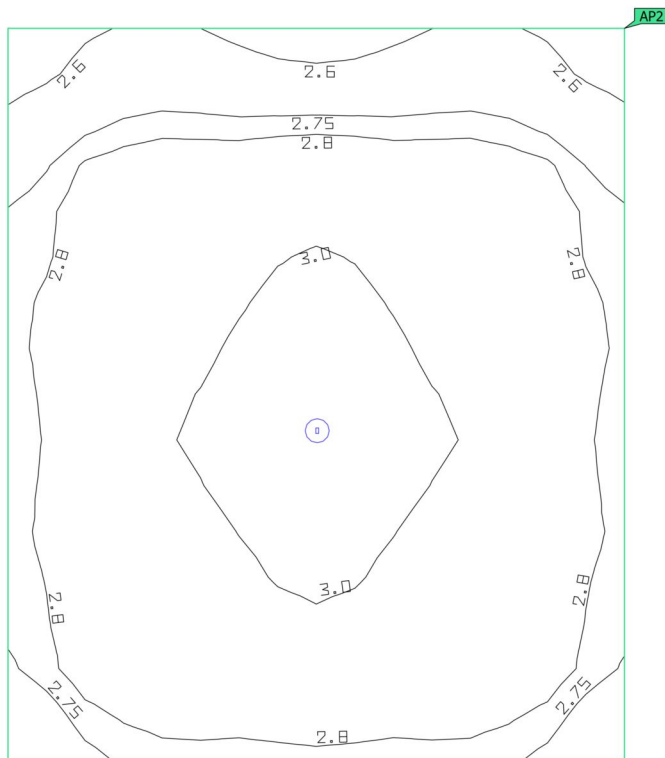



Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (204 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	2.55 lx (≥ 0.50 lx) ✓	3.09 lx	0.83 (≥ 0.025) ✓	AP2

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 204 MEETING (Emergency light scene)

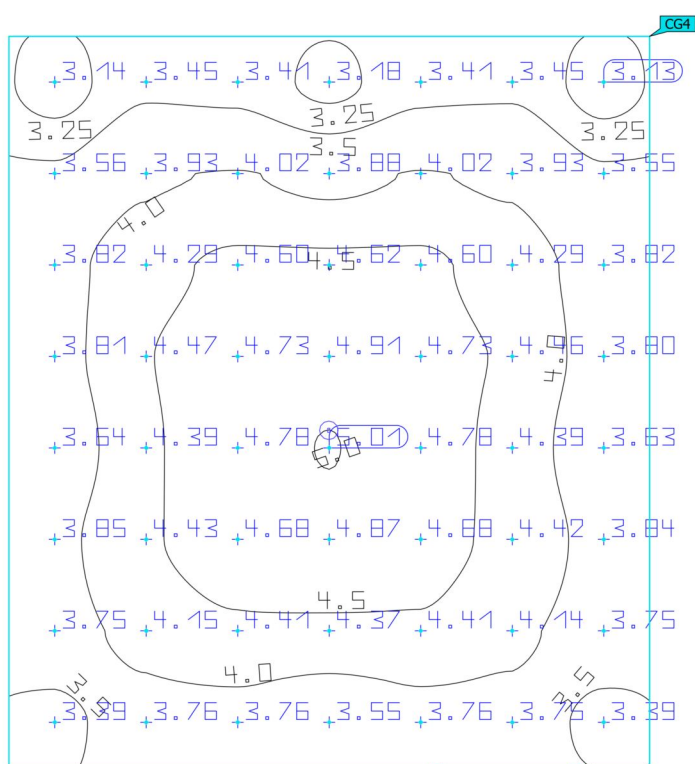204 Meeting



Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
204 Meeting Perpendicular illuminance Height: 0.700 m	4.05 lx	3.13 lx	5.01 lx	0.77	0.62	CG4

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

204 Meeting

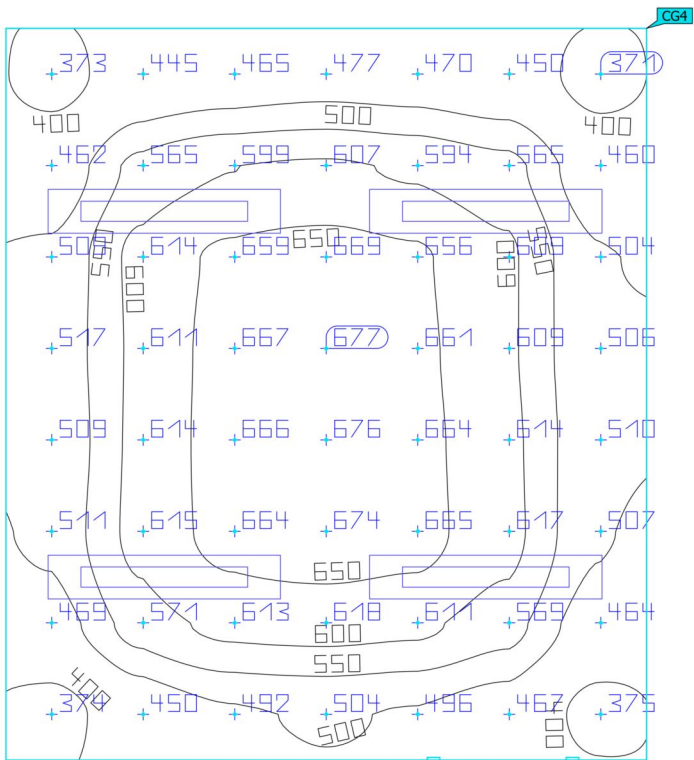


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
204 Meeting Perpendicular illuminance Height: 0.700 m	553 lx	371 lx	677 lx	0.67	0.55	CG4

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 205 OFFICE (Emergency light scene)

Summary

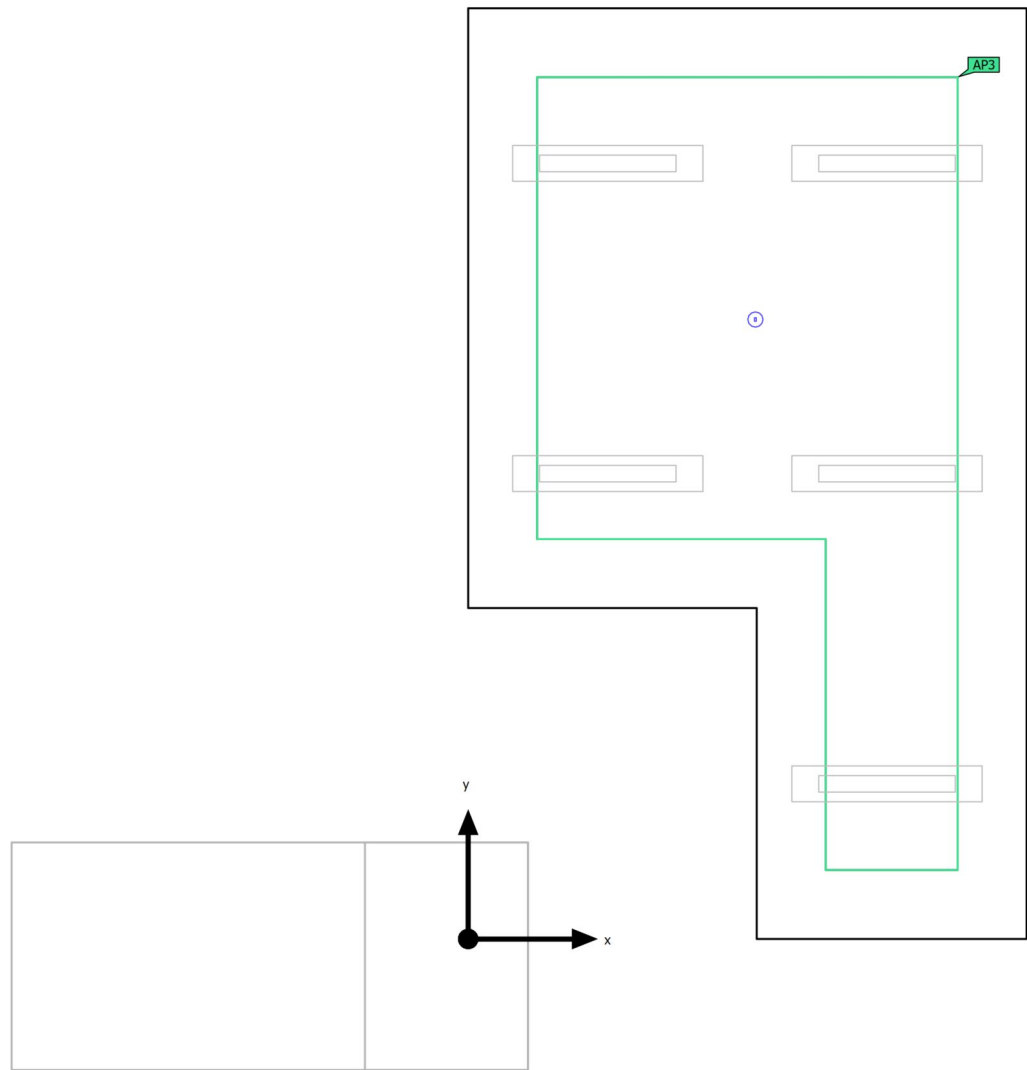

Ground area	22.32 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	3.368 m

Building B · FIRST FOOR · 205 OFFICE (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.04 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (205 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.52 lx (≥ 0.50 lx) ✓	3.08 lx	0.49 (≥ 0.025) ✓	AP3

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Summary

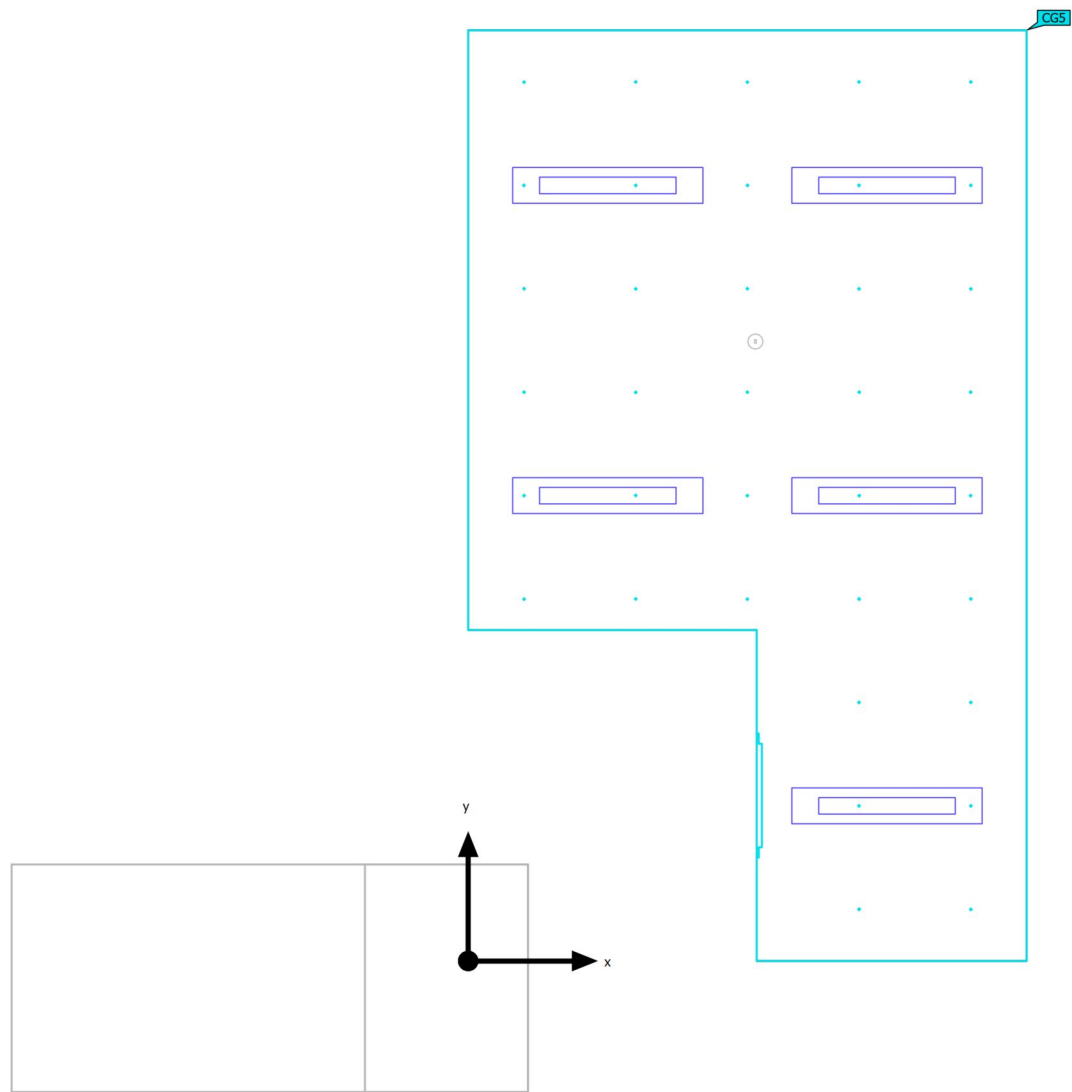

Ground area	22.32 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	2.800 m

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[207 - 328] kWh/a	max. 800 kWh/a	✓	
Space	Lighting power density	5.94 W/m ²	–		

(1) Based on a rectangular space of 6.750 m x 4.050 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
5	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 205 OFFICE

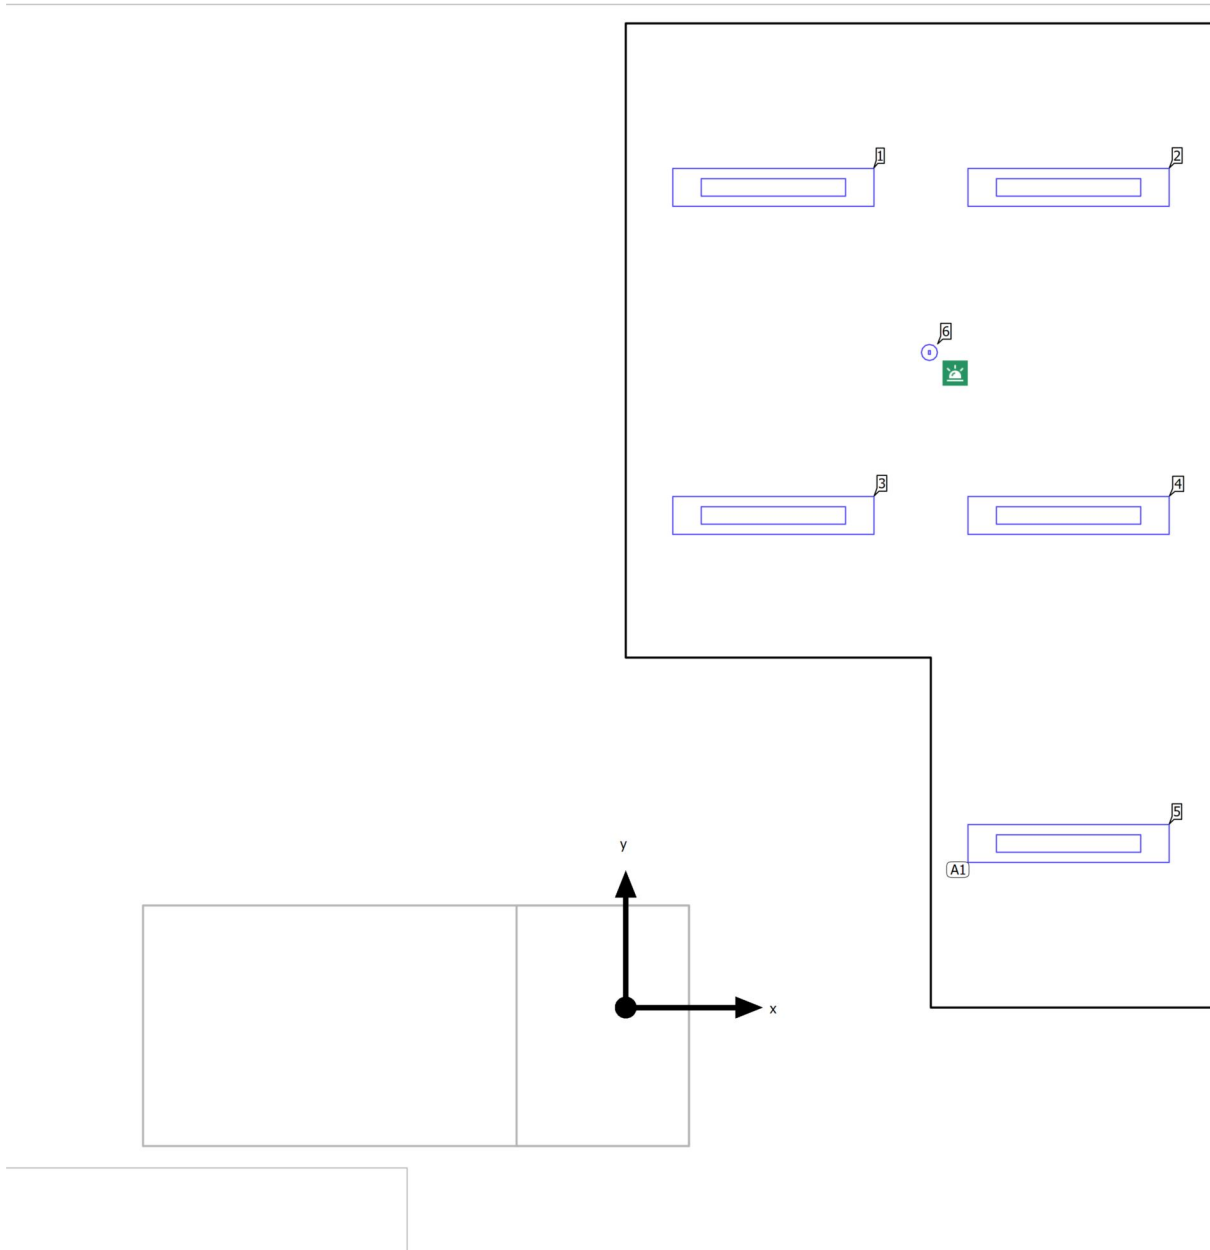Luminaire layout plan

Building B · FIRST FOOR · 205 OFFICE


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
2.083 m	4.493 m	3.368 m	6

Building B · FIRST FOOR · 205 OFFICE

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	Φ _{Luminaire}	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

5 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	3.037 m / 1.125 m / 2.800 m	1.012 m	5.625 m	2.800 m	1
X-direction	2 pcs., Centre - centre, 2.025 m	3.037 m	5.625 m	2.800 m	2
Y-direction	3 pcs., Centre - centre, 2.250 m	1.012 m	3.375 m	2.800 m	3
		3.037 m	3.375 m	2.800 m	4
Arrangement	A1	3.037 m	1.125 m	2.800 m	5

Building B · FIRST FOOR · 205 OFFICE


Luminaire list

Φ_{total} 21800 lm	P_{total} 133.4 W	Luminous efficacy 163.4 lm/W	$\Phi_{\text{Emergency lighting}}$ 300 lm	$P_{\text{Emergency lighting}}$ 0.9 W
-----------------------------------	-------------------------------	---------------------------------	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	-
5	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 205 OFFICE (Emergency light scene)

Calculation objects

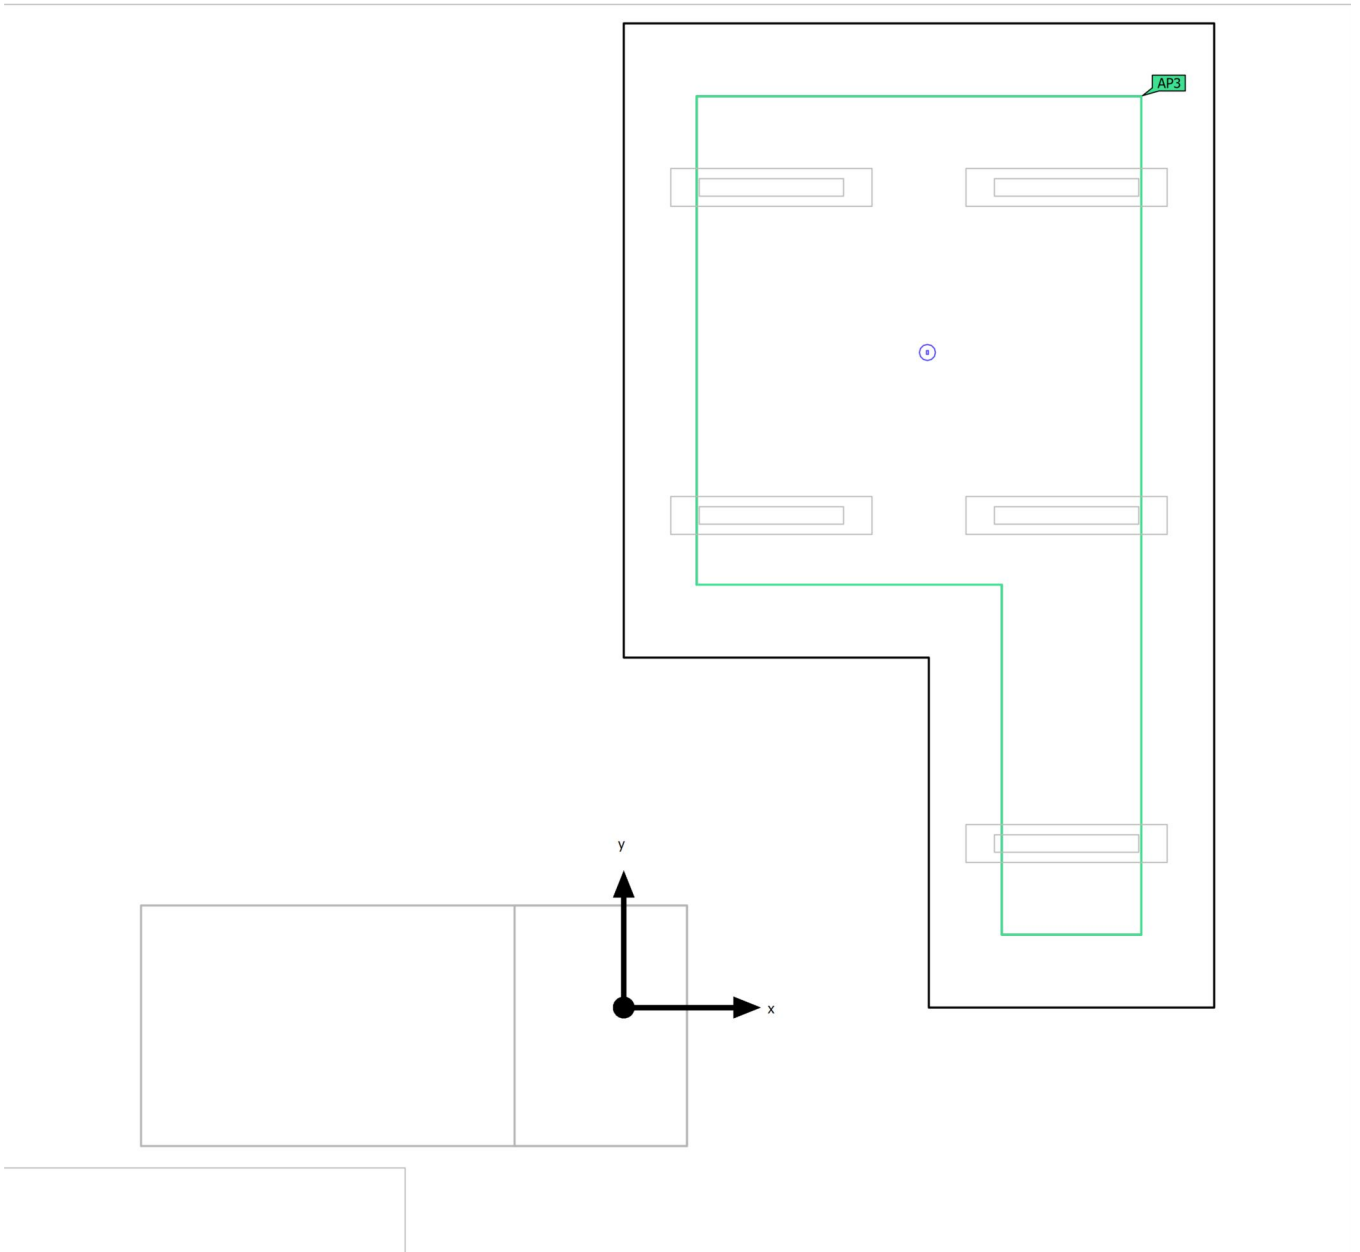

Building B · FIRST FOOR · 205 OFFICE (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (205 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.52 lx (≥ 0.50 lx) ✓	3.08 lx	0.49 (≥ 0.025) ✓	AP3

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Calculation objects

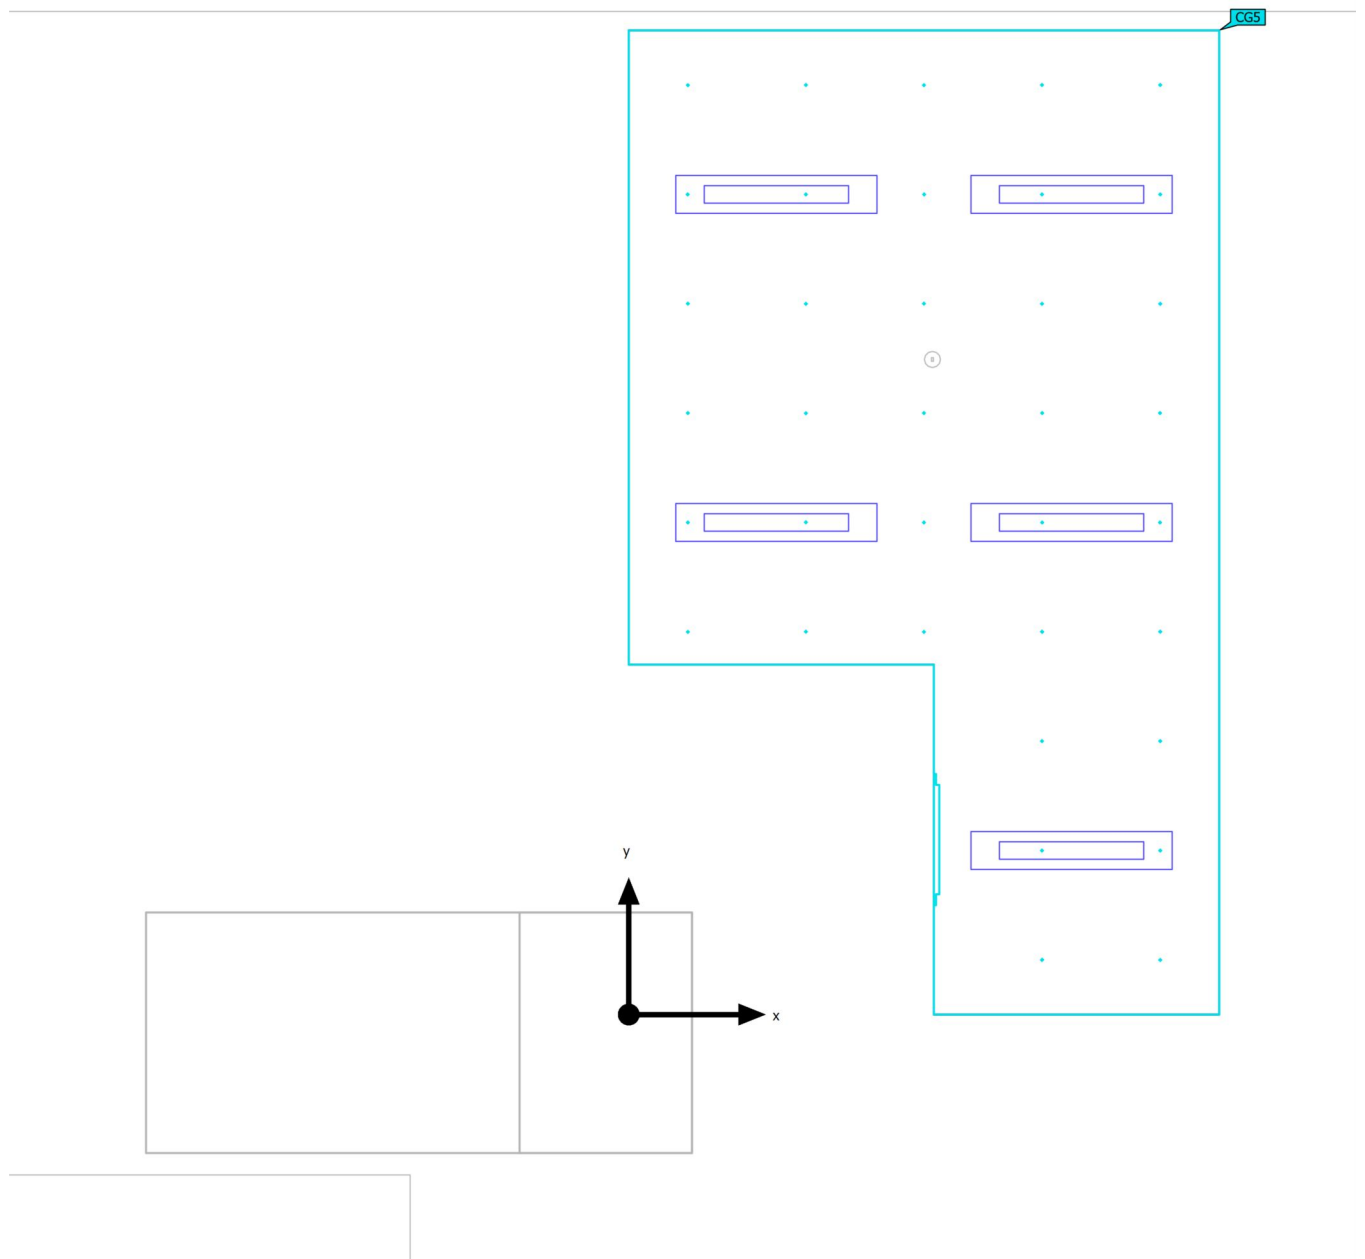

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)


Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
205 Office Perpendicular illuminance Height: 0.700 m	530 lx	356 lx	669 lx	0.67	0.53	CG5

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 205 OFFICE (Emergency light scene)
Anti panic surface (205 OFFICE)

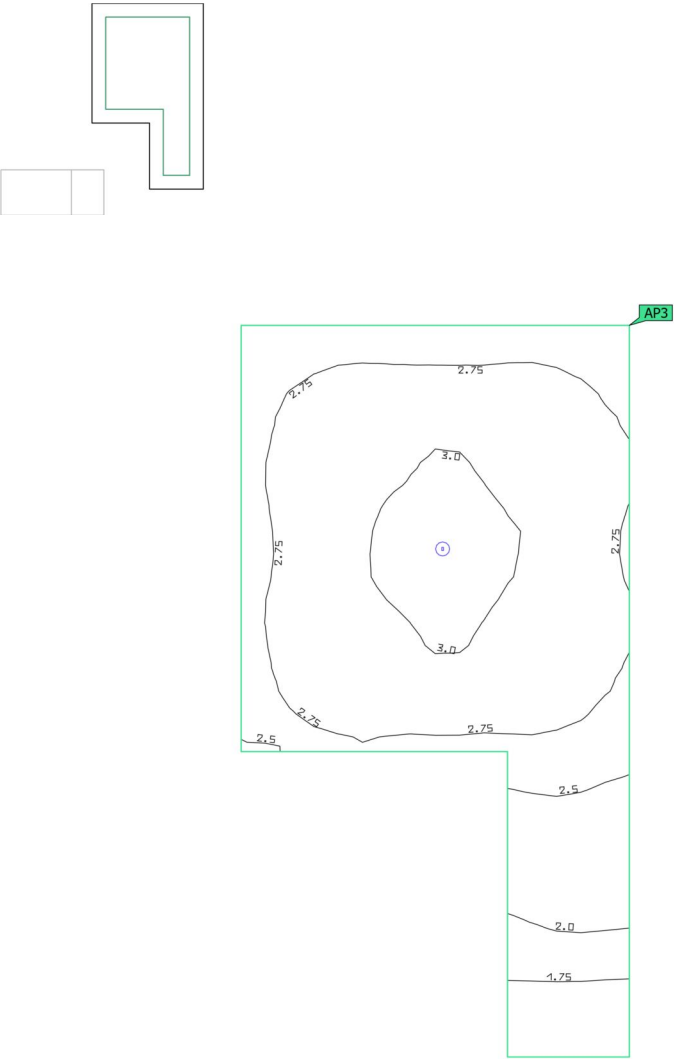


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (205 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.52 lx (≥ 0.50 lx) ✓	3.08 lx	0.49 (≥ 0.025) ✓	AP3

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 205 OFFICE (Emergency light scene)

205 Office


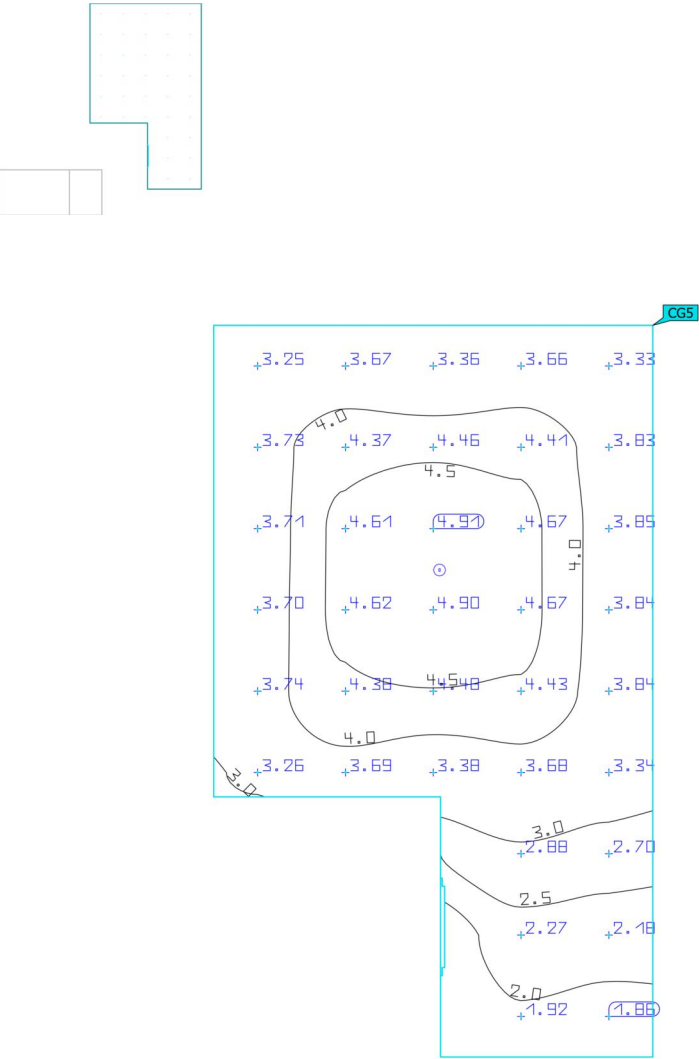


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
205 Office Perpendicular illuminance Height: 0.700 m	3.71 lx	1.86 lx	4.91 lx	0.50	0.38	CG5

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

205 Office

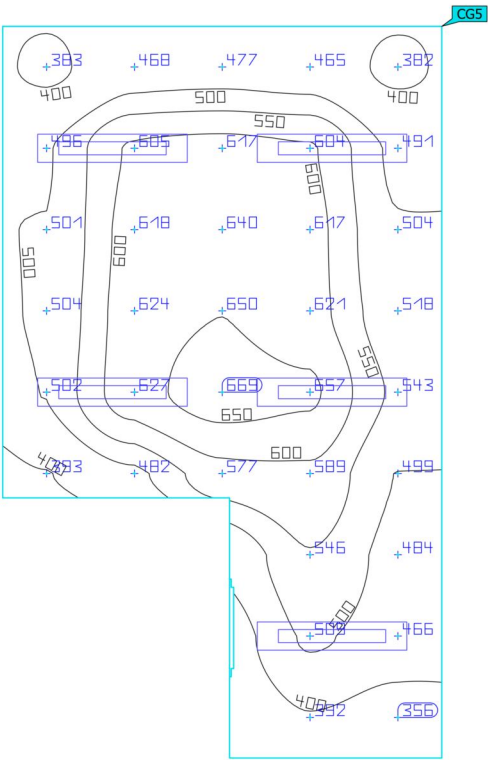


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
205 Office Perpendicular illuminance Height: 0.700 m	530 lx	356 lx	669 lx	0.67	0.53	CG5

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 206 KITCHEN (Emergency light scene)

Summary

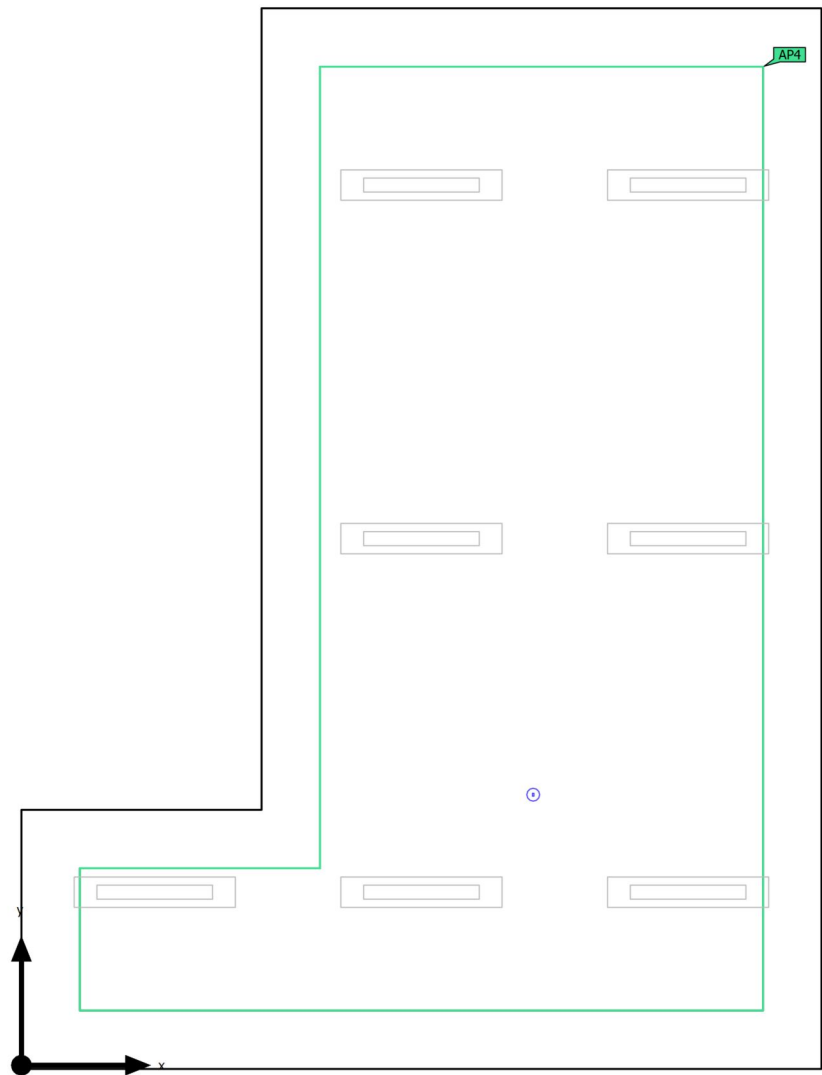

Ground area	48.10 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.88 (fixed)	Mounting height	3.368 m

Building B · FIRST FOOR · 206 KITCHEN (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.02 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (206 KITCHEN) Perpendicular illuminance (adaptive) Height: 0.000 m	1.10 lx (≥ 0.50 lx) ✓	3.10 lx	0.35 (≥ 0.025) ✓	AP4

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Summary

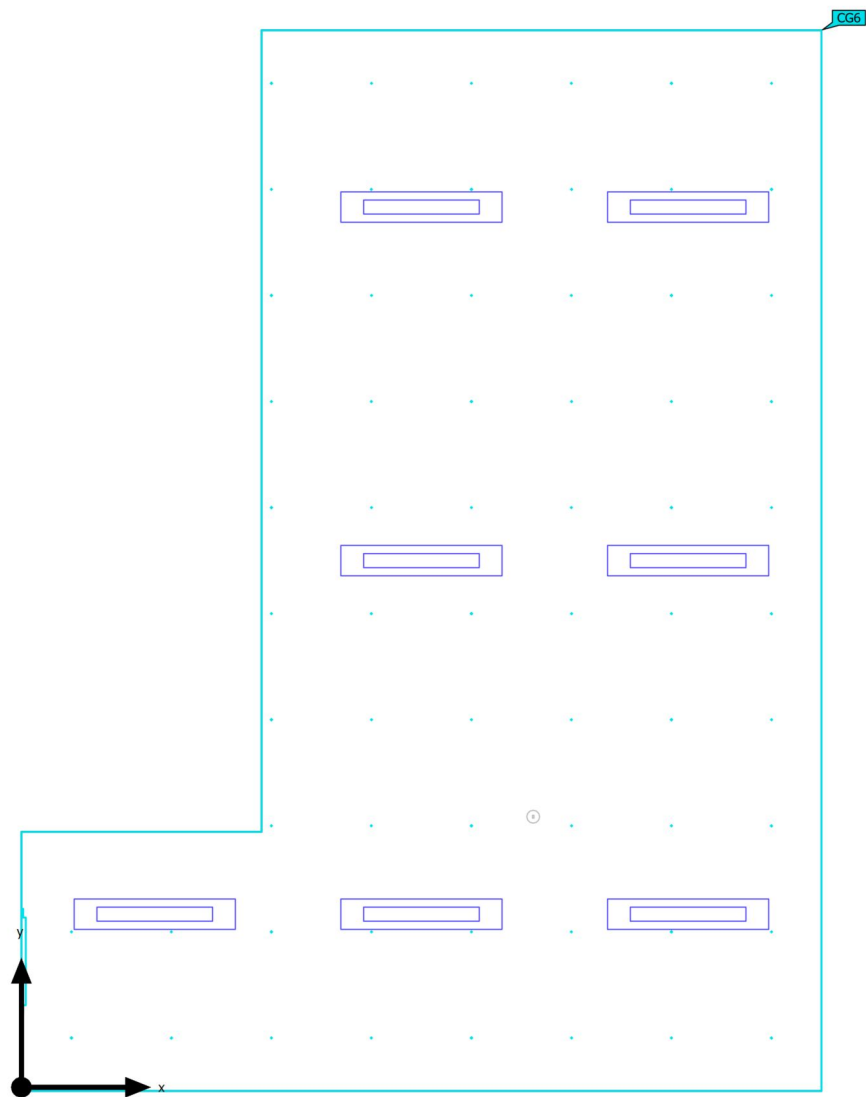

Ground area	48.10 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	3.000 m

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	15	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[289 - 459] kWh/a	max. 1700 kWh/a	✓	
Space	Lighting power density	3.86 W/m ²	–		

(1) Based on a rectangular space of 6.850 m x 9.082 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
7	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	15	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 206 KITCHEN

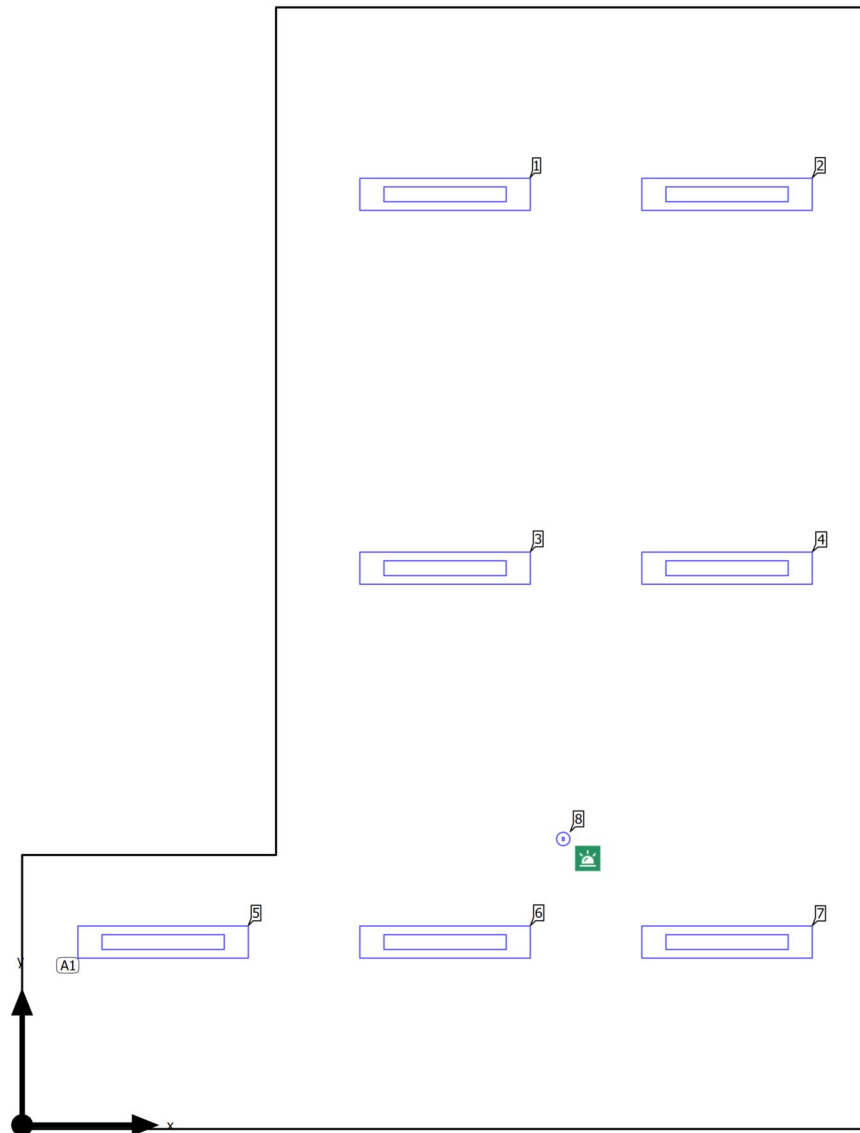Luminaire layout plan

Building B · FIRST FOOR · 206 KITCHEN


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
4.382 m	2.317 m	3.368 m	8

Building B · FIRST FOOR · 206 KITCHEN

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	Φ _{Luminaire}	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

7 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.142 m / 1.482 m / 3.000 m	3.425 m	7.536 m	3.000 m	1
X-direction	3 pcs., Centre - centre, 2.283 m	5.708 m	7.536 m	3.000 m	2
Y-direction	3 pcs., Centre - centre, 3.027 m	3.425 m	4.509 m	3.000 m	3
		5.708 m	4.509 m	3.000 m	4
Arrangement	A1	1.142 m	1.482 m	3.000 m	5
		3.425 m	1.482 m	3.000 m	6
		5.708 m	1.482 m	3.000 m	7


Building B · FIRST FOOR · 206 KITCHEN

Luminaire list

Φ_{total} 30400 lm		P_{total} 186.4 W		Luminous efficacy 163.1 lm/W		$\Phi_{\text{Emergency lighting}}$ 300 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K1R222/3-A-A630A630 (_LTRevAB)			0.9 W	300 lm	340.9 lm/W	
						0.9 W	300 lm (100 %)	-	
7	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)			26.5 W	4291 lm	161.9 lm/W	

Building B · FIRST FOOR · 206 KITCHEN (Emergency light scene)

Calculation objects

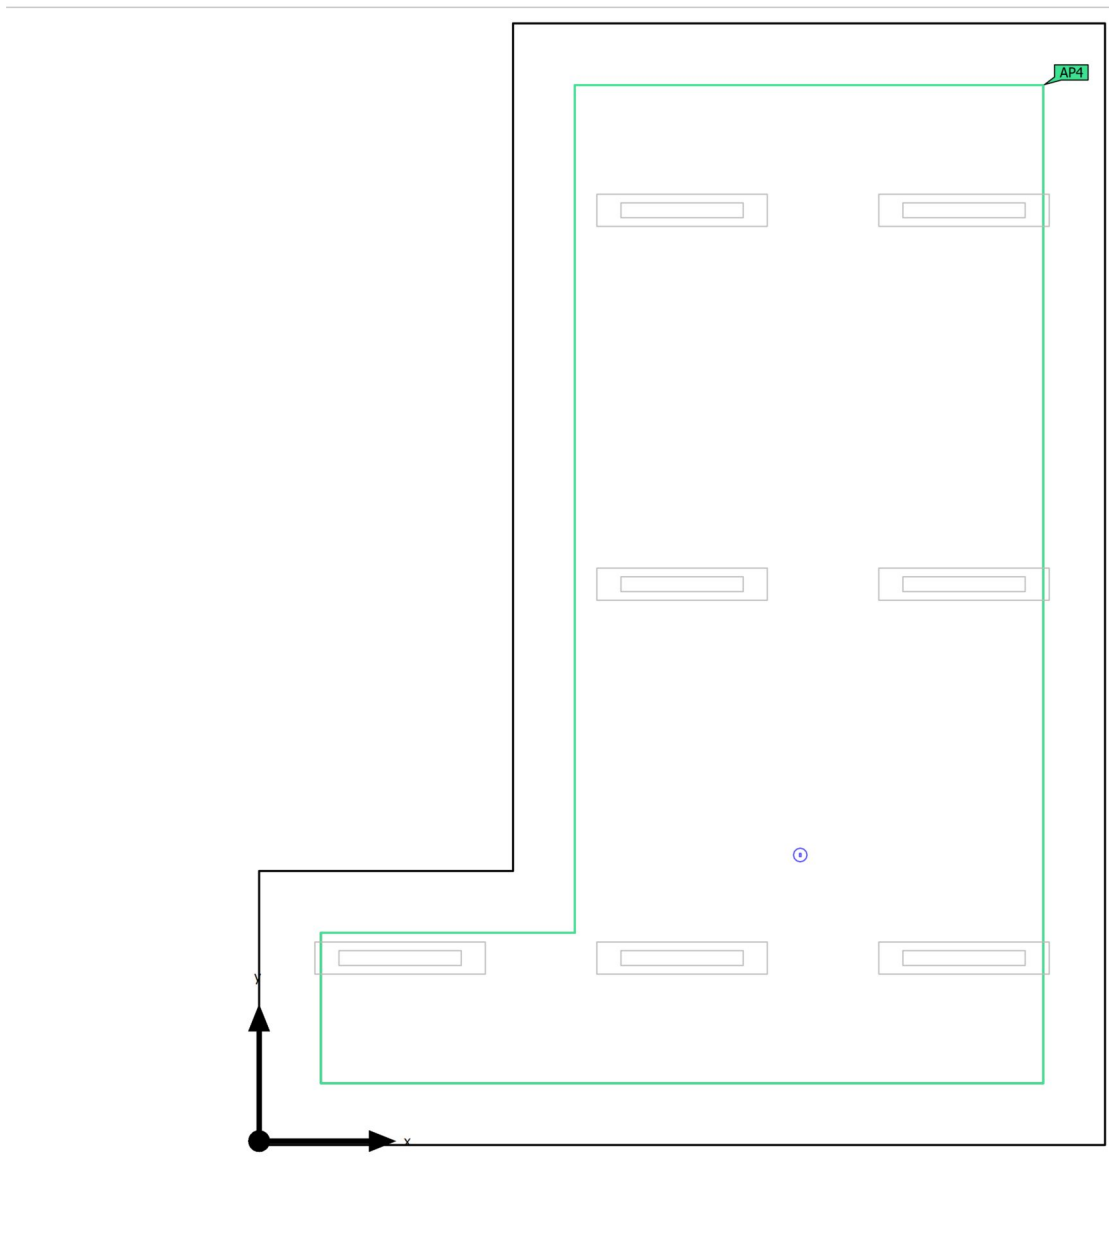

Building B · FIRST FOOR · 206 KITCHEN (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (206 KITCHEN) Perpendicular illuminance (adaptive) Height: 0.000 m	1.10 lx (≥ 0.50 lx) ✓	3.10 lx	0.35 (≥ 0.025) ✓	AP4

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Calculation objects

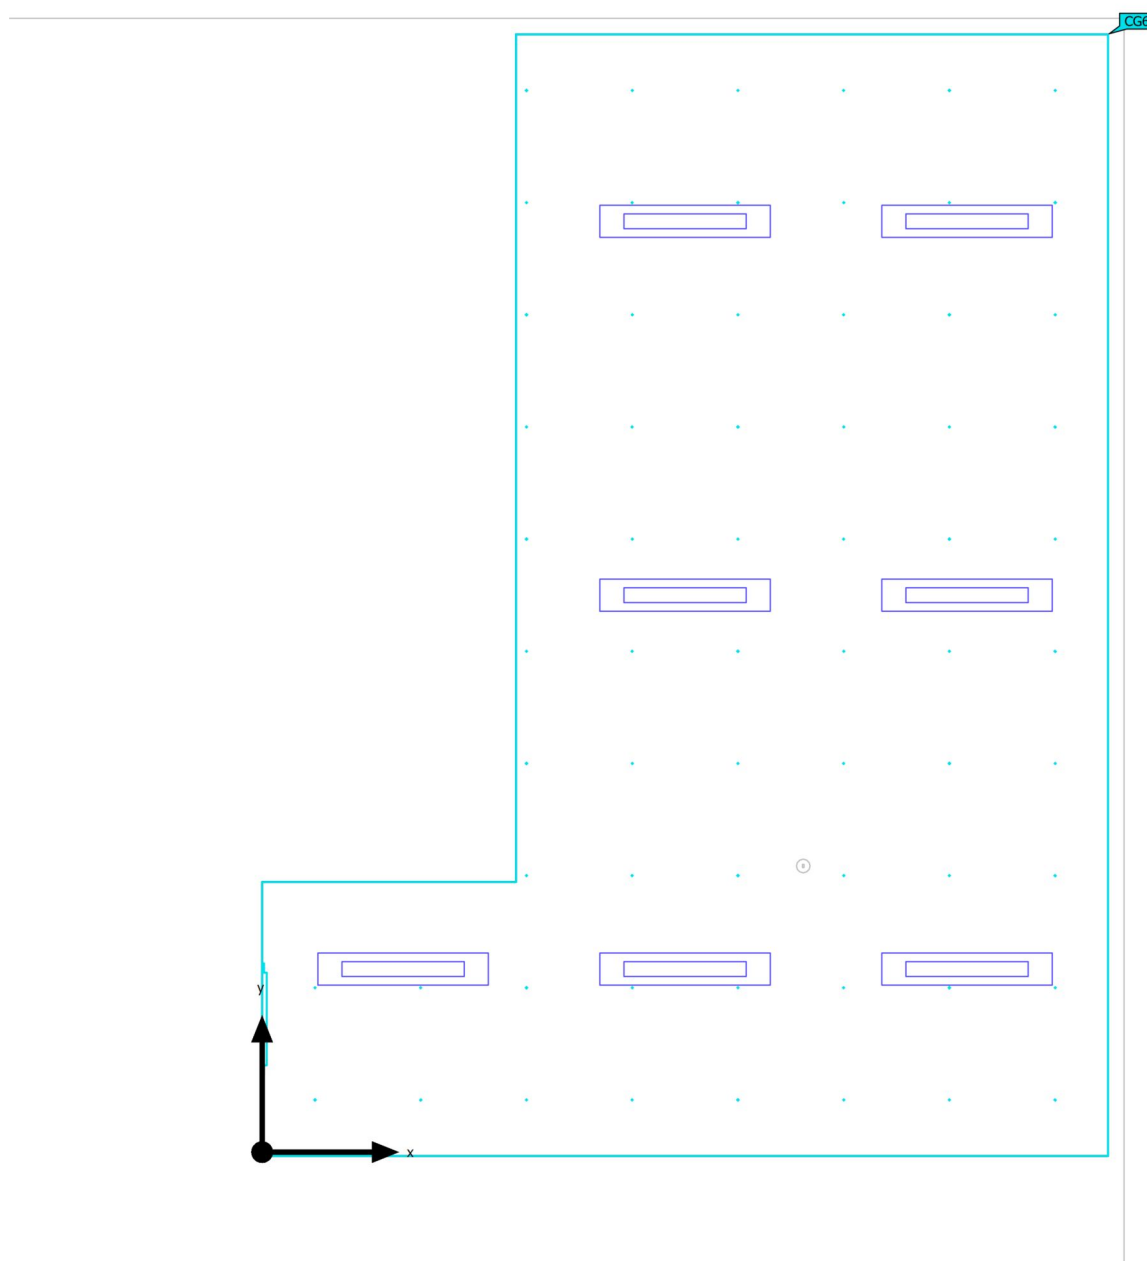

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Calculation objects



Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
206 Kitchen Perpendicular illuminance Height: 0.850 m	391 lx	197 lx	513 lx	0.50	0.38	CG6

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 206 KITCHEN (Emergency light scene)



Anti panic surface (206 KITCHEN)

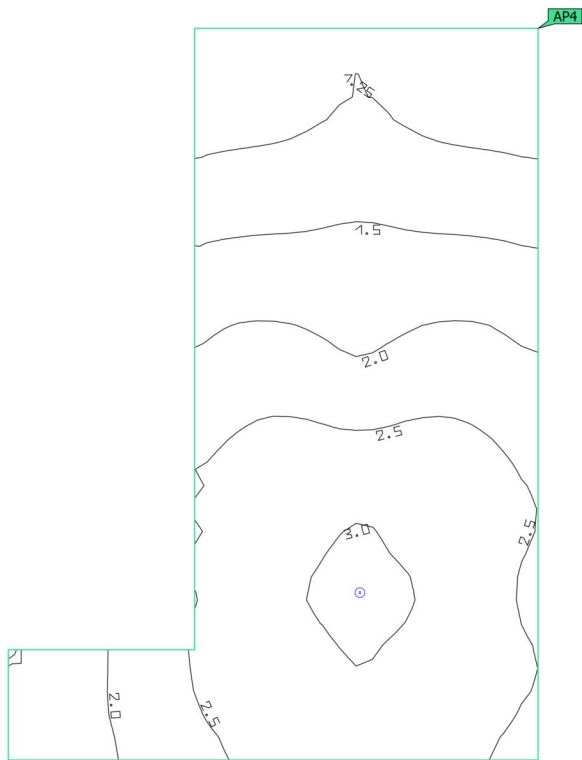

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (206 KITCHEN) Perpendicular illuminance (adaptive) Height: 0.000 m	1.10 lx (≥ 0.50 lx) ✓	3.10 lx	0.35 (≥ 0.025) ✓	AP4

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 206 KITCHEN (Emergency light scene)

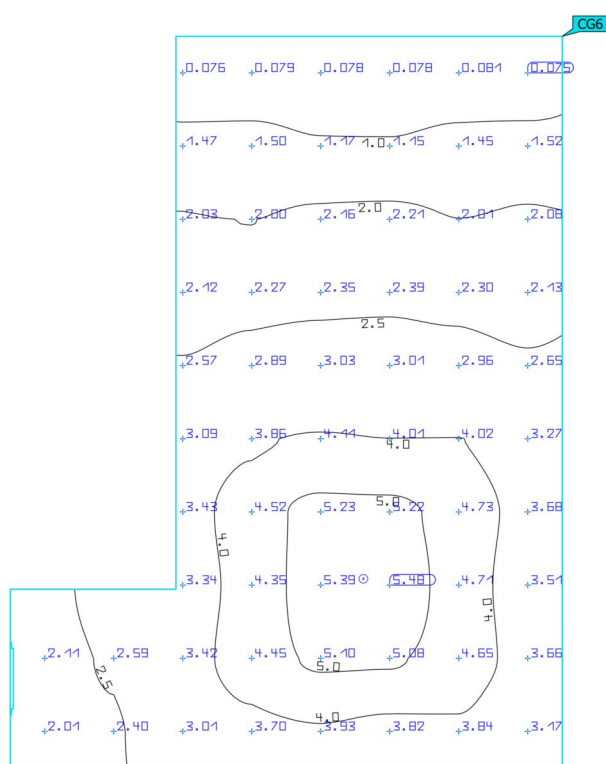206 Kitchen



Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
206 Kitchen	2.89 lx	0.075 lx	5.48 lx	0.026	0.014	CG6
Perpendicular illuminance						
Height: 0.850 m						

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

206 Kitchen

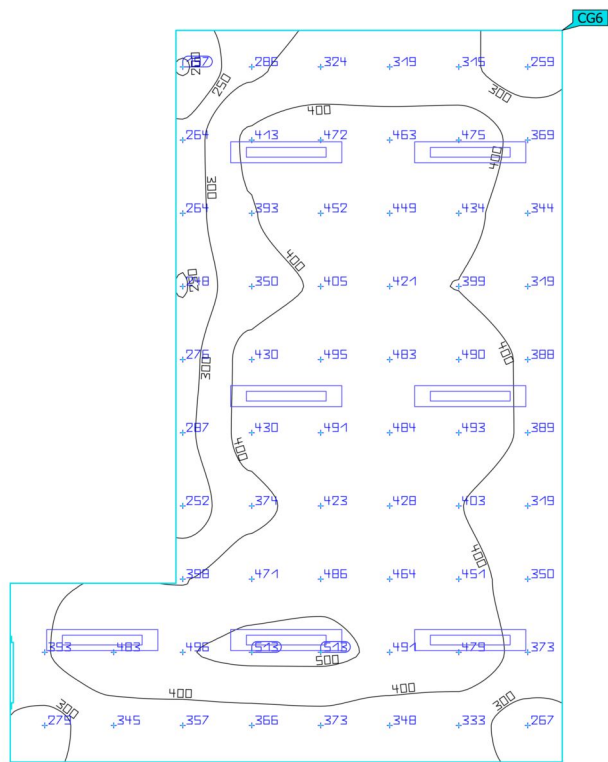


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
206 Kitchen Perpendicular illuminance Height: 0.850 m	391 lx	197 lx	513 lx	0.50	0.38	CG6

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 207 CAD (Emergency light scene)

Summary

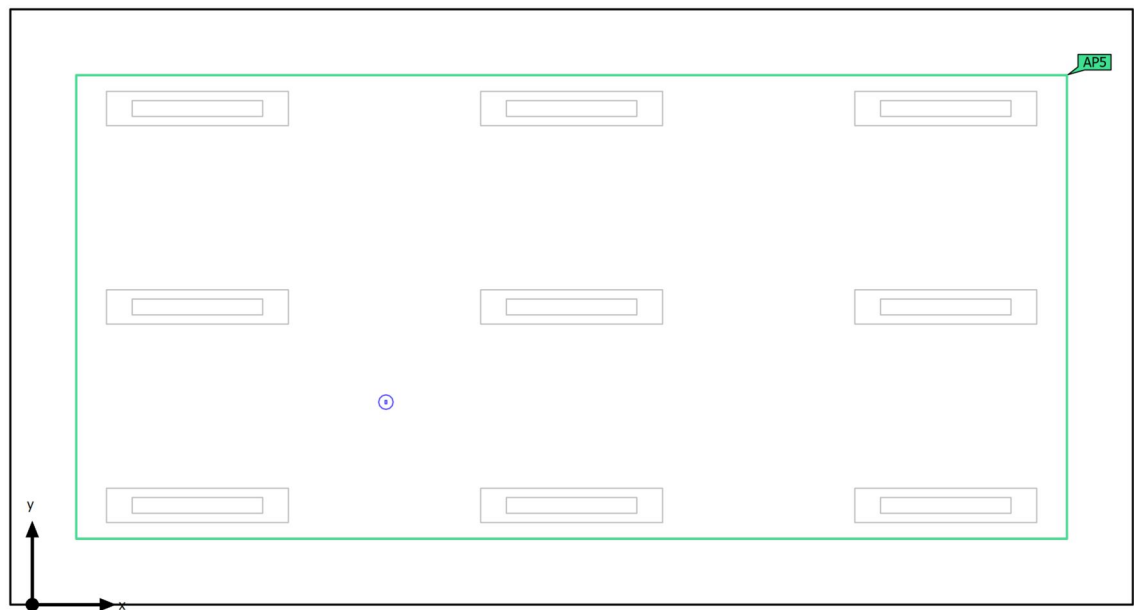

Ground area	38.48 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	3.368 m

Building B · FIRST FOOR · 207 CAD (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.02 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (207 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.16 lx (≥ 0.50 lx) ✓	3.08 lx	0.38 (≥ 0.025) ✓	AP5

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Summary

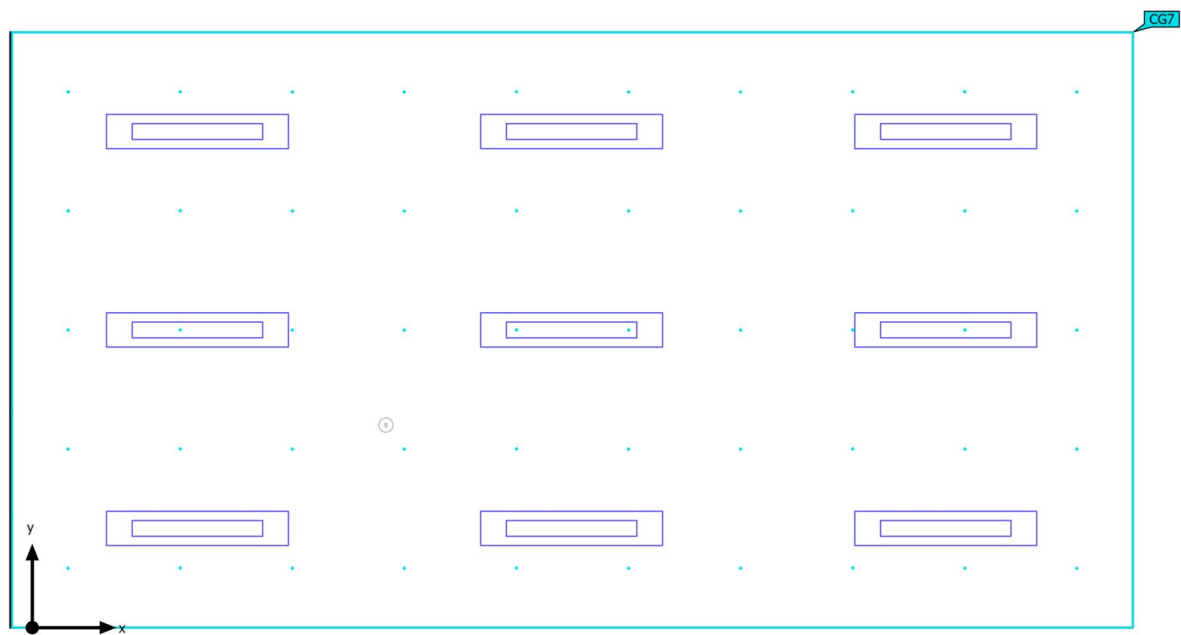

Ground area	38.48 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	2.800 m

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[372 - 590] kWh/a	max. 1350 kWh/a	✓	
Space	Lighting power density	6.20 W/m ²	–		

(1) Based on a rectangular space of 8.516 m x 4.519 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
9	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 207 CAD

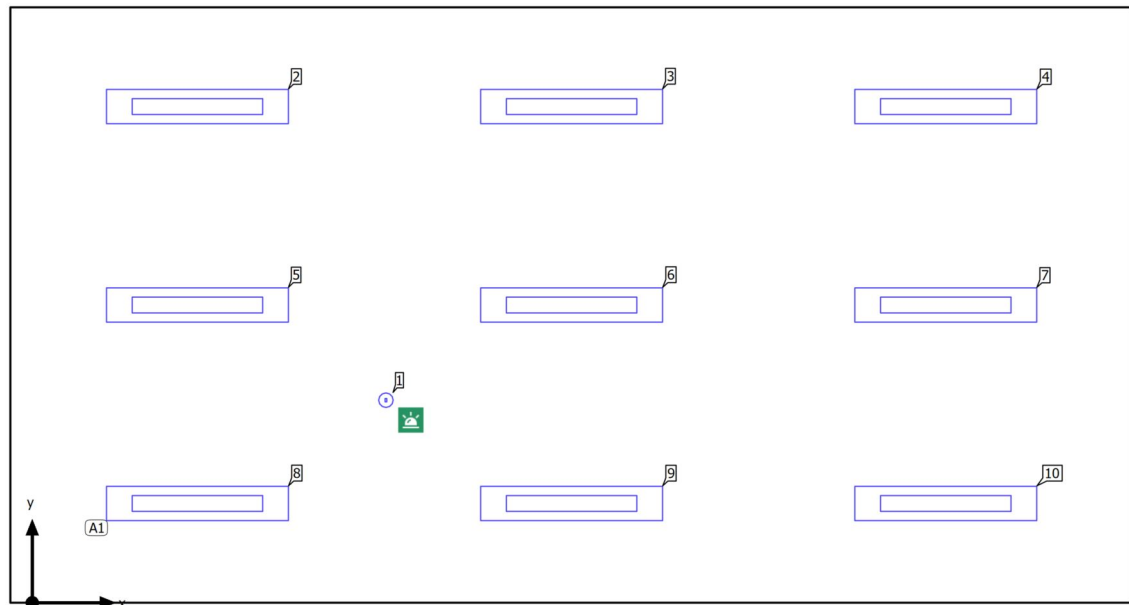Luminaire layout plan

Building B · FIRST FOOR · 207 CAD


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
2.683 m	1.537 m	3.368 m	1

Building B · FIRST FOOR · 207 CAD

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	Φ _{Luminaire}	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

9 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.253 m / 0.753 m / 2.800 m	1.253 m	3.766 m	2.800 m	2
X-direction	3 pcs., Centre - centre, 2.839 m	4.092 m	3.766 m	2.800 m	3
Y-direction	3 pcs., Centre - centre, 1.506 m	6.931 m	3.766 m	2.800 m	4
Arrangement	A1	1.253 m	2.259 m	2.800 m	5
		4.092 m	2.259 m	2.800 m	6
		6.931 m	2.259 m	2.800 m	7
		1.253 m	0.753 m	2.800 m	8
		4.092 m	0.753 m	2.800 m	9
		6.931 m	0.753 m	2.800 m	10


Building B · FIRST FOOR · 207 CAD

Luminaire list

Φ_{total} 39000 lm		P_{total} 239.4 W		Luminous efficacy 162.9 lm/W		$\Phi_{\text{Emergency lighting}}$ 300 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K1R222/3-A-A630A630 (_LTRevAB)			0.9 W	300 lm	340.9 lm/W	
						0.9 W	300 lm (100 %)	-	
9	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)			26.5 W	4291 lm	161.9 lm/W	

Building B · FIRST FOOR · 207 CAD (Emergency light scene)

Calculation objects

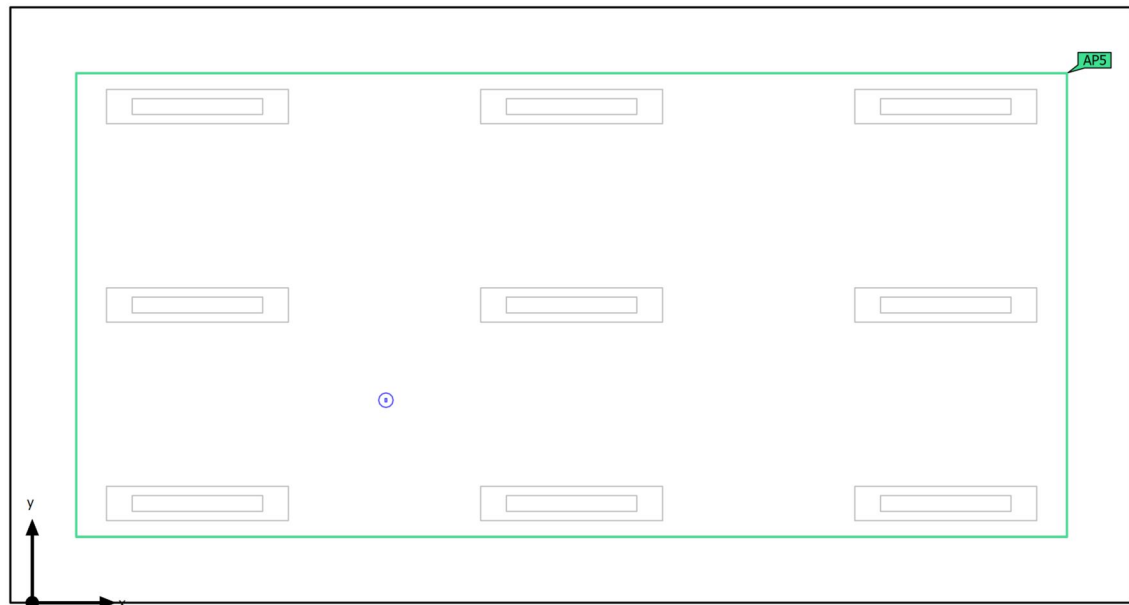

Building B · FIRST FOOR · 207 CAD (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (207 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.16 lx (≥ 0.50 lx) ✓	3.08 lx	0.38 (≥ 0.025) ✓	AP5

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Calculation objects

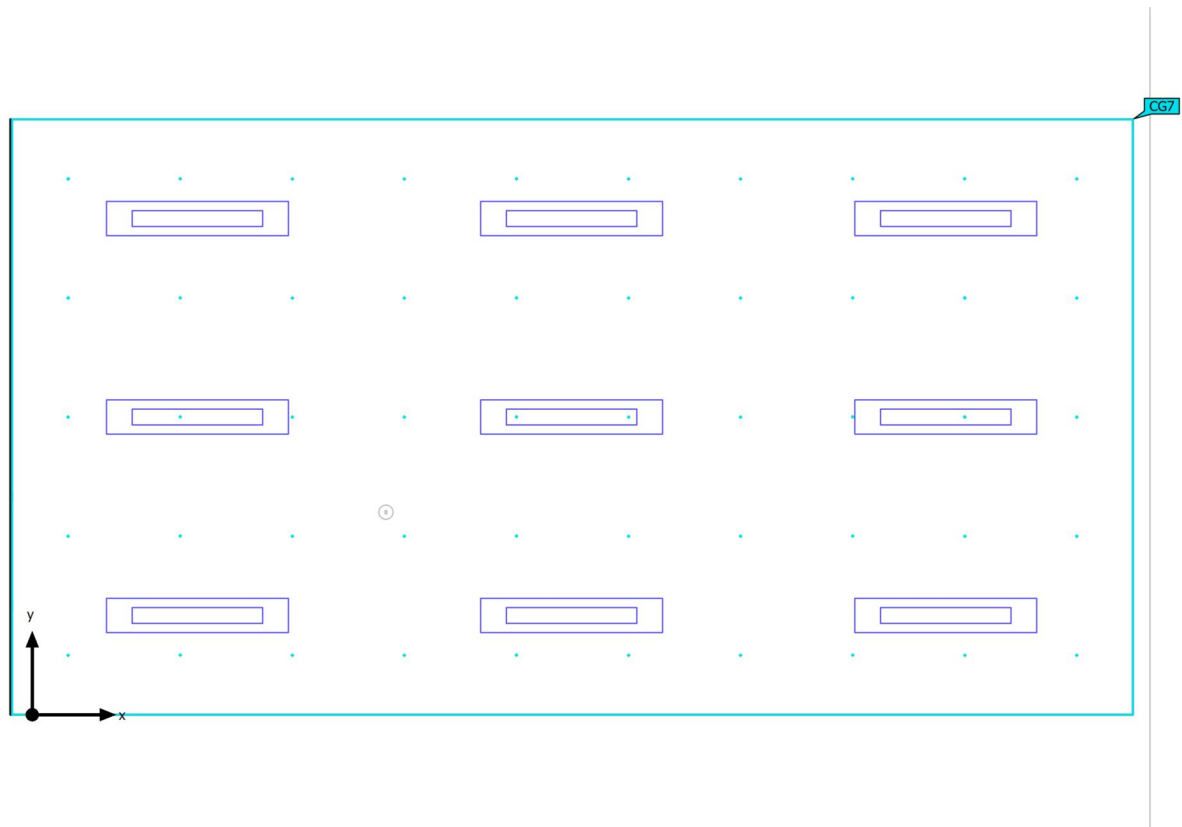

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
207 CAD Perpendicular illuminance Height: 0.700 m	635 lx	423 lx	801 lx	0.67	0.53	CG7

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Calculation objects


207 CAD (RUG)

Strongest glare at	15°
max	18.9
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG7

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Calculation objects


207 CAD (RUG)

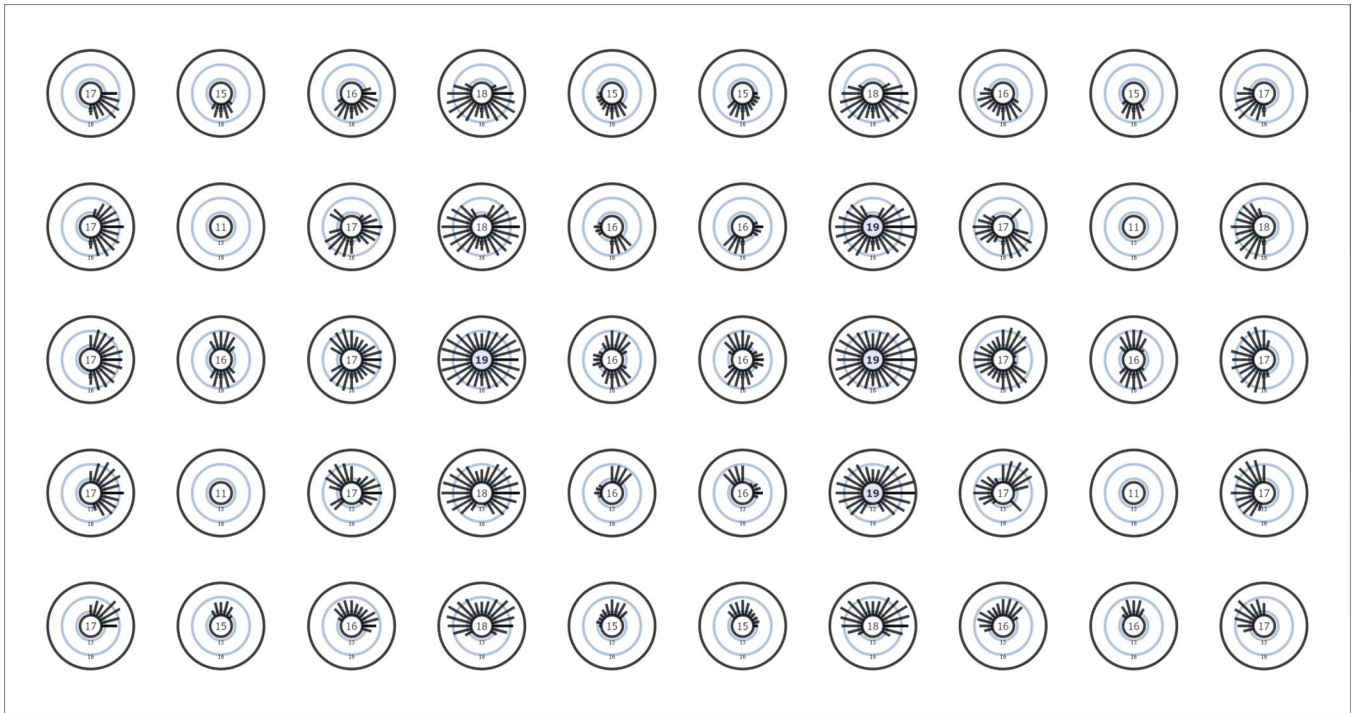

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 207 CAD (Emergency light scene)

Anti panic surface (207 CAD)

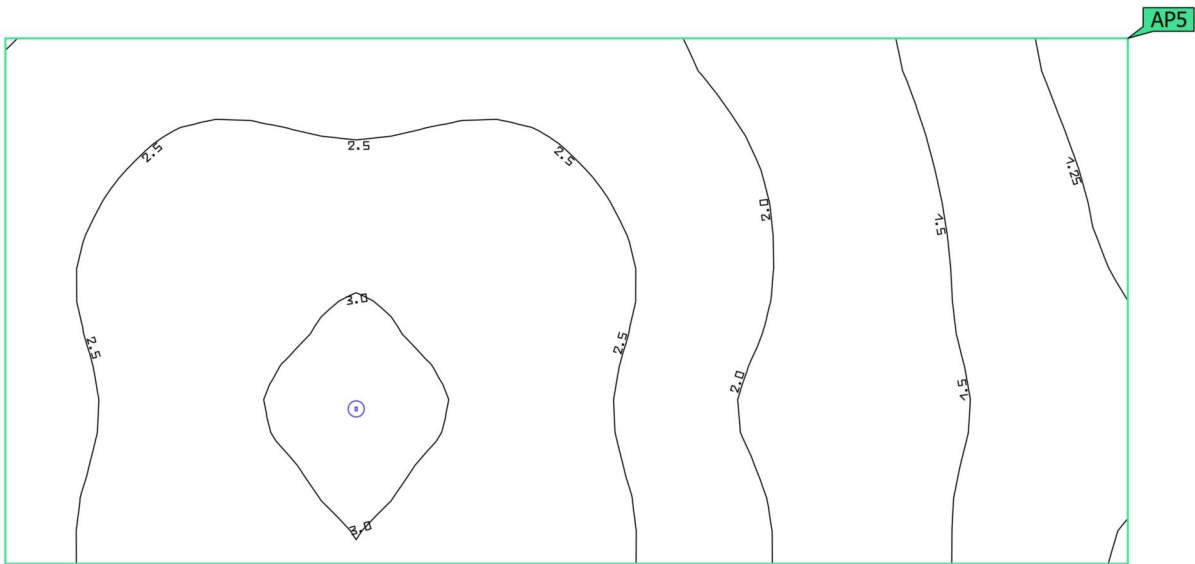


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (207 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.16 lx (≥ 0.50 lx) ✓	3.08 lx	0.38 (≥ 0.025) ✓	AP5

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 207 CAD (Emergency light scene)

207 CAD

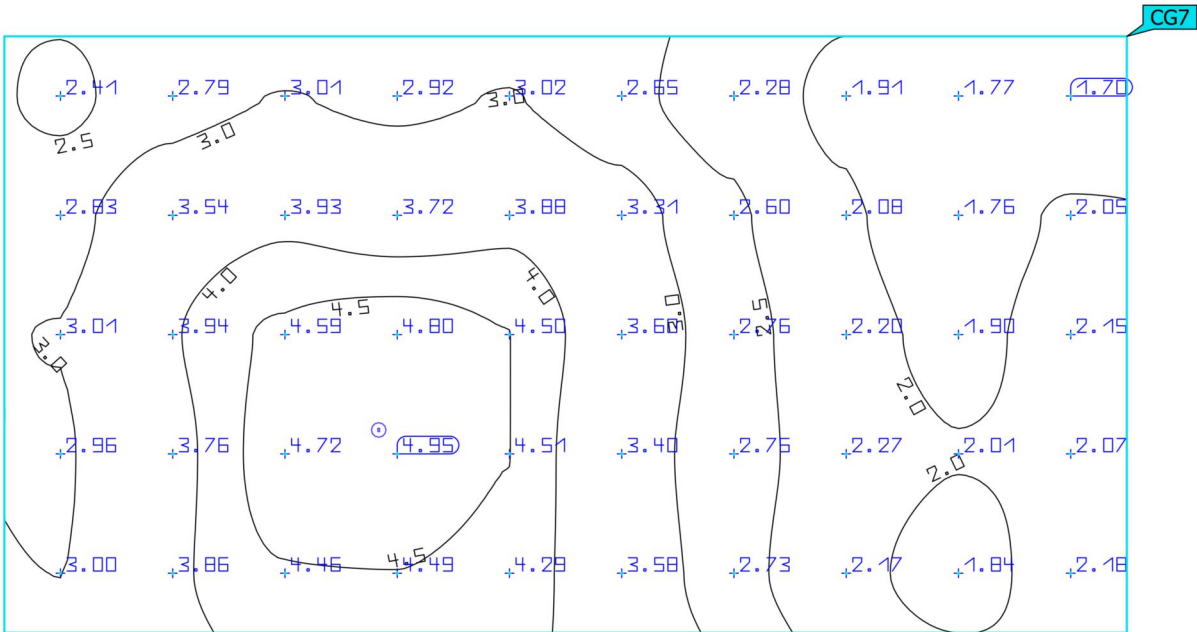


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
207 CAD Perpendicular illuminance Height: 0.700 m	3.07 lx	1.70 lx	4.95 lx	0.55	0.34	CG7

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 207 CAD (Light scene 1)

207 CAD

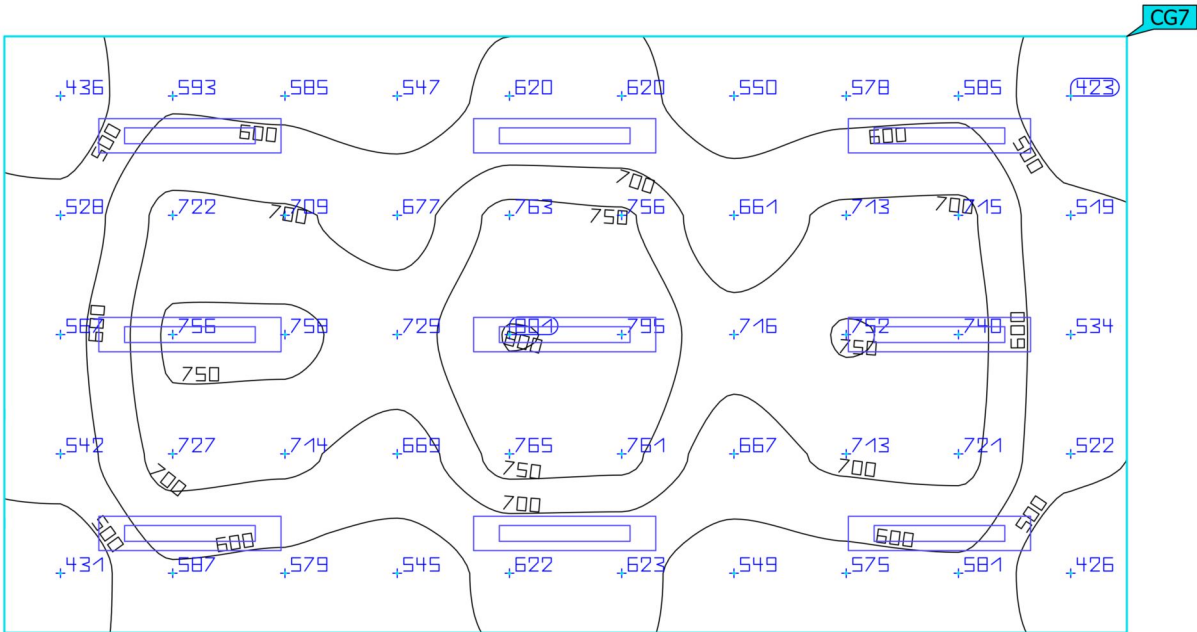


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
207 CAD Perpendicular illuminance Height: 0.700 m	635 lx	423 lx	801 lx	0.67	0.53	CG7

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 208 MEETING (Emergency light scene)

Summary

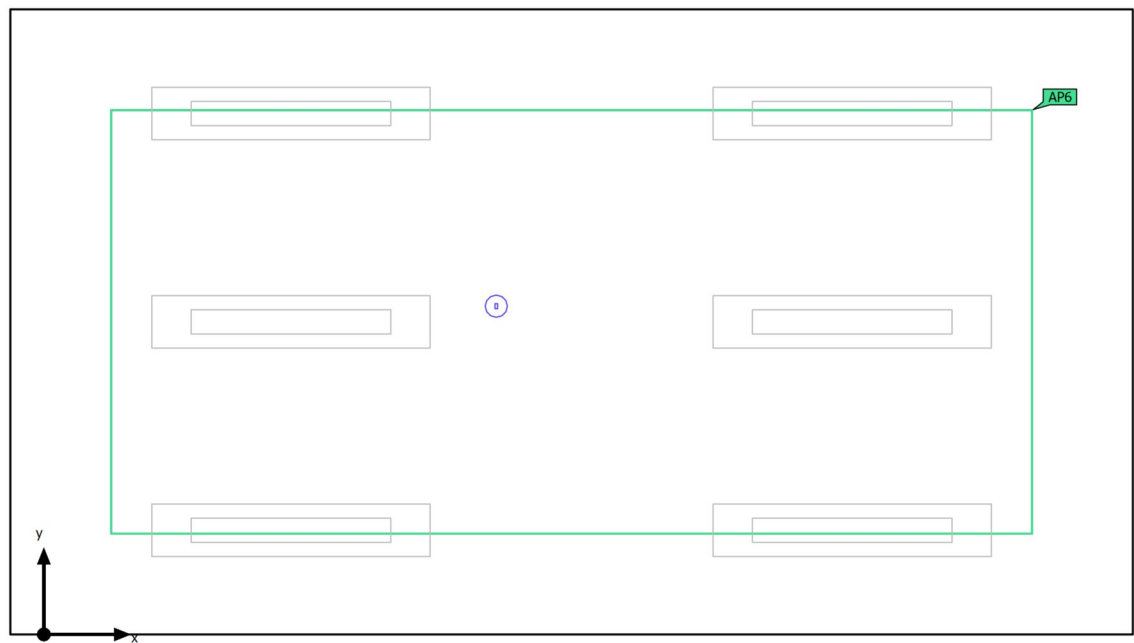

Ground area	17.26 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	3.368 m

Building B · FIRST FOOR · 208 MEETING (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.05 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (208 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	2.02 lx (≥ 0.50 lx) ✓	3.08 lx	0.66 (≥ 0.025) ✓	AP6

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Summary

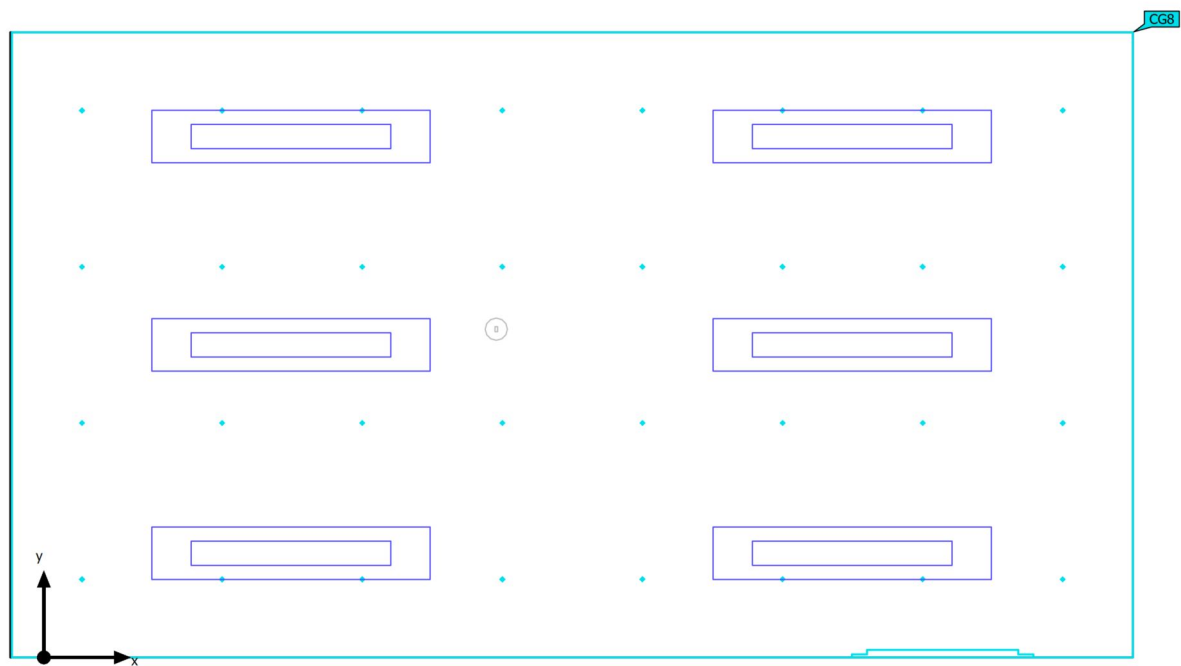

Ground area	17.26 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	2.800 m

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	394 kWh/a	max. 650 kWh/a	✓	
Space	Lighting power density	9.21 W/m ²	–		

(1) Based on a rectangular space of 5.566 m x 3.100 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
6	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 208 MEETING

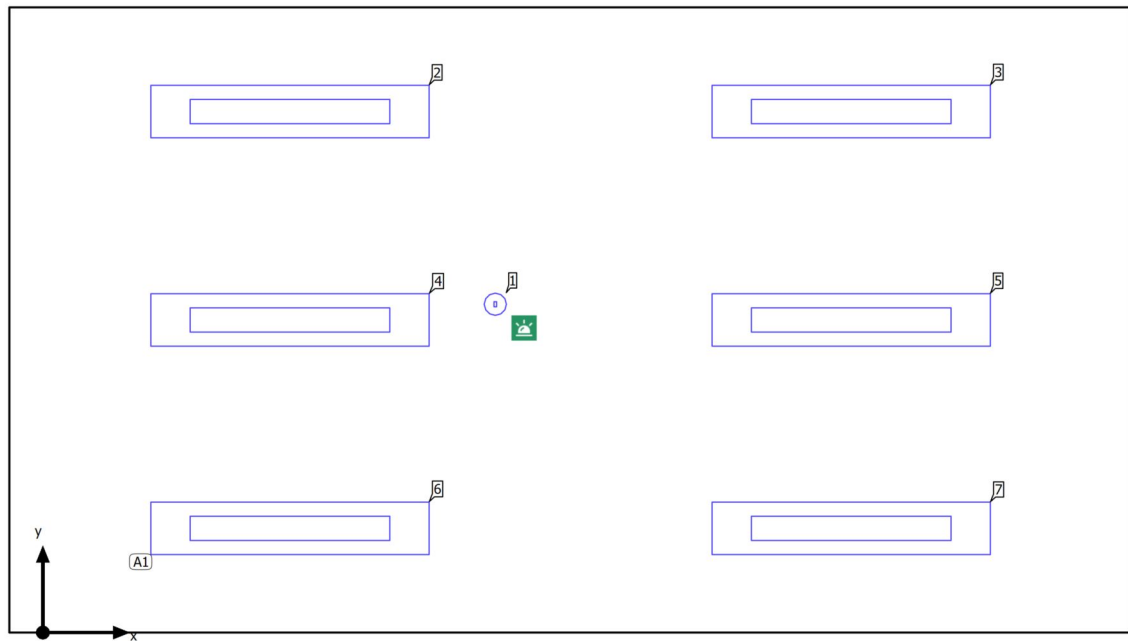Luminaire layout plan

Building B · FIRST FOOR · 208 MEETING


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
2.243 m	1.628 m	3.368 m	1

Building B · FIRST FOOR · 208 MEETING

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

6 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.225 m / 0.517 m / 2.800 m	1.225 m	2.583 m	2.800 m	2
X-direction	2 pcs., Centre - centre, 2.783 m	4.008 m	2.583 m	2.800 m	3
Y-direction	3 pcs., Centre - centre, 1.033 m	1.225 m	1.550 m	2.800 m	4
		4.008 m	1.550 m	2.800 m	5
Arrangement	A1	1.225 m	0.517 m	2.800 m	6
		4.008 m	0.517 m	2.800 m	7

Building B · FIRST FOOR · 208 MEETING


Luminaire list

Φ_{total} 26100 lm	P_{total} 159.9 W	Luminous efficacy 163.2 lm/W	$\Phi_{\text{Emergency lighting}}$ 300 lm	$P_{\text{Emergency lighting}}$ 0.9 W
-----------------------------------	-------------------------------	---------------------------------	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	-
6	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 208 MEETING (Emergency light scene)

Calculation objects

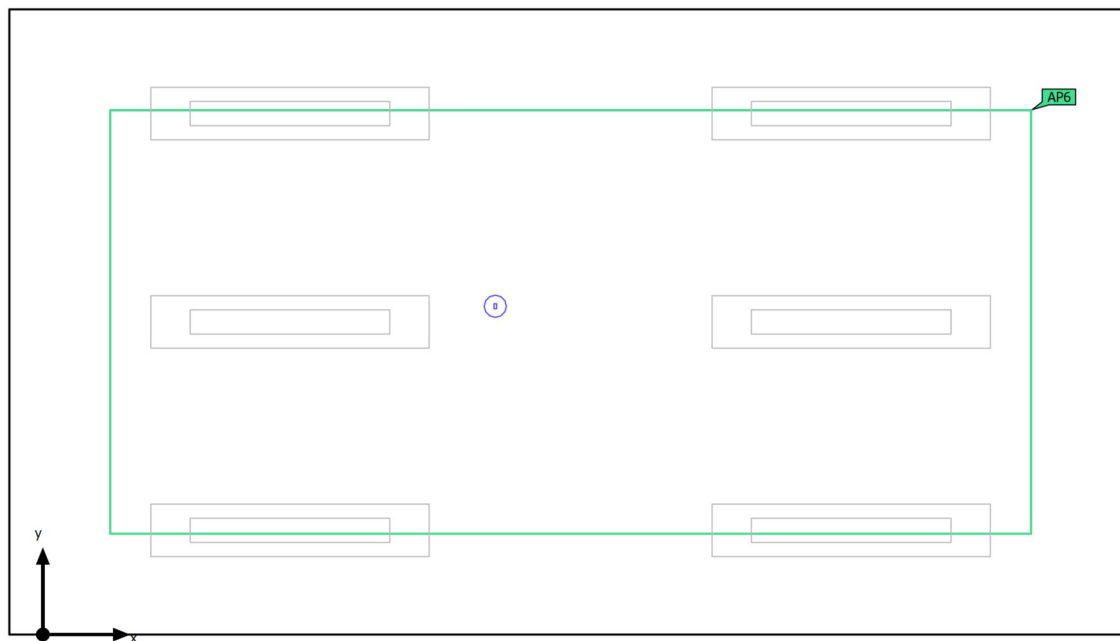

Building B · FIRST FOOR · 208 MEETING (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (208 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	2.02 lx (≥ 0.50 lx) ✓	3.08 lx	0.66 (≥ 0.025) ✓	AP6

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Calculation objects

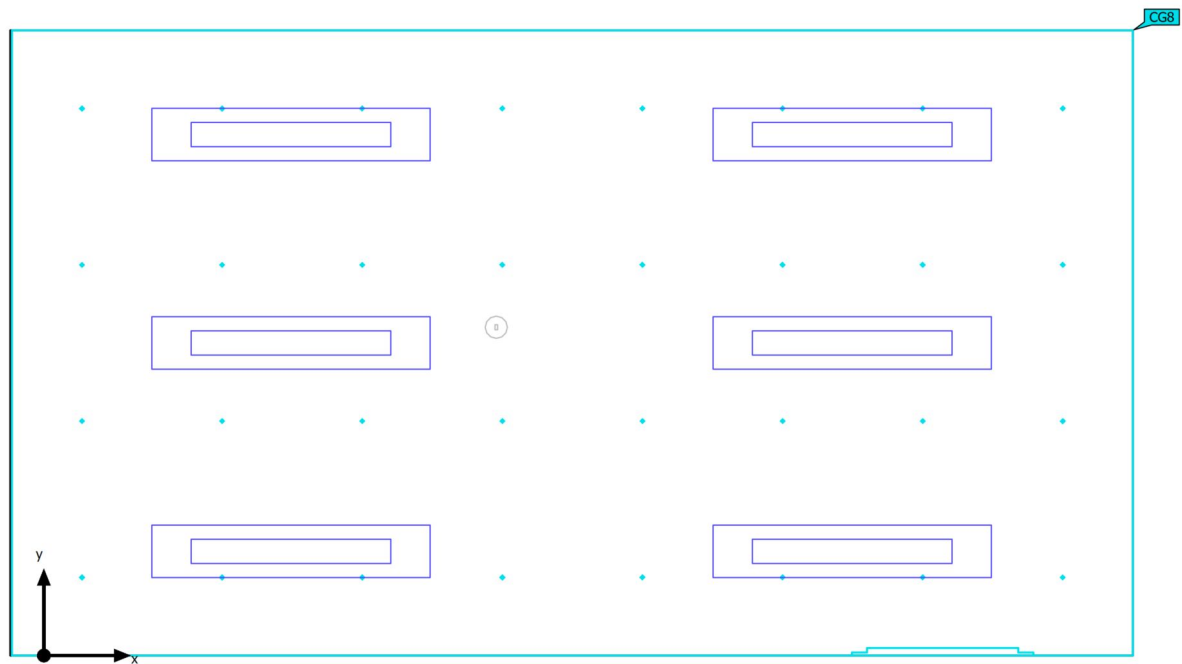

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
208 Meeting Perpendicular illuminance Height: 0.700 m	796 lx	567 lx	989 lx	0.71	0.57	CG8

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 208 MEETING (Emergency light scene)

Anti panic surface (208 MEETING)

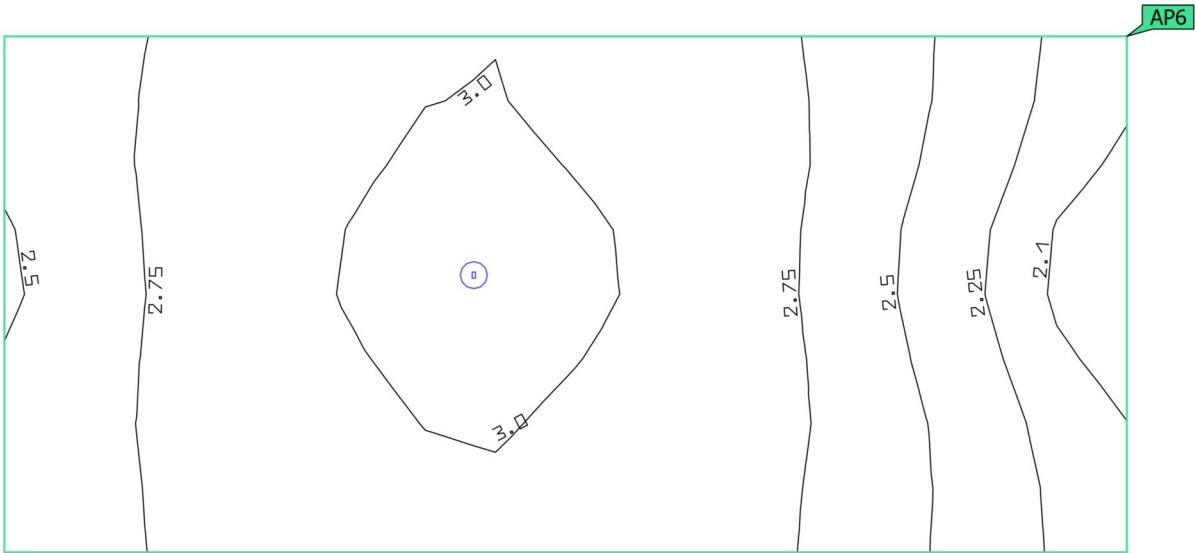


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (208 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	2.02 lx (≥ 0.50 lx) ✓	3.08 lx	0.66 (≥ 0.025) ✓	AP6

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 208 MEETING (Emergency light scene)

208 Meeting

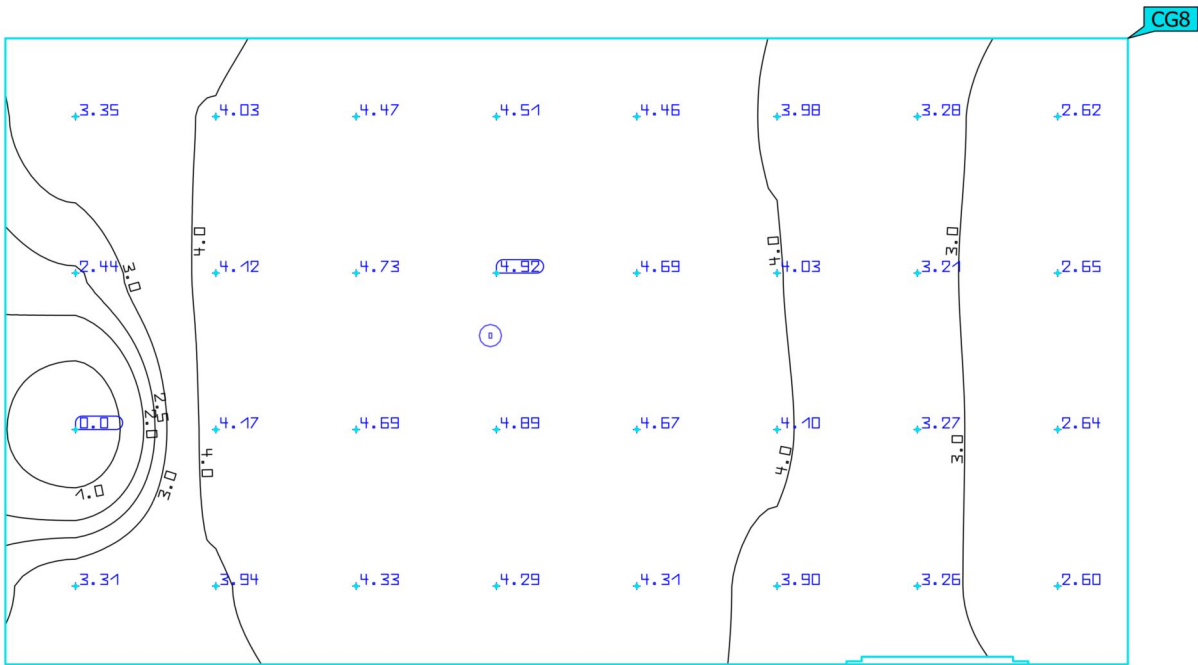


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
208 Meeting Perpendicular illuminance Height: 0.700 m	3.75 lx	0.00 lx	4.92 lx	0.00	0.00	CG8

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

208 Meeting

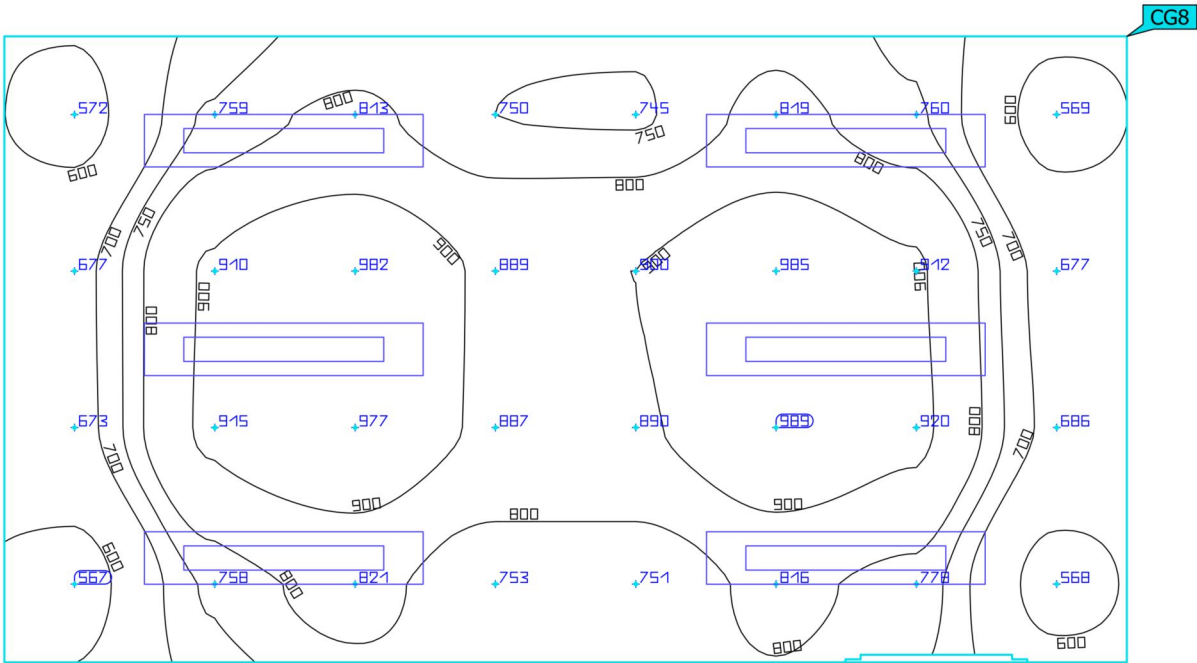


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
208 Meeting Perpendicular illuminance Height: 0.700 m	796 lx	567 lx	989 lx	0.71	0.57	CG8

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 209 TOILET (Emergency light scene)

Summary

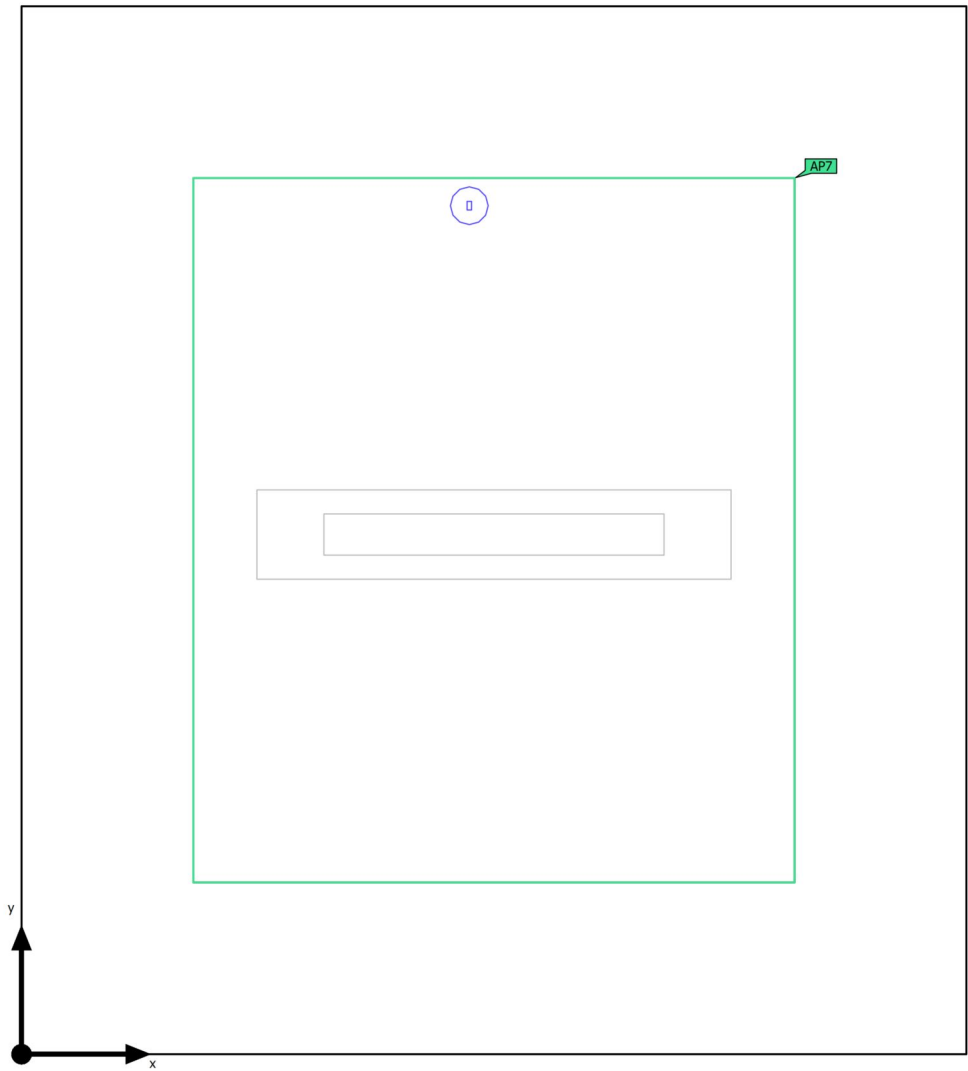

Ground area	8.39 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	3.368 m

Building B · FIRST FOOR · 209 TOILET (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.11 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (209 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m	2.52 lx (≥ 0.50 lx) ✓	3.08 lx	0.82 (≥ 0.025) ✓	AP7

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Summary

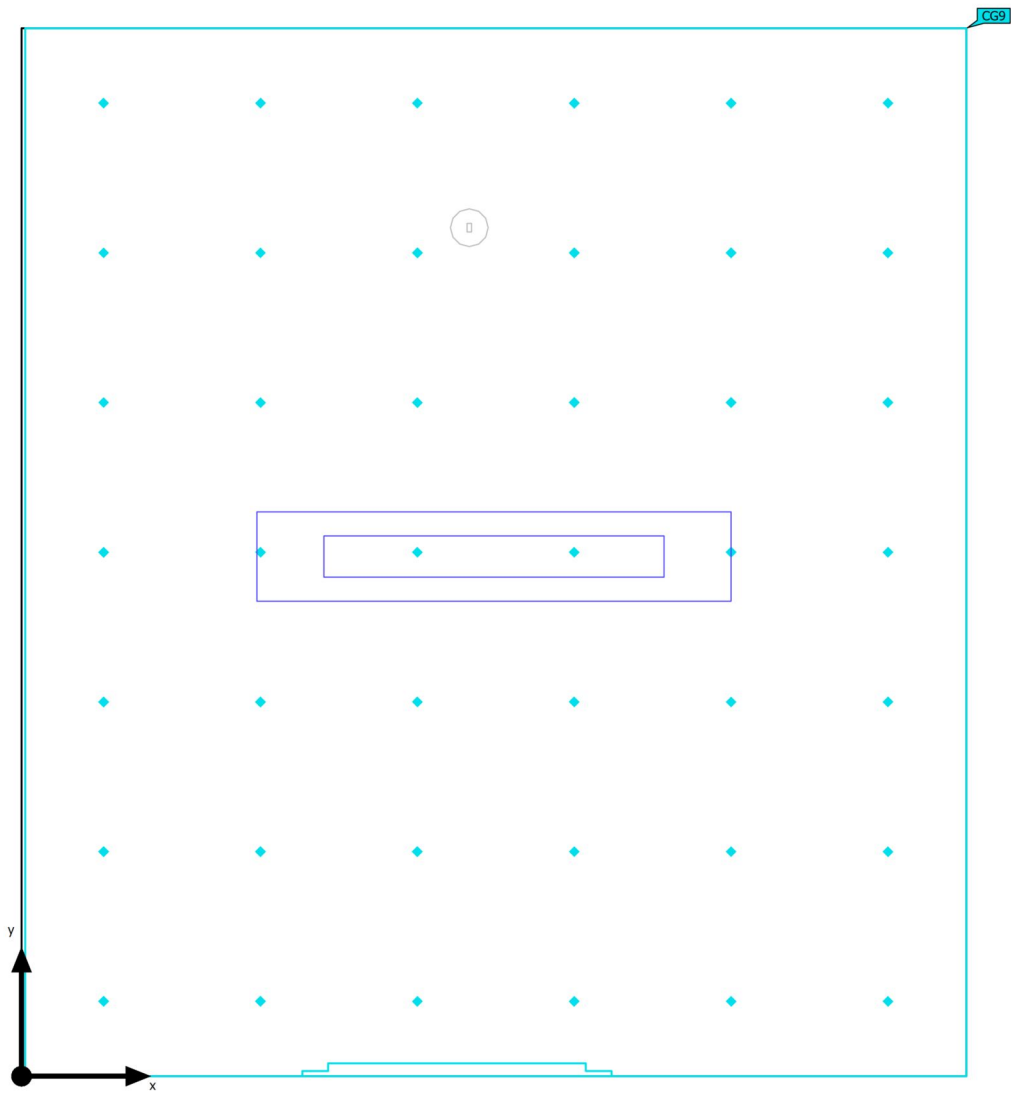

Ground area	8.39 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.88 (fixed)	Mounting height	2.800 m

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[41 - 66] kWh/a	max. 300 kWh/a	✓	
Space	Lighting power density	3.16 W/m ²	–		

(1) Based on a rectangular space of 3.050 m x 2.750 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
1	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 209 TOILET

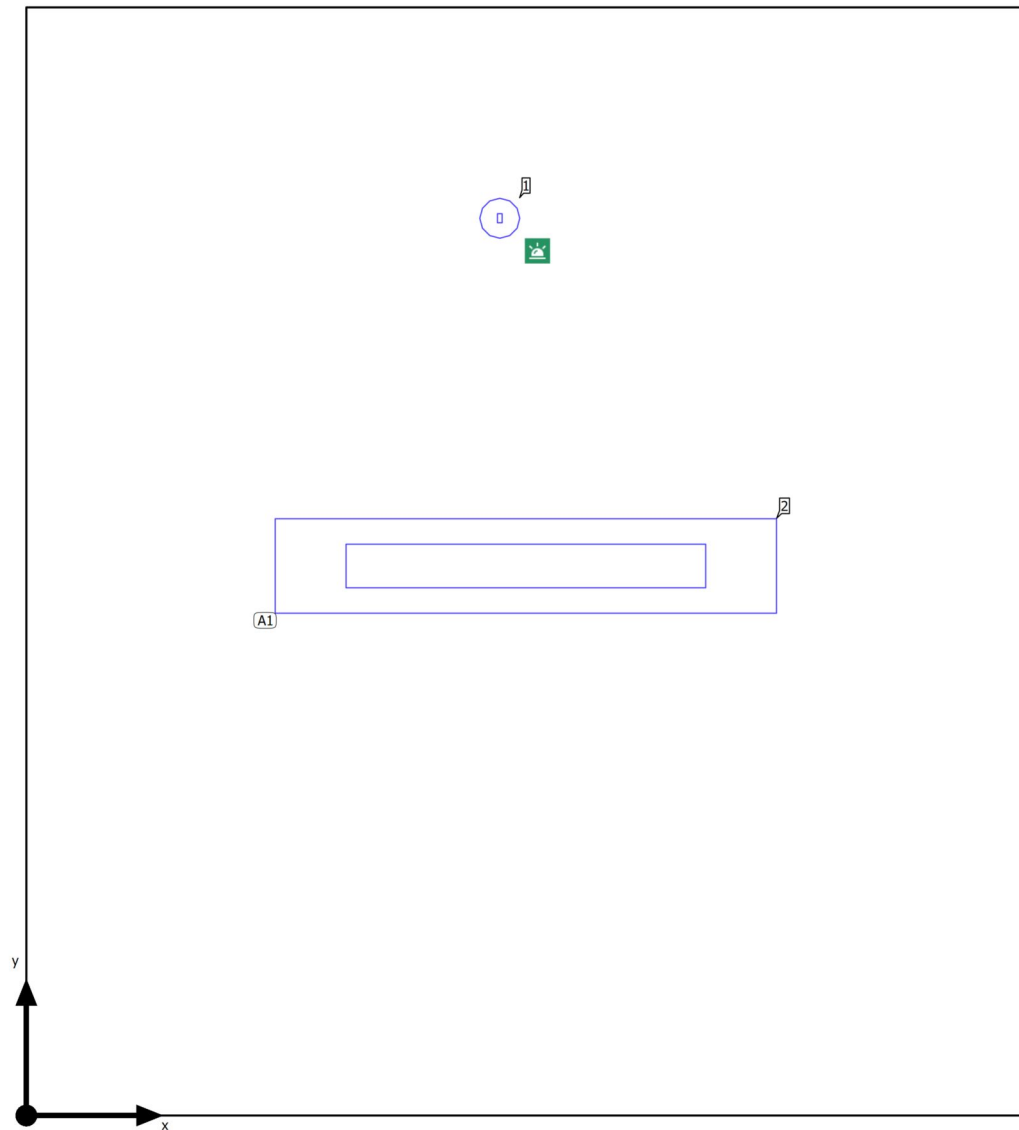Luminaire layout plan

Building B · FIRST FOOR · 209 TOILET


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
1.303 m	2.470 m	3.368 m	1

Building B · FIRST FOOR · 209 TOILET

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

1 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.375 m / 1.513 m / 2.800 m	1.375 m	1.513 m	2.800 m	2
X-direction	1 pcs., Centre - centre, Distances not equal				
Y-direction	2 pcs., Centre - centre, Distances not equal				
Arrangement	A1				


Building B · FIRST FOOR · 209 TOILET

Luminaire list

Φ_{total} 4600 lm		P_{total} 27.4 W		Luminous efficacy 167.9 lm/W		$\Phi_{\text{Emergency lighting}}$ 300 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name				P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRevAB)				0.9 W	300 lm	340.9 lm/W
							 0.9 W	300 lm (100 %)	-
1	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)				26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 209 TOILET (Emergency light scene)

Calculation objects

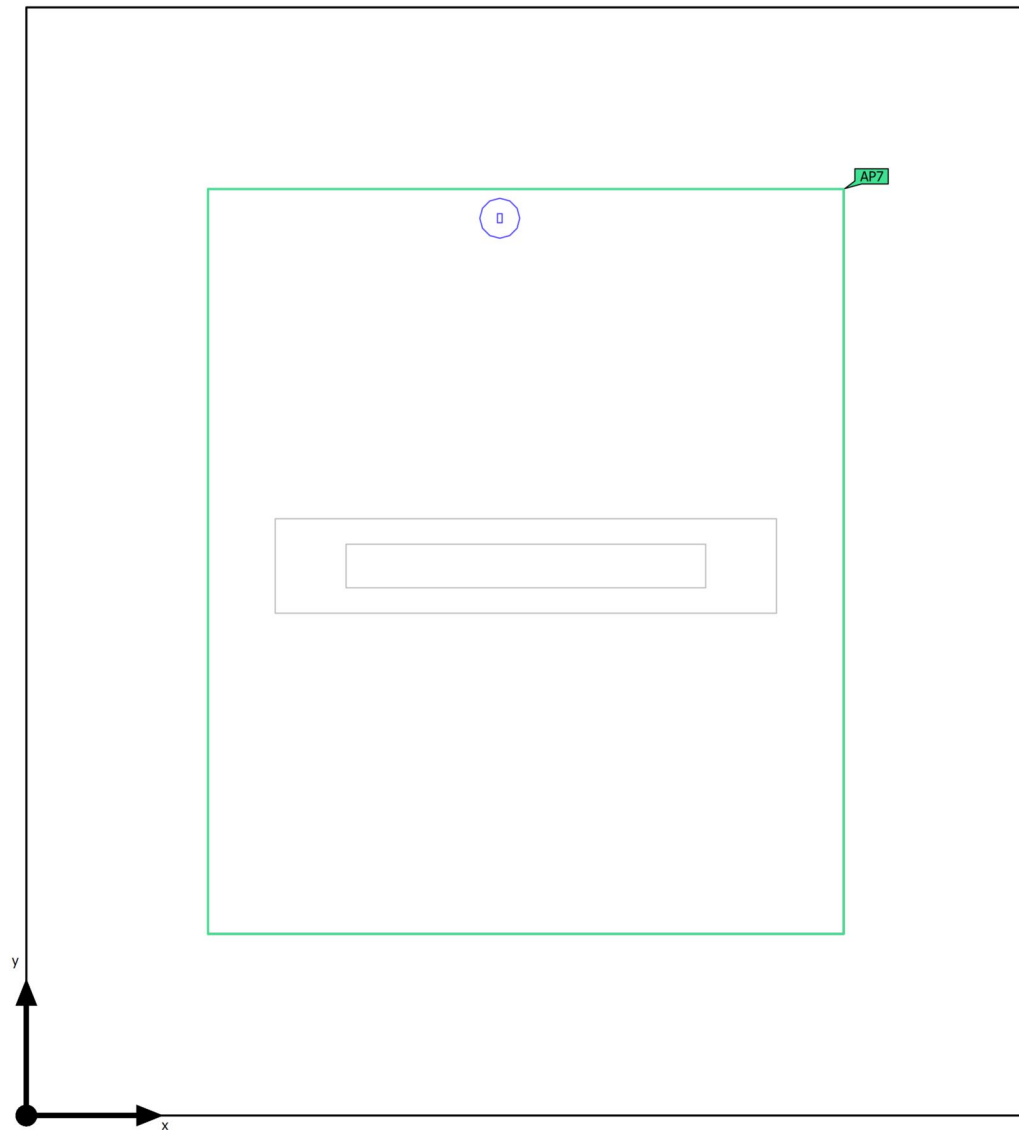

Building B · FIRST FOOR · 209 TOILET (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (209 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m	2.52 lx (≥ 0.50 lx) ✓	3.08 lx	0.82 (≥ 0.025) ✓	AP7

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Calculation objects

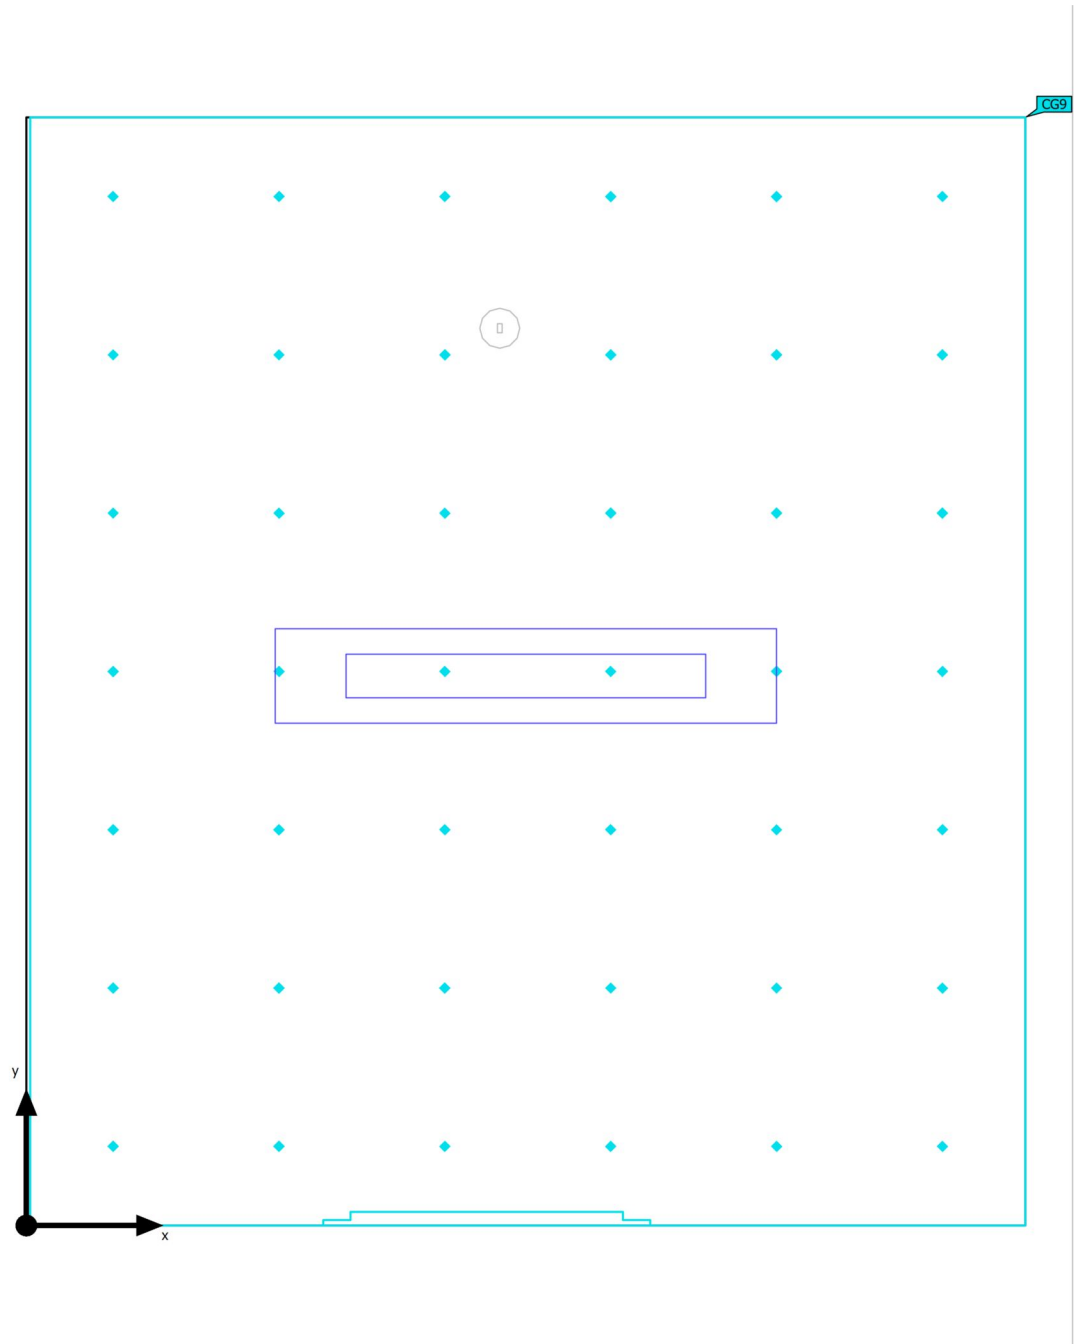

Building B · FIRST FOOR · 209 TOILET (Light scene 1)



Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
209 Toilet Perpendicular illuminance Height: 0.000 m	193 lx	143 lx	244 lx	0.74	0.59	CG9

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 209 TOILET (Emergency light scene)
Anti panic surface (209 TOILET)

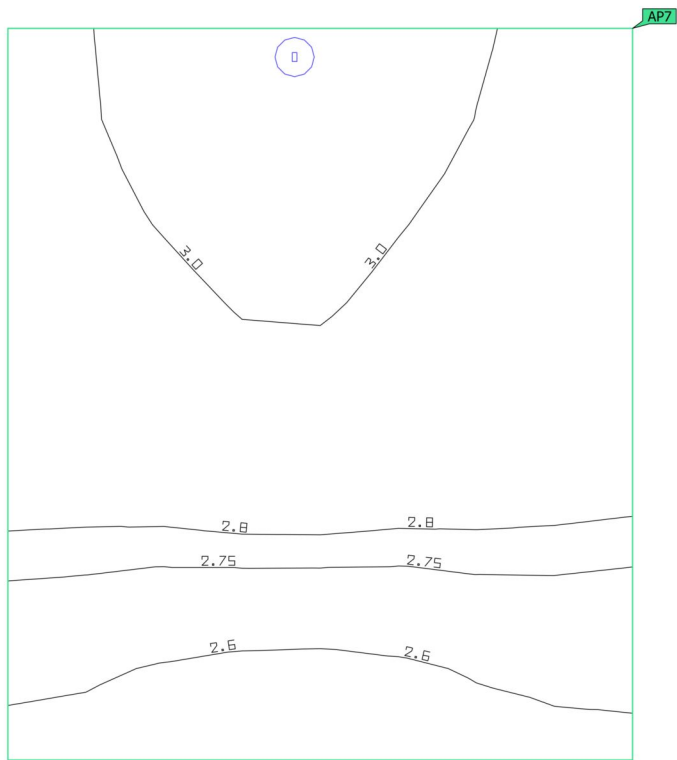



Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (209 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m	2.52 lx (≥ 0.50 lx) ✓	3.08 lx	0.82 (≥ 0.025) ✓	AP7

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 209 TOILET (Emergency light scene)

209 Toilet

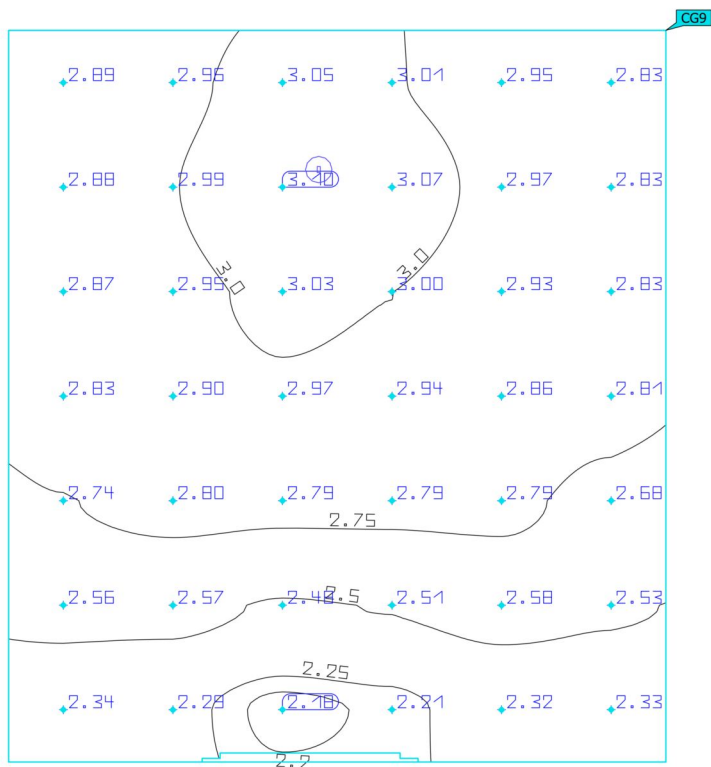



Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
209 Toilet	2.76 lx	2.18 lx	3.10 lx	0.79	0.70	CG9
Perpendicular illuminance						
Height: 0.000 m						

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

209 Toilet

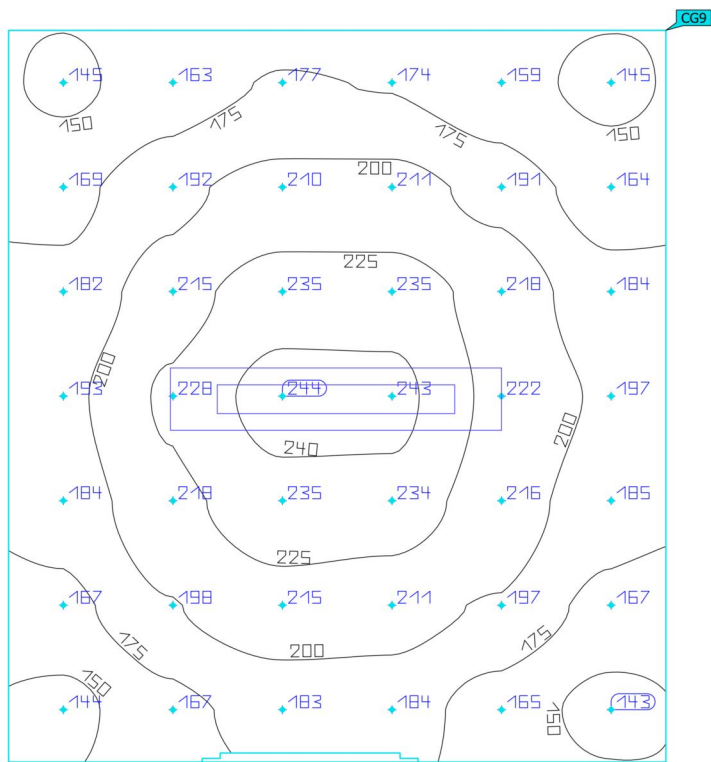


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
209 Toilet Perpendicular illuminance Height: 0.000 m	193 lx	143 lx	244 lx	0.74	0.59	CG9

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 210 OFFICE (Emergency light scene)

Summary

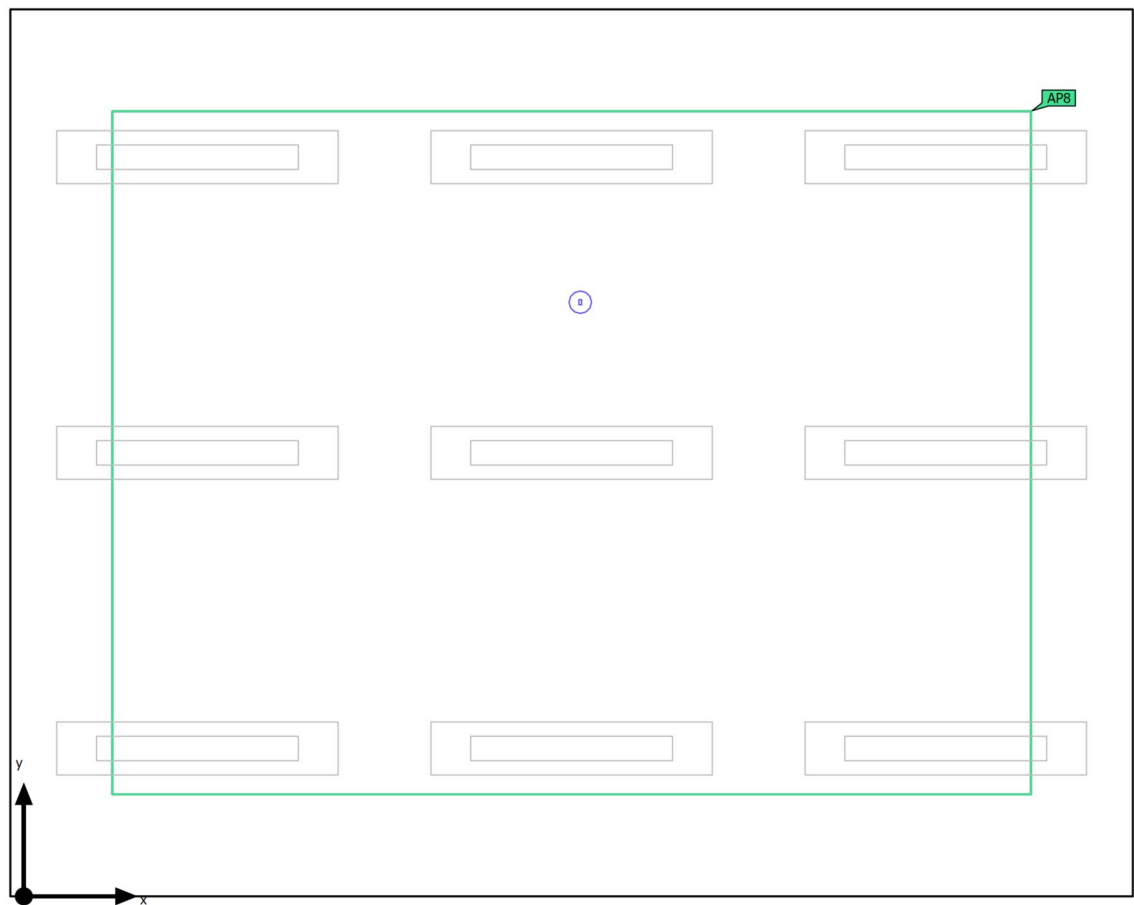

Ground area	23.95 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	3.368 m

Building B · FIRST FOOR · 210 OFFICE (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.04 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (210 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	2.07 lx (≥ 0.50 lx) ✓	3.08 lx	0.67 (≥ 0.025) ✓	AP8

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Summary

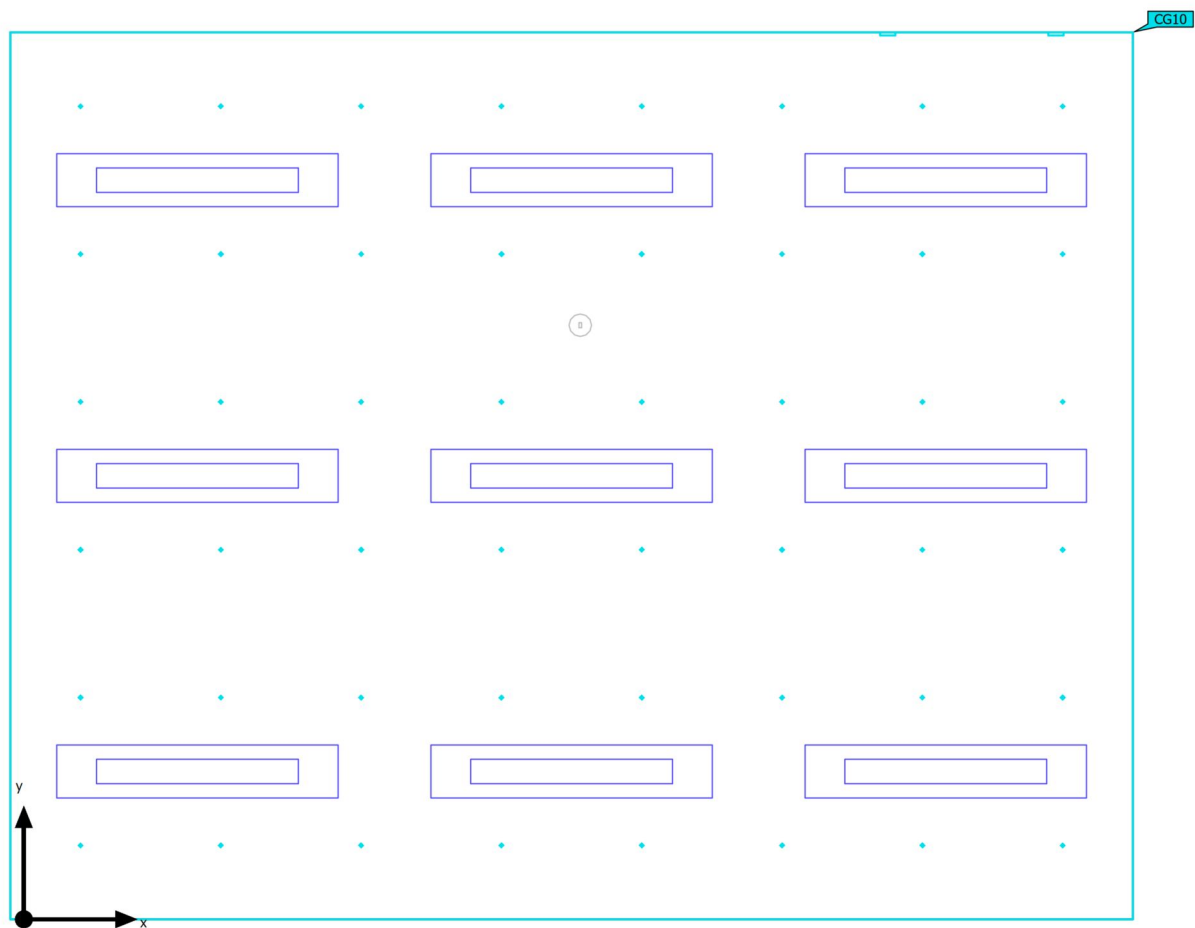

Ground area	23.95 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	2.800 m

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	590 kWh/a	max. 850 kWh/a	✓	
Space	Lighting power density	9.96 W/m ²	–		

(1) Based on a rectangular space of 5.505 m x 4.350 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
9	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 210 OFFICE

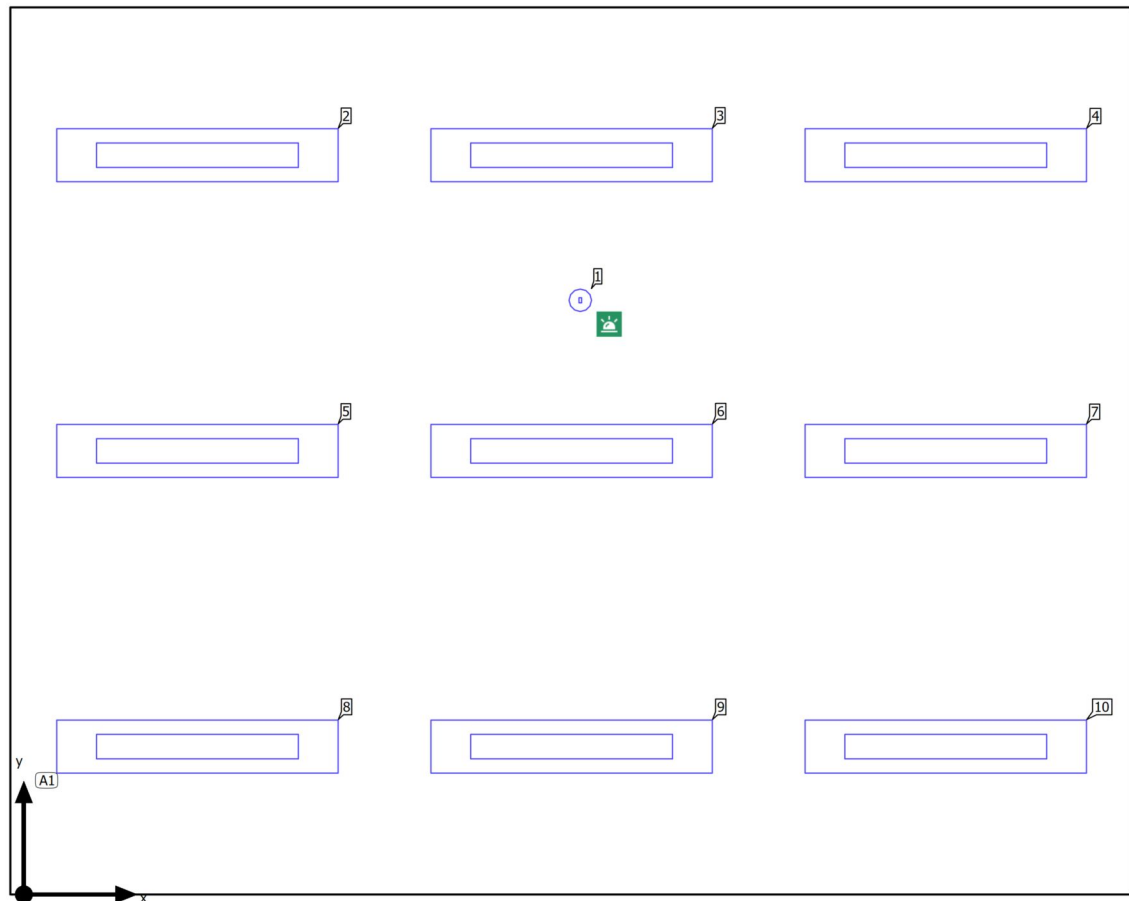Luminaire layout plan

Building B · FIRST FOOR · 210 OFFICE


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
2.729 m	2.914 m	3.368 m	1

Building B · FIRST FOOR · 210 OFFICE

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	Φ _{Luminaire}	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

9 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.851 m / 0.725 m / 2.800 m	0.851 m	3.625 m	2.800 m	2
X-direction	3 pcs., Centre - centre, 1.835 m	2.686 m	3.625 m	2.800 m	3
Y-direction	3 pcs., Centre - centre, 1.450 m	4.521 m	3.625 m	2.800 m	4
Arrangement	A1	0.851 m	2.175 m	2.800 m	5
		2.686 m	2.175 m	2.800 m	6
		4.521 m	2.175 m	2.800 m	7
		0.851 m	0.725 m	2.800 m	8
		2.686 m	0.725 m	2.800 m	9
		4.521 m	0.725 m	2.800 m	10


Building B · FIRST FOOR · 210 OFFICE

Luminaire list

Φ_{total} 39000 lm		P_{total} 239.4 W		Luminous efficacy 162.9 lm/W		$\Phi_{\text{Emergency lighting}}$ 300 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)			0.9 W	300 lm	340.9 lm/W	
						0.9 W	300 lm (100 %)	-	
9	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)			26.5 W	4291 lm	161.9 lm/W	

Building B · FIRST FOOR · 210 OFFICE (Emergency light scene)

Calculation objects

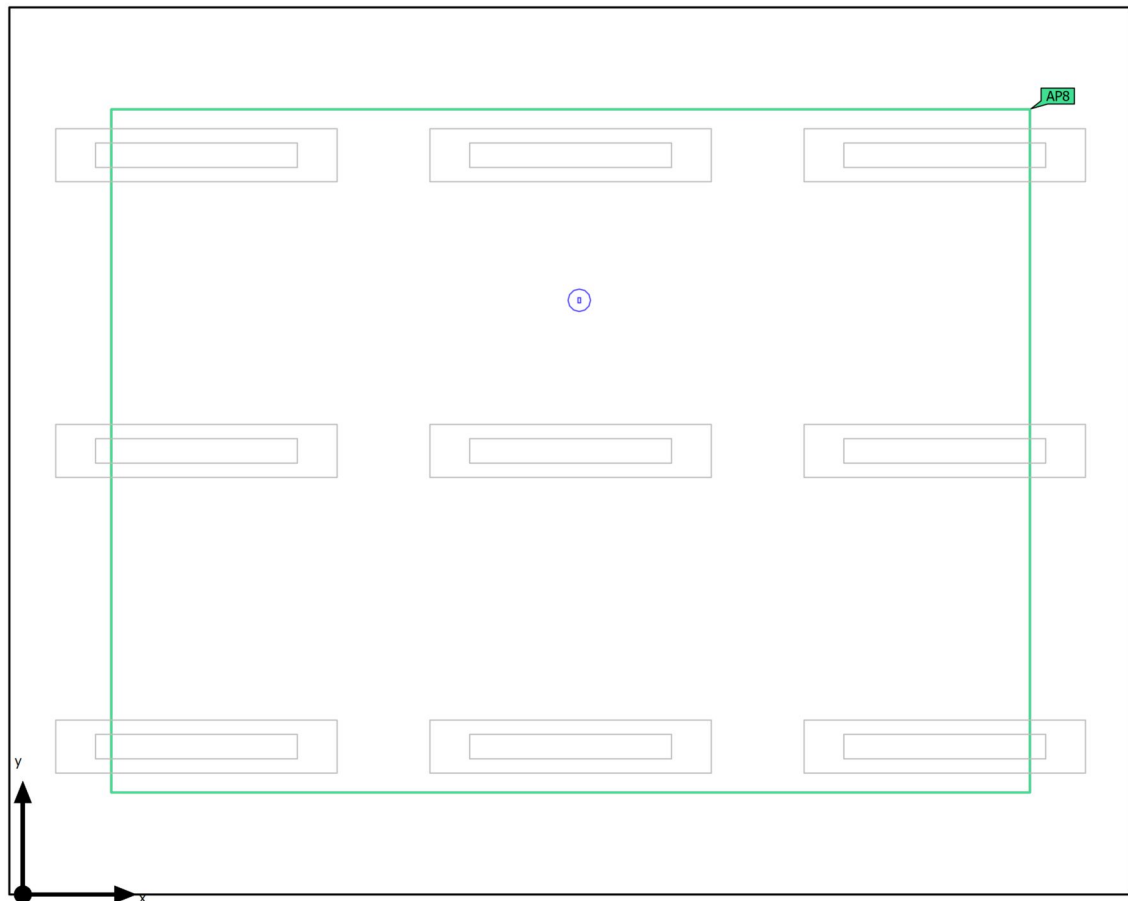

Building B · FIRST FOOR · 210 OFFICE (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (210 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	2.07 lx (≥ 0.50 lx) ✓	3.08 lx	0.67 (≥ 0.025) ✓	AP8

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Calculation objects

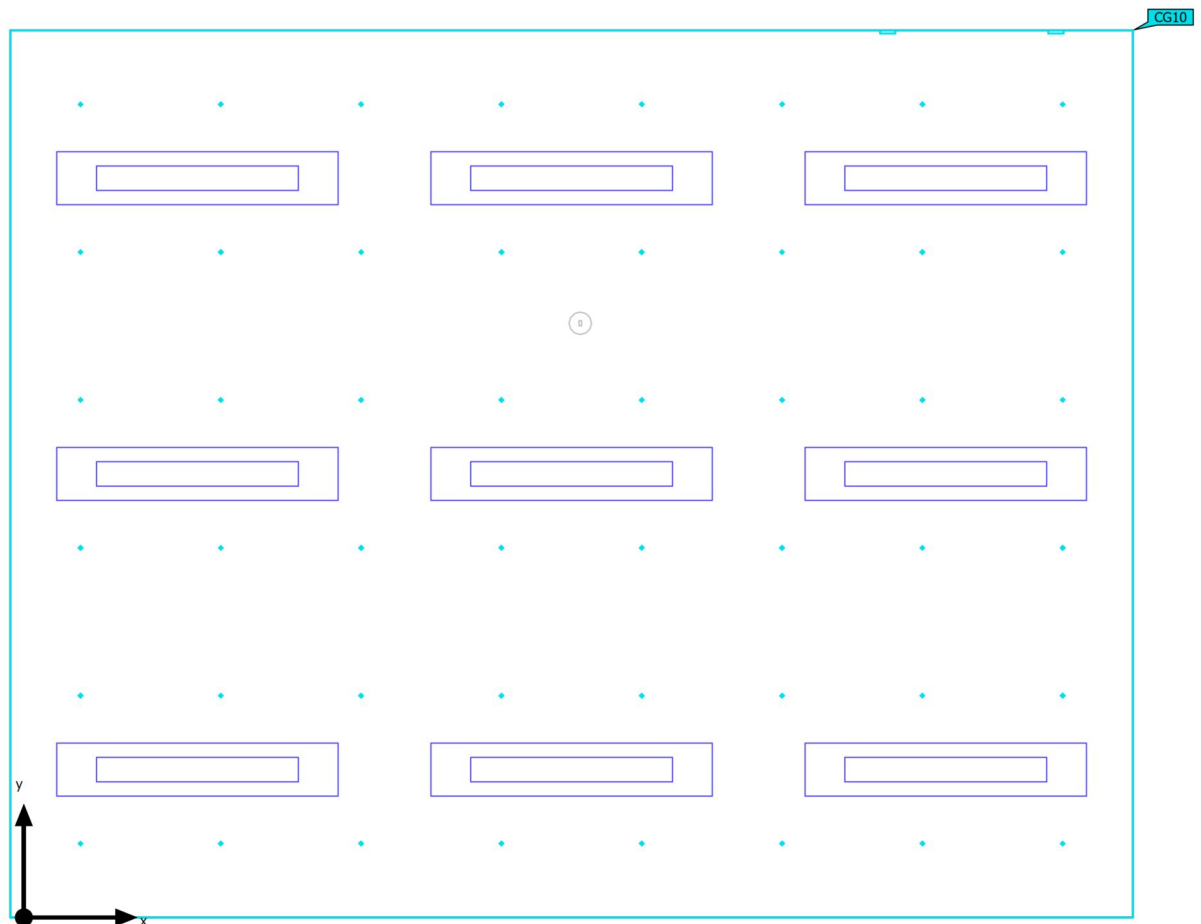

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
210 Office Perpendicular illuminance Height: 0.700 m	959 lx	636 lx	1174 lx	0.66	0.54	CG10

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 210 OFFICE (Emergency light scene)



Anti panic surface (210 OFFICE)

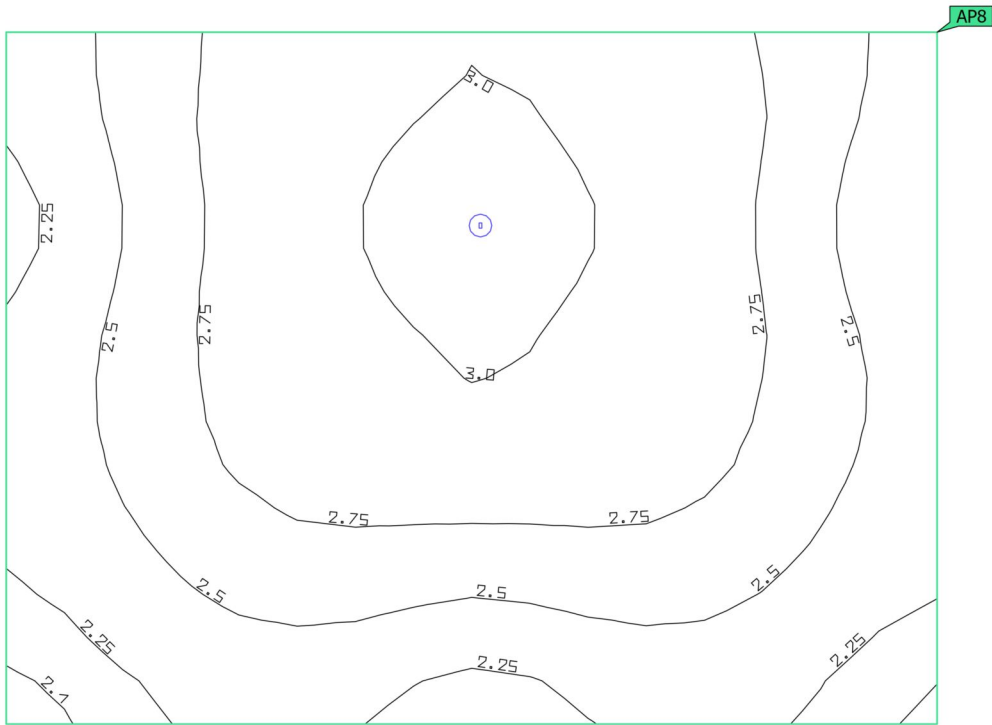

Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (210 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	2.07 lx (≥ 0.50 lx) ✓	3.08 lx	0.67 (≥ 0.025) ✓	AP8

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 210 OFFICE (Emergency light scene)

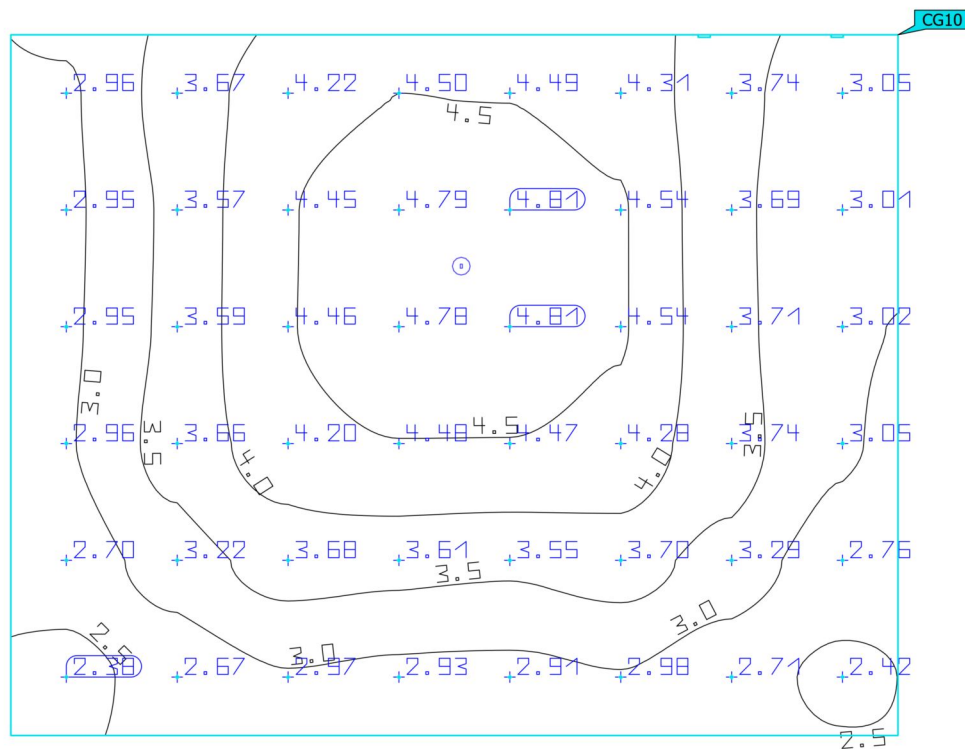

210 Office

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
210 Office	3.62 lx	2.38 lx	4.81 lx	0.66	0.49	CG10
Perpendicular illuminance						
Height: 0.700 m						

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

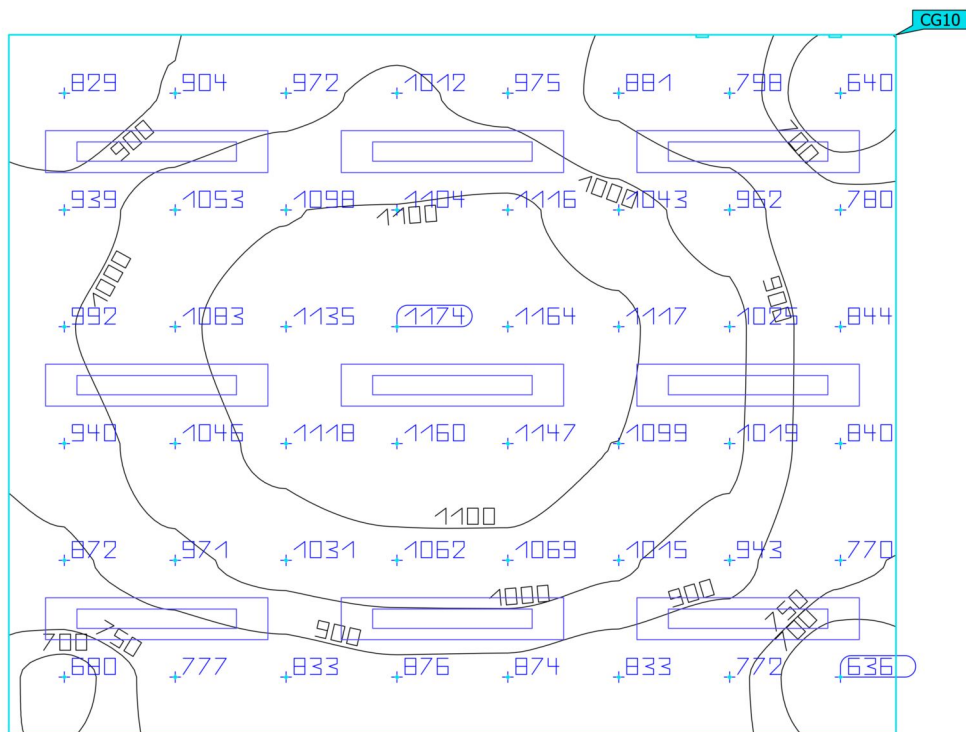
210 Office

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
210 Office Perpendicular illuminance Height: 0.700 m	959 lx	636 lx	1174 lx	0.66	0.54	CG10

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 211 TOILET (Emergency light scene)

Summary

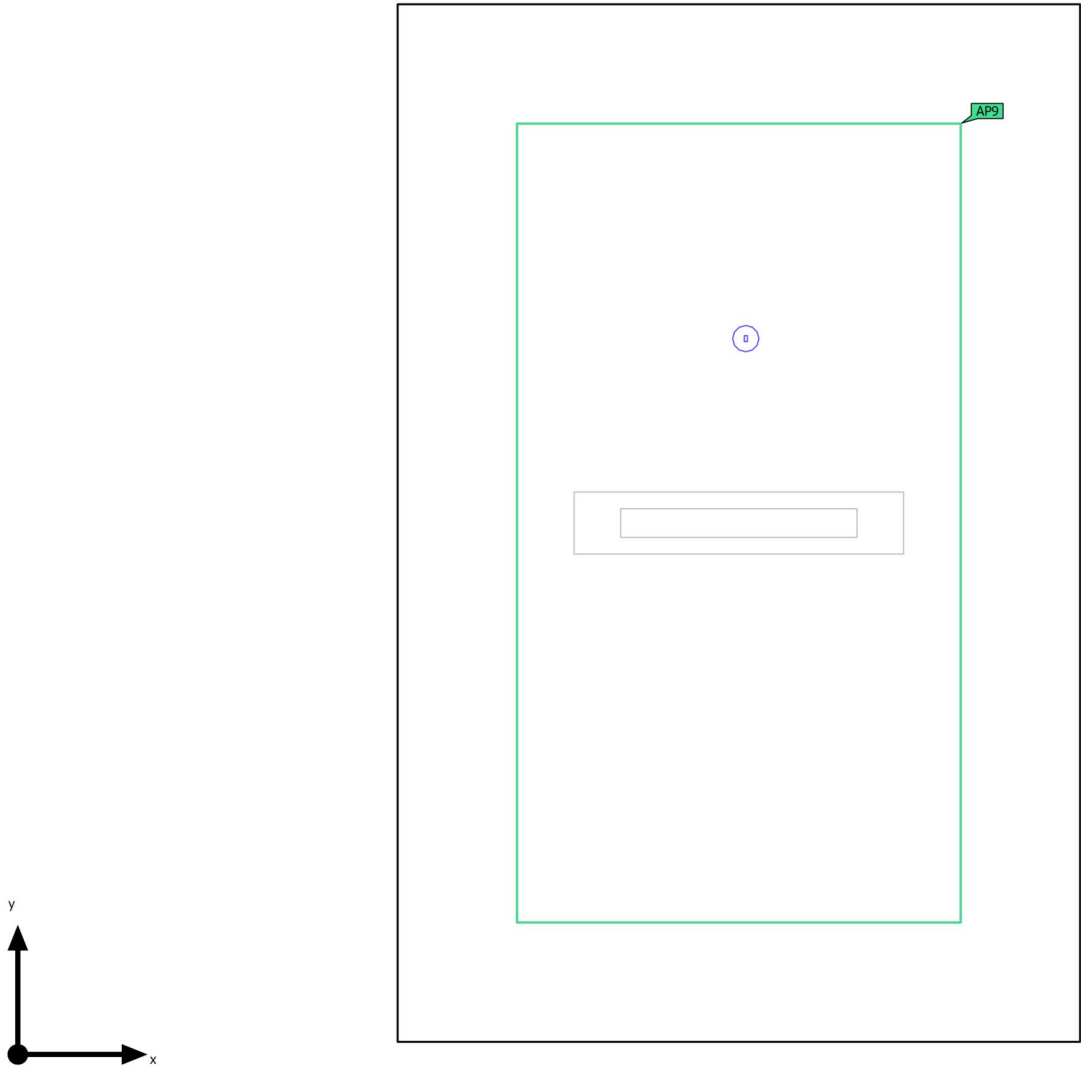

Ground area	12.43 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	3.368 m

Building B · FIRST FOOR · 211 TOILET (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.07 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (211 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m	2.16 lx (≥ 0.50 lx) ✓	3.07 lx	0.70 (≥ 0.025) ✓	AP9

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Summary

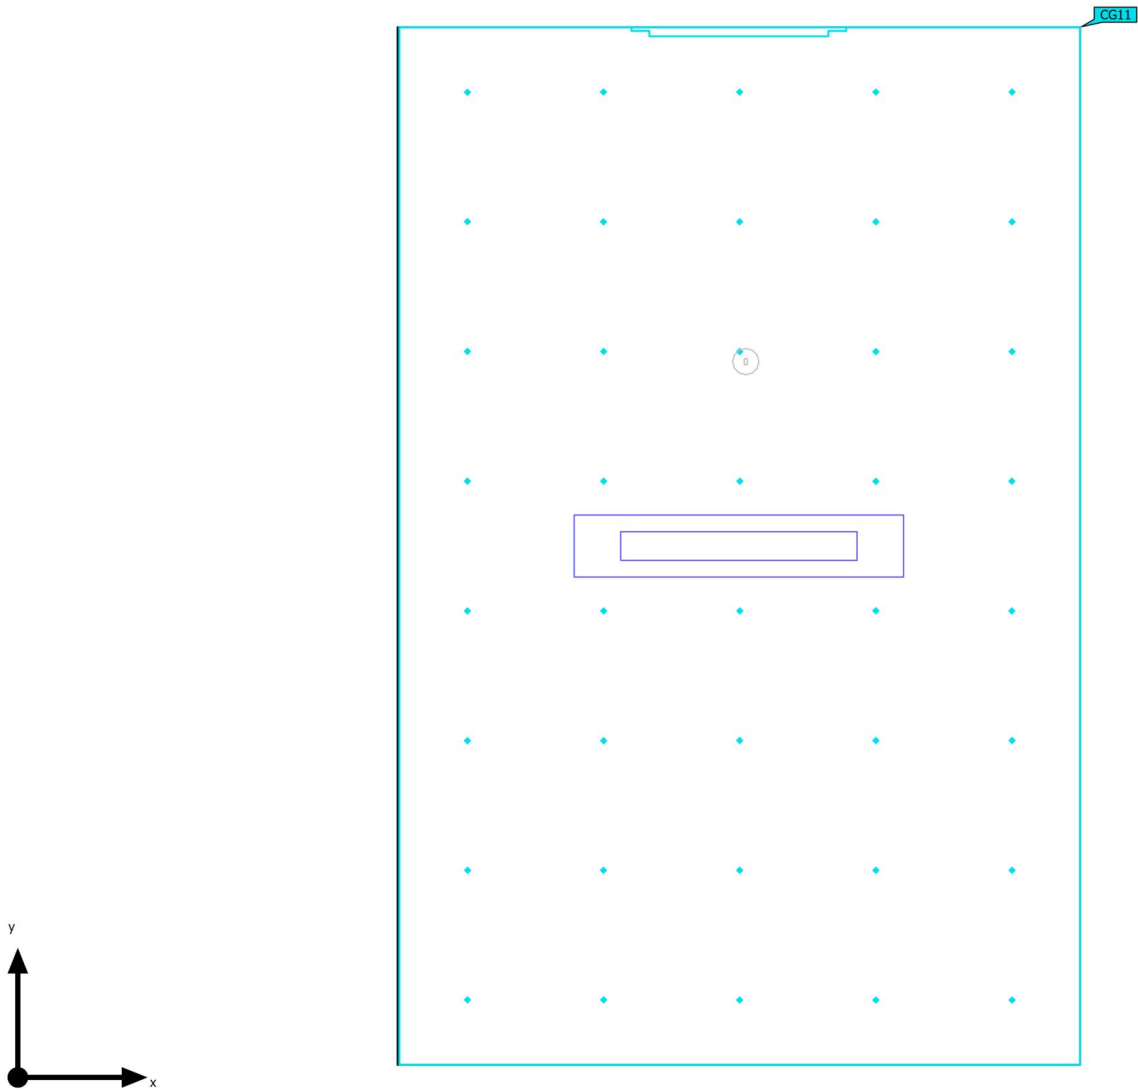

Ground area	12.43 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	2.800 m

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[41 - 66] kWh/a	max. 450 kWh/a	✓	
Space	Lighting power density	2.13 W/m ²	–		

(1) Based on a rectangular space of 4.347 m x 2.859 m and SHR of 0.25.



(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
1	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 211 TOILET

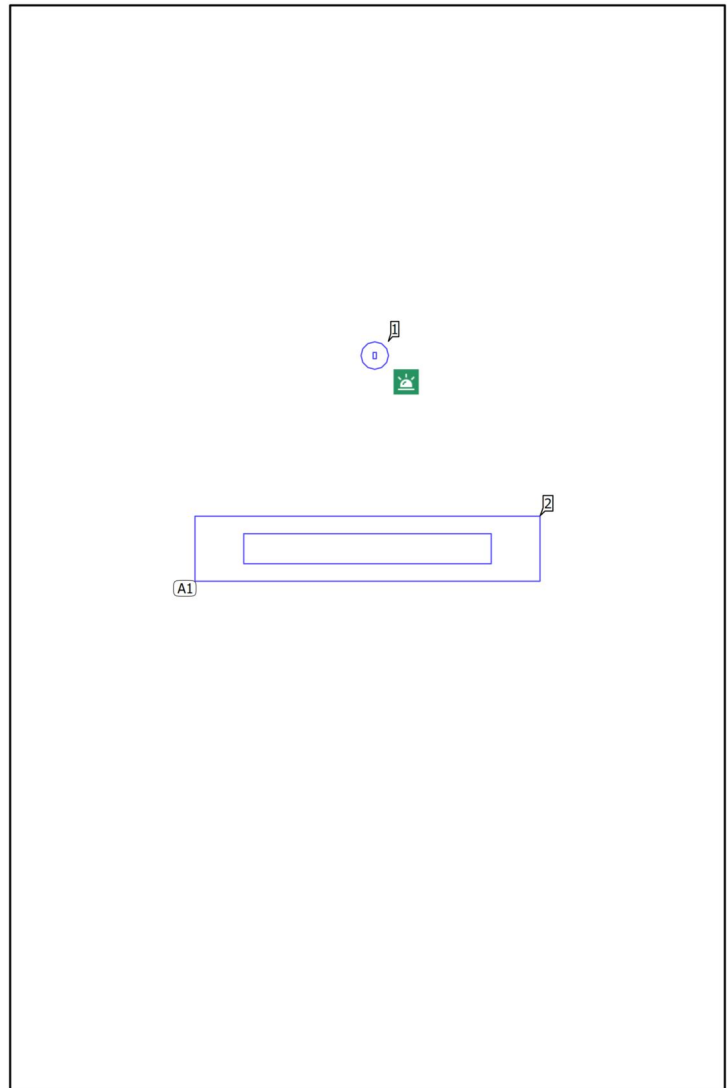Luminaire layout plan

Building B · FIRST FOOR · 211 TOILET


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
3.050 m	2.999 m	3.368 m	1

Building B · FIRST FOOR · 211 TOILET

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

1 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	3.021 m / 2.226 m / 2.800 m	3.021 m	2.226 m	2.800 m	2
X-direction	1 pcs., Centre - centre, Distances not equal				
Y-direction	3 pcs., Centre - centre, Distances not equal				
Arrangement	A1				



Building B · FIRST FOOR · 211 TOILET

Luminaire list

Φ_{total} 4600 lm		P_{total} 27.4 W		Luminous efficacy 167.9 lm/W		$\Phi_{\text{Emergency lighting}}$ 300 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name				P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRevAB)				0.9 W	300 lm	340.9 lm/W
							 0.9 W	300 lm (100 %)	-
1	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)				26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 211 TOILET (Emergency light scene)

Calculation objects

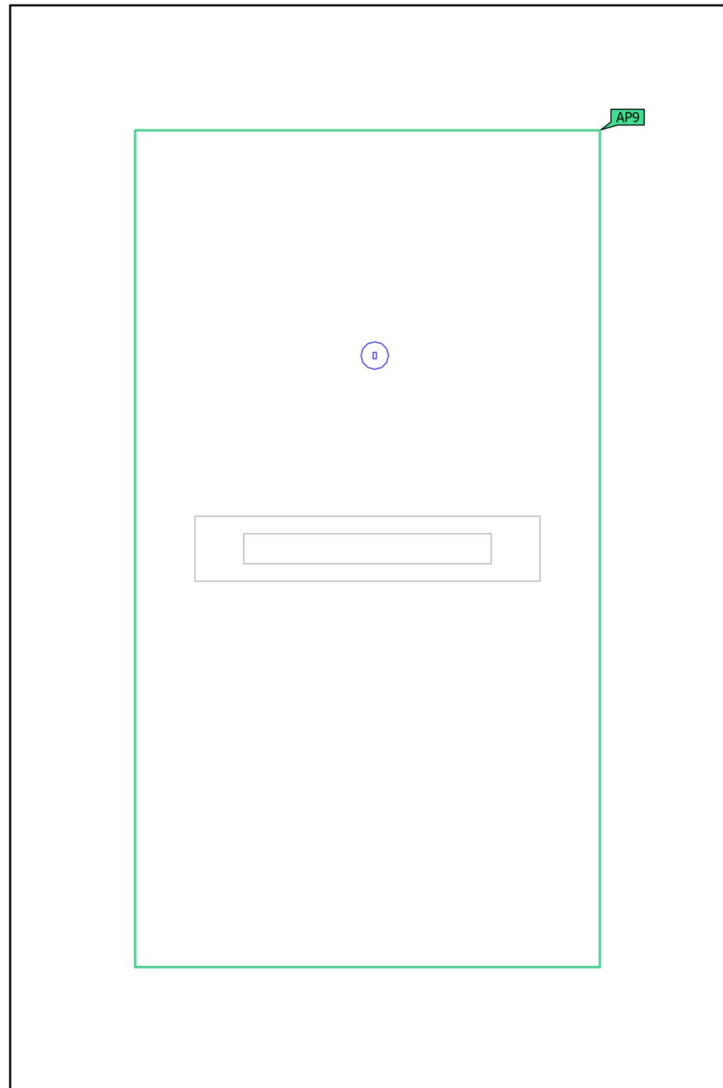

Building B · FIRST FOOR · 211 TOILET (Emergency light scene)

Calculation objects

Anti panic surfaces



Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (211 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m	2.16 lx (≥ 0.50 lx) ✓	3.07 lx	0.70 (≥ 0.025) ✓	AP9

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Calculation objects

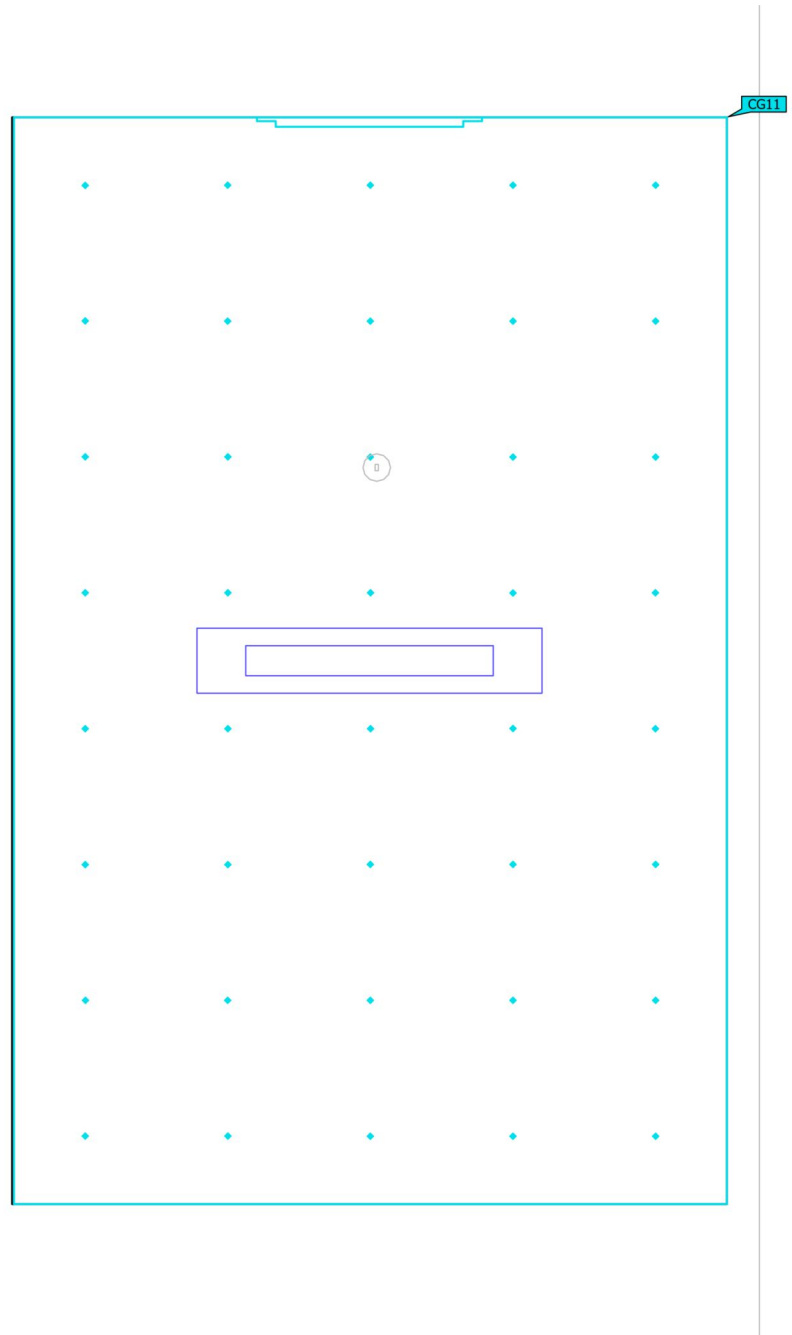

Building B · FIRST FOOR · 211 TOILET (Light scene 1)



Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
211 Toilet Perpendicular illuminance Height: 0.000 m	155 lx	95.1 lx	225 lx	0.61	0.42	CG11

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 211 TOILET (Emergency light scene)
Anti panic surface (211 TOILET)

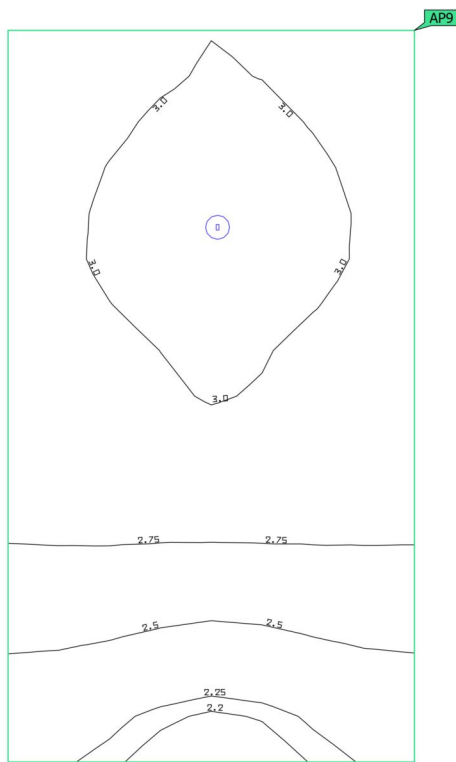


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (211 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m	2.16 lx (≥ 0.50 lx) ✓	3.07 lx	0.70 (≥ 0.025) ✓	AP9

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 211 TOILET (Emergency light scene)

211 Toilet


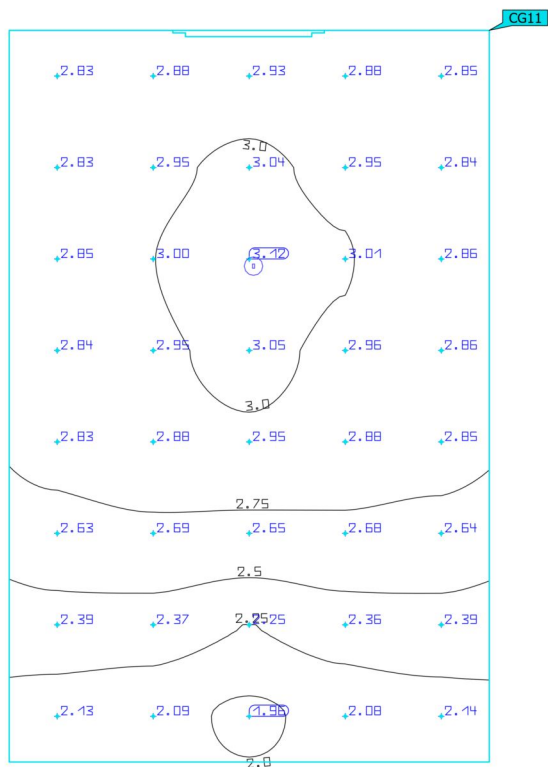


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
211 Toilet	2.71 lx	1.96 lx	3.12 lx	0.72	0.63	CG11
Perpendicular illuminance						
Height: 0.000 m						

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

211 Toilet

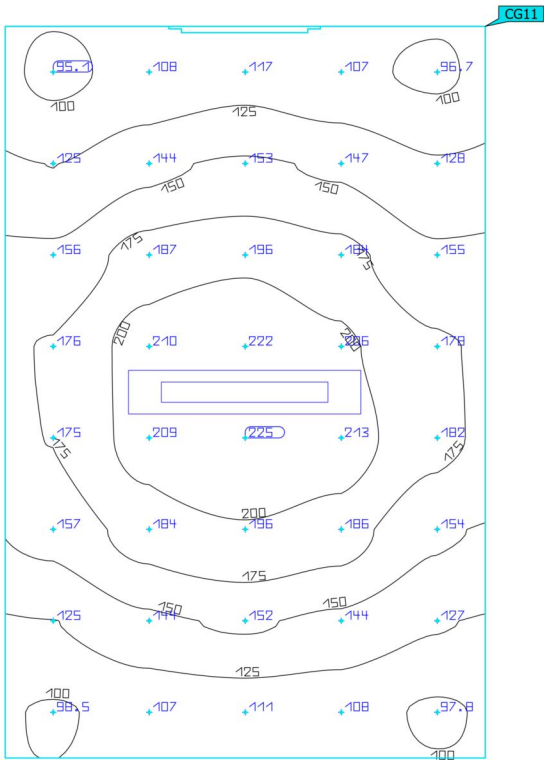


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
211 Toilet Perpendicular illuminance Height: 0.000 m	155 lx	95.1 lx	225 lx	0.61	0.42	CG11

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212 OFFICE (Emergency light scene)

Summary

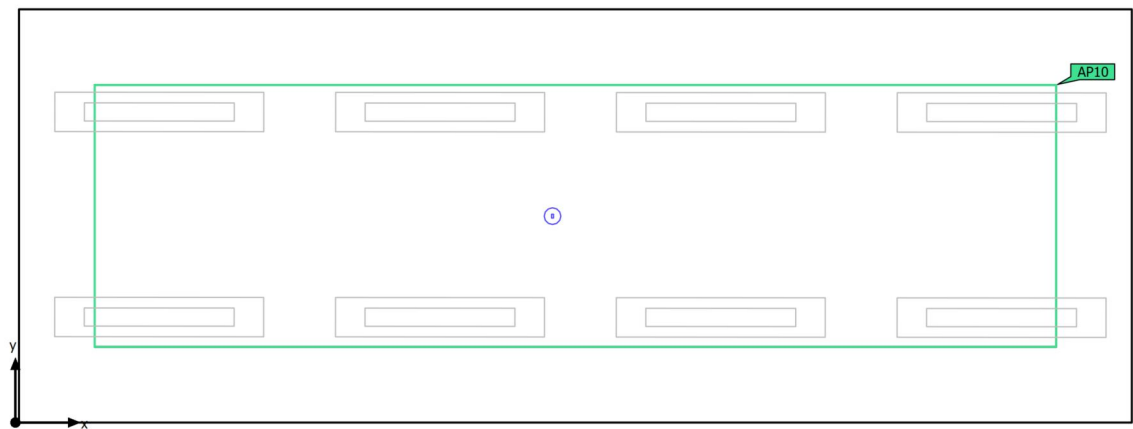

Ground area	20.07 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	3.368 m

Building B · FIRST FOOR · 212 OFFICE (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.04 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (212 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.80 lx (≥ 0.50 lx) ✓	3.08 lx	0.58 (≥ 0.025) ✓	AP10

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Summary

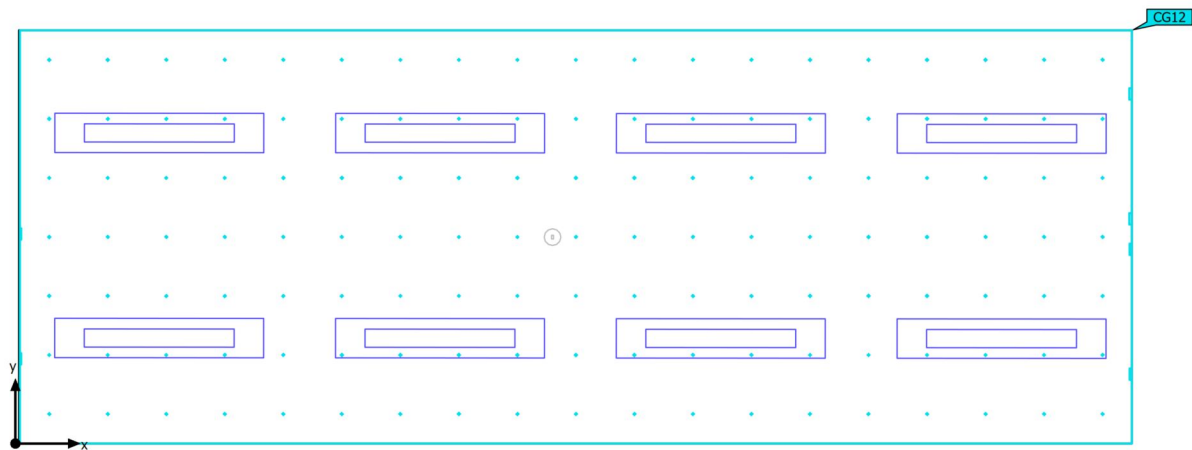

Ground area	20.07 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.88 (fixed)	Mounting height	2.800 m

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	525 kWh/a	max. 750 kWh/a	✓	
Space	Lighting power density	10.57 W/m ²	–		

(1) Based on a rectangular space of 7.350 m x 2.730 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
8	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 212 OFFICE

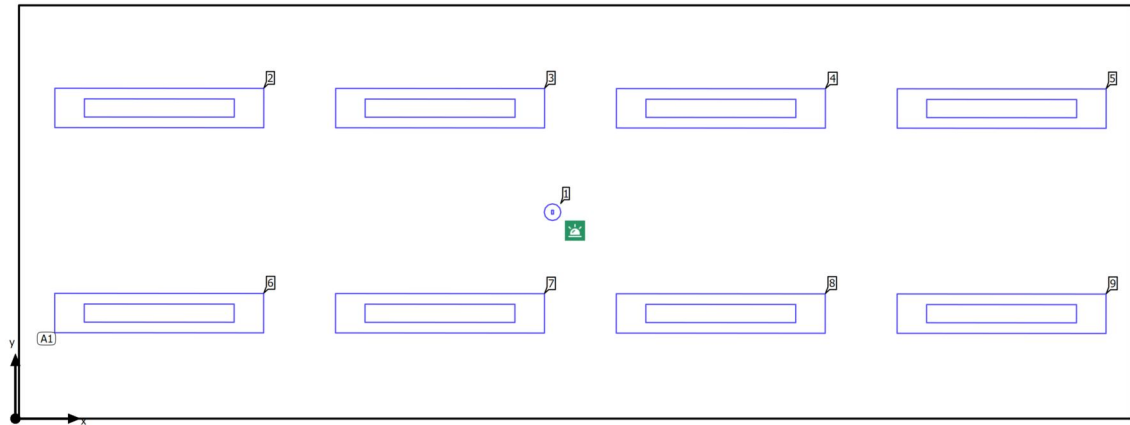Luminaire layout plan

Building B · FIRST FOOR · 212 OFFICE


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
3.548 m	1.364 m	3.368 m	1

Building B · FIRST FOOR · 212 OFFICE

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	Φ _{Luminaire}	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

8 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.950 m / 0.697 m / 2.800 m	0.951 m	2.052 m	2.800 m	2
X-direction	4 pcs., Centre - centre, 1.855 m	2.805 m	2.051 m	2.800 m	3
Y-direction	2 pcs., Centre - centre, 1.355 m	4.660 m	2.049 m	2.800 m	4
		6.514 m	2.048 m	2.800 m	5
Arrangement	A1	0.950 m	0.697 m	2.800 m	6
		2.804 m	0.696 m	2.800 m	7
		4.659 m	0.694 m	2.800 m	8
		6.513 m	0.693 m	2.800 m	9

Building B · FIRST FOOR · 212 OFFICE


Luminaire list

Φ_{total} 34700 lm	P_{total} 212.9 W	Luminous efficacy 163.0 lm/W	$\Phi_{\text{Emergency lighting}}$ 300 lm	$P_{\text{Emergency lighting}}$ 0.9 W
-----------------------------------	-------------------------------	---------------------------------	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	-
8	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 212 OFFICE (Emergency light scene)

Calculation objects

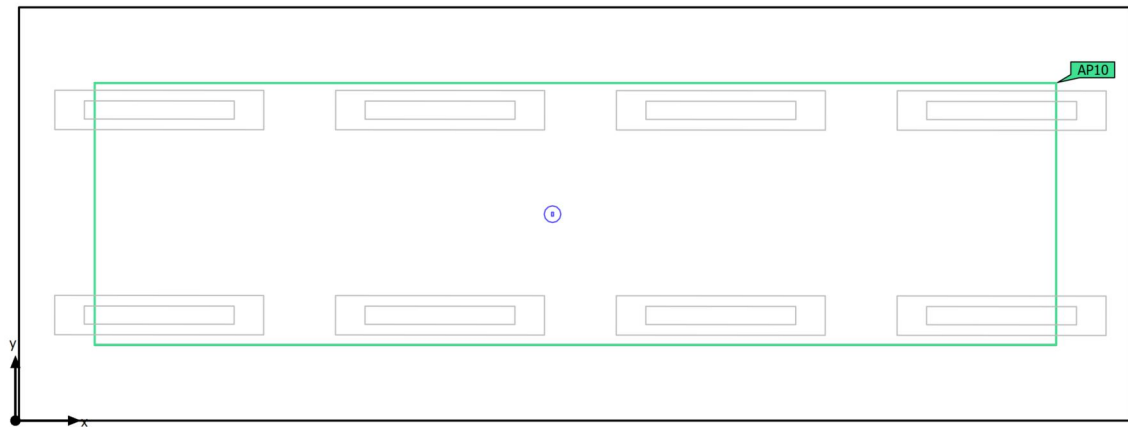

Building B · FIRST FOOR · 212 OFFICE (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (212 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.80 lx (≥ 0.50 lx) ✓	3.08 lx	0.58 (≥ 0.025) ✓	AP10

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Calculation objects

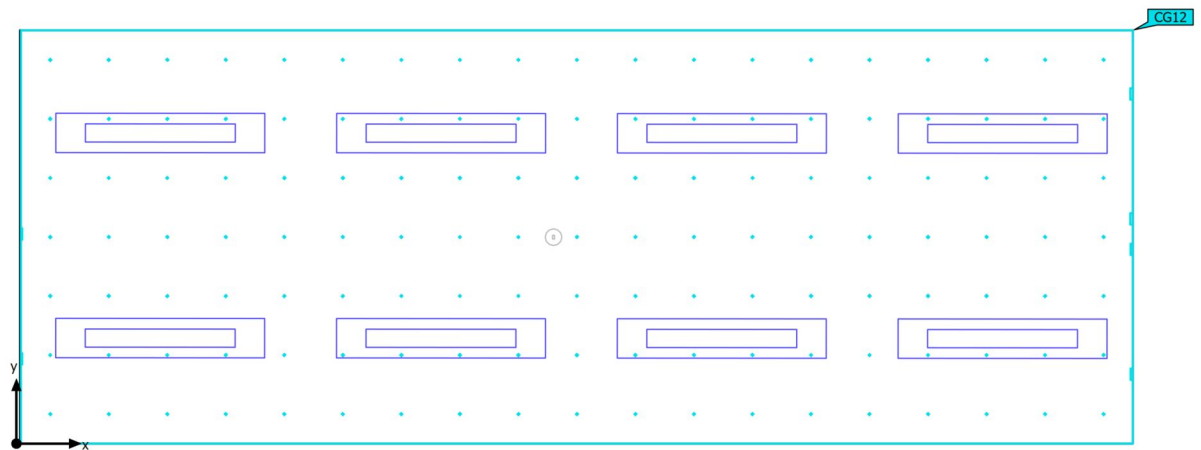

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Calculation objects



Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
212 Office Perpendicular illuminance Height: 0.700 m	887 lx	561 lx	1078 lx	0.63	0.52	CG12

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212 OFFICE (Emergency light scene)


Anti panic surface (212 OFFICE)

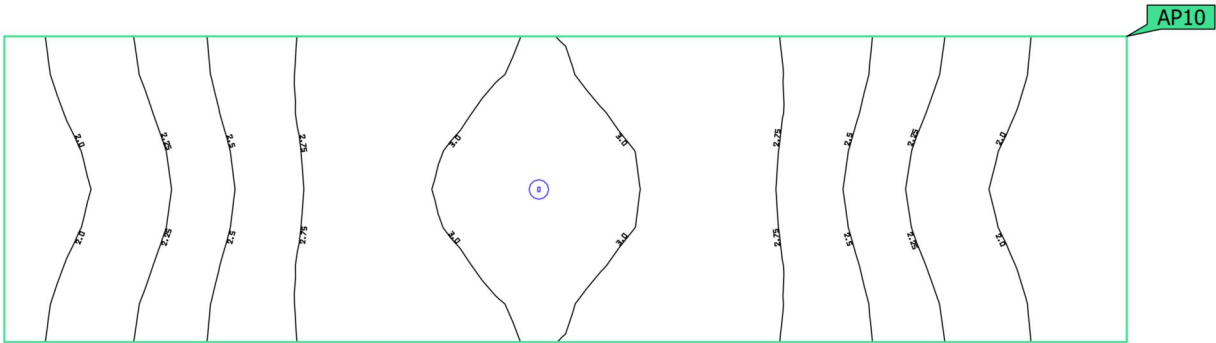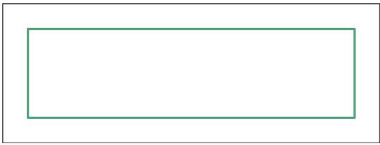

Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (212 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.80 lx (≥ 0.50 lx) ✓	3.08 lx	0.58 (≥ 0.025) ✓	AP10

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 212 OFFICE (Emergency light scene)

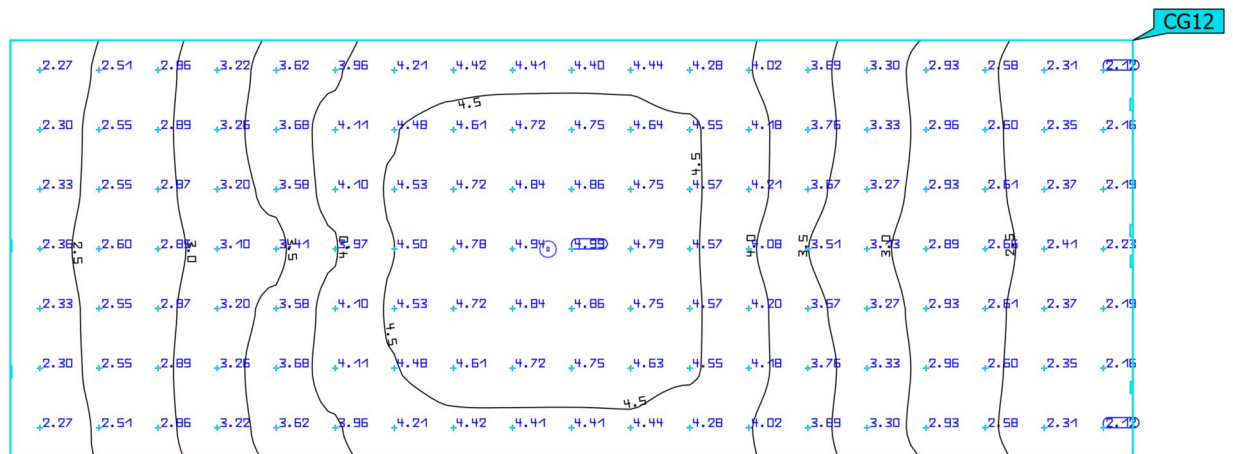
212 Office

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
212 Office	3.54 lx	2.12 lx	4.99 lx	0.60	0.42	CG12
Perpendicular illuminance						
Height: 0.700 m						

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

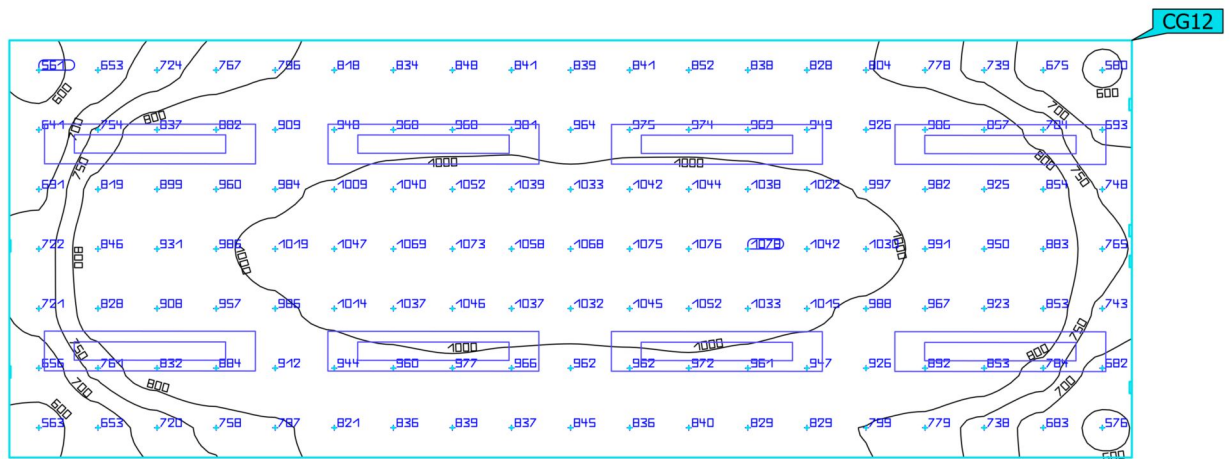
212 Office

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
212 Office Perpendicular illuminance Height: 0.700 m	887 lx	561 lx	1078 lx	0.63	0.52	CG12

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212A DB (Emergency light scene)

Summary

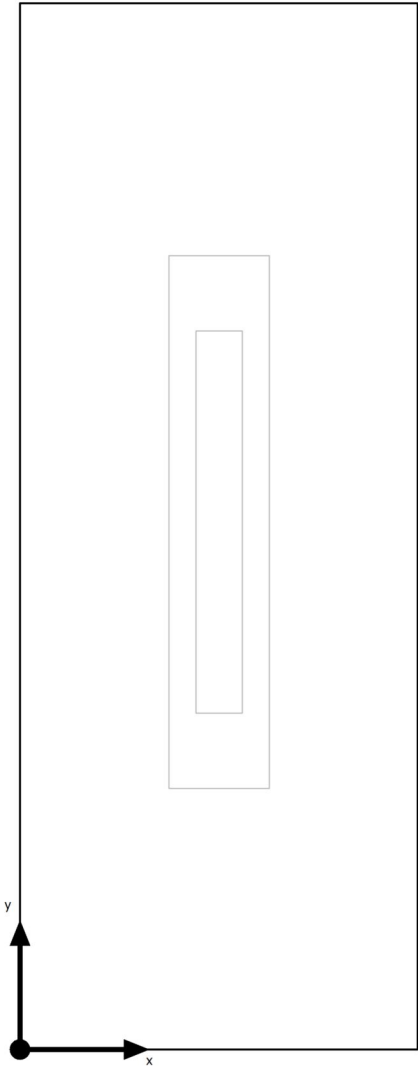

Ground area	2.79 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %		
Maintenance factor	0.88 (fixed)	Clearance height	3.300 m

Building B · FIRST FOOR · 212A DB (Emergency light scene)

Summary

Results


	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.00 W/m ²	–		

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 212A DB (Light scene 1)

Summary

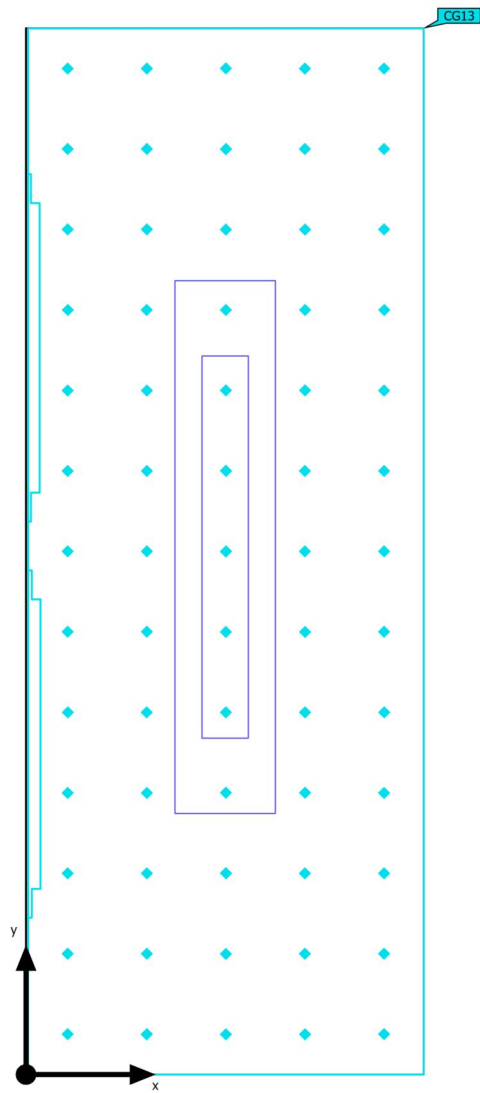

Ground area	2.79 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.88 (fixed)	Mounting height	2.800 m

Building B · FIRST FOOR · 212A DB (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	65.6 kWh/a	max. 100 kWh/a	✓	
Space	Lighting power density	9.49 W/m ²	–		

(1) Based on a rectangular space of 1.030 m x 2.710 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
1	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 212A DB

Luminaire layout plan

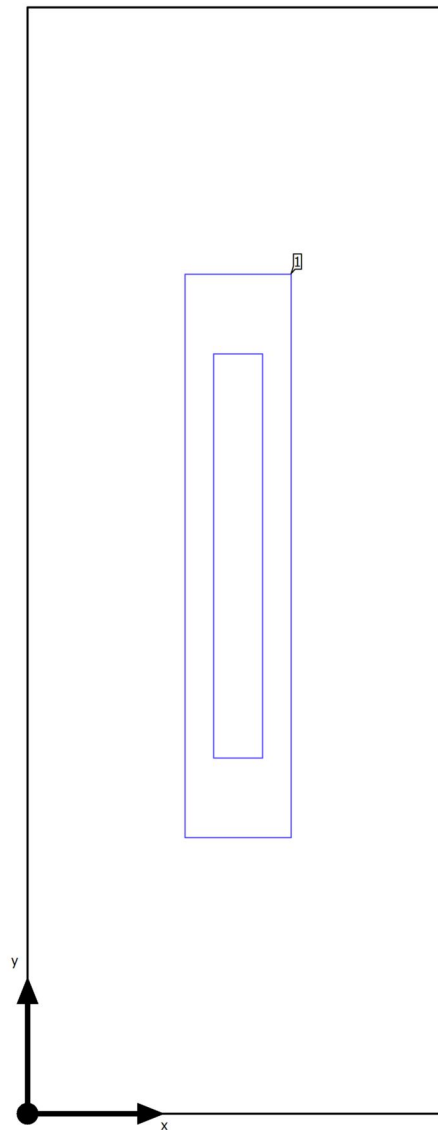

Building B · FIRST FOOR · 212A DB

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.516 m	1.366 m	2.800 m	1

Building B · FIRST FOOR · 212A DB


Luminaire list

Φ_{total} 4300 lm	P_{total} 26.5 W	Luminous efficacy 162.3 lm/W
----------------------------------	------------------------------	---------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	R3111/LEDN445DX1 (_LTRRevAC)	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 212A DB (Emergency light scene)

Calculation objects

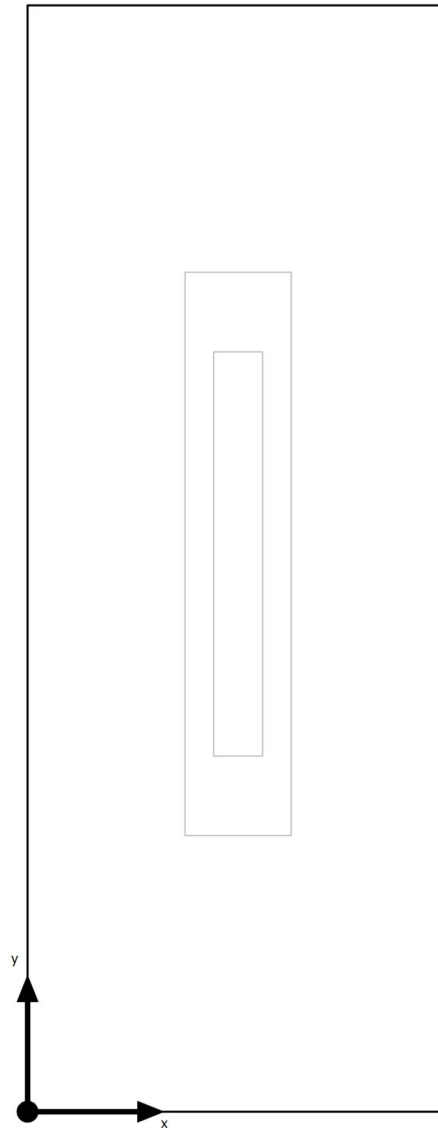

Building B · FIRST FOOR · 212A DB (Emergency light scene)


Calculation objects

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 212A DB (Light scene 1)

Calculation objects

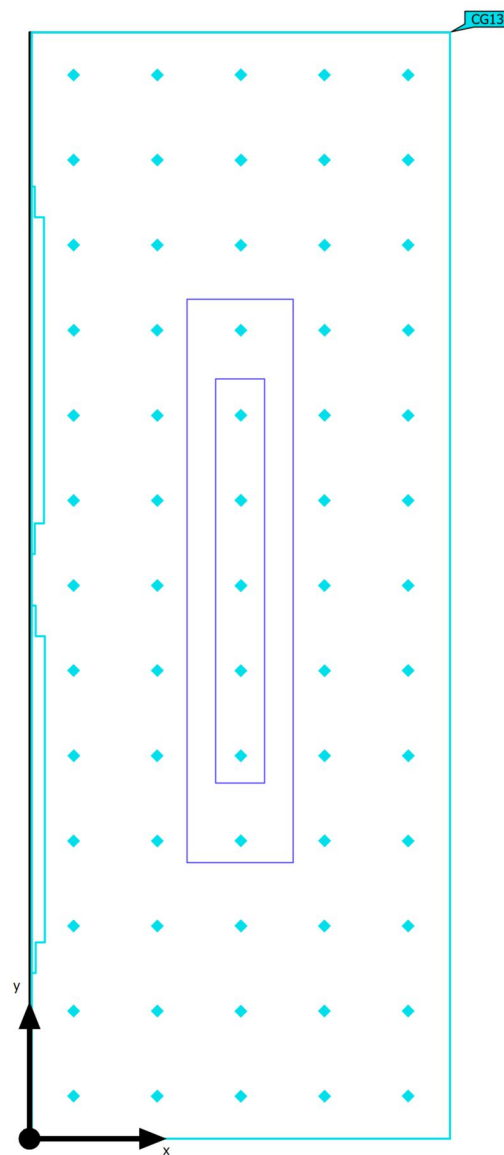

Building B · FIRST FOOR · 212A DB (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
212A DB Perpendicular illuminance Height: 0.000 m	261 lx	201 lx	303 lx	0.77	0.66	CG13

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212A DB (Emergency light scene)

212A DB

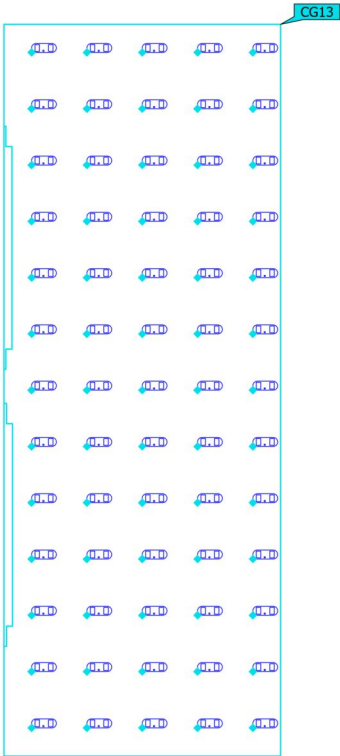


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
212A DB Perpendicular illuminance Height: 0.000 m	0.00 lx	0.00 lx	0.00 lx	-	-	CG13

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 212A DB (Light scene 1)

212A DB

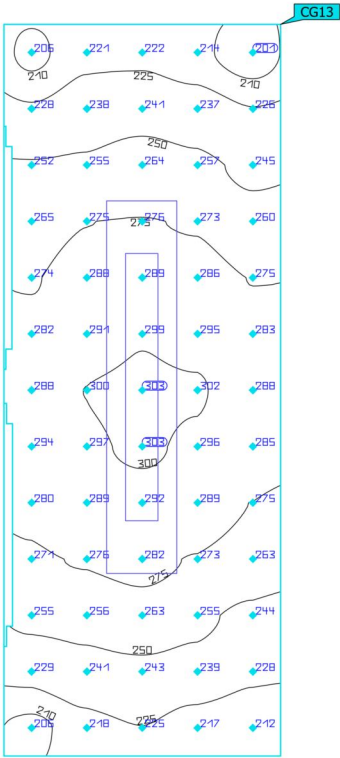


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
212A DB Perpendicular illuminance Height: 0.000 m	261 lx	201 lx	303 lx	0.77	0.66	CG13

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 213 CONFERENCE (Emergency light scene)

Summary

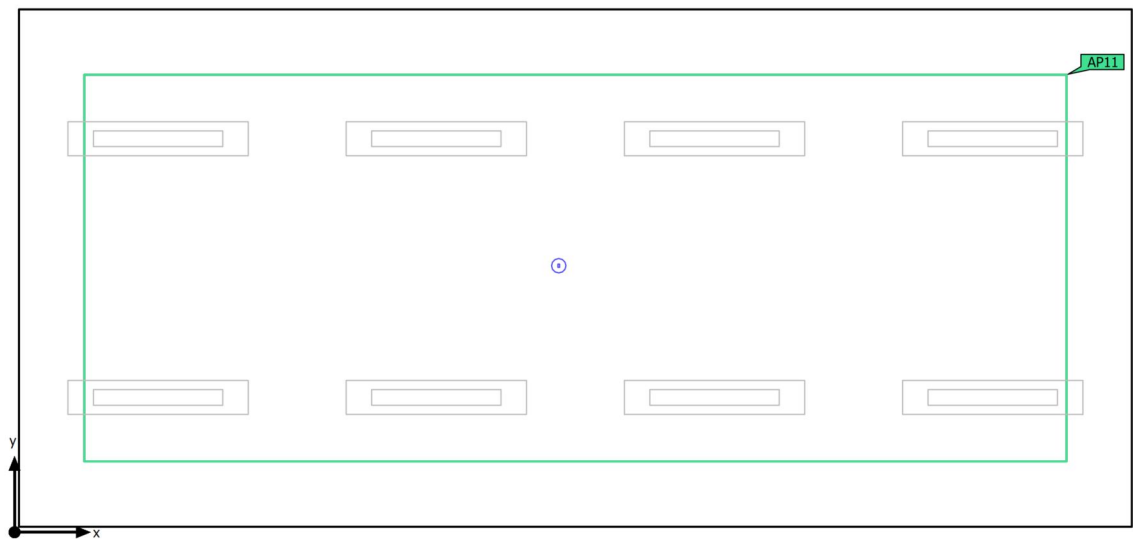

Ground area	33.71 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	3.368 m

Building B · FIRST FOOR · 213 CONFERENCE (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.03 W/m²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (213 CONFERENCE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.57 lx (≥ 0.50 lx) ✓	3.08 lx	0.51 (≥ 0.025) ✓	AP11


Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Summary

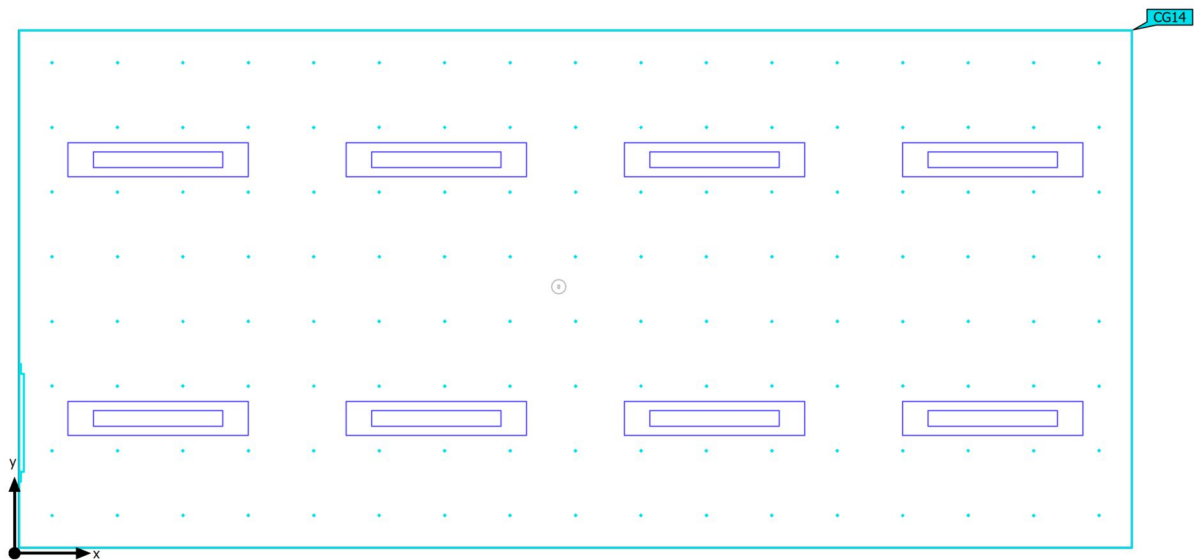

Ground area	33.71 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.88 (fixed)

Clearance height	3.300 m
Mounting height	2.800 m

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[331 - 525] kWh/a	max. 1200 kWh/a	✓	
Space	Lighting power density	6.29 W/m ²	–		

(1) Based on a rectangular space of 8.516 m x 3.958 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
8	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)	16	26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 213 CONFERENCE

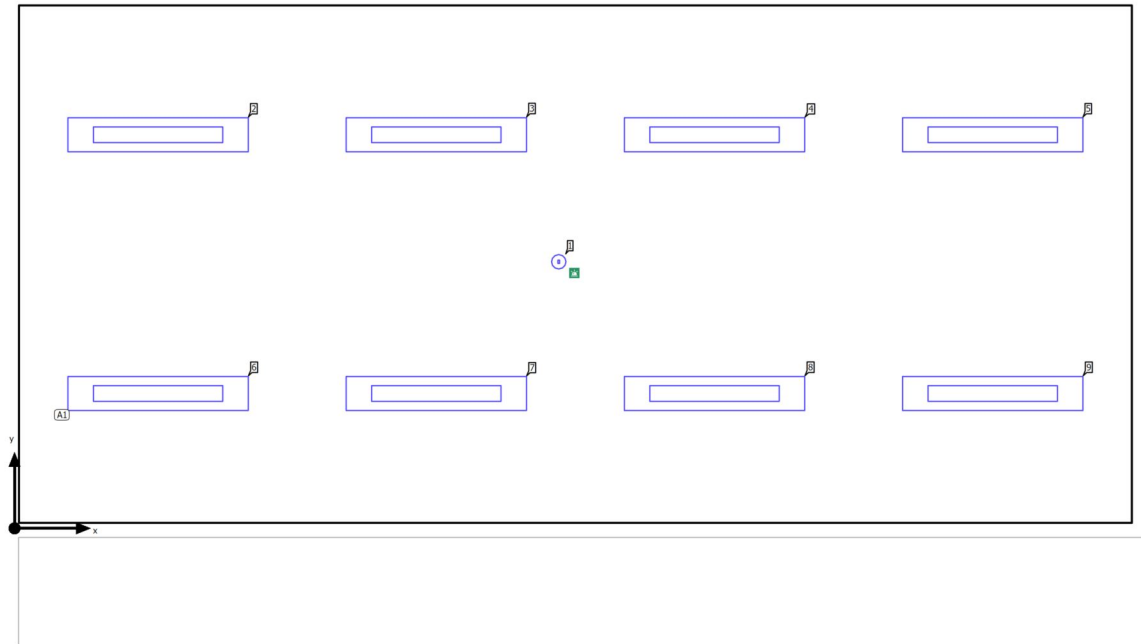Luminaire layout plan

Building B · FIRST FOOR · 213 CONFERENCE


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
4.164 m	2.039 m	3.368 m	1

Building B · FIRST FOOR · 213 CONFERENCE

Luminaire layout plan

Manufacturer	ETAP	P	26.5 W
Article No.	-	Φ _{Luminaire}	4291 lm
Article name	R3111/LEDN445DX1 (_LTRevAC)		
Fitting	1x LED		

8 x ETAP R3111/LEDN445DX1 (_LTRevAC)

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.098 m / 1.031 m / 2.800 m	1.098 m	3.010 m	2.800 m	2
X-direction	4 pcs., Centre - centre, 2.129 m	3.227 m	3.010 m	2.800 m	3
		5.356 m	3.010 m	2.800 m	4
Y-direction	2 pcs., Centre - centre, 1.979 m	7.485 m	3.010 m	2.800 m	5
Arrangement	A1	1.098 m	1.031 m	2.800 m	6
		3.227 m	1.031 m	2.800 m	7
		5.356 m	1.031 m	2.800 m	8
		7.485 m	1.031 m	2.800 m	9

Building B · FIRST FOOR · 213 CONFERENCE


Luminaire list

Φ_{total} 34700 lm	P_{total} 212.9 W	Luminous efficacy 163.0 lm/W	$\Phi_{\text{Emergency lighting}}$ 300 lm	$P_{\text{Emergency lighting}}$ 0.9 W
-----------------------------------	-------------------------------	---------------------------------	--	--

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRevAB)		0.9 W	300 lm	340.9 lm/W
					0.9 W	300 lm (100 %)	-
8	ETAP	-	R3111/LEDN445DX1 (_LTRevAC)		26.5 W	4291 lm	161.9 lm/W

Building B · FIRST FOOR · 213 CONFERENCE (Emergency light scene)

Calculation objects

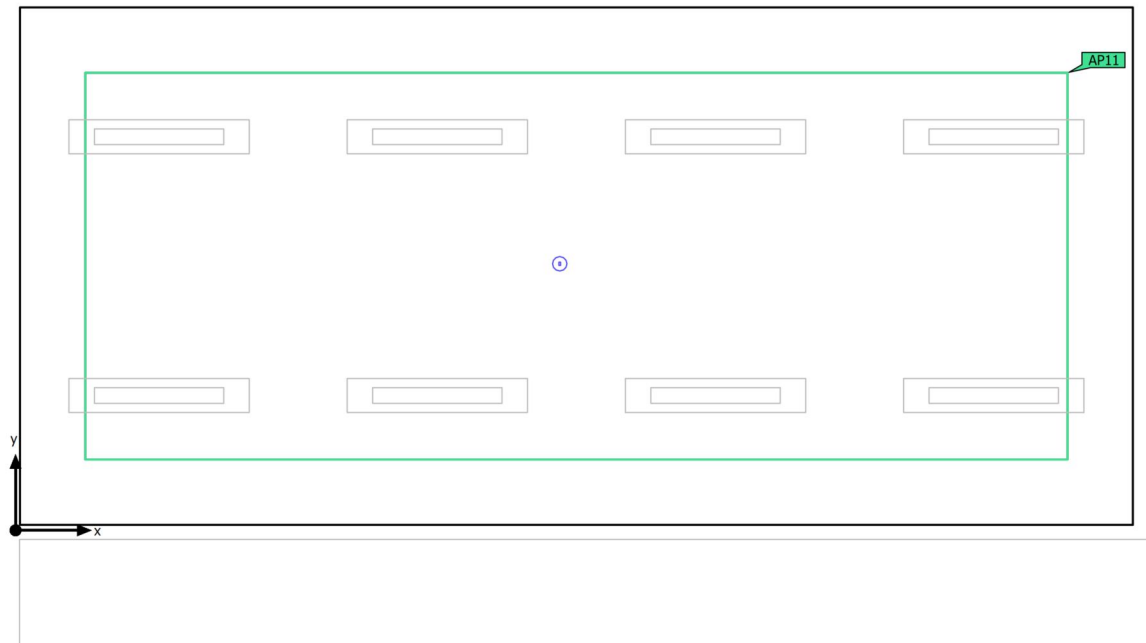

Building B · FIRST FOOR · 213 CONFERENCE (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (213 CONFERENCE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.57 lx (≥ 0.50 lx) ✓	3.08 lx	0.51 (≥ 0.025) ✓	AP11

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Calculation objects

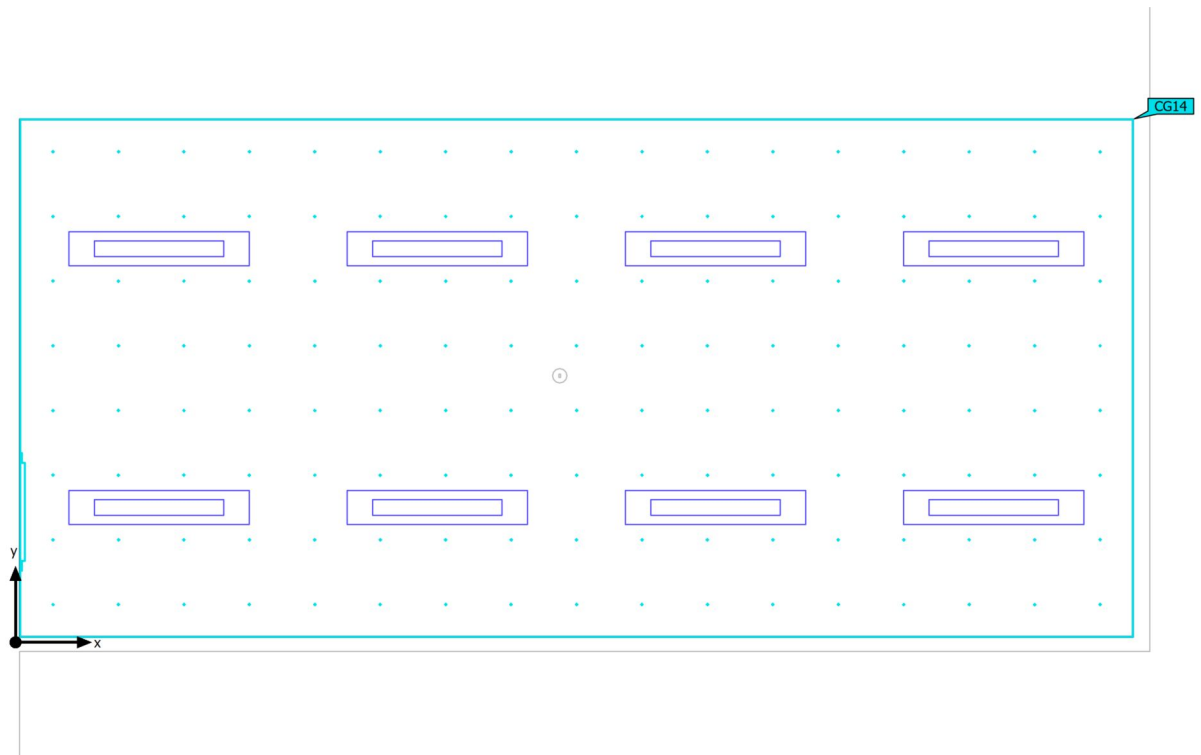

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
213 Conference Perpendicular illuminance Height: 0.700 m	620 lx	370 lx	759 lx	0.60	0.49	CG14

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 213 CONFERENCE (Emergency light scene)

Anti panic surface (213 CONFERENCE)


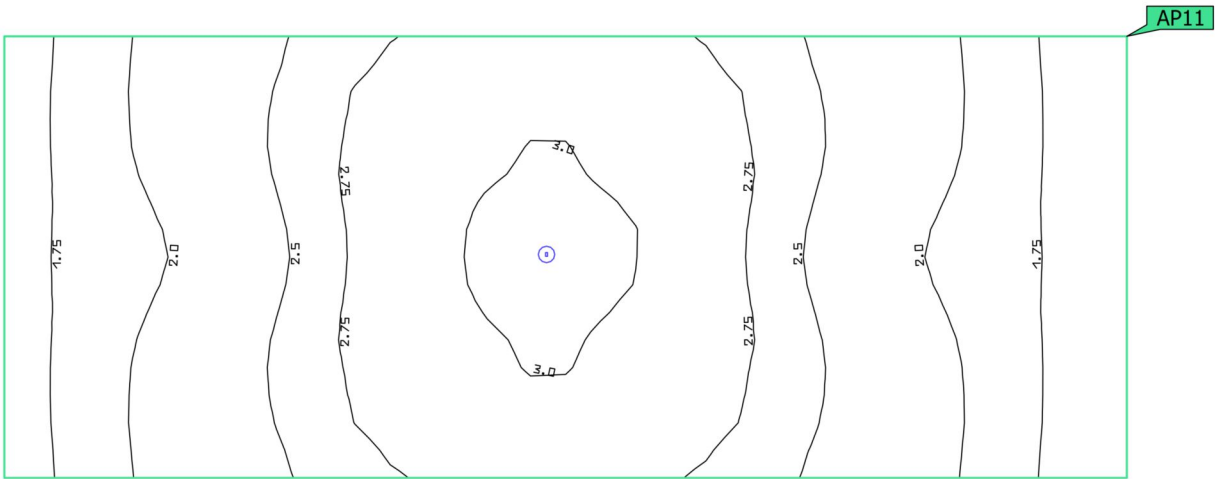


Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (213 CONFERENCE) Perpendicular illuminance (adaptive) Height: 0.000 m	1.57 lx (≥ 0.50 lx) ✓	3.08 lx	0.51 (≥ 0.025) ✓	AP11

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 213 CONFERENCE (Emergency light scene)


213 Conference

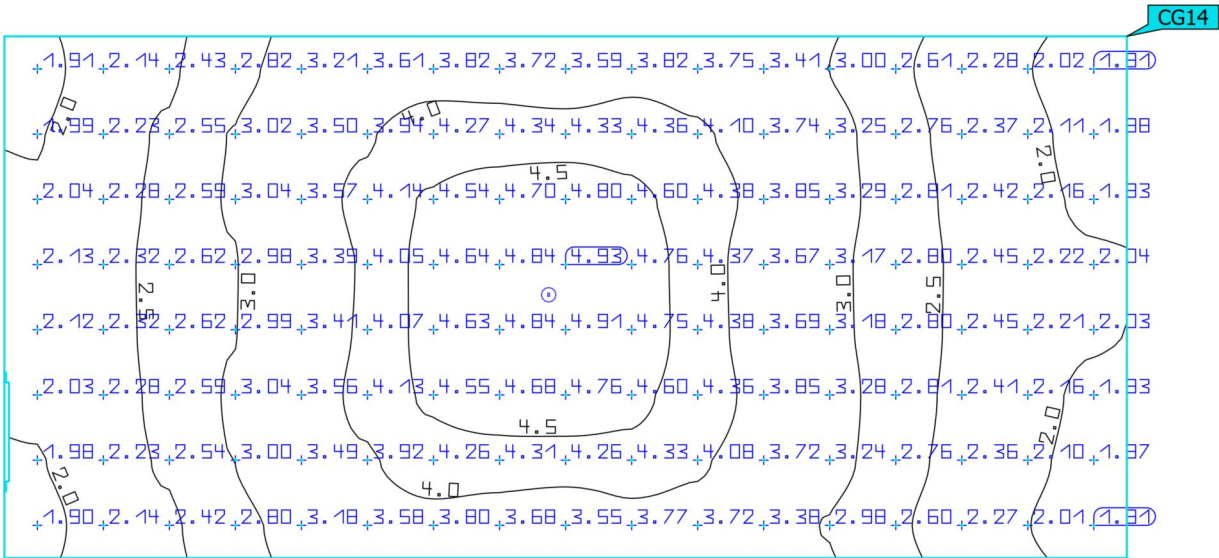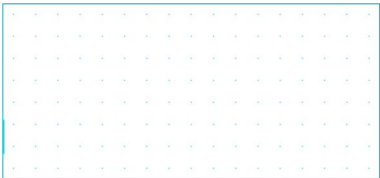

Properties	$\bar{E}$	E_{min}	E_{max}	$U_0 (g_1)$	g_2	Index
213 Conference Perpendicular illuminance Height: 0.700 m	3.22 lx	1.81 lx	4.93 lx	0.56	0.37	CG14

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

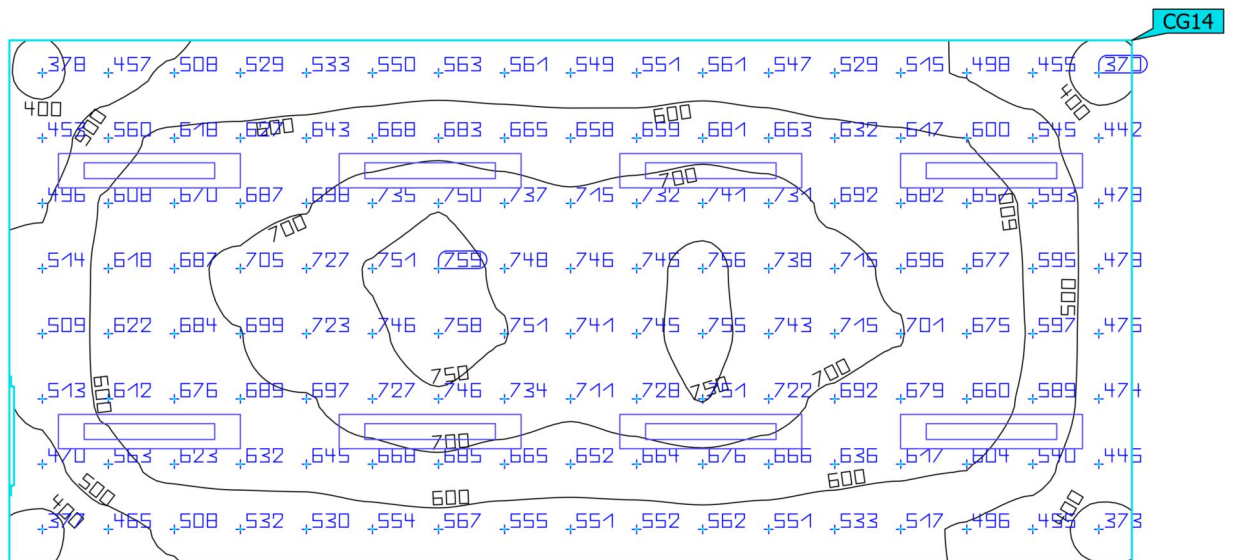
213 Conference

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
213 Conference Perpendicular illuminance Height: 0.700 m	620 lx	370 lx	759 lx	0.60	0.49	CG14

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · Space 1 (Emergency light scene)

Summary

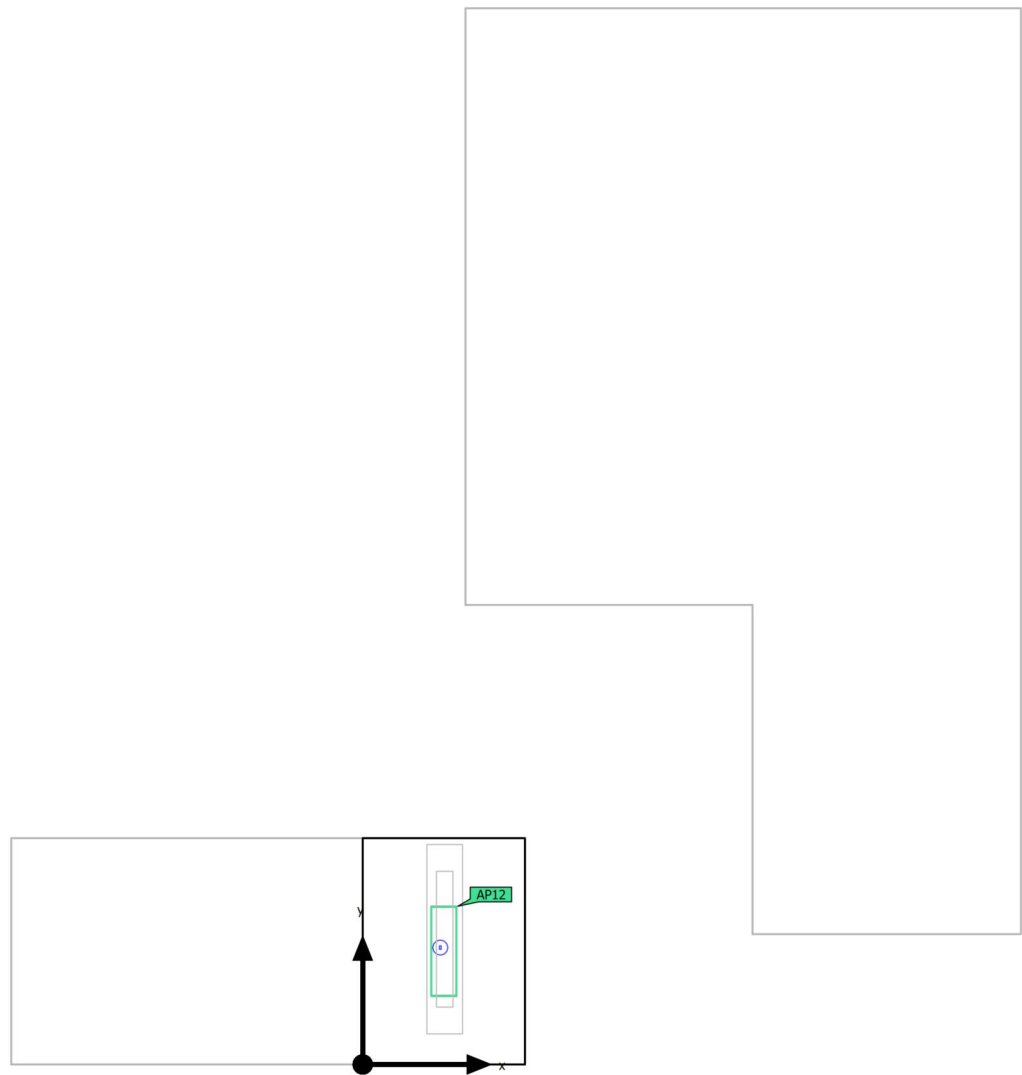

Ground area	1.95 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 0.0 %		
Maintenance factor	0.88 (fixed)	Mounting height	3.368 m

Building B · FIRST FOOR · Space 1 (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.46 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (Space 1) Perpendicular illuminance (adaptive) Height: 0.000 m	3.12 lx (≥ 0.50 lx) ✓	3.12 lx	1.00 (≥ 0.025) ✓	AP12

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K1R222/3-A-A630A630 (_LTRRevAB)	0.9 W	300 lm	340.9 lm/W
				 0.9 W	300 lm (100 %)	–

Building B · FIRST FOOR · Space 1 (Light scene 1)

Summary

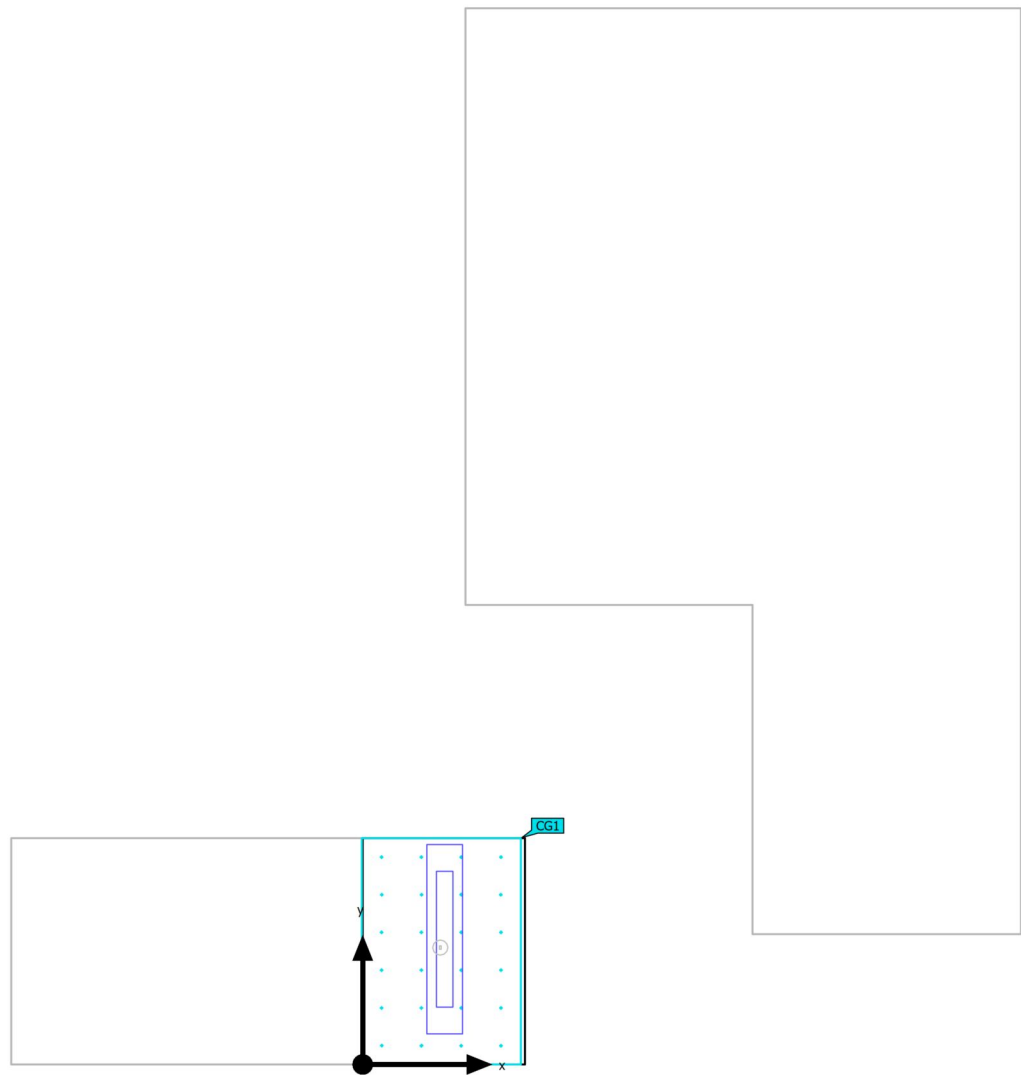

Ground area	1.95 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 0.0 %		
Maintenance factor	0.88 (fixed)	Mounting height	3.300 m

Building B · FIRST FOOR · Space 1 (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	69.3 kWh/a	max. 100 kWh/a	✓	
Space	Lighting power density	14.35 W/m ²	–		

(1) Based on a rectangular space of 1.650 m x 1.183 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
1	ETAP	-	R3111/LEDW445DX1 (_LTRevAC)	16	28.0 W	4291 lm	153.3 lm/W

Building B · FIRST FOOR · Space 1

Luminaire layout plan

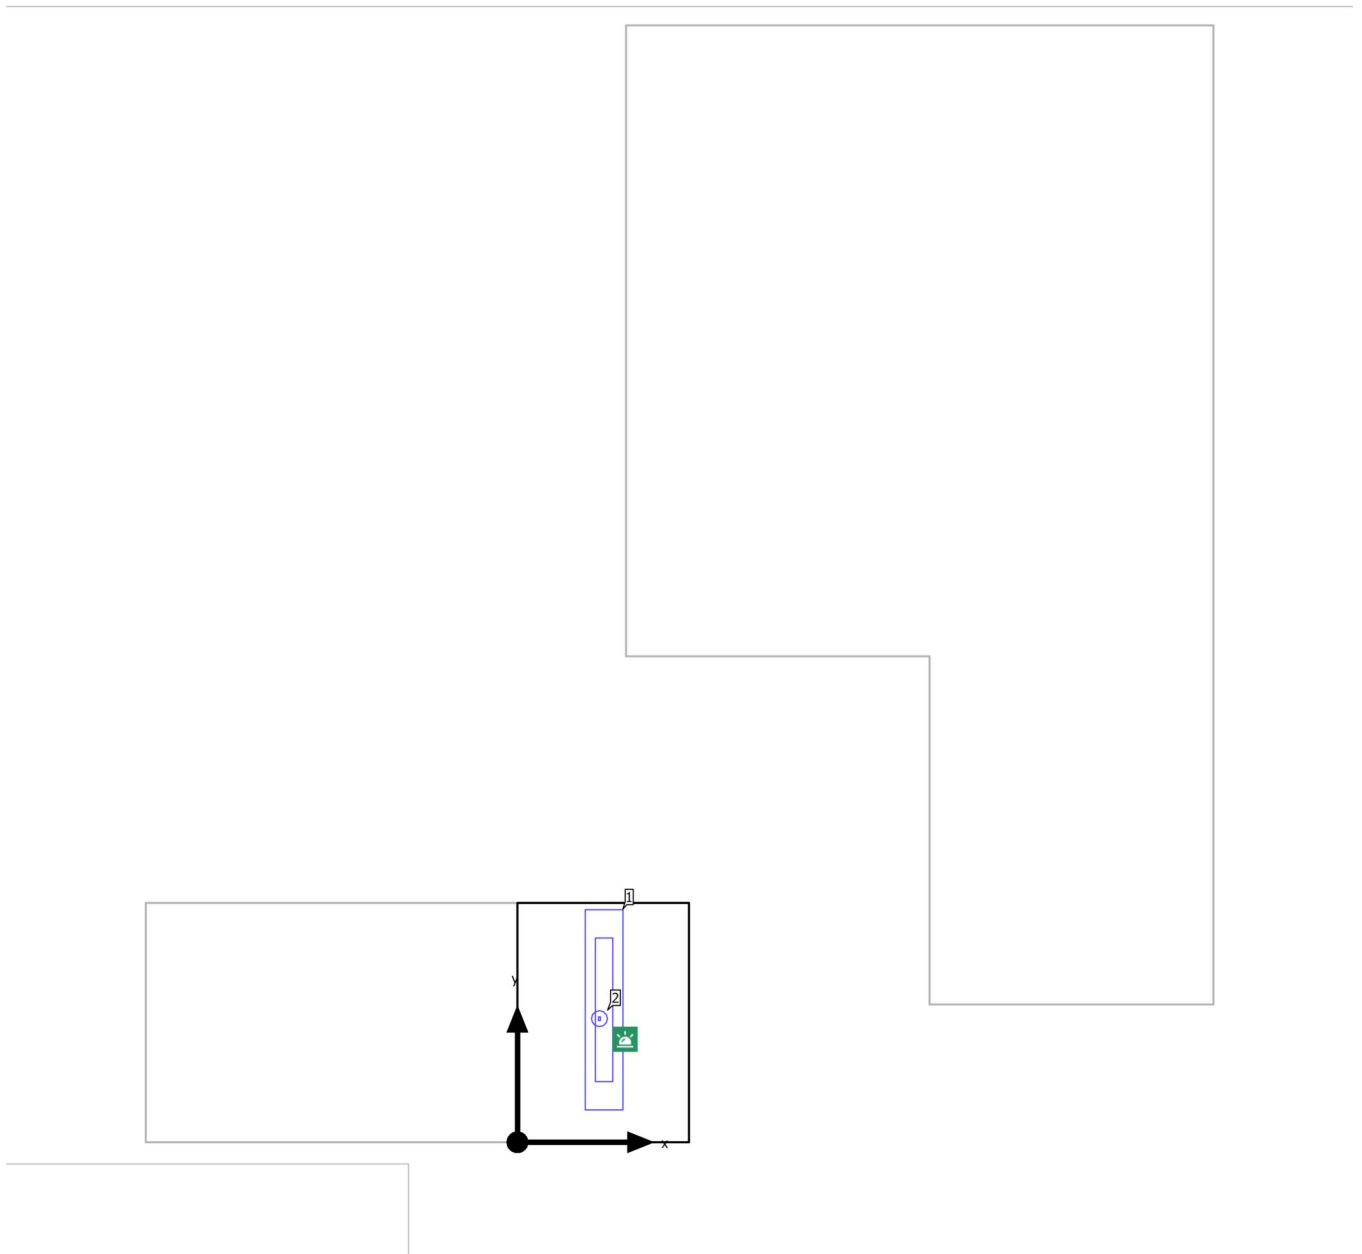

Building B · FIRST FOOR · Space 1


Luminaire layout plan

Manufacturer	ETAP	P	0.9 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K1R222/3-A-A630A630 (_LTRevAB)	Φ _{Luminaire}	300 lm
		Φ _{Emergency lighting}	300 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
0.566 m	0.852 m	3.368 m	2

Building B · FIRST FOOR · Space 1

Luminaire layout plan

Manufacturer	ETAP	P	28.0 W
Article No.	-	$\Phi_{\text{Luminaire}}$	4291 lm
Article name	R3111/LEDW445DX1 (_LTRrevAC)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.598 m	0.913 m	3.300 m	1


Building B · FIRST FOOR · Space 1

Luminaire list

Φ_{total} 4600 lm		P_{total} 28.9 W		Luminous efficacy 159.2 lm/W		$\Phi_{\text{Emergency lighting}}$ 300 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K1R222/3-A-A630A630 (_LTRevAB)			0.9 W	300 lm	340.9 lm/W	
						 0.9 W	300 lm (100 %)	-	
1	ETAP	-	R3111/LEDW445DX1 (_LTRevAC)			28.0 W	4291 lm	153.3 lm/W	

Building B · FIRST FOOR · Space 1 (Emergency light scene)

Calculation objects

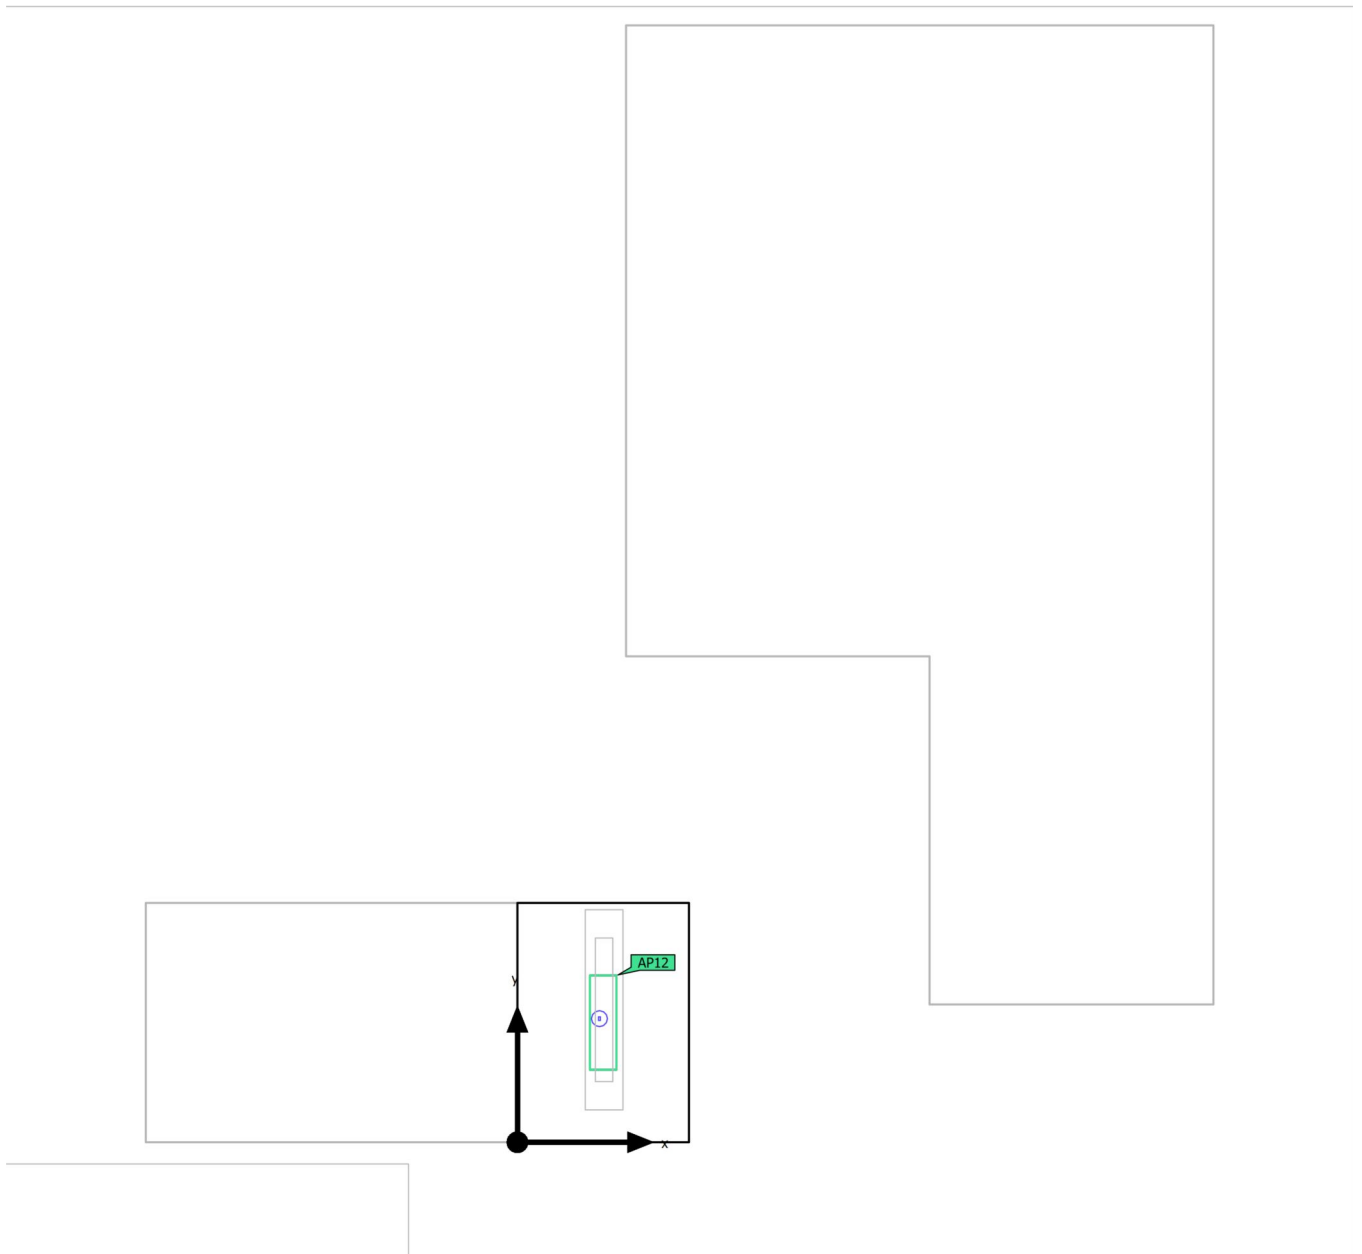

Building B · FIRST FOOR · Space 1 (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (Space 1) Perpendicular illuminance (adaptive) Height: 0.000 m	3.12 lx (≥ 0.50 lx) ✓	3.12 lx	1.00 (≥ 0.025) ✓	AP12

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · Space 1 (Light scene 1)

Calculation objects

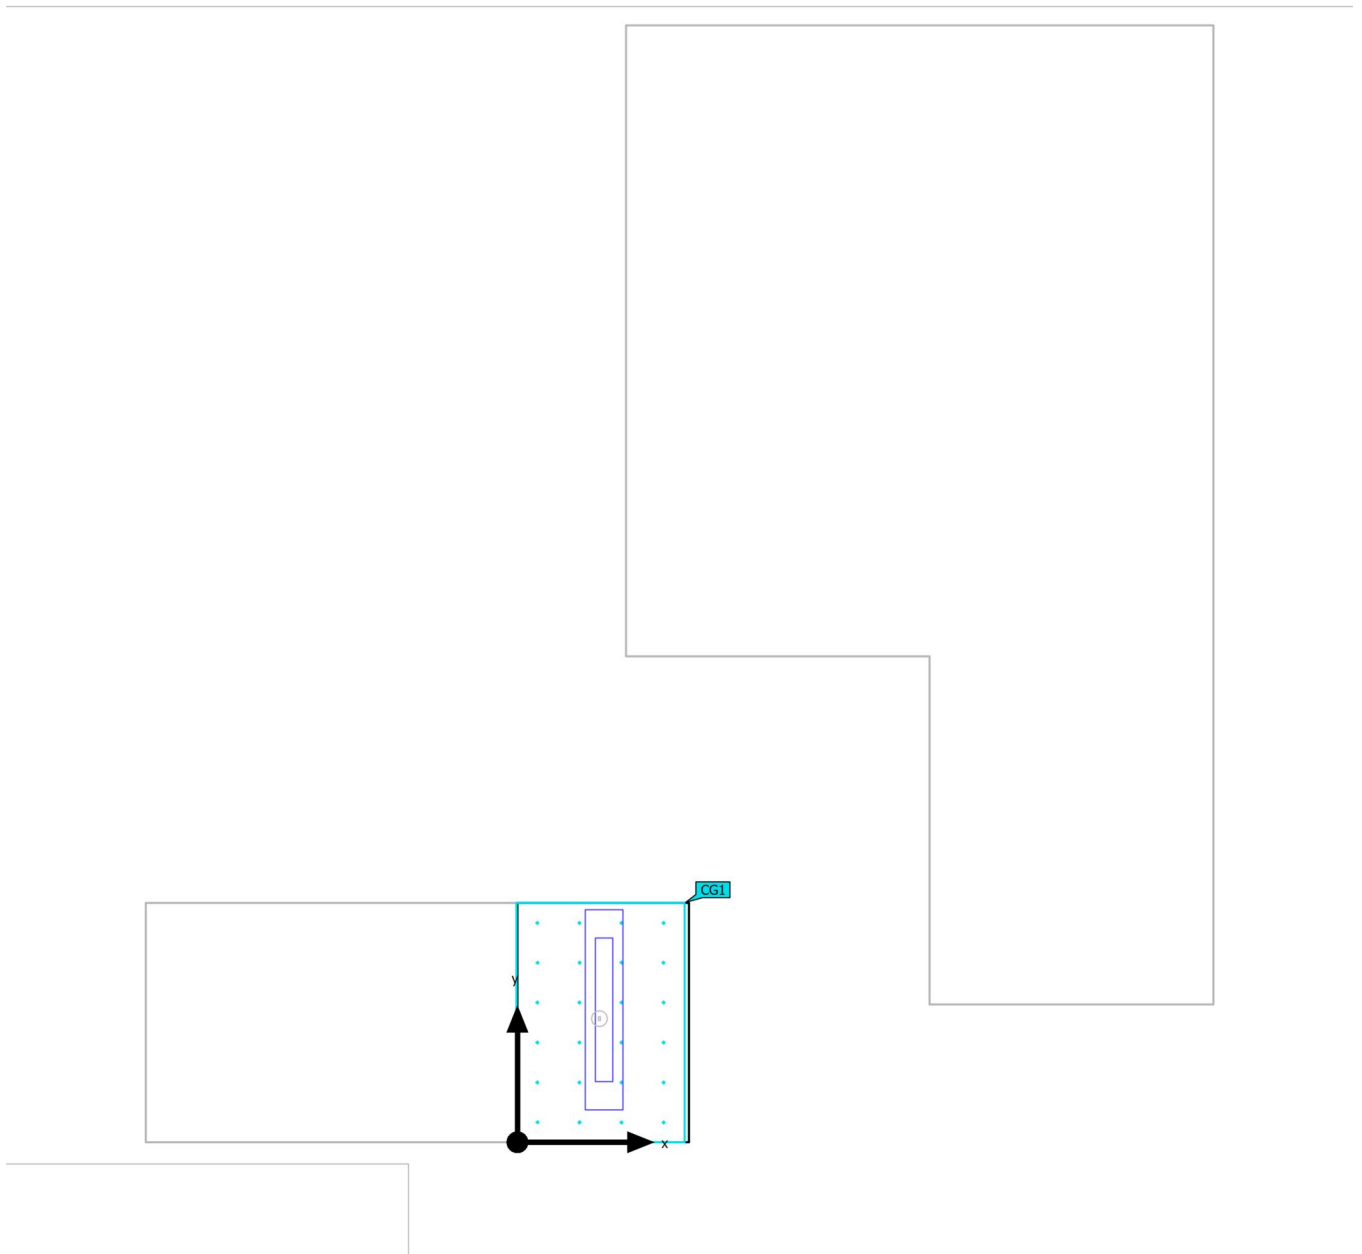

Building B · FIRST FOOR · Space 1 (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
201 Stairs Perpendicular illuminance Height: 0.000 m	282 lx	238 lx	314 lx	0.84	0.76	CG1

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building B · FIRST FOOR · Space 1 (Emergency light scene)

Anti panic surface (Space 1)


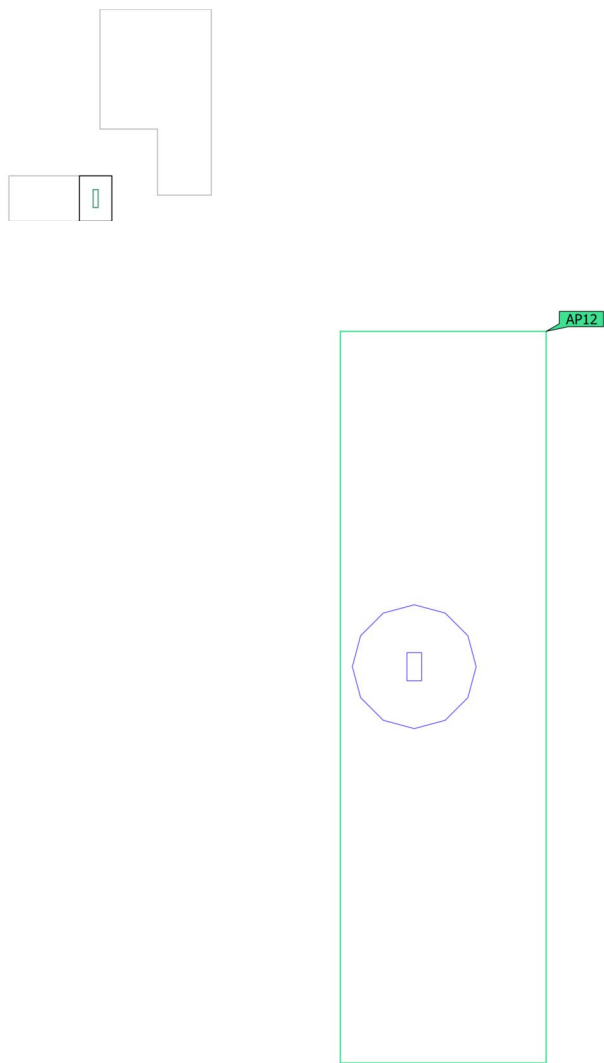


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (Space 1) Perpendicular illuminance (adaptive) Height: 0.000 m	3.12 lx (≥ 0.50 lx) ✓	3.12 lx	1.00 (≥ 0.025) ✓	AP12

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · Space 1 (Emergency light scene)

201 Stairs

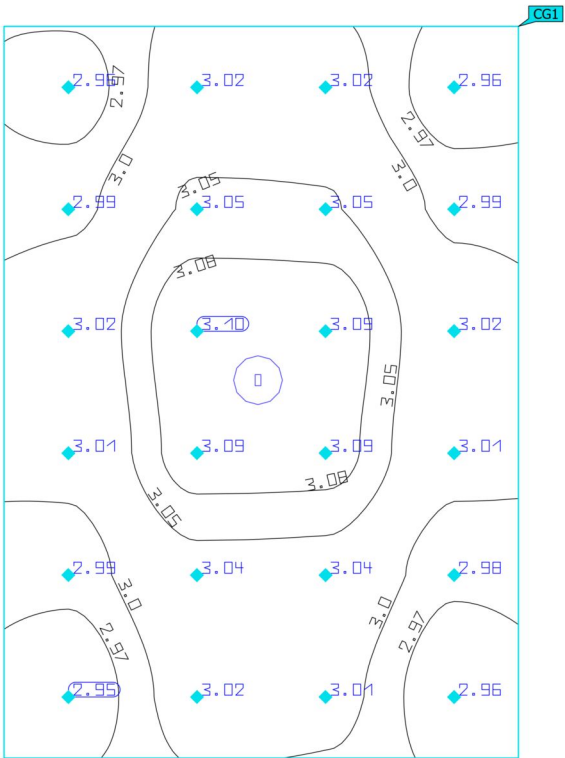



Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
201 Stairs Perpendicular illuminance Height: 0.000 m	3.02 lx	2.95 lx	3.10 lx	0.98	0.95	CG1

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building B · FIRST FOOR · Space 1 (Light scene 1)

201 Stairs

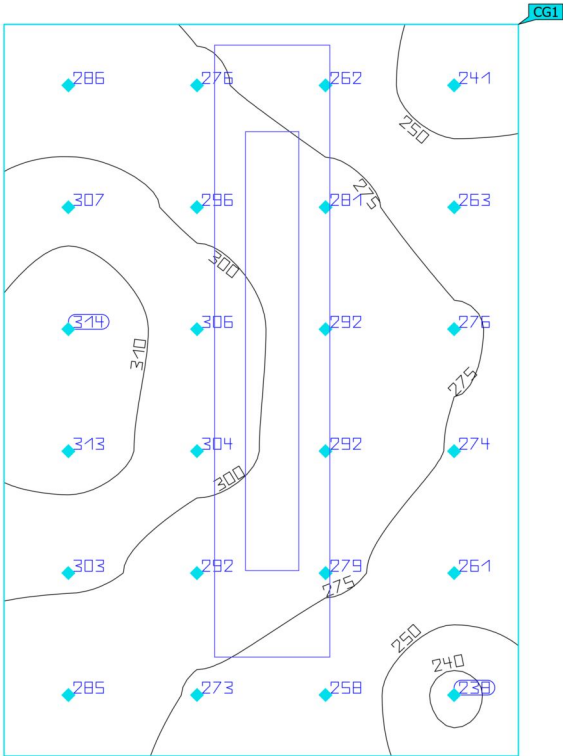

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
201 Stairs Perpendicular illuminance Height: 0.000 m	282 lx	238 lx	314 lx	0.84	0.76	CG1

Utilisation profile: DIALux presetting (34.2 Standard (office))