


Building B · FIRST FOOR (Light scene 1)

Room list

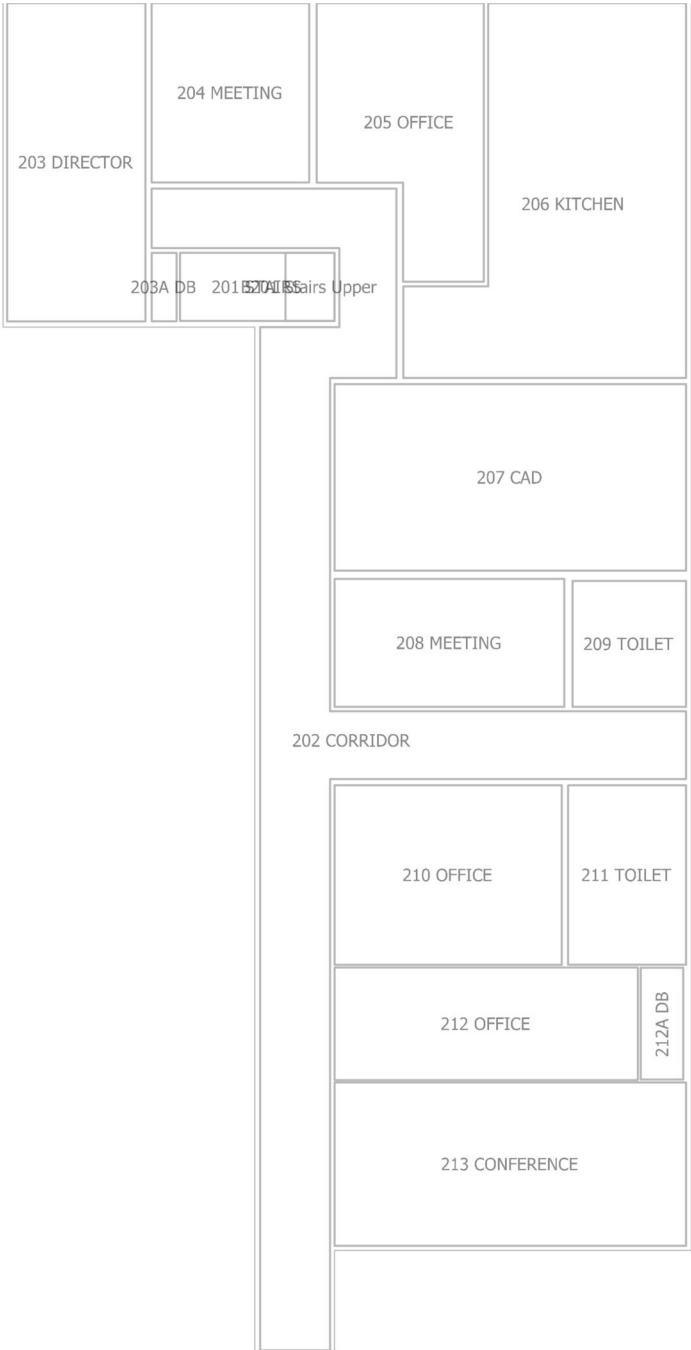

Building B · FIRST FOOR (Light scene 1)

Room list

201 STAIRS

P_{total}
76.0 W

A_{Room}
6.18 m²

Lighting power density
12.30 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	Philips		2x36W	76.0 W	4663 lm

202 CORRIDOR

P_{total}
684.0 W

A_{Room}
69.35 m²

Lighting power density
9.86 W/m² = 5.86 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$
168 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
9	Philips		2x36W	76.0 W	4663 lm

203 DIRECTOR

P_{total}
304.0 W

A_{Room}
25.83 m²

Lighting power density
11.77 W/m² = 4.04 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$
291 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
4	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

204 MEETING

P_{total} 304.0 W	A_{Room} 16.60 m ²	Lighting power density 18.32 W/m ² = 4.77 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 384 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	Philips		2x36W	76.0 W	4663 lm

205 OFFICE

P_{total} 380.0 W	A_{Room} 22.32 m ²	Lighting power density 17.03 W/m ² = 4.54 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 375 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
5	Philips		2x36W	76.0 W	4663 lm

206 KITCHEN

P_{total} 532.0 W	A_{Room} 48.10 m ²	Lighting power density 11.06 W/m ² = 3.50 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 316 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
7	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

207 CAD

P_{total}
684.0 W**A_{Room}**
38.48 m²**Lighting power density**
17.77 W/m² = 3.74 W/m²/100 lx (Space)**E_{perpendicular} (Working plane)**
476 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
9	Philips		2x36W	76.0 W	4663 lm

208 MEETING

P_{total}
456.0 W**A_{Room}**
17.26 m²**Lighting power density**
26.43 W/m² = 4.79 W/m²/100 lx (Space)**E_{perpendicular} (Working plane)**
552 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
6	Philips		2x36W	76.0 W	4663 lm

209 TOILET

P_{total}
152.0 W**A_{Room}**
8.39 m²**Lighting power density**
18.12 W/m² = 7.97 W/m²/100 lx (Space)**E_{perpendicular} (Working plane)**
227 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
2	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

210 OFFICE

P_{total} 684.0 W	A_{Room} 23.95 m ²	Lighting power density $28.56 \text{ W/m}^2 = 4.12 \text{ W/m}^2/100 \text{ lx (Space)}$	$\bar{E}_{\text{perpendicular (Working plane)}}$ 693 lx
-------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
9	Philips		2x36W	76.0 W	4663 lm

211 TOILET

P_{total} 228.0 W	A_{Room} 12.43 m ²	Lighting power density $18.35 \text{ W/m}^2 = 6.73 \text{ W/m}^2/100 \text{ lx (Space)}$	$\bar{E}_{\text{perpendicular (Working plane)}}$ 273 lx
-------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
3	Philips		2x36W	76.0 W	4663 lm

212 OFFICE

P_{total} 608.0 W	A_{Room} 20.07 m ²	Lighting power density $30.30 \text{ W/m}^2 = 4.87 \text{ W/m}^2/100 \text{ lx (Space)}$	$\bar{E}_{\text{perpendicular (Working plane)}}$ 622 lx
-------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
8	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

212A DB

P_{total} 76.0 W	A_{Room} 2.79 m ²	Lighting power density 27.23 W/m ² = 20.09 W/m ² /100 lx (Space)	$\bar{E}_{\text{perpendicular (Working plane)}}$ 136 lx
------------------------------	--	---	--

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	Philips		2x36W	76.0 W	4663 lm

213 CONFERENCE

P_{total} 608.0 W	A_{Room} 33.71 m ²	Lighting power density 18.04 W/m ² = 3.94 W/m ² /100 lx (Space)	$\bar{E}_{\text{perpendicular (Working plane)}}$ 458 lx
-------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
8	Philips		2x36W	76.0 W	4663 lm

B201 Stairs Upper

P_{total} 76.0 W	A_{Room} 1.96 m ²	Lighting power density 38.83 W/m ² = 16.94 W/m ² /100 lx (Space)	$\bar{E}_{\text{perpendicular (Working plane)}}$ 229 lx
------------------------------	--	---	--

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR

Luminaire list Φ_{total}

359051 lm

 P_{total}

5852.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
77	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR (Light scene 1)

Calculation objects

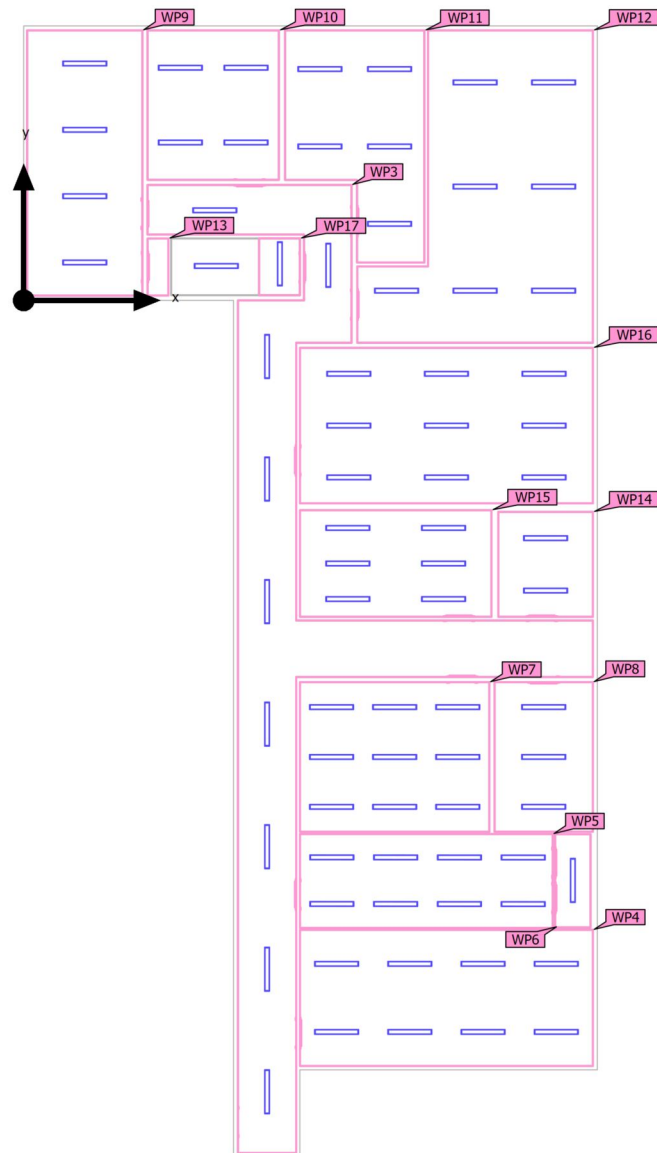

Building B · FIRST FOOR (Light scene 1)

Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
B201 Stairs Upper Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	229 lx (≥ 500 lx) ✗	213 lx	241 lx	0.93 (≥ 0.60) ✓	0.88	WP17
Working plane (202 CORRIDOR) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	168 lx (≥ 500 lx) ✗	11.9 lx	305 lx	0.071 (≥ 0.60) ✗	0.039	WP3
Working plane (203 DIRECTOR) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	291 lx (≥ 500 lx) ✗	195 lx	370 lx	0.67 (≥ 0.60) ✓	0.53	WP9
Working plane (203A DB) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	0.00 lx (≥ 500 lx) ✗	0.00 lx	0.00 lx	- (≥ 0.60)	-	WP13
Working plane (204 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	384 lx (≥ 500 lx) ✗	295 lx	460 lx	0.77 (≥ 0.60) ✓	0.64	WP10
Working plane (205 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	375 lx (≥ 500 lx) ✗	223 lx	477 lx	0.59 (≥ 0.60) ✗	0.47	WP11
Working plane (206 KITCHEN) Perpendicular illuminance (adaptive) Height: 0.850 m, Wall zone: 0.000 m	316 lx (≥ 500 lx) ✗	195 lx	391 lx	0.62 (≥ 0.60) ✓	0.50	WP12
Working plane (207 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	476 lx (≥ 500 lx) ✗	314 lx	577 lx	0.66 (≥ 0.60) ✓	0.54	WP16
Working plane (208 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	552 lx (≥ 500 lx) ✓	396 lx	649 lx	0.72 (≥ 0.60) ✓	0.61	WP15
Working plane (209 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	227 lx (≥ 500 lx) ✗	197 lx	258 lx	0.87 (≥ 0.60) ✓	0.76	WP14
Working plane (210 OFFICE) Perpendicular illuminance (adaptive) Height: 0.800 m, Wall zone: 0.000 m	693 lx (≥ 300 lx) ✓	464 lx	836 lx	0.67 (≥ 0.40) ✓	0.56	WP7


Building B · FIRST FOOR (Light scene 1)

Calculation objects


Working plane (211 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	273 lx (≥ 500 lx) ✗	179 lx	322 lx	0.66 (≥ 0.60) ✓	0.56	WP8
Working plane (212 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	622 lx (≥ 500 lx) ✓	434 lx	731 lx	0.70 (≥ 0.60) ✓	0.59	WP5
Working plane (212A DB) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	136 lx (≥ 500 lx) ✗	104 lx	145 lx	0.76 (≥ 0.60) ✓	0.72	WP6
Working plane (213 CONFERENCE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	458 lx (≥ 500 lx) ✗	286 lx	550 lx	0.62 (≥ 0.60) ✓	0.52	WP4

Building B · FIRST FOOR · 201 STAIRS

Luminaire layout plan

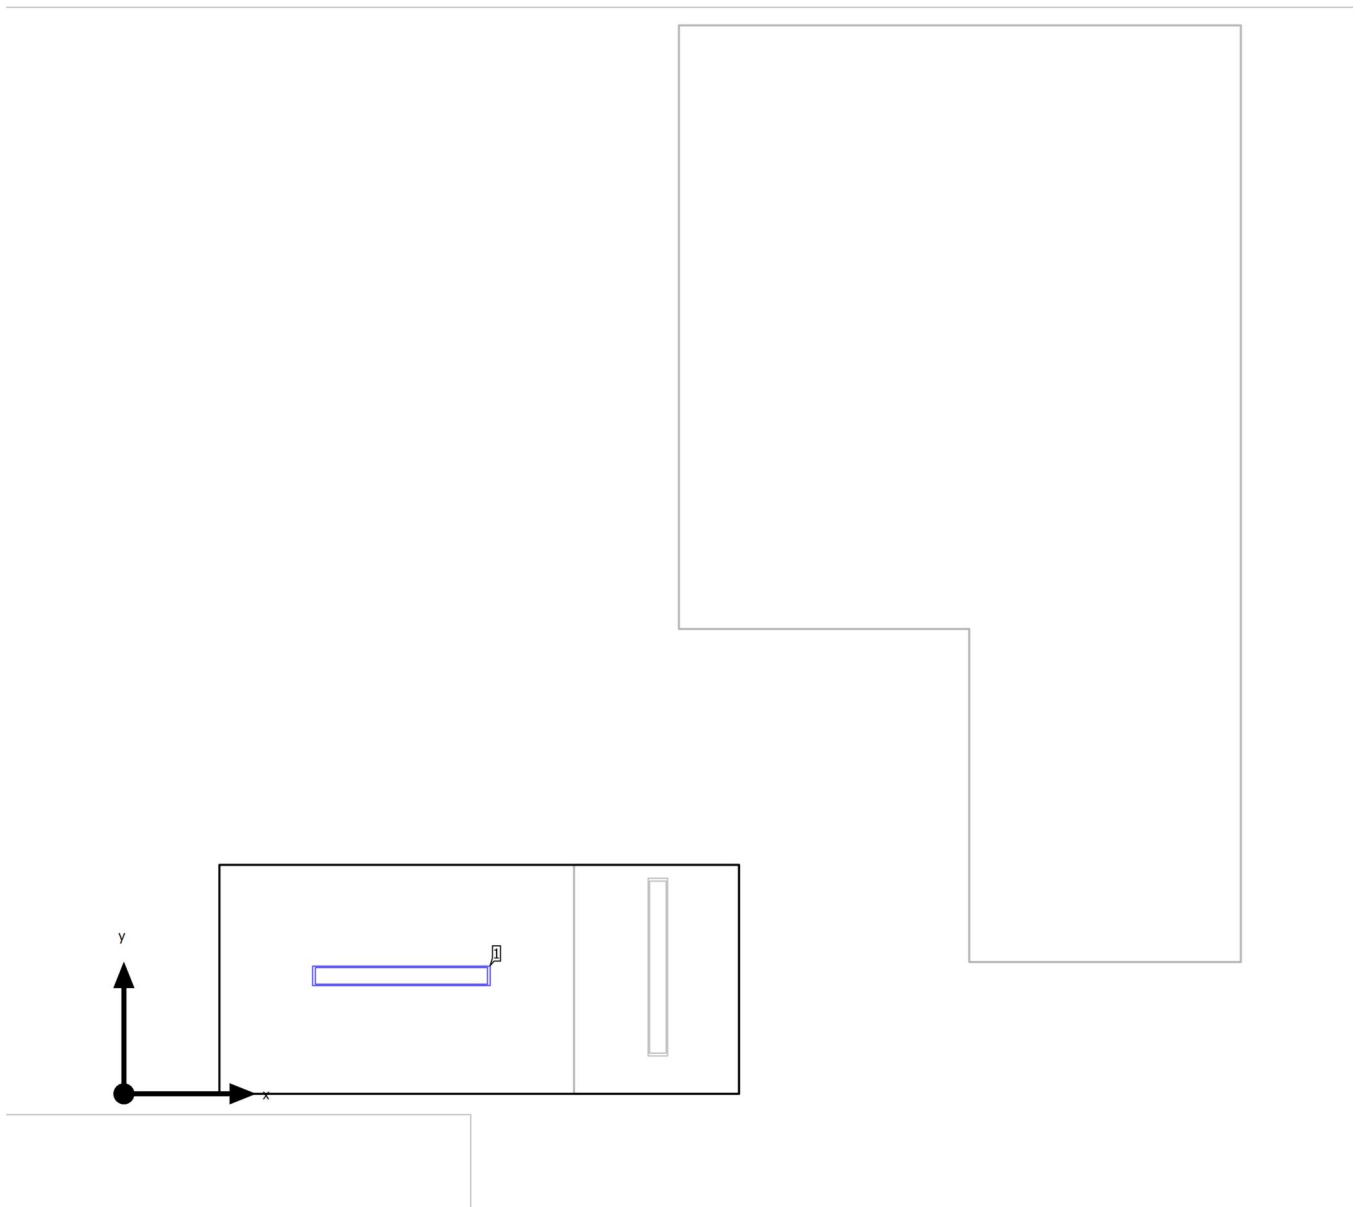

Building B · FIRST FOOR · 201 STAIRS

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
2.000 m	0.850 m	3.300 m	1

Building B · FIRST FOOR · 201 STAIRS


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Summary

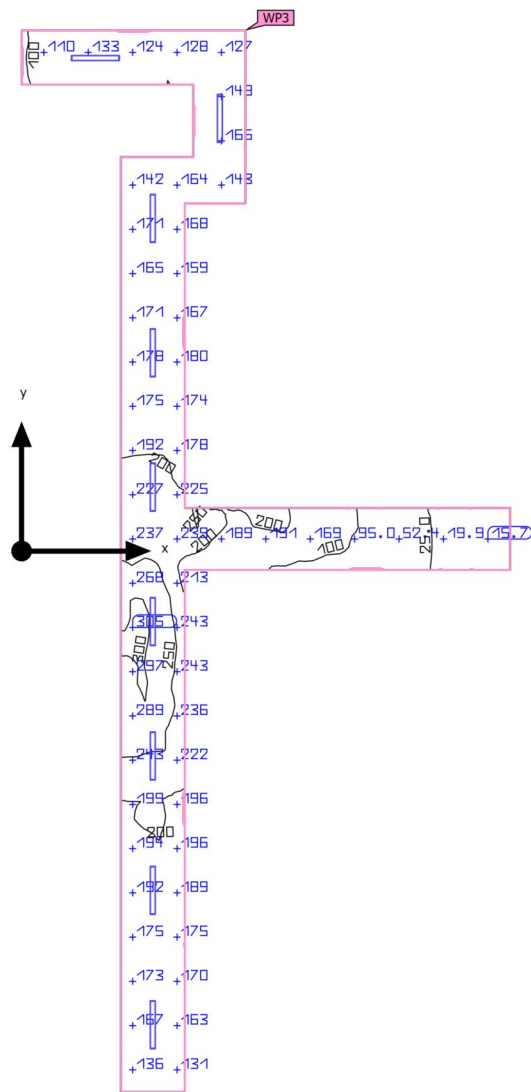

Ground area	69.35 m²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.000 m
		Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	168 lx	$\geq 500 \text{ lx}$	✗	WP3
	$U_o (g_1)$	0.071	≥ 0.60	✗	WP3
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	31	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[1275 - 1693] kWh/a	max. 2450 kWh/a	✓	
Space	Lighting power density	9.86 W/m ²	–		
		5.86 W/m ² /100 lx	–		

(1) Based on a rectangular space of 28.146 m x 12.950 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
9	Philips		2x36W	31	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 202 CORRIDOR

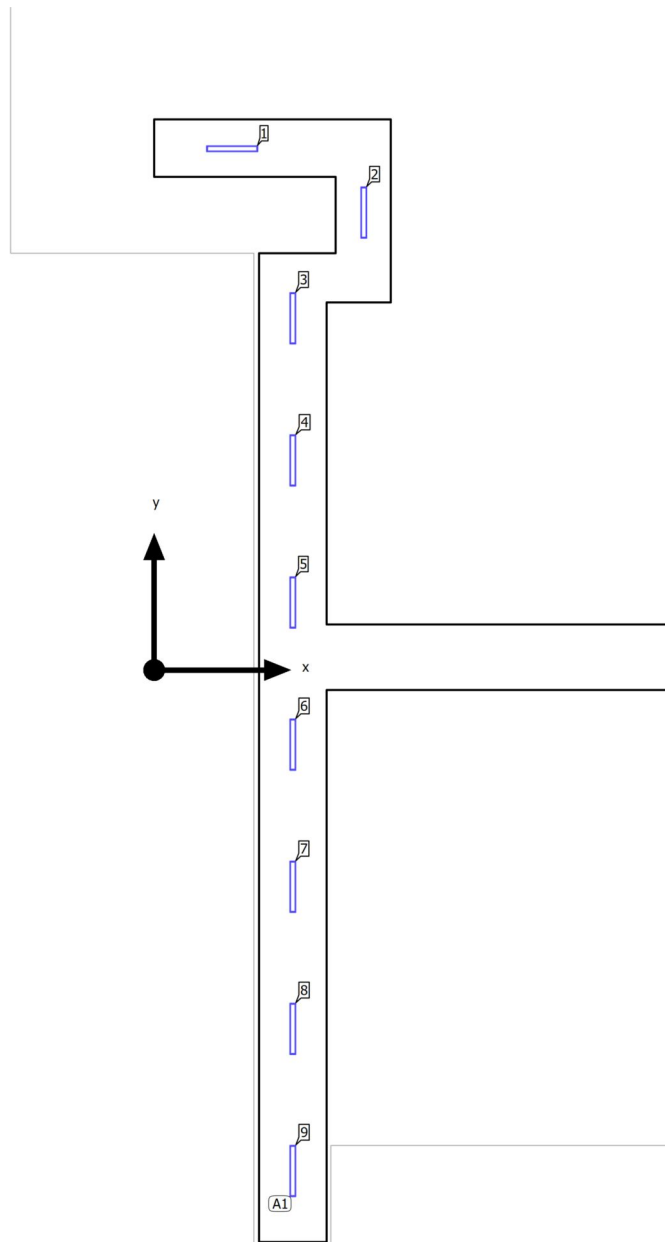Luminaire layout plan

Building B · FIRST FOOR · 202 CORRIDOR

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

7 x Philips 2x36W

Type	Line arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	3.477 m / 8.819 m / 3.300 m	3.477 m	8.819 m	3.300 m	3
X-direction	7 pcs., Centre - centre, 3.563 m	3.477 m	5.256 m	3.300 m	4
Arrangement	A1	3.477 m	1.693 m	3.300 m	5
		3.477 m	-1.870 m	3.300 m	6
		3.477 m	-5.433 m	3.300 m	7
		3.477 m	-8.996 m	3.300 m	8
		3.477 m	-12.559 m	3.300 m	9

Individual luminaires

X	Y	Mounting height	Luminaire
1.956 m	13.069 m	3.300 m	1
5.256 m	11.469 m	3.300 m	2

Building B · FIRST FOOR · 202 CORRIDOR

Luminaire list Φ_{total}

41967 lm

 P_{total}

684.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
9	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Calculation objects

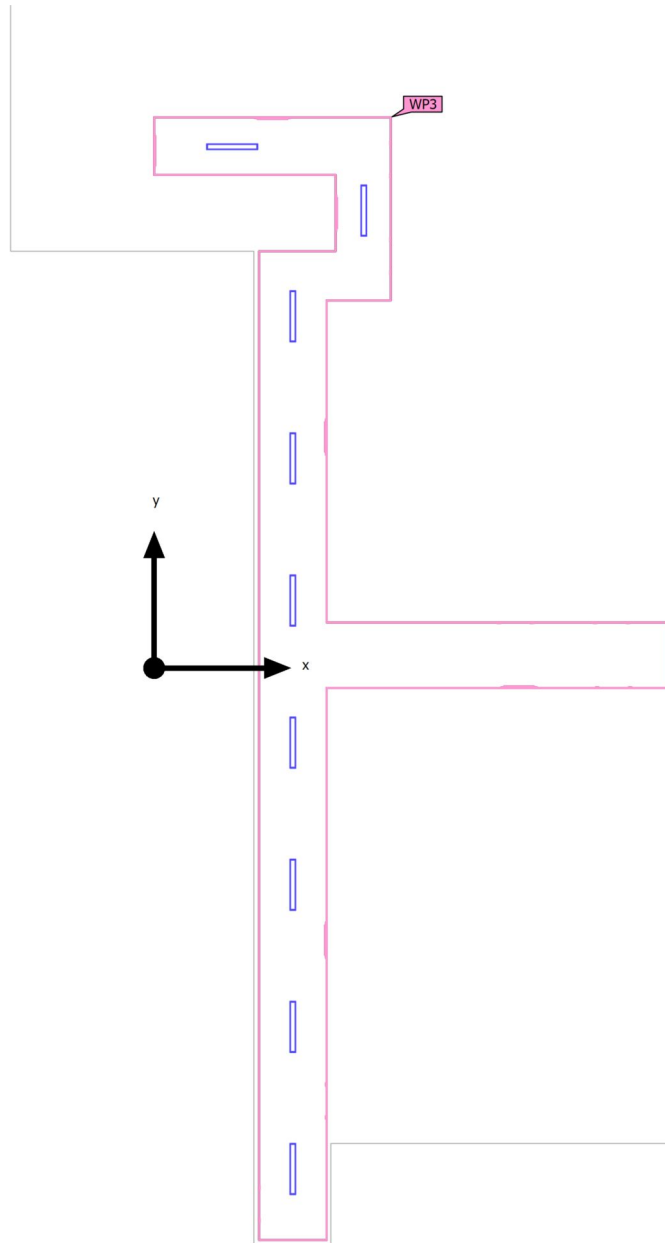

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (202 CORRIDOR)	168 lx	11.9 lx	305 lx	0.071	0.039	WP3
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Working plane (202 CORRIDOR)

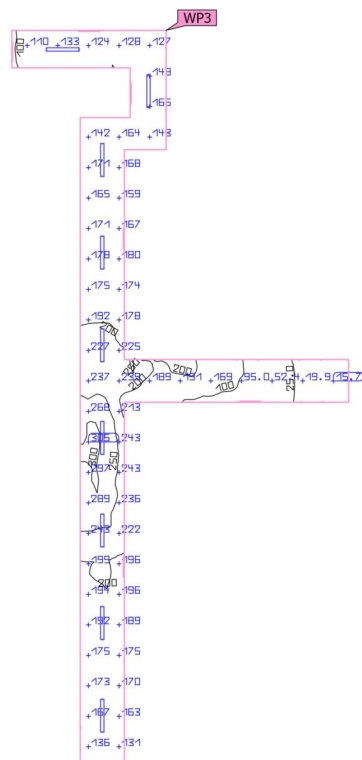


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (202 CORRIDOR)	168 lx	11.9 lx	305 lx	0.071	0.039	WP3
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Summary

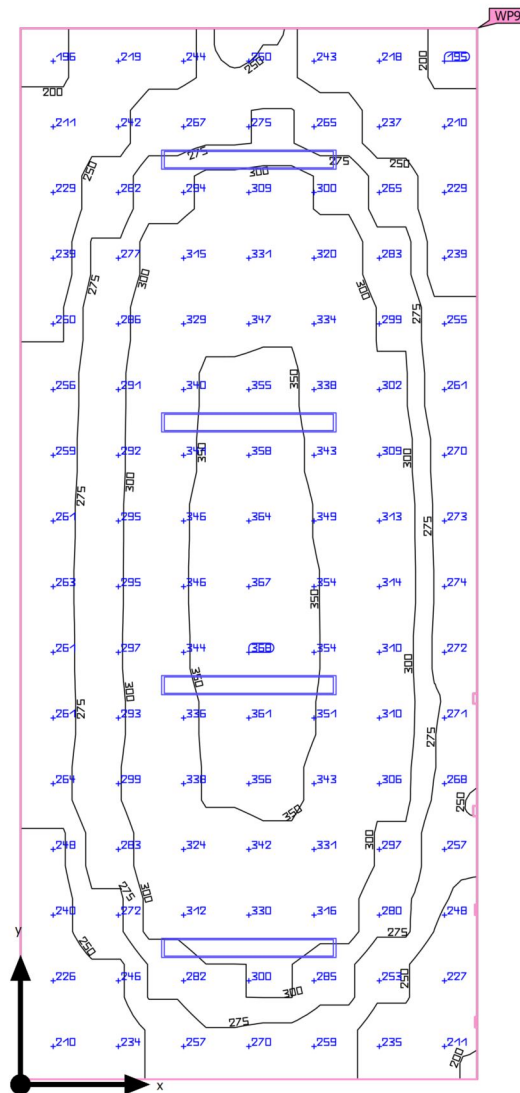

Ground area	25.83 m ²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	291 lx	$\geq 500 \text{ lx}$	✗	WP9
	$U_o (g_1)$	0.67	≥ 0.60	✓	WP9
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	25	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[474 - 752] kWh/a	max. 950 kWh/a	✓	
Space	Lighting power density	11.77 W/m ²	–		
		4.04 W/m ² /100 lx	–		

(1) Based on a rectangular space of 3.350 m x 7.712 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	25	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 203 DIRECTOR

Luminaire layout plan

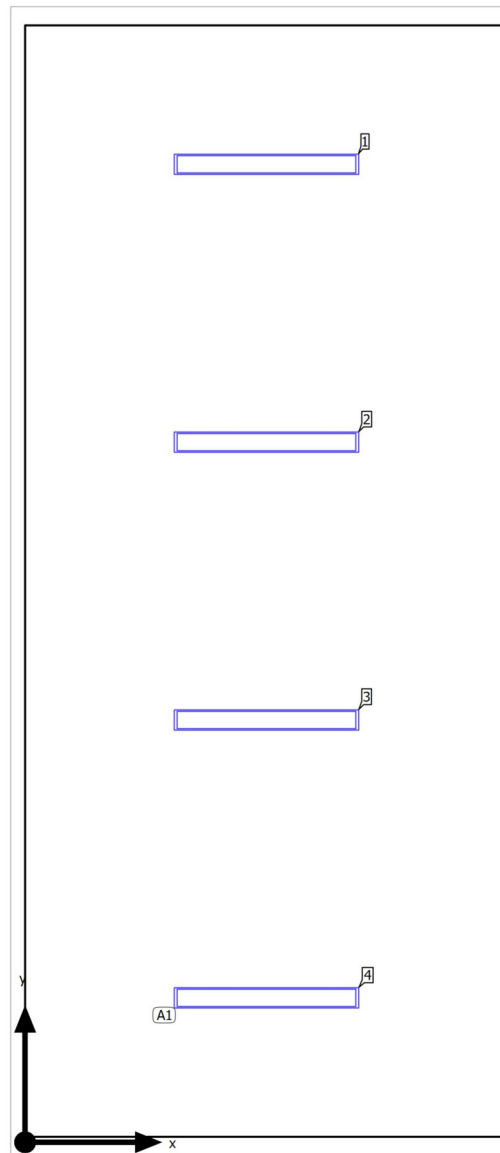

Building B · FIRST FOOR · 203 DIRECTOR

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

4 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.675 m / 1.002 m / 3.300 m	1.675 m	6.786 m	3.300 m	1
X-direction	1 pcs., Centre - centre, 3.350 m	1.675 m	4.858 m	3.300 m	2
Y-direction	4 pcs., Centre - centre, 1.928 m	1.675 m	2.930 m	3.300 m	3
		1.675 m	1.002 m	3.300 m	4
Arrangement	A1				

Building B · FIRST FOOR · 203 DIRECTOR

Luminaire list Φ_{total}

18652 lm

 P_{total}

304.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Calculation objects

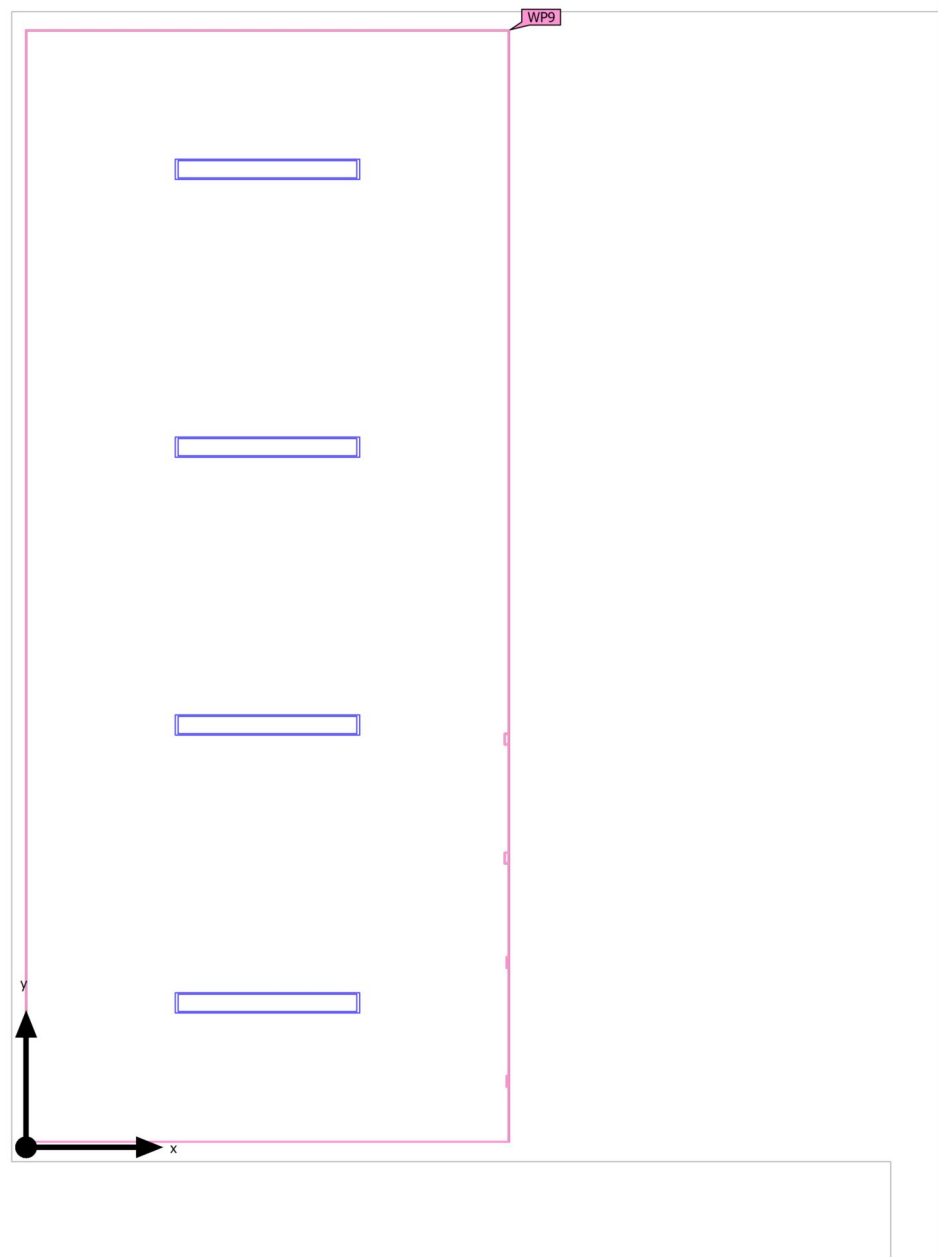

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (203 DIRECTOR) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	291 lx (≥ 500 lx) ✗	195 lx	370 lx	0.67 (≥ 0.60) ✓	0.53	WP9

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Working plane (203 DIRECTOR)

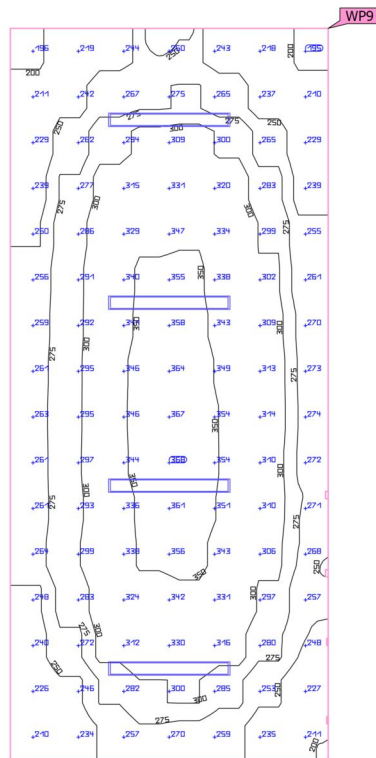


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (203 DIRECTOR)	291 lx	195 lx	370 lx	0.67	0.53	WP9
Perpendicular illuminance (adaptive)	$\geq 500 \text{ lx}$			≥ 0.60		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203A DB (Light scene 1)

Summary

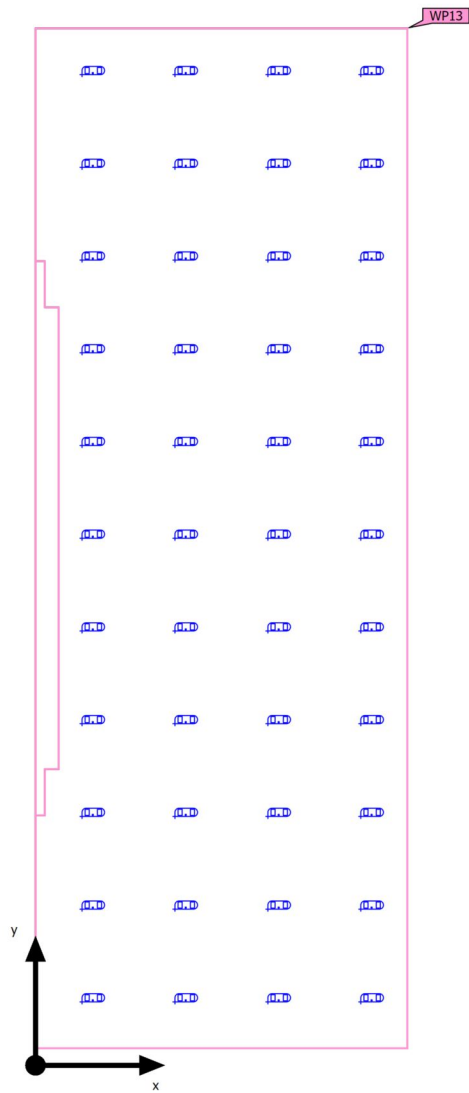

Ground area	1.00 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 203A DB (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	0.00 lx	$\geq 500 \text{ lx}$	✗	WP13
	$U_o (g_1)$	-	≥ 0.60		WP13
Energy estimation ⁽²⁾	Consumption	0.00 kWh/a	max. 50 kWh/a	✓	
Space	Lighting power density	0.00 W/m ²	-		


(1) Based on a rectangular space of 1.656 m x 0.604 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203A DB (Light scene 1)

Calculation objects

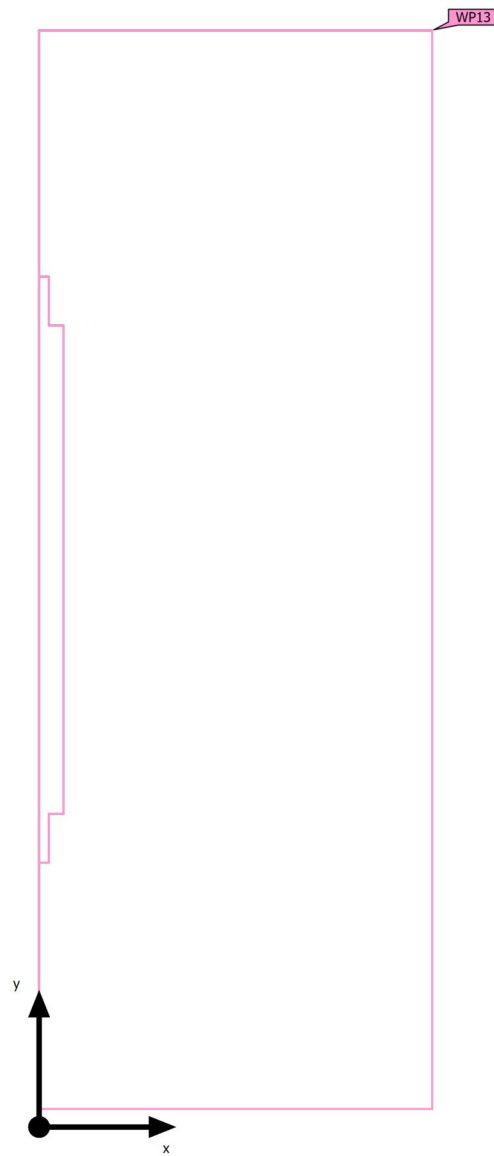

Building B · FIRST FOOR · 203A DB (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (203A DB) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	0.00 lx (≥ 500 lx) ✗	0.00 lx	0.00 lx	- (≥ 0.60)	-	WP13

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203A DB (Light scene 1)

Working plane (203A DB)

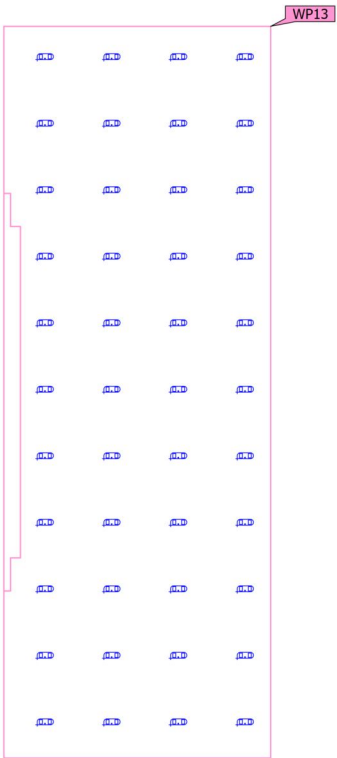


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (203A DB) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	0.00 lx (≥ 500 lx) ✗	0.00 lx	0.00 lx	- (≥ 0.60)	-	WP13

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Summary

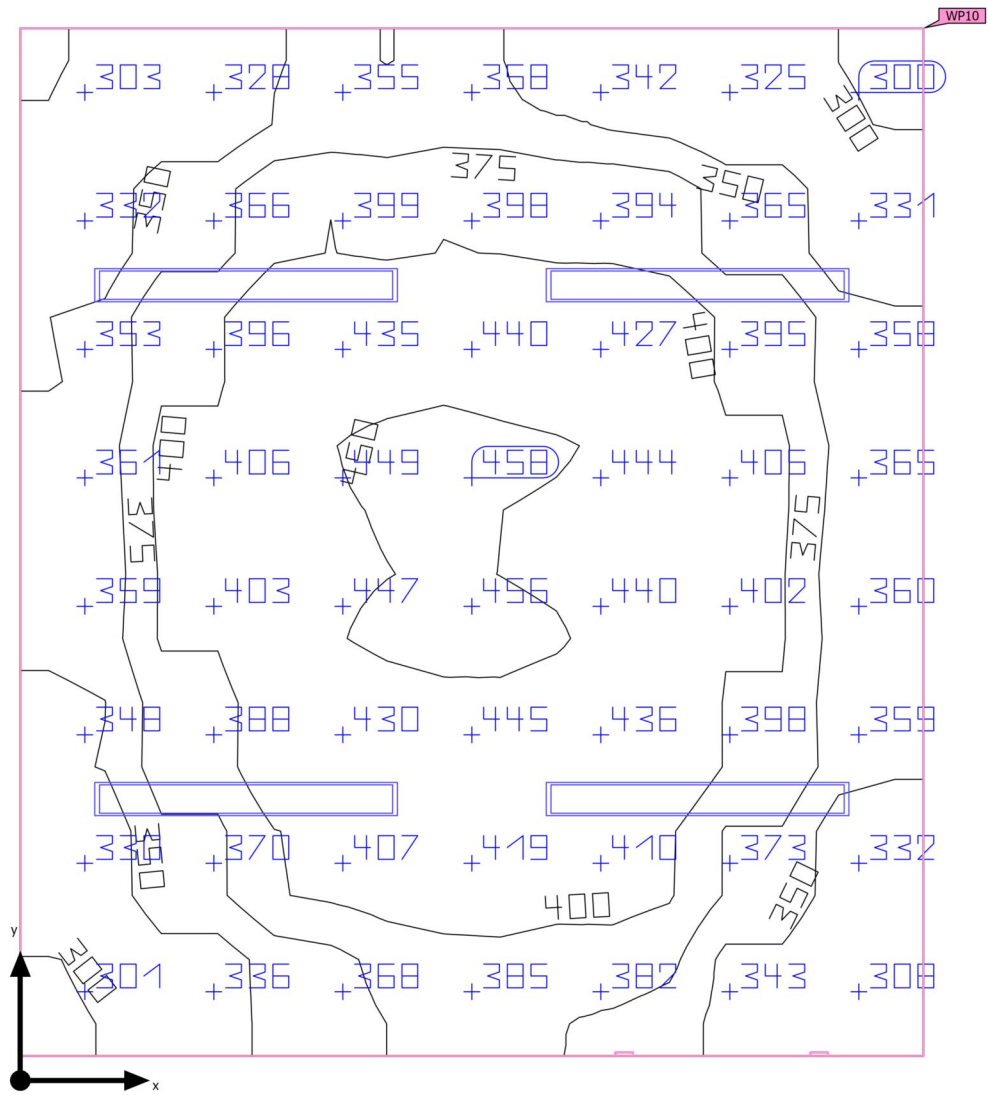

Ground area	16.60 m²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	384 lx	$\geq 500 \text{ lx}$	✗	WP10
	$U_o (g_1)$	0.77	≥ 0.60	✓	WP10
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[474 - 752] kWh/a	max. 600 kWh/a	✗	
Space	Lighting power density	18.32 W/m ²	–		
		4.77 W/m ² /100 lx	–		

(1) Based on a rectangular space of 3.819 m x 4.346 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 204 MEETING

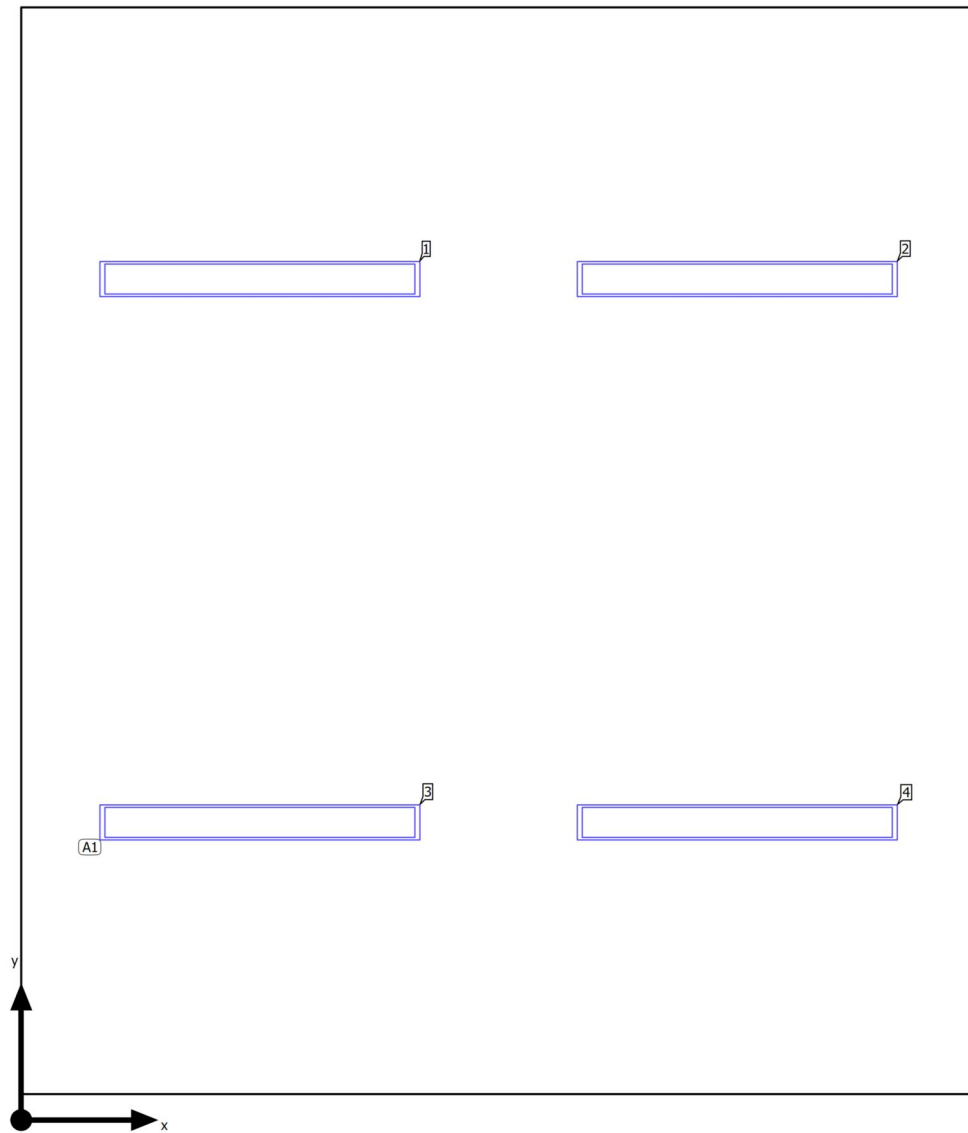Luminaire layout plan

Building B · FIRST FOOR · 204 MEETING

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

4 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.955 m / 1.190 m / 3.300 m	0.955 m	3.363 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 1.909 m	2.864 m	3.363 m	3.300 m	2
Y-direction	2 pcs., Centre - centre, 2.173 m	0.955 m	1.190 m	3.300 m	3
		2.864 m	1.190 m	3.300 m	4
Arrangement	A1				

Building B · FIRST FOOR · 204 MEETING

Luminaire list Φ_{total}

18652 lm

 P_{total}

304.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Calculation objects

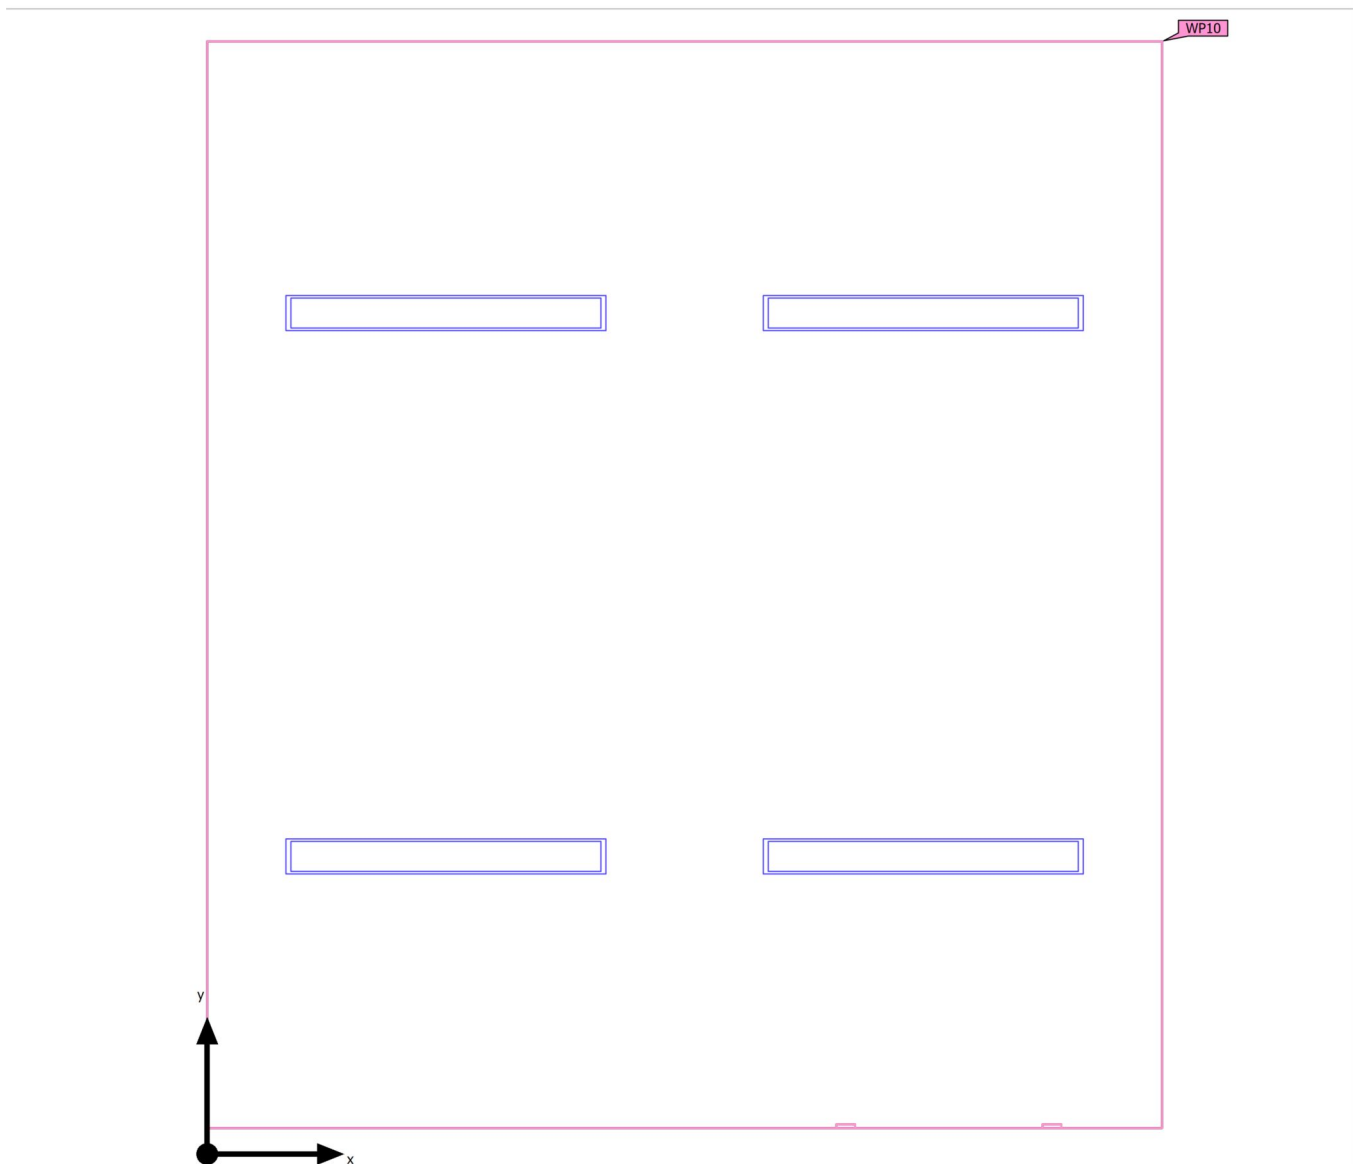

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (204 MEETING)	384 lx	295 lx	460 lx	0.77	0.64	WP10
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Working plane (204 MEETING)

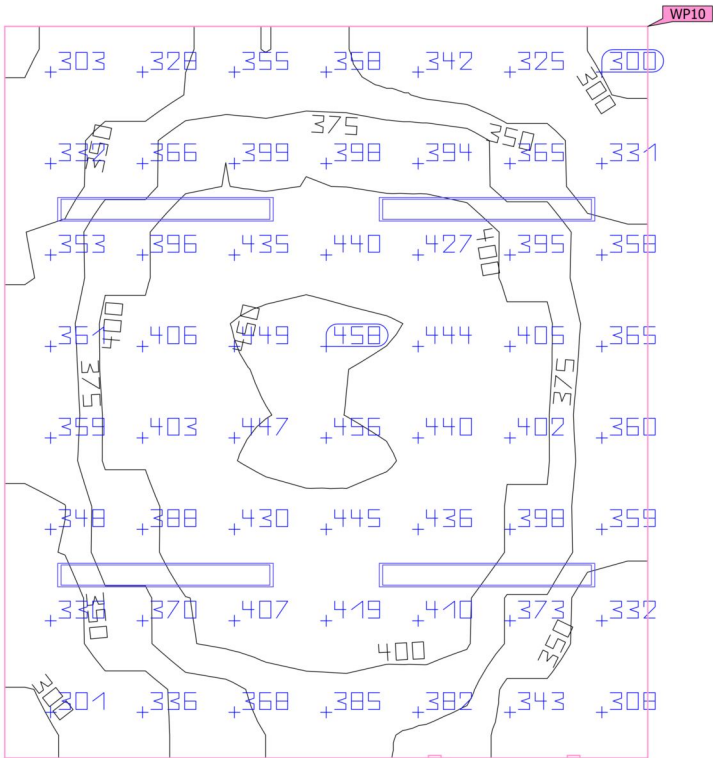


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (204 MEETING)	384 lx	295 lx	460 lx	0.77	0.64	WP10
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Summary

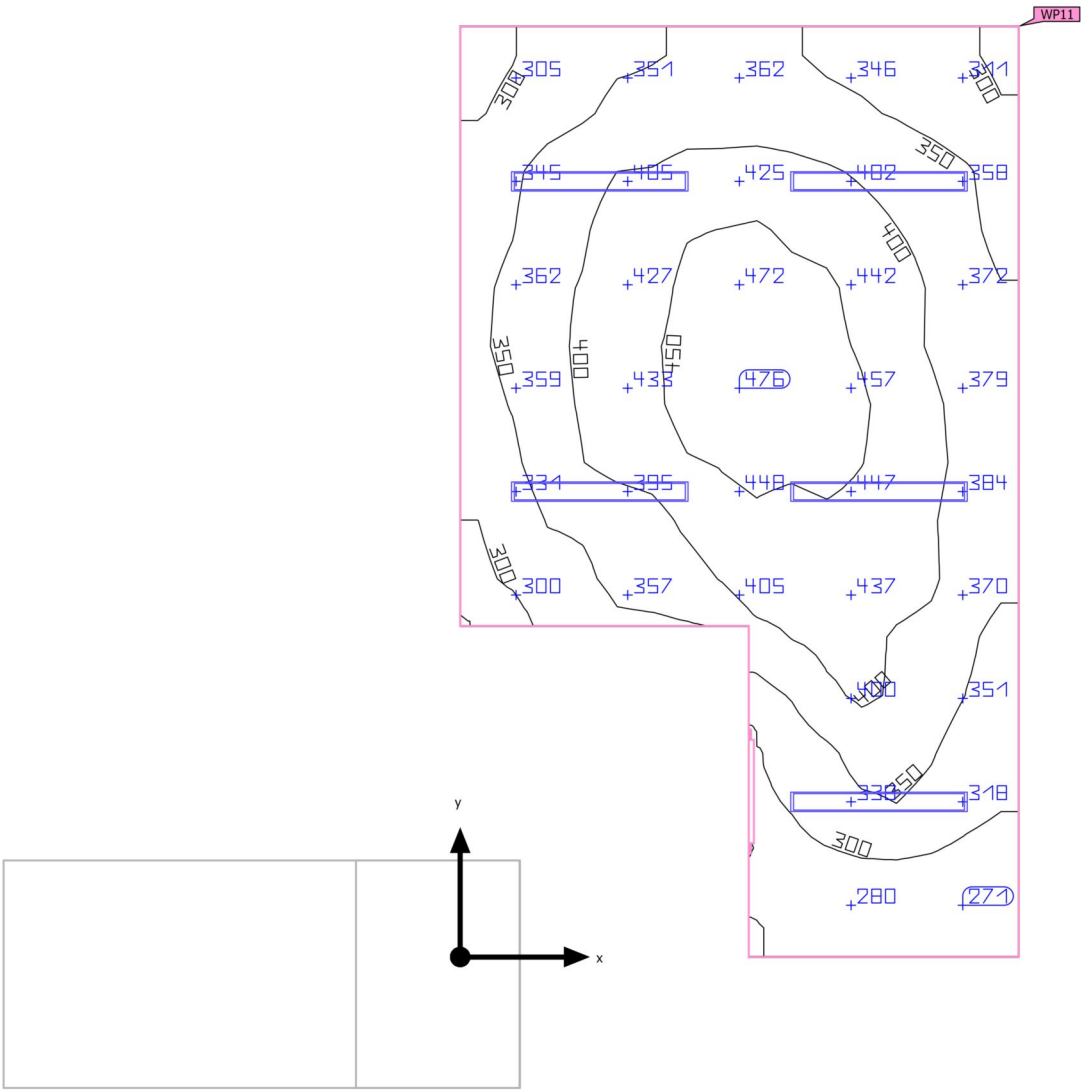

Ground area	22.32 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	375 lx	$\geq 500 \text{ lx}$	✗	WP11
	$U_o (g_1)$	0.59	≥ 0.60	✗	WP11
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[593 - 941] kWh/a	max. 800 kWh/a	✗	
Space	Lighting power density	17.03 W/m ²	–		
		4.54 W/m ² /100 lx	–		

(1) Based on a rectangular space of 6.750 m x 4.050 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
5	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 205 OFFICE

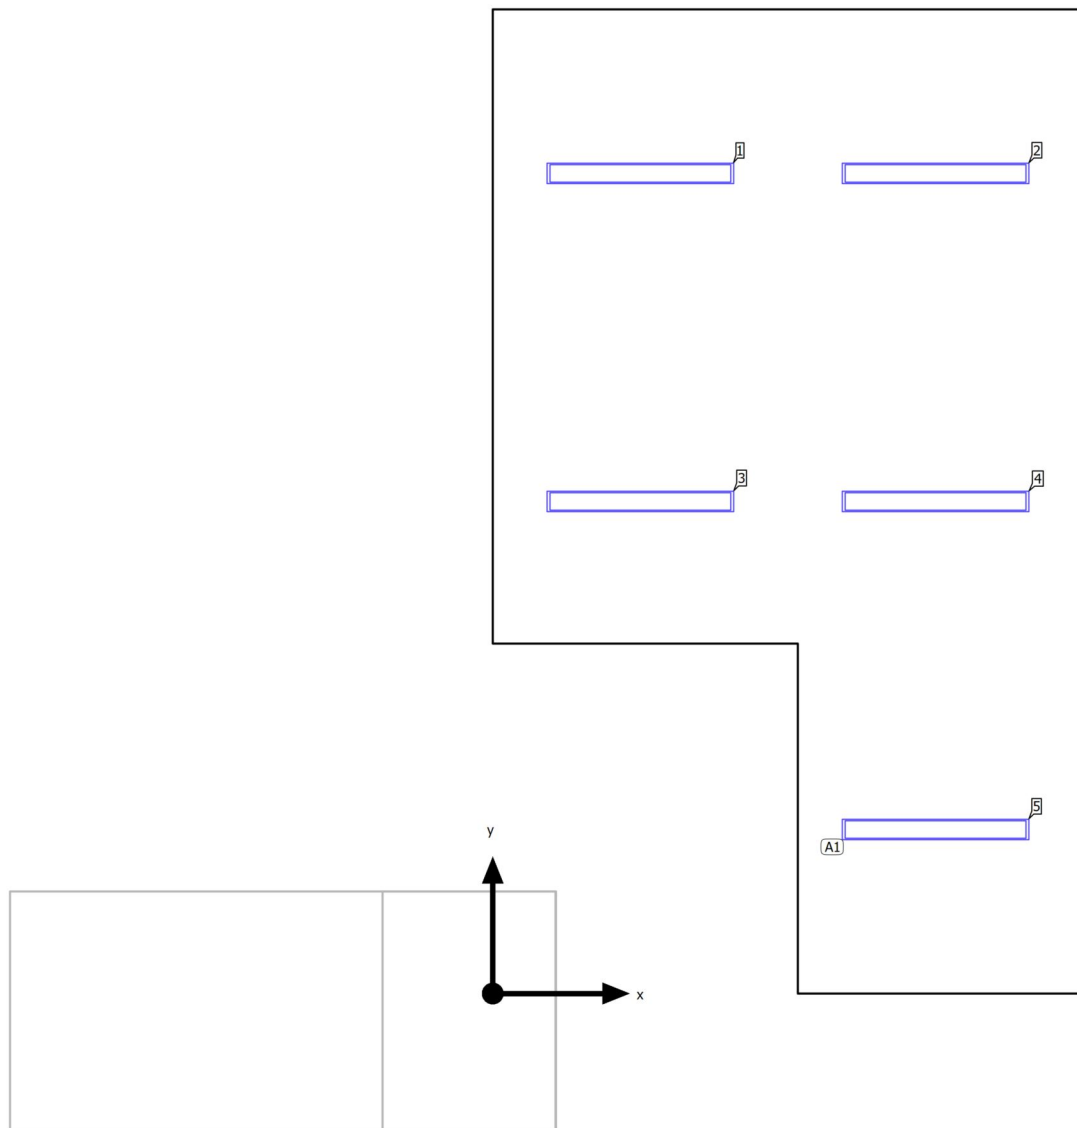Luminaire layout plan

Building B · FIRST FOOR · 205 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

5 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	3.037 m / 1.125 m / 3.300 m	1.012 m	5.625 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.025 m	3.037 m	5.625 m	3.300 m	2
Y-direction	3 pcs., Centre - centre, 2.250 m	1.012 m	3.375 m	3.300 m	3
		3.037 m	3.375 m	3.300 m	4
Arrangement	A1	3.037 m	1.125 m	3.300 m	5

Building B · FIRST FOOR · 205 OFFICE

Luminaire list Φ_{total}

23315 lm

 P_{total}

380.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
5	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Calculation objects

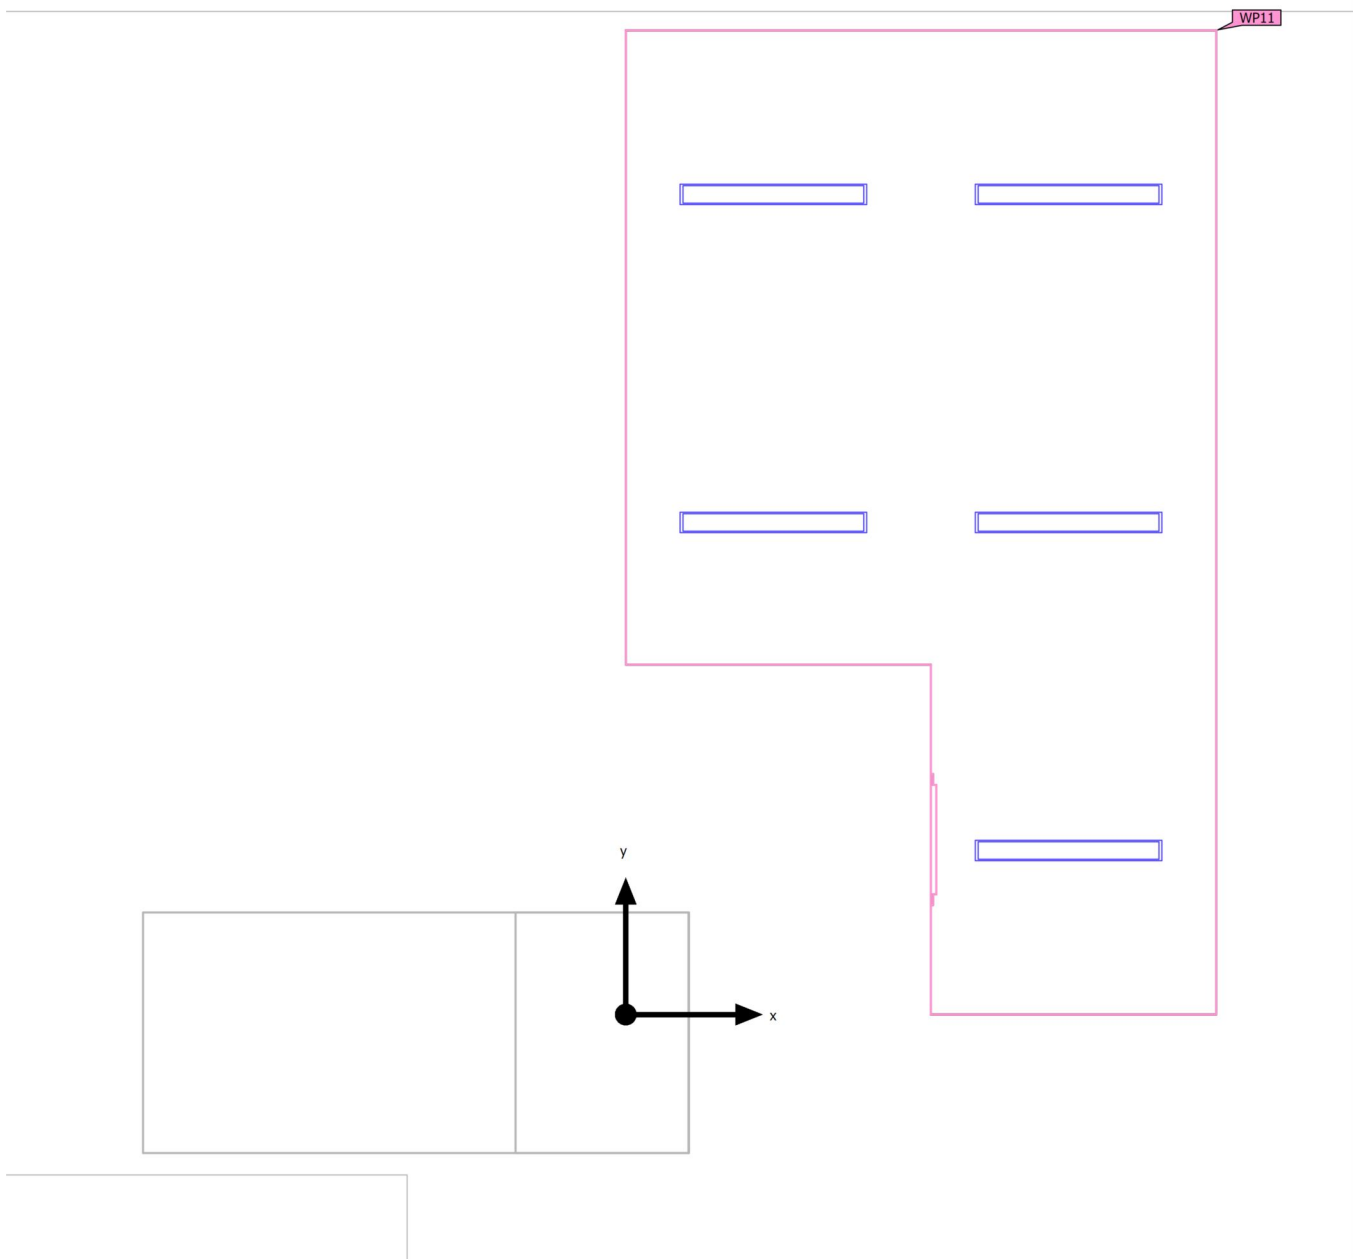

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (205 OFFICE)	375 lx	223 lx	477 lx	0.59	0.47	WP11
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Working plane (205 OFFICE)

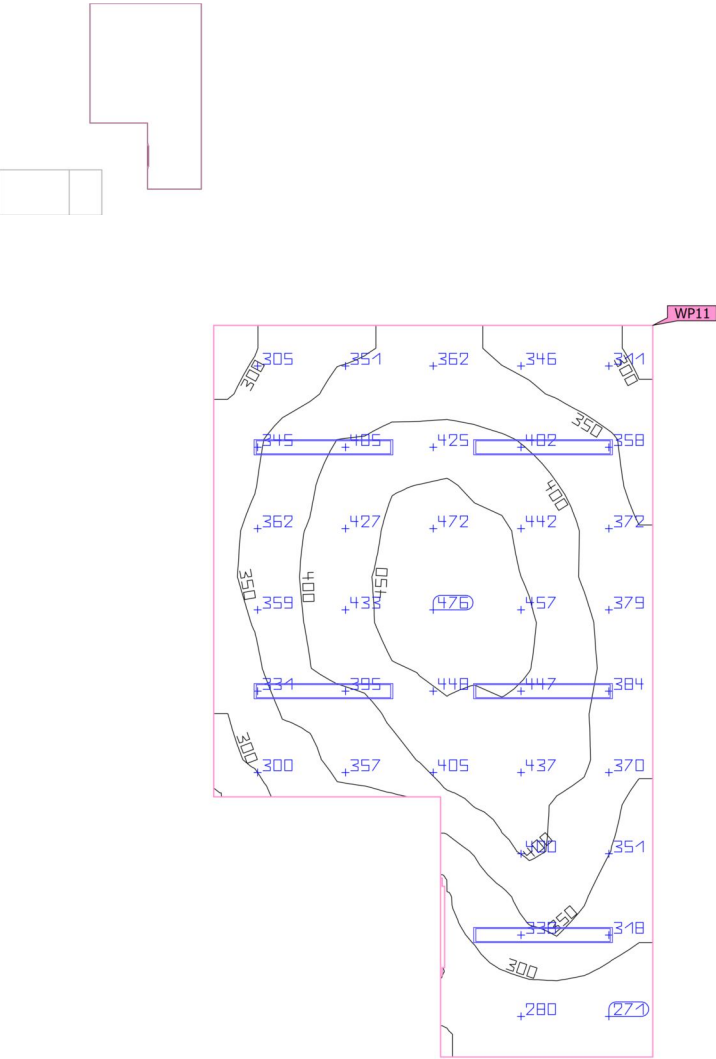


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (205 OFFICE)	375 lx	223 lx	477 lx	0.59	0.47	WP11
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Summary

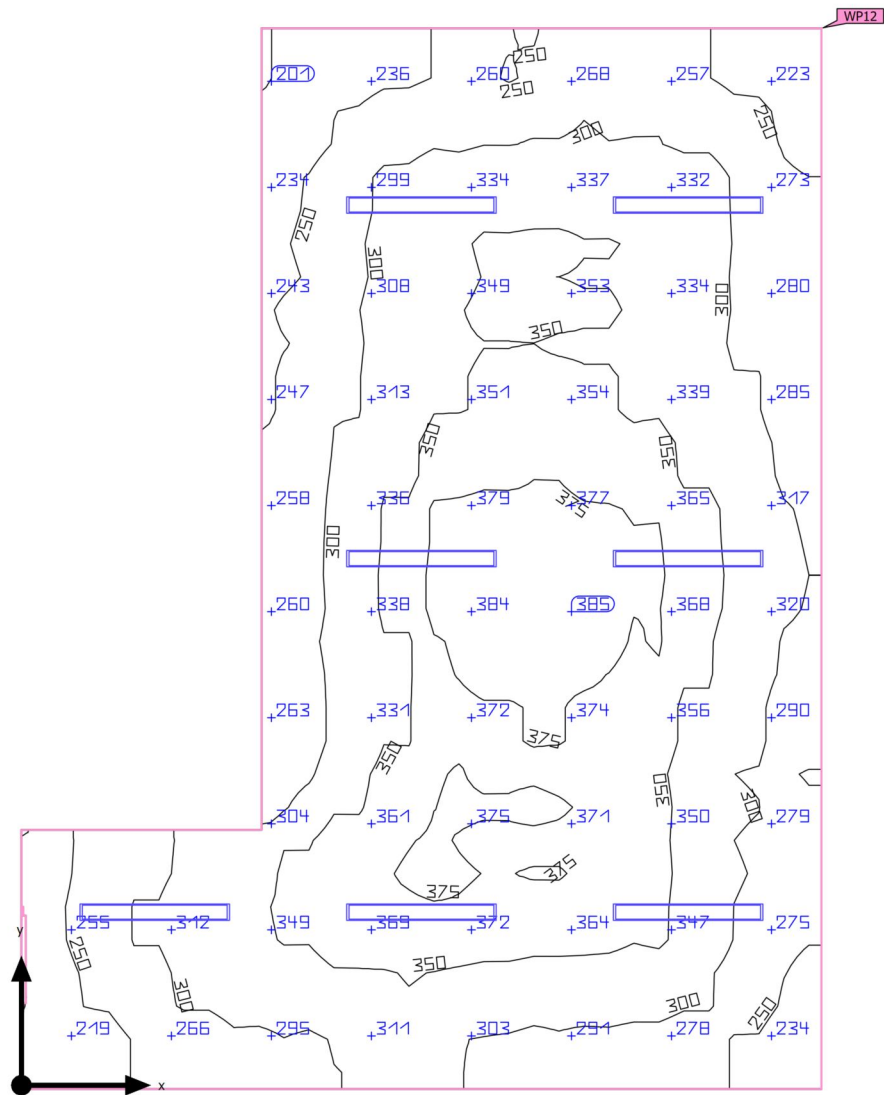

Ground area	48.10 m ²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.850 m
		Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	316 lx	≥ 500 lx	✗	WP12
	$U_o (g_1)$	0.62	≥ 0.60	✓	WP12
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	26	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[830 - 1317] kWh/a	max. 1700 kWh/a	✓	
Space	Lighting power density	11.06 W/m ²	–		
		3.50 W/m ² /100 lx	–		

(1) Based on a rectangular space of 6.850 m x 9.082 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
7	Philips		2x36W	26	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 206 KITCHEN

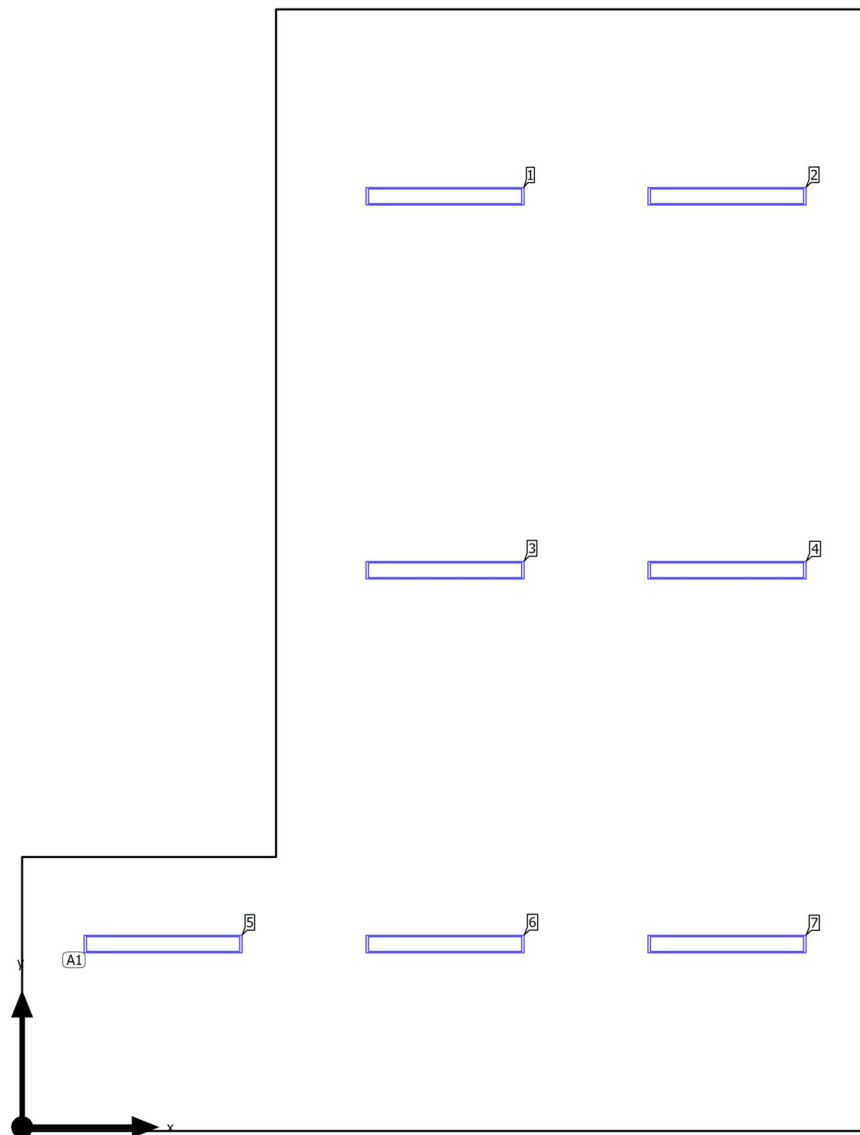Luminaire layout plan

Building B · FIRST FOOR · 206 KITCHEN

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

7 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.142 m / 1.482 m / 3.300 m	3.425 m	7.536 m	3.300 m	1
X-direction	3 pcs., Centre - centre, 2.283 m	5.708 m	7.536 m	3.300 m	2
Y-direction	3 pcs., Centre - centre, 3.027 m	3.425 m	4.509 m	3.300 m	3
		5.708 m	4.509 m	3.300 m	4
Arrangement	A1	1.142 m	1.482 m	3.300 m	5
		3.425 m	1.482 m	3.300 m	6
		5.708 m	1.482 m	3.300 m	7

Building B · FIRST FOOR · 206 KITCHEN

Luminaire list Φ_{total}

32641 lm

 P_{total}

532.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
7	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Calculation objects

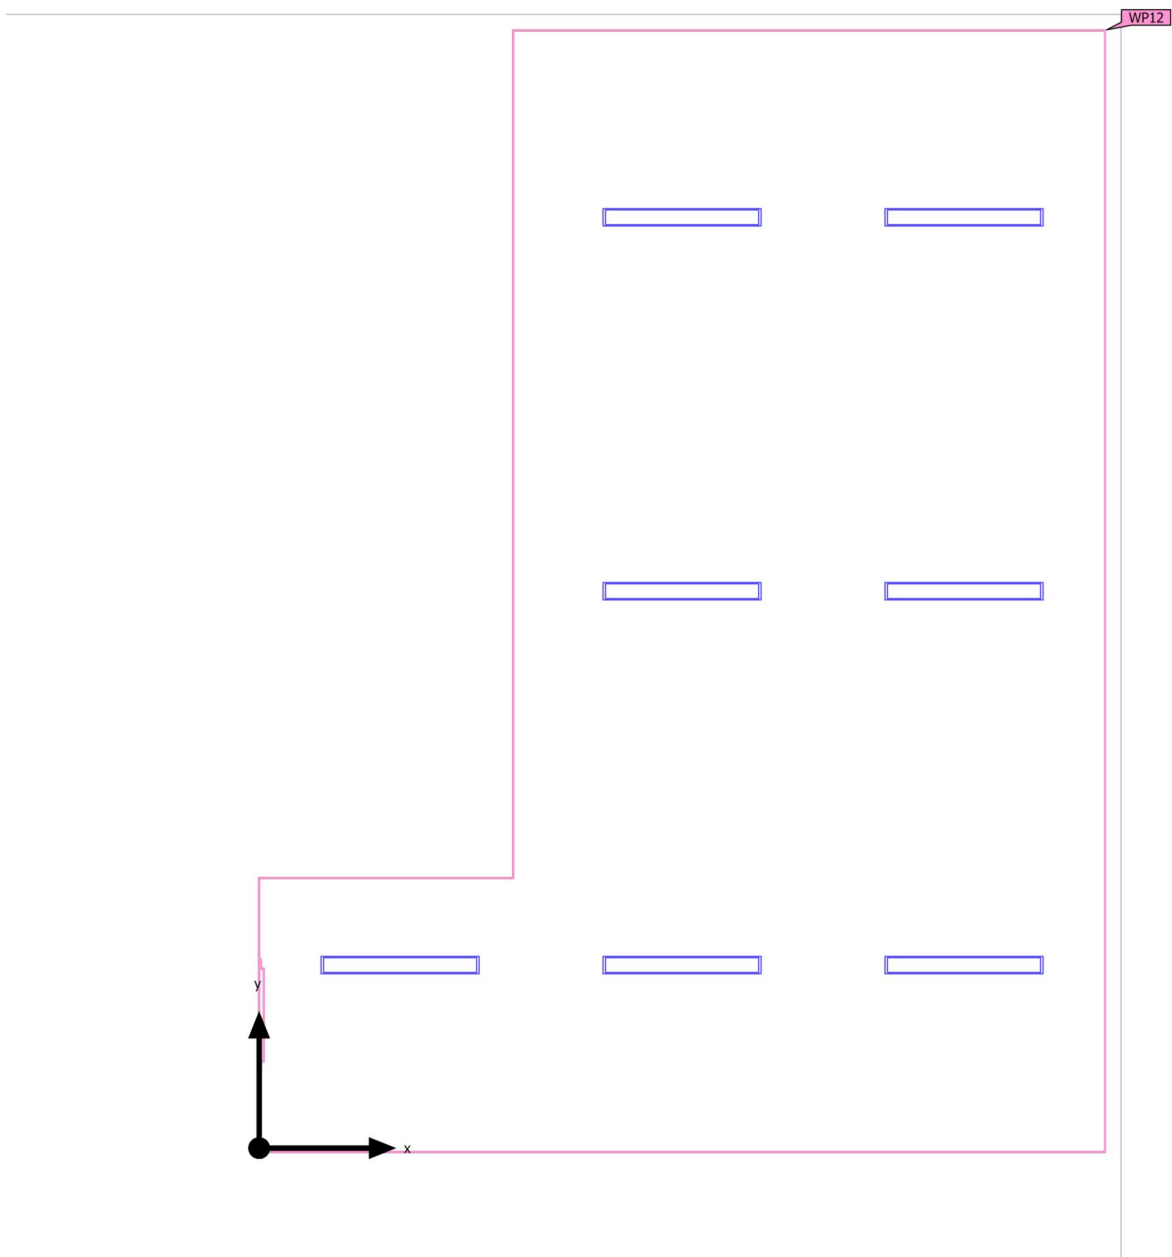

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (206 KITCHEN) Perpendicular illuminance (adaptive) Height: 0.850 m, Wall zone: 0.000 m	316 lx (≥ 500 lx) ✗	195 lx	391 lx	0.62 (≥ 0.60) ✓	0.50	WP12

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

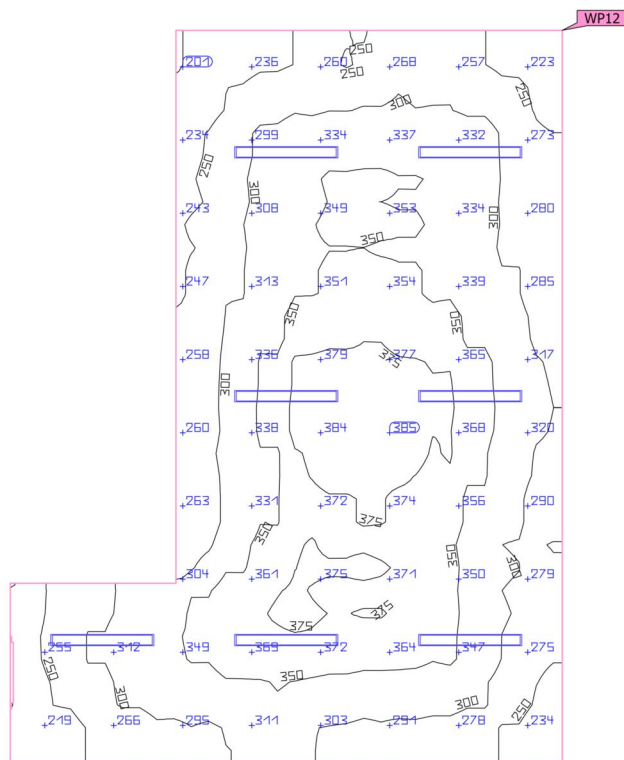
Working plane (206 KITCHEN)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (206 KITCHEN)	316 lx	195 lx	391 lx	0.62	0.50	WP12
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.850 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Summary

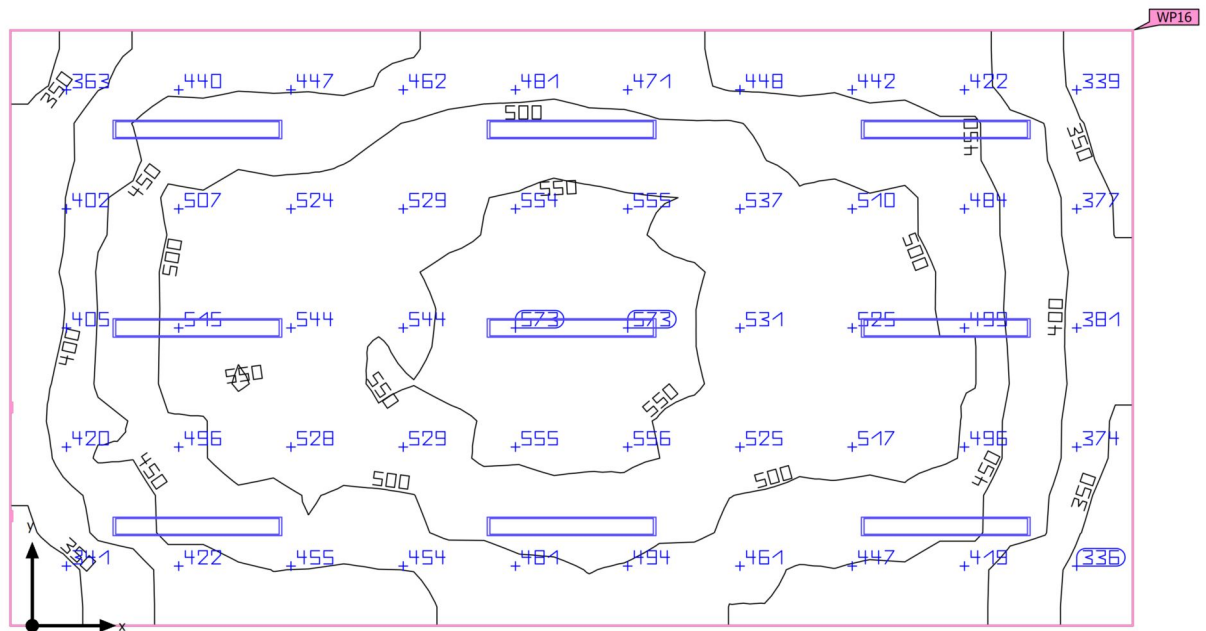

Ground area	38.48 m²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	476 lx	≥ 500 lx	✗	WP16
	$U_o (g_1)$	0.66	≥ 0.60	✓	WP16
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	25	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[1067 - 1693] kWh/a	max. 1350 kWh/a	✗	
Space	Lighting power density	17.77 W/m ²	–		
		3.74 W/m ² /100 lx	–		

(1) Based on a rectangular space of 8.516 m x 4.519 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
9	Philips		2x36W	25	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 207 CAD

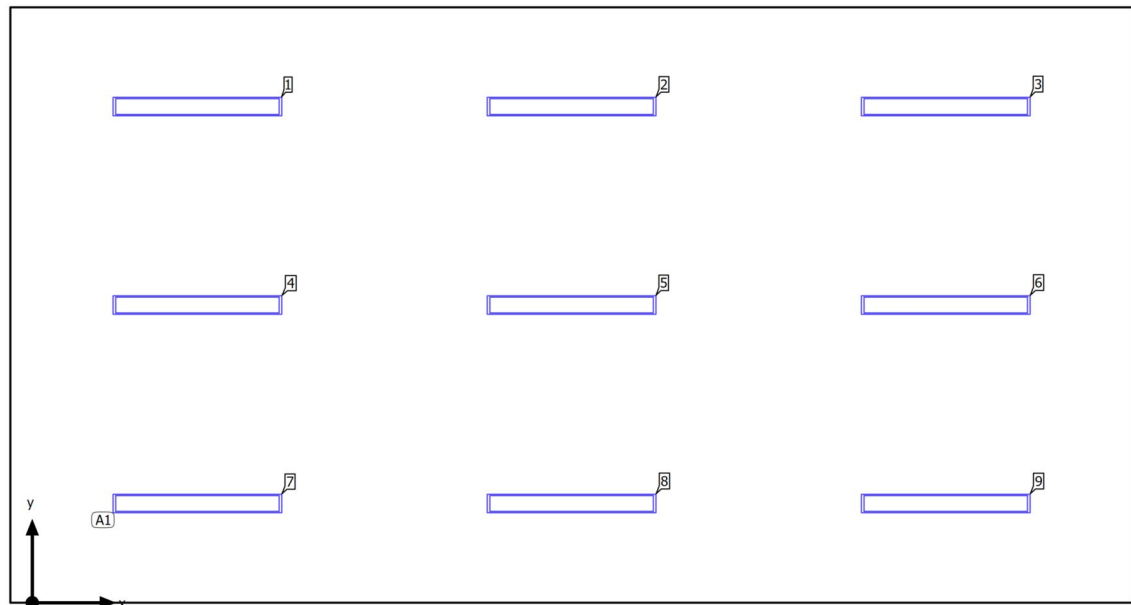Luminaire layout plan

Building B · FIRST FOOR · 207 CAD

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

9 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.253 m / 0.753 m / 3.300 m	1.253 m	3.766 m	3.300 m	1
X-direction	3 pcs., Centre - centre, 2.839 m	4.092 m	3.766 m	3.300 m	2
Y-direction	3 pcs., Centre - centre, 1.506 m	6.931 m	3.766 m	3.300 m	3
Arrangement	A1	1.253 m	2.259 m	3.300 m	4
		4.092 m	2.259 m	3.300 m	5
		6.931 m	2.259 m	3.300 m	6
		1.253 m	0.753 m	3.300 m	7
		4.092 m	0.753 m	3.300 m	8
		6.931 m	0.753 m	3.300 m	9

Building B · FIRST FOOR · 207 CAD

Luminaire list Φ_{total}

41967 lm

 P_{total}

684.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
9	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Calculation objects

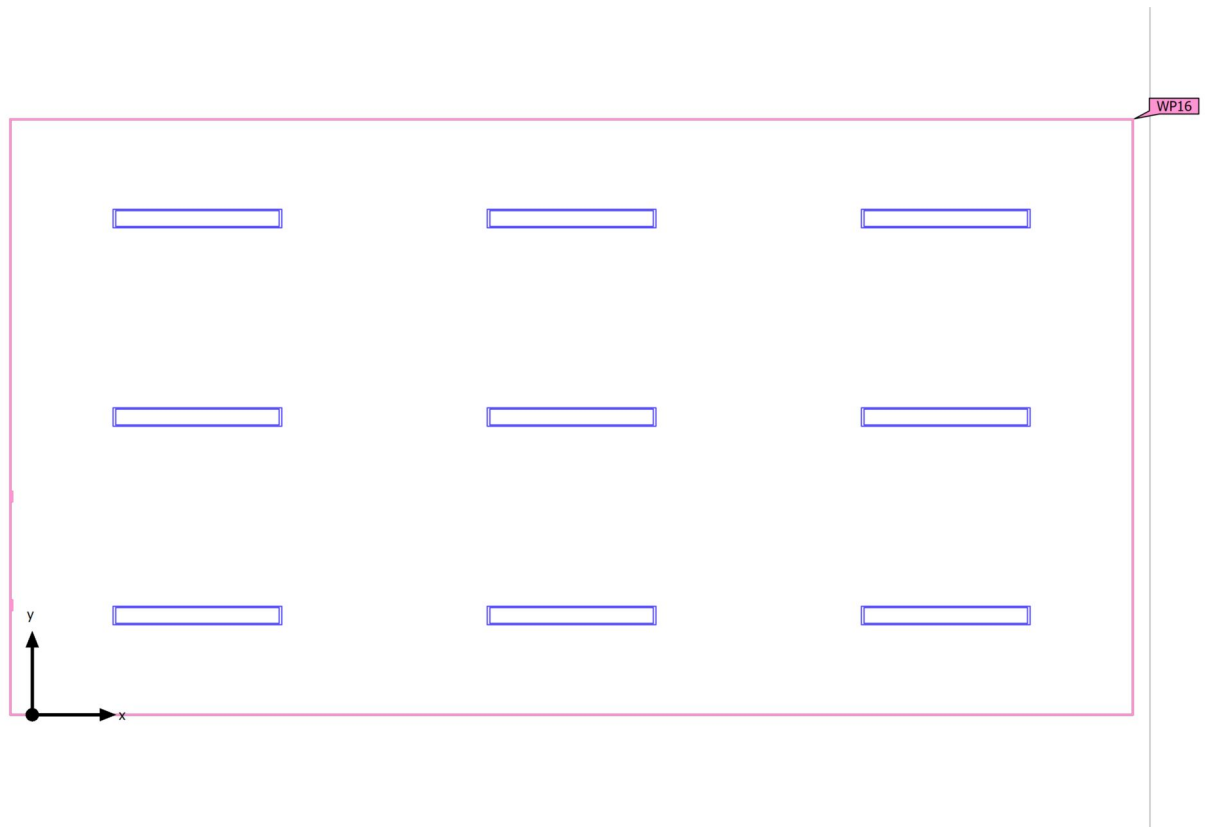

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (207 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	476 lx (≥ 500 lx) ✗	314 lx	577 lx	0.66 (≥ 0.60) ✓	0.54	WP16

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Working plane (207 CAD)

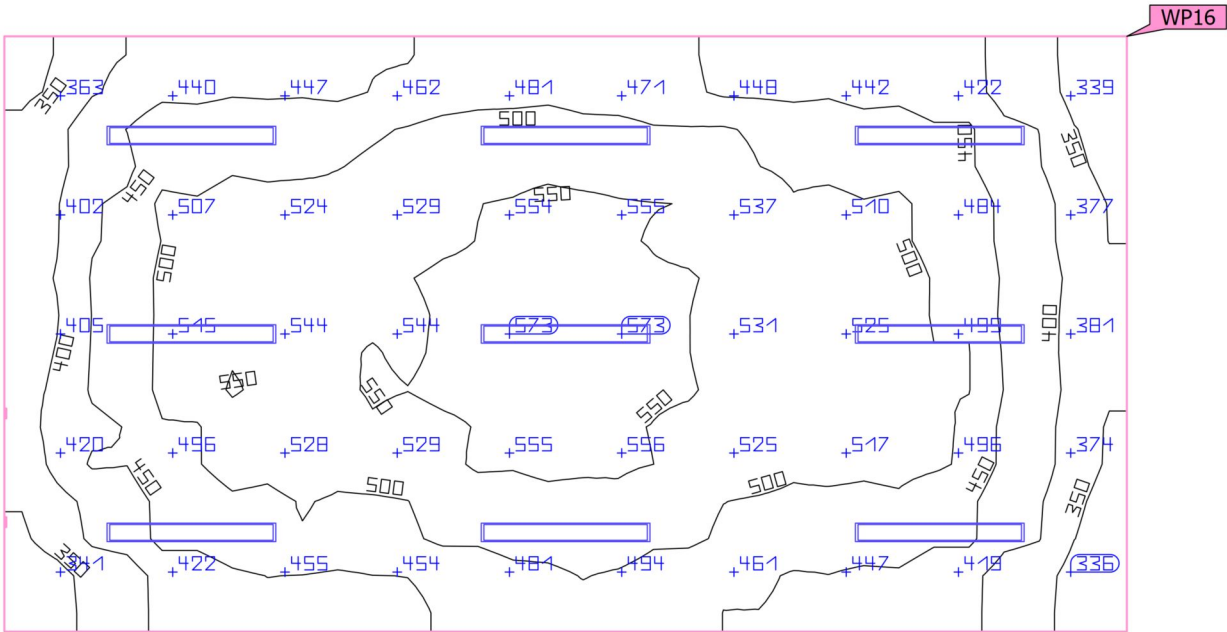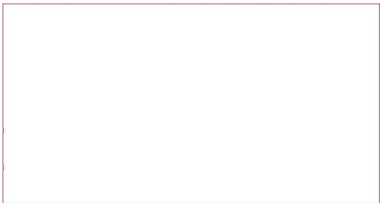


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (207 CAD)	476 lx	314 lx	577 lx	0.66	0.54	WP16
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Summary

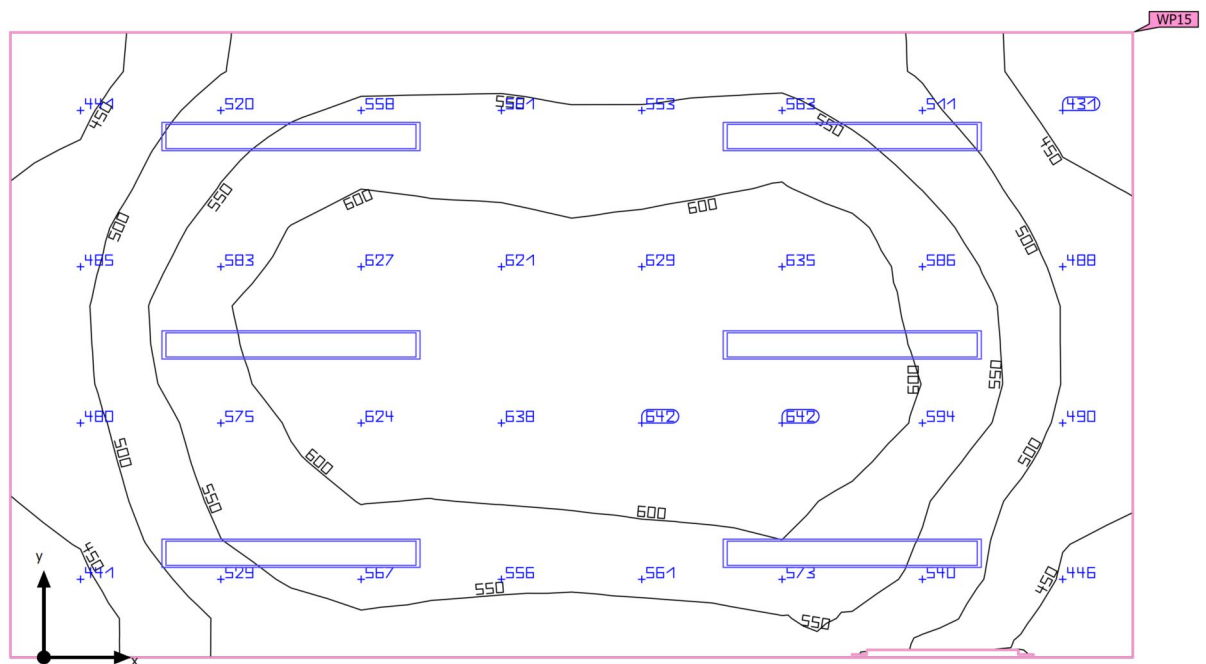

Ground area	17.26 m²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	552 lx	≥ 500 lx	✓	WP15
	$U_o (g_1)$	0.72	≥ 0.60	✓	WP15
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	1129 kWh/a	max. 650 kWh/a	✗	
Space	Lighting power density	26.43 W/m ²	–		
		4.79 W/m ² /100 lx	–		

(1) Based on a rectangular space of 5.566 m x 3.100 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
6	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 208 MEETING

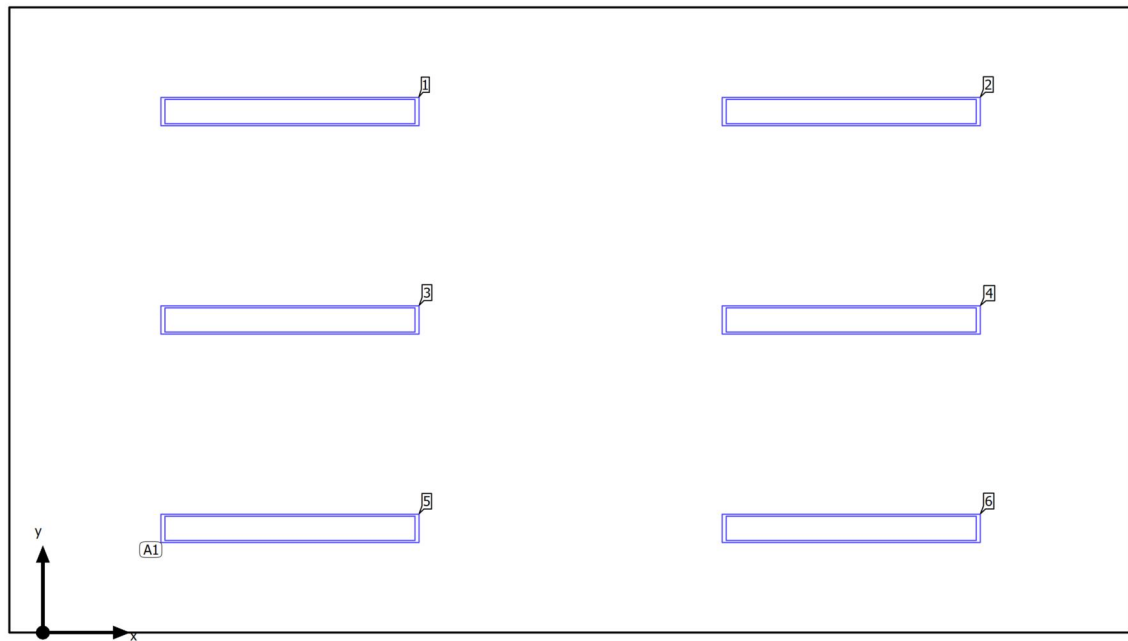Luminaire layout plan

Building B · FIRST FOOR · 208 MEETING

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

6 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.225 m / 0.517 m / 3.300 m	1.225 m	2.583 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.783 m	4.008 m	2.583 m	3.300 m	2
Y-direction	3 pcs., Centre - centre, 1.033 m	1.225 m	1.550 m	3.300 m	3
		4.008 m	1.550 m	3.300 m	4
Arrangement	A1	1.225 m	0.517 m	3.300 m	5
		4.008 m	0.517 m	3.300 m	6

Building B · FIRST FOOR · 208 MEETING

Luminaire list Φ_{total}

27978 lm

 P_{total}

456.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
6	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Calculation objects

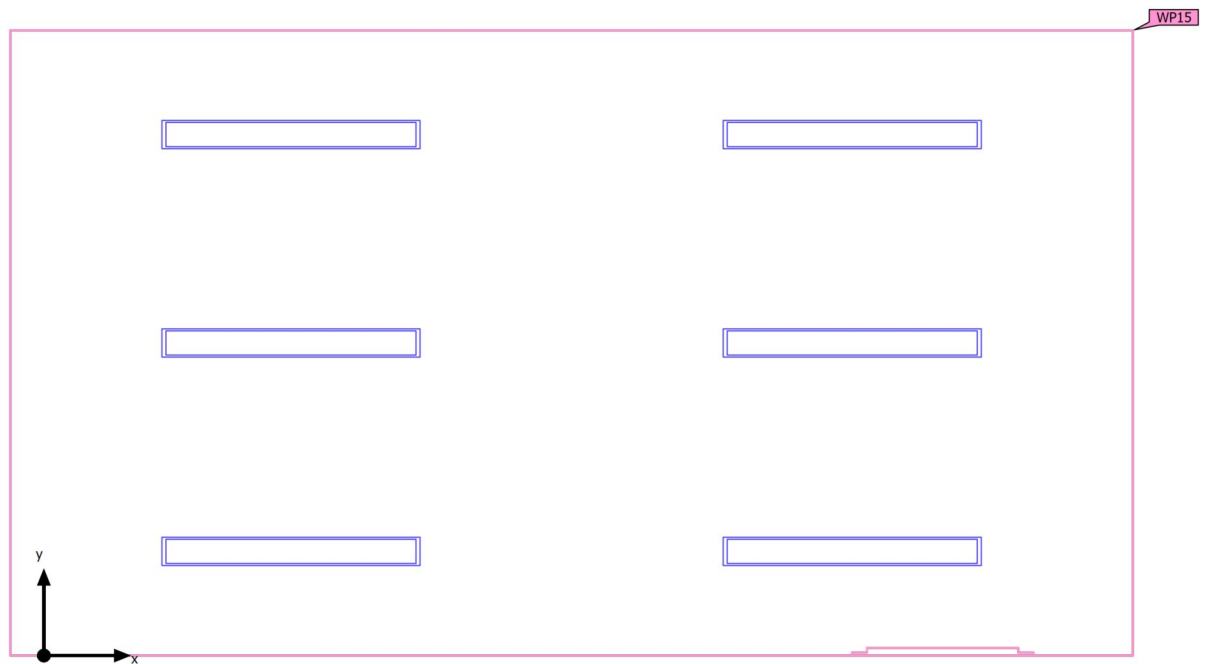

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (208 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	552 lx (≥ 500 lx) ✓	396 lx	649 lx	0.72 (≥ 0.60) ✓	0.61	WP15

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Working plane (208 MEETING)

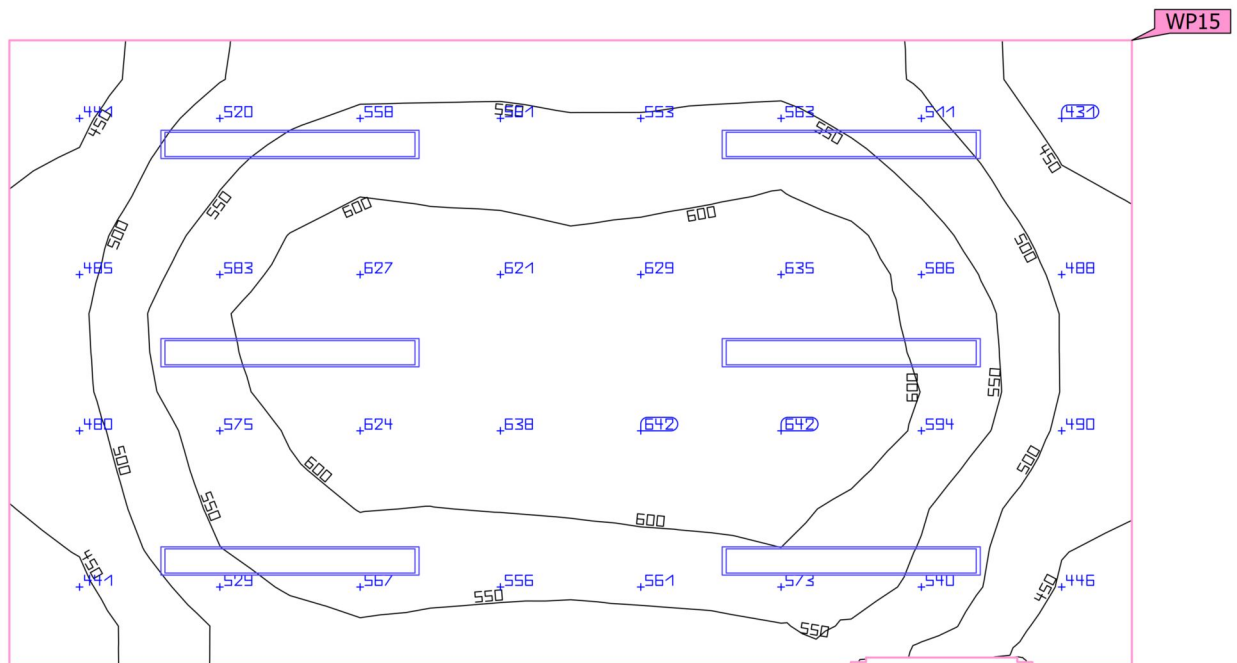


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (208 MEETING)	552 lx	396 lx	649 lx	0.72	0.61	WP15
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.700 m, Wall zone: 0.000 m	✓			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Summary

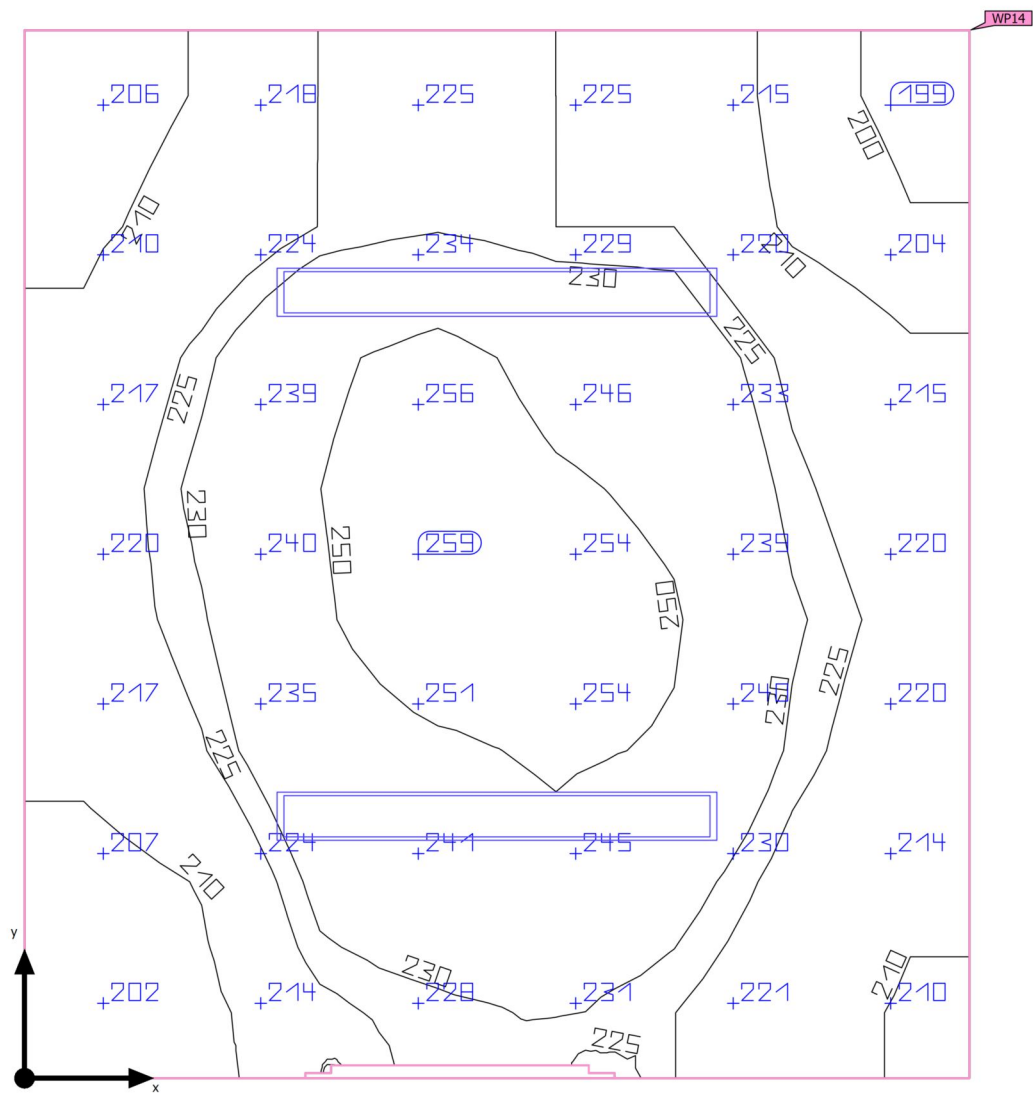

Ground area	8.39 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	227 lx	$\geq 500 \text{ lx}$	✗	WP14
	$U_o (g_1)$	0.87	≥ 0.60	✓	WP14
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[237 - 376] kWh/a	max. 300 kWh/a	✗	
Space	Lighting power density	18.12 W/m ²	–		
		7.97 W/m ² /100 lx	–		

(1) Based on a rectangular space of 3.050 m x 2.750 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 209 TOILET

Luminaire layout plan

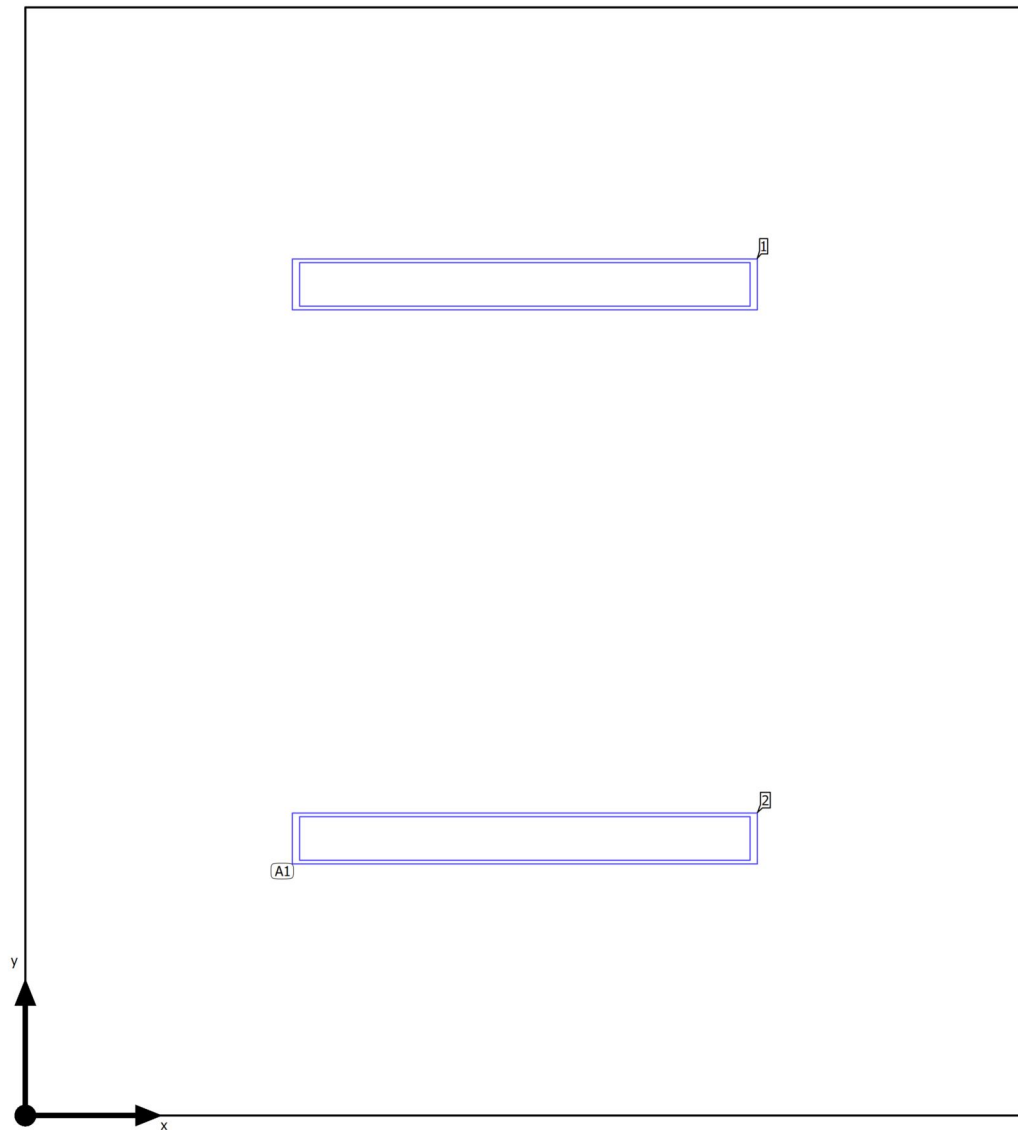

Building B · FIRST FOOR · 209 TOILET

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

2 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.375 m / 0.763 m / 3.300 m	1.375 m	2.287 m	3.300 m	1
X-direction	1 pcs., Centre - centre, 2.750 m	1.375 m	0.763 m	3.300 m	2
Y-direction	2 pcs., Centre - centre, 1.525 m				
Arrangement	A1				

Building B · FIRST FOOR · 209 TOILET


Luminaire list

Φ_{total} 9326 lm	P_{total} 152.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
2	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Calculation objects

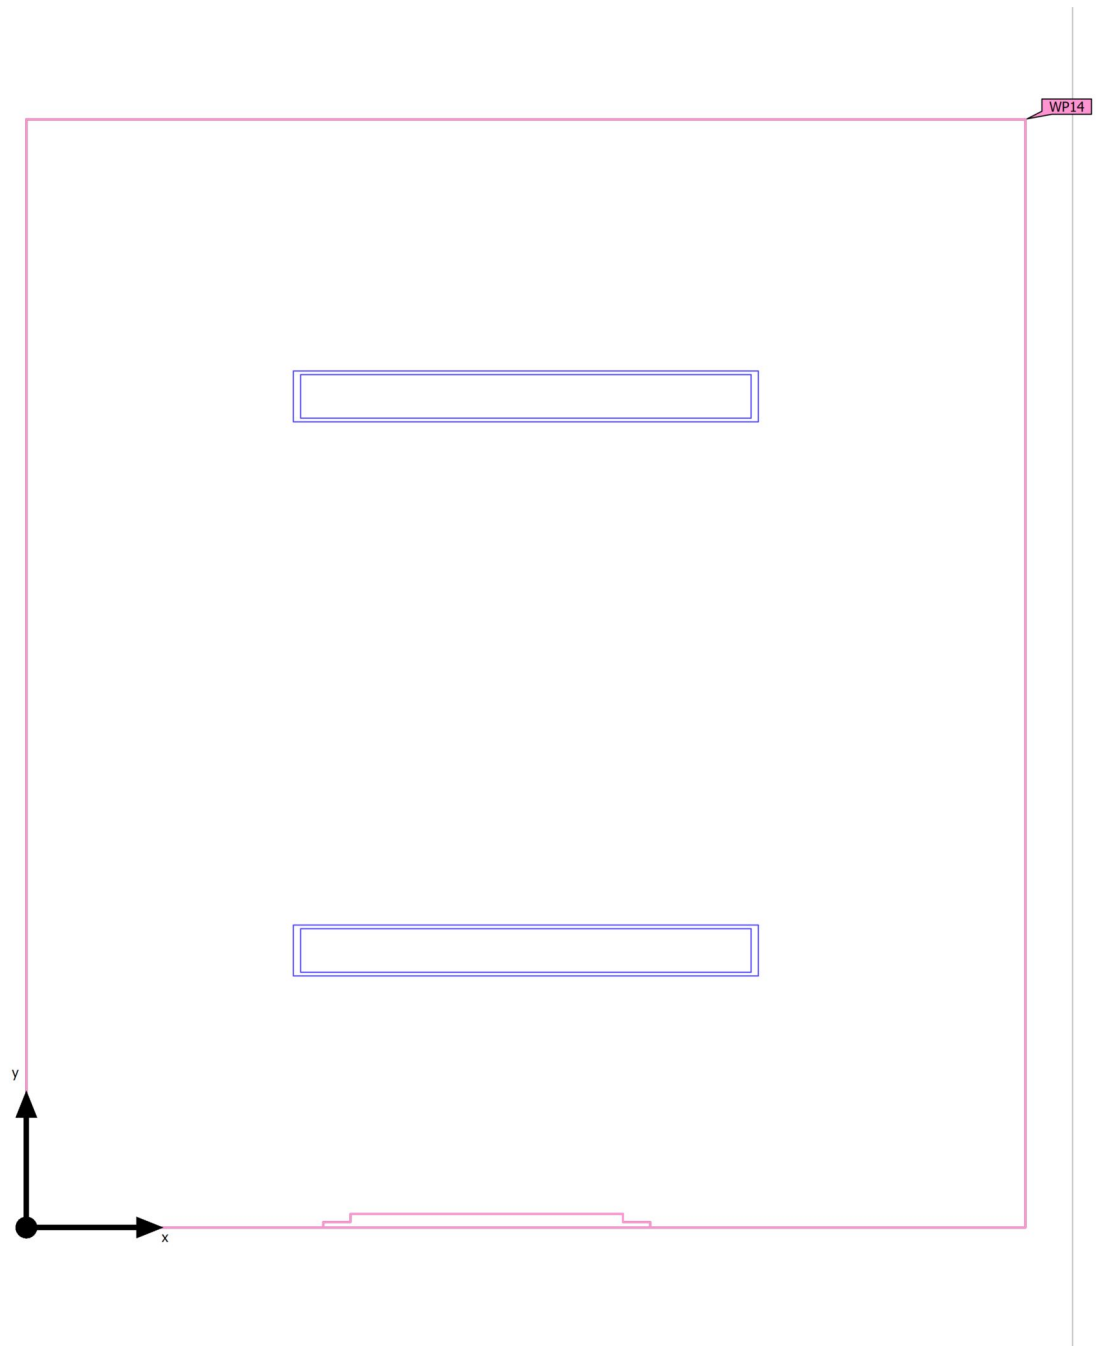

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (209 TOILET)	227 lx	197 lx	258 lx	0.87	0.76	WP14
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Working plane (209 TOILET)

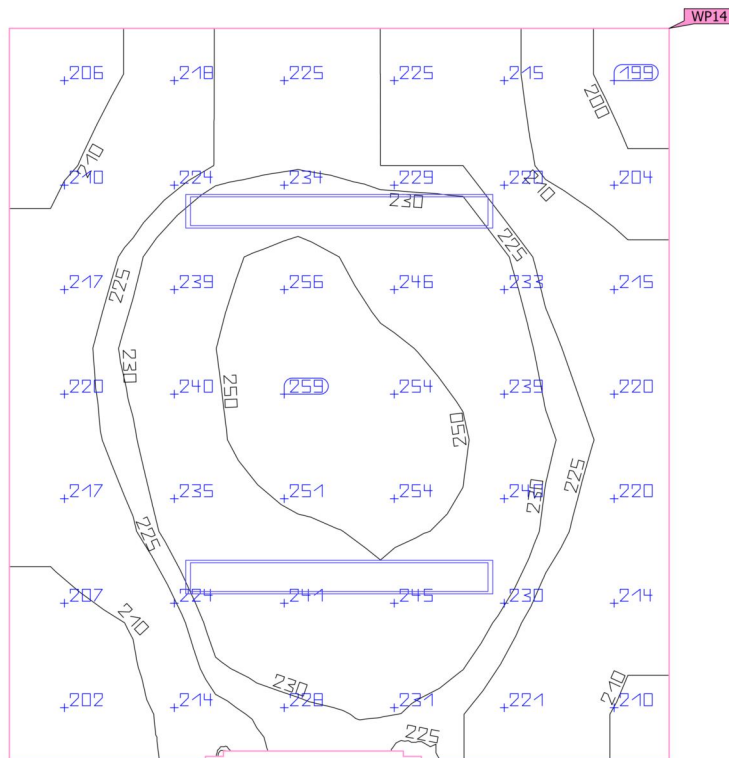


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (209 TOILET)	227 lx	197 lx	258 lx	0.87	0.76	WP14
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Summary

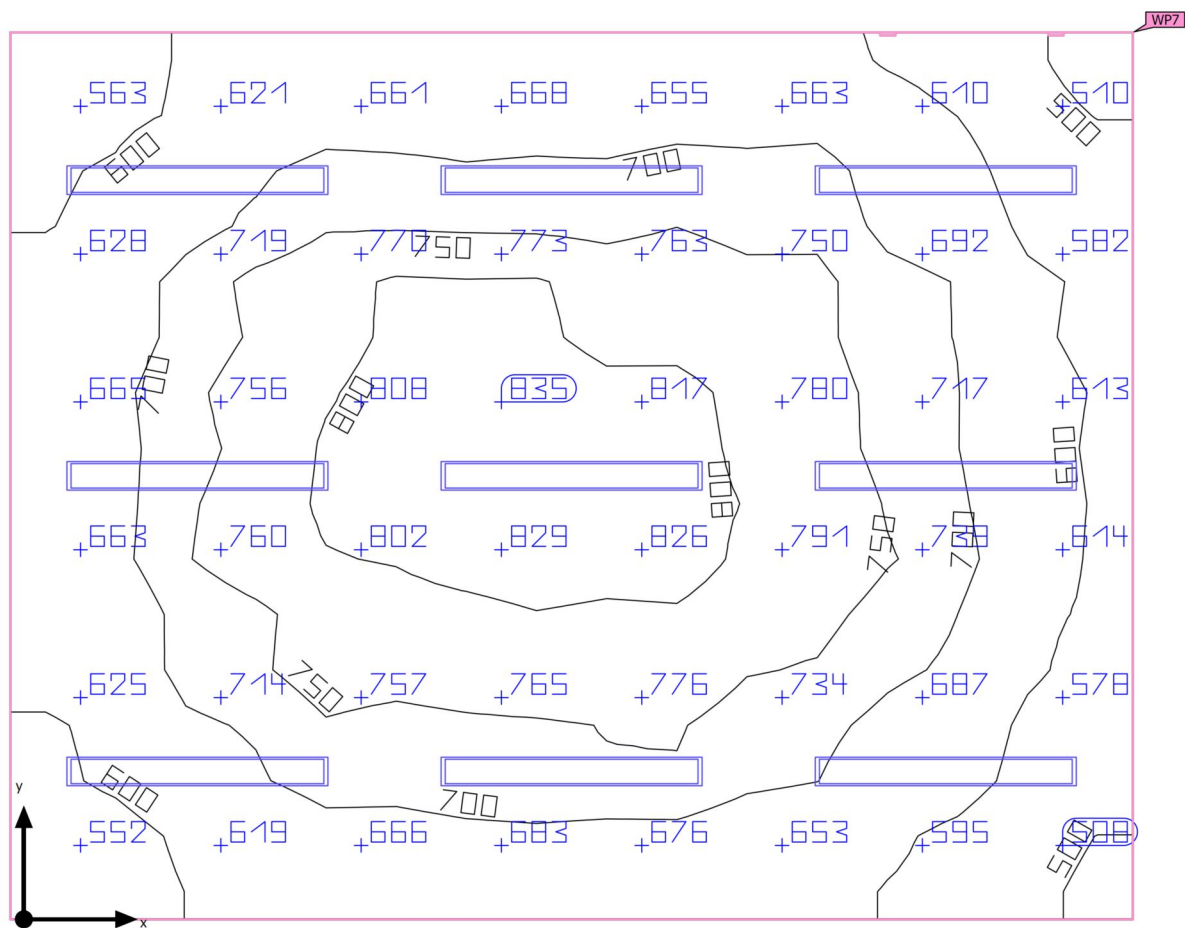

Ground area	23.95 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.800 m
Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	693 lx	$\geq 300 \text{ lx}$	✓	WP7
	$U_o (g_1)$	0.67	≥ 0.40	✓	WP7
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	92.3 kWh/a	max. 850 kWh/a	✓	
Space	Lighting power density	28.56 W/m ²	–		
		4.12 W/m ² /100 lx	–		

(1) Based on a rectangular space of 5.505 m x 4.350 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: Offices (34.1 Filing, copying, etc.)


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
9	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 210 OFFICE

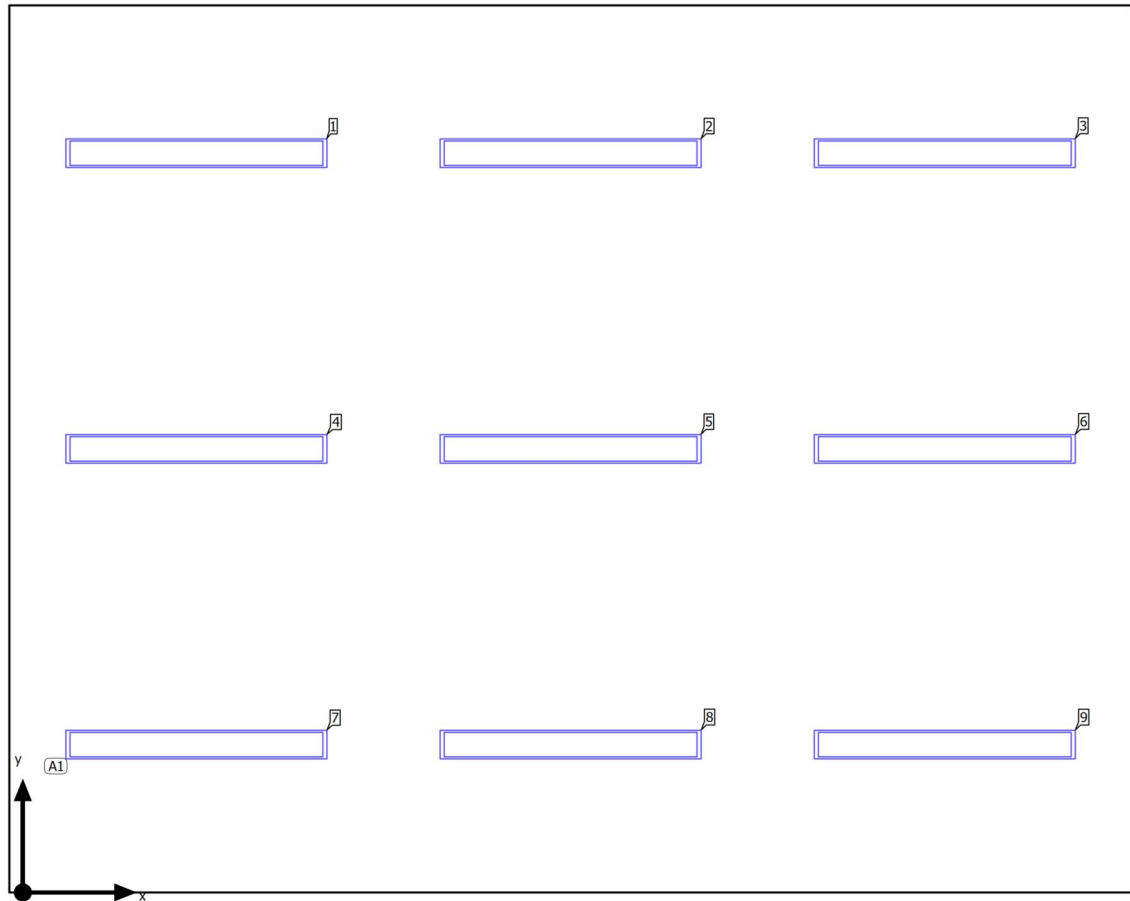Luminaire layout plan

Building B · FIRST FOOR · 210 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

9 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.851 m / 0.725 m / 3.300 m	0.851 m	3.625 m	3.300 m	1
X-direction	3 pcs., Centre - centre, 1.835 m	2.686 m	3.625 m	3.300 m	2
		4.521 m	3.625 m	3.300 m	3
Y-direction	3 pcs., Centre - centre, 1.450 m	0.851 m	2.175 m	3.300 m	4
		2.686 m	2.175 m	3.300 m	5
		4.521 m	2.175 m	3.300 m	6
		0.851 m	0.725 m	3.300 m	7
		2.686 m	0.725 m	3.300 m	8
		4.521 m	0.725 m	3.300 m	9

Building B · FIRST FOOR · 210 OFFICE

Luminaire list Φ_{total}

41967 lm

 P_{total}

684.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
9	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Calculation objects

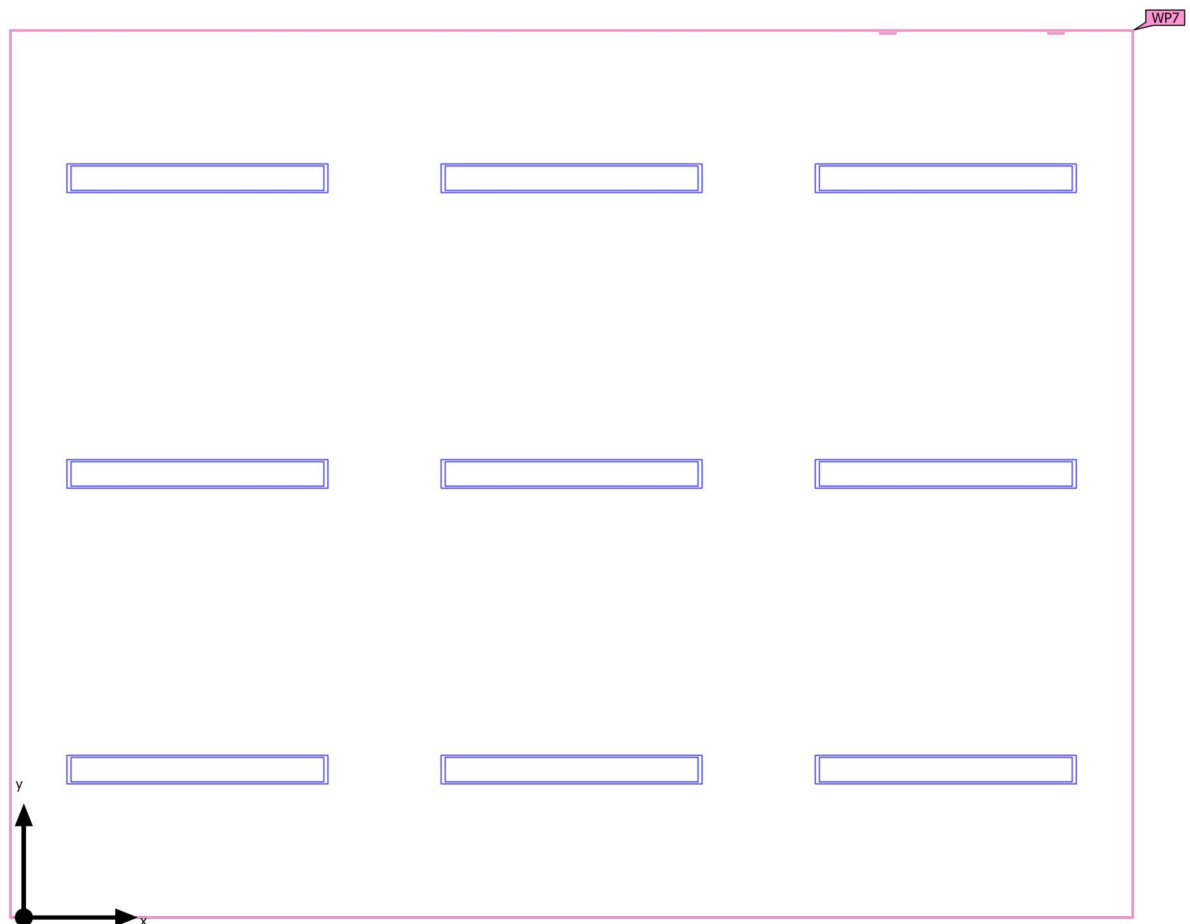

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (210 OFFICE) Perpendicular illuminance (adaptive) Height: 0.800 m, Wall zone: 0.000 m	693 lx (≥ 300 lx) ✓	464 lx	836 lx	0.67 (≥ 0.40) ✓	0.56	WP7

Utilisation profile: Offices (34.1 Filing, copying, etc.)

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Working plane (210 OFFICE)

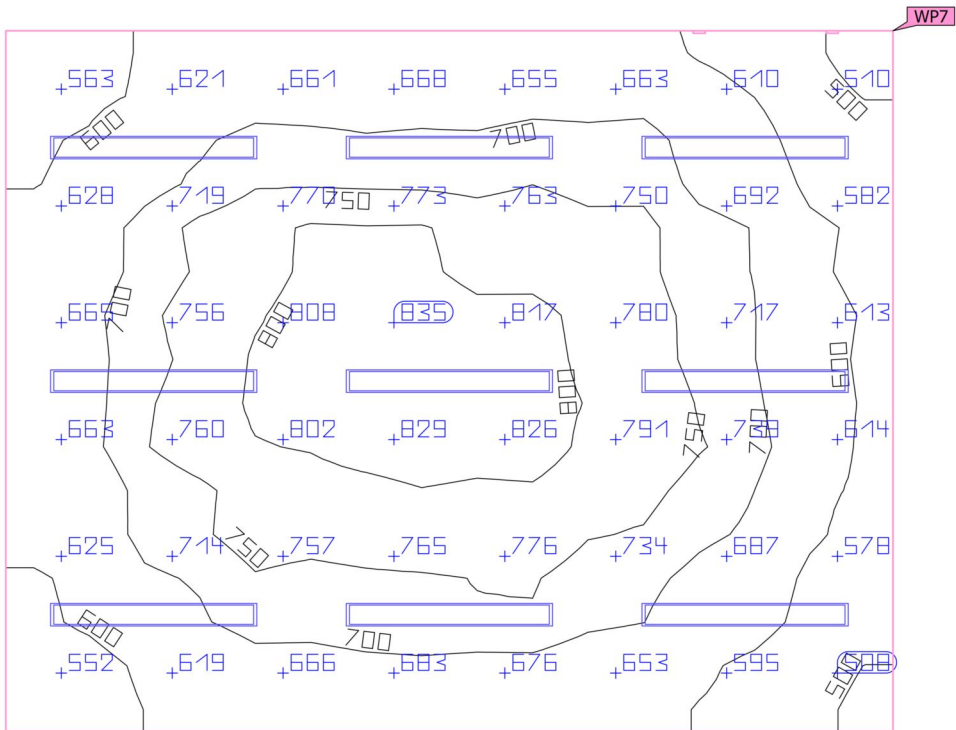


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (210 OFFICE) Perpendicular illuminance (adaptive) Height: 0.800 m, Wall zone: 0.000 m	693 lx (≥ 300 lx) ✓	464 lx	836 lx	0.67 (≥ 0.40) ✓	0.56	WP7

Utilisation profile: Offices (34.1 Filing, copying, etc.)

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Summary

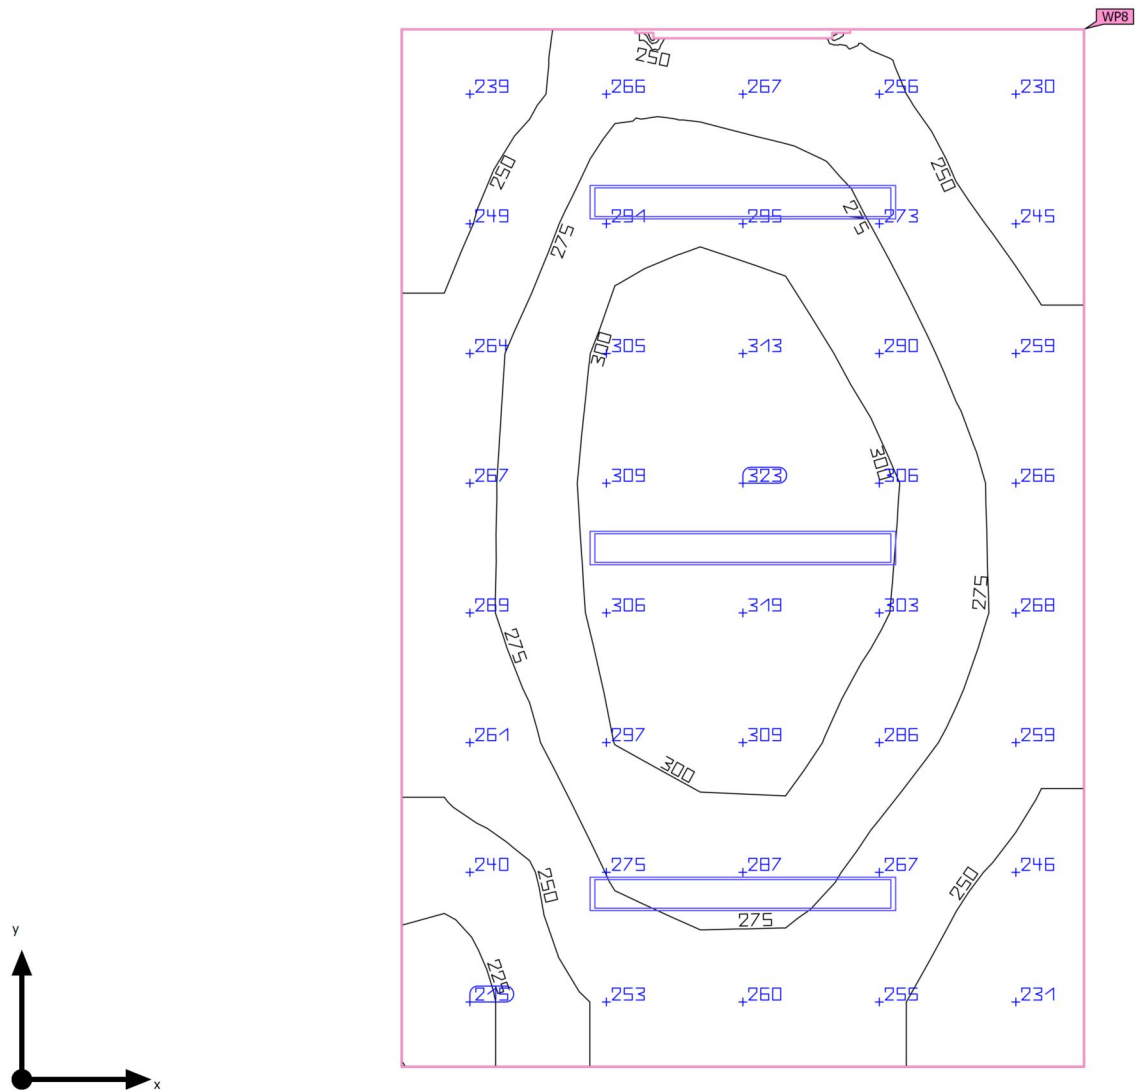

Ground area	12.43 m²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.000 m
		Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	273 lx	$\geq 500 \text{ lx}$	✗	WP8
	$U_o (g_1)$	0.66	≥ 0.60	✓	WP8
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[356 - 564] kWh/a	max. 450 kWh/a	✗	
Space	Lighting power density	18.35 W/m ²	–		
		6.73 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.347 m x 2.859 m and SHR of 0.25.



(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
3	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 211 TOILET

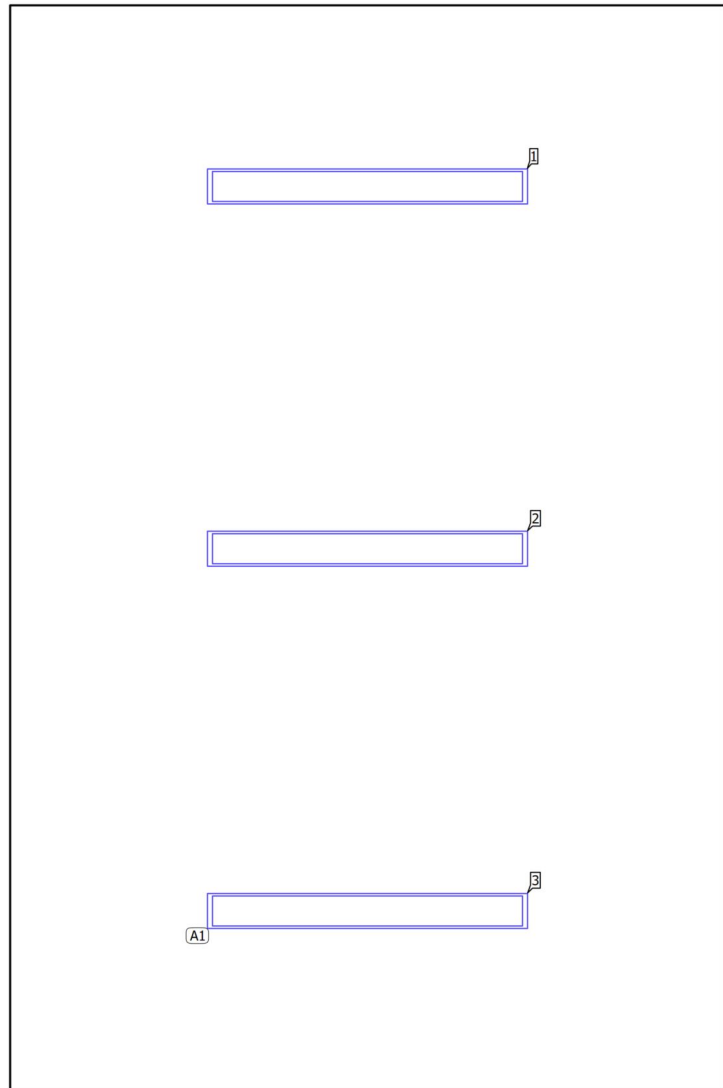Luminaire layout plan

Building B · FIRST FOOR · 211 TOILET

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

3 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	3.021 m / 0.777 m / 3.300 m	3.021 m	3.675 m	3.300 m	1
X-direction	1 pcs., Centre - centre, 2.859 m	3.021 m	2.226 m	3.300 m	2
Y-direction	3 pcs., Centre - centre, 1.449 m	3.021 m	0.777 m	3.300 m	3
Arrangement	A1				

Building B · FIRST FOOR · 211 TOILET



Luminaire list

Φ_{total} 13989 lm	P_{total} 228.0 W	Luminous efficacy 61.4 lm/W
-----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
3	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Calculation objects

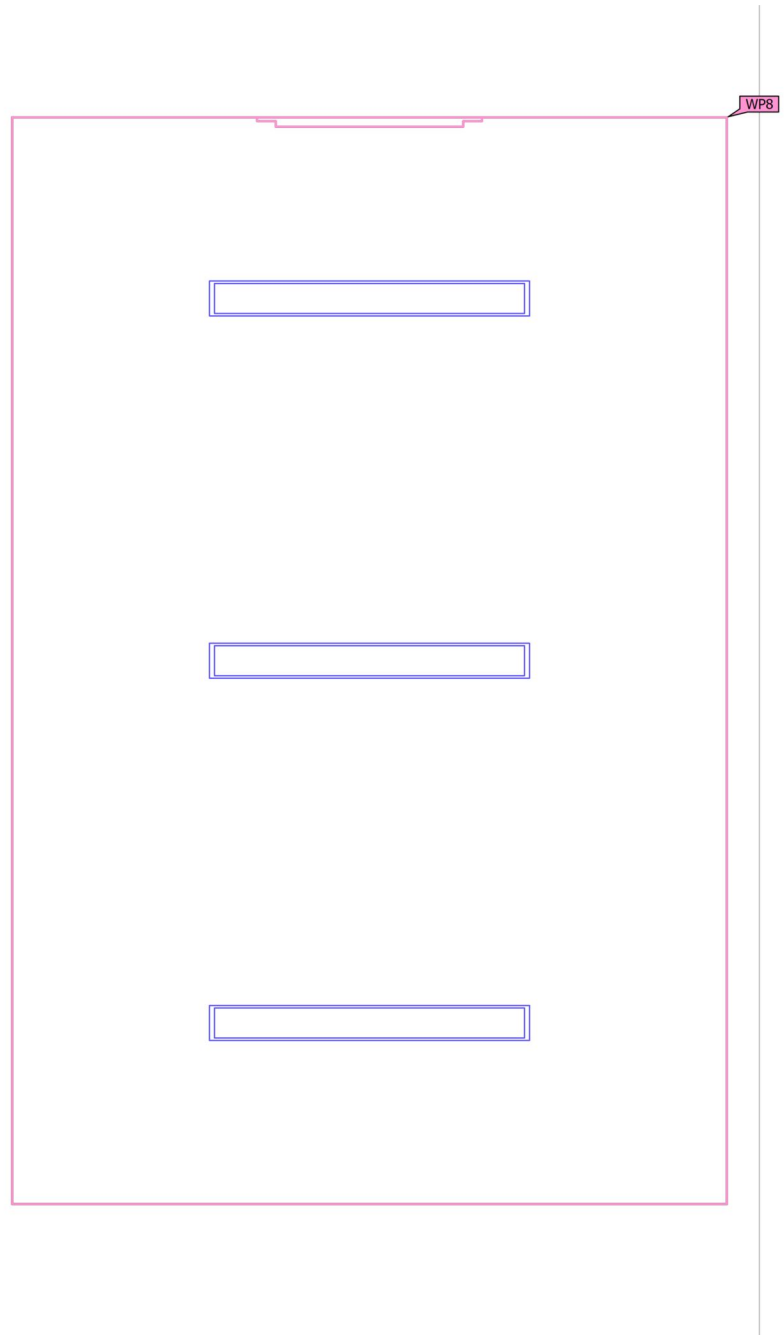

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (211 TOILET)	273 lx	179 lx	322 lx	0.66	0.56	WP8
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Working plane (211 TOILET)

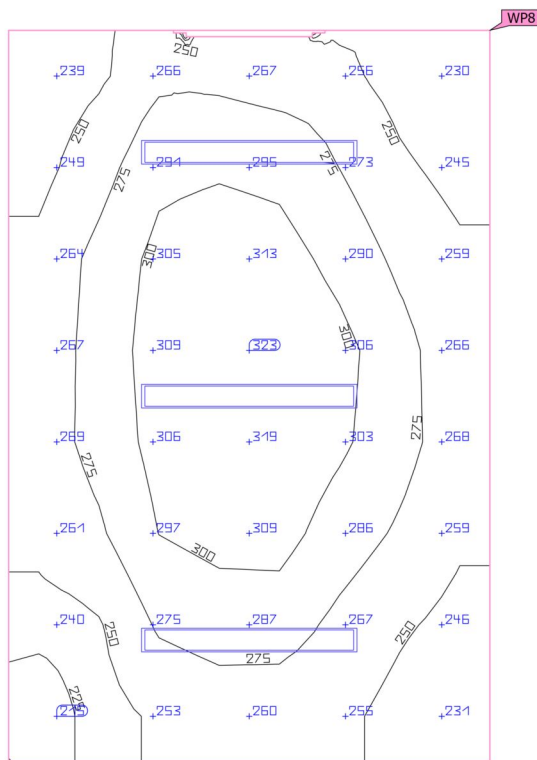


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (211 TOILET)	273 lx	179 lx	322 lx	0.66	0.56	WP8
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Summary

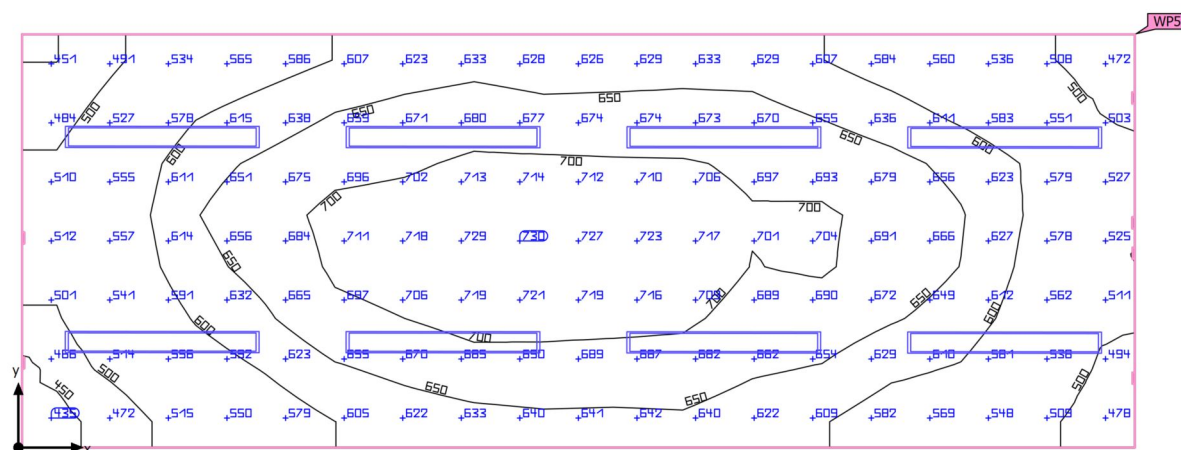

Ground area	20.07 m ²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	622 lx	≥ 500 lx	✓	WP5
	$U_o (g_1)$	0.70	≥ 0.60	✓	WP5
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	25	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	1505 kWh/a	max. 750 kWh/a	✗	
Space	Lighting power density	30.30 W/m ²	–		
		4.87 W/m ² /100 lx	–		

(1) Based on a rectangular space of 7.350 m x 2.730 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
8	Philips		2x36W	25	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 212 OFFICE

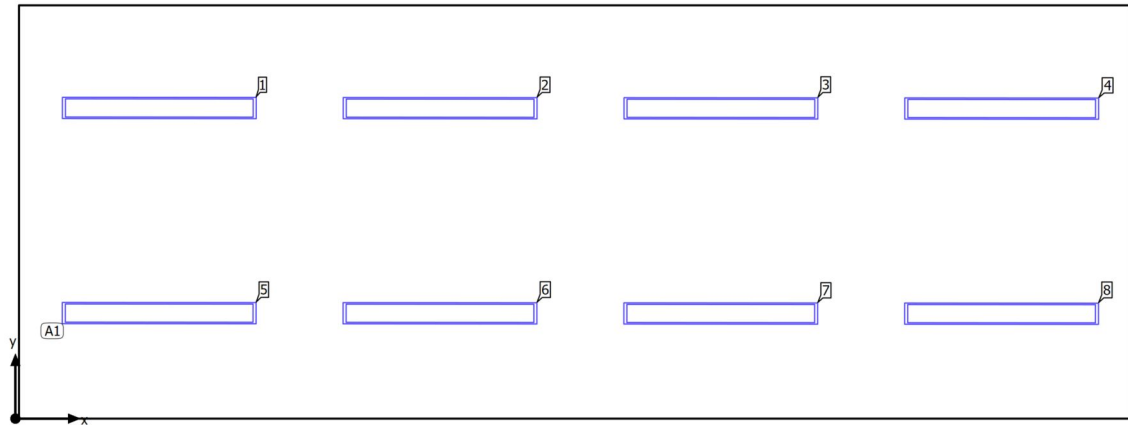Luminaire layout plan

Building B · FIRST FOOR · 212 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

8 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.950 m / 0.697 m / 3.300 m	0.951 m	2.052 m	3.300 m	1
X-direction	4 pcs., Centre - centre, 1.855 m	2.805 m	2.051 m	3.300 m	2
		4.660 m	2.049 m	3.300 m	3
Y-direction	2 pcs., Centre - centre, 1.355 m	6.514 m	2.048 m	3.300 m	4
Arrangement	A1	0.950 m	0.697 m	3.300 m	5
		2.804 m	0.696 m	3.300 m	6
		4.659 m	0.694 m	3.300 m	7
		6.513 m	0.693 m	3.300 m	8

Building B · FIRST FOOR · 212 OFFICE

Luminaire list Φ_{total}

37304 lm

 P_{total}

608.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
8	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Calculation objects

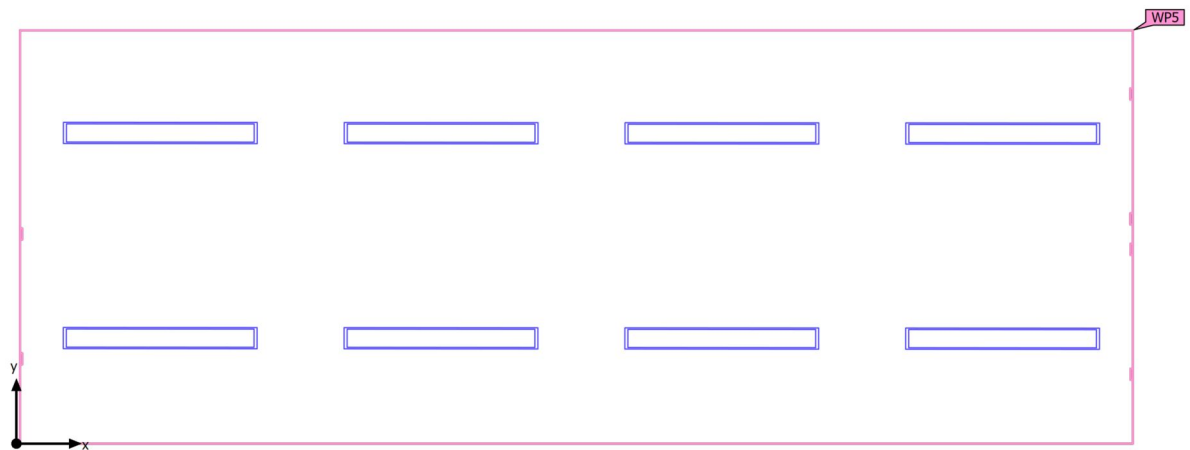

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (212 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	622 lx (≥ 500 lx) ✓	434 lx	731 lx	0.70 (≥ 0.60) ✓	0.59	WP5

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

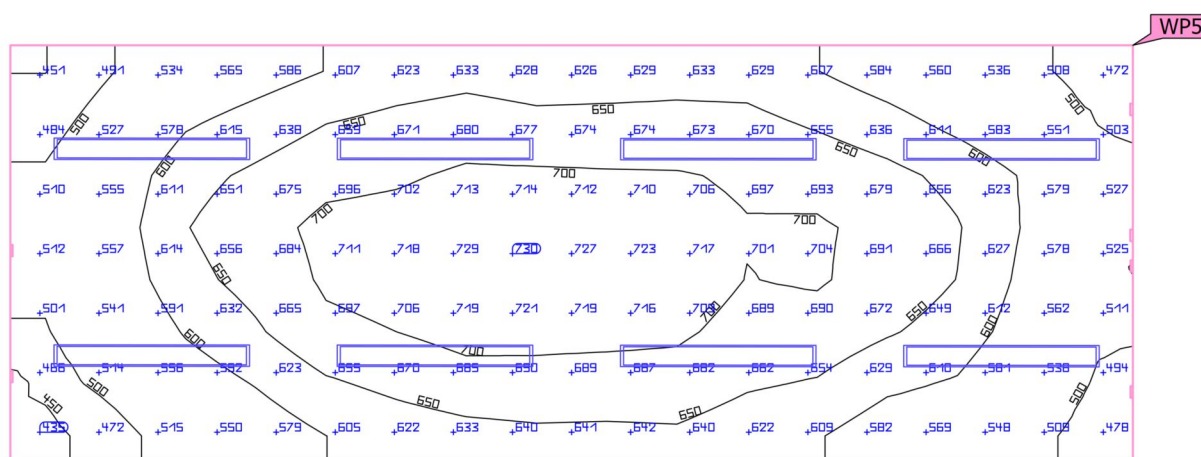
Working plane (212 OFFICE)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (212 OFFICE)	622 lx	434 lx	731 lx	0.70	0.59	WP5
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✓			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212A DB (Light scene 1)

Summary

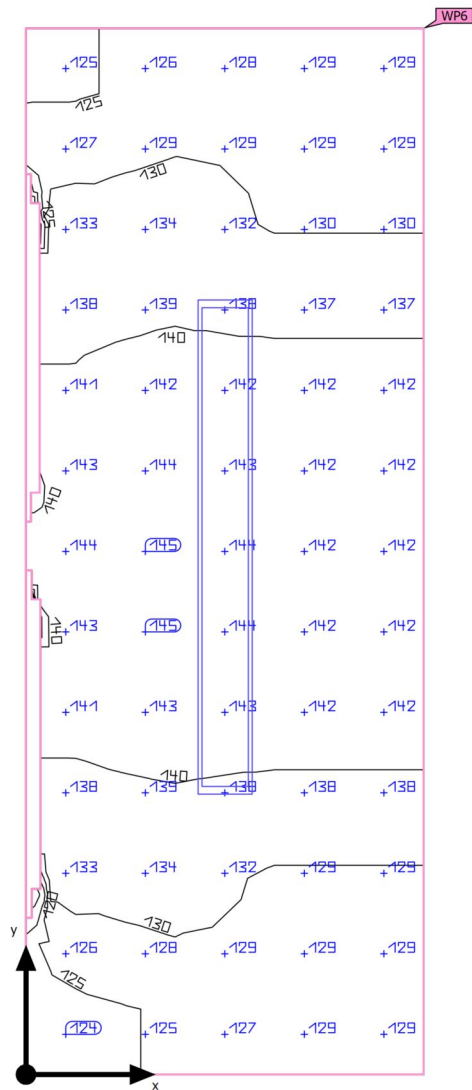

Ground area	2.79 m ²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	3.300 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.000 m
		Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 212A DB (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	136 lx	$\geq 500 \text{ lx}$	✗	WP6
	$U_o (g_1)$	0.76	≥ 0.60	✓	WP6
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 100 kWh/a	✗	
Space	Lighting power density	27.23 W/m ²	–		
		20.09 W/m ² /100 lx	–		

(1) Based on a rectangular space of 1.030 m x 2.710 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 212A DB

Luminaire layout plan

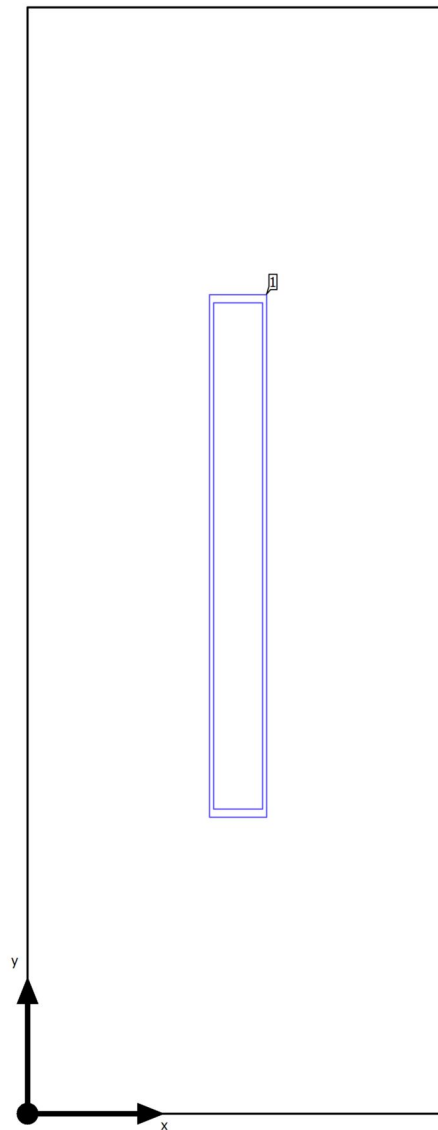

Building B · FIRST FOOR · 212A DB

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
0.516 m	1.366 m	3.300 m	1

Building B · FIRST FOOR · 212A DB


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 212A DB (Light scene 1)

Calculation objects

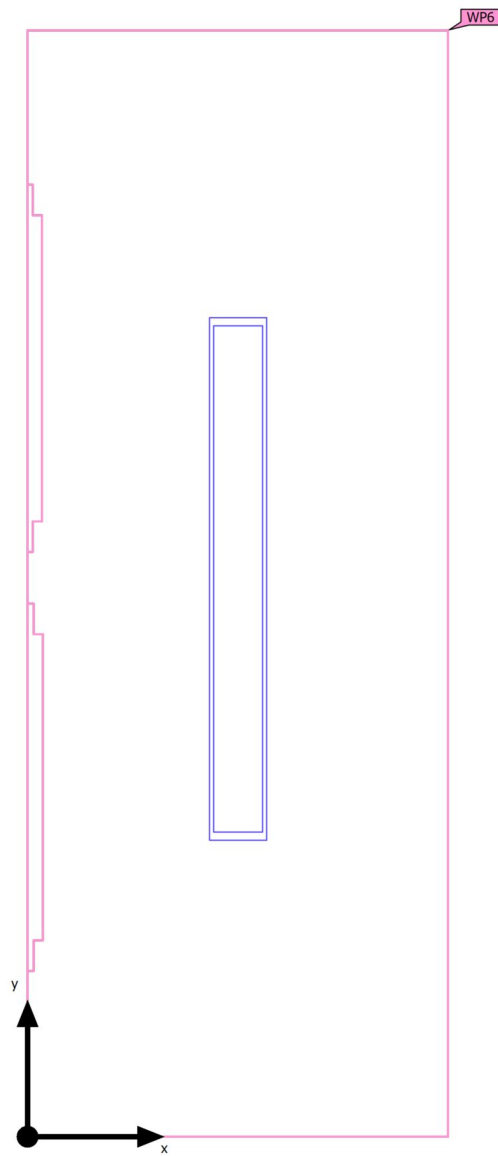

Building B · FIRST FOOR · 212A DB (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (212A DB)	136 lx	104 lx	145 lx	0.76	0.72	WP6
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212A DB (Light scene 1)

Working plane (212A DB)

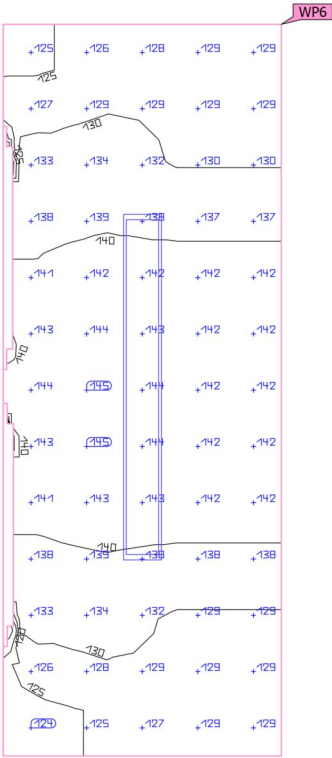


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (212A DB) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	136 lx (≥ 500 lx) ✗	104 lx	145 lx	0.76 (≥ 0.60) ✓	0.72	WP6

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Summary

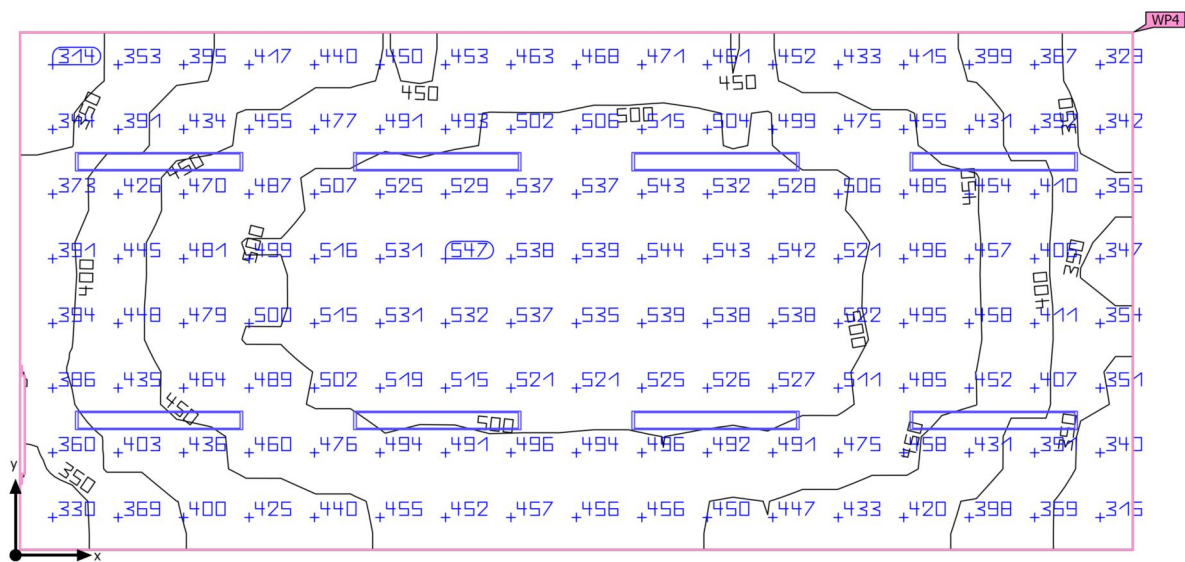

Ground area	33.71 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	458 lx	$\geq 500 \text{ lx}$	✗	WP4
	$U_o (g_1)$	0.62	≥ 0.60	✓	WP4
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	25	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[948 - 1505] kWh/a	max. 1200 kWh/a	✗	
Space	Lighting power density	18.04 W/m ²	–		
		3.94 W/m ² /100 lx	–		

(1) Based on a rectangular space of 8.516 m x 3.958 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
8	Philips		2x36W	25	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 213 CONFERENCE

Luminaire layout plan

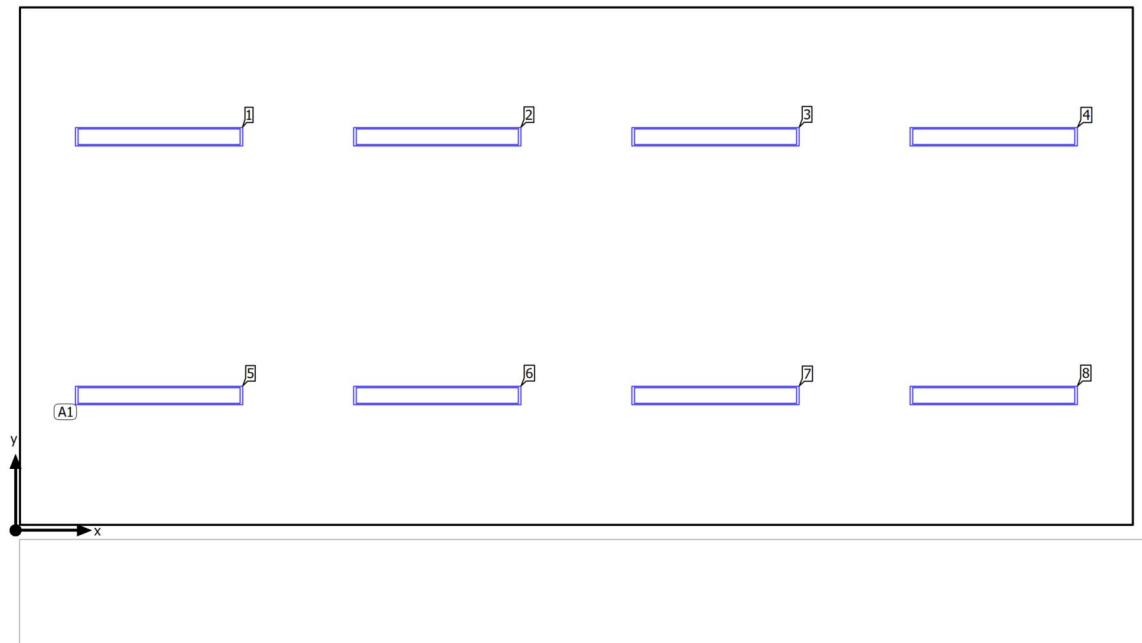

Building B · FIRST FOOR · 213 CONFERENCE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

8 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.098 m / 1.031 m / 3.300 m	1.098 m	3.010 m	3.300 m	1
X-direction	4 pcs., Centre - centre, 2.129 m	3.227 m	3.010 m	3.300 m	2
		5.356 m	3.010 m	3.300 m	3
Y-direction	2 pcs., Centre - centre, 1.979 m	7.485 m	3.010 m	3.300 m	4
Arrangement	A1	1.098 m	1.031 m	3.300 m	5
		3.227 m	1.031 m	3.300 m	6
		5.356 m	1.031 m	3.300 m	7
		7.485 m	1.031 m	3.300 m	8

Building B · FIRST FOOR · 213 CONFERENCE

Luminaire list Φ_{total}

37304 lm

 P_{total}

608.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
8	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Calculation objects

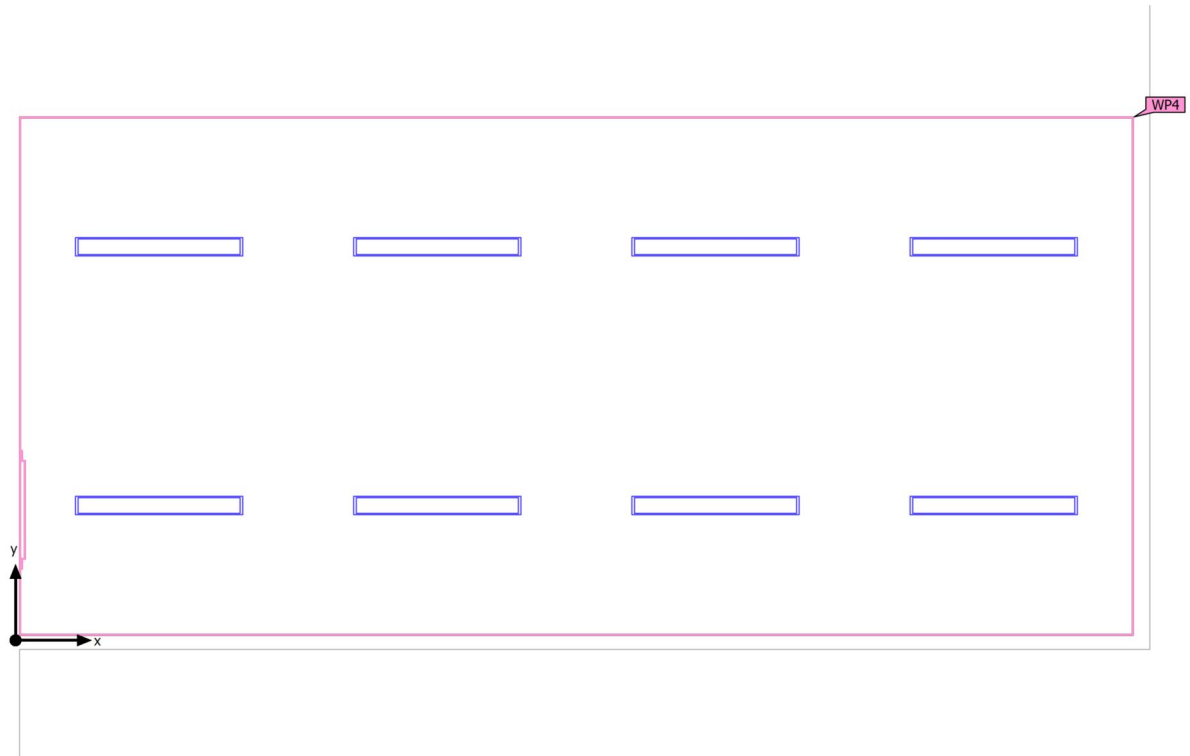

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (213 CONFERENCE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	458 lx (≥ 500 lx) ✗	286 lx	550 lx	0.62 (≥ 0.60) ✓	0.52	WP4

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Working plane (213 CONFERENCE)

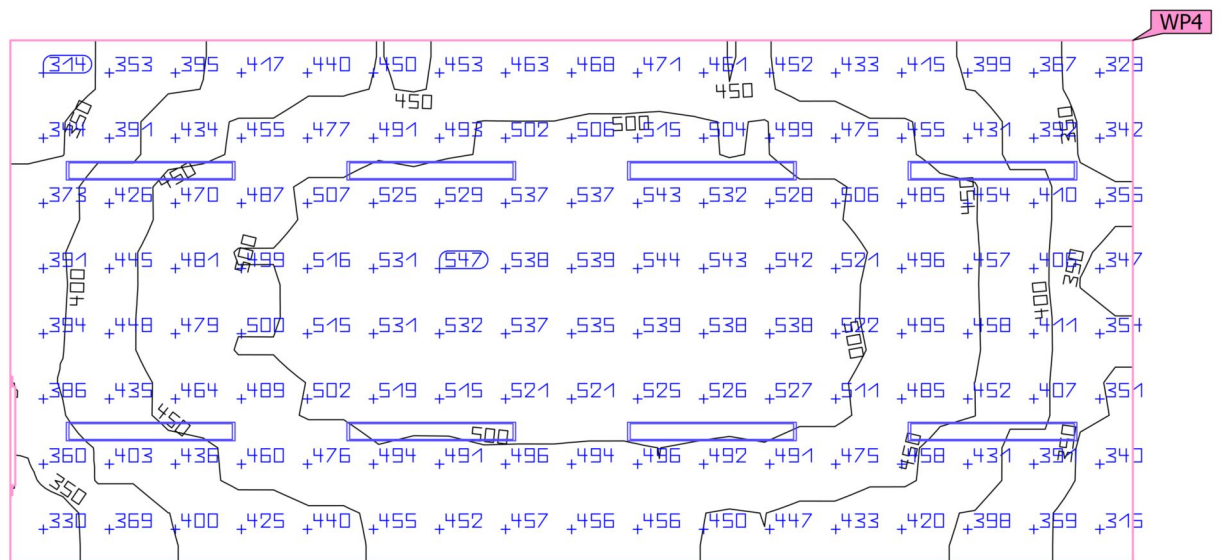


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (213 CONFERENCE)	458 lx	286 lx	550 lx	0.62	0.52	WP4
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · B201 Stairs Upper (Light scene 1)

Summary

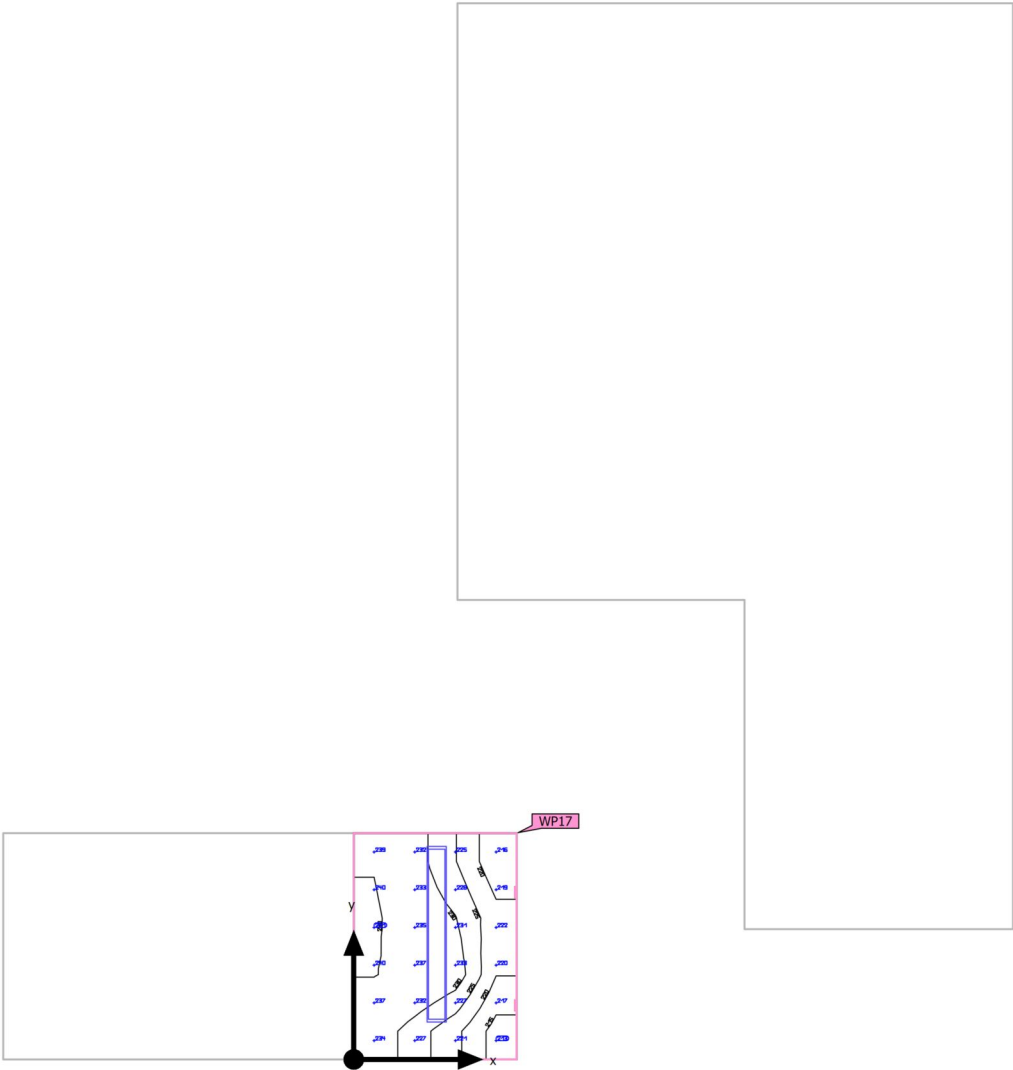

Ground area	1.96 m ²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 70.0 %	Mounting height	3.300 m
		Height _{Working plane}	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone _{Working plane}	0.000 m

Building B · FIRST FOOR · B201 Stairs Upper (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	229 lx	$\geq 500 \text{ lx}$	✗	WP17
	$U_o (g_1)$	0.93	≥ 0.60	✓	WP17
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 100 kWh/a	✗	
Space	Lighting power density	38.83 W/m ²	–		
		16.94 W/m ² /100 lx	–		

(1) Based on a rectangular space of 1.186 m x 1.650 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W


Building B · FIRST FOOR · B201 Stairs Upper

Luminaire layout plan

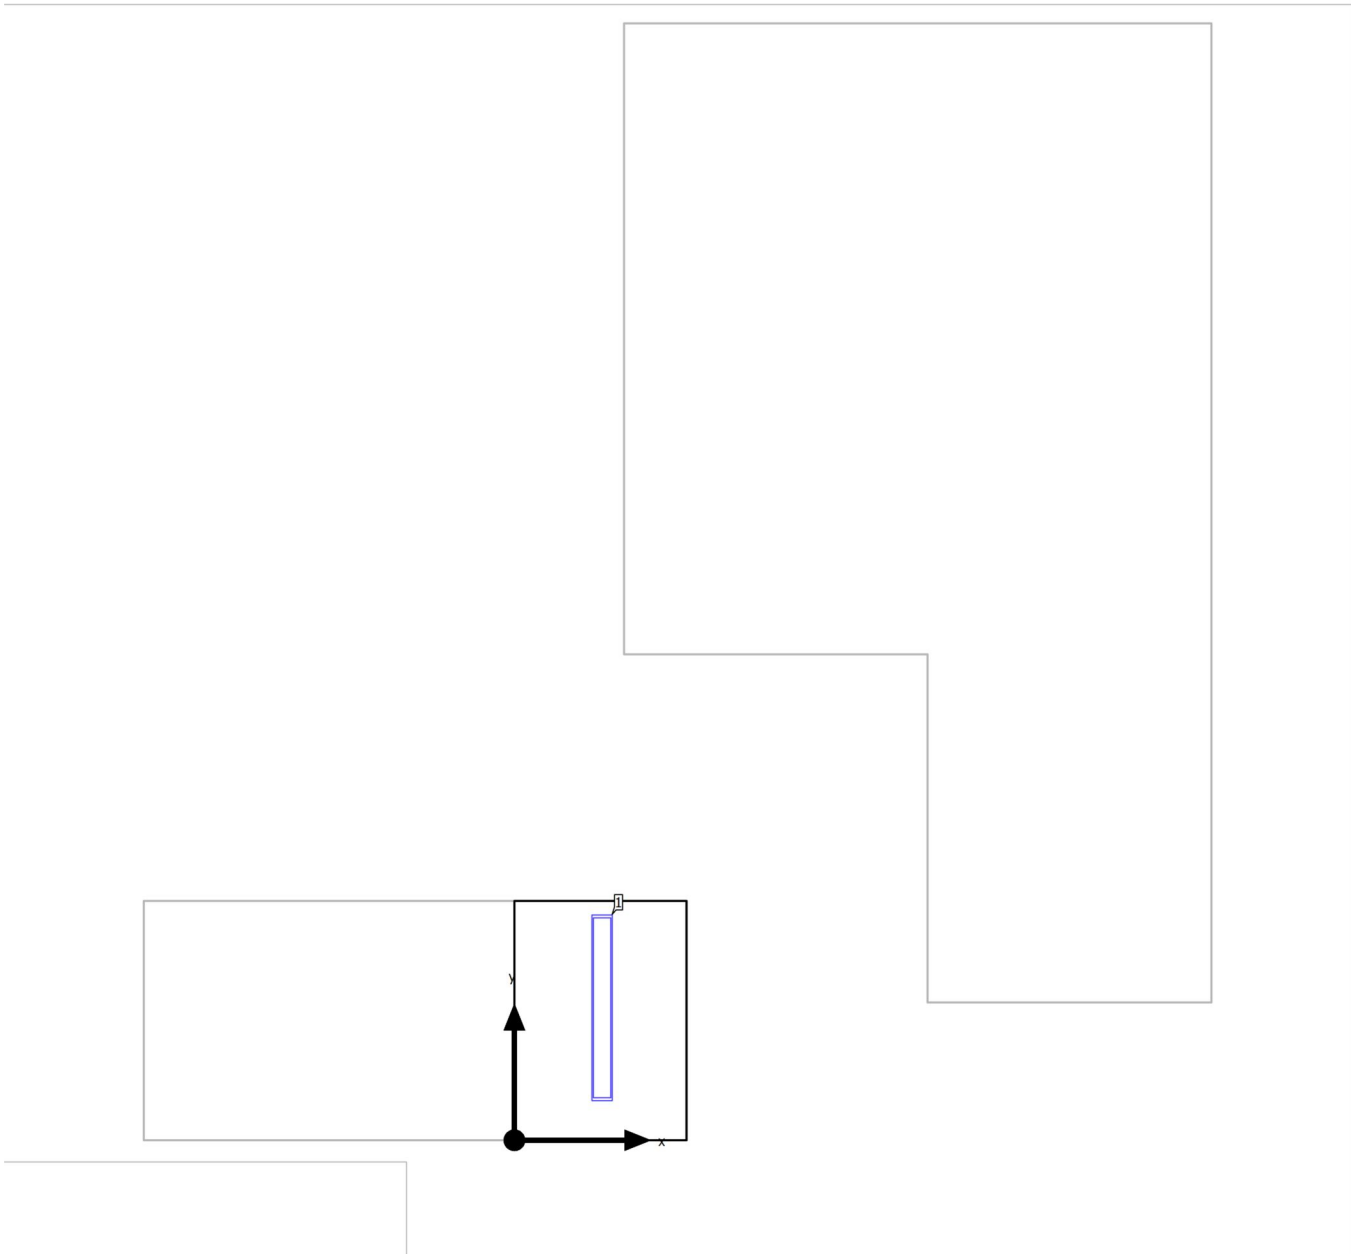

Building B · FIRST FOOR · B201 Stairs Upper

Luminaire layout plan



Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
0.605 m	0.913 m	3.300 m	1

Building B · FIRST FOOR · B201 Stairs Upper


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
---------------------------	-----------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · B201 Stairs Upper (Light scene 1)

Calculation objects

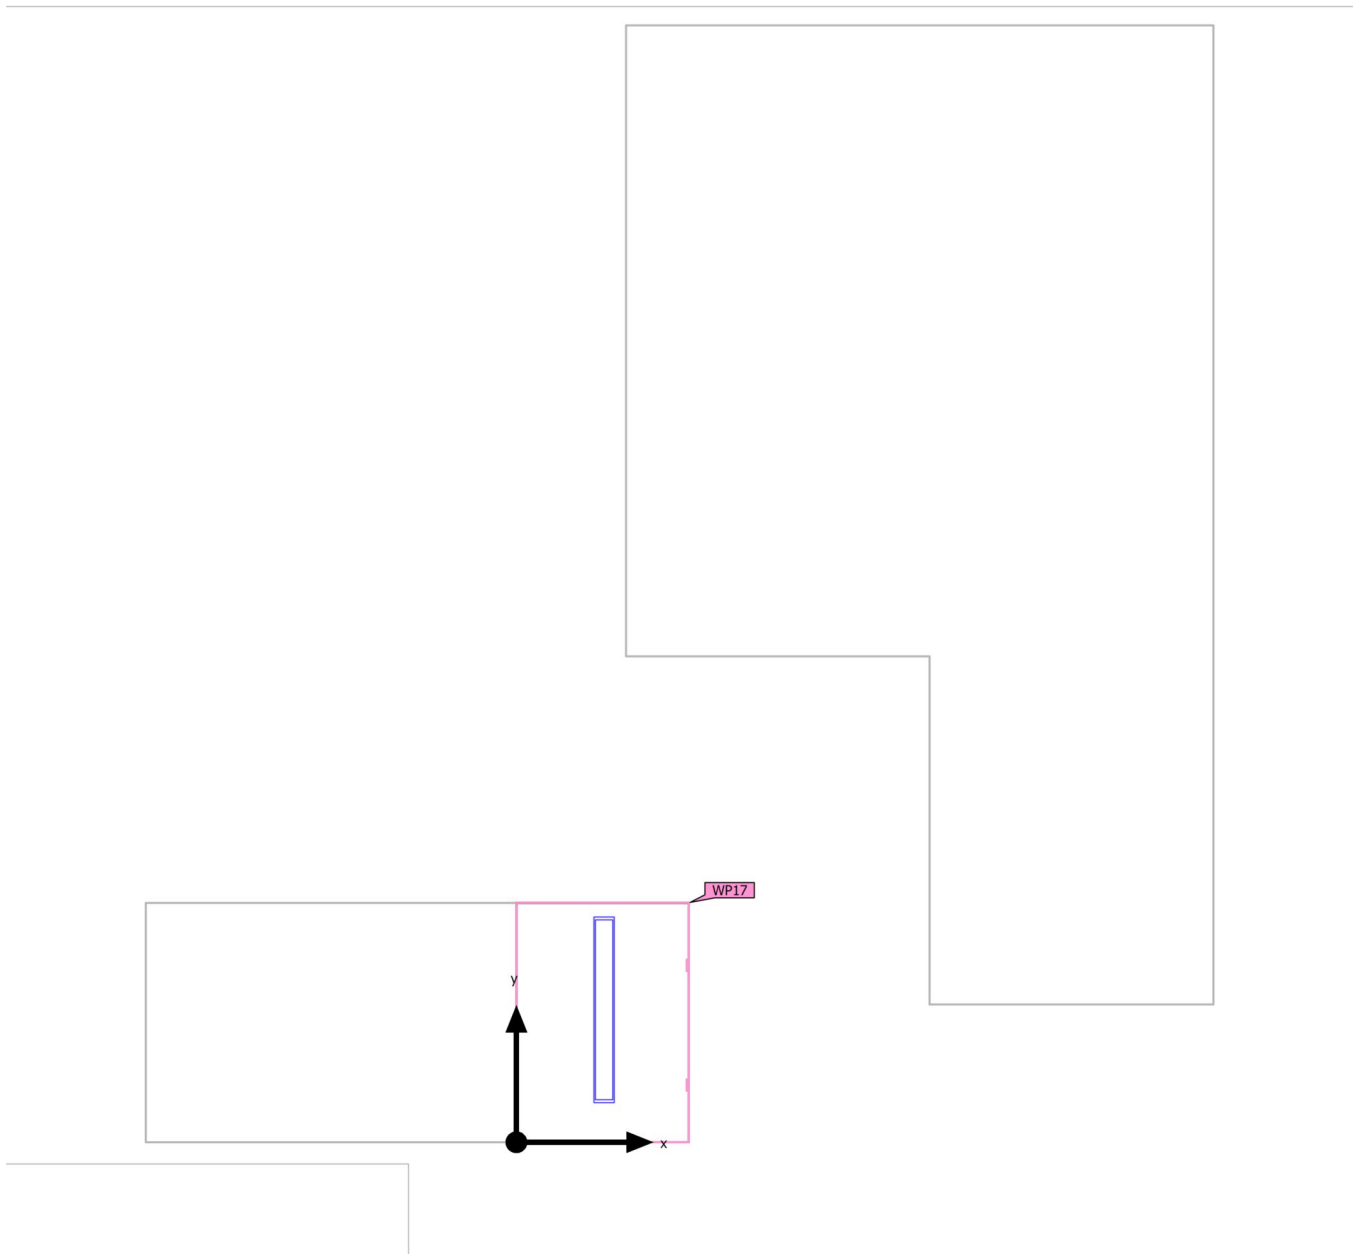

Building B · FIRST FOOR · B201 Stairs Upper (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
B201 Stairs Upper Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	229 lx (≥ 500 lx) ✗	213 lx	241 lx	0.93 (≥ 0.60) ✓	0.88	WP17

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building B · FIRST FOOR · B201 Stairs Upper (Light scene 1)

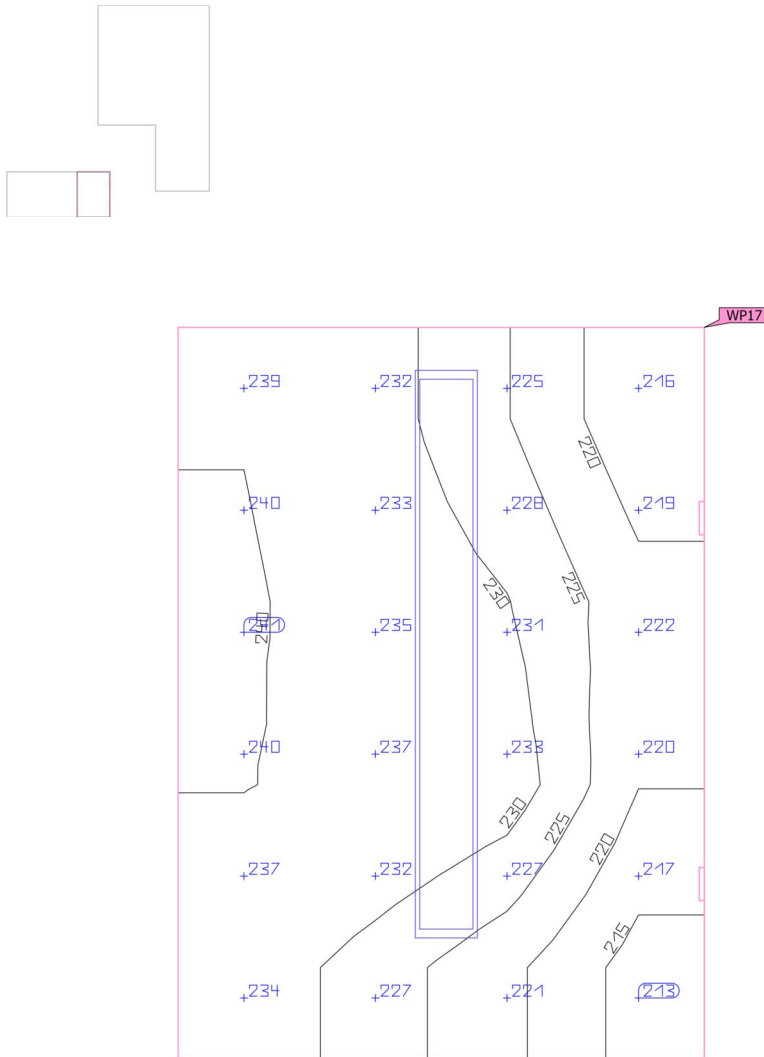B201 Stairs Upper

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
B201 Stairs Upper Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	229 lx (≥ 500 lx) ✗	213 lx	241 lx	0.93 (≥ 0.60) ✓	0.88	WP17

Utilisation profile: DIALux presetting (34.2 Standard (office))